


SCALE:
HORZ. - 1" = 20'
VERT. - 1" = 5'

INVERT ELEVATIONS			
LINE NO.	LENGTH OF PIPE	CATCH BASIN	SD MANHOLE
①	35'	4962.00	(NW) 4961.82
②	48'	4962.26	(NE) 4962.02
③	40'	4962.62	(SE) 4962.42
④	22'	4961.63	(SW) 4961.52
			(W) 4962.62

INTERSECTION 3RD ST. & VERANDA RD. N.W.

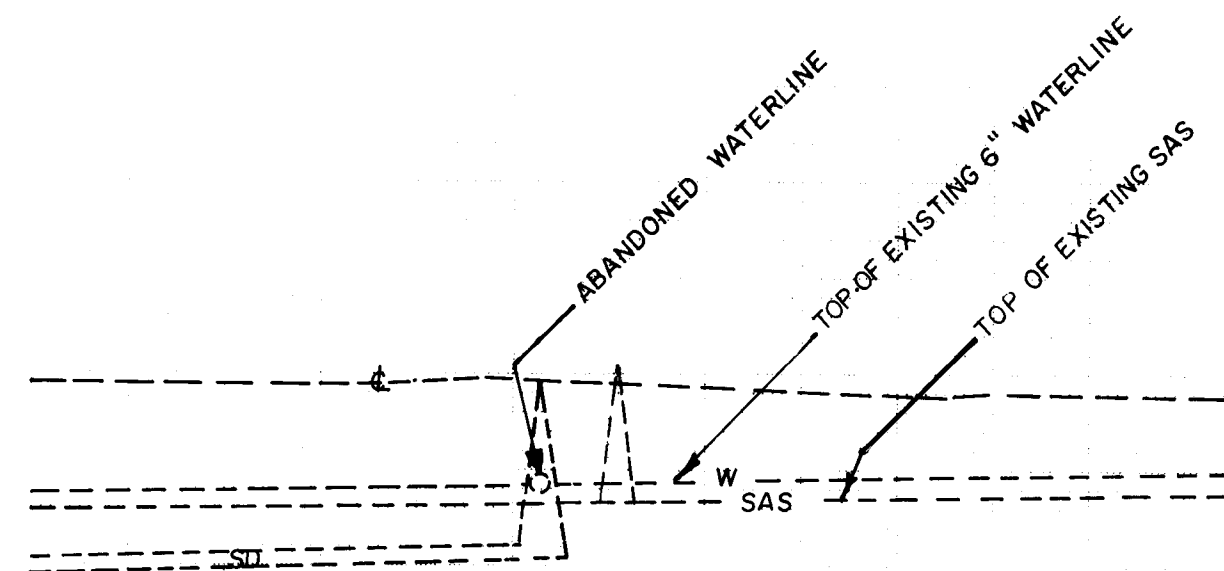

STATION 53 EXISTING MHL 4 DIA.
R/W ELEV. 64.72

10+00

11+00

LOCATION MAP	
"NOTICE TO CONTRACTORS"	
1) New Mexico Standard Specification for Public Works Construction - 1979 Edition will be referred to hereon as the "Standard Specification."	
2) All work detailed on these plans to be performed under contract shall, except as otherwise stated or provided for herein, be constructed in accordance with "Contract Documents for City-Wide Utilities and Cash Paving No. 20" and the Standard Specification."	
3) Two working days prior to any excavation, contractor must contact Line Locating Service, 765-1234, for location of existing utilities.	
4) Prior to construction, the contractor shall excavate and verify the horizontal and vertical locations of all obstructions. Should a conflict exist, the contractor shall notify the engineer or surveyor so that the conflict can be resolved with minimum amount of delay.	

THE FOLLOWING NOTES APPLY WHEN CHECKED	
<input type="checkbox"/>	All utilities and utility service lines shall be installed prior to paving.
<input checked="" type="checkbox"/>	Backfill compaction shall be according to specified street use. (SEE SCHEDULE)
<input type="checkbox"/>	Tack coat requirements shall be determined by the City Engineer.
<input type="checkbox"/>	Sidewalks and wheelchair ramps within the curb returns shall be constructed wherever a new curb return is constructed.
<input type="checkbox"/>	If curb is depressed for a driveway, the driveway shall be constructed prior to acceptance of the curb and gutter.
<input type="checkbox"/>	All storm drainage facilities shall be completed prior to final acceptance.

NOTES:	
1. REMOVE EXISTING PIPES BETWEEN STORM DRAIN MANHOLE AND CATCH BASINS AND INSTALL NEW 12" D.I.P.	
2. INVERT ELEVATIONS AT STORM DRAIN MANHOLE FOR 12" D.I.P. WILL CORRESPOND TO EXISTING INVERTS.	
3. ALL NEW CATCH BASINS WILL BE SINGLE TYPE "D".	
4. PRIOR TO INSTALLING CATCH BASINS AND PIPE, ALL UTILITY LINES IN PROPOSED AREA OF PIPE SHALL BE EXPOSED, MINOR FIELD ADJUSTMENTS MAY BE REQUIRED.	

REVISIONS	
NO.	DATE
1	26/14/50/182

CITY OF ALBUQUERQUE MUNICIPAL DEVELOPMENT DEPARTMENT ENGINEERING DIVISION	
TITLE: STORM SEWER MODIFICATION 3RD ST. NW & VERANDA RD. NW	

APPROVALS	
City Engineer	DATE
A.C.E. - Design	DATE
A.C.E. - Hydrology	DATE

APPROVED FOR CONSTRUCTION	
CITY ENGINEER	DATE
DRAWING NO. 1415	
MAP NO. G-14	
SHEET 1 OF 1	