


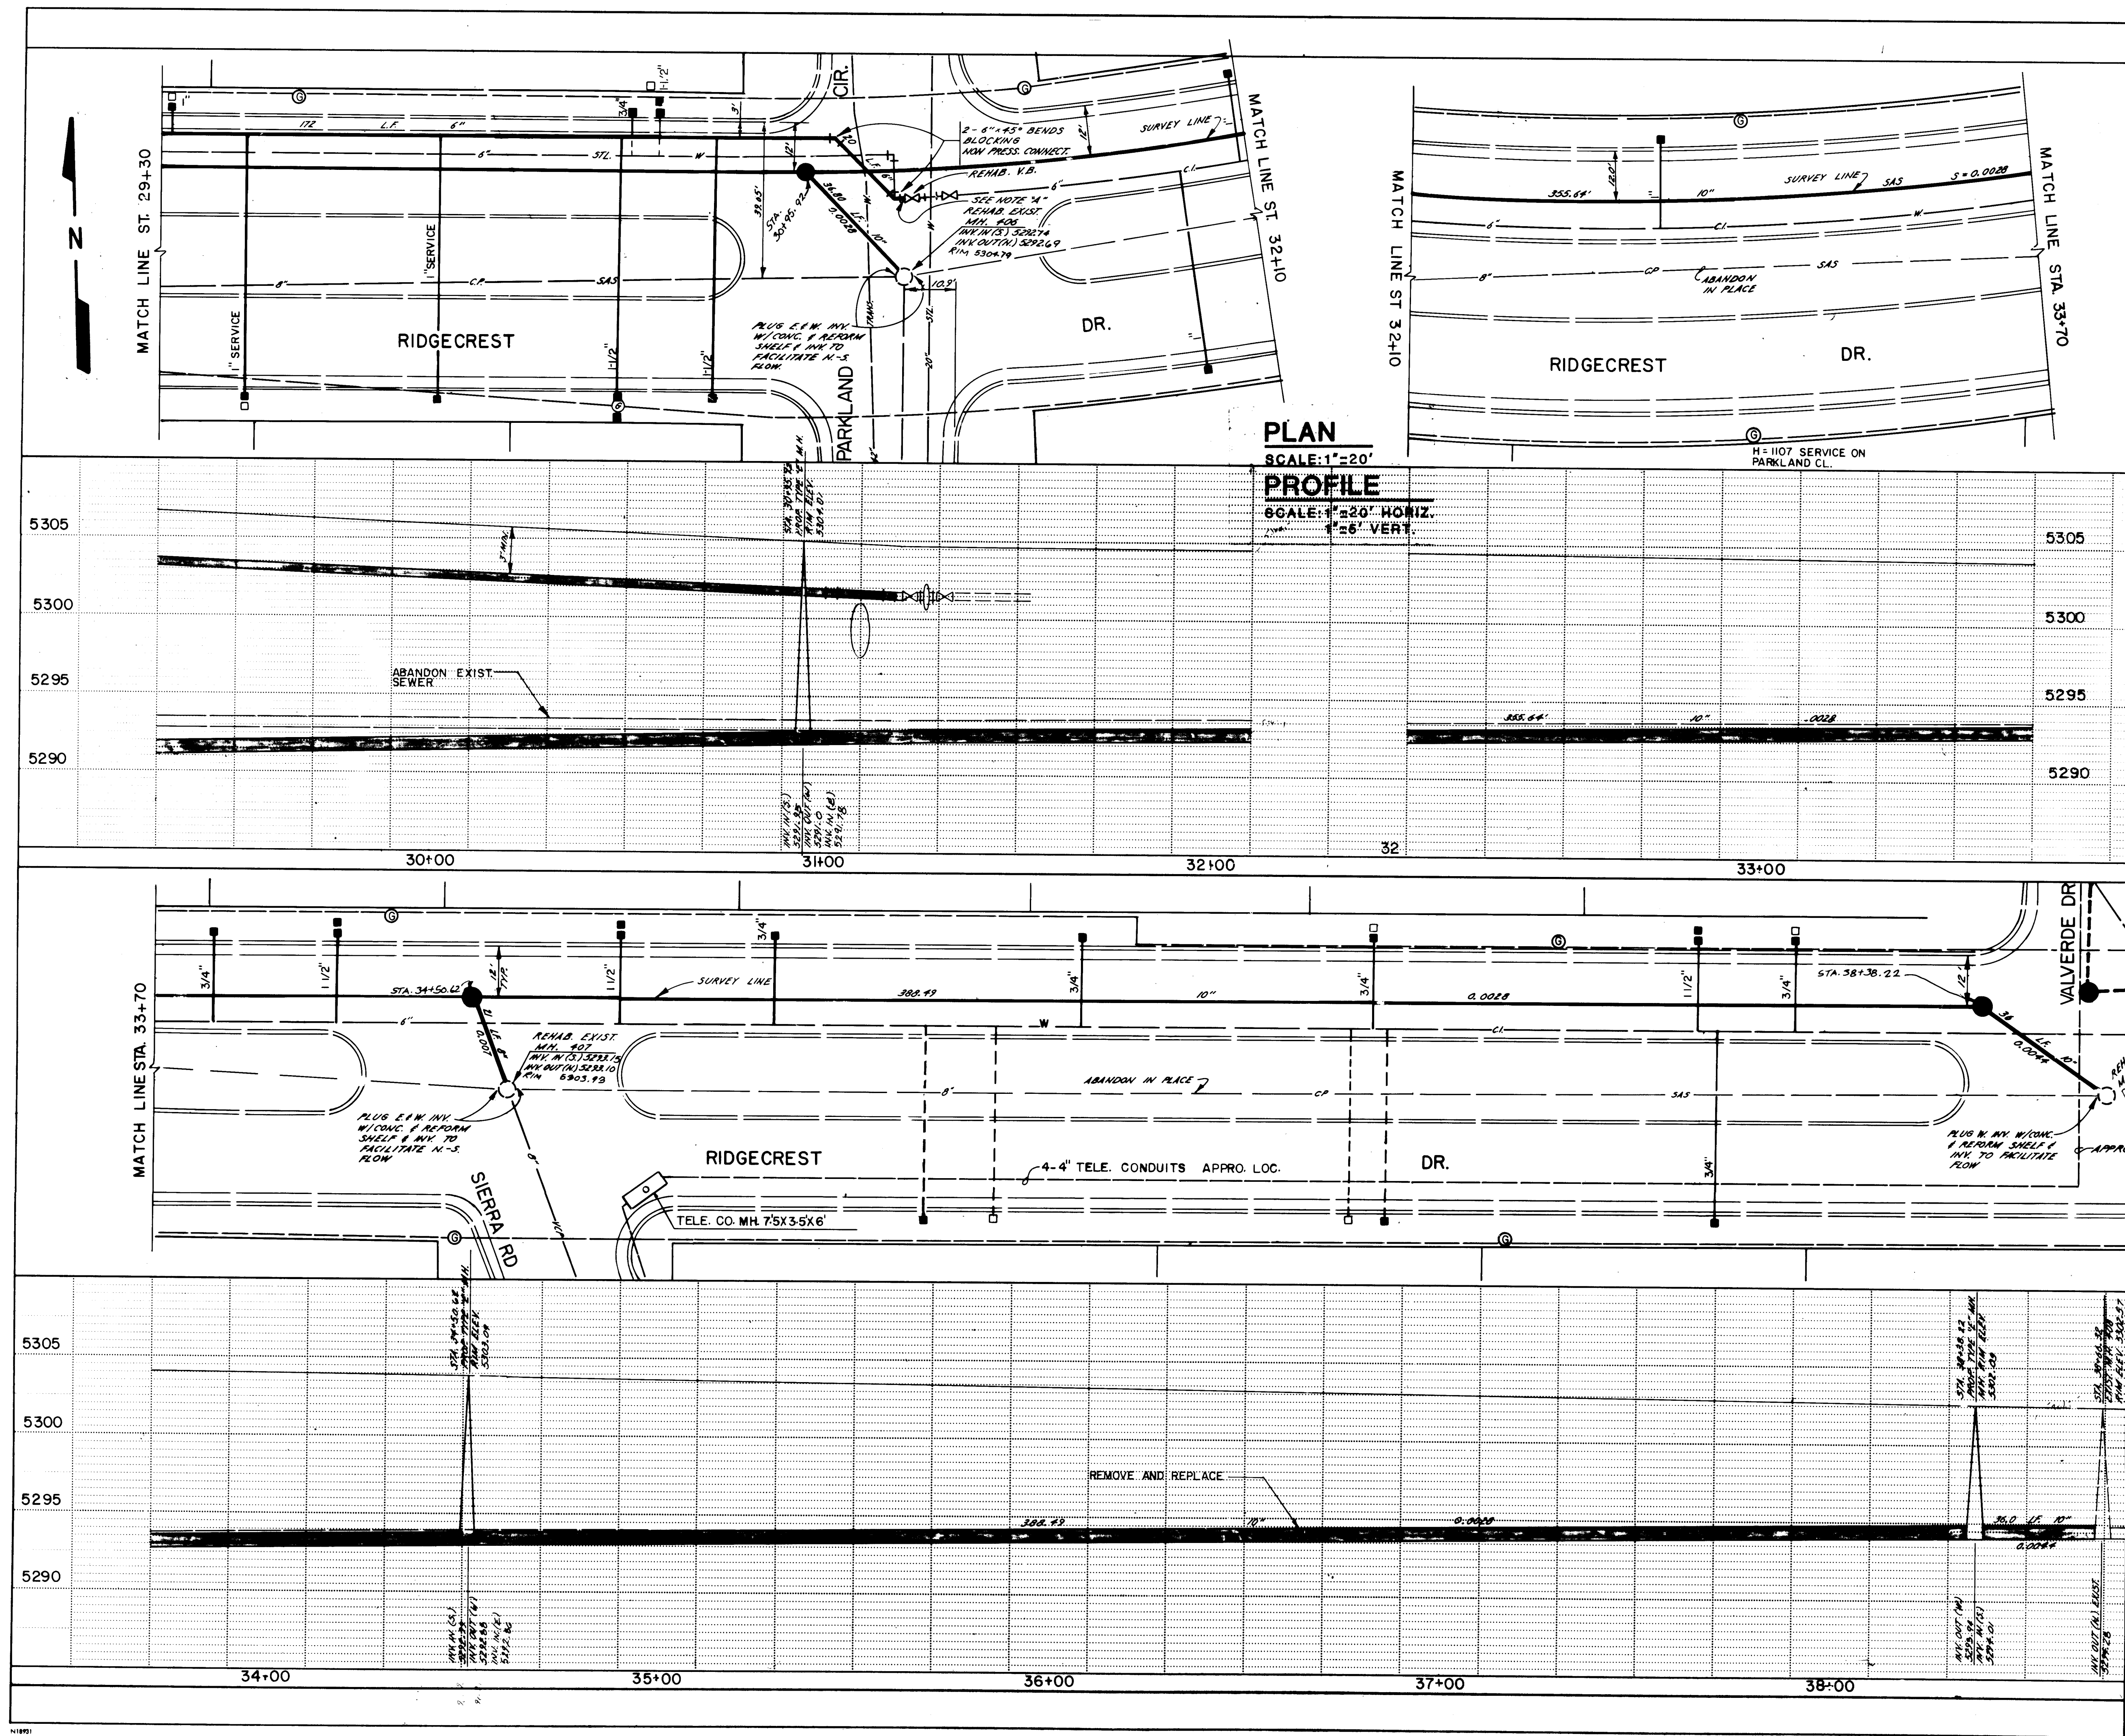

NOTE: ON RIDGECREST DR.:

- A. ONLY ONE VALVE COVER EXPOSED IN EXIST. PAVEMENT. SECOND VALVE COVER IS PROBABLY PAVED OVER. CONNECT TO EXIST. VALVE ON NORTHWEST SIDE OF 20" STEEL WATERLINE. UNDER NO CIRCUMSTANCES SHALL THE CONTRACTOR TAP INTO THE EXIST. 20" OR 42".
- B. CONTRACTOR SHALL REPLACE ALL SOD DISTURBED IN HIS WORK. REPLACED SOD MUST BE PLACED ON AN 18-INCH DEPTH OF SOIL WITH AN 95% COMPACTION EFFORT IN LAWN AND MEDIAN SOD REPLACEMENT.
- REPLACED SOD WILL BE INSPECTED BY THE PARKS AND RECREATION DEPARTMENT AND MUST MEET THEIR APPROVAL. IF NOT APPROVED, CONTRACTOR WILL CORRECT WORK TO THE SATISFACTION OF THE PARKS AND RECREATION DEPARTMENT AT CONTRACTORS EXPENSE.
- C. "CONTRACTOR WILL REPLACE 4-INCH ASPHALT CONCRETE BASE COURSE ONLY IN RIDGECREST DRIVE SE TO THE LEVEL OF EXISTING ADJACENT PAVEMENT. THE STREET IS SCHEDULED FOR OVERLAY FOLLOWING THE WORK OF THIS PROJECT.

[illegible]