



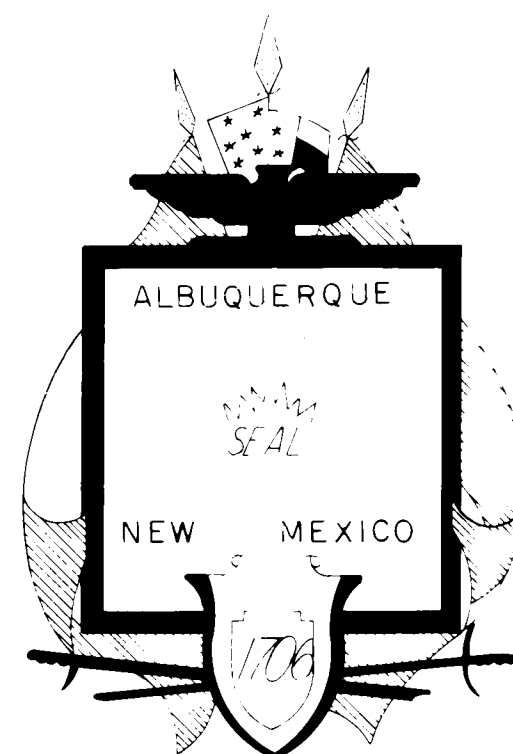

CITY OF ALBUQUERQUE, NEW MEXICO

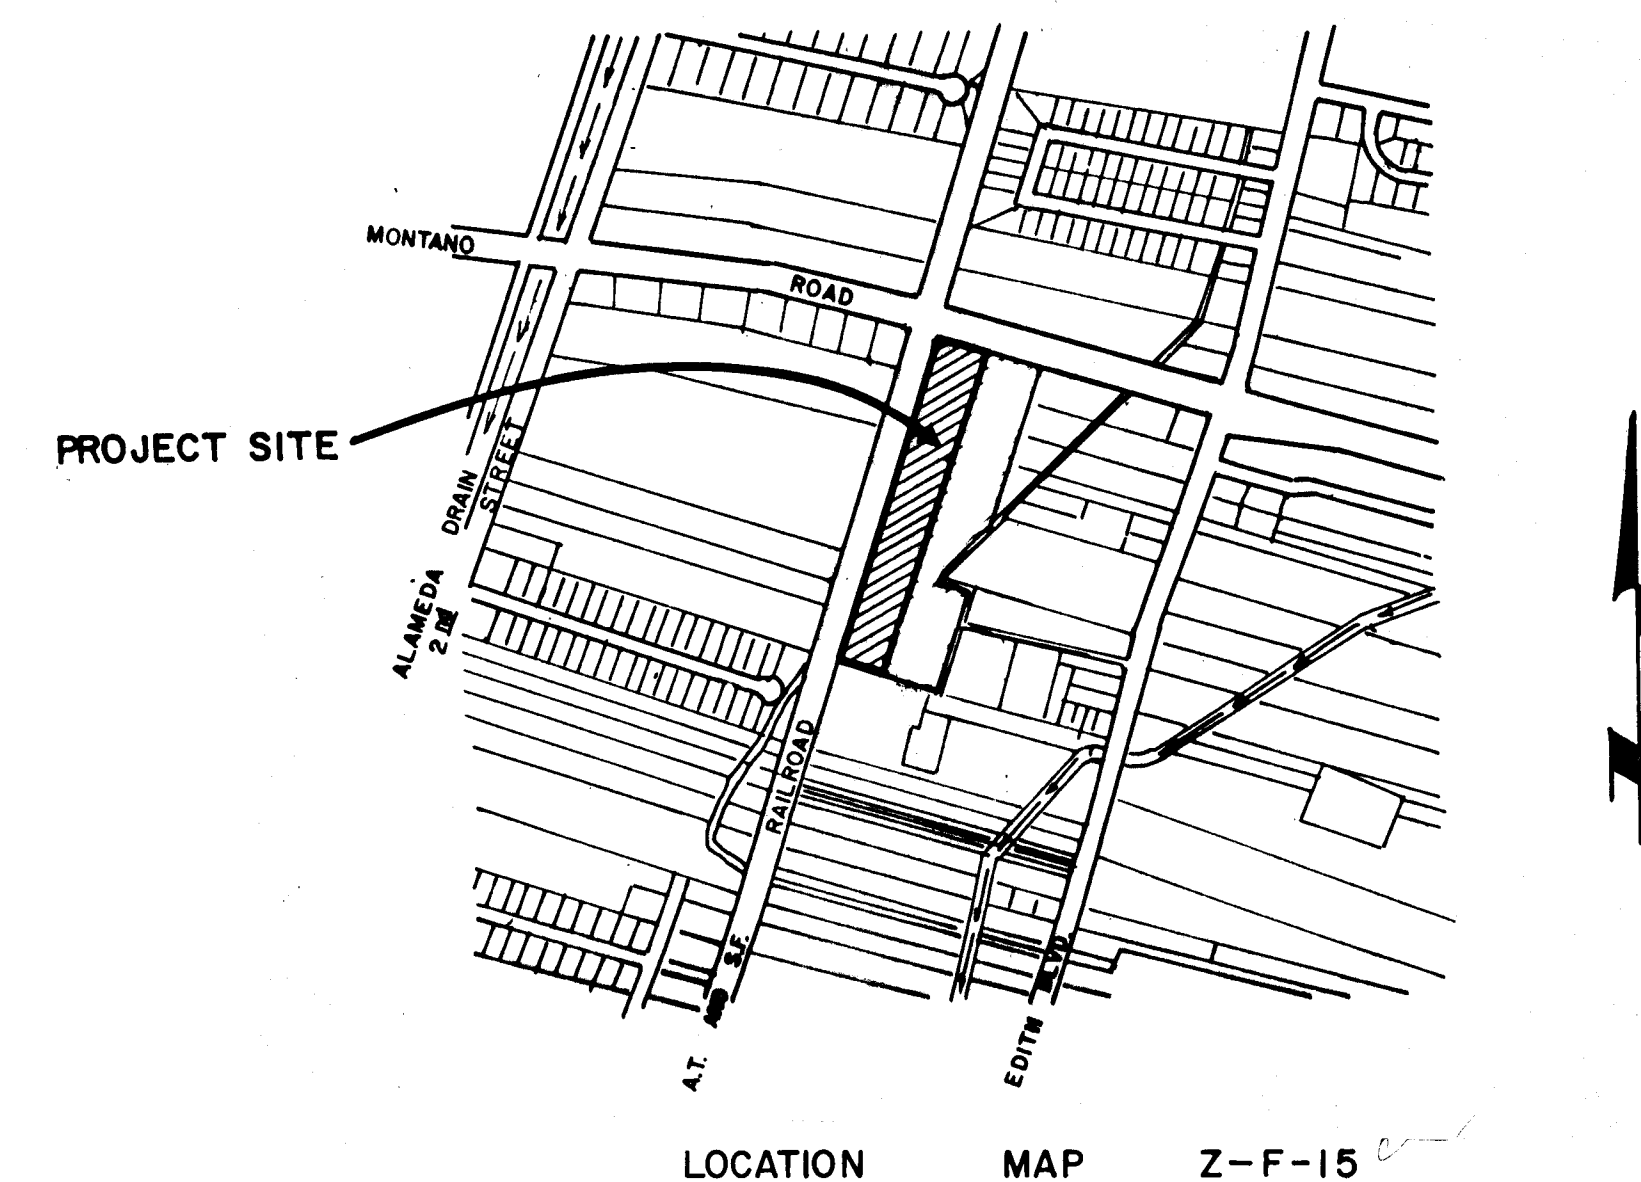

SOUTHWESTERN PORTLAND CEMENT CO.

CEMENT DISTRIBUTION CENTER

TRACT I, R.O.M. SUBDIVISION

ALBUQUERQUE, NEW MEXICO

INDEX

1. TITLE SHEET
2. PLAN & PROFILE

26 28 110 184


dtm & associates, inc.

Denney-Tibljias-McLean & Associates, Inc.
Consulting Engineers ■ Planners ■ Surveyors
2400 COMANCHE ROAD, N.E. ■ ALBUQUERQUE, NM 87107
TELEPHONE (505) 884-0696

REV.	SHEETS	CITY ENGR	DATE	USER DEPT.	DATE	USER DEPT.	DATE
APPROVAL OF REVISIONS							

	DENNEY-TIBLIJAS-McLEAN & ASSOC., INC. CONSULTING ENGINEERS PLANNERS SURVEYORS 2400 COMANCHE RD. N.E., ALBUQ. N.M. 87107 (505) 884-0696	APPROVED FOR CONSTRUCTION C.E.
	2811	SHEET 1 OF 2

1. Sta. 144.5 (R.O.W.) To Sta. 314.0
The 6" W.C. F.H.W. Be A Private
Infrastructure Improvement & Will
Be Maintained By The Developer.
2. 3'x3'6" Conc. Pad Shall Be Poured
Around F.H.W.
3. Contractor Shall Adhere To C.O.A.
Interim Std. Spec. P.W.C. 1985
4. Two Working Days Prior To Excavation,
The Contractor Must Contact Line Locating
Service (765) 1234, For The Location Of
Existing Utilities.
5. Prior To Construction, The Contractor Shall
Expose And Label All Existing Utilities
And Obstructions, Both Horizontal And
Vertical. Any Conflict Shall Be Advised
To Engineer Immediately.
6. The Contractor Must Submit A Construction
Signing And Barricading Plan To Traffic
Engineering To Receive A Barricading Permit
Prior To Construction.
7. **COUNTY EXCAVATION PERMIT
REQUIRED PRIOR TO
CONSTRUCTION**

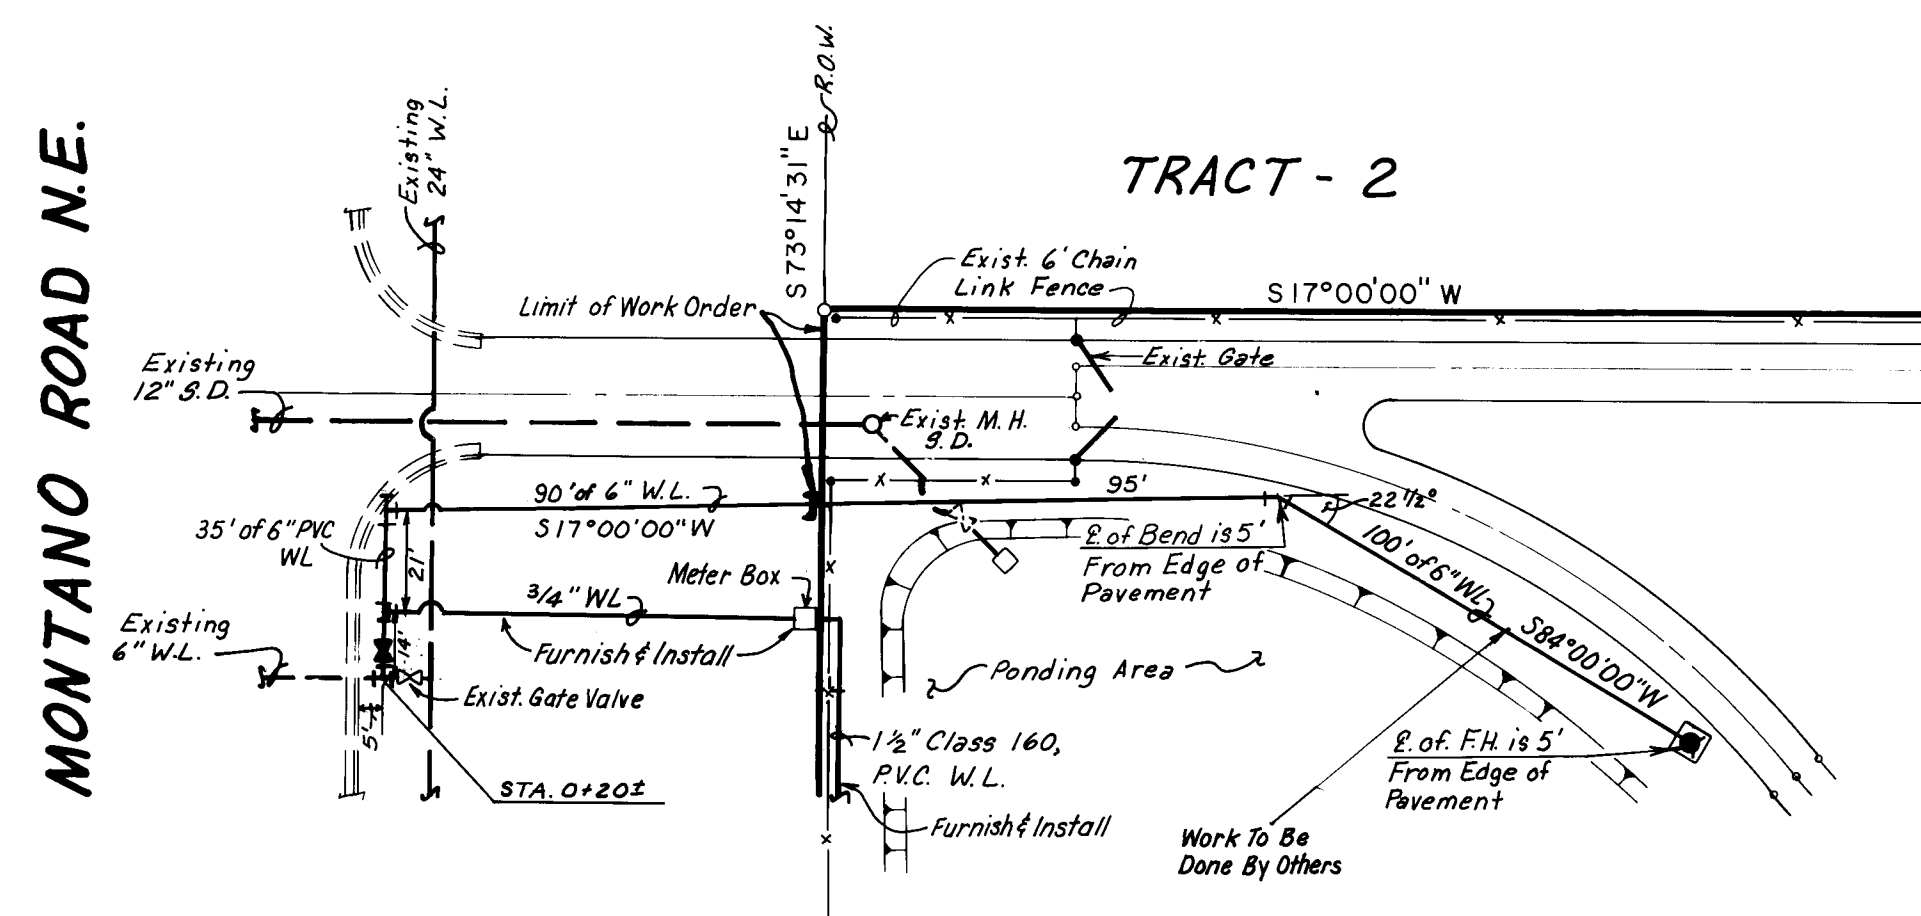

Sta. 0+20±
Install 1-6"x6"x6" Tee w/Bkg.
#1-Non-pressurized Connection,
1-6" Gate Valve & 1-Type "B" Valve Box
per C.O.A. Std. W-22

Sta. 0+34
Install 1-3/4" Service,
80 LF of 3/4" W.L. &
1-3/4" Cap @ 80' Rt.


Sta. 0+55
Remove & Replace Curb & Gutter to
Match Existing per C.O.A. Std. P-8
as Necessary

Sta. 0+55
Install 1'-6" x 6" x 6" Tee w/ Blkg.,
-6" Cap. East Side per
O & S+D W-22

U.S. 5/3. P. 22.

Sta. 2+40
Install 1-6"x22½" Bend
w/Bkg. Per C.O.A. Std. W-22

Sta. 3140
Install 1-6"x4" 90° Reducing Bend
w/ Blkg. #1-4" Fire Hydrant
1/3"x3"x6" Conc. Pad Per C.O.A.
Std. W-20, W-22
Range Elev. = 79.6

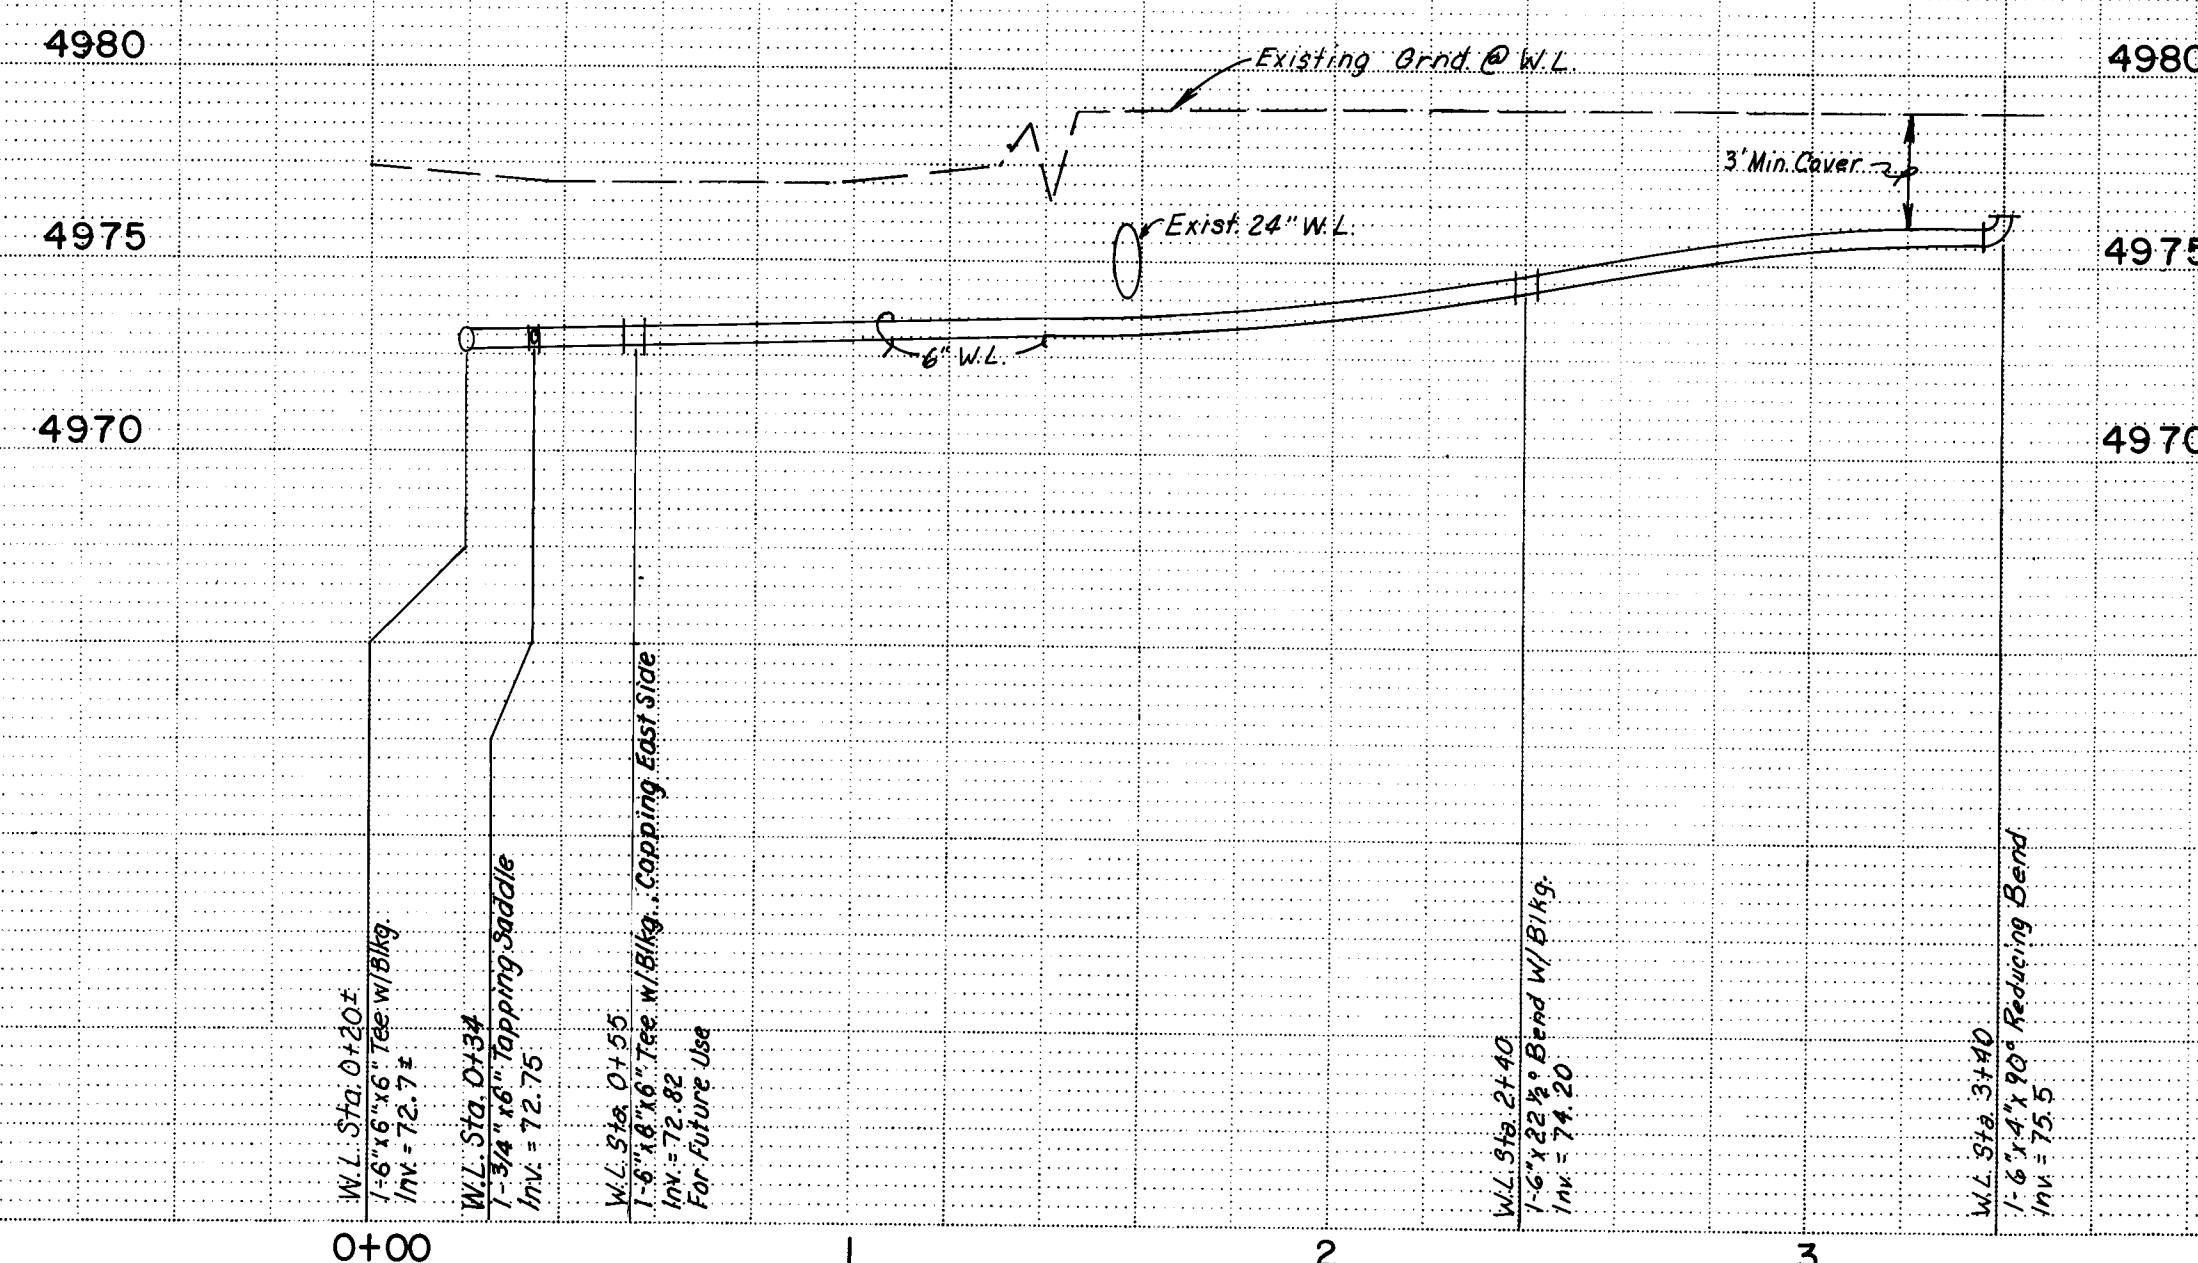

26	28	11	02	86
----	----	----	----	----

Professional Engineer Seal for the State of New York, No. 10000, signed by Robert A. L. Smith.

FOR INFORMATION ONLY

[illegible]

CITY OF ALBUQUERQUE					
MUNICIPAL DEVELOPMENT DEPARTMENT					
ENGINEERING DIVISION					
TITLE: SOUTHWEST PORTLAND CEMENT 6" WATER LINE					
APPROVALS	ENGINEER	DATE	APPROVALS	ENGINEER	DATE
City Engineer	<i>[Signature]</i>	4/14/86	Liquid Waste	<i>[Signature]</i>	3/19/86
A.C.E. - Design	<i>[Signature]</i>	3/29/86	Traffic	<i>[Signature]</i>	3/19/86
A.C.E. - Hydrology	<i>[Signature]</i>	3/29/86	Water	<i>[Signature]</i>	3/19/86
DRAWING NO.	2811		MAP NO.	SHEET OF	
	F 15			2	2