

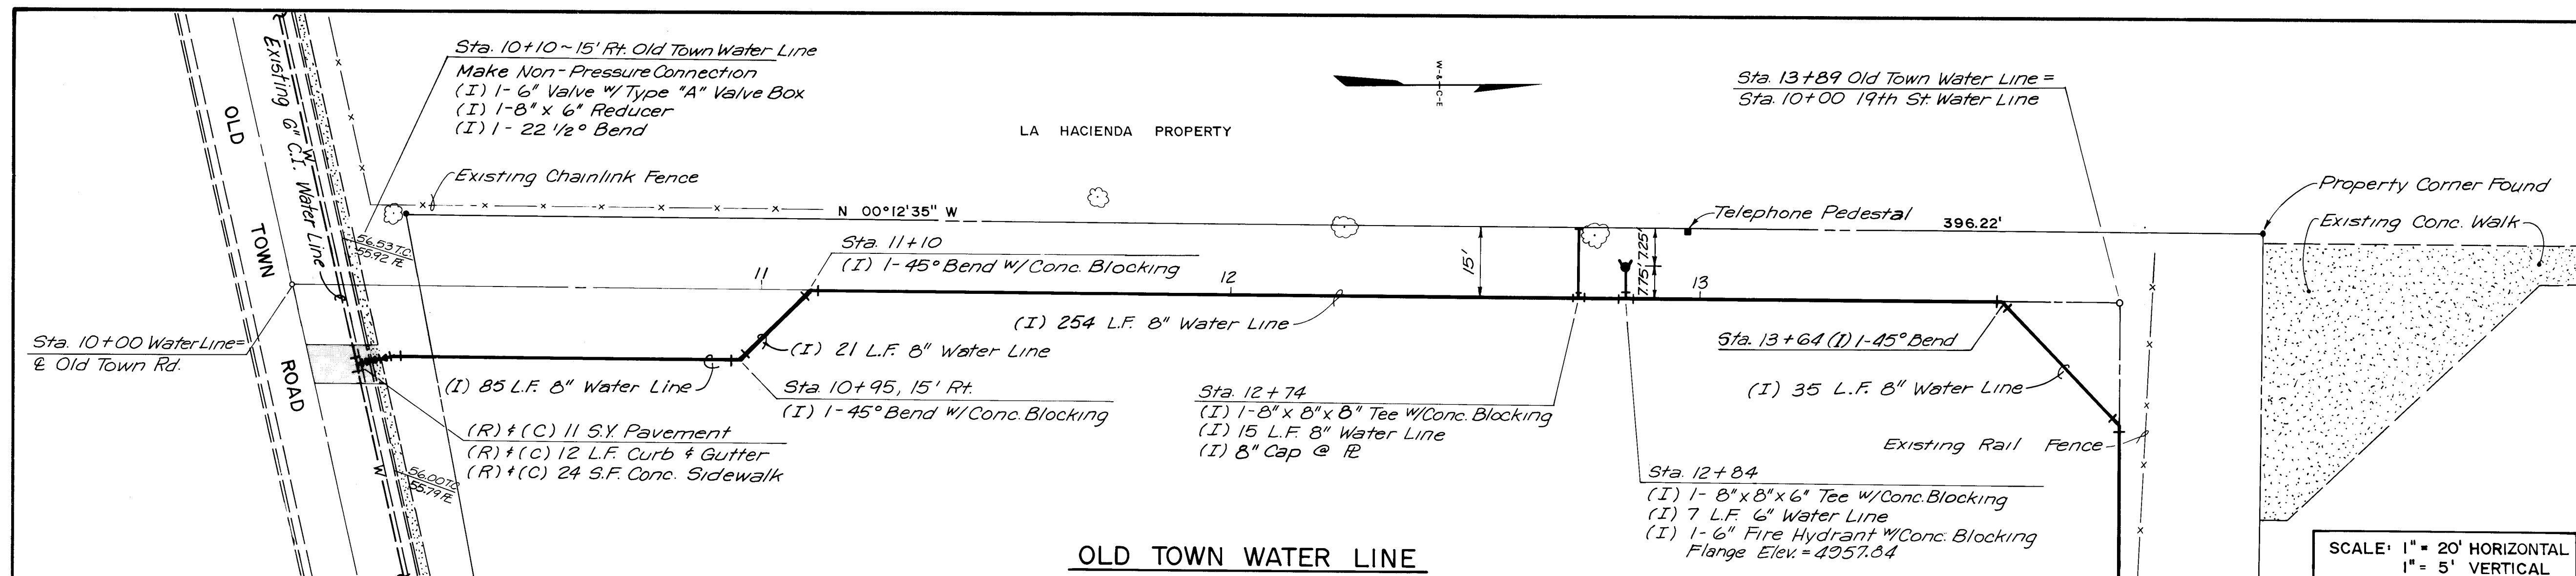
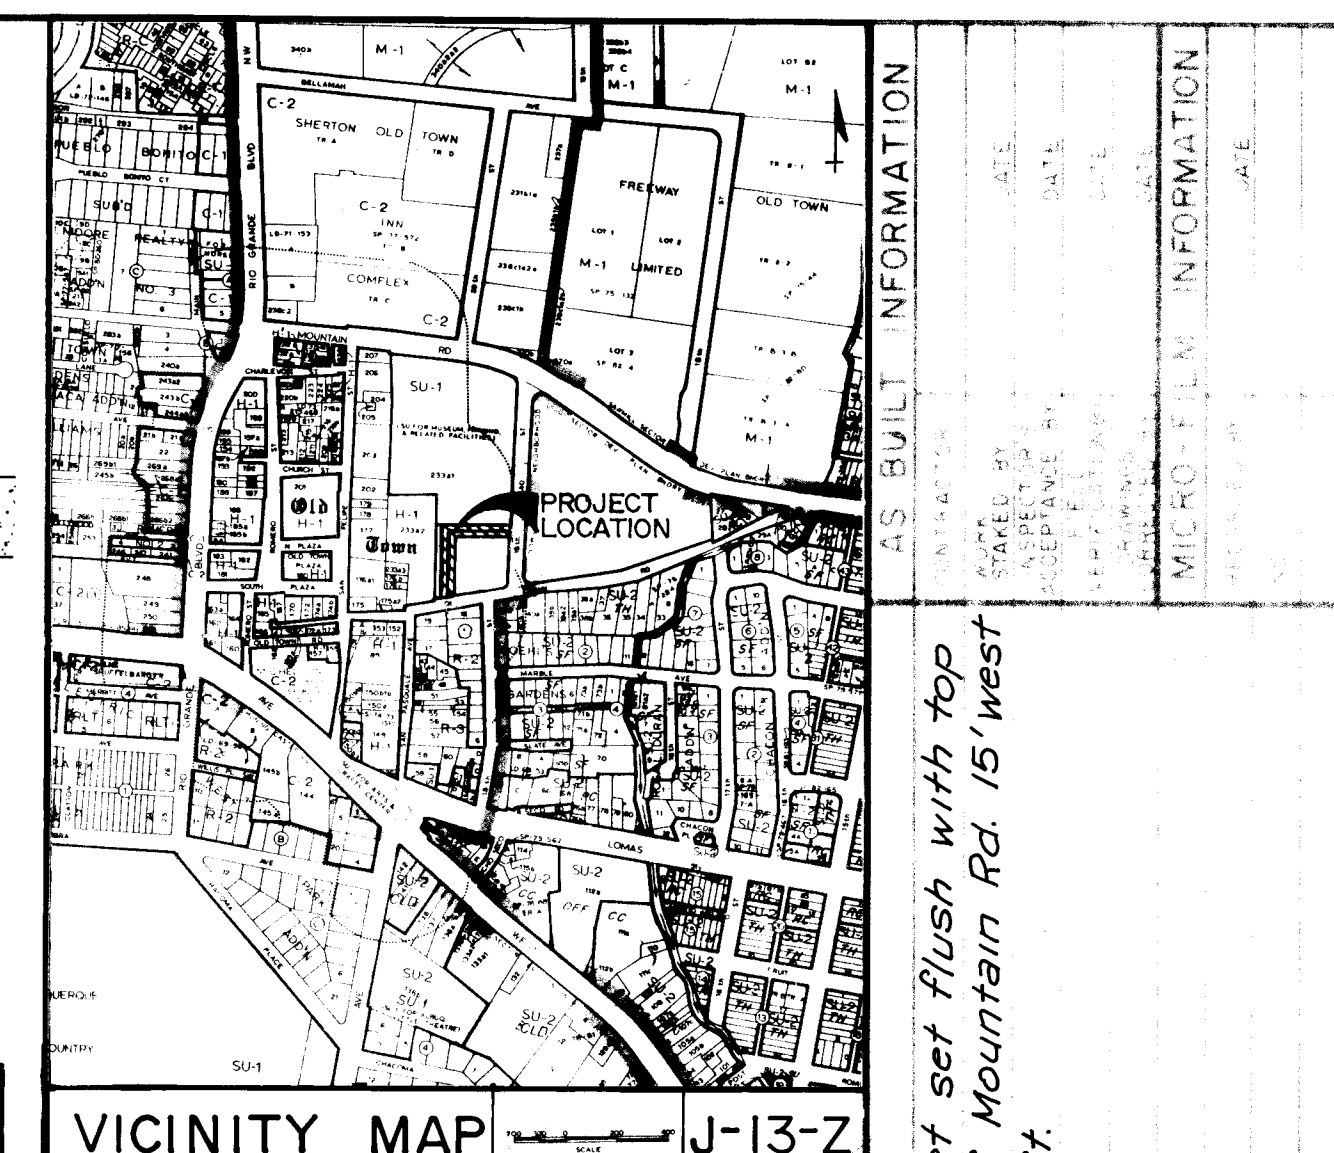


SCANNED BY LSW

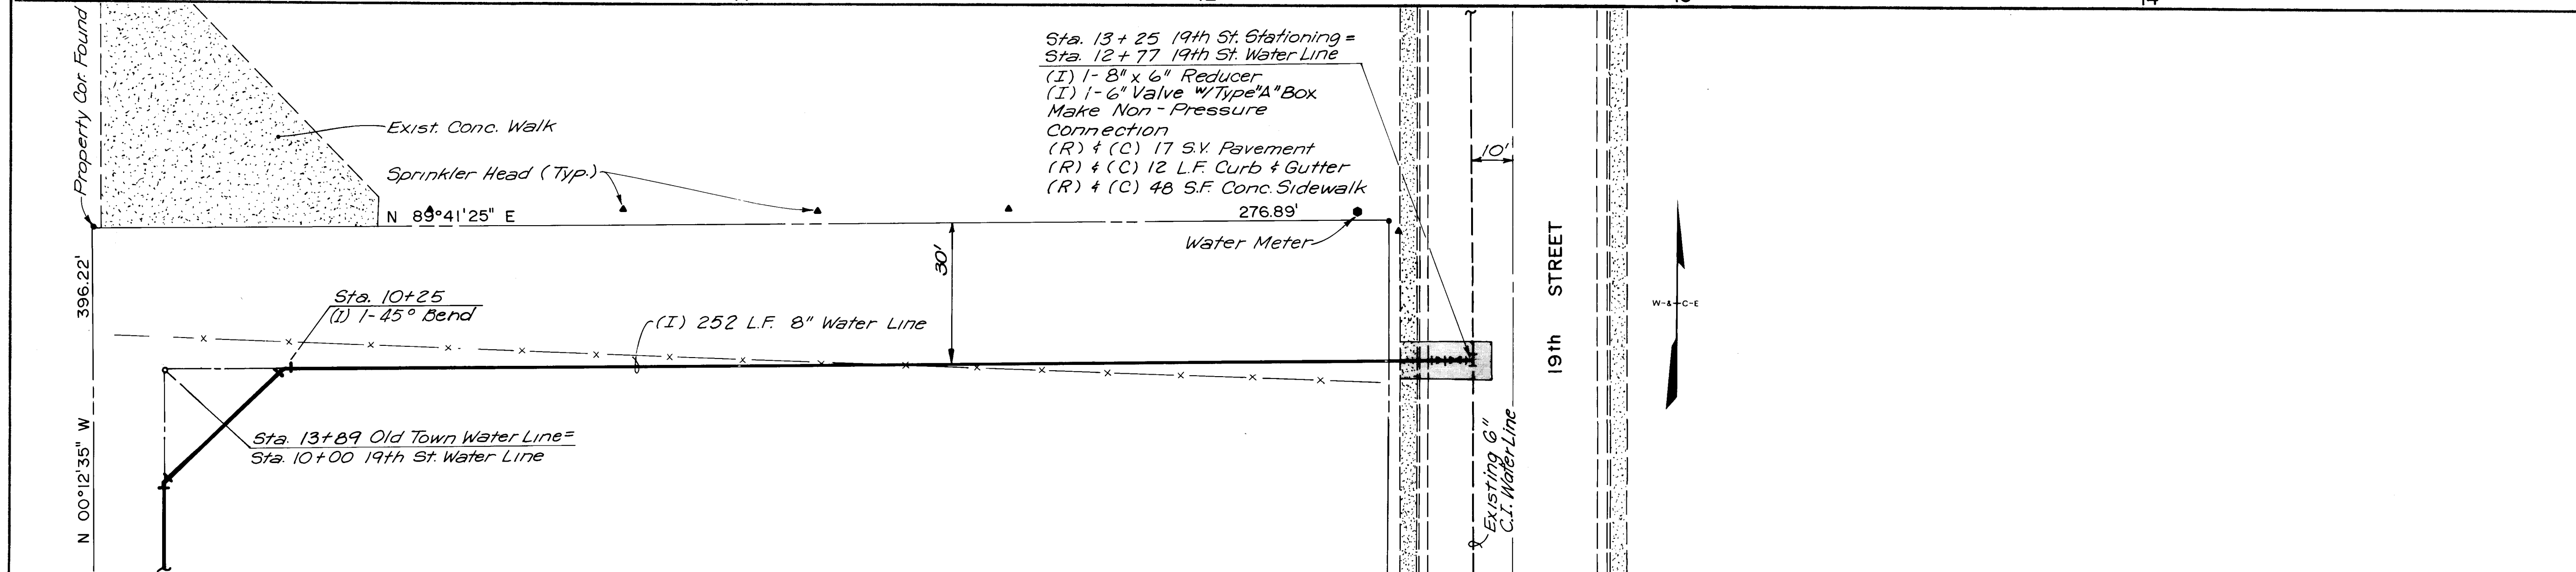

OLD TOWN WATER LINE

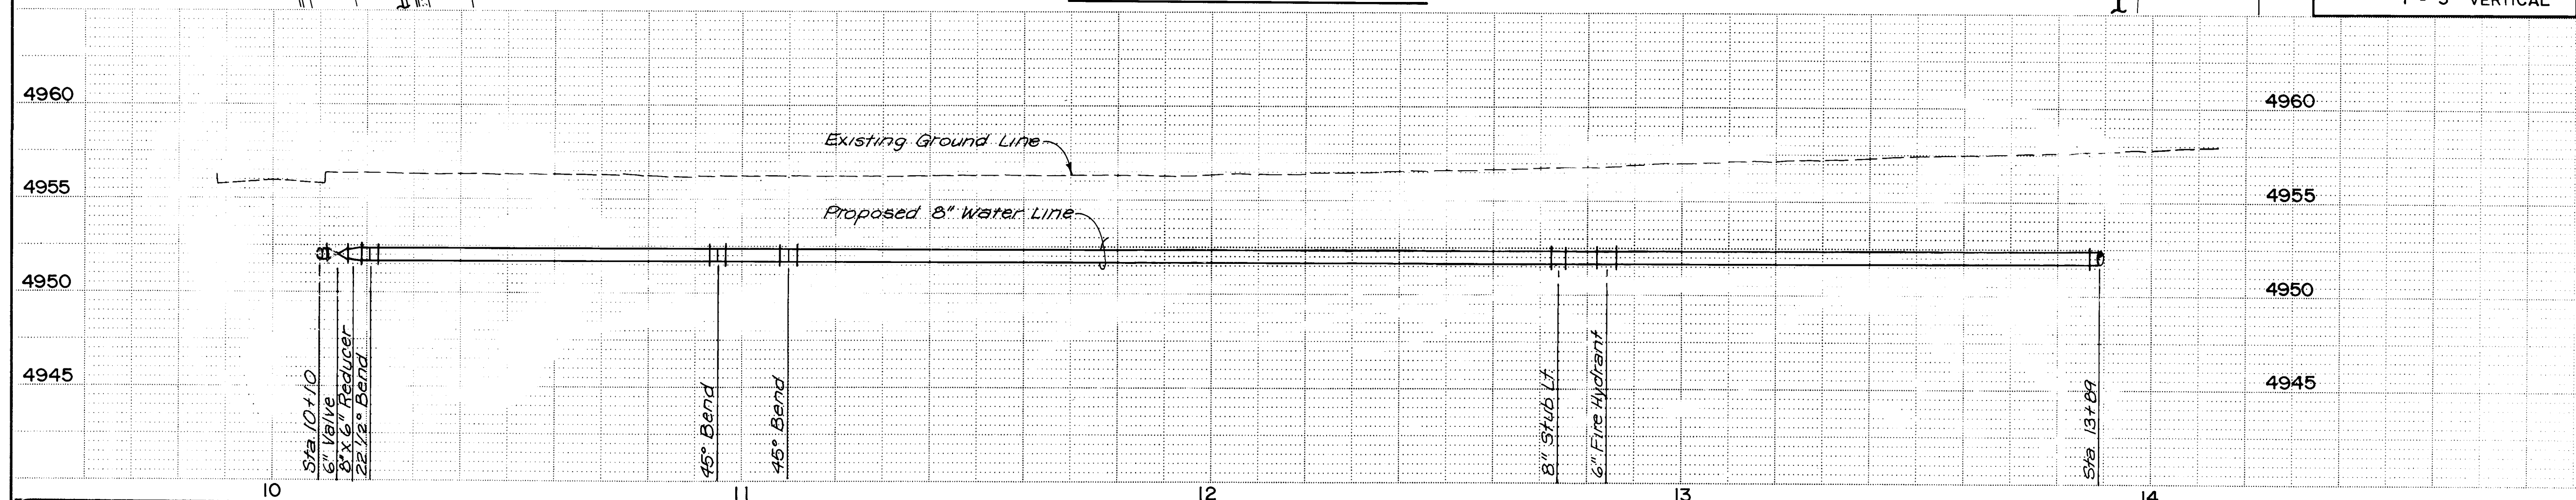

NOTES

- All work to be in accordance with City of Albuquerque Standard Specifications for Public Works Construction, 1985.
- Minimum cover over waterline is 4 feet.
- All fittings and fire hydrants shall be blocked with concrete in accordance with City of Albuquerque Std. dwgs.
- All fire hydrants shall be located and installed per C.O.A. std. dwg. W-20-1.
- Contractor shall submit a traffic control plan for work within Old Town Rd. and 19th St. to Traffic Engineering for barricade permit prior to construction.
- Pavement replacement shall be residential section per C.O.A. std. dwg. P-25.

LEGEND

- (I).....Install
(C).....Construct
(R).....Remove

26-2954 0197

APPROVED FOR CONSTRUCTION

Chief Engineer

CITY OF ALBUQUERQUE

WATER LINE WITHIN TRACT 233a1,
M.R.G.C.D. MAP N° 38
OLD TOWN ROAD & 19th St. N.W.

APPROVALS	ENGINEER	DATE	APPROVALS	ENGINEER	DATE
City Engineer	Robert D. Smith	7/15/86	Traffic	NADWH	7/11/86
Liquid Waste	Robert D. Smith	7/10/86	Water	Robert D. Smith	7/10/86
A.C.E. - Design	Robert D. Smith	7/15/86	2954		
A.C.E. - Hydrology	Robert D. Smith	7/15/86			