

Work Location

Google Earth

© 2018 Google



Construct new parallel
diagonal curb ramps.

Construct new mid-block
parallel curb ramp.




FINAL ACCEPTANCE OF CURB RAMP DOES NOT OCCUR UNTIL THE FINAL INSPECTION OF THE PROJECT



ADA Curb Ramp Documentation

Type: Parallel (Diagonal)

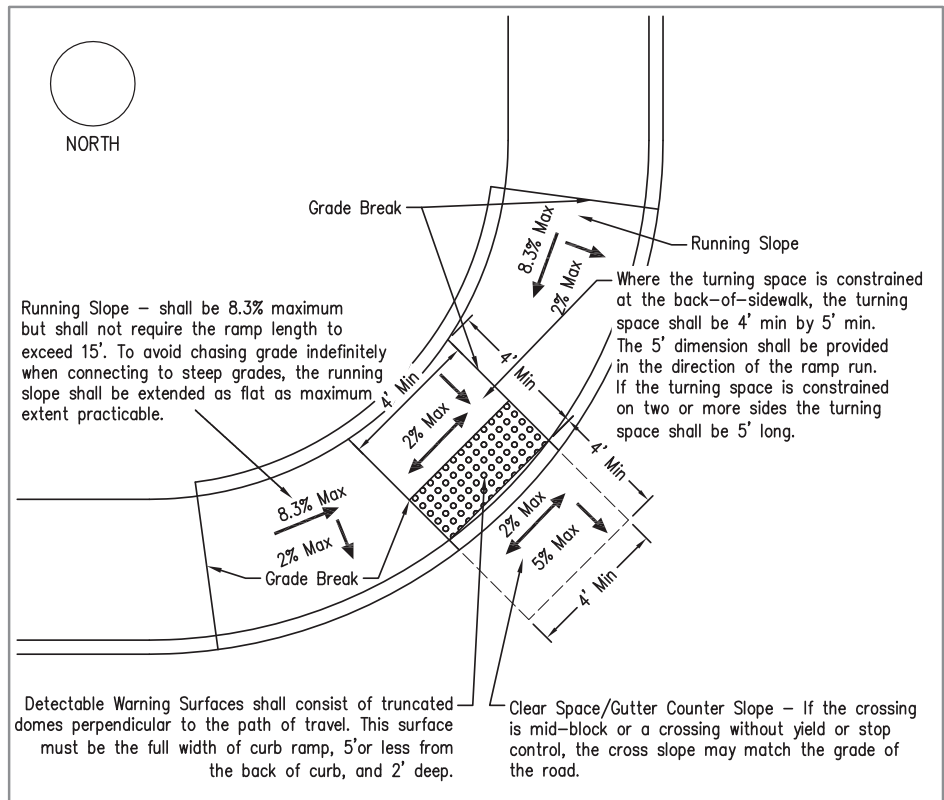


Vertical Surface Discontinuities

SCALE : N.T.S.

1/4 - 1/2 MAX

1/4 MAX



Vertical surface discontinuities shall be 0.5" maximum. Vertical discontinuities between 0.25" and 0.5" shall be beveled with a slope not steeper than 50%. The bevel shall be applied across the entire vertical surface discontinuity.



ADA Curb Ramp Documentation


Type: Parallel (Diagonal)

COMMENTS:



ADA Curb Ramp Documentation
Type: Mid-Block Parallel

Pre-Pour Inspection

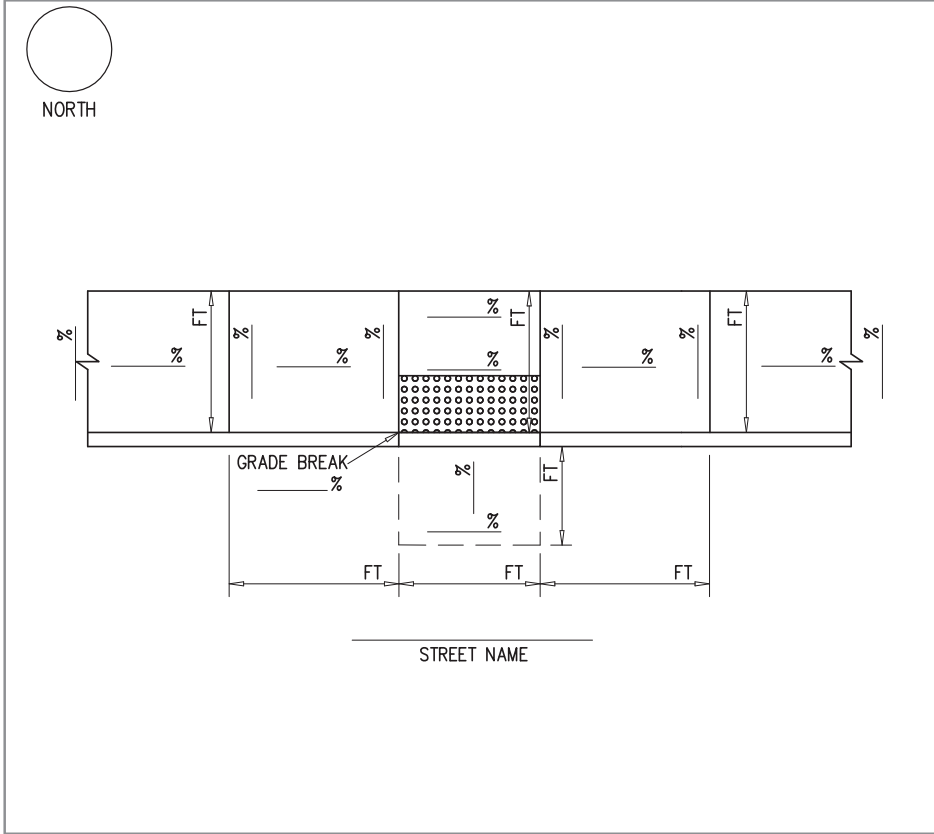

INSPECTOR SIGNATURE: _____

PRINT NAME: _____

CONTRACTOR: _____

CONTRACTOR SIGNATURE: _____

LEVEL CALIBRATION

COA INSPECTOR INITIAL _____ DATE _____

CONTRACTOR INITIAL _____ DATE _____


CPN:
Project Name:
Intersection:
Corner:
DATE:

FINAL ACCEPTANCE OF CURB RAMP DOES NOT OCCUR UNTIL THE FINAL INSPECTION OF THE PROJECT



ADA Curb Ramp Documentation
Type: Mid-Block Parallel

Constructed Inspection

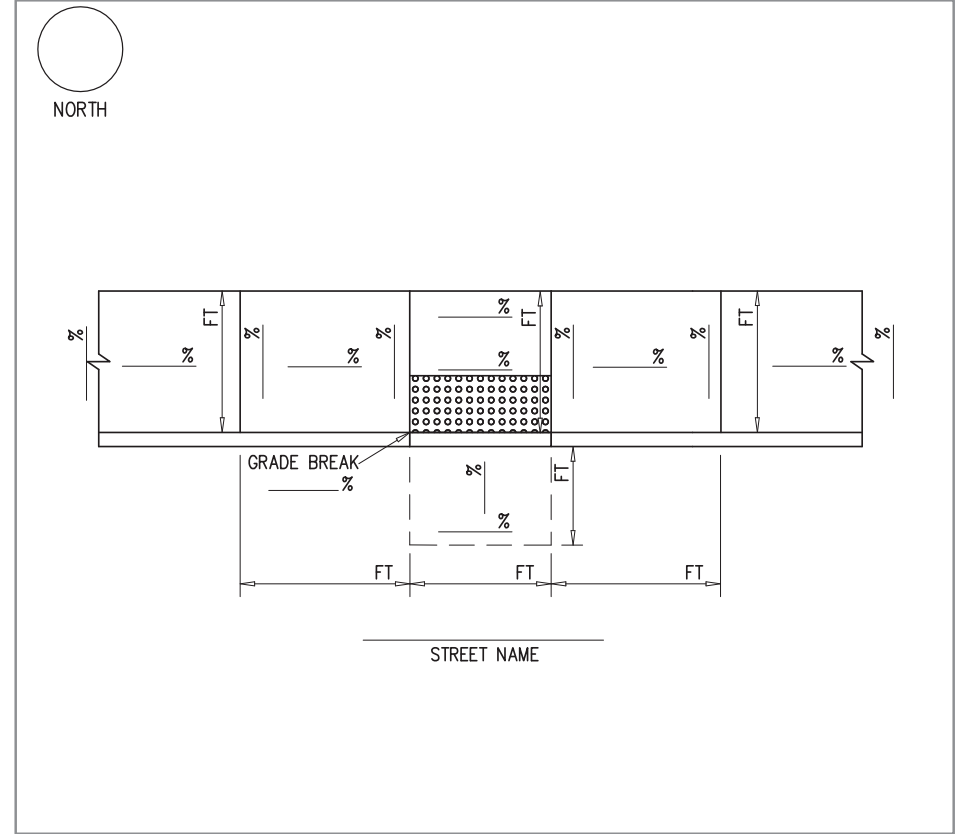

INSPECTOR SIGNATURE: _____

PRINT NAME: _____

CONTRACTOR: _____

CONTRACTOR SIGNATURE: _____

LEVEL CALIBRATION

COA INSPECTOR INITIAL _____ DATE _____

CONTRACTOR INITIAL _____ DATE _____

CPN:
Project Name:
Intersection:
Corner:
DATE:

FINAL ACCEPTANCE OF CURB RAMP DOES NOT OCCUR UNTIL THE FINAL INSPECTION OF THE PROJECT



ADA Curb Ramp Documentation


Type: Mid-Block Parallel



NORTH

Where the turning space is constrained at the back-of-sidewalk, the turning space shall be 4' min by 5' min. The 5' dimension shall be provided in the direction of the ramp run. If the turning space is constrained on two or more sides the turning space shall be 5' long.

Running Slope – shall be 8.3% maximum but shall not require the ramp length to exceed 15'. To avoid chasing grade indefinitely when connecting to steep grades, the running slope shall be extended as flat as maximum extent practicable.

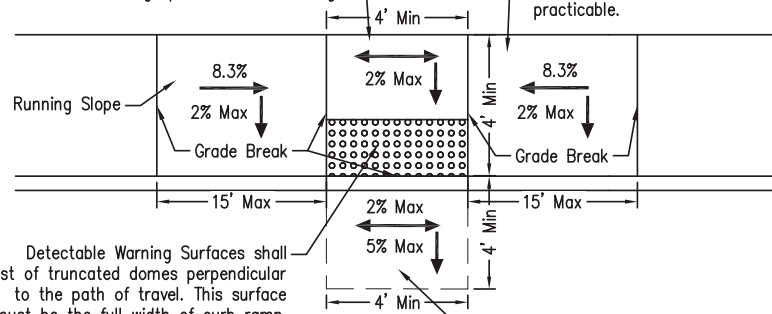


Detectable Warning Surfaces shall consist of truncated domes perpendicular to the path of travel. This surface must be the full width of curb ramp, 5' or less from the back of curb, and 2' deep.

Clear Space/Gutter Counter Slope – If the crossing is mid-block or a crossing without yield or stop control, the cross slope may match the grade of the road.

Vertical Surface Discontinuities

SCALE : N.T.S.

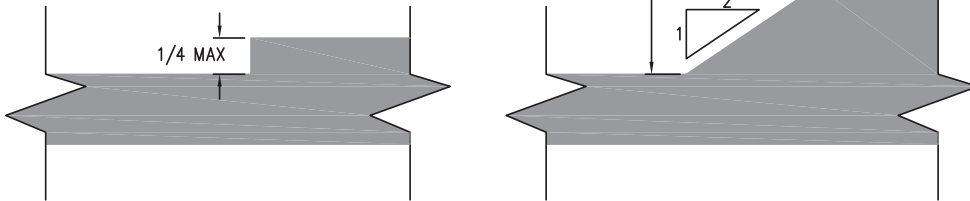

Vertical surface discontinuities shall be 0.5" maximum. Vertical discontinuities between 0.25" and 0.5" shall be beveled with a slope not steeper than 50%. The bevel shall be applied across the entire vertical surface discontinuity.



ADA Curb Ramp Documentation

Type: Mid-Block Parallel

COMMENTS: