


VICINITY MAP

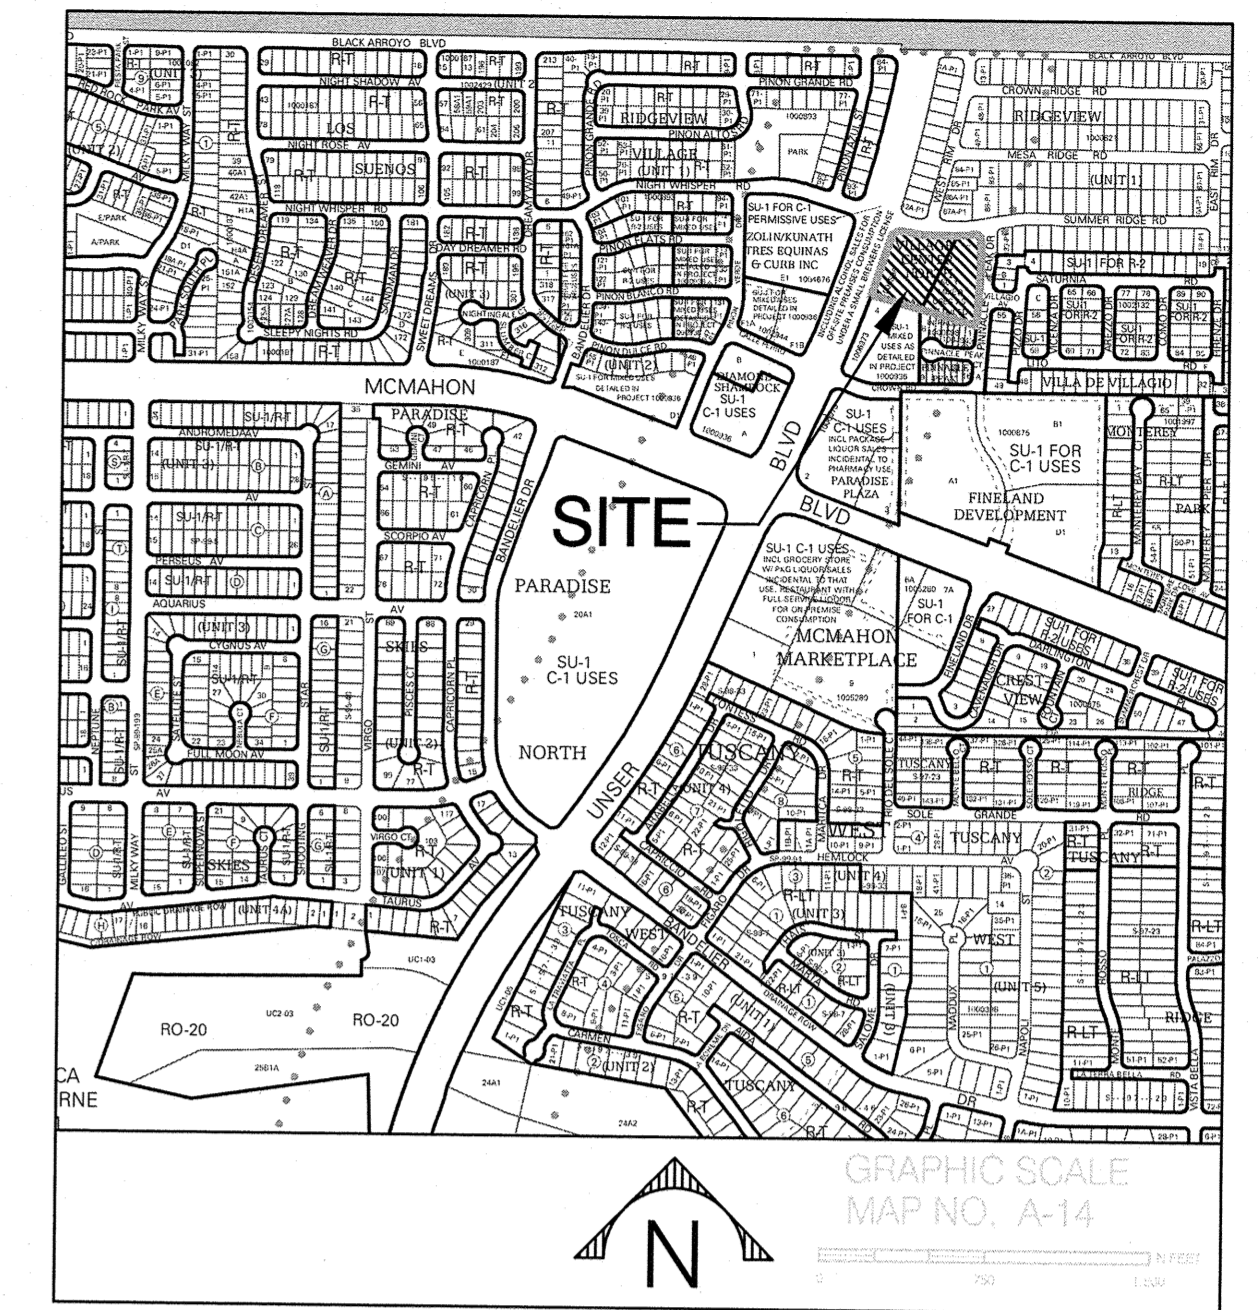

KEYED NOTES

1. PUBLIC FIRE HYDRANT
2. FIRE DEPARTMENT CONNECTION (FDC)
3. POST INDICATOR VALVE (PIV)
4. FIRE LANE DESIGNATION - PAINT CURB RED WITH ALTERNATING "NO PARKING" AND "FIRE LANE" TEXT @ 50' INTERVALS, MAX.
5. KNOX BOX LOCATION

BUILDING AREA: 88200 SF

CONSTRUCTION TYPE: IIB, FIRE SPRINKLER SYSTEM

FIRE FLOW TYPE: 6,250 GALLONS/MINUTE, 3 FIRE HYDRANTS PROVIDED

max Building Height 38 feet

Edge Cases & Details
 HYDRANT AND FIRE ACCESS
 ALLUAGES CHECKING DIVISION
 PLANS CHECKING DIVISION
 80% GSD - CONSTRUCTION TYPE IIB
 0% GSD - NUMBER OF HYDRANTS 3
 APPROVED BY DISAPPROVED
 SIGNATURE / EXAMINER / DATE

FF 5282.17


GUARDIAN STORAGE Unser & McMahon

FIRE 1 PLAN

Prepared For:
Guardian Storage
9221 Eagle Ranch Rd. NW
Albuquerque, NM 87114

Prepared By:
Consensus Planning, Inc.
302 Eighth Street NW
Albuquerque, NM 87102

Designed By:
HUITT-ZOLIARS
Huitt-Zollars, Inc.
333 Rio Rancho Drive NE, Suite 101
Rio Rancho, New Mexico 87124
Phone (505) 892-5141 Fax (505) 892-3259

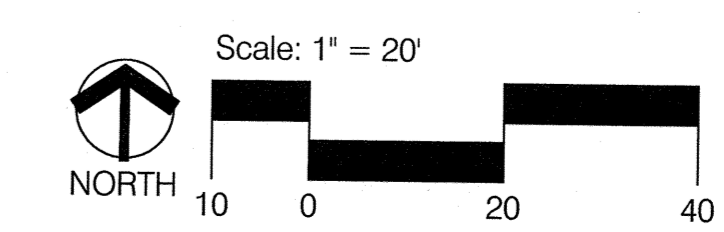

April 27, 2016

Huitt-Zollars
333 Rio Rancho Blvd., Suite 101
Rio Rancho, NM 87124