




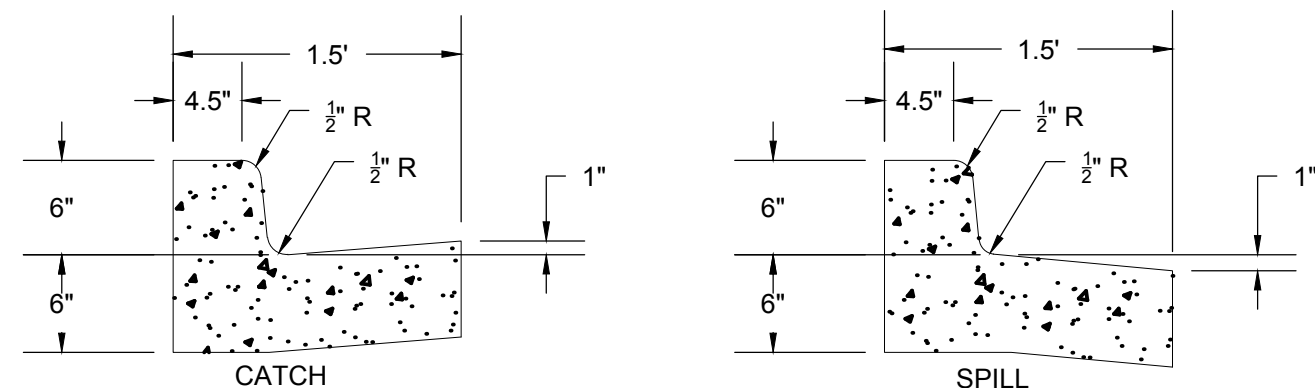

PRIVATE CURB & GUTTER
N.T.S.


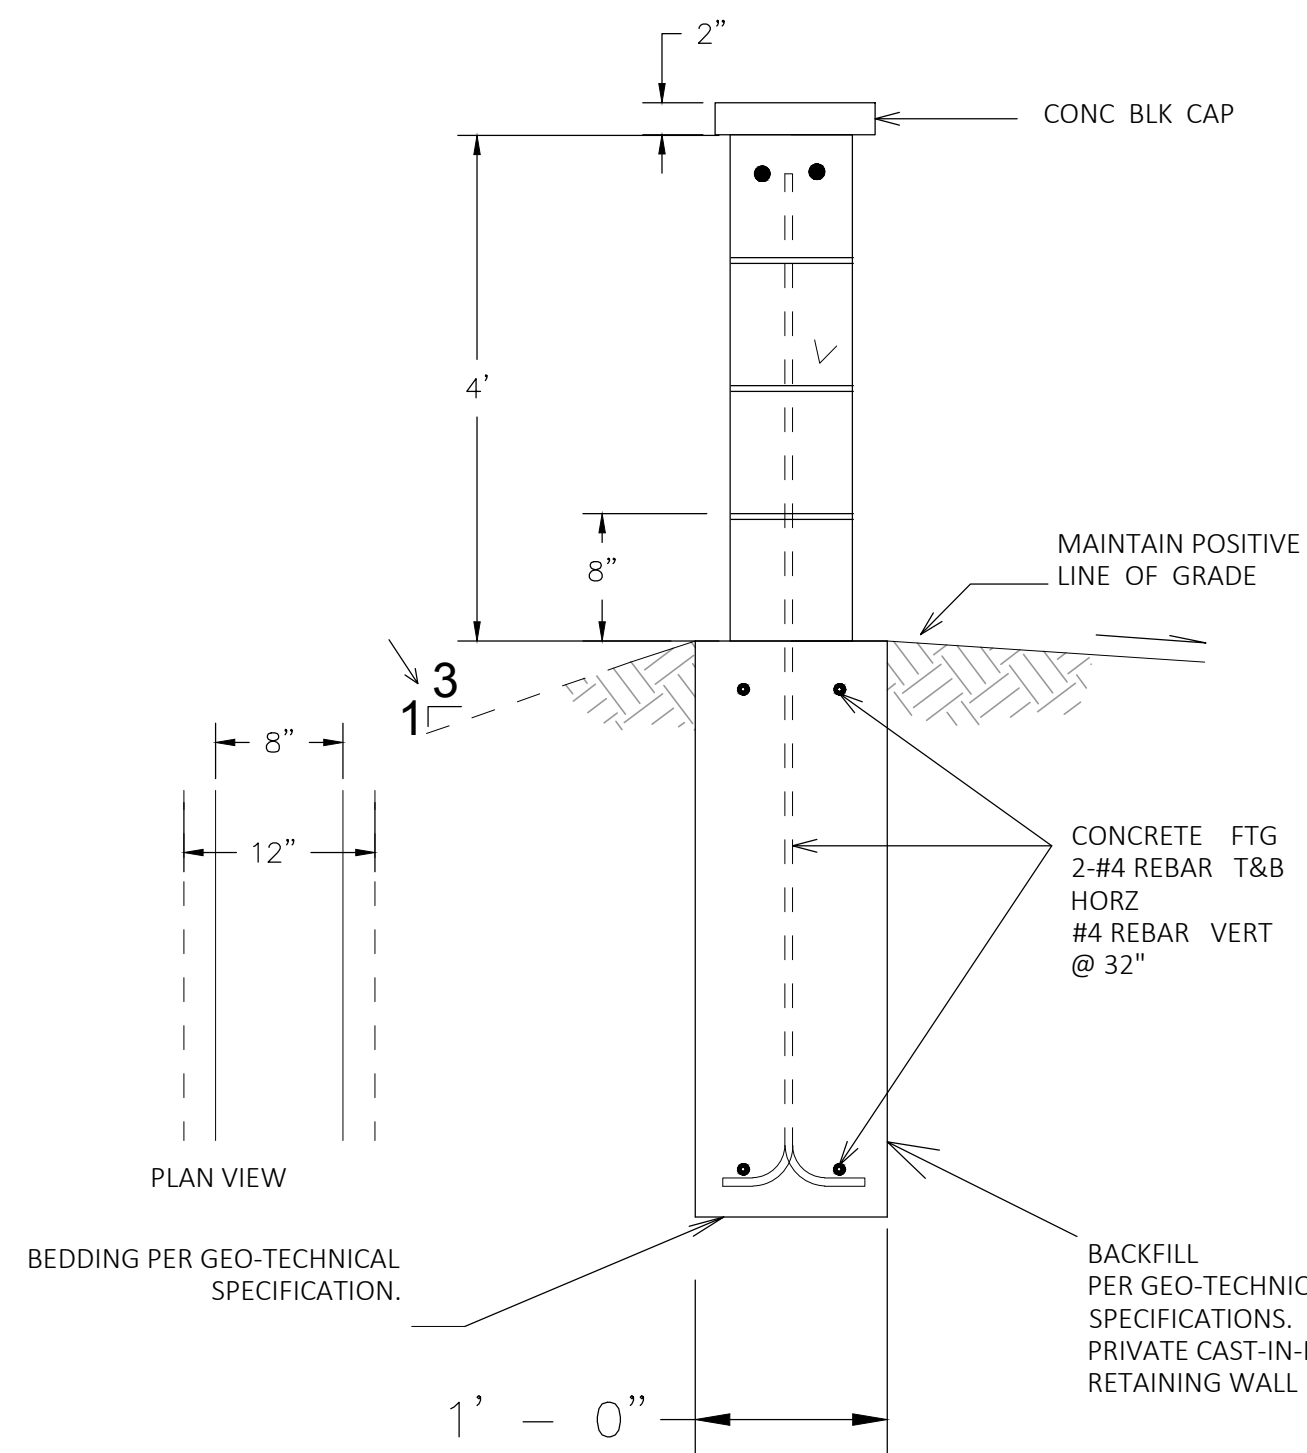


PRIVATE SCREENING WALL
N.T.S.


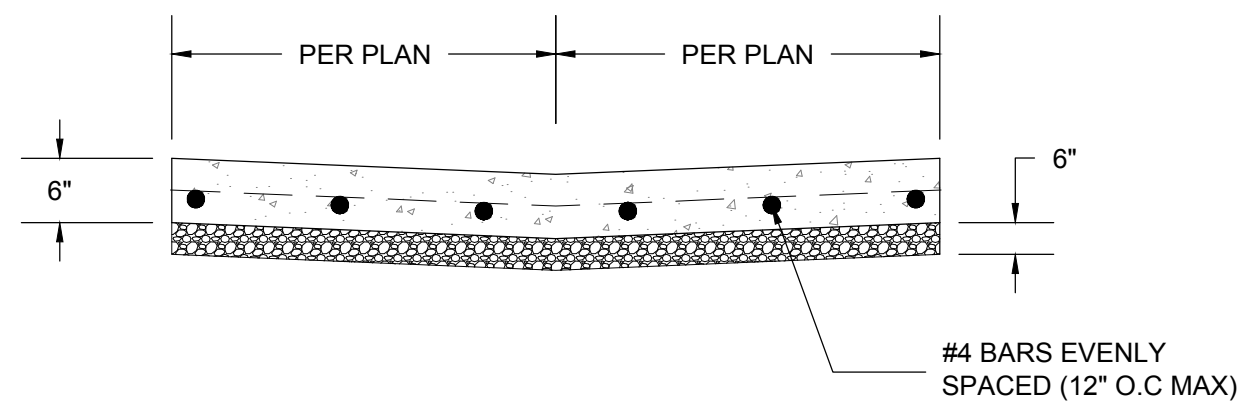


- NOTES:
- ALL CONCRETE TO BE 4500 PSI.
 - SUBGRADE TO BE COMPACTED PER GEOTECH.
 - PROVIDE CONTRACTION JOINT 10FT MAX.
 - 3/4" DEEP FROM LIP TO FL.
 - 6" OF CLASS 6 BASE PER GEOTECH REPORT.

V- PAN
N.T.S.

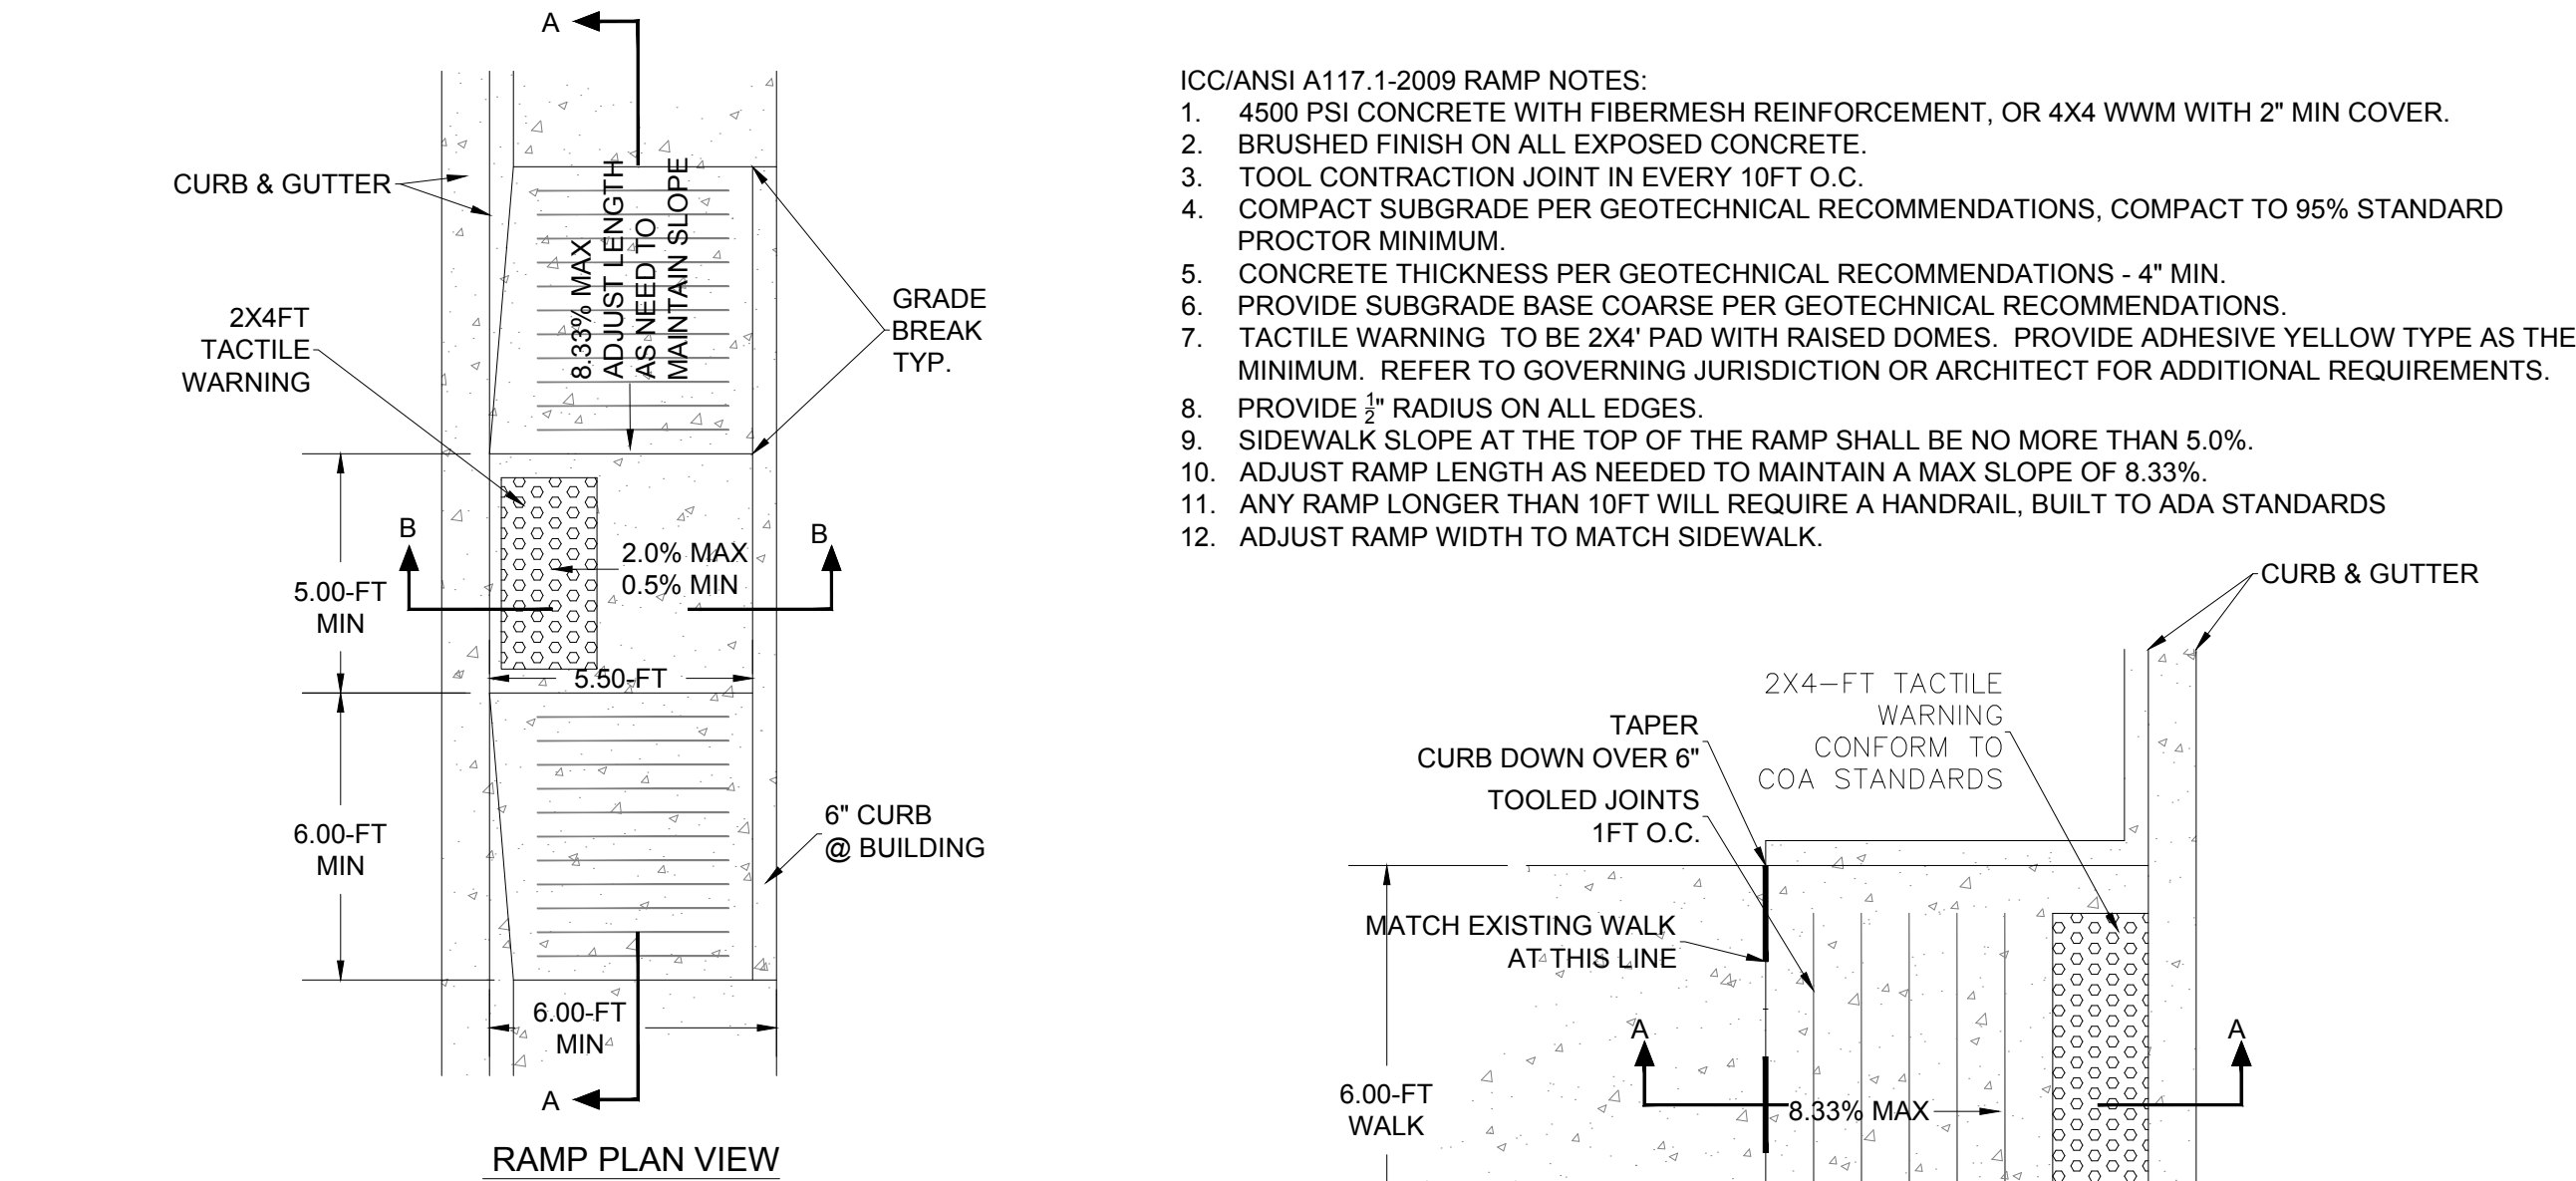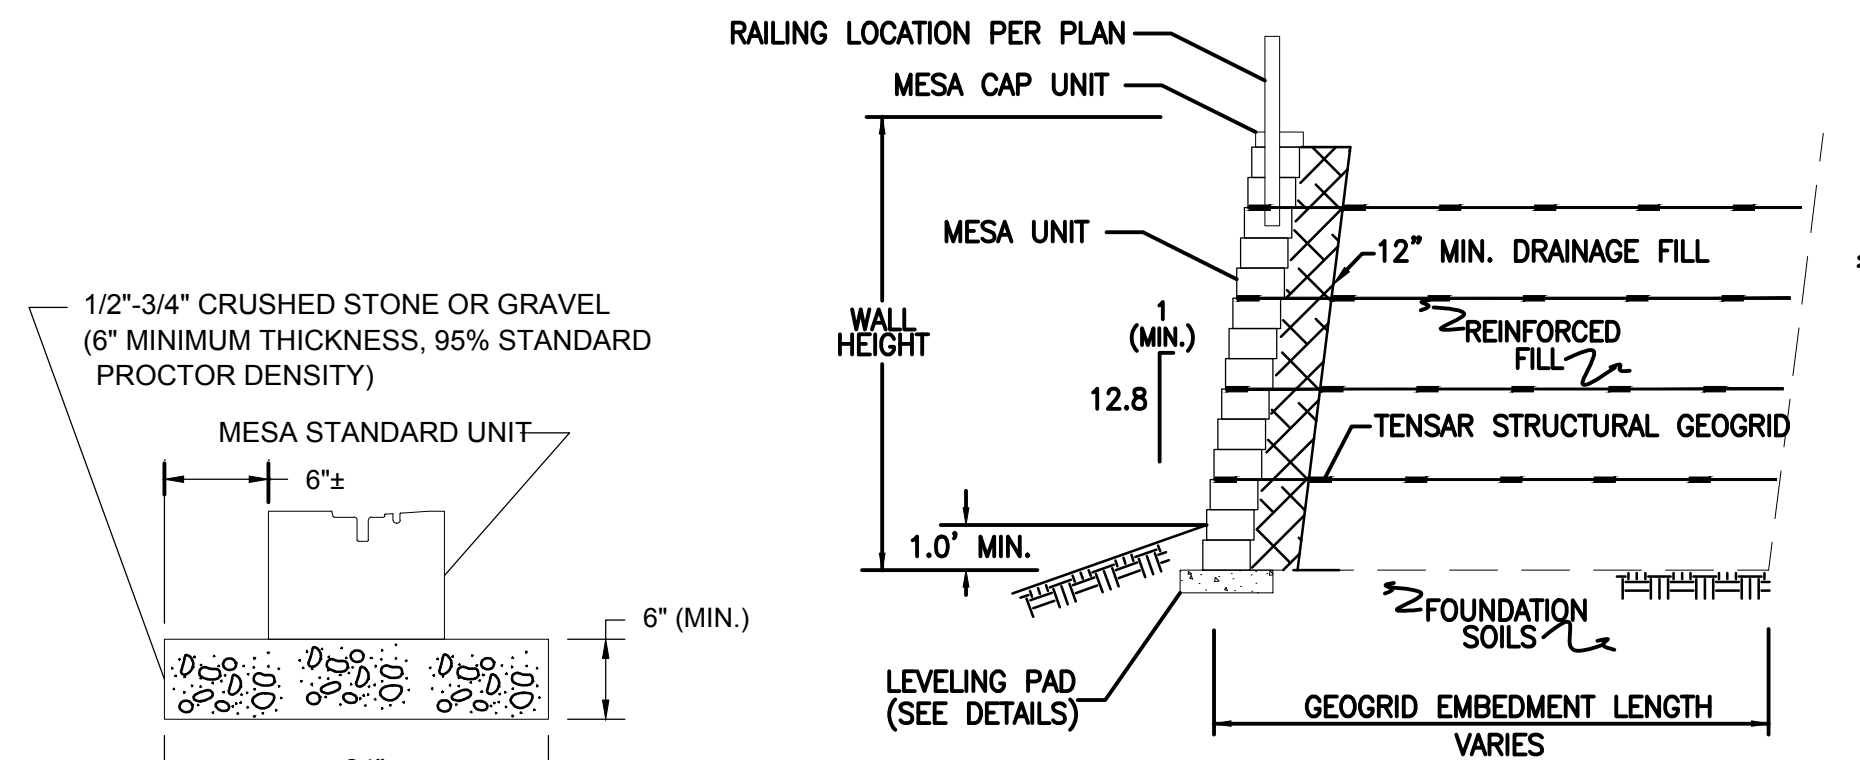

- ICC/ANSI A117.1-2009 RAMP NOTES:
- 4500 PSI CONCRETE WITH FIBERMESH REINFORCEMENT, OR 4X4 WWM WITH 2" MIN COVER.
 - BRUSHED FINISH ON ALL EXPOSED CONCRETE.
 - TOOL CONTRACTION JOINT IN EVERY 10FT O.C.
 - COMPACT SUBGRADE PER GEOTECHNICAL RECOMMENDATIONS, COMPACT TO 95% STANDARD PROCTOR MINIMUM.
 - CONCRETE THICKNESS PER GEOTECHNICAL RECOMMENDATIONS - 4" MIN.
 - PROVIDE SUBGRADE BASE COARSE PER GEOTECHNICAL RECOMMENDATIONS.
 - TACTILE WARNING TO BE 2X4" PAD WITH RAISED DOMES. PROVIDE ADHESIVE YELLOW TYPE AS THE MINIMUM. REFER TO GOVERNING JURISDICTION OR ARCHITECT FOR ADDITIONAL REQUIREMENTS.
 - PROVIDE 3/4" RADIUS ON ALL EDGES.
 - SIDEWALK SLOPE AT THE TOP OF THE RAMP SHALL BE NO MORE THAN 5.0%.
 - ADJUST RAMP LENGTH AS NEEDED TO MAINTAIN A MAX SLOPE OF 8.33%.
 - ANY RAMP LONGER THAN 10FT WILL REQUIRE A HANDRAIL, BUILT TO ADA STANDARDS
 - ADJUST RAMP WIDTH TO MATCH SIDEWALK.

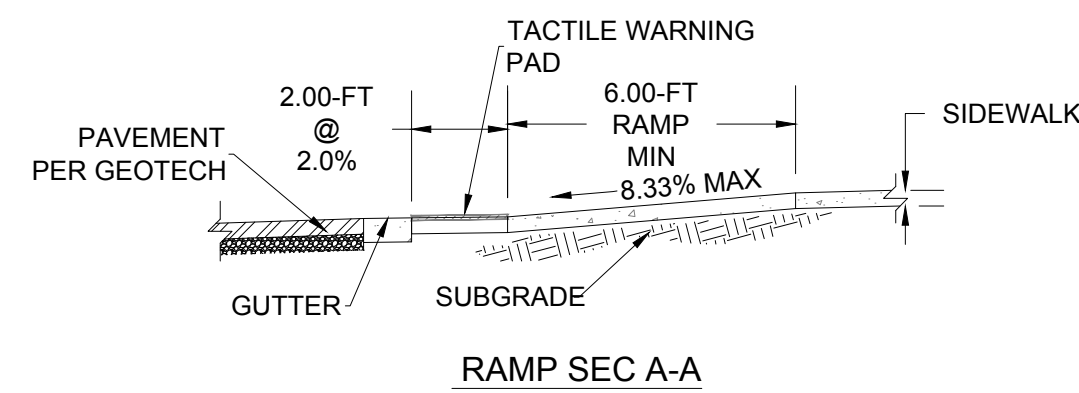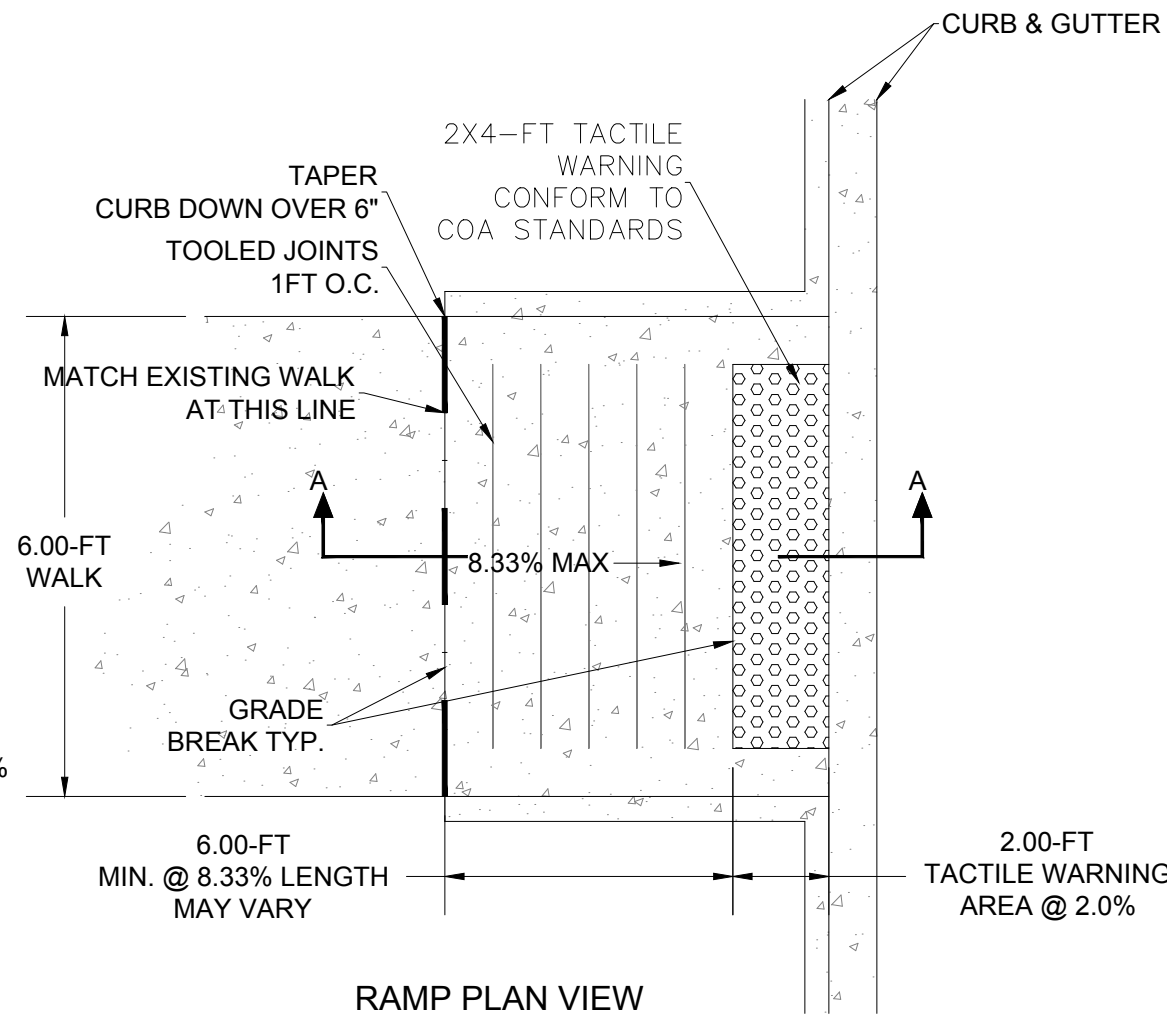

HCI ENGINEERING
A DIVISION OF
HABERER CARPENTRY INC.
801 SOUTH PARK BLVD., SUITE 700
LITTLETON CO. 80120
INFO@HABERERGROUP.COM
WWW.HABERERGROUP.COM

MARK D. MCCLUGGAGE AIA, CCS
1225 S. W. 10TH AVE., SUITE 100
DENVER, CO 80202
Tel: (316) 282-3347 Fax: (316) 282-5446
www.gimv.com



VERTEX
Main: 303.623.9116 | Direct: 720.545.0459
3734 Osage Street | Denver, CO 80211
CONTACT: LANCE VANDEMARK, P.E.

12134.240
△ EPC 1ST SUB 09.28.16
△ EPC 2ND SUB 10.31.16
△ DRB 1ST SUB 03.02.17
△
△
△
△
△
△
△
△

CONTRACT DATE: JUNE 07, 2016
BUILDING TYPE: EXP. LITE MED40
PLAN VERSION: SEPTEMBER 2015
SITE NUMBER:
STORE NUMBER:

TACO BELL
UNSER BLVD NW & LADERA
ALBUQUERQUE, NM 87114

TACO BELL
EXPLORER LITE
MEDIUM40

DETAILS SHEET 1

C4.0