
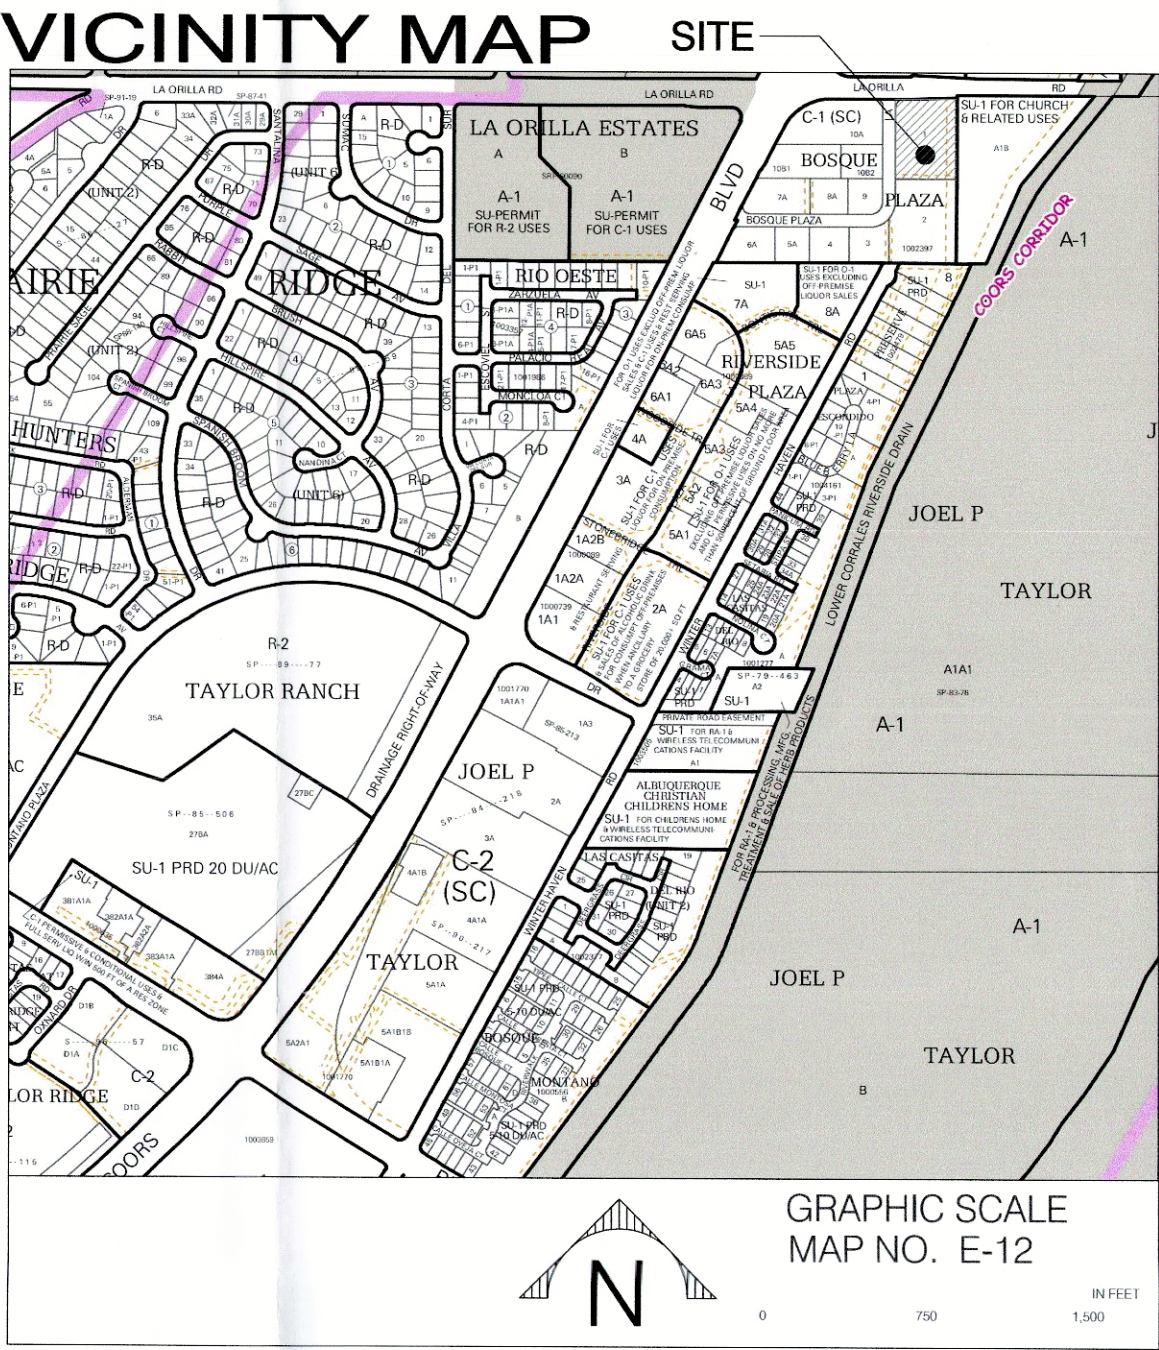


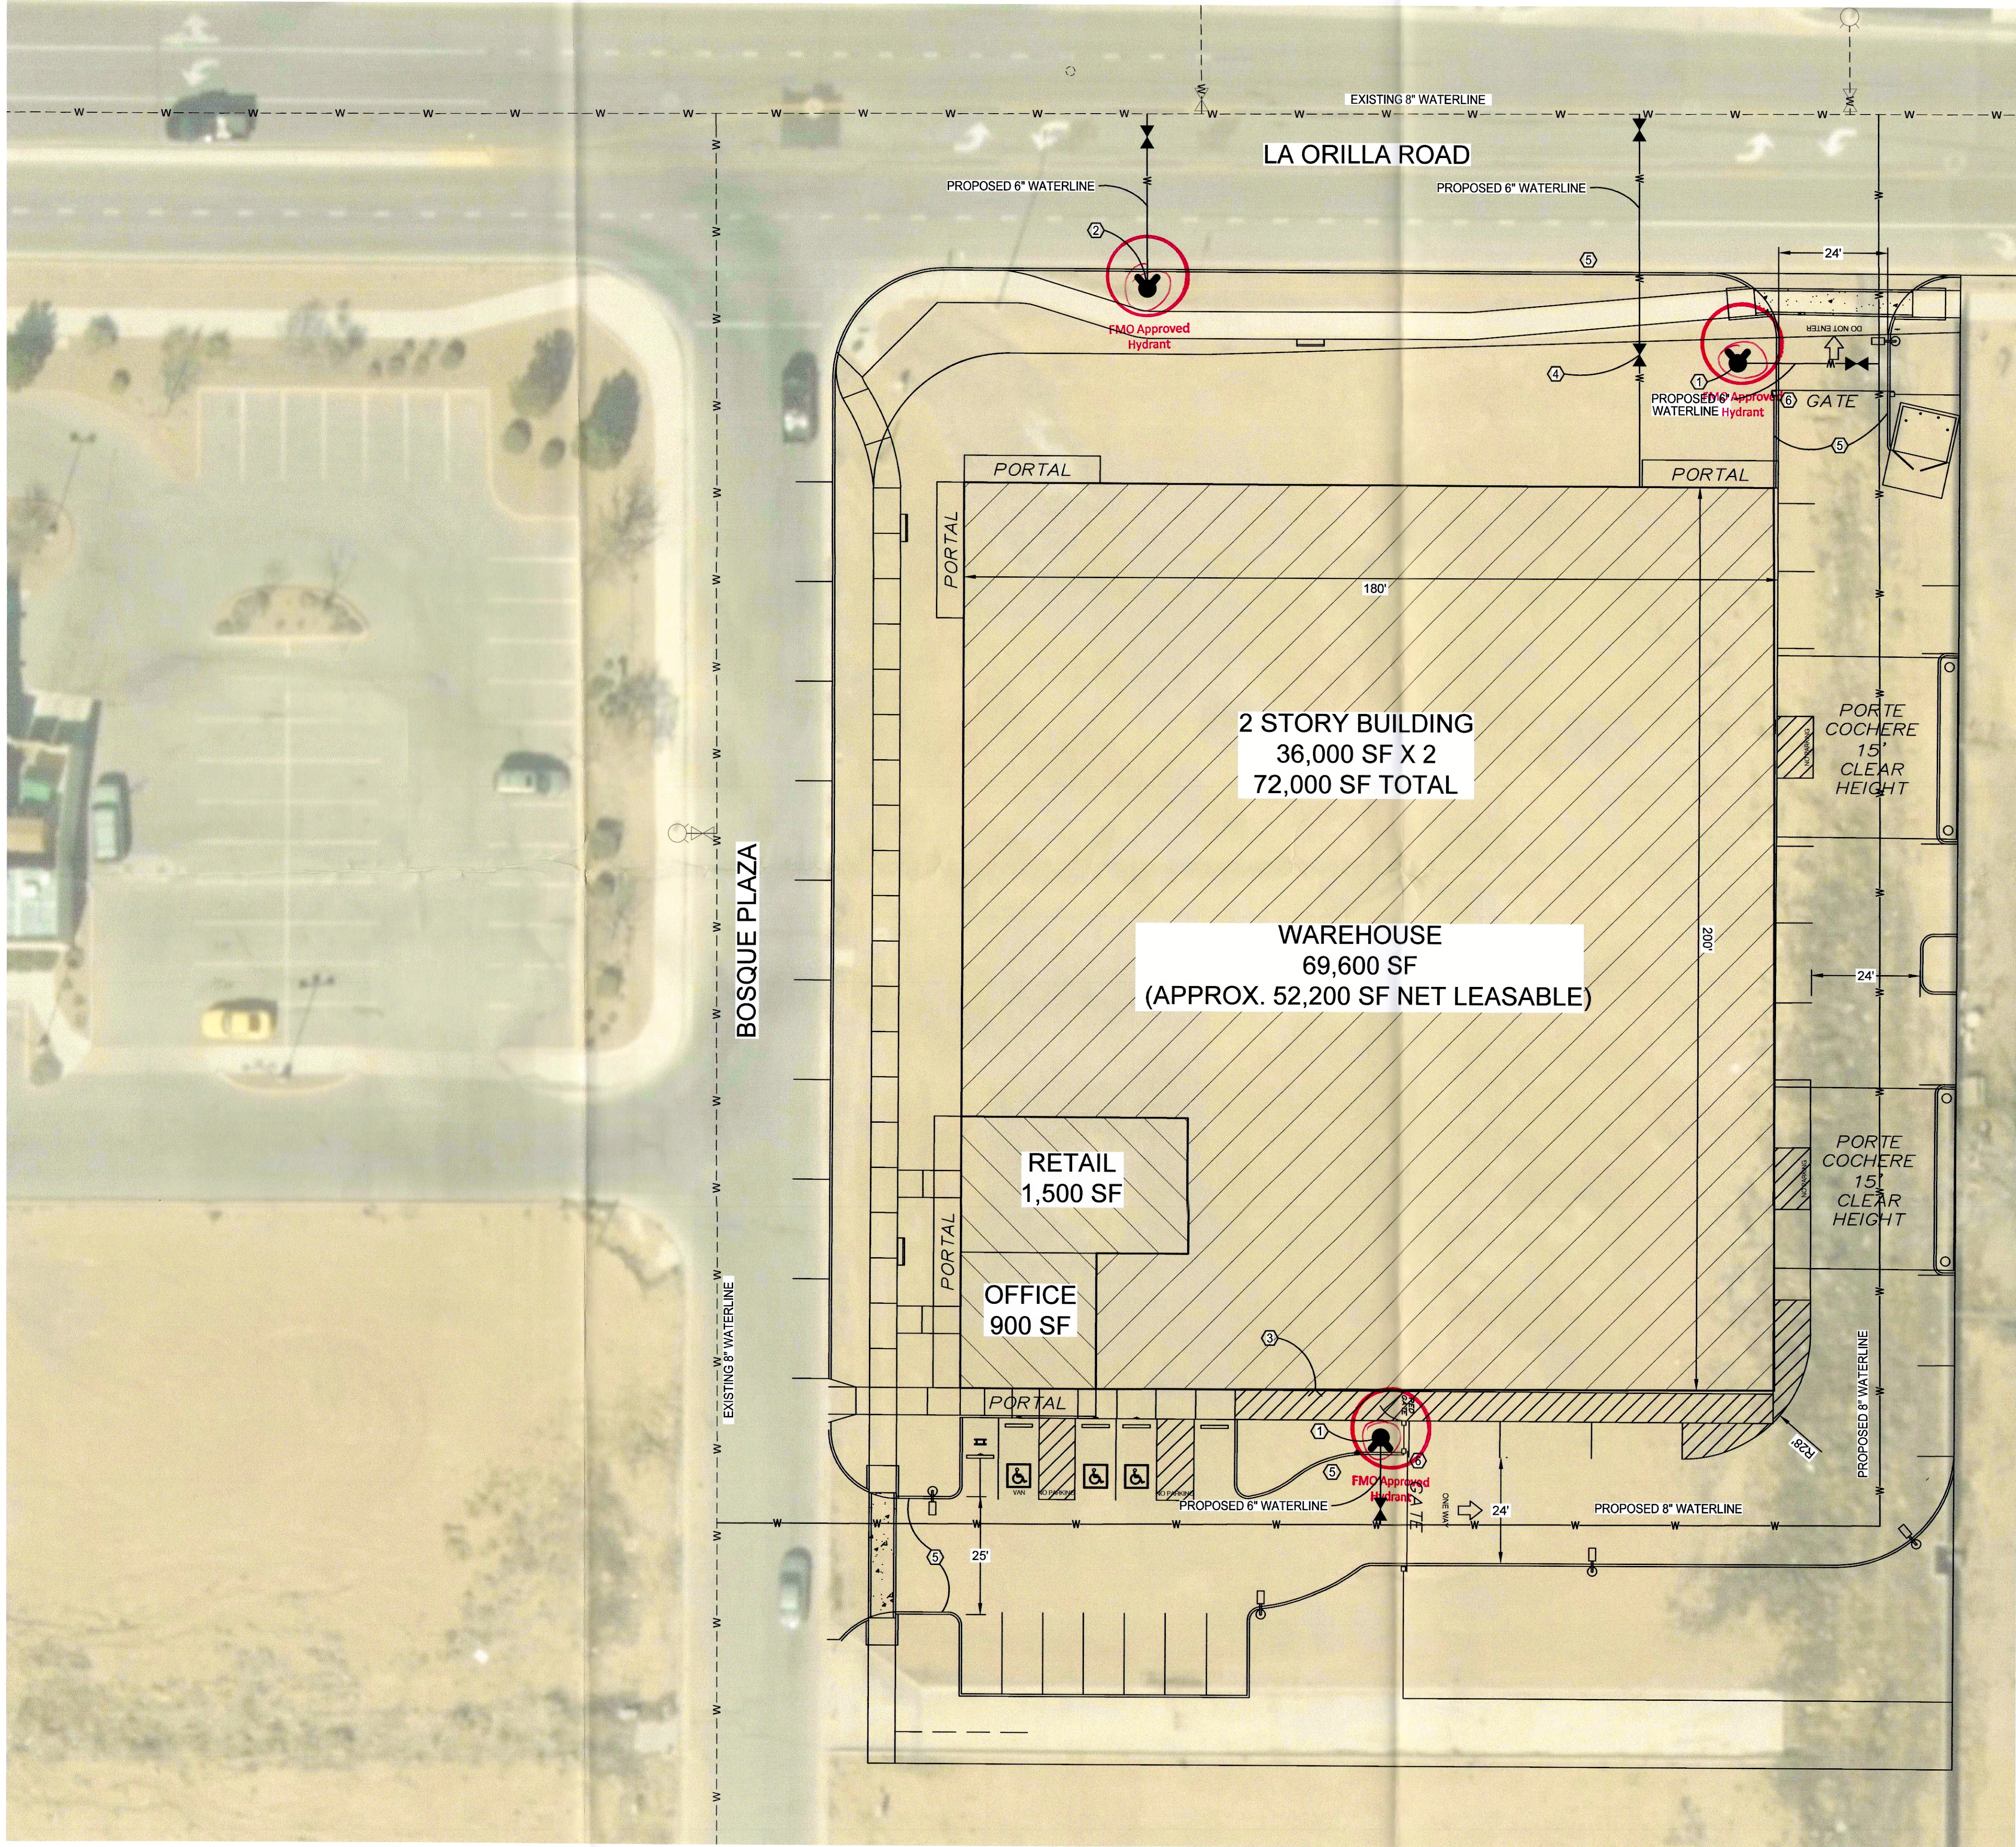

- KEYED NOTES**
- PROPOSED PRIVATE FIRE HYDRANT (PAINTED ORANGE)
 - PROPOSED PUBLIC FIRE HYDRANT
 - PROPOSED FIRE DEPARTMENT CONNECTION (FDC)
 - PROPOSED POST INDICATOR VALVE (PIV)
 - FIRE LANE DESIGNATION - PAINT CURB RED WITH ALTERNATING "NO PARKING" AND "FIRE LANE" TEXT @ 50' INTERVALS, MAX.
 - KNOX BOX LOCATION

BUILDING HEIGHT: 26-FEET
BUILDING AREA: 72,000 SF
CONSTRUCTION TYPE: IIB, FIRE SPRINKLER SYSTEM
FIRE FLOW TYPE: 2.875 GALLONS/MINUTE, 3 FIRE HYDRANTS PROVIDED


FIRE DEPARTMENT HYDRANT AND ACCESS PERMIT CHECKLIST NOTES
SECURITY GATES:
SECURITY GATES THAT EXTEND ACROSS FIRE APPARATUS ACCESS ROADS OR IMPEDE FIRE APPARATUS ACCESS SHALL HAVE AN APPROVED MEANS OF OPERATION TO ALLOW FIRE DEPARTMENT ACCESS.

FIRE LANES:
ON SITE FIRE LANE ROAD SHALL BE MARKED ON BOTH SIDES, AS DIRECTED BY FIRE MARSHALL.

PREMISE ID:
BUILDINGS SHALL HAVE APPROVED ADDRESS NUMBERS OR BUILDING IDENTIFICATION PLACED IN A POSITION PLAINLY LEGIBLE AND VISIBLE FROM THE STREET OR THE ROAD FRONTING THE PROPERTY.

ACCESS AND LOADING:
AN APPROVED FIRE APPARATUS ACCESS ROADS SHALL HAVE AN ASPHALT, CONCRETE, OR OTHER APPROVED DRIVING SURFACE CAPABLE OF SUPPORTING THE IMPOSED LOAD OF FIRE APPARATUS WEIGHING AT LEAST 75,000 POUNDS.

GRADE:
FIRE APPARATUS ACCESS ROADS SHALL NOT EXCEED 10 PERCENT IN GRADE.

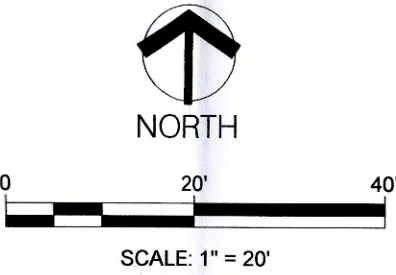

Designed By: HUITT-ZOLLARS Huitt-Zollars, Inc. 333 Rio Rancho Drive NE, Suite 101 Rio Rancho, New Mexico 87124 Phone (505) 892-5141 Fax (505) 892-3259	
GUARDIAN STORAGE BOSQUE PLAZA	
TITLE: FIRE 1 PLAN	
Design Review Committee	City Engineer
Mo./Day/Yr.	Mo./Day/Yr.
City Project No.	Zone Map No.
XXXXXXX	E-12-Z
Sheet	Of
C - 103	