


landscapiforms™ Drawing: PK163-03  
 Dimensions are in inches [mm]

CONFIDENTIAL DRAWING INFORMATION CONTAINED HEREIN IS THE PROPERTY OF LANDSCAPE FORMS, INC. INTENDED USE IS LIMITED TO DESIGN PROFESSIONALS SPECIFYING LANDSCAPE FORMS, INC. PRODUCTS AND THEIR DIRECT CLIENTS. DRAWING IS NOT TO BE COPIED OR DISCLOSED TO OTHERS WITHOUT THE CONSENT OF LANDSCAPE FORMS, INC. © 2013 LANDSCAPE FORMS, INC. ALL RIGHTS RESERVED.

NOTES:

- 1) CONTRACTOR SHALL USE THE SAME, OR CLOSEST EQUIVALENT, BENCH TO APPROVED MASTER PLANS
- 2) LOCATION TO BE SET IN THE FIELD.

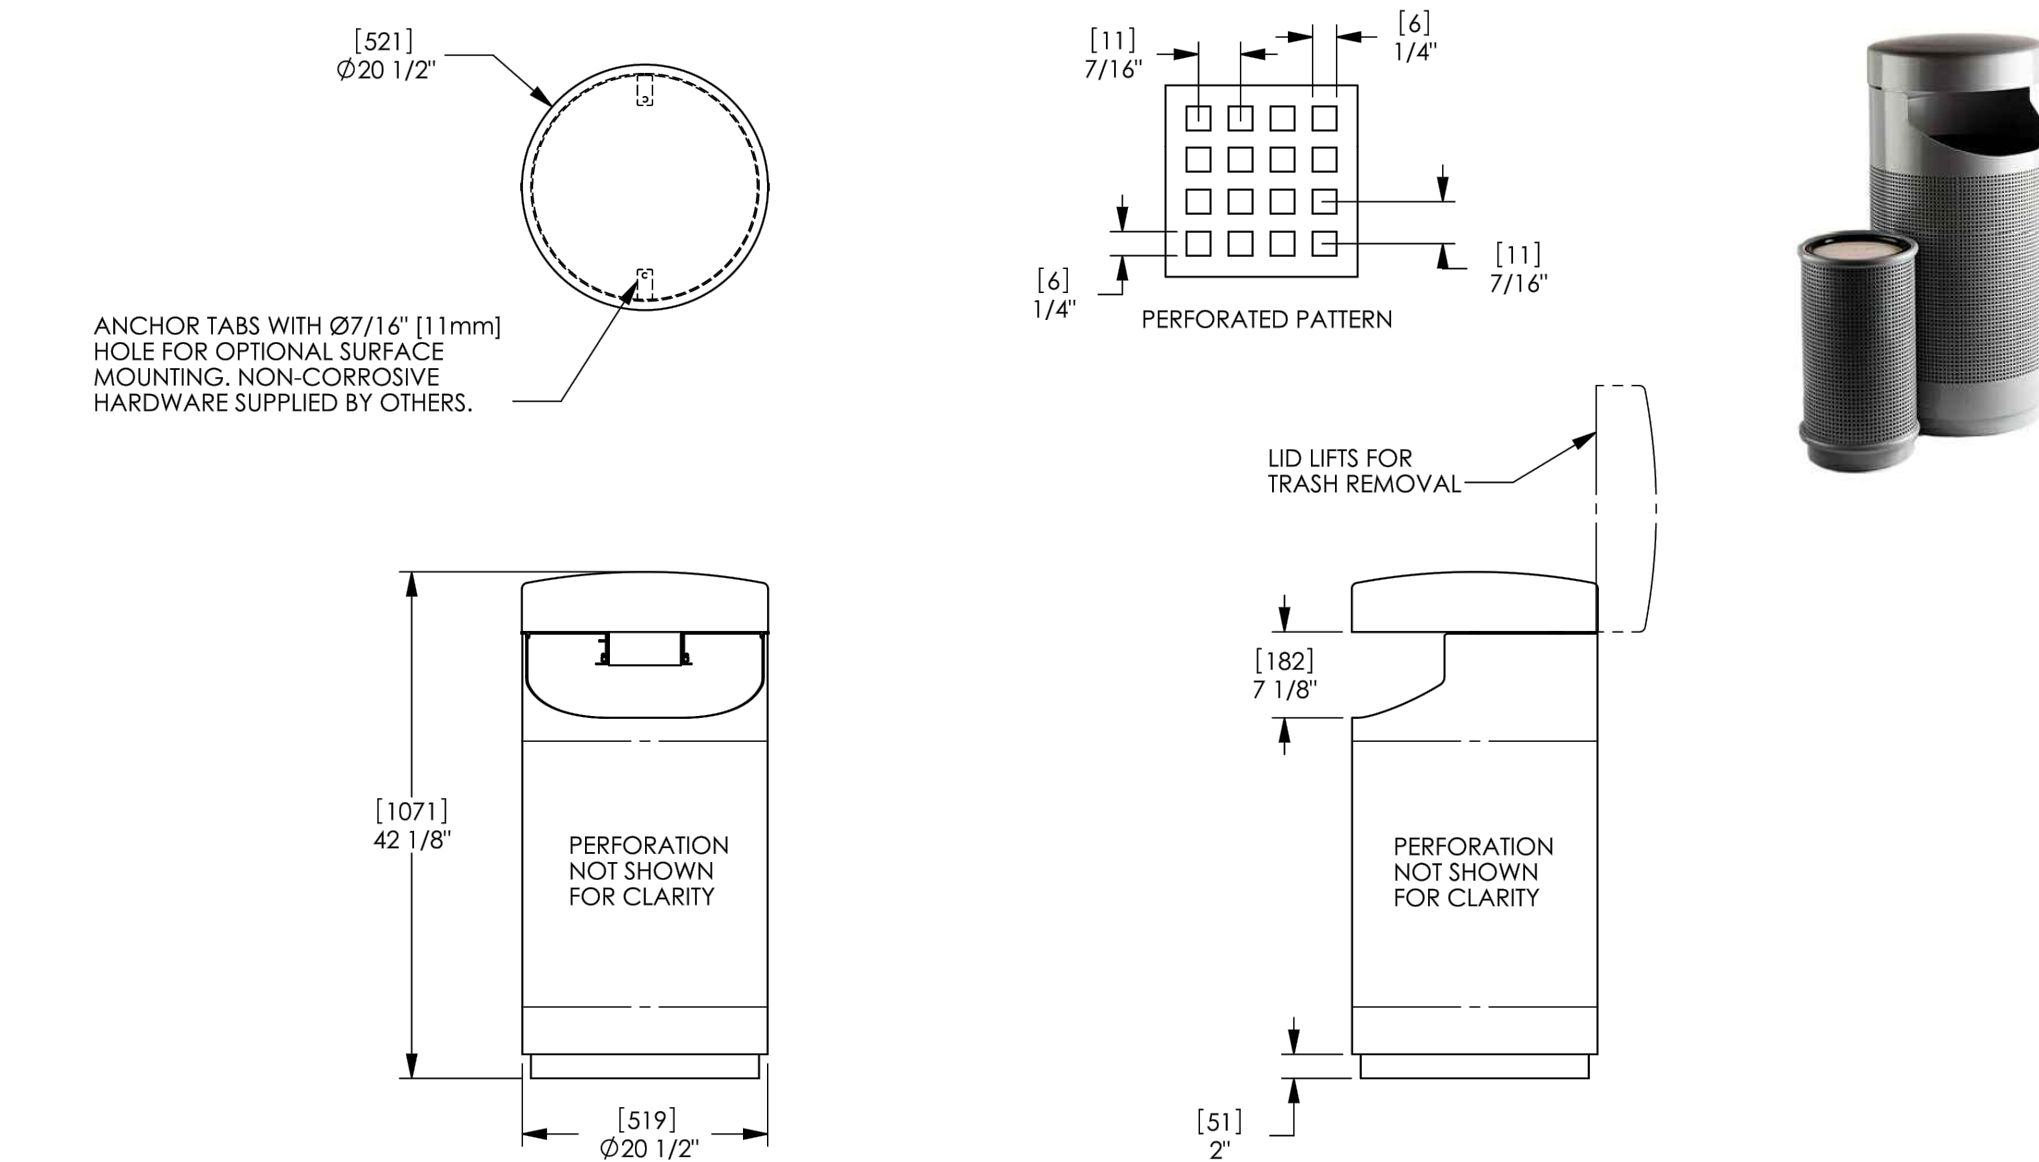


landscapiforms™ Drawing: PK166-01  
 Dimensions are in inches [mm]

CONFIDENTIAL DRAWING INFORMATION CONTAINED HEREIN IS THE PROPERTY OF LANDSCAPE FORMS, INC. INTENDED USE IS LIMITED TO DESIGN PROFESSIONALS SPECIFYING LANDSCAPE FORMS, INC. PRODUCTS AND THEIR DIRECT CLIENTS. DRAWING IS NOT TO BE COPIED OR DISCLOSED TO OTHERS WITHOUT THE CONSENT OF LANDSCAPE FORMS, INC. © 2014 LANDSCAPE FORMS, INC. ALL RIGHTS RESERVED.

NOTES:


- 1) CONTRACTOR SHALL USE THE SAME, OR CLOSEST EQUIVALENT, BENCH TO APPROVED MASTER PLANS
- 2) LOCATION TO BE SET IN THE FIELD.

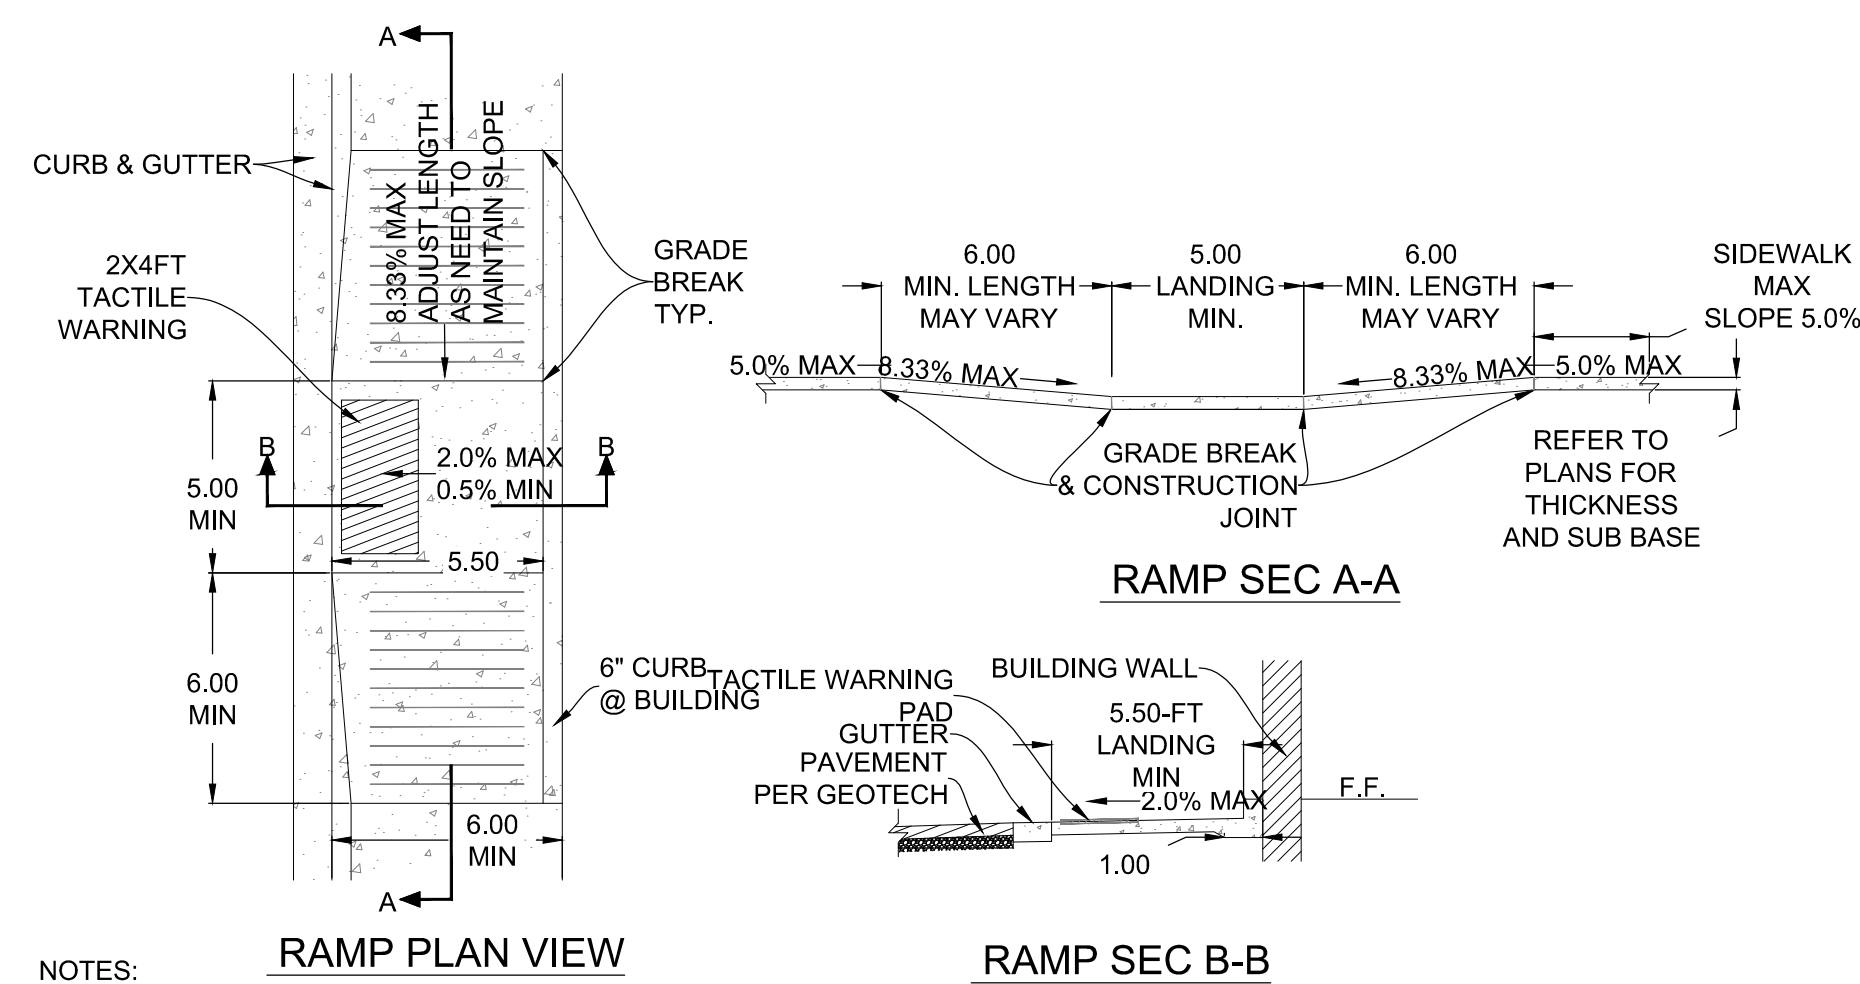


NOTES:

1. 5000 PSI CONCRETE WITH FIBERMESH REINFORCEMENT, OR 4X4 WWM WITH 2" MIN COVER.
2. BRUSHED FINISH ON ALL EXPOSED CONCRETE.
3. TOOL CONTRACTION JOINT IN EVERY 10FT O.C.
4. COMPACT SUBGRADE PER GEOTECHNICAL RECOMMENDATIONS, COMPACT TO 95% STANDARD PROCTOR MINIMUM.
5. CONCRETE THICKNESS PER GEOTECHNICAL RECOMMENDATIONS - 4" MIN.
6. PROVIDE SUBGRADE BASE COARSE PER GEOTECHNICAL RECOMMENDATIONS.
7. TACTILE WARNING TO BE 2X4 PAD WITH RAISED DOMES. PROVIDE ADHESIVE YELLOW TYPE AS THE MINIMUM. REFER TO GOVERNING JURISDICTION OR ARCHITECT FOR ADDITIONAL REQUIREMENTS.
8. PROVIDE 1/4" RADIUS ON ALL EDGES.
9. SIDEWALK SLOPE AT THE TOP OF THE RAMP SHALL BE NO MORE THAN 5.0%.
10. ADJUST RAMP LENGTH AS NEEDED TO MAINTAIN A MAX SLOPE OF 8.33%.
11. ANY RAMP LONGER THAN 10FT WILL REQUIRE A HANDRAIL, BUILT TO ADA STANDARDS
12. ADJUST RAMP WIDTH TO MATCH SIDEWALK.

TWO WAY ADA RAMP W/ LANDING  
 N.T.S.

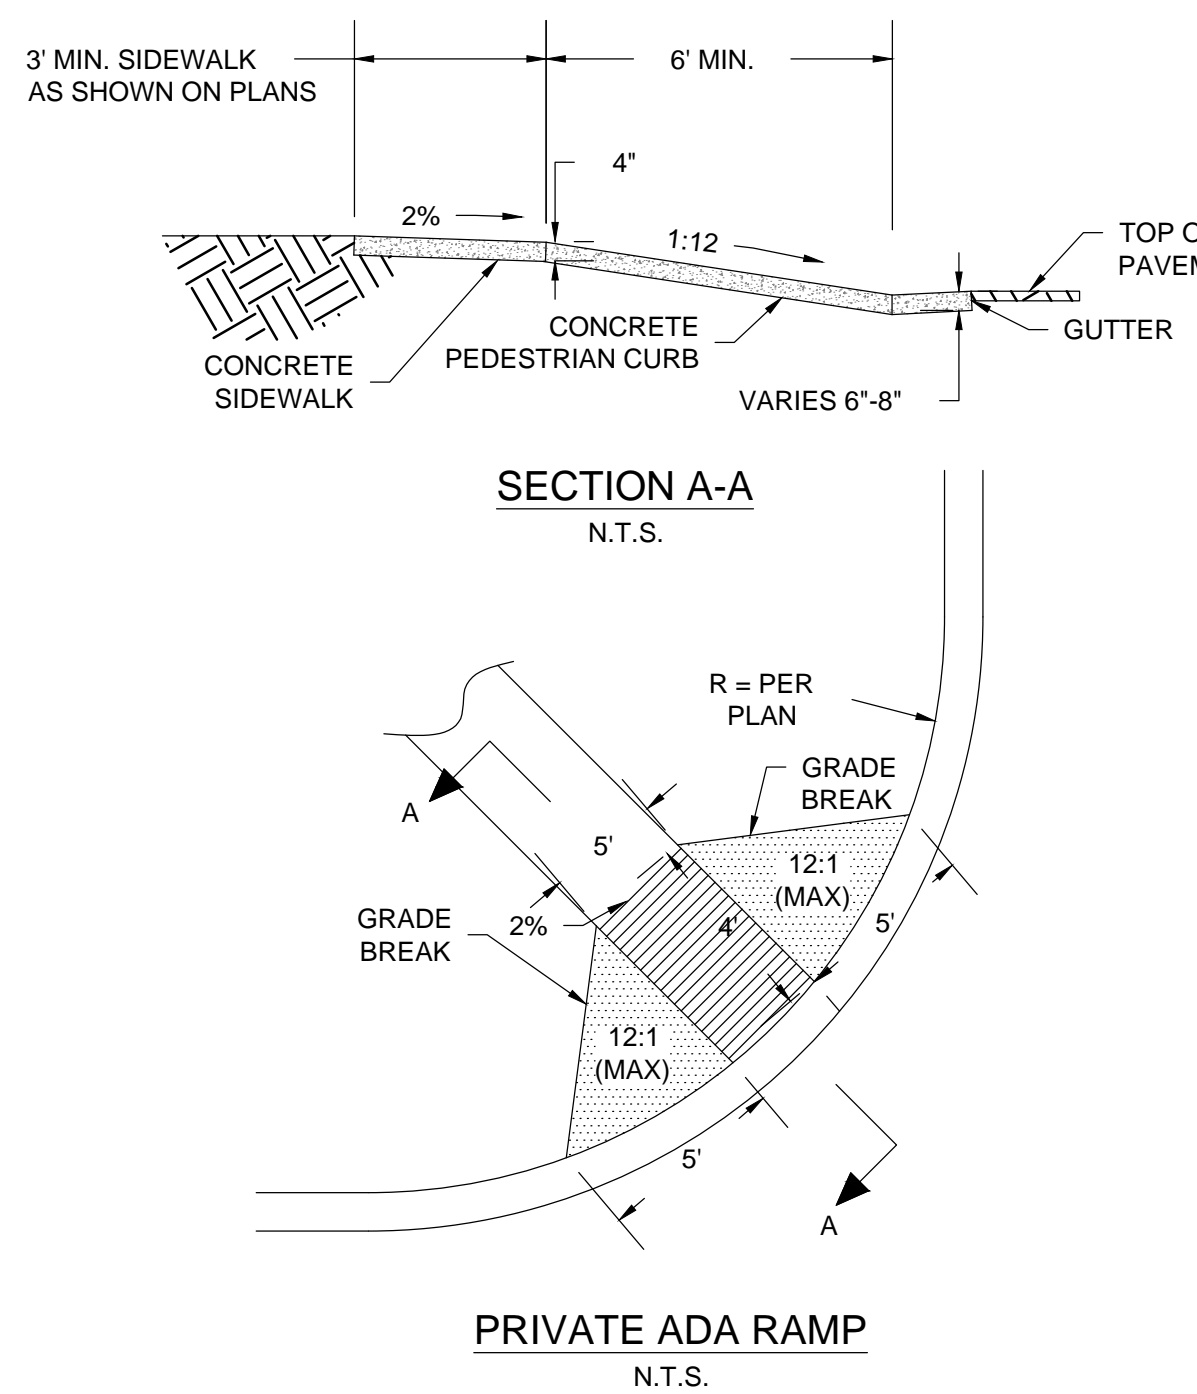


PRIVATE ADA RAMP  
 N.T.S.

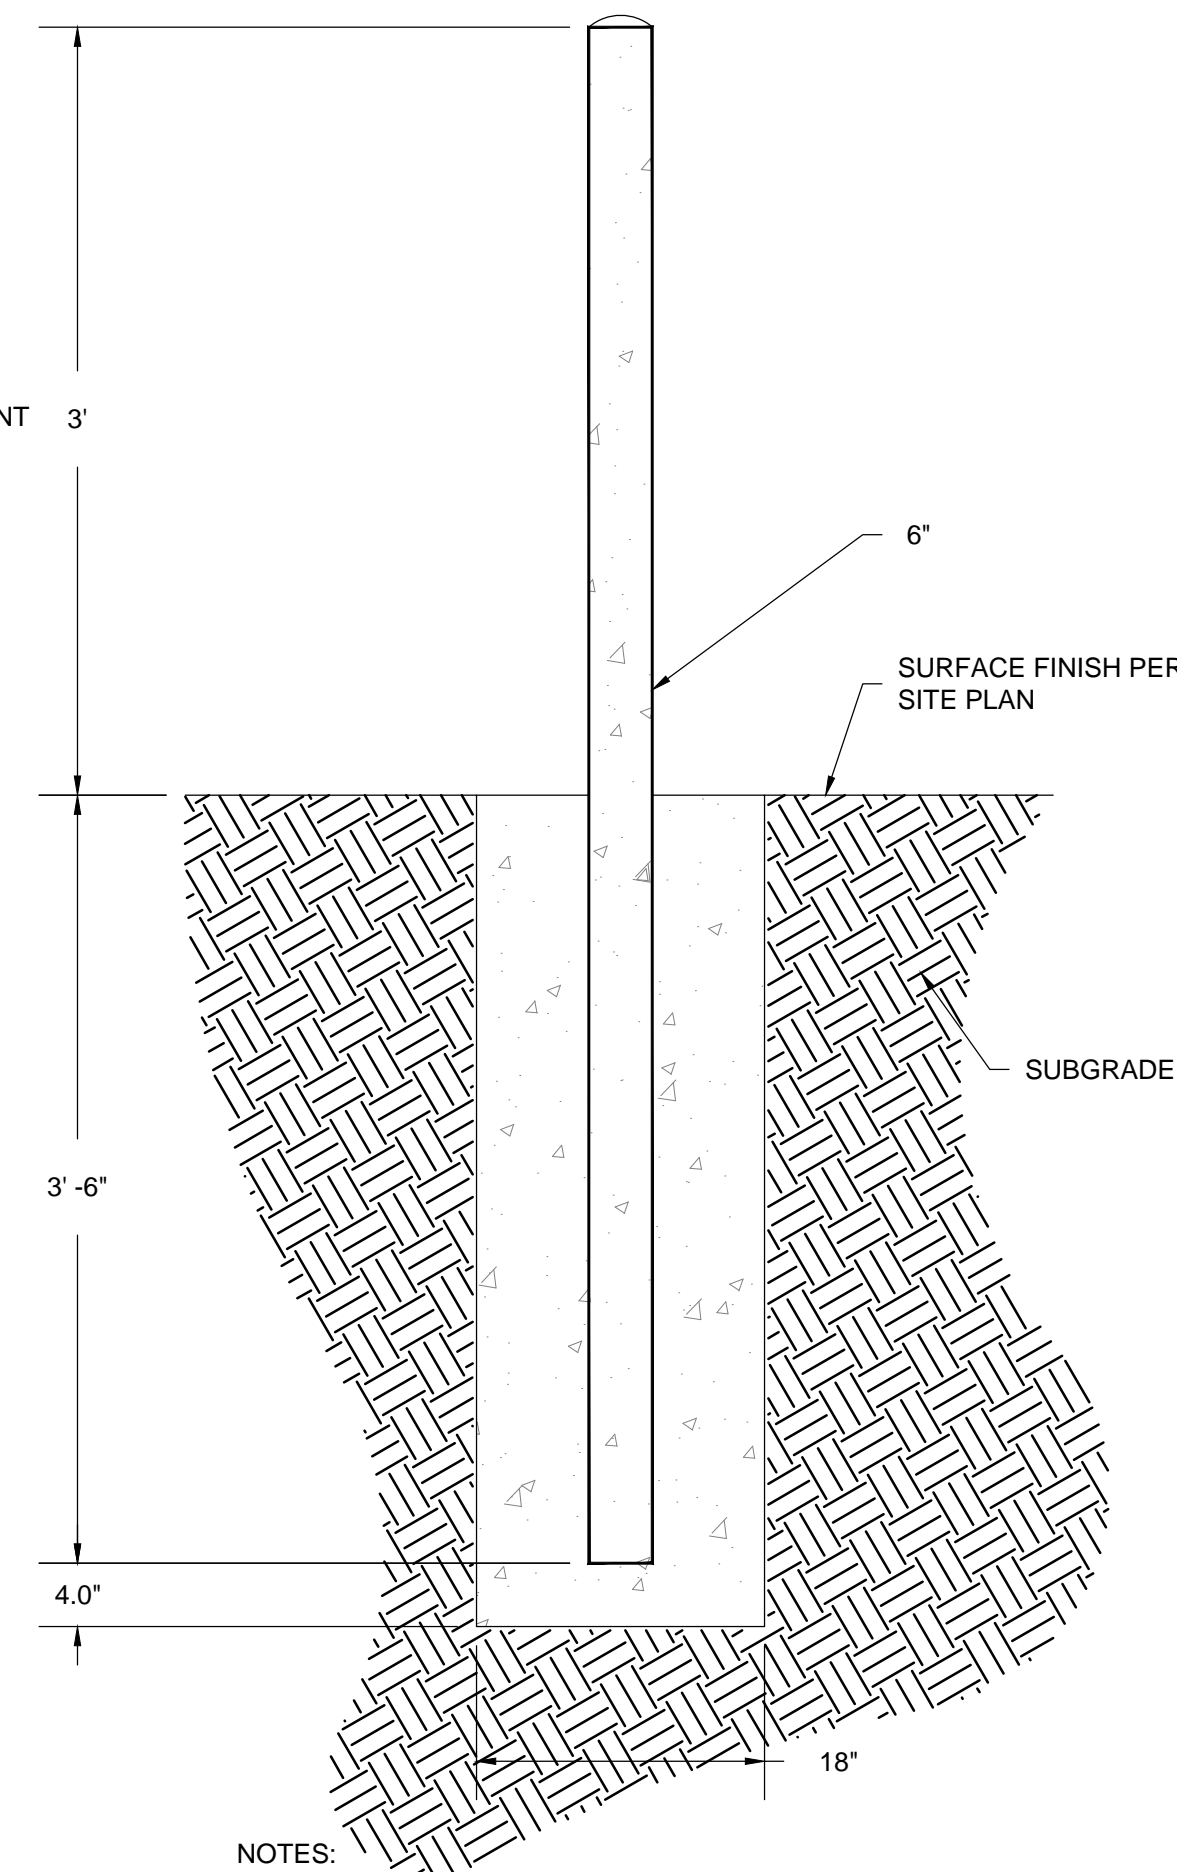


NOTES:

1. CONCRETE SHALL BE 4000 PSI MIN.
2. SUBGRADE SHALL BE PREPARED PER GEOTECH REPORT.
3. REFER TO SITE PLAN FOR BOLLARD LOCATION AND SIZE.
4. BOLLARD SHALL BE SCH 40 GALVANIZED STEEL PIPE PAINTED OSHA YELLOW AND FILLED WITH CONCRETE.


BOLLARD DETAILS  
 N.T.S.

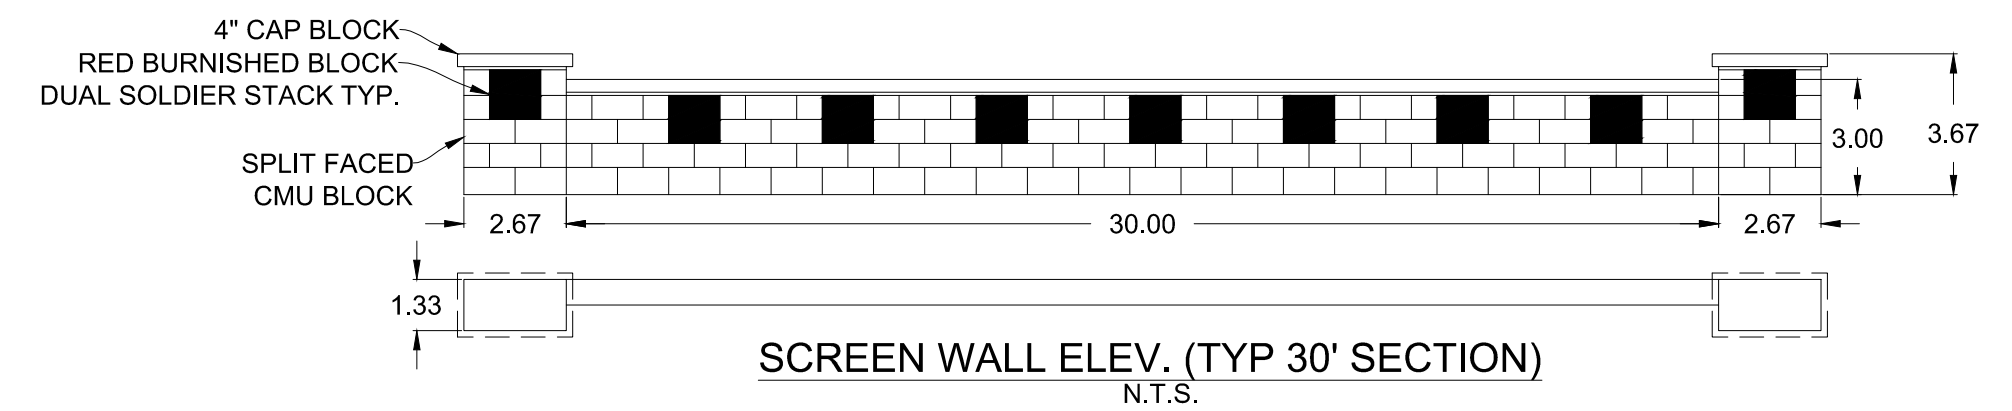

SCREEN WALL ELEV. (TYP 30' SECTION)  
 N.T.S.

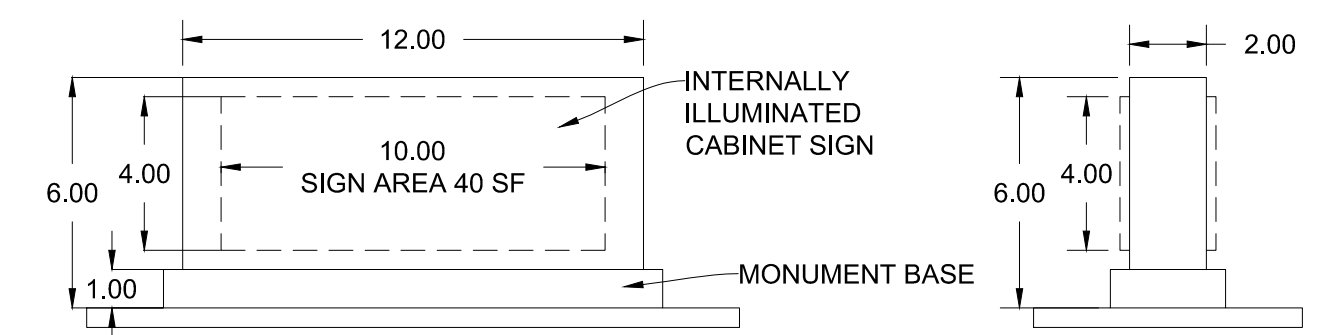


MONUMENT SIGN ELEVATIONS (SIGN TYPE A)  
 N.T.S.

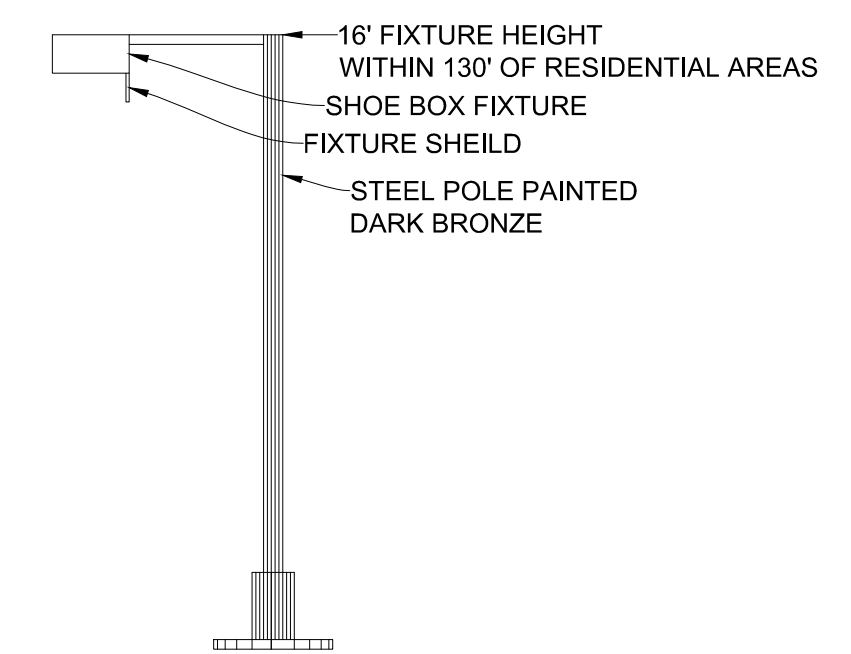

NOTES:


- 1) LIGHTS TO BE HORIZONTAL LAMPS WITH SHIELDED FIXTURES
- 2) RE: ARCHITECTURAL DESIGN GUIDELINE DRAWING FOR ADDITIONAL LIGHTING INFORMATION

LIGHT POLE DETAIL  
 N.T.S.

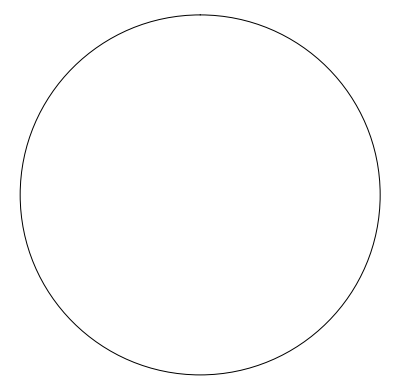

12134.150

△EPC 1ST SUB 03.30.16  
 △EPC 2ND SUB 05.02.16

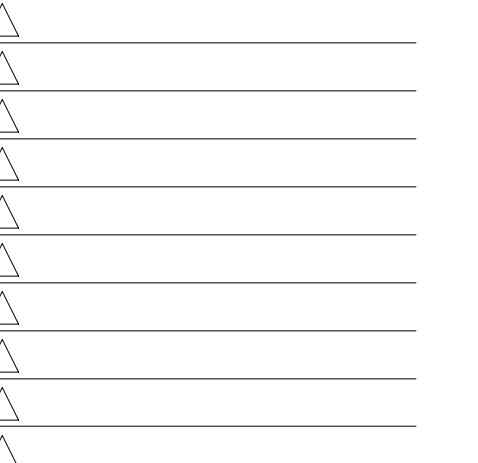

CONTRACT DATE: APRIL 24, 2016  
 BUILDING TYPE: EXPLORER MED54  
 PLAN VERSION: ARRIL 2015 (N)  
 SITE NUMBER:  
 STORE NUMBER:

TACO BELL

UNSER BLVD  
 ALBUQUERQUE, NM 87114



EXPLORER  
 MEDIUM40

DETAIL  
 SHEET 2

D2.0