

TWO WAY CLEANOUT DETAIL
NTS

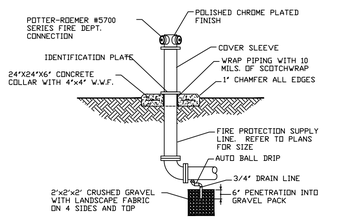

FREE STANDING FIRE DEPARTMENT CONNECTION DETAIL
NTS



POST INDICATOR VALVE
NTS

NOTES:

1. ALL MECHANICAL JOINTS SHALL BE RESTRAINED AT THE FITTING.
2. THE CONTRACTOR SHALL PROVIDE A MINIMUM PIPE LENGTH OF 20 LF FROM ALL MECHANICAL JOINTS. ALL PIPE JOINTS WITHIN 20 LF OF A MECHANICAL JOINT SHALL BE RESTRAINED AT THE CONTRACTOR'S EXPENSE.
3. THE CONTRACTOR SHALL RESTRAIN ALL PIPE JOINTS IN THE SPECIFIED DISTANCE LISTED IN THE TABLE ON THIS SHEET.
4. THE CONTRACTOR SHALL RESTRAIN ALL FIRE HYDRANT JOINTS FROM THE TEE ON THE MAIN TO THE FIRE HYDRANT FLANGE.

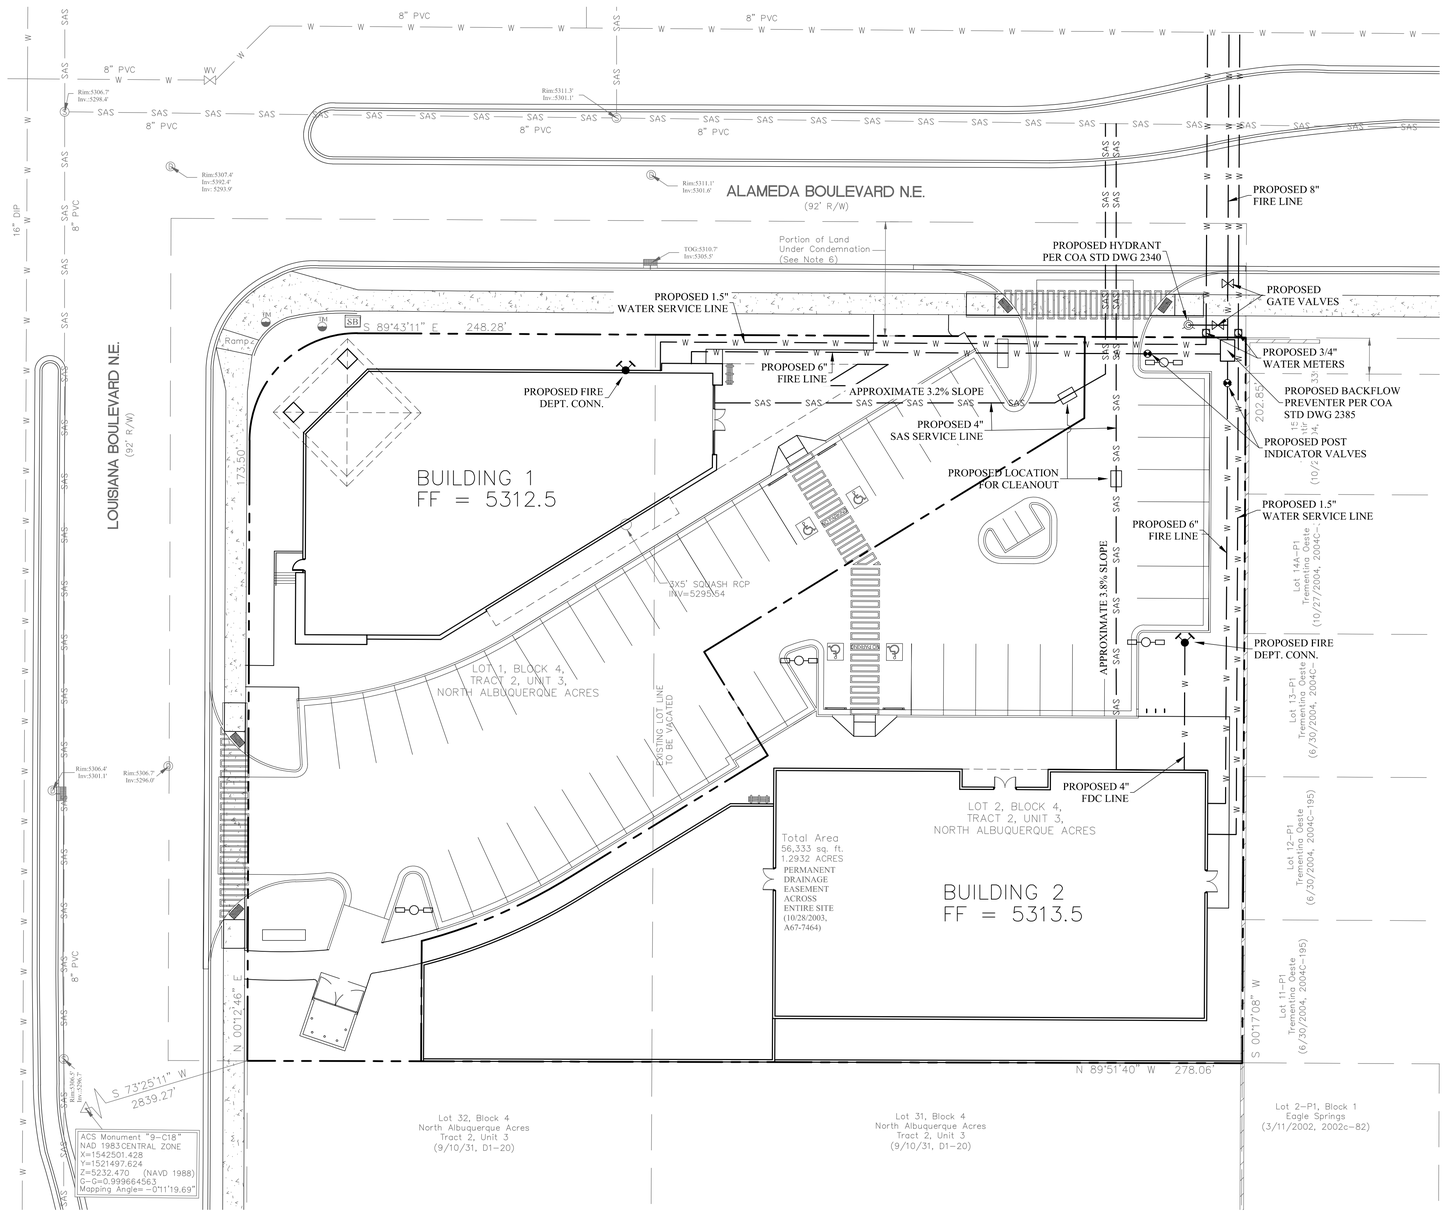

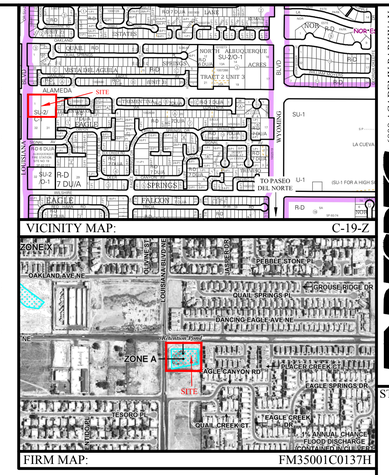

GENERAL NOTE:
ALL EXISTING UTILITY LOCATIONS AND DETAILS ARE FOR INFORMATION ONLY. THE CONTRACTOR SHALL POTHOLE TO VERIFY ALL EXISTING UTILITIES.

LEGEND

- SANITARY SEWER MANHOLE
- WATER VALVE
- STORM DRAIN MANHOLE
- TRAFFIC MAST
- SIGNAL BOX
- INLET GRATE
- EXISTING WATER LINE
- PROPOSED WATER LINE
- EXISTING SAS LINE
- PROPOSED SAS LINE

ISSUED FOR DRB SITE PLAN

RESPEC
WATER & NATURAL RESOURCES
6808 ACADEMY PARKWAY EAST NE, BUILDING C2
ALBUQUERQUE, NM 87109
PHONE: 505.253.9810

REVISION			
DESIGNED	HWF		
DRAWN	JWS		
CHECKED	HWF		
DATE	11/14/2016		

STAMP

HUGH W. FLOYD NEW MEXICO 16633 11/14/16 LICENSED PROFESSIONAL ENGINEER

LEGAL DESCRIPTION:
PORTIONS OF LOTS 1 & 2, BLOCK 4, TRACT 2, UNIT 3 OF NORTH ALBUQUERQUE ACRES IN BERNALILLO COUNTY, NEW MEXICO

ALAMEDA & LOUISIANA COMMERCIAL DEVELOPMENT

UTILITY PLAN

GRAPHIC SCALE
(IN FEET)
1 inch = 20 ft.
40 20 10 0 20

SHEET NUMBER:
C-2