


- ### ○ WATERLINE KEYNOTES
- CONNECT TO EXISTING WATER LINE. CONTRACTOR SHALL FIELD VERIFY EXISTING SIZE AND LOCATION AND NOTIFY ENGINEER WITH ANY DISCREPANCIES.
 - INSTALL 6"x3" TEE, 3" GATE VALVE WITH BOX AND LID PER COA STD DWG 2326.
 - REMOVE AND RE-USE EXISTING FIRE HYDRANT.
 - INSTALL 6" GATE VALVE WITH BOX & LID PER COA STD DWG 2326.
 - NOT USED.
 - INSTALL 6"x6" TEE, 6" GATE VALVE WITH BOX & LID PER COA STD DWG 2326, & INSTALL FIRE HYDRANT PER COA STD DWG 2340.
 - INSTALL 90° BEND (SIZE PER PLAN) W/ RESTRAINED JOINTS.
 - INSTALL 45° BEND (SIZE PER PLAN) W/ RESTRAINED JOINTS.
 - INSTALL 22.5° BEND (SIZE PER PLAN) W/ RESTRAINED JOINTS.
 - INSTALL 11.25° BEND (SIZE PER PLAN) W/ RESTRAINED JOINTS.
 - NOT USED.
 - INSTALL 1-3" DOMESTIC REDUCED PRESSURE BACKFLOW PREVENTION DEVICE AND 1-6" FIRE LINE REDUCED PRESSURE BACKFLOW PREVENTION DEVICE WITHIN A DUAL HEATED ENCLOSURE. INSTALL PER MANUFACTURER SPECIFICATIONS. SEE ELECTRICAL PLANS FOR POWER.
 - NOT USED.
 - INSTALL POST INDICATOR VALVE.
 - INSTALL DOMESTIC SERVICE (SEE PLAN FOR SIZE) TO WITHIN 5' OF BUILDING. SEE PLUMBING PLANS FOR CONTINUATION.
 - INSTALL 6" FIRE LINE TO WITHIN 5' OF BUILDING. SEE PLUMBING PLANS FOR CONTINUATION.
 - INSTALL REMOTE FIRE DEPARTMENT CONNECTION. CONNECT 6" LINE TO WITHIN 5' OF BUILDING. RESTRAIN LINE FROM APPARATUS TO BUILDING CONNECTION. SEE PLUMBING PLANS FOR CONTINUATION.
 - INSTALL 3" CAP FOR LANDSCAPE CONNECTION. SEE LANDSCAPE PLANS FOR CONTINUATION.
 - SAWCUT, REMOVE, AND REPLACE EXISTING ASPHALT PAVEMENT PER COA STD DWG 2485.
 - NOT USED.
 - DIP DOMESTIC LINE.

- ### □ SANITARY SEWER KEYNOTES
- CONNECT TO EXISTING SANITARY SEWER MANHOLE. CONTRACTOR TO VERIFY INVERT ELEVATIONS AND NOTIFY ENGINEER IF ANY DISCREPANCIES ARE FOUND.
 - INSTALL 6" SANITARY SEWER CLEANOUT.
 - INSTALL INLINE GASKETED, SANITARY STANDARD WYE FITTING (SEE PLAN FOR SIZE).
 - INSTALL 4" SANITARY SEWER SERVICE TO WITHIN 5' OF BUILDING & SEE PLUMBING PLANS FOR CONTINUATION.
 - REMOVE AND DISPOSE OF EXISTING SAS LINE.

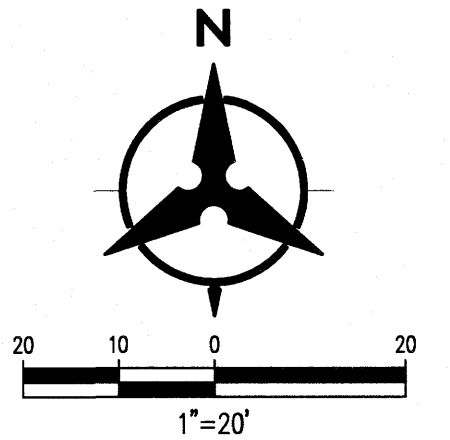

UTILITY LEGEND

| | | | |
|-----------|---------------------------------|-----------|-----------------------------------|
| --- | PROPERTY LINE | - - - - - | PROPOSED EASEMENT |
| - - - - - | EXISTING EASEMENT | SAS | PROPOSED SANITARY SEWER LINE |
| SAS | EXISTING SANITARY SEWER | ● | PROPOSED SANITARY SEWER MANHOLE |
| W | EXISTING WATER LINE | ○ | PROPOSED CLEANOUT |
| □ | EXISTING WATER METER | W | PROPOSED WATER LINE |
| ~ | EXISTING CAP | W | PROPOSED VALVE |
| W | EXISTING VALVE | FL | PROPOSED FIRE WATER LINE |
| W | EXISTING FIRE HYDRANT | ● | PROPOSED HYDRANT |
| ○ | EXISTING SANITARY SEWER MANHOLE | ~ | PROPOSED CAP |
| ⊙ | EXISTING STORM DRAIN MANHOLE | ■ | PROPOSED WATER METER |
| □ | EXISTING INLET | ▲ | PROPOSED PIV |
| | | W | REMOTE FIRE DEPARTMENT CONNECTION |

GREER STAFFORD/SJ&F ARCHITECTURE, INC.
 1777 LOUISIANA NE, SUITE 805
 ALBUQUERQUE, NM 87110-7087
 (505) 881-0885 • FAX: (505) 881-0848
 3005 NORTHBRIDGE DR, SUITE F
 FARMINGTON, NM 87401-2085
 (505) 382-7475 • FAX: (505) 382-6464

THE NEW LOS ALTOS POOL
CITY OF ALBUQUERQUE
 10100 LOMAS BOULEVARD NE
 ALBUQUERQUE, NM 87123

PROJECT NO: 5280.00
 DRAWN BY: MHS
 CHECKED BY: JLM
 GREER STAFFORD ARCHITECTURE
 SHEET TITLE
 UTILITY PLAN
 DRAWING SHEET
 104

February 24, 2017
 ISSUE: