

ADMINISTRATIVE AMENDMENT

FILE #: _____ PROJECT #: _____


APPROVED BY

DATE

PHASE	DATE
DRB	4.10.19



SCALE 3/32" = 1'

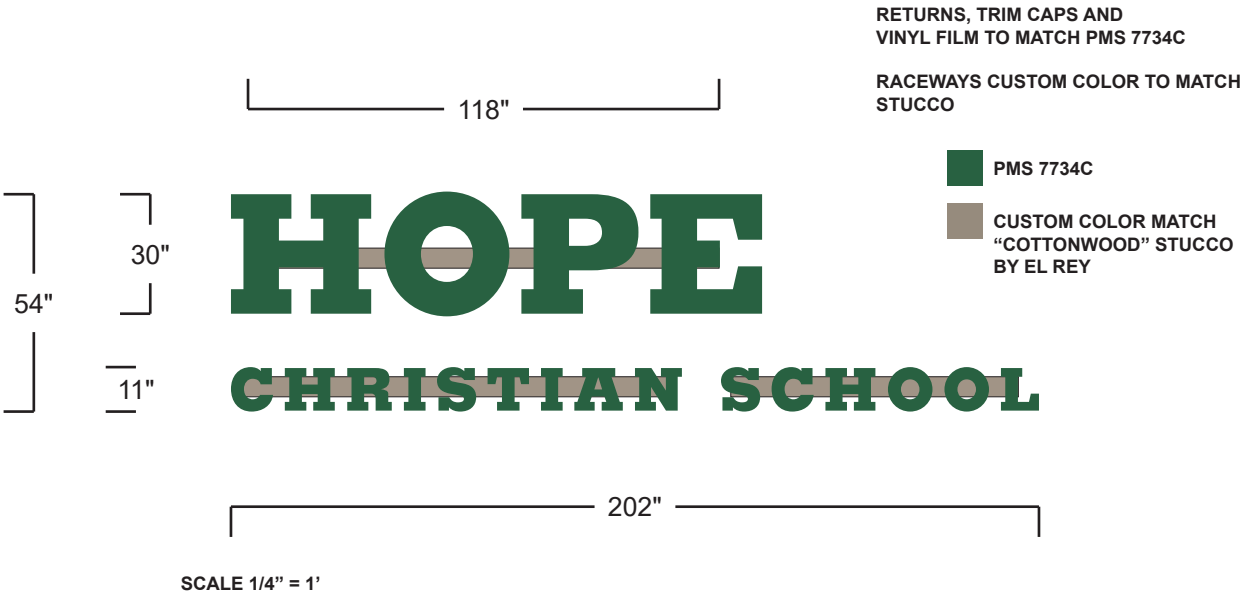

SCALE 1/4" = 1'

ELECTRICAL SPECIFICATIONS (L.E.D.)

ALL ELECTRICAL COMPONENTS WILL BE UL LISTED AND APPROVED AS PER NEC 600.4, 600.3 & DESIGNED TO UL #48 PER F.S. 553-19. ALL SIGNS ARE TO BE GROUNDED AND BONDED PER NEC 600.7 AND 250. ALL WIRING INSIDE LETTERS WILL BE 12V- CLASS 2 18GA / LOW VOLTAGE WIRING. ALL PRIMARY WIRING WILL BE #12 THWN HIGH TENSION AS PER NEC 600.12(C). THESE PLANS COMPLY WITH FBC 4805-91. JUNCTION BOX INSTALLED BY CUSTOMER'S ELECTRICAL CONTRACTOR TO WITHIN 6' OF SIGN LOCATION. 11W/2 1600 WITH WIND LOADS PER ASCE 7-10. **TIME CLOCK OR PHOTOCELL PER FED.**

Underwriters Laboratories Inc.®
Listed

FASTENER SCHEDULE		
	3/8" LAG SCREW	FOR USE WITH WOOD OR EIFS WALL SYSTEMS. 1-1/2" MIN PENETRATION (EXCL. TIP)
	3/8" DIA. THREADED ROD	FOR USE WITH WOOD, CONCRETE BLOCK OR EIFS WALL SYSTEMS.
	3/8" RED HEAD L.D.T. (LARGE DIAMETER TAPCON)	FOR USE WITH CONCRETE BLOCK, BRICK OR CONCRETE. EMBED A MIN. OF 2 1/2".
	3/8" DIA. HLTI HT ROD WITH HY150 MAX ADHESIVE	FOR USE WITH CONCRETE. EMBED A MIN. OF 2".
	3/8" DIA. HLTI HT ROD WITH HY20 ADHESIVE	FOR USE WITH MASONRY AND BRICK. EMBED A MIN. OF 3 3/8".
	3/8" DIA. HLTI HT ROD WITH HY20 ADHESIVE	FOR USE WITH CONCRETE BLOCK. EMBED A MIN. OF 2".
	3/8" DIA. HLTI HLC SLEEVE ANCHOR	FOR USE WITH CONCRETE, MASONRY AND BRICK. EMBED A MIN. OF 3 3/8".

INSTALLER SHALL VERIFY THAT FASTENERS CHOSEN ARE SUITABLE WITH WALL CONDITIONS

CLIENT APPROVAL: Approved AS-IS I approve this design as shown in this drawing and request production begin on my order. I understand any changes requested subsequent to this approval will result in additional charges and delay completion.

X _____ Date: _____

LANDLORD APPROVAL: Approved AS-IS I approve this design as shown in this drawing for installation at the address shown. I also hereby certify that I am the Owner or Owner's Authorized Agent with authority to grant this approval.

X _____ Date: _____

INVOICE #: **1379**

CUSTOMER:
HOPE CHRISTIAN SCHOOL

ORIGINAL DRAWING DATE:
6/20/2023

DRAWING NUMBER:
1

DRAWN BY:
AC

VERSION 2 BY: _____ REV. DATE
6/30/2023

VERSION 3 BY: _____ REV. DATE
7/14/2023

VERSION 4 BY: _____ REV. DATE
7/17/2023

VERSION 5 BY: _____ REV. DATE
8/11/2023

INSTALLATION LOCATION:
**6721 PALOMAS AVE NE
ALBUQUERQUE, NM
87109**

UPC: 101806338849410510

NOTES:

RACEWAY MOUNTED CHANNEL LETTERS

TRANSLUCENT VINYL FILM OVER TRANSLUCNT FACES

CONNECT TO EXISTING SIGN CIRCUIT AND SWITCH

SIGN AREA CALCULATIONS
SIGN AREA:
202"W X 54"H = 75.75 SF

FRONTAGE AREA:
92"W X 30'H = 2760 SF

SIGN AREA = 2.74%

FASTSIGNS®
Make Your Statement™
9664 Eagle Ranch Rd. NW, Ste. 6
Albuquerque, NM 87114
Phone 505-532-1001
fastsigns.com/2434

NM Lic # 410487
This drawing is the property of FASTSIGNS Albuquerque Northwest. It shall not be reproduced, copied or used for any purpose without permission.