

# ADMINISTRATIVE AMENDMENT

FILE #: \_\_\_\_\_ PROJECT #: \_\_\_\_\_

---

---

---

---

---

\_\_\_\_\_  
APPROVED BY

\_\_\_\_\_  
DATE



**NOTE:** The Atlas LED is less than 25% of the sign.


**Stewart Signs**  
ONE SIGN, ONE COMPANY  
1-800-237-3928 [stewartsigns.com](http://stewartsigns.com)

TekStar Color 16mm 40x100  
Cabinet size: 5'x10'  
Sk: 1002403-9e Cust: 1906556  
10/4/2024 CgO/kDiaz PROPOSAL  
Scale: 1/2"=1' Cabinet color: Blue

Signature \_\_\_\_\_  
Date \_\_\_\_\_


Please confirm that all lettering, colors and graphics are correct before signing. Changes to artwork after signature is received will incur a \$500 art change fee.



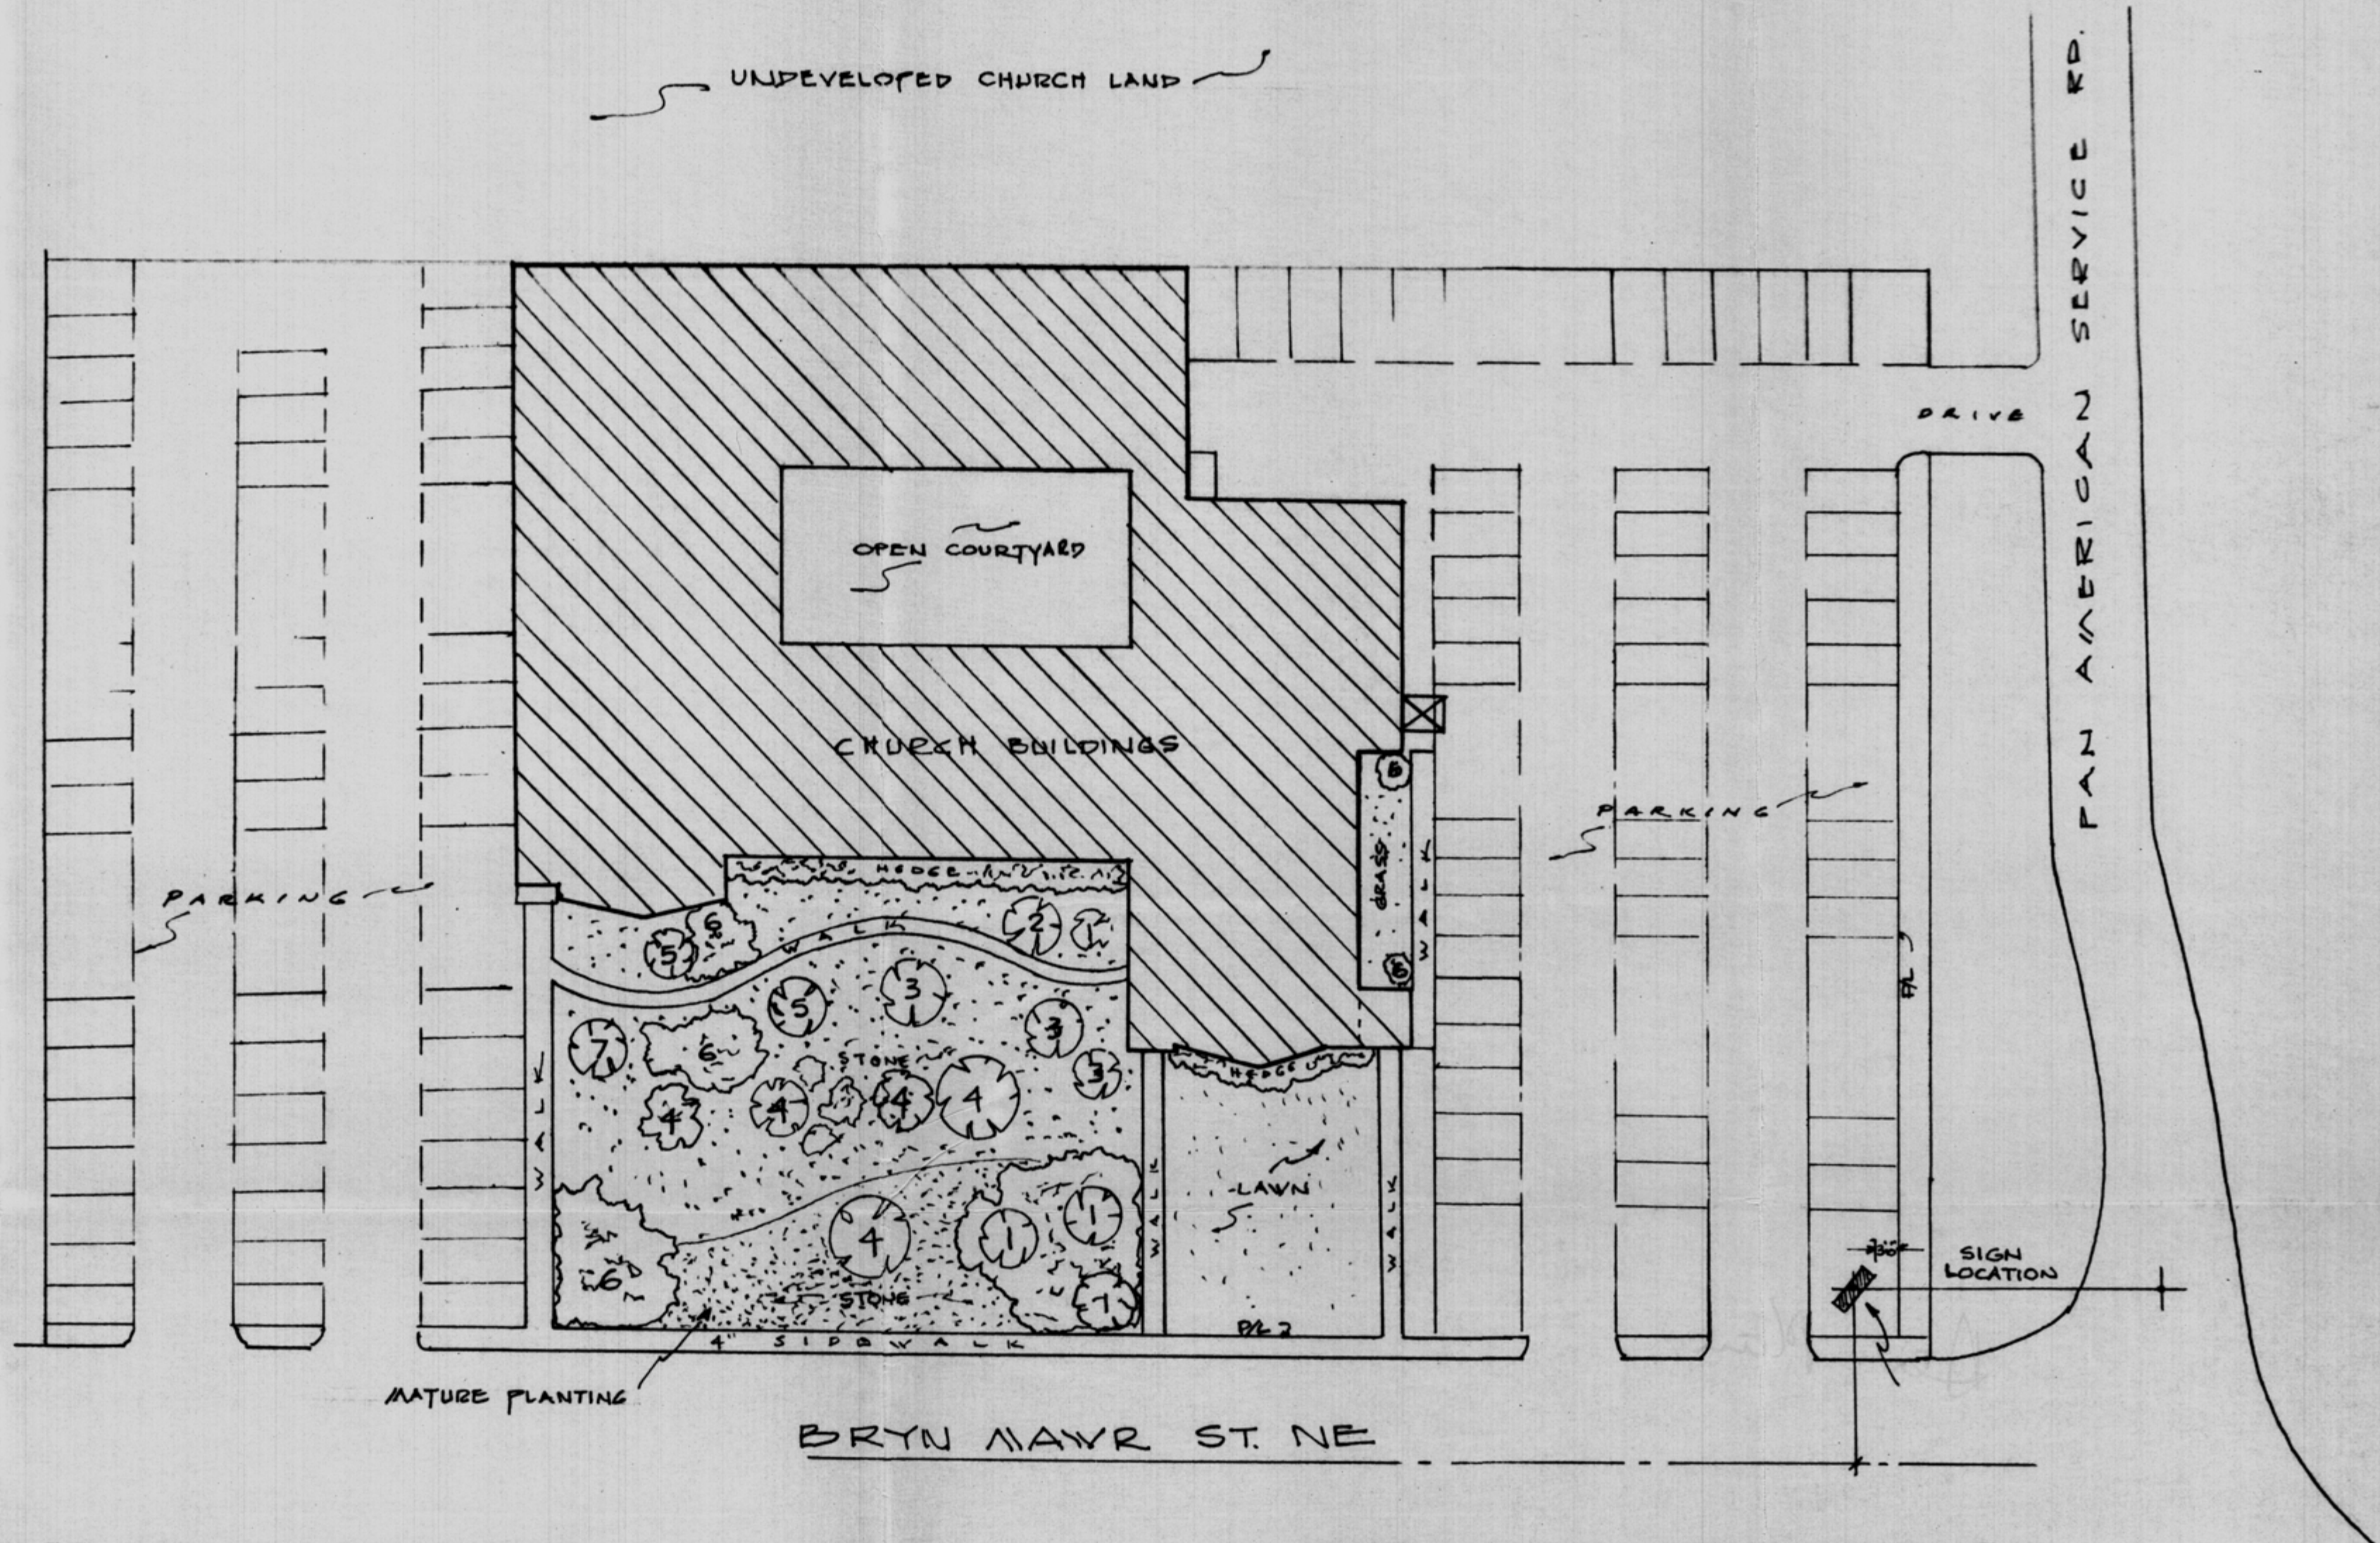


ADMINISTRATIVE  
DEVELOPMENT PLAN AMENDMENT  
FILE NO. Z 71-11-1  
*sign location & colors*  
*Gilman by [signature]* 1/11/82  
PLANNING DIRECTOR DATE

| LEGEND |                 |
|--------|-----------------|
| 1      | PINION          |
| 2      | MIMOSA          |
| 3      | UPRIGHT JUNIPER |
| 4      | PINE            |
| 5      | FRUITLESS PLUM  |
| 6      | JUNIPER         |
| 7      | ARBORVITA       |

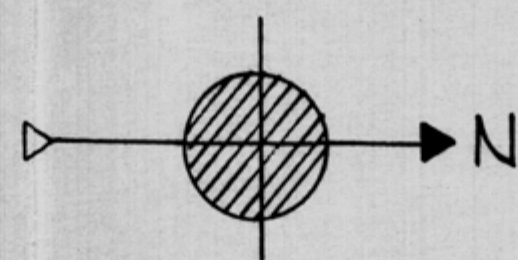

Montgomery Heights  
**Church of the Nazarene**  
4301 BRYN MAWR NE - ALBUQUERQUE, N.M. 87107  
**PARKING & LANDSCAPING**  
TOTAL PARKING 99 spcs  
SCALE 1/32"=1'-0"

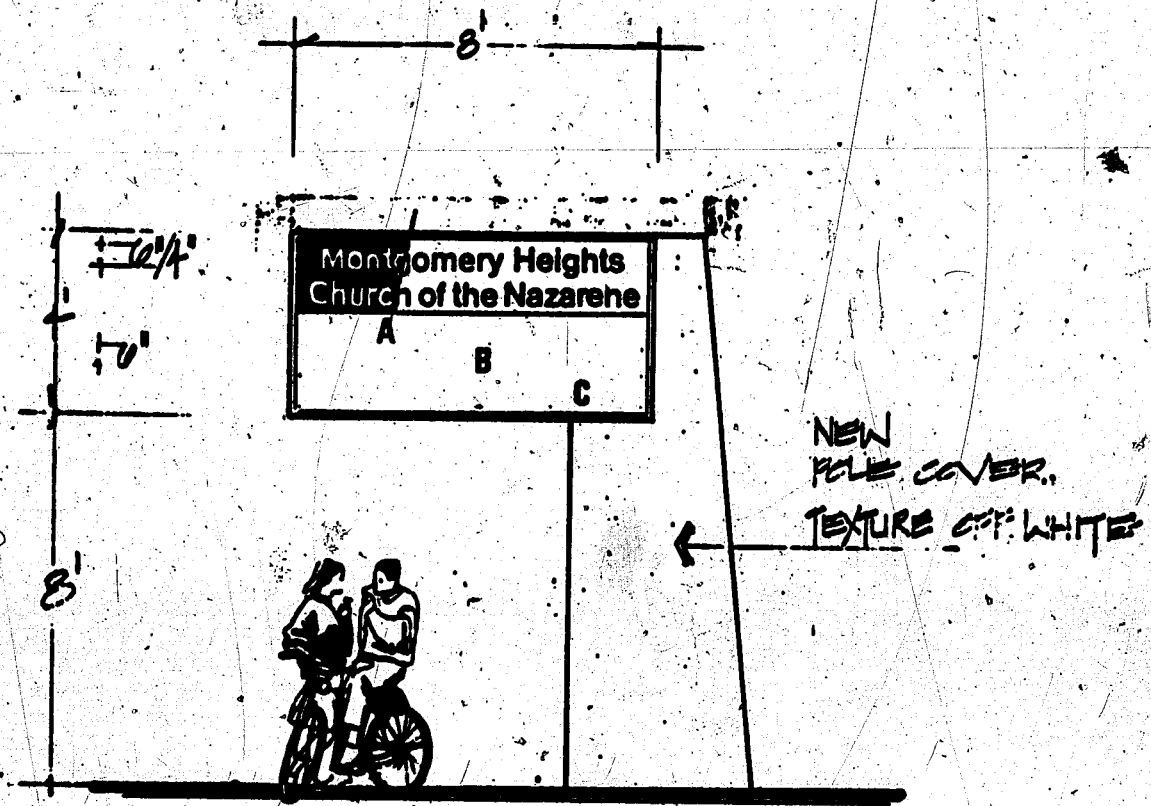


(A)



NEW MEXICO  
**SIGN**  
LIGHTING CO.

D/F RE-CONDITIONED DISPLAY

INTERIOR ILLUMINATION.

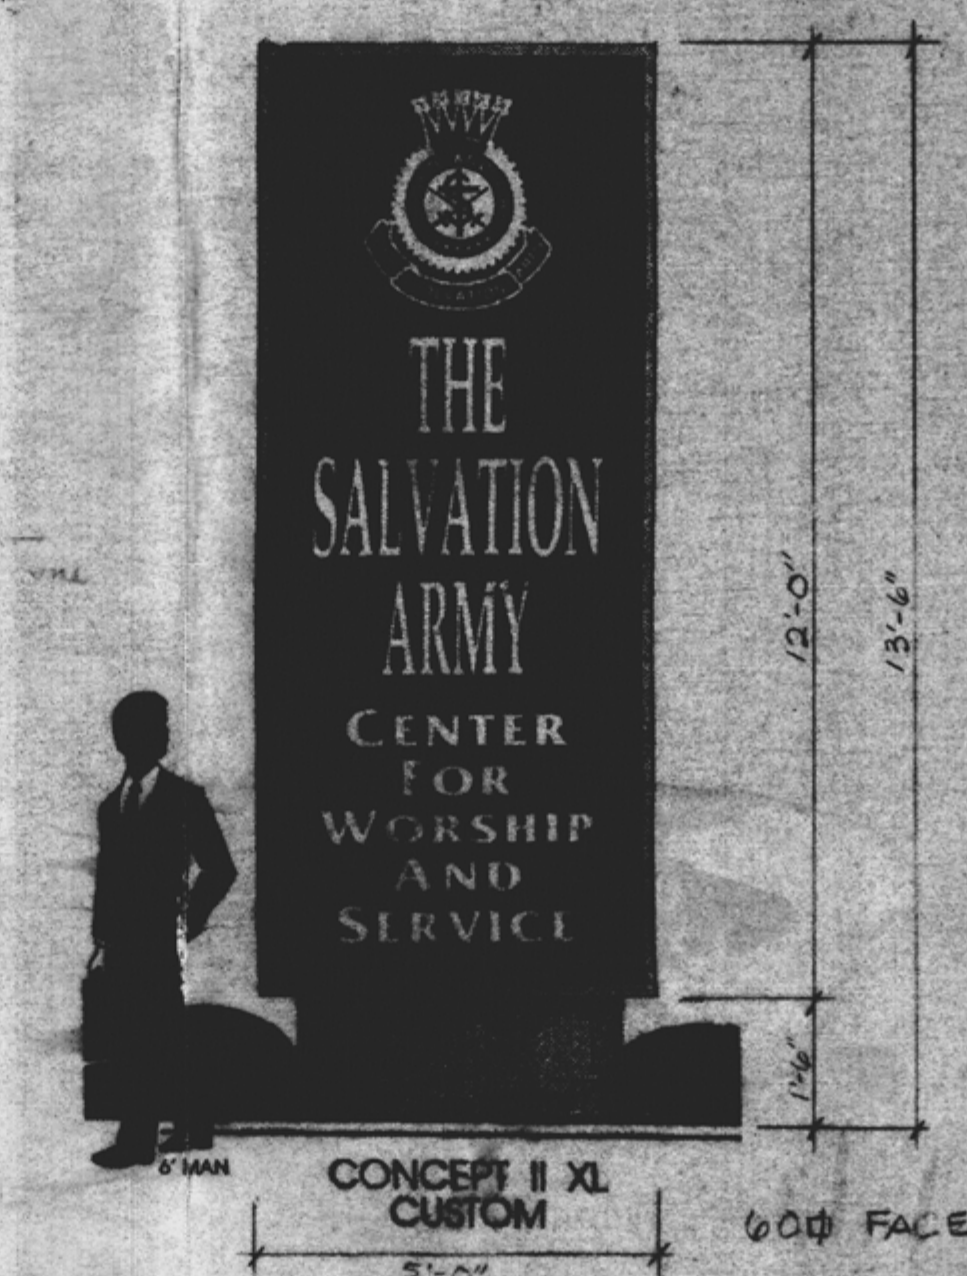

NEW SIGN REPLACES EXISTING UNIT AT EXISTING LOCATION. NEW FOOTING AS DETAILED. REUSE EXISTING ELECTRICAL, CONNECT AS REQUIRED.

LEGAL DESCRIPTION:

4301 BYRN MAWR DRIVE N.E.,  
TRACTS A AND B OF THE LANDS OF  
THE SALVATION ARMY  
UPC: 10160603644892007


ADMINISTRATIVE  
DEVELOPMENT PLAN AMENDMENT

FILE NO. Z-89-19

*replace sign*


*Robert J. Pinner* 7.15.99  
PLANNING DIRECTOR DATE

*for zoning file*

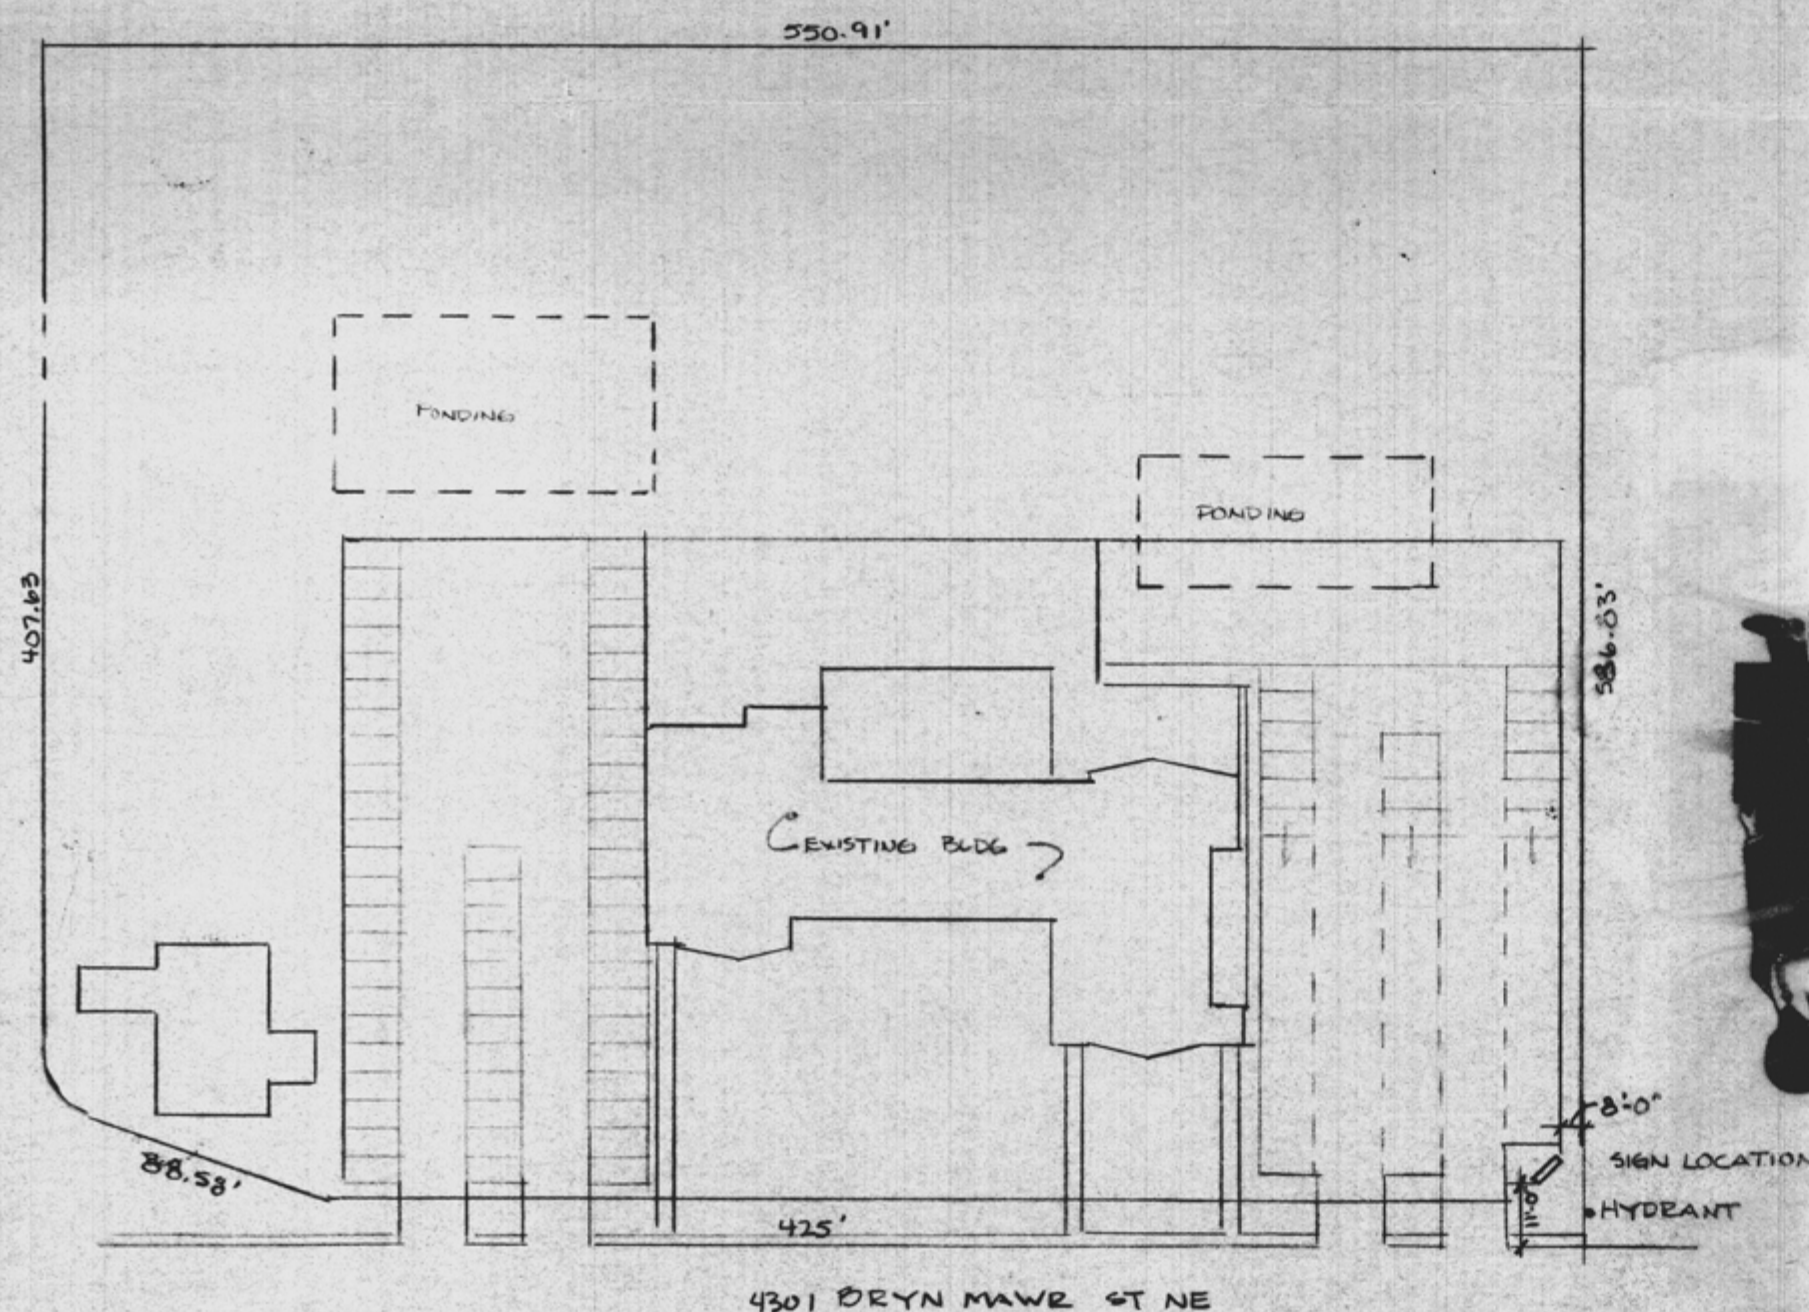


SITE PLAN



TOTAL PARKING - 99 SP

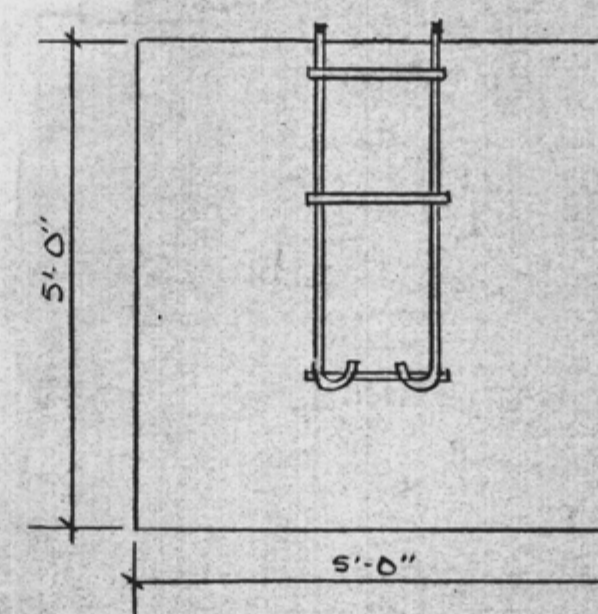

1. 3/4" x 30" ANCHOR BOLTS - 4 REQD
2. #5 REBAR - GRADE 60 OR BTR

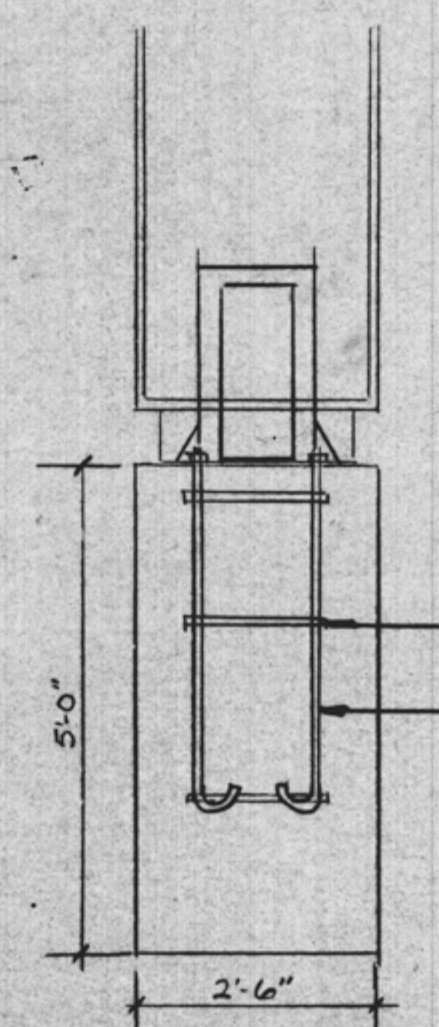

DESIGN FACTOR - 50 PSF, 120 MPH WIND LOAD  
ELECTRICAL - 58 AMP/120VAC - EXIST

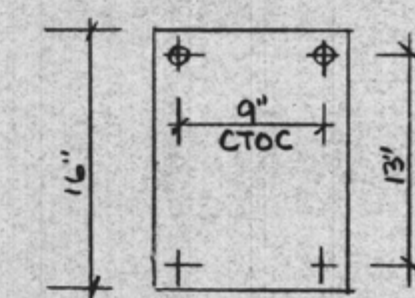

BOLT LAYOUT

FOOTING DETAIL