
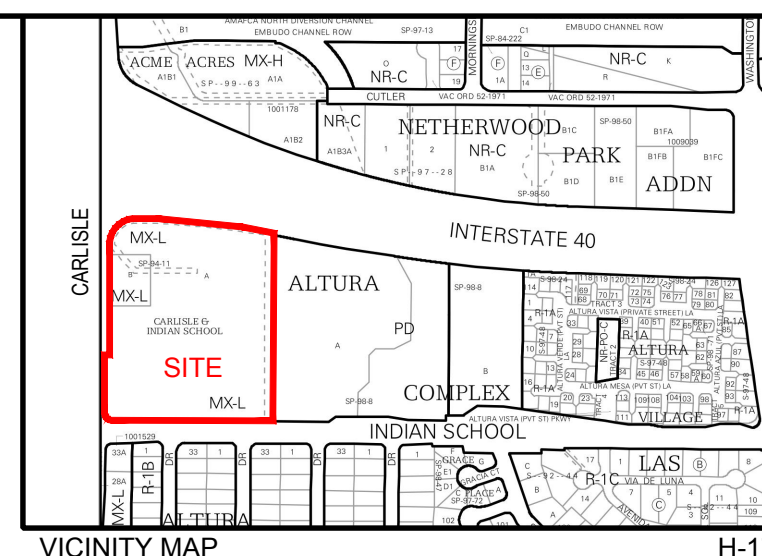


NAME: L:\Active Projects\03738 Modulus Carlisle Marketplace3_DWG\Sheets\03738 Utility.dwg PLOT DATE: Jul 09, 2019 5:24pm

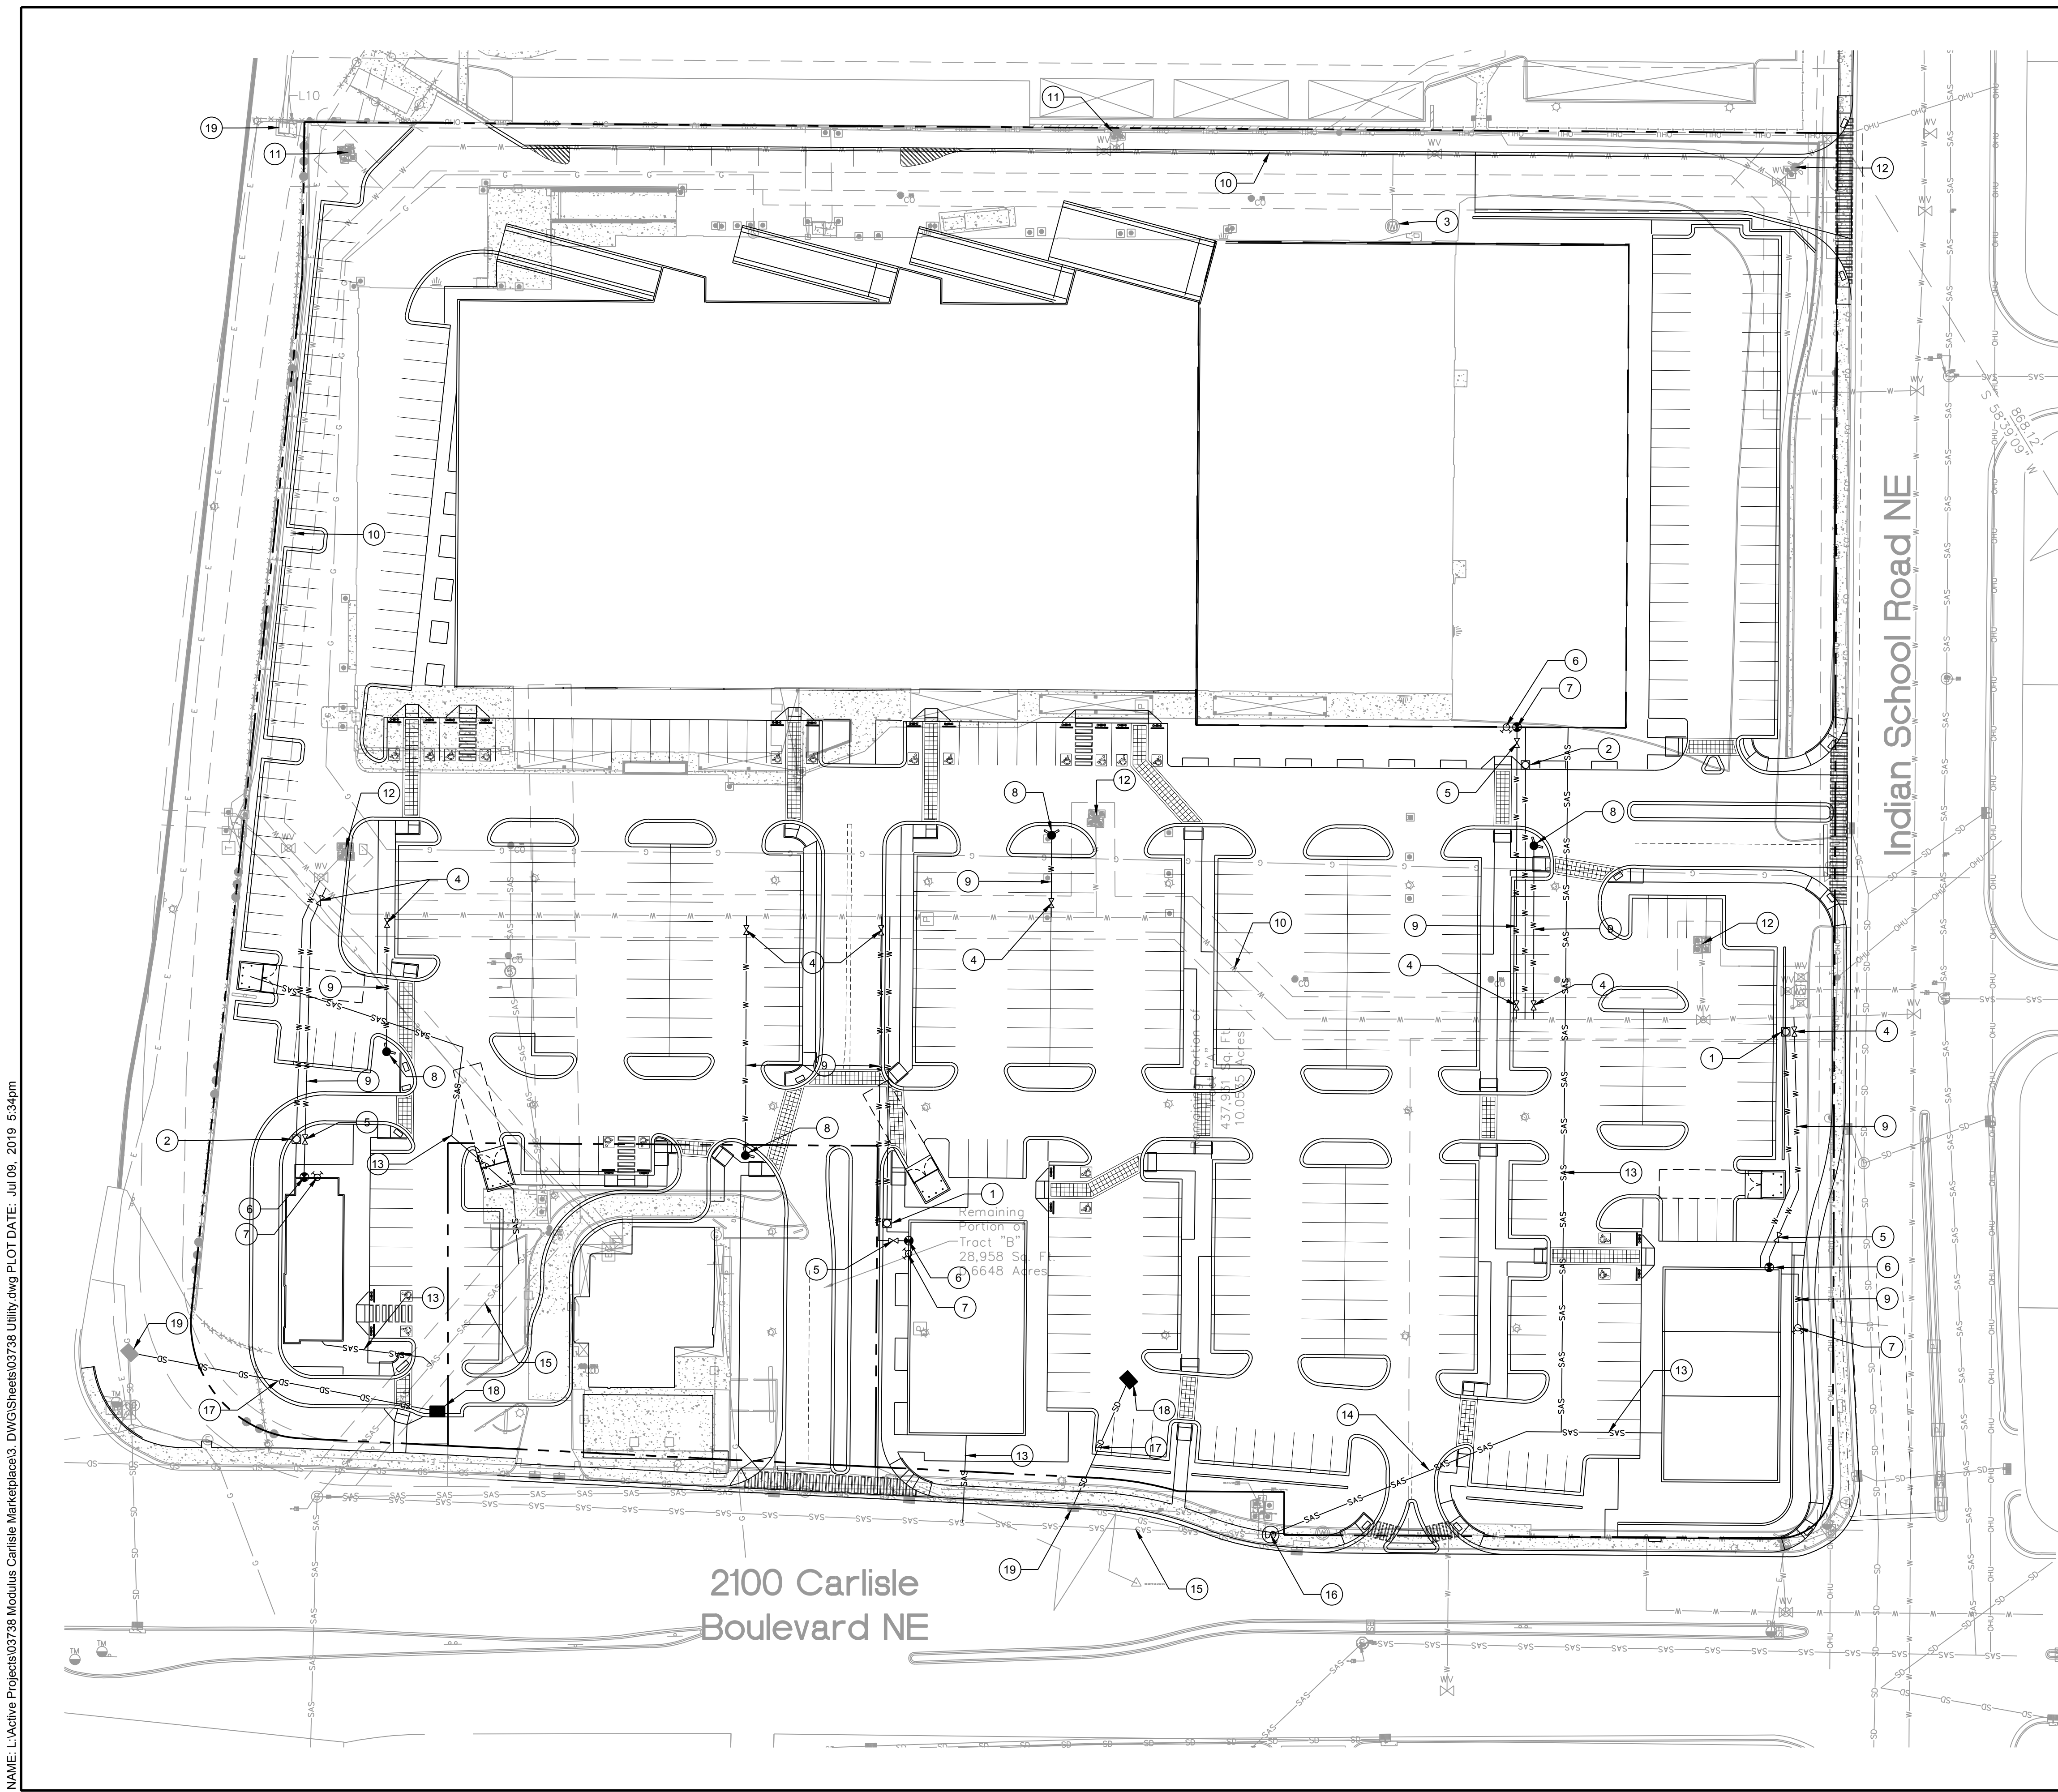

KEYED NOTES


- 1 INSTALL 1" WATER SERVICE
- 2 INSTALL 1 1/2" WATER SERVICE
- 3 EXISTING WATER SERVICE
- 4 INSTALL PUBLIC 6" GATE VALVE & VALVE BOX
- 5 INSTALL PRIVATE 6" GATE VALVE & VALVE BOX
- 6 INSTALL WALL INDICATOR VALVE
- 7 INSTALL FIRE DEPARTMENT CONNECTION
- 8 INSTALL PUBLIC FIRE HYDRANT
- 9 INSTALL 6" WATER LINE
- 10 EXISTING 10" PVC PUBLIC WATER LINE
- 11 EXISTING PUBLIC FIRE HYDRANT TO REMAIN
- 12 EXISTING PUBLIC FIRE HYDRANT TO BE REMOVED
- 13 INSTALL 4" SEWER SERVICE
- 14 INSTALL 6" SEWER SERVICE
- 15 EXISTING PUBLIC SEWER
- 16 INSTALL SEWER MANHOLE
- 17 INSTALL STORM DRAIN PIPE
- 18 INSTALL DROP INLET
- 19 EXISTING DROP INLET

LEGEND

- PROPERTY LINE
- W — W — WATER LINE
- SAS — SAS — SANITARY SEWER LINE
- SD — SD — STORM DRAIN
- - - EASEMENT
- W V WATER VALVE
- WATER METER
- FIRE HYDRANT
- ⊕ POST / WALL INDICATOR VALVE
- ⊕ FIRE DEPARTMENT CONNECTION
- ⊙ SANITARY SEWER MANHOLE
- DROP INLET

GENERAL NOTE

- 1. TYPE RBPA BACKFLOW PREVENTERS FOR ALL PROPOSED PRIVATE WATER LINES WILL BE PROVIDED INTERNAL TO EACH PROPOSED BUILDING PER COA STD DTL 2385. THE BACKFLOW PREVENTERS WILL BE THE SAME SIZE AS THE TAP/CONNECTION AT THE MAIN LINE.

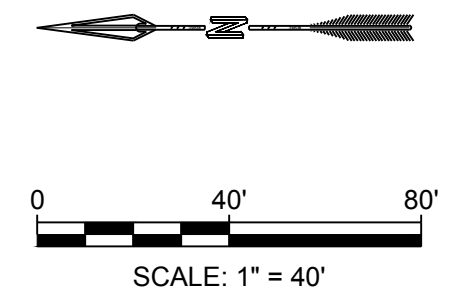

<p>DESIGNED JS DRAWN JS CHECKED SG DATE 7.09.2019</p> <p>RESPEC 5971 JEFFERSON STREET SUITE 101 ALBUQUERQUE, NM 87109 WWW.RESPEC.COM 505.253.9718</p>	<p>REVISION</p> <p>STAMP 3.0% REVIEW</p> <p>PRELIMINARY NOT FOR CONSTRUCTION 7/2019</p> <p>THIS DRAWING IS INCOMPLETE AND NOT TO BE USED FOR CONSTRUCTION UNLESS IT IS STAMPED, SIGNED AND DATED.</p> <p>nm811 Know what's below. Call before you dig.</p>
PROJECT NAME:	CARLISLE MARKETPLACE
SHEET TITLE:	CONCEPTUAL UTILITY
SUBMITTED FOR:	DRB SITE PLAN
SHEET NUMBER:	C-2