

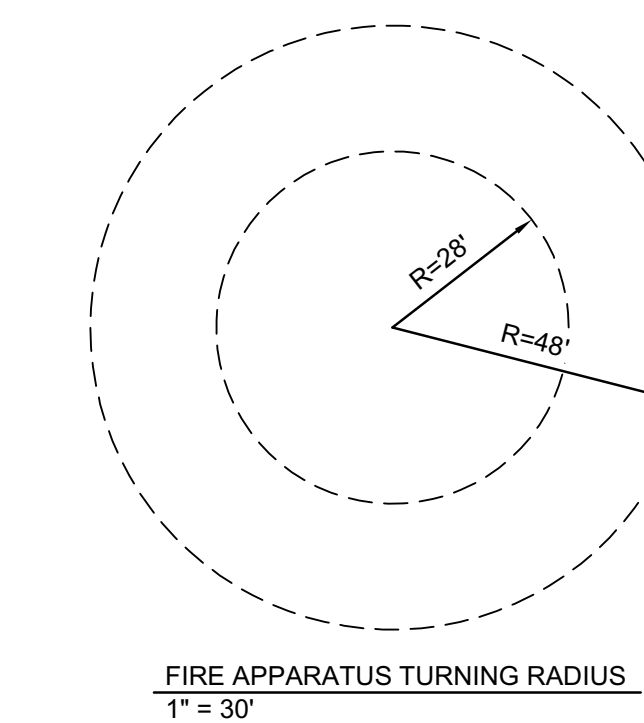


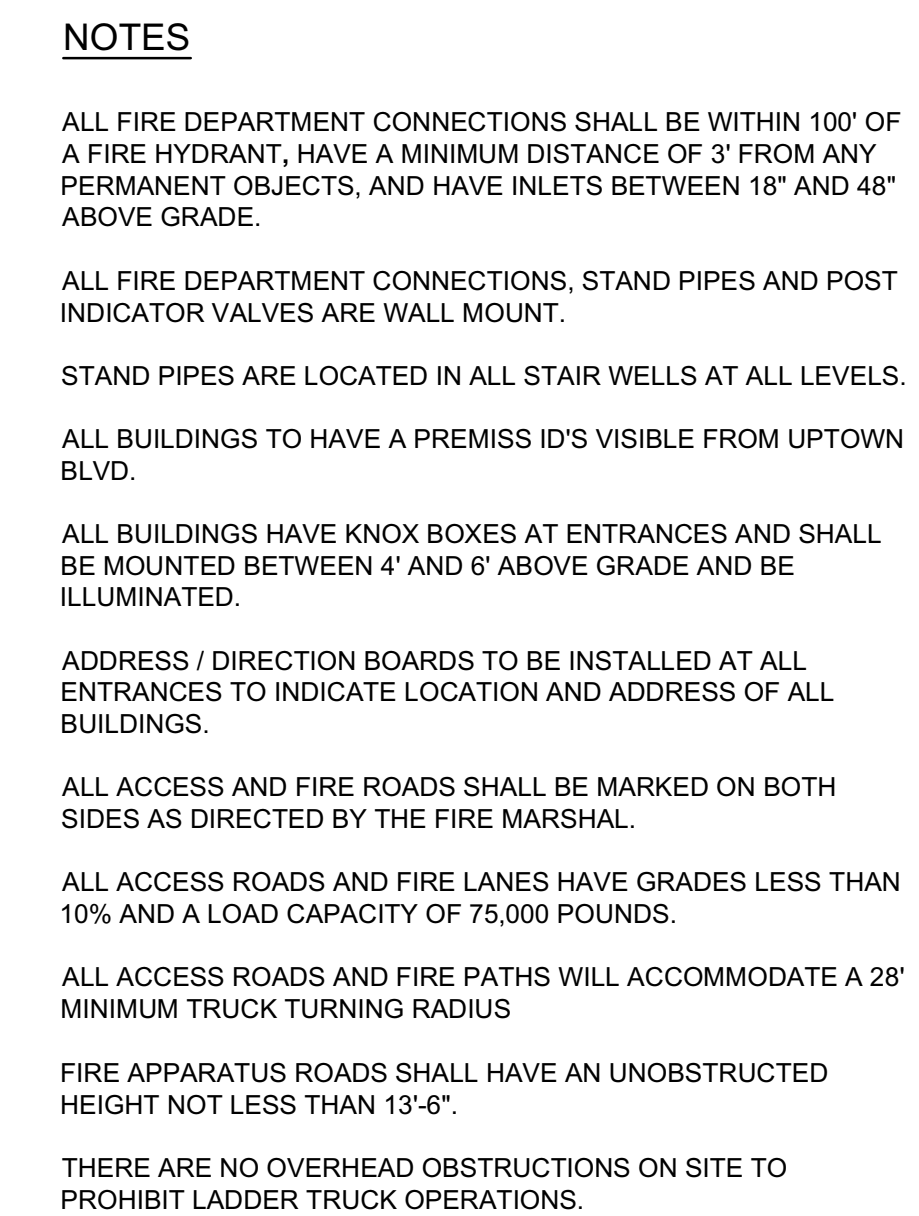

UPTOWN CONNECT
UPTOWN BLVD.
ALBUQUERQUE, NM 87123

DESIGN DEVELOPMENT

REVISIONS

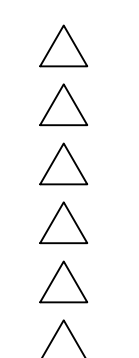


DRAWN BY	JTS/BJB/DEC
REVIEWED BY	FCA/IMA
DATE	06/04/2024
PROJECT NO.	IA 2625 XX-XXXX

DRAWING NAME

FIRE HYDRANT LOCATION & ACCESS PLAN

SHEET NO.

FIRE 1

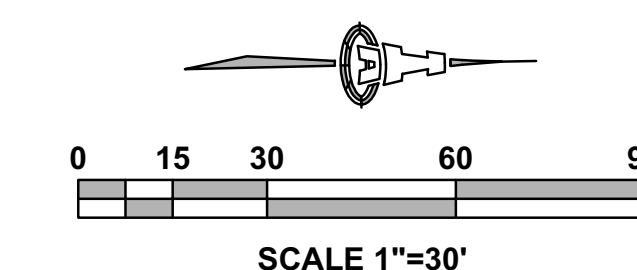


Isaacson & Arman, Inc.
Civil Engineering Consultants



128 Monroe Street NE
Albuquerque, NM 87106
505-266-8628 | www.iaacim.com

© 2020 Isaacson & Arman, Inc. This design, calculations, and concepts are owned by and remain the property of Isaacson & Arman, Inc. and no part thereof shall be utilized by any person, firm or corporation for any purpose whatsoever except with the written permission of Isaacson & Arman, Inc.

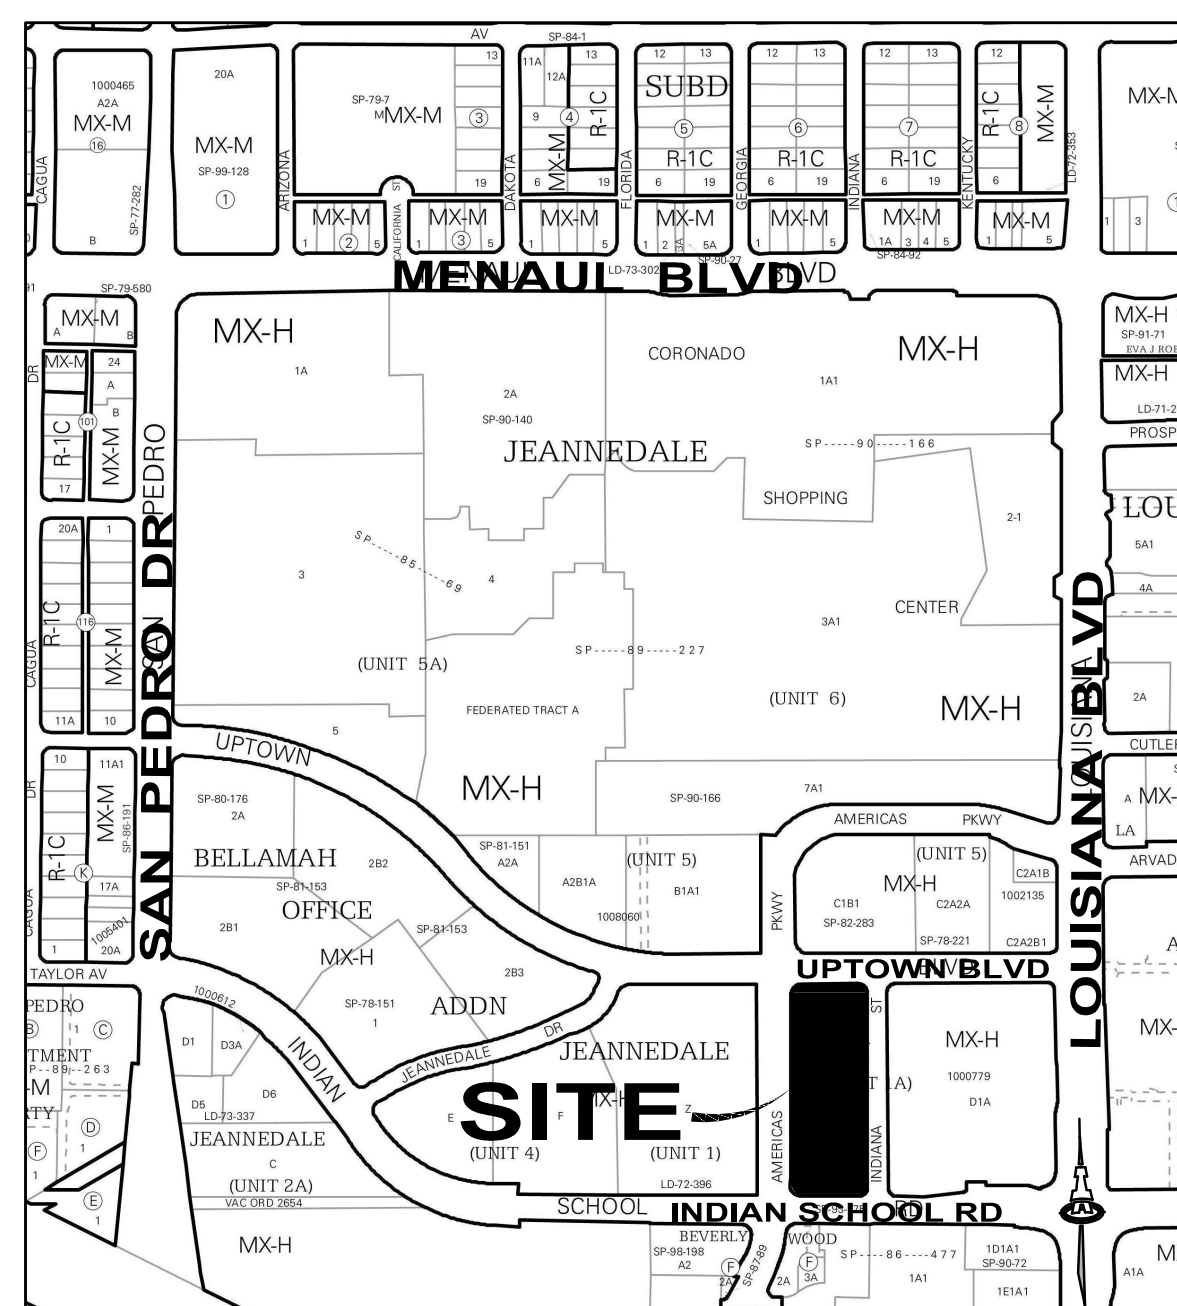

LEVELS 3-5 = 13,113 SF
OCCUPANCY TYPE = R-2
CONSTRUCTION TYPE = V-A
SPRINKLER SYSTEM IN BLDG.
FIRE FLOW = 2,250 GPM /2 = 1,125 GPM -
MIN. 1,750 GPM
REQUIRED 1 FIRE HYDRANT
PROVIDED: 1 FIRE HYDRANT

LEVELS 3-7 = 144,715 SF
OCCUPANCY TYPE = R-2
CONSTRUCTION TYPE = III-A
SPRINKLER SYSTEM IN BLDG.
FIRE FLOW = 6,750 GPM / 2 = 3,375 GPM -
REQUIRED 4 FIRE HYDRANT
PROVIDED: 4 FIRE HYDRANT

82,640 SF
OCCUPANCY TYPE = S-2
CONSTRUCTION TYPE = 1-A
SPRINKLER SYSTEM IN BLDG.
FIRE FLOW = 3,000 GPM / 2 = 1,500 GPM -
MIN. 1,750 GPM
REQUIRED 1 FIRE HYDRANT
PROVIDED: 1 FIRE HYDRANT