

GO

AL MAY 30th, 2024



hotels

DEVELOPED BY


GATEHOUSE CAPITAL
FOR ALVARADO HOTELS

2026 CENTRAL AVENUE
ALBUQUERQUE, NM

100%
DESIGN DEVELOPMENT

MAR. 05, 2024

OPTOMETRIC PLAN

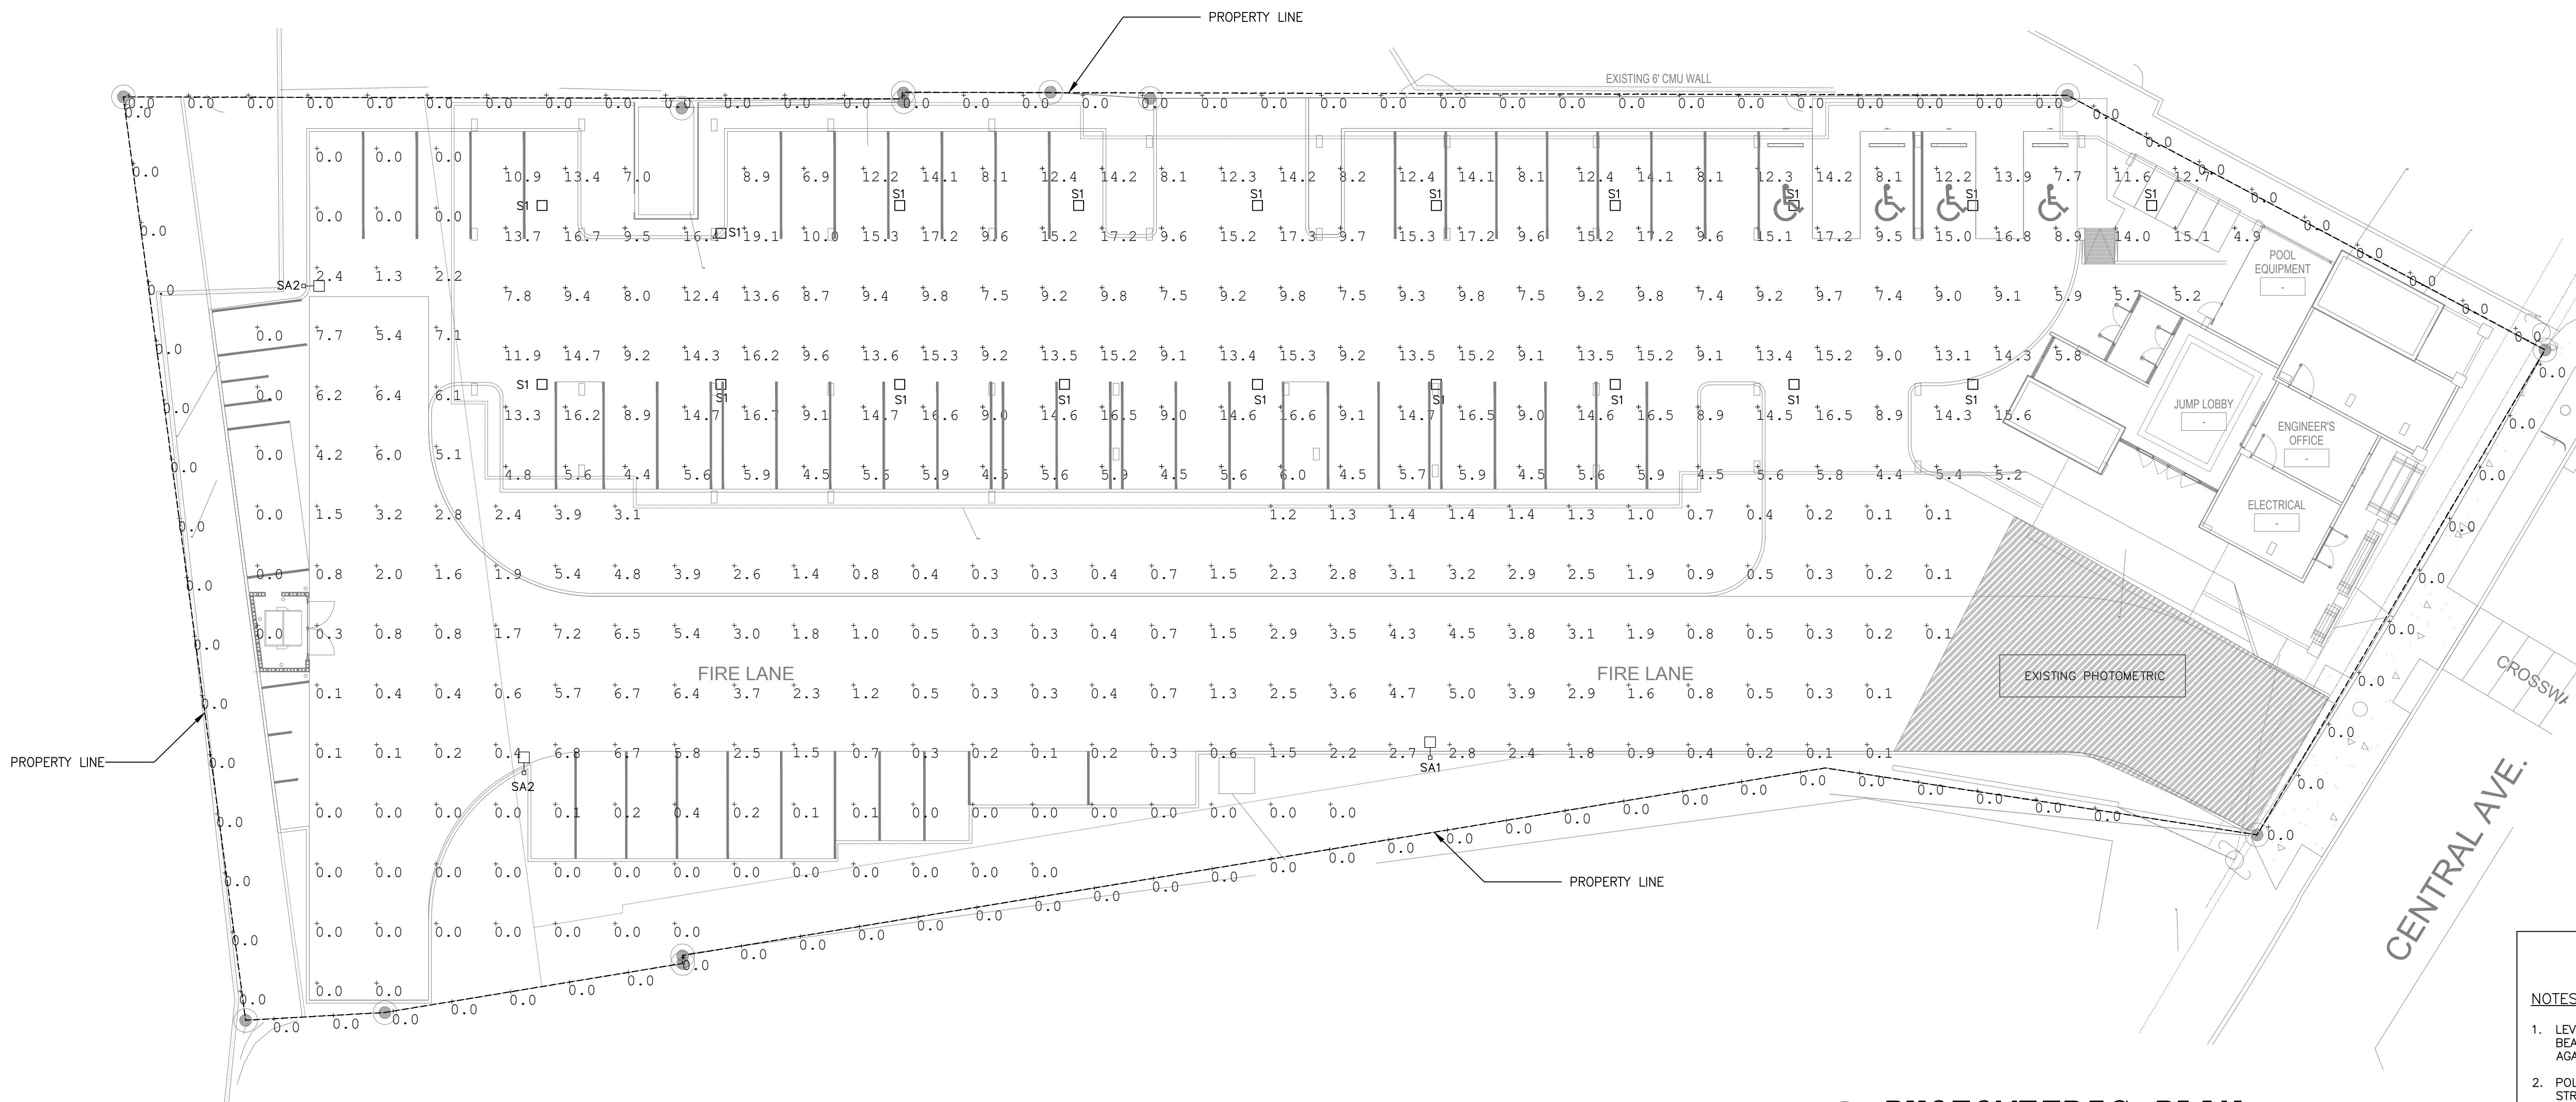


1 PHOTOMETRIC PLAN

Calculation Summary							
Label	CalcType	Units	Avg	Max	Min	Avg/Min	Max/Min
Parking Lots	Illuminance	Fc	1.53	7.7	0.0	N.A.	N.A.
Parking Indoor	Illuminance	Fc	10.59	7.7	0.0	N.A.	N.A.
Property Line	Illuminance	Fc	0.0	0.0	0.0	N.A.	N.A.

Luminaire Schedule							
Qty	Label	Arrangement	LLF	Description	Lum. Watts	Lum. Lumens	
1	SA1	SINGLE	1.000	DSX0 LED P6 30K 70CRI BLC3	137	11957	
2	SA2	SINGLE	1.000	DSX0 LED P6 30K 70CRI LCOO	137	11966	
10	S1	SINGLE	1.000	CRF CANOPY LIGHT 5700 CFW IES	95.21	11959	

NO

THE CONTRACTOR SHALL BE RESPONSIBLE FOR CONDUCTING THE SITE LIGHTING PHOTOMETRIC TESTING AND COMMISSIONING TO ENSURE THE ACTUAL PHOTOMETRIC READINGS ARE CONSISTENT WITH THOSE OF THE DESIGNED PHOTOMETRIC PLAN.

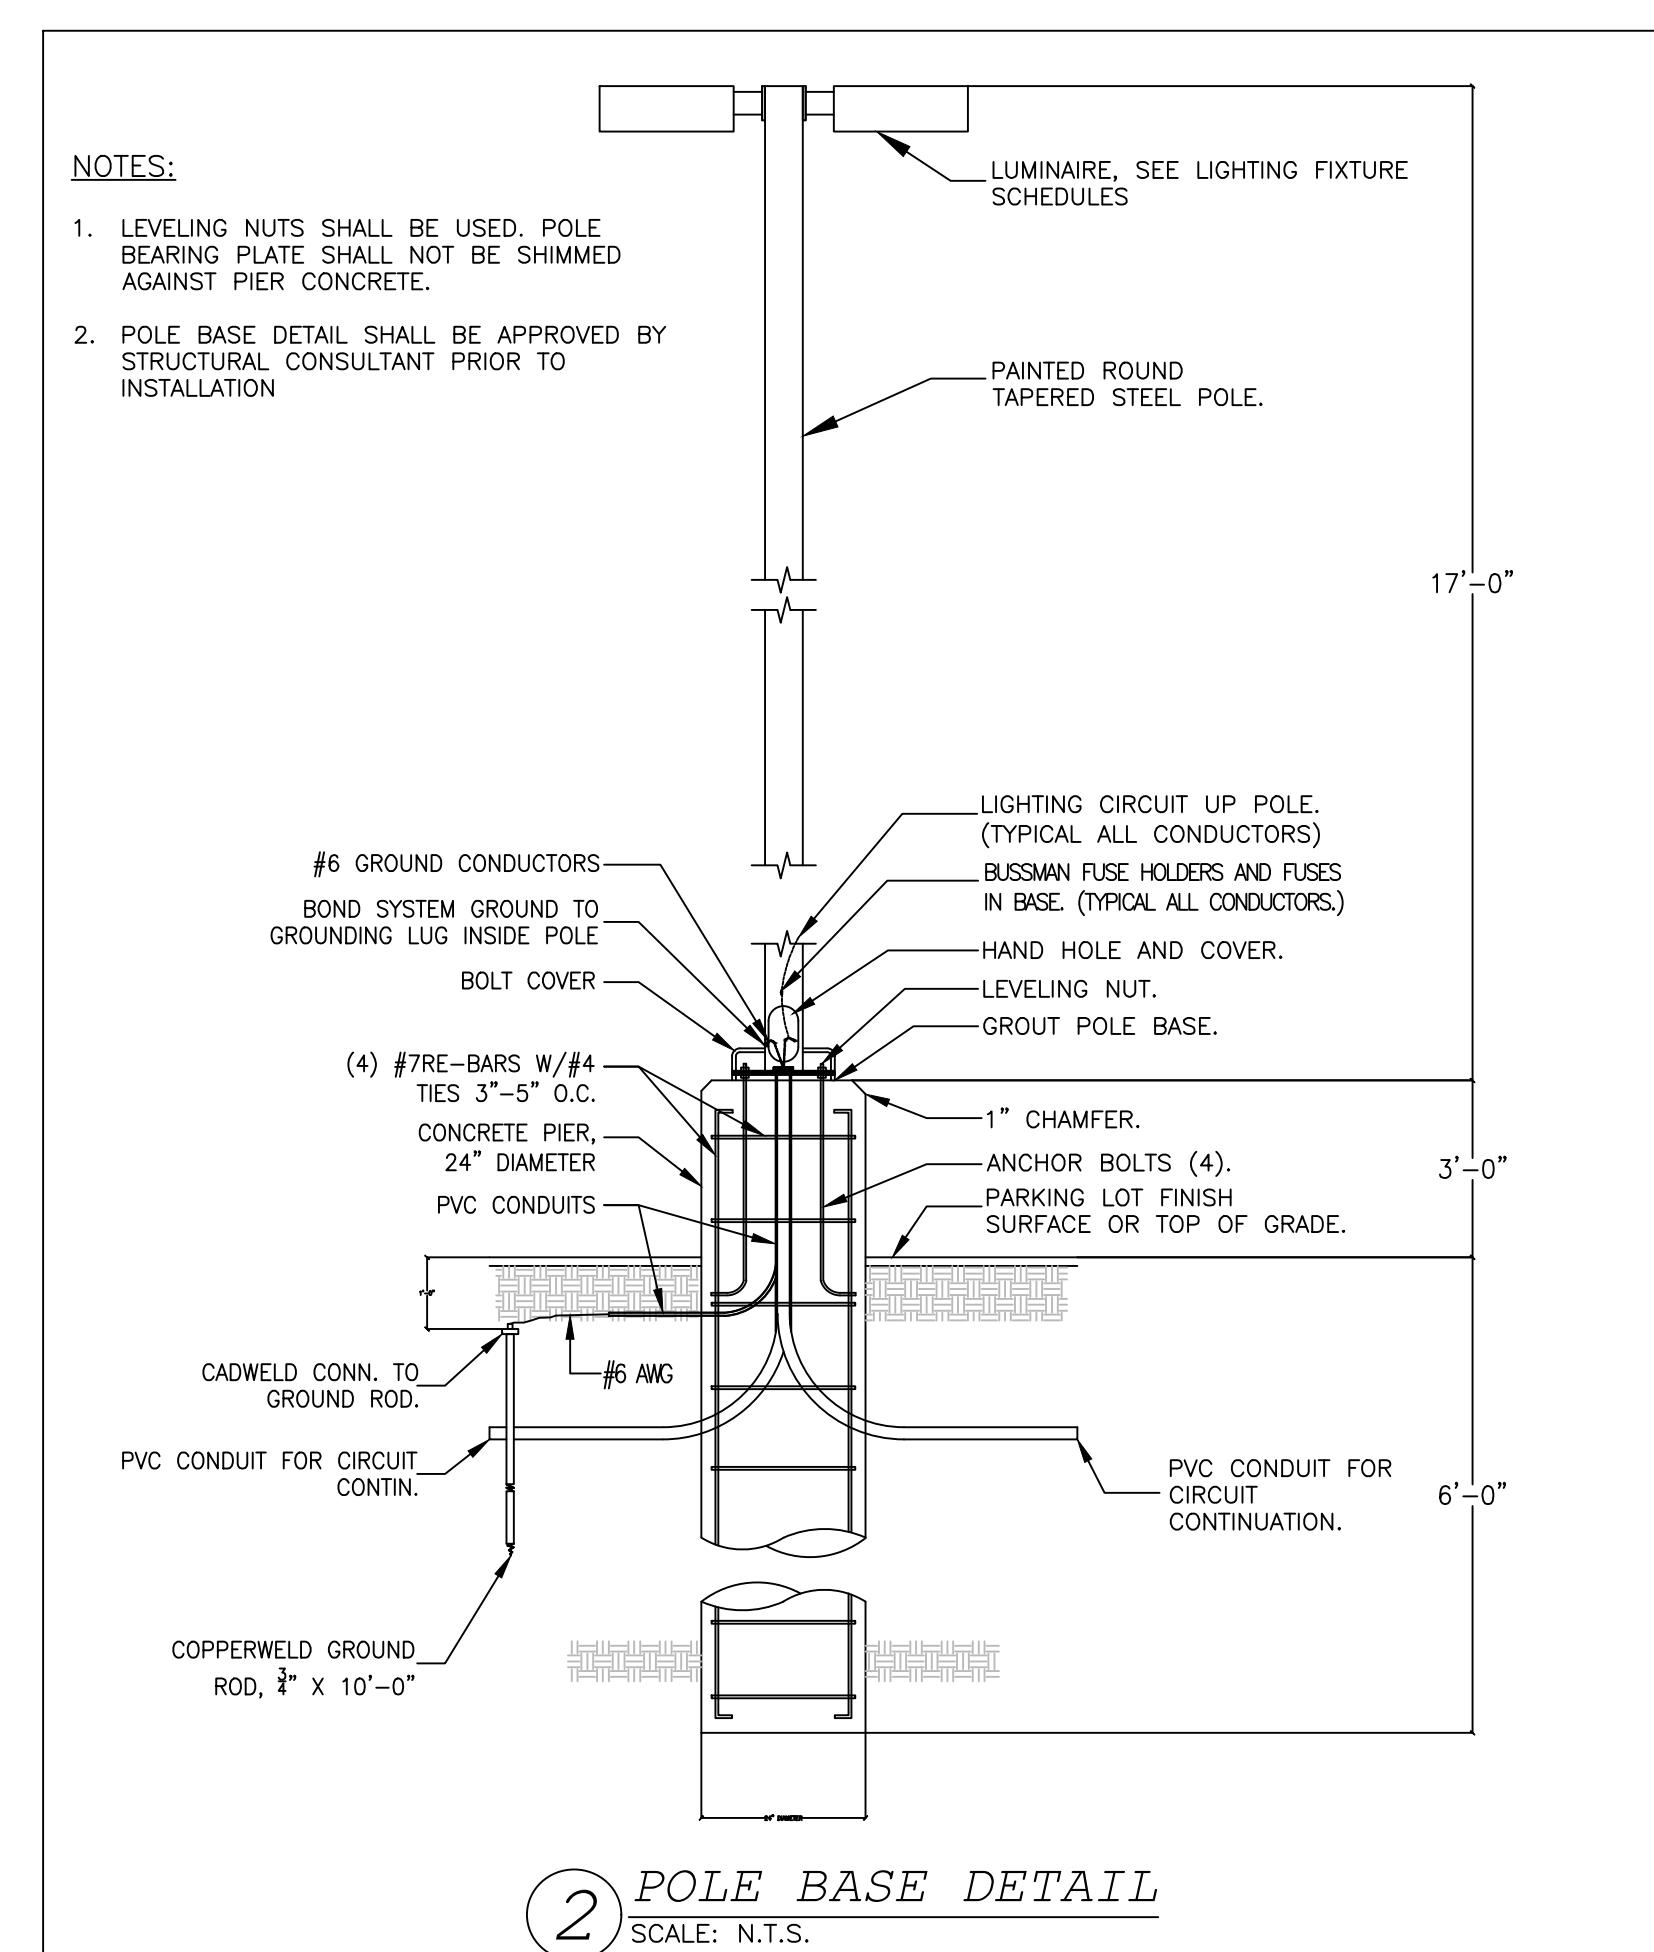

2 POLE BASE DETAIL
SCALE: N.T.S.