ALBUQUERQUE FIRE MARSHAL'S
DIVISION OFFICE/PLANS
CHECKING DIVISION

PERMIT

PERMIT NUMBER: FP 23-013722
APPROVED DATE: 06/01/23

APPROVED

THESE CONSTRUCTION DOCUMENTS WERE REVIEWED AND APPROVED BY THE ALBUQUERQUE FIRE MARSHAL'S OFFICE IN ACCORDANCE WITH THE CITY ORDINACE, THE INTERNATIONAL FIRE CODE, AND NFPA STANDARDS. THIS PERMIT IS VALID FOR 180 DAYS. FINAL INSPECTION IS REQUIRED.

FIRE FLOW: 2625 GPM, 3 HYDRANTS, II-B

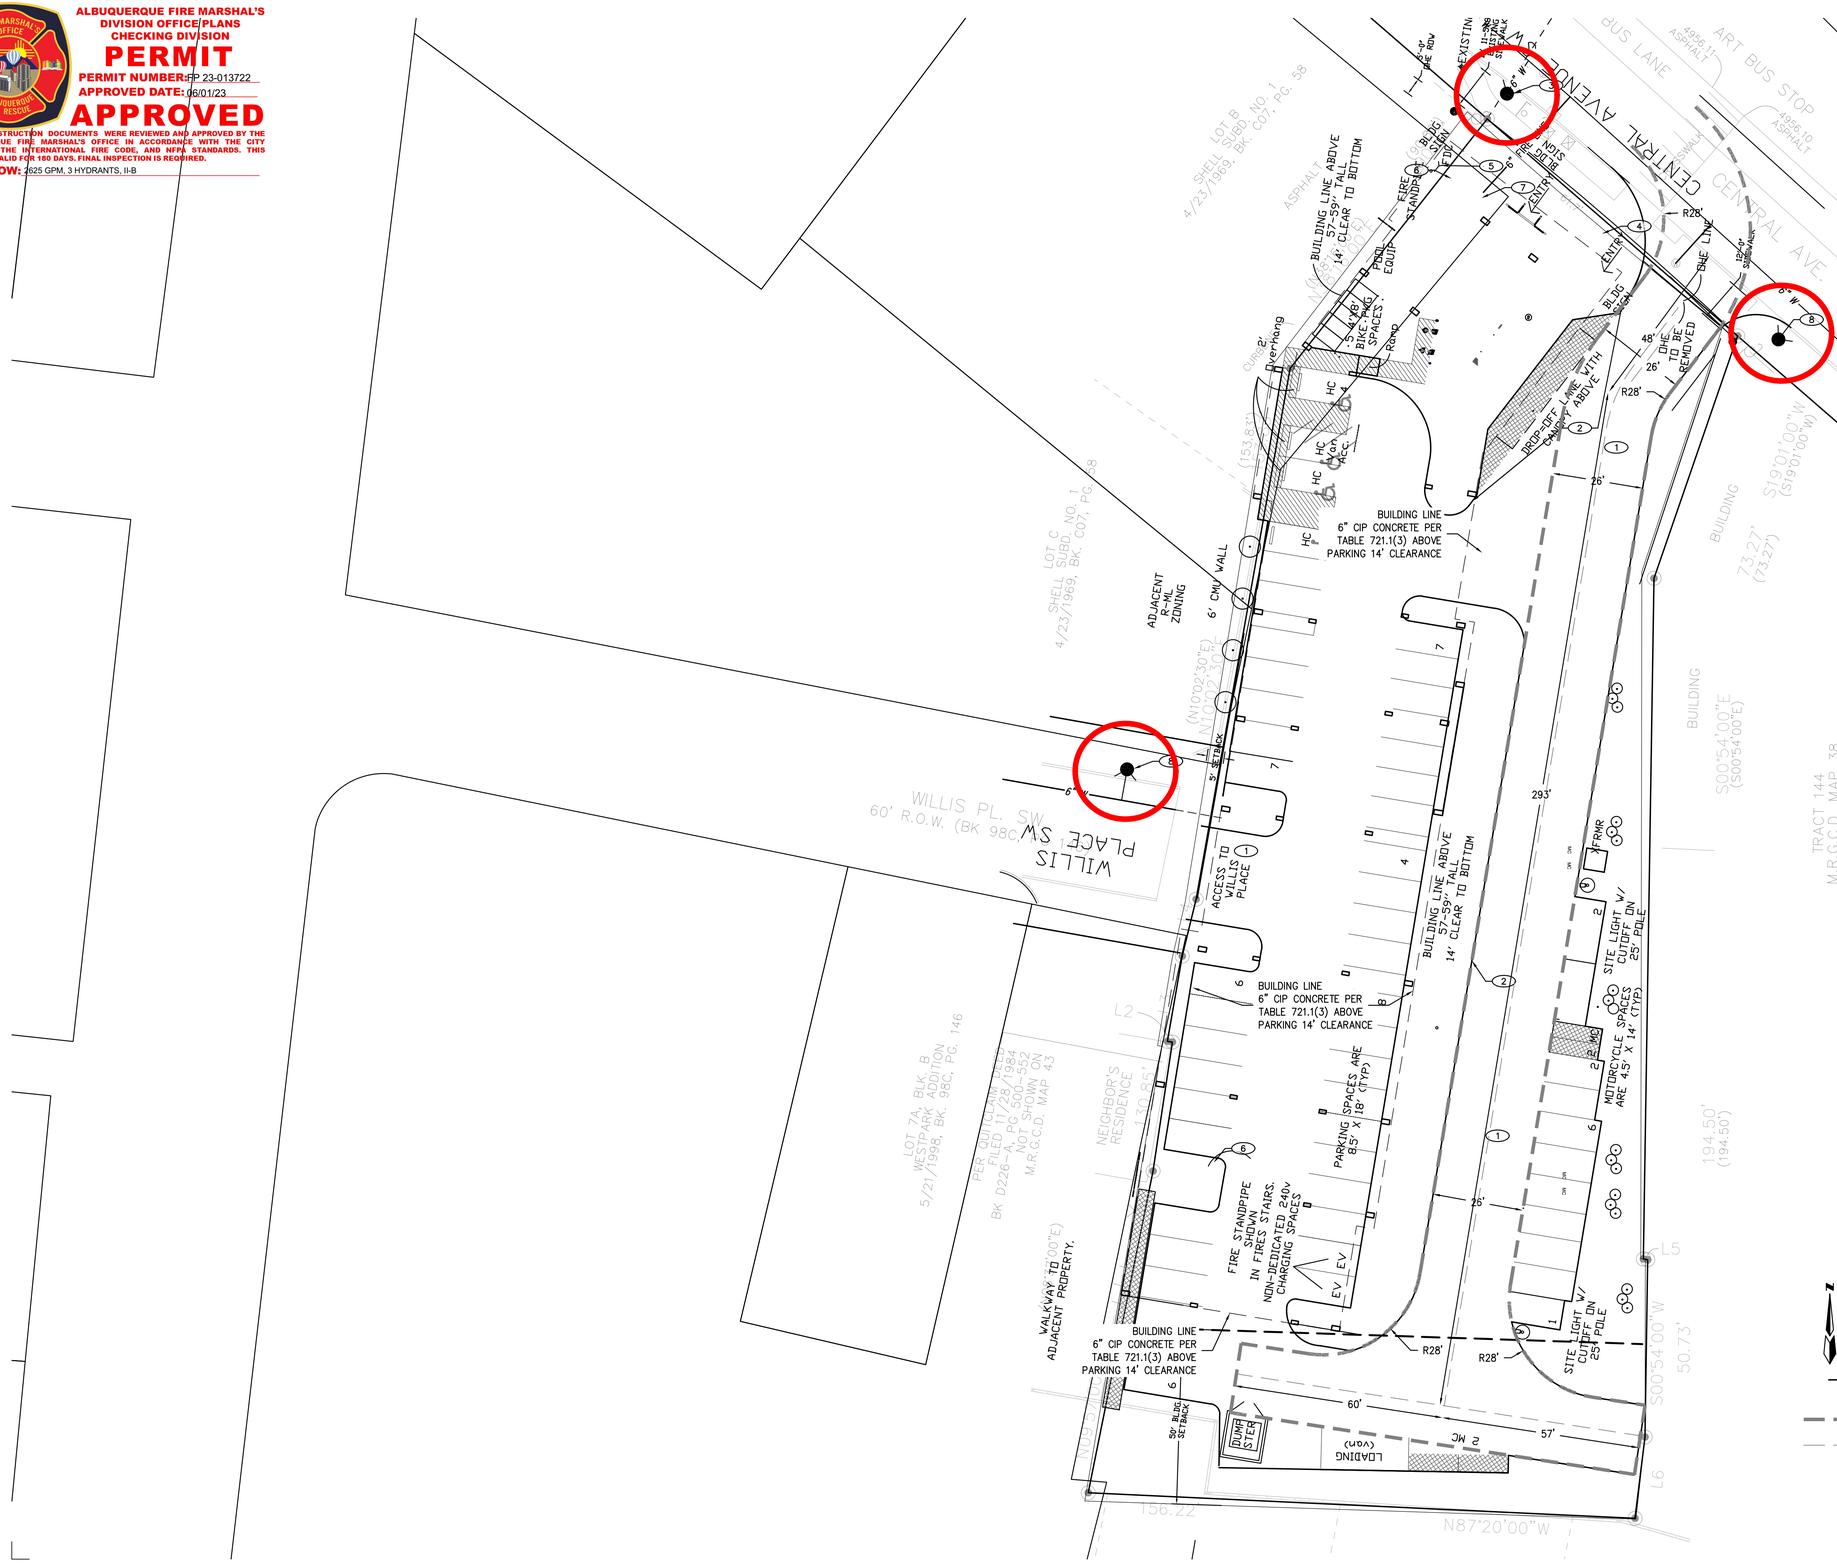

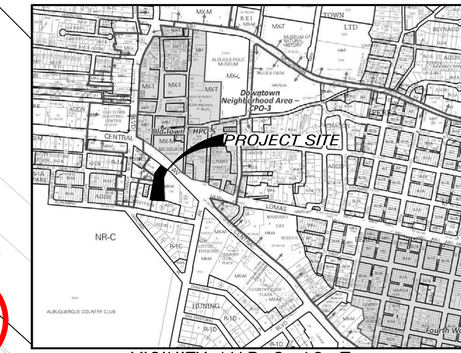

VICINITY MAP G-10-Z

GENERAL NOTES

1. FIRE FLOW REQUIREMENTS:

1.A.	OCCUPANCY GROUP:	R-1, B, S-2
1.B.	CONSTRUCTION TYPE:	II-B
1.C.	FIRE AREA SQUARE FOOTAGE:	65,020
1.D.	FIRE FLOW PER TABLE B105.1:	5,250 gpm
1.E.	AUTOMATIC SPRINKLERS PER FIRE DEPT.	50% of TABLE B105.1
1.F.	REQUIRED FIRE FLOW PER FIRE DEPT.	2,625 gpm @ 4HR DURATION
1.G.	NUMBER OF HYDRANTS REQUIRED:	3
1.H.	BUILDING HEIGHT: 3-STORY	59'
1.I.	FIRE LANE	TWO ENTRANCES PROVIDED

2. ALL FIRE APPARATUS ACCESS ROUTE SURFACES SHALL BE CAPABLE OF SUPPORTING 75,000 POUNDS
3. FIRE ACCESS ROUTES SHALL NOT EXCEED 10 PERCENT IN GRADE.
4. REFERENCE 2015 INTERNATIONAL FIRE CODE APPENDIX B, C AND D FOR CODE CRITERIA

KEYED NOTES

1. ASPHALT PAVING WITH 75,000 LB CAPACITY
2. CONCRETE CURB, PAINT RED, WHITE PAINT STENCIL 'NO PARKING' 'FIRE LANE' AT 20' O.C.
3. EXISTING FIRE HYDRANT
4. PREMISES STREET ADDRESS 4" HIGH MIN. W/MINIMUM STROKE WIDTH OF 0.5 IN. VISIBLE FROM STREET PER IFC 2015, SEC. 505
5. FIRE DEPARTMENT CONNECTION
6. CLASS 1 STANDPIPE PER 2015 IFC 905.3
7. FIRE RISER
8. NEW FIRE HYDRANT

N

20' 10' 0 20' 40'

SCALE: 1" = 20'

LEGEND

- FIRE HYDRANT
- FIRE ROUTE
- FIRE LANE
  24' MINIMUM WIDTH
  28' MINIMUM TURN RADIUS

THE group
THE HENSLEY ENGINEERING GROUP
300 BRANDING IRON RD. SE
RIO RANCHO, NEW MEXICO 87124
Phone:(505) 410-1622

RON E. HENSLEY
NEW MEXICO
21850
LICENSED PROFESSIONAL ENGINEER
06/01/23

1. THIS SET OF DRAWINGS EXISTS AS A WHOLE AND IT IS THE RESPONSIBILITY OF EACH CONTRACTOR BIDDING ON THE PROJECT TO REVIEW THE ENTIRE DRAWINGS AS SUCH. EACH SHEET EXPRESSES ONLY A PORTION TO THEIR RESPECTIVE DISCIPLINES.
2. DUE TO POTENTIAL REPRODUCTION, SCALING THE DRAWINGS MAY CAUSE DIMENSIONS IN NOT RECOMMENDED.

-PROJECT ADDRESS-
2026 CENTRAL AVE. S.W.
ALBUQUERQUE, NM

-CLIENT'S NAME-

-DRAWING NAME-
FIRE ACCESS PLAN

-PROJECT NAME-
CAMBRIA HOTEL

-PROJECT NUMBER-

-PROJECT PROGRESS-
PERMIT

-DRAWN BY-
REH

-CHECKED BY- REH / -APPROVED BY- REH

-DATE-
APR. 17, 23

-SCALE-
AS NOTED

-SHEET-
FIRE 1