



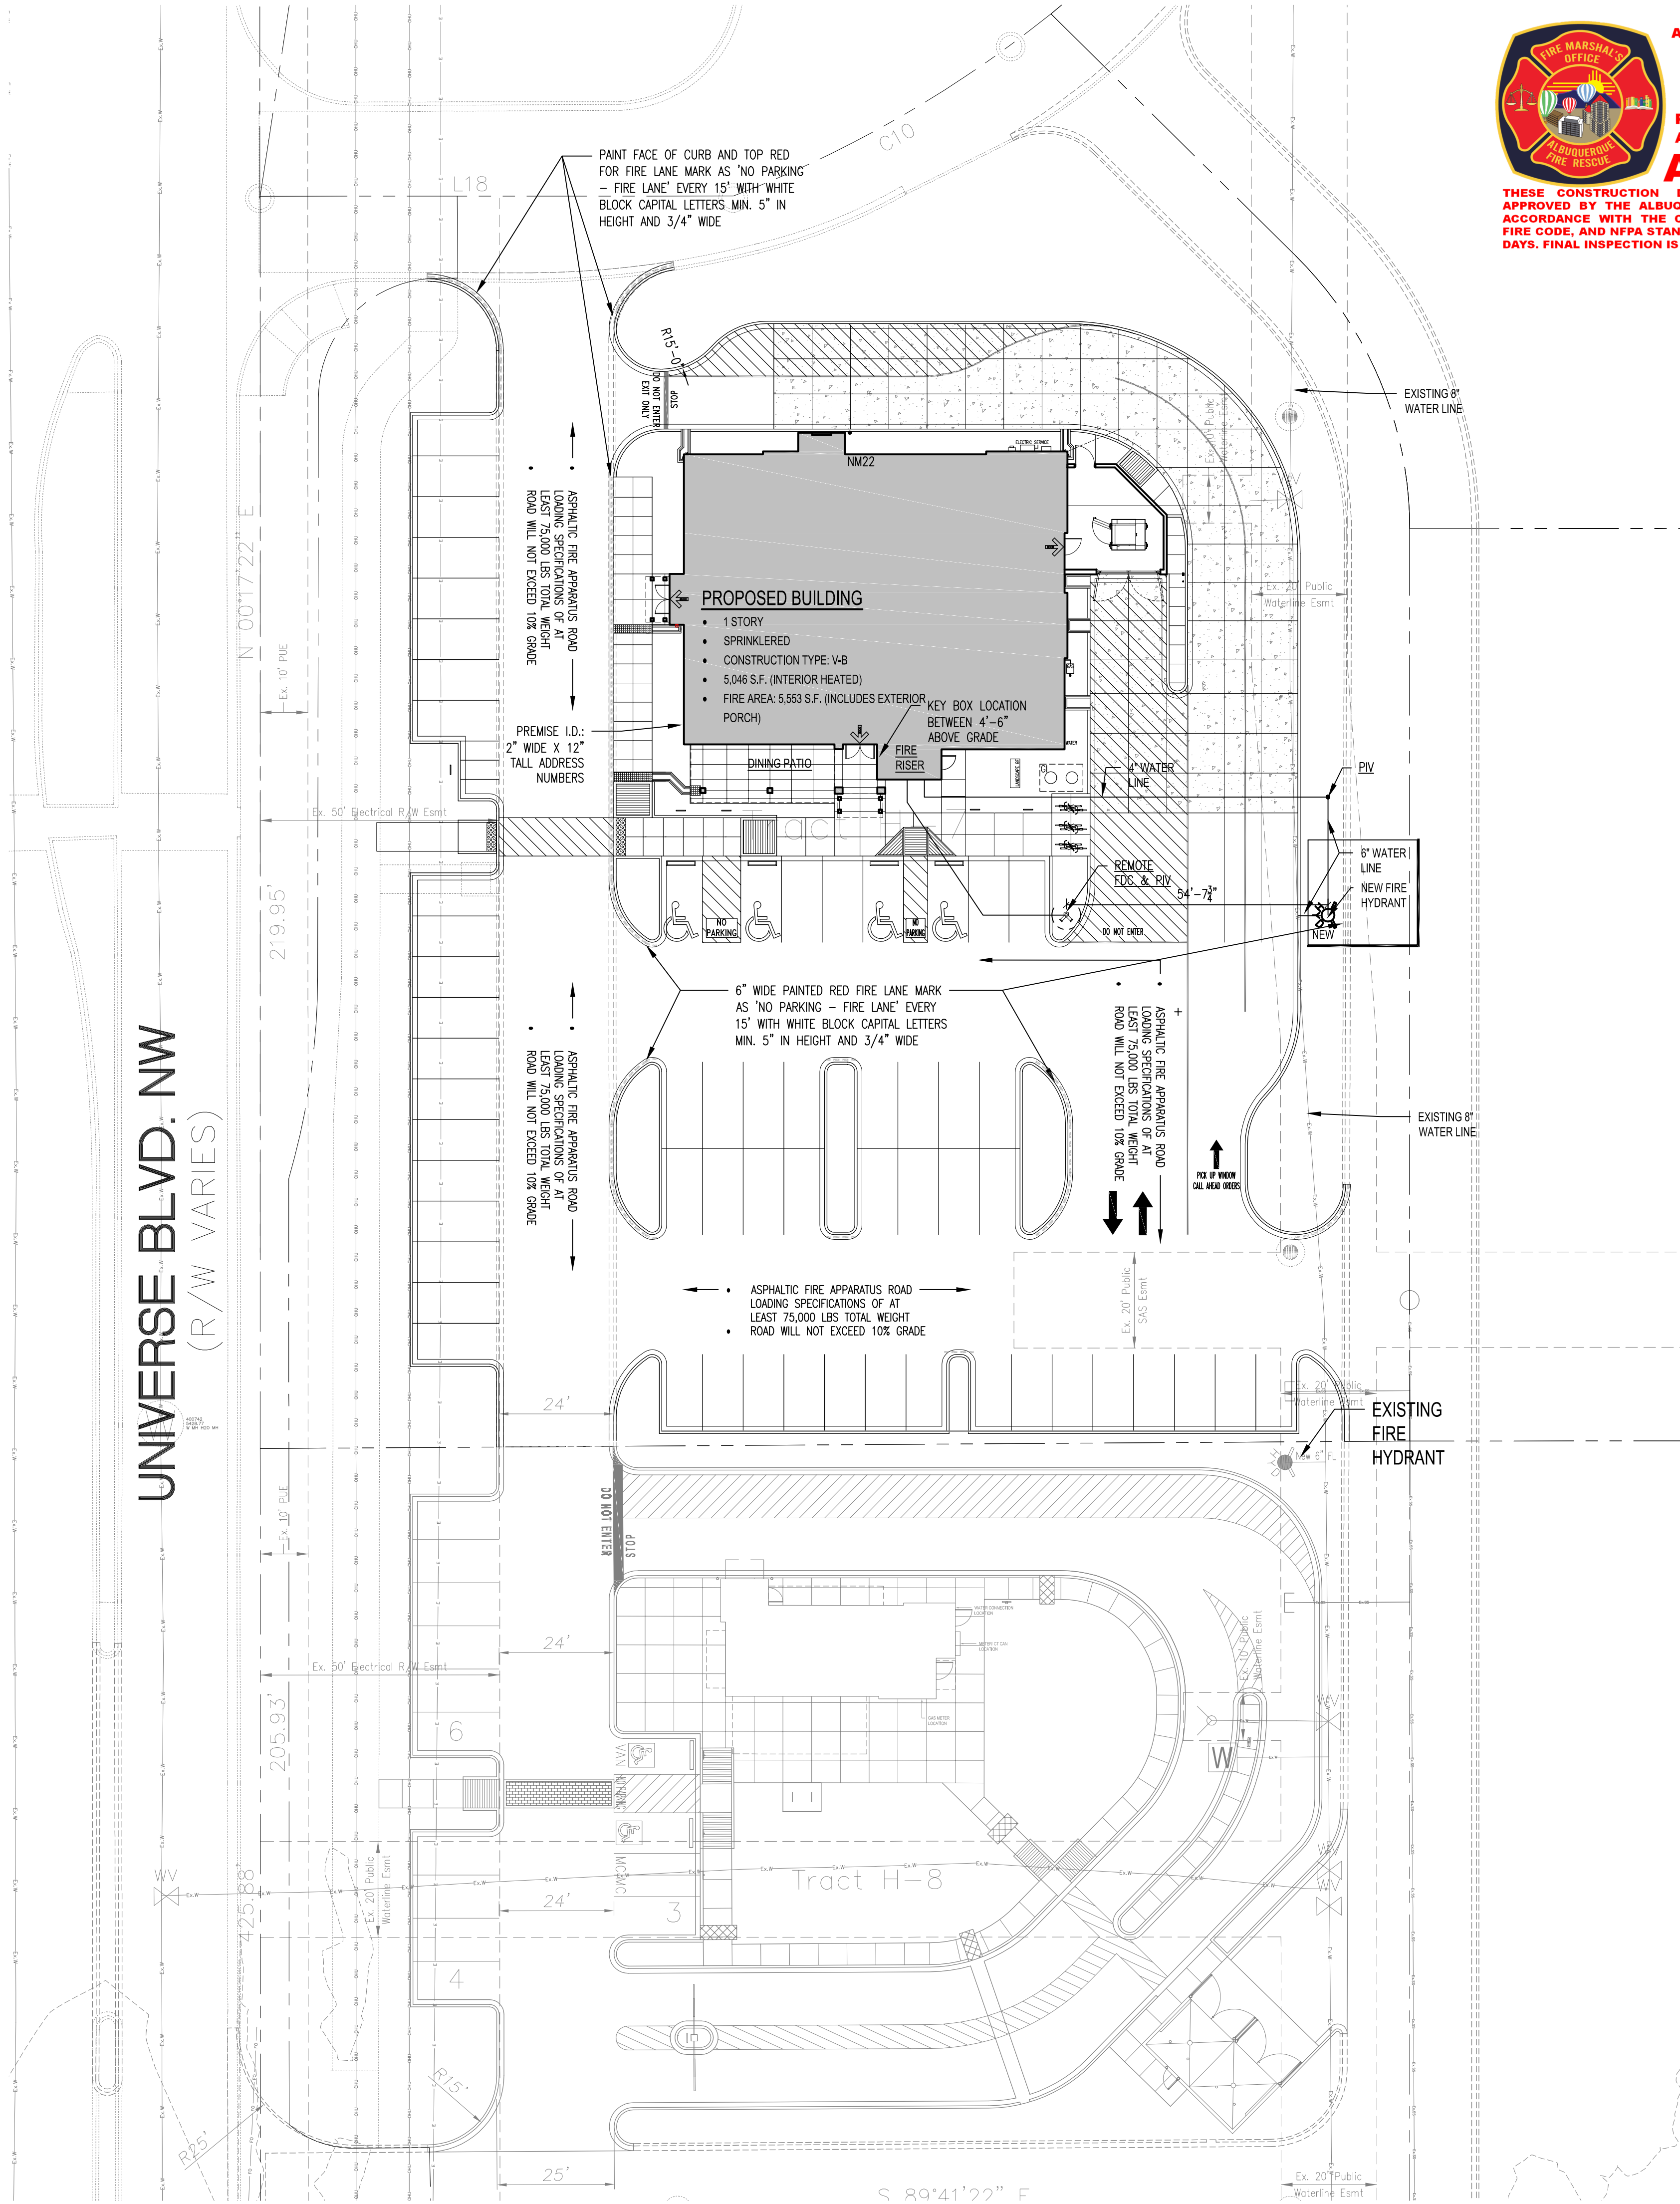

ALBUQUERQUE FIRE MARSHAL'S
DIVISION OFFICE PLANS
CHECKING DIVISION
PERMIT
PERMIT NUMBER: FP 21-007123
APPROVED DATE: 08/11/21
FIRE DEPARTMENT DATA


- THESE CONSTRUCTION DOCUMENTS HAVE BEEN REVIEWED AND APPROVED BY THE ALBUQUERQUE FIRE MARSHAL'S OFFICE IN ACCORDANCE WITH THE CITY ORDINANCE, THE INTERNATIONAL FIRE CODE, AND NFPA STANDARDS. THIS PERMIT IS VALID FOR 180 DAYS. FINAL INSPECTION IS REQUIRED.
- 1.1. TOTAL BUILDING AREA: 5,553 SF
1.2. CONSTRUCTION TYPE: V-B
1.3. REQUIRED FIRE FLOW: 25% OF VALUE IN TABLE B105.1(2) GPM
1.4. VALUE IN TABLE B105.1(2) = 2,000 GPM
2. 25% OF VALUE: 1000 GPM (PER FOOTNOTE a)
3. REQUIRED # OF FIRE HYDRANTS PER TABLE C102.1:
3.1. 1,750 OR LESS REQUIREMENT: 1 HYDRANT
3.2. MAXIMUM SPACING FROM ANY POINT ON STREET TO HYDRANT: 250'
3.3. MAXIMUM SPACING BETWEEN HYDRANTS: 500'



FIRE PLAN 1

SCALE: 1"=20'-0"

DRAWING NAME
REVISIONS

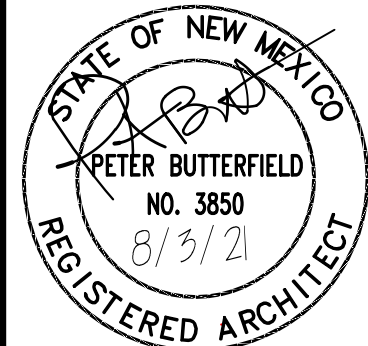

peter butterfield
architect 13013 glenwood hills ct. ne
albuquerque nm 87111 (ph) 505 332 9323 (fax) 212 0901

Dion's Restaurant - NM 22
9620 Universe Blvd. NW
Albuquerque, NM
FIRE 1
August 3, 2021