

GOLDEN LANE & ASSOCIATES
Consulting Structural Engineers
 9808 Dorothy Pl. NE
 ALBUQUERQUE, NM 87111
 (505) 298-2385 FAX (505) 294-7230

JOB 11-101 ASPEN CONCRETE

SHEET NO. 1 OF 1


CALCULATED BY GEL DATE 12/5/11

CHECKED BY _____ DATE _____

SCALE _____

GENERAL NOTES

1. CONCRETE 3000 psi
2. GROUT 2500 psi
3. MORTAR TYPE S
4. CMU TYPE N-I
5. REINFORCING GRADE 40
6. SEE GEOTECHNICAL INVESTIGATION REPORT, AMESTOY ESTATES PHASES 2 THRU 4, PREPARED BY VINYARD & ASSOCIATES, INC. ALBUQUERQUE, NM, PROJECT NO. 09-1-131, DATED SEPTEMBER 14, 2009 FOR PROPER SUBGRADE PREPARATION AND COMPACTION TO ACHIEVE A MINIMUM BEARING CAPACITY OF 1500 PSF. HAND COMPACT BACKFILL IN 12" LIFTS.
7. INSTALL CONTROL JOINTS WITH ONE VERTICAL BAR EACH SIDE OF JOINT AT A MAXIMUM SPACING OF 16'.

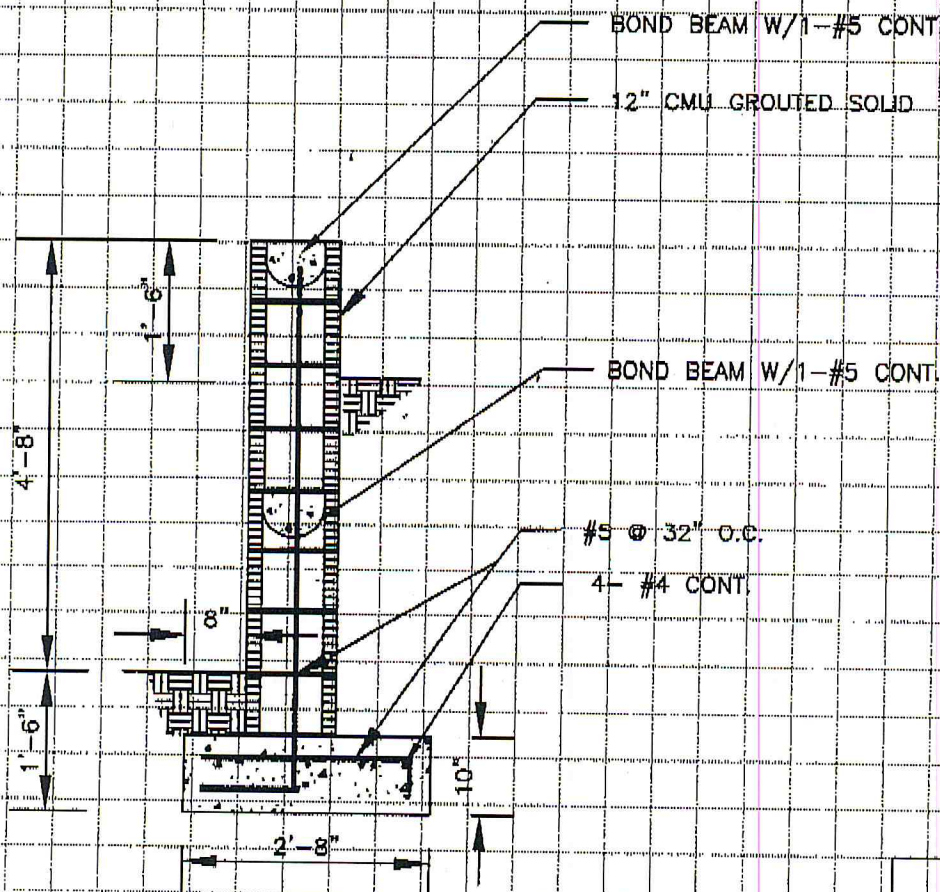

SCALE: 1/2" = 1'-0"

THE BOULDERS, FLOOD WALL
 ALBUQUERQUE, NEW MEXICO



GOLDEN LANE & ASSOCIATES
 Consulting Structural Engineers
 9808 Dorothy Pl. NE
 ALBUQUERQUE, NM 87111
 (505) 298-2385 FAX (505) 294-7230

JOB 11-101 ASPEN CONCRETE

SHEET NO. 1

OF 1

CALCULATED BY G. L. L.

DATE 12/5/11

CHECKED BY _____


DATE _____

SCALE _____

GENERAL NOTES

1. CONCRETE
2. GROUT
3. MORTAR
4. CMU
5. REINFORCING
6. SEE GEOTECHNICAL INVESTIGATION REPORT, AMESTOY ESTATES PHASES 2 THRU 4, PREPARED BY VINYARD & ASSOCIATES, INC. ALBUQUERQUE, NM, PROJECT NO. 09-1-131, DATED SEPTEMBER 14, 2009 FOR PROPER SUBGRADE PREPARATION AND COMPACTION TO ACHIEVE A MINIMUM BEARING CAPACITY OF 1500 PSF. HAND COMPACT BACKFILL IN 12" LIFTS.
7. INSTALL CONTROL JOINTS WITH ONE VERTICAL BAR EACH SIDE OF JOINT AT A MAXIMUM SPACING OF 16'.

3000 psi
 2500 psi
 TYPE S
 TYPE N-1
 GRADE 40

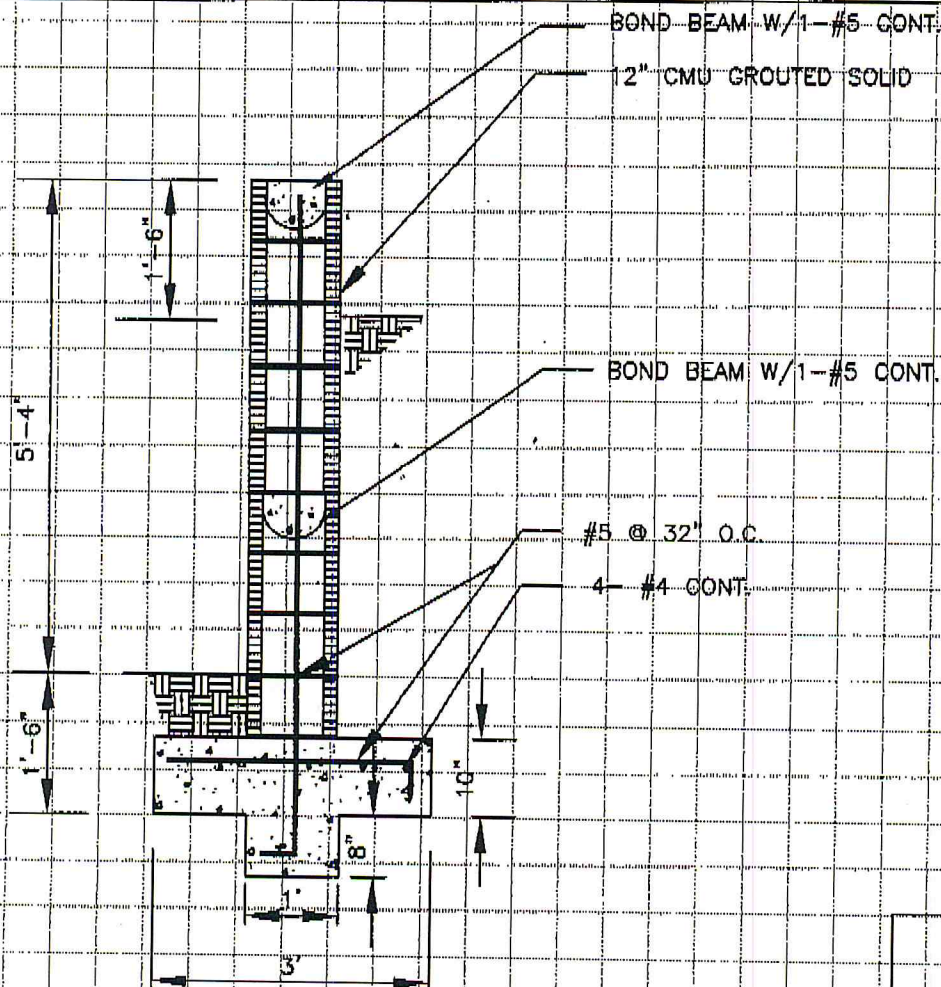

5'-4" CMU FLOOD WALL

THE BOULDERS, FLOOD WALL SCALE: 1/2" = 1'-0"
 ALBUQUERQUE, NEW MEXICO



GOLDEN LANE & ASSOCIATES
Consulting Structural Engineers
 9808 Dorothy Pl. NE
 ALBUQUERQUE, NM 87111
 (505) 298-2385 FAX (505) 294-7230

JOB 11-101 ASPEN CONCRETE

SHEET NO. 1 OF 1


CALCULATED BY GEL DATE 12/5/11

CHECKED BY _____ DATE _____

SCALE

GENERAL NOTES

1. CONCRETE 3000 psi
2. GROUT 2500 psi
3. MORTAR TYPE S
4. CMU TYPE N-
5. REINFORCING GRADE 40
6. SEE GEOTECHNICAL INVESTIGATION REPORT, AMESTOY ESTATES PHASES 2 THRU 4, PREPARED BY VINYARD & ASSOCIATES, INC. ALBUQUERQUE, NM, PROJECT NO. 09-1-131, DATED SEPTEMBER 14, 2009 FOR PROPER SUBGRADE PREPARATION AND COMPACTION TO ACHIEVE A MINIMUM BEARING CAPACITY OF 1500 PSF. HAND COMPACT BACKFILL IN 12" LIFTS.
7. INSTALL CONTROL JOINTS WITH ONE VERTICAL BAR EACH SIDE OF JOINT AT A MAXIMUM SPACING OF 16'.

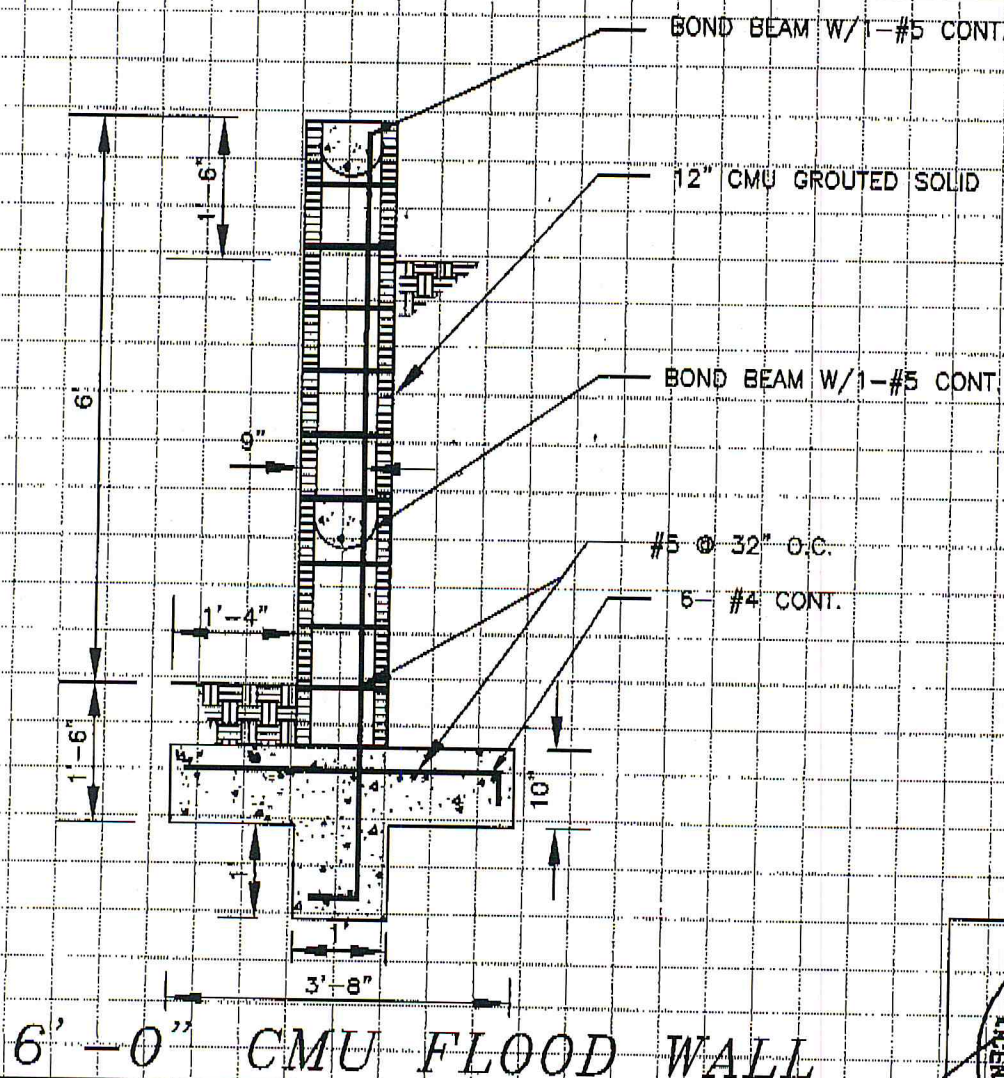

THE BOULDERS, FLOOD WALL
 ALBUQUERQUE, NEW MEXICO

SCALE: 1/2" = 1'-0"



GOLDEN LANE & ASSOCIATES

Consulting Structural Engineers

9808 Dorothy Pl. NE

ALBUQUERQUE, NM 87111

(505) 298-2385 FAX (505) 294-7230

JOB 11-101 ASPEN CONCRETESHEET NO. 1OF 1CALCULATED BY GRLDATE 12/5/11

CHECKED BY _____

DATE _____


SCALE _____

GENERAL NOTES

1. CONCRETE
2. GROUT
3. MORTAR
4. CMU
5. REINFORCING


3000 psi
2500 psi
TYPE S
TYPE N-I
GRADE 40

6. SEE GEOTECHNICAL INVESTIGATION REPORT, AMESTOY ESTATES PHASES 2 THRU 4, PREPARED BY VINYARD & ASSOCIATES, INC. ALBUQUERQUE, NM, PROJECT NO. 09-1-131, DATED SEPTEMBER 14, 2009 FOR PROPER SUBGRADE PREPARATION AND COMPACTION TO ACHIEVE A MINIMUM BEARING CAPACITY OF 1500 PSF. HAND COMPACT BACKFILL IN 12" LIFTS.
7. INSTALL CONTROL JOINTS WITH ONE VERTICAL BAR EACH SIDE OF JOINT AT A MAXIMUM SPACING OF 16'.

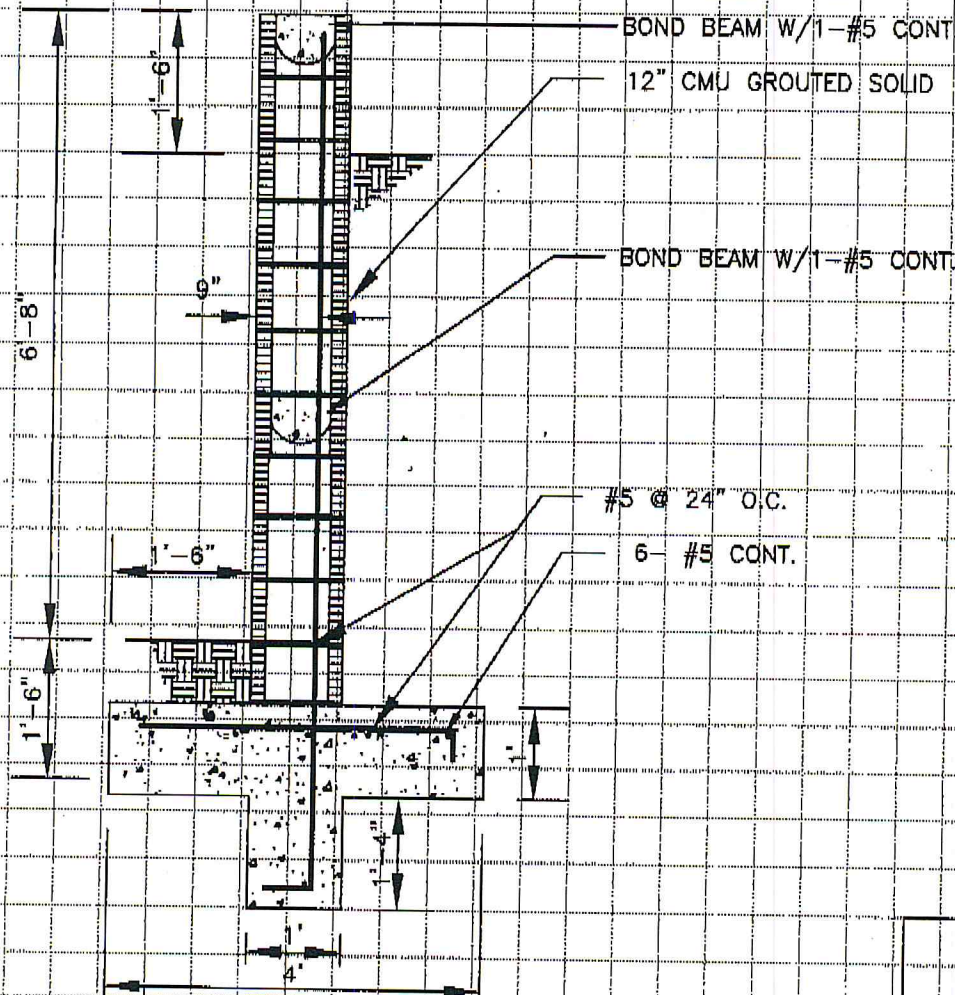

THE BOULDERS, FLOOD WALL
ALBUQUERQUE, NEW MEXICO

SCALE: 1/2" = 1'-0"

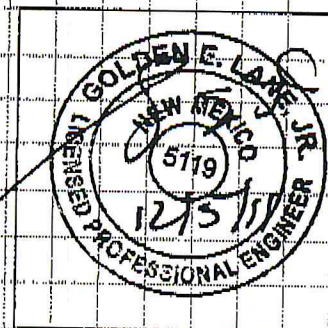

GOLDEN LANE & ASSOCIATES

Consulting Structural Engineers

9808 Dorothy Pl. NE

ALBUQUERQUE, NM 87111

(505) 298-2385 FAX (505) 294-7230


JOB 11-101 ASPEN CONCRETESHEET NO. 1 OF 1CALCULATED BY GEL DATE 12/5/11

CHECKED BY _____ DATE _____

SCALE _____

GENERAL NOTES

1. CONCRETE 3000 psi
2. GROUT 2500 psi
3. MORTAR TYPE S
4. CMU TYPE N-1
5. REINFORCING GRADE 40
6. SEE GEOTECHNICAL INVESTIGATION REPORT, AMESTOY ESTATES PHASES 2 THRU 4, PREPARED BY VINYARD & ASSOCIATES, INC. ALBUQUERQUE, NM, PROJECT NO. 09-1-131, DATED SEPTEMBER 14, 2009 FOR PROPER SUBGRADE PREPARATION AND COMPACTION TO ACHIEVE A MINIMUM BEARING CAPACITY OF 1500 PSF. HAND COMPACT BACKFILL IN 12" LIFTS.
7. INSTALL CONTROL JOINTS WITH ONE VERTICAL BAR EACH SIDE OF JOINT AT A MAXIMUM SPACING OF 16'.

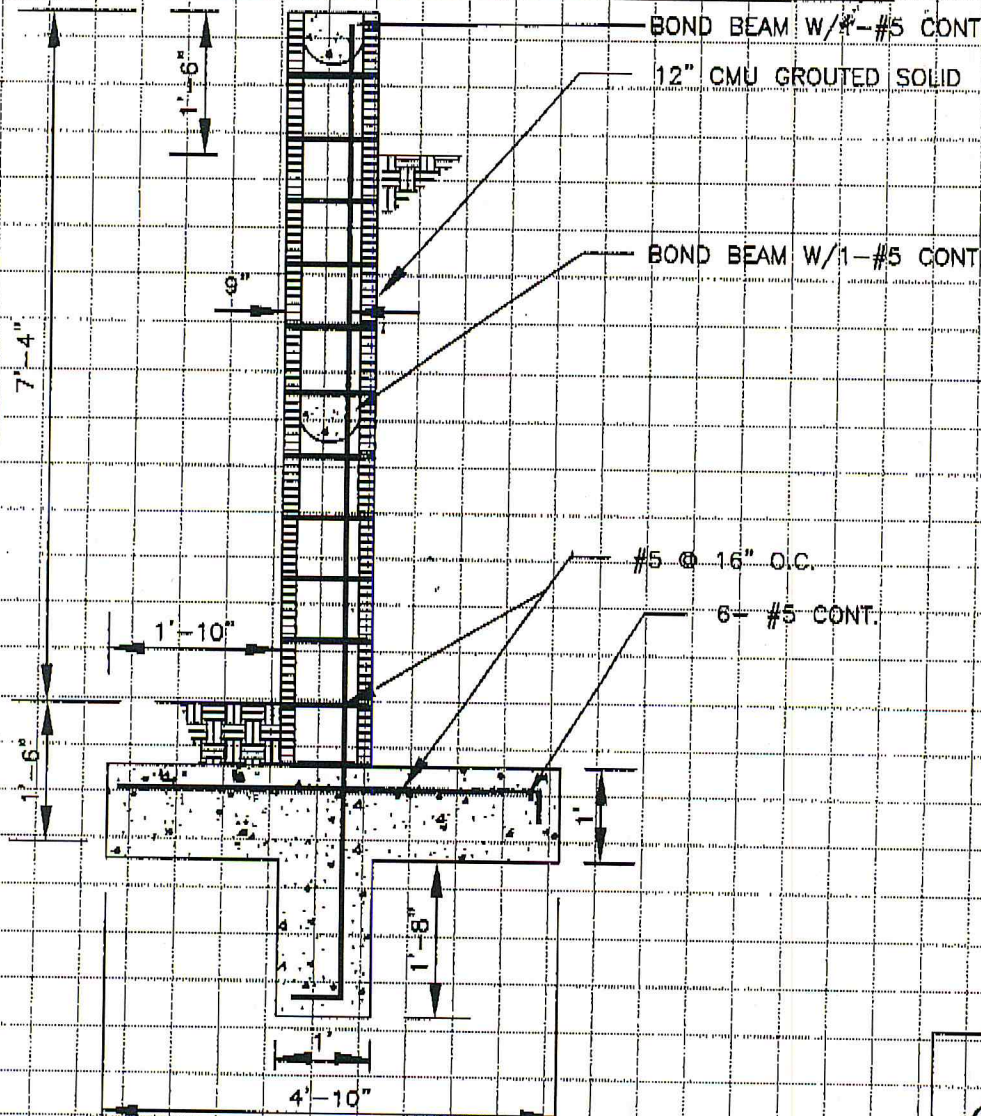**7'-4" CMU FLOOD WALL**THE BOULDERS, FLOOD WALL
ALBUQUERQUE, NEW MEXICO

SCALE: 1/2" = 1'-0"

