

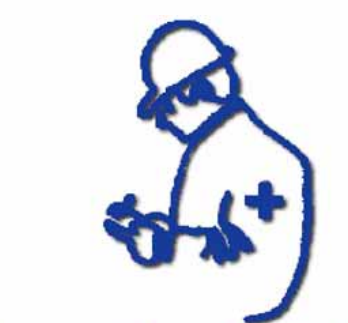
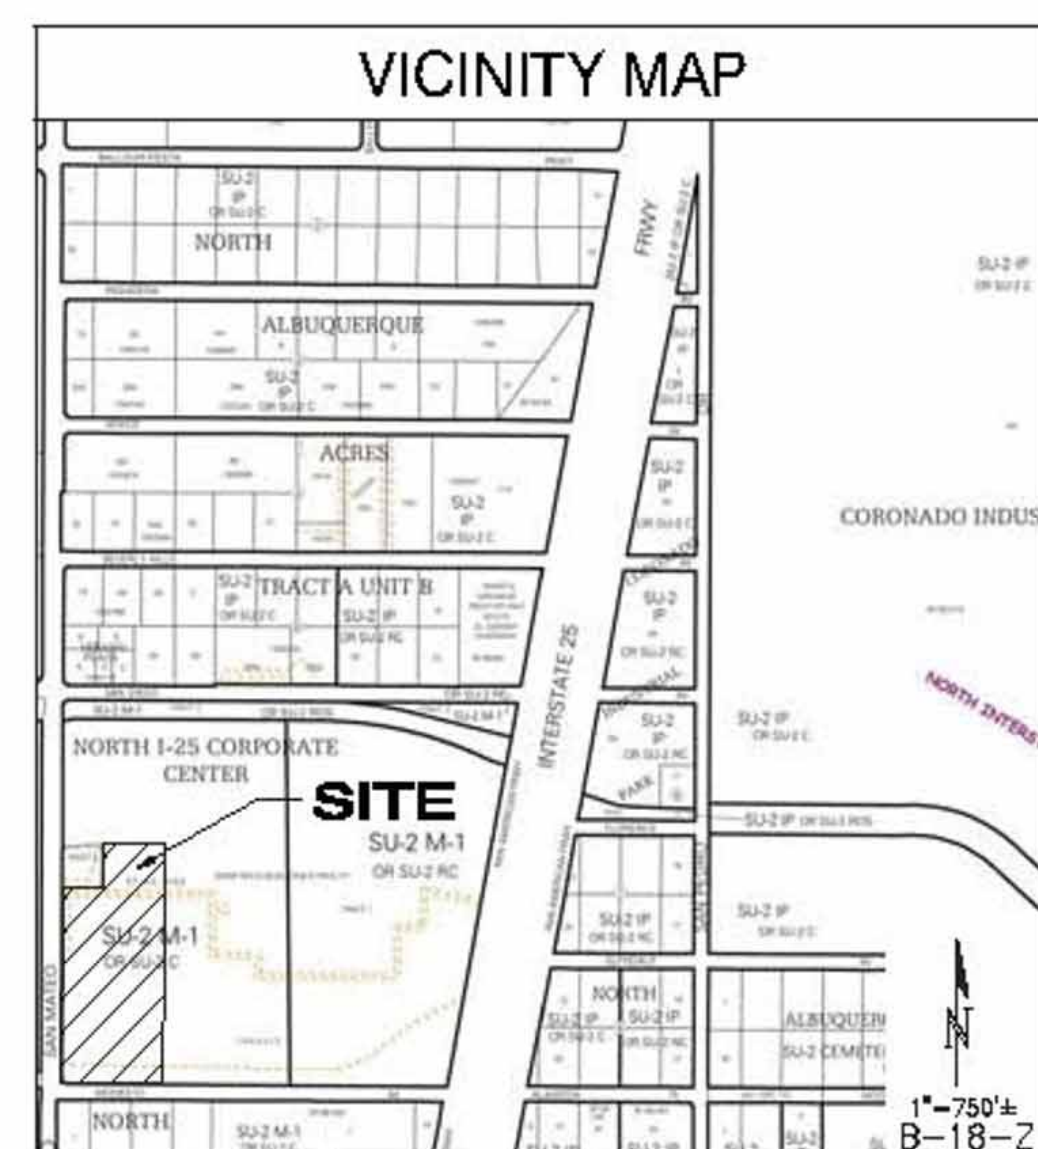


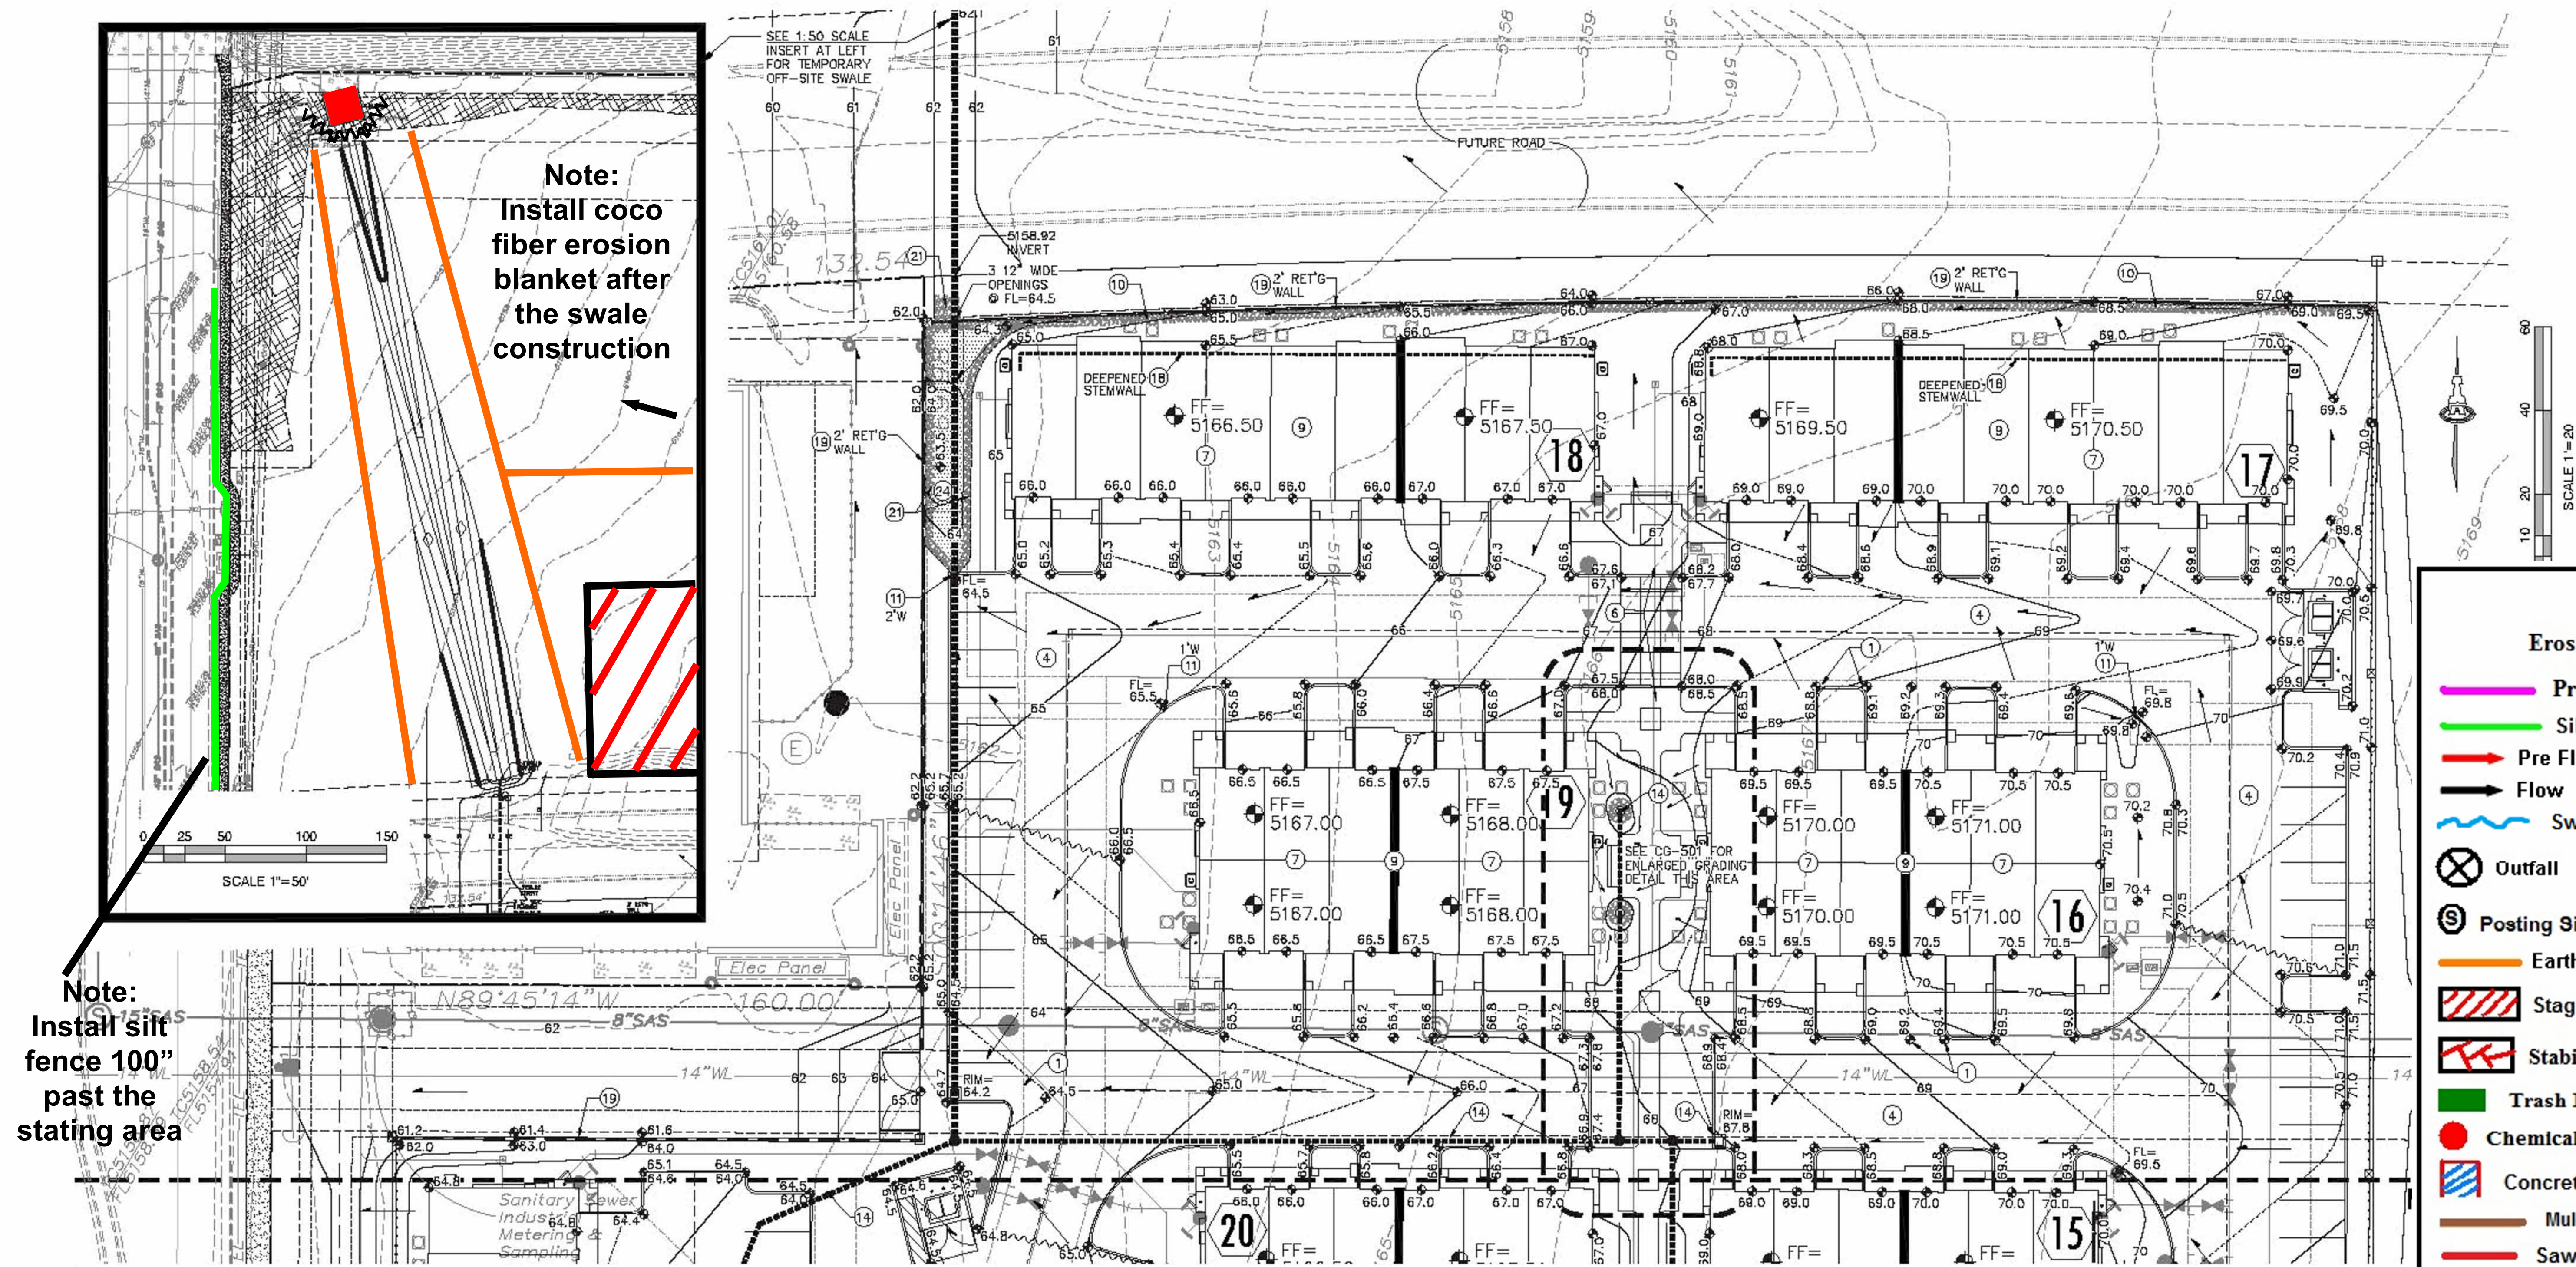

Engineer Stamp

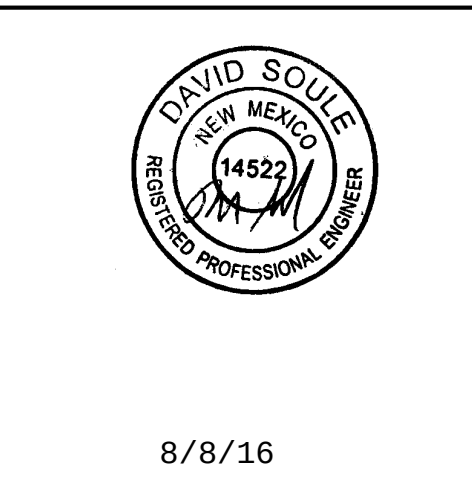

Broadstone NorthPoint
Townhomes

Receiving Waters and Critical Habitat: Rio Grande

Impairments: E. coli, Dissolved Oxygen, PCBs in Fish Tissue, Water Temperature

Grade: Before 1% - 4% After 1% - 3%