



**DRAINAGE REPORT**  
for  
**Desert Ridge Trails North**

see for 8/2003  
sheet 526 of 30

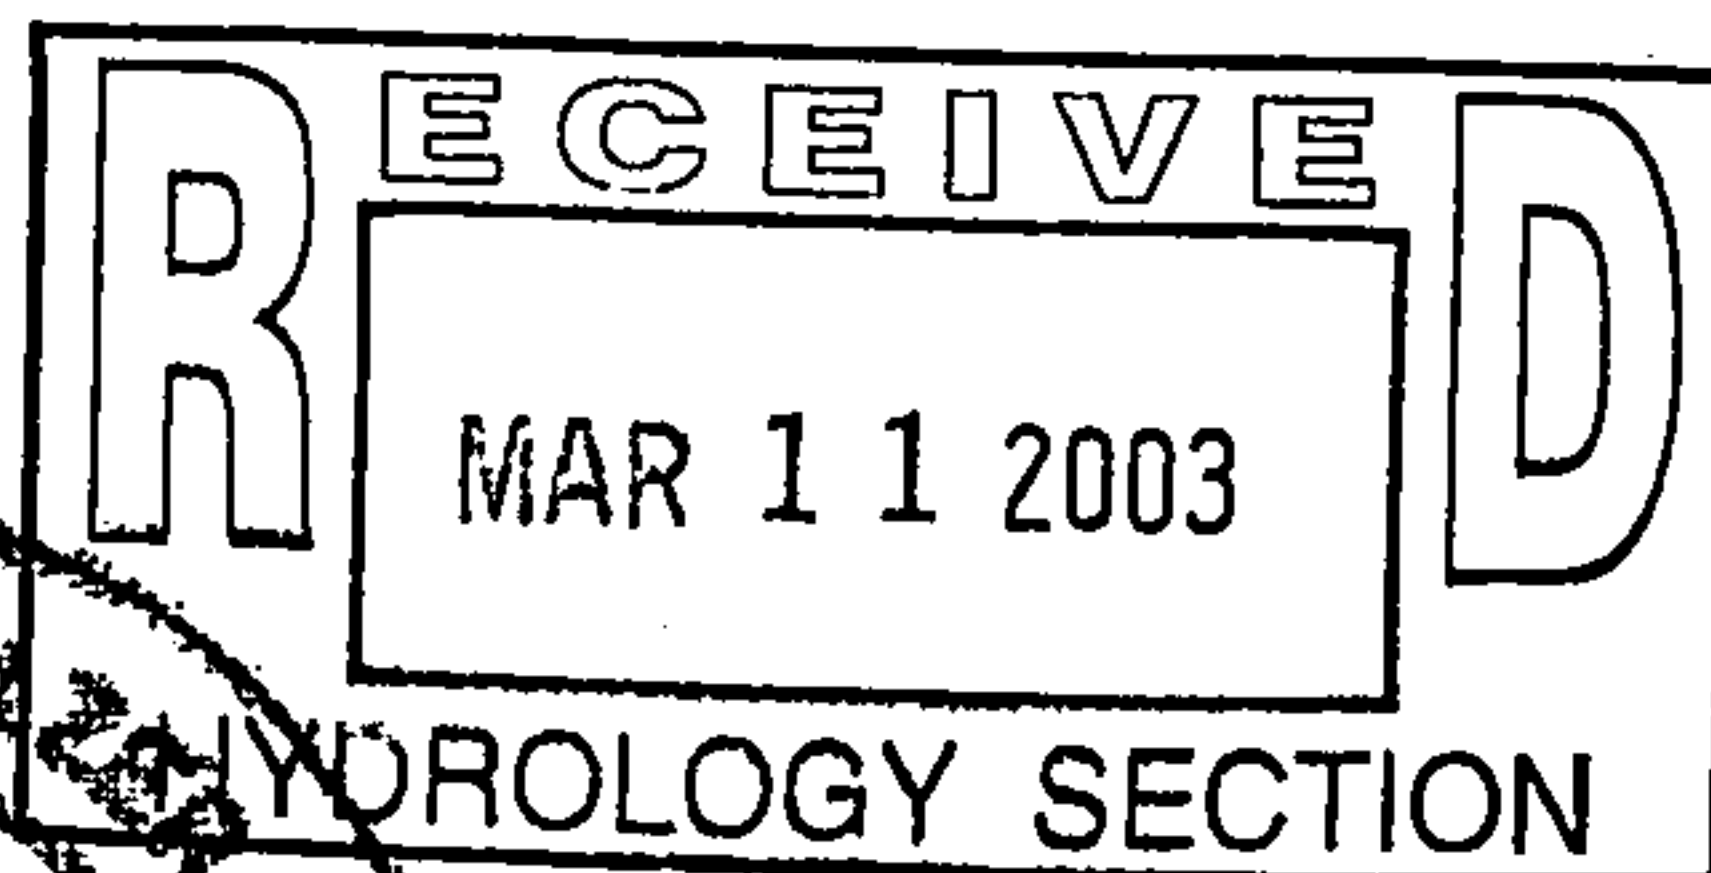

MARCH 2003  
DLH

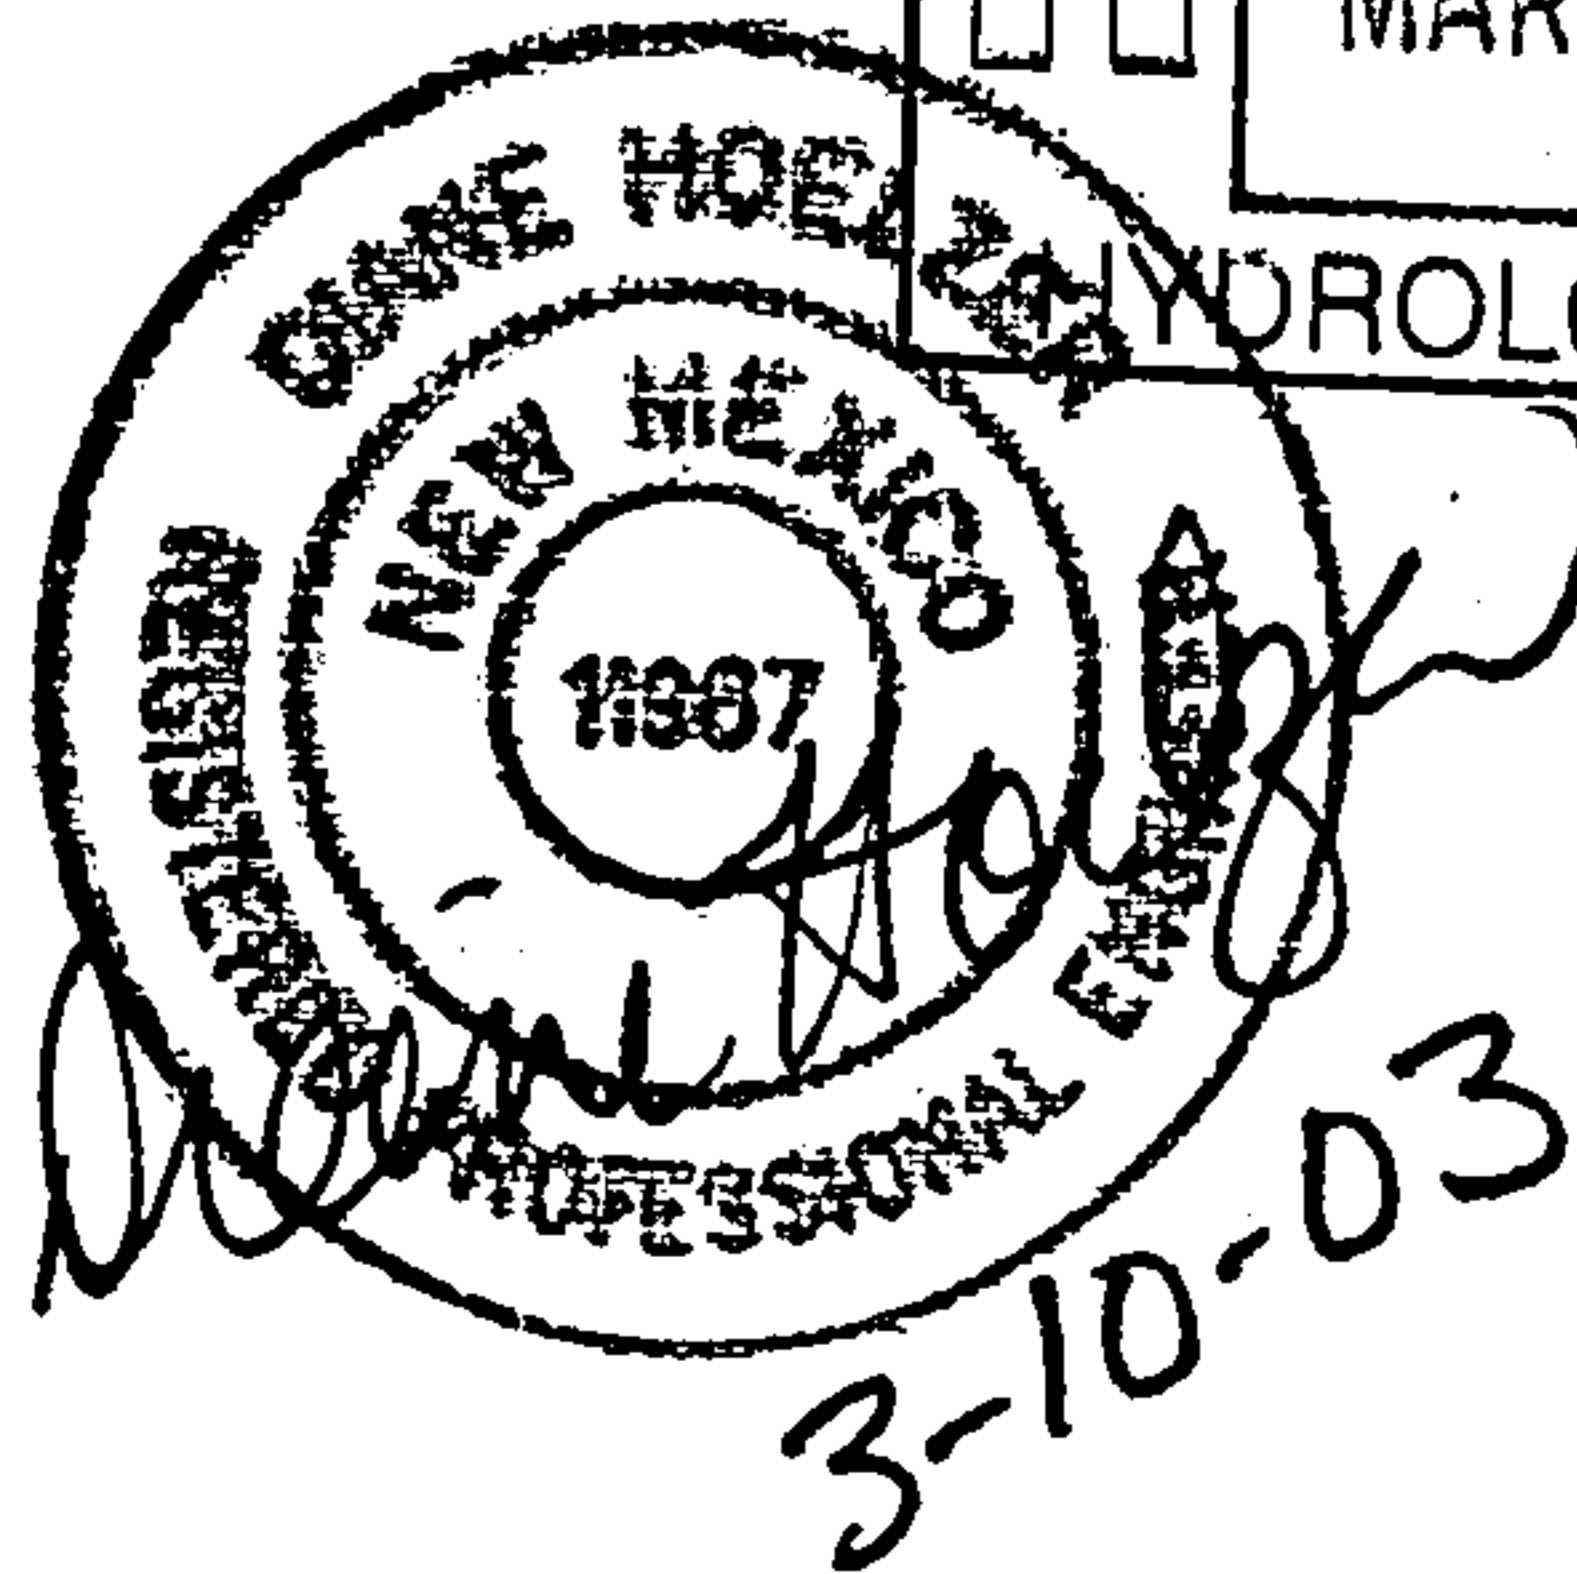

D. Mark Goodwin & Associates, P.A.  
Consulting Engineers

P.O. BOX 90606, ALBUQUERQUE, NM 87199  
(505) 828-2200 FAX 797-9539  
e-mail: dmgs@swcp.com

March 10, 2003

Mr. Carlos Montoya  
City of Albuquerque  
Hydrology Dept.  
PO Box 1293  
Albuquerque, NM 87103

**Re: Desert Ridge Trails North Subdivision ZAP C-19 (COA Rpt B19-D21)**

Dear Mr. Montoya,

This letter is in response to your comment letters dated February 7 and February 13 and our subsequent meeting on March 3, 2003 with yourself, Fred Aguirre and Richard Dourte:

February 7<sup>th</sup> comment letter:

1. Per our March 3 meeting, offsite flows entering Wyoming Blvd. from the east just north of the future Florence Avenue will be intercepted by a temporary detention pond on Lot 32, Block 10 and then conveyed to the proposed storm sewer in Wyoming which will extend to Beverly Hills and then west to the temporary offsite retention pond on Lot 25, Block 2. This offsite ponds will each be granted as a temporary public drainage easement with an accompanying executed Agreement and Covenant with maintenance responsibilities being taken care of by the developer/owner or Home Owners Association.

Offsite flows at the northeast corner of San Diego and Wyoming will be intercepted by a future double 'A' inlet to be constructed at the future curb return of the future Wyoming east lane. For the interim condition the double 'A' inlet box will be constructed with either a temporary Type D grate or beehive grate cover at the existing ground elevation.

Offsite flows originating from Lot 1, Block 9 will be allowed to flow across Wyoming Blvd. and then be intercepted by a series of inlets along the west side of Wyoming Blvd. just south of the Beverly Hills intersection.

2. The NAA Master Drainage Plan (Figure 5) proposed that all of the flows from our project site and the offsite flows east of Wyoming which enter our site end up at AP 204.19. This drainage report is not changing the location where all the flows were proposed to ultimately converge in accordance with the NAA Master Plan. With the exception of the diversion of subbasin 204.4 in a storm sewer in Florence, the NAA did not specifically address how the flows from subbasin 204.1 or 204.3 were to be subdivided and conveyed to AP 204.19. Figure 6 shows the proposed NAA Master Plan ultimate conceptual storm sewer system. Our drainage plan is in compliance with the conceptual storm sewer design with the ultimate construction of a storm sewer outfall westward at the intersection of Louisiana and San Diego. The only change our plan has made is to divert subbasin 204.4 north and west in Beverly Hills as opposed to in a storm sewer in Florence Avenue. In addition, as was indicated in our March 3 meeting, these flows may ultimately go south in Wyoming from Florence to another system in the future thus reducing the overall runoff contribution at Louisiana and San Diego. The downstream required improvements west of Louisiana will be equal to or less than the NAA Master Drainage Plan.

3. *The revised grading and drainage plan shows that the additional runoff from the north side of Florence Avenue as a result of construction from this project will be intercepted by an inlet on the north side of Florence at the intersection of Palm Yucca Drive. This inlet is already constructed and connected to the existing storm sewer system in Desert Ridge Trails. The Storm sewer analysis for this system was included in Appendix C as 'Stormplus Florence Avenue Diversion'.*
4. *The revised G&D plan gives all the required dimensions necessary to construct the pond for the required runoff capacity. Historically, as shown on the 'Existing Offsite Drainage Conditions Exhibit', runoff from our project site and offsite subbasins 204.1AE, 204.1BE and 204.4AE have been diverted along the south side of and in Beverly Hills Avenue and then across Louisiana and back into the natural arroyo channel. Per our meeting on March 3, the proposal is to construct the south half of Beverly Hills from the west end of our project site to Louisiana Blvd. and divert any spillway flows from the pond in Beverly Hills westward across Louisiana and back into the arroyo. This will be accomplished in a 24' wide pavement section with curb and gutter along the south side and extruded curb along the north side.*

*The pond will be dedicated as a 'public drainage easement' and the standard 'Agreement and Covenant' will be executed with either the developer or the Home Owners Association being responsible for maintenance of the pond.*
5. *Under existing drainage conditions, Lot 7,8 and 9 drain in a west to northwest direction. This historical flow pattern will not change with this development. At this time our client has control over Lot 9. The access issue has been resolved through the creation of a temporary turnaround easement as shown on the revised grading and drainage plan and as will be shown on the final plat.*

*February 13<sup>th</sup> comment letter:*

1. *A temporary storm sewer in Wyoming was not proposed. The intent of this drainage plan is to build the ultimate future storm sewer system with several temporary surface collection systems that could be converted to future inlets. Per our March 3 meeting the original intent and proposal is to build the required ultimate storm sewer, waterline, sanitary sewer and the west half of the Wyoming Blvd. pavement section as part of this project and intercept all the offsite flows east of Wyoming into the Wyoming storm sewer.*
2. *The Wyoming storm sewer has been designed as reflected on the revised grading and drainage plan. The stormplus 'Wyoming/Beverly Hills storm sewer analysis can be found in Appendix C.*
3. *Per your request I submitted the Drainage Report to Bernalillo County (Susan Calongne) and AMAFCA (Lynn Mazur). I have received comments from both of the them and have addressed their comments accordingly. (See accompanying letters and responses).*
4. *The storm sewer analysis was included in the original report in Appendix C. Refer to comment #3 for February 7th.*

5. *Per our March 3 meeting, the offsite retention pond has capacity for all the onsite project flows and the offsite paving improvements for Beverly Hills and Wyoming Blvd. for the 100 year 10 day storm. The offsite flows from subasins 204.1AE, 204.1BE and 204.4AE east of Wyoming will be routed through the retention pond. It is my understanding that all parties were in agreement that any overflow from the retention pond would be diverted west along Beverly Hills to Louisiana in a proposed 24' pavement section with curb and gutter on the south side to be built in conjunction with this project.*

*Please call me if you have any questions.*

*Sincerely,*

MARK GOODWIN & ASSOCIATES, P.A.



Diane Hoelzer, PE  
Senior Engineer

DLH/dlh

f:\desert ridge trails north\dr\_city\_ltr.wpd



## TABLE OF CONTENTS

COA COMMENT LETTERS AND RESPONSE  
BERNALILLO COUNTY COMMENT LETTER AND RESPONSE  
AMAFCA COMMENT LETTER AND RESPONSE

- I. PROJECT DESCRIPTION
- II. DESIGN CRITERIA AND PREVIOUS REPORTS
- III. EXISTING DRAINAGE CONDITIONS
- IV. DEVELOPED DRAINAGE CONDITIONS
  - IV.A N.A.A. MASTER DRAINAGE PLAN
  - IV.B REVISED MASTER DRAINAGE PLAN

FIGURE 1: VICINITY MAP

FIGURE 2.1-2.3 CURRENT FEMA FLOODPLAIN MAP

FIGURE 3: REVISED FEMA FLOODPLAIN MAP (EL CAMINO ARROYO)

FIGURE 3.1: CLOMR LETTER FROM FEMA -February 20, 2003

FIGURE 4: EXISTING DRAINAGE CONDITIONS (N.A.A. MASTER DRAINAGE PLAN)

FIGURE 5: FUTURE DRAINAGE CONDITIONS (N.A.A. MASTER DRAINAGE PLAN)

FIGURE 6: FUTURE STORM SEWER FACILITIES (N.A.A. MASTER DRAINAGE PLAN)

FIGURE 7: REVISED PROPOSED DRAINAGE PLAN

FIGURE 8: INFRASTRUCTURE LIST

TABLE 1: SUMMARY OF ONSITE HYDROLOGY

TABLE 2: SUMMARY OF ONSITE STREET CAPACITIES

TABLE 3: SUMMARY OF ONSITE STORM SEWER INLET INTERCEPT

*Table of Contents - continued*

**APPENDIX A - HYDROLOGY**

*Temporary Retention Pond Volume Calcs and Design*

*Time of Concentration Calcs.*

*Land Treatment and Area Calcs.*

*AHYMO Hydrology for Summary Tables 4, 5 and 7*

*AHYMO Hydrology for routing existing offsite flows thru Retention Pond*

*AHYMO Hydrology for routing developed offsite flows thru Retention Pond*

**APPENDIX B - HYDRAULICS**

*HEC-2 Street Capacity Calcs. Wyoming Blvd. For Inlets*

*HEC-2 Street Capacity Calcs Onsite and Offsite*

**APPENDIX C - STORM SEWER**

*Sump Inlet Calcs.*

*Storm Sewer Analysis Wyoming / Beverly Hills*

*Storm Sewer Analysis Desert Ridge Trails*

**APPENDIX D - NAA MASTER DRAINAGE PLAN**

*Supplemental Information*

**POCKET A:**    *EXISTING OFFSITE DRAINAGE CONDITIONS EXHIBIT  
STREET CAPACITY AND SUBASIN BOUNDARY EXHIBIT*

**POCKET B:**    *GRADING AND DRAINAGE PLAN  
PRELIMINARY PLAT*

## **I. PROJECT DESCRIPTION**

The proposed Desert Ridge Trails North Subdivision comprises approximately 32 acres to be developed into 124 single family homes. The project site is located immediately north of the currently developing Desert Ridge Trails subdivision. The site is bounded by the future Wyoming Blvd. to the east, the future Beverly Hills Avenue to the north and the existing Sandia Sports Plex to the west and Florence Avenue to the south as shown on Figure 1 Vicinity Map.

## **II. DRAINAGE DESIGN CRITERIA AND PREVIOUS REPORTS**

The design criteria used in this report was in accordance with Section 22.2 Hydrology of the Development Process Manual, Volume 2, Design Criteria, January 1993 edition. The 100-year 6-hour storm event was analyzed to determine street capacities using  $P(1\text{ hr})=2.15"$ ,  $P(6\text{ hr})=2.55"$ . The onsite Land Treatment values used were Treatment D=45, Treatment C=27.5 and Treatment B=27.5 as determined using "Table A-5 Percent Treatment D" in the DPM. AHYMO printouts are provided in Appendix A.

## **III. EXISTING DRAINAGE CONDITIONS**

Under existing drainage conditions, the south fork and the north fork of the El Camino Arroyo enter the site from the east near the intersection of Florence and Wyoming at the southeast quadrant of the project site. The south fork enters the southwest quadrant of this project from Florence Avenue. The north fork enters the project site from Wyoming Blvd. just north of the intersection with Florence Avenue.

As shown in Figure 2.1-2.3 the project site lies within the 100 year FEMA floodplain. A CLOMR request for "The La Cueva Arroyo I-25 East to Eagle Rock Avenue and The El Camino Arroyo Diversion Storm Drain" was made to FEMA and a CLOMR approval letter from FEMA was received on February 20, 2003 as shown in Figure 3.1 in this report. When all construction has been completed in accordance with the CLOMR, a LOMR request will be submitted and upon FEMA's approval, the revised floodplain will be as shown in Figure 3. The CLOMR will divert the entire south fork of the El Camino Arroyo to a sediment pond to be located in the northeast quadrant at the intersection of Glendale and Wyoming Blvd. Runoff from the sediment pond outfall will then be conveyed through a storm sewer to the La Cueva channel to the south which is under construction as part of the Desert Ridge Trails Subdivision.

Two additional small arroyos enter the project site from the east at Wyoming Blvd. The first arroyo crosses Wyoming at San Diego Avenue. The second arroyo enters the site just north of the first one just south of the Beverly Hills intersection. Refer to Pocket A: "Existing Offsite Drainage Conditions" Exhibit and Figure 4.

As shown Figure 3, after the LOMR is received from FEMA for Desert Ridge Trails, a remnant floodplain will still lie within 4 lots of our project site. A CLOMR and LOMR request will need to be made to FEMA for the removal of this remnant floodplain from our project site. The CLOMR request will be submitted upon approval of this drainage plan.

No offsite flows enter the site from the north, west or south. The developing Desert Ridge Trails to the south is eliminating offsite flows from enter the project site from Florence Avenue.

On the north side of the Sports Plex immediately south of Beverly Hills Avenue there is a diversion berm that deflects flows westward and away from the existing homes located on the north side of Beverly Hills Avenue to the existing arroyo path just west of Louisiana Blvd. There is also a graded swale on the south side of the unimproved Beverly Hills Avenue that conveys runoff to Louisiana where runoff is then conveyed west of Louisiana in the arroyos historical flow pattern.

## **IV. DEVELOPED DRAINAGE CONDITIONS**

### **IV.A. N.A.A. Master Drainage Plan**

This project site lies within the City of Albuquerque's "Final North Albuquerque Acres Master Drainage Plan", RTI, October 1998. As shown in Figure 5 "Future Conditions (NAA Master Drainage Plan)" the north half of this project site is part of Subasin 204.1 and the south half is part of Subasin 204.3. Runoff from Subasin 204.4 was conveyed to Louisiana in a 36" RCP storm sewer in Florence Avenue. At Florence and Louisiana runoff from Subasin 204.3 was added into the storm sewer and conveyed north in Louisiana and then west



towards I-25. Subasins 204.1 and 204.2 were conveyed to an I-25 crossing through a combination of storm sewer and a concrete lined channel and added to the runoff from Subasins 204.4 and 204.3 before crossing under the I-25 freeway as shown in Figure 6. The actual alignment of the channel and storm sewer west of Louisiana Blvd. has yet to be determined.

#### **IV.B. Revised Proposed Master Drainage Plan**

Figure 7 shows in detail the proposed revised future master drainage plan as part of the development of this project. The natural topographic fall of the land on this project site is towards the northwest. The project site will be graded so that all of the developed flows will be conveyed to the northwest corner through a combination of street flow, storm sewer and open channel. The overall fall in Wyoming Blvd. adjacent to this project is also towards the north. For this reason, the originally proposed 36" storm sewer in Florence is being proposed to be relocated in Beverly Hills Avenue.

The offsite flows from Subasins 1A, 1B and 4A as shown in Figure 7 and the 'Existing Offsite Drainage Subasins Map (Pocket A)' are to be conveyed through a 42" RCP storm sewer north in Wyoming and then west in Beverly Hills to the west property line. The storm sewer is sized to convey the future 'developed' conditions flows. At some undefined future time when the existing Sports Plex property develops into a different use, this storm sewer will continue in Beverly Hills to Louisiana and then be conveyed either north or south before continuing west to the future I-25 crossing as shown in Figure 6. Any future alignment(s) will have to be determined at the time of development of the adjacent properties. Since the general relief of the land is in a westerly direction, there are numerous potential alignments that could work in the future depending upon how all of this vacant land west of Louisiana develops. For these reasons no specific alignment is being proposed at this time in conjunction with this project that differs from what is already proposed in the NAA Master Drainage Plan.

At the northwest corner of the project site the onsite and offsite flows are to be combined in the storm sewer and then routed through an offsite temporary retention pond located on Lot 25 immediately north and adjacent to the north side of Beverly Hills Avenue. This temporary retention pond is sized to contain the 100 year 10 day storm event for all the developed flows originating from this project site, Wyoming Blvd. and Beverly Hills Avenue. When the 'developed' flows from the project site and the 'existing' flows from the offsite subasins 1A, 1B, and 4A are routed through the offsite retention pond there is a peak discharge over the spillway of 75.1 cfs. When the 'developed' flows from the project site and the developed flows from the offsite subasins 1A, 1B, and 4A are routed through the pond there is a peak discharge over the spillway of 45.4 cfs. It should be noted that these flows are still considerably less than the (+) 276 cfs that would currently flow towards Beverly Hills and then westward to the Louisiana/Beverly Hills intersection under 'existing' drainage conditions. Refer to Figure 4 where flows from subasins 204.0 and upstream from there are being removed and subasin 204.1 east of Wyoming is being diverted to the retention pond. All the AHYMO output files can be found in Appendix A.

The 'existing drainage conditions' flows from Subasins 1A, 1B and 4A will be routed through the pond. A spillway along the south side of the pond will allow overflow to discharge into Beverly Hills. It is proposed that overflow from the temporary retention pond be directed south across Beverly Hills and then west along a 24' wide curb and gutter pavement section to Louisiana Blvd. before spilling into the existing arroyo west of the Louisiana/Beverly Hills intersection. The diversion of these flows north in Wyoming and then west in Beverly Hills around our project site will allow some of the area in the Sport Plex to be removed from the floodplain while returning the overflow from the pond to the existing flow path of the floodplain downstream of the proposed diversions in Wyoming Blvd.

All of the developed flows in Florence Avenue are being diverted into the storm sewer in the Desert Ridge Trails subdivision (currently under construction). That project's onsite storm sewer was re-analyzed to verify that the additional developed flows from Florence Avenue could be received into that system. A portion of the onsite storm sewer within that project has already been upsized to accomplish these additional flows. The revised storm sewer analysis can be found in Appendix C.

Two inlet catch basins will intercept flows from subasins 1B and 4A into the Wyoming storm sewer. A temporary public detention pond on Lot 32 immediately northeast of the Florence / Wyoming intersection will detain flows for a short period before allowing runoff to enter the Wyoming storm sewer. At some future date when either Lot 32 develops or the east side of Wyoming Blvd. is constructed, this temporary pond will be eliminated. A public drainage easement will be granted and an 'Agreement and Covenant' will be executed by the owners of Lot 32 for this pond. The flows at San Diego and Wyoming will be intercepted by a double



*inlet catch basin that will be converted to an inlet when the future east side of Wyoming Blvd. is constructed.*

*Summaries for onsite hydrology, street capacities and inlet interception can be found in Tables 1, 2 and 3.  
A Street Capacity and Subbasin Boundary Exhibit can be found in Pocket A.*



# Federal Emergency Management Agency

Washington, D.C. 20472

FEB 20 2003

The Honorable Martin Chavez  
Mayor, City of Albuquerque  
P.O. Box 1293  
Albuquerque, NM 87103

## IN REPLY REFER TO:

Case Number: 02-06-2430R

Community: City of Albuquerque,  
Bernalillo County, New Mexico

Community No.: 350002

104

Dear Mayor Chavez:

This is in reference to a letter, dated August 27, 2002, from Carlos A. Montoya, Floodplain Administrator, City of Albuquerque, requesting a Conditional Letter of Map Revision (CLOMR) from the Federal Emergency Management Agency (FEMA) for the proposed La Cueva Arroyo, I-25 East to Eagle Rock Avenue and the El Camino Arroyo Diversion Storm Drain. The proposed project will be located along the North La Cueva Arroyo from I-25 to Wyoming Boulevard and along the El Camino Arroyo from I-25 to approximately 350 feet upstream of Wyoming Boulevard. The proposed project will consist of channelization of the North La Cueva Arroyo and the construction of a sediment pond and diversion pipe on the El Camino Arroyo. The area of the proposed project is shown on Flood Insurance Rate Map (FIRM) numbers 35001C0129 E, 35001C0133 E, and 35001C0141 E, each dated April 2, 2002. This project also affects flood hazard information for Bernalillo County (Unincorporated Areas).

We received the following data, prepared by James D. Hughes, P.E., of D. Mark Goodwin & Associates, P.A., in support of this request:

- an AHYMO 97 hydrologic model, dated October 2, 2002, of the 1% annual chance flood, representing the proposed conditions for the North La Cueva Arroyo and the El Camino Arroyo;
- a drainage map, titled *Existing Conditions Basin Map*, dated December 26, 2001, at a scale of 1 inch = 500 feet, in support of the hydrologic model;
- a HEC-RAS hydraulic model, dated March 29, 2002, of the 1% annual chance flood, representing the proposed conditions for the North La Cueva Arroyo;
- HEC-RAS hydraulic models, dated January 10, 2002, of the 1% annual chance flood, representing proposed conditions for the El Camino Arroyo;

- certified design plans, dated March 18, 2002, at a scale of 1 inch = 300 feet, representing the proposed channelized stream details for the North La Cueva Arroyo and the proposed sediment pond and storm drain details for the El Camino Arroyo;
- topographic work maps, dated October 4, 2002 and January 9, 2003, titled *Color Work Map (2)* and *Color Work Map*, respectively, at a scale of 1 inch = 100 feet, with a contour interval of 2 feet, representing the 1% annual chance floodplain for the proposed project conditions along the North La Cueva Arroyo and the El Camino Arroyo;
- a report, titled *C.L.O.M.R. Request for the La Cueva Arroyo, I-25 East to Eagle Rock Ave. NE and the El Camino Arroyo Diversion Storm Drain*, submitted by D. Mark Goodwin & Associates, P.A., dated January 2002;
- copies of the Bernalillo County, New Mexico and Incorporated Areas FIRM numbers 35001C0129 E, 35001C0133 E, and 35001C0141 E, annotated to reflect proposed conditions; and
- completed application/certification forms, including community concurrence with the proposed project.

We received all of the data required to perform a technical review of the CLOMR request as of January 9, 2003.

We have reviewed the submitted data and determined that the proposed project meets the minimum floodplain management criteria of the National Flood Insurance Program (NFIP). If the project is built as proposed, a revision to the FIRM for your community will be warranted. This revision will show the following effects, as shown by the data submitted to support the request:

#### 1% Annual Chance Floodplain (Zone A)

When the proposed conditions were compared to the effective conditions for the North La Cueva Arroyo, it was determined that the proposed project would cause decreases and shifting of the 1% annual chance floodplain. The maximum decrease, for the entire project area and your community, of 525 feet occurs approximately 775 feet upstream of San Pedro Drive, and the maximum shift of 325 feet occurs approximately 350 feet downstream of Louisiana Boulevard.

#### 1% Annual Chance Floodplain (Zone AO)

When the proposed conditions were compared to the effective conditions for the El Camino Arroyo, it was determined that the proposed project would eliminate the 1% annual chance floodplain from Wyoming Boulevard to approximately 550 feet downstream of Wyoming Boulevard. The 1% annual chance discharge will be contained in the storm drain and routed to the North La Cueva Arroyo. In addition, the proposed project would cause decreases and shifting of the 1% annual chance floodplain for the entire project and your community, with a maximum decrease of 1,100 feet occurring approximately 1,200 feet downstream of



Louisiana Boulevard and a maximum shift of 300 feet occurring just downstream of Louisiana Boulevard.

Future revisions to the FIRM, or restudies of the flood hazards in this area, could modify this determination.

We based this determination on the 1% annual chance discharges computed in the submitted hydrologic model for the North La Cueva Arroyo and the El Camino Arroyo. Future development of projects upstream may increase discharges, which may increase flood hazards. A comprehensive restudy of your community's flood hazards would consider the cumulative effects of development on discharges and, therefore, could establish greater flood hazards in this area.

Your community must approve all proposed floodplain development, including this proposed project, and ensure that permits required by other Federal agencies and/or State and local agencies have been obtained. State and/or community officials may set standards for construction that are more restrictive than the minimum NFIP standards or may limit development in floodplains, based on knowledge of local conditions and in the interest of safety. If the State and/or the community have adopted more restrictive or comprehensive floodplain management criteria, those criteria take precedence over the minimum NFIP requirements.

Channel modifications, sediment pond outlet structures, and diversion pipes will fail to function as designed without proper maintenance, such as the regular clearing of the channelized stream, outlet structure, and diversion pipe. To avoid such failures, we require participating communities to ensure that the flood-carrying capacity within the altered or relocated portion of any watercourse is maintained according to NFIP regulations Subparagraph 60.3(b)(7). Therefore, upon completion of the project, your community must submit documentation ensuring that the modified channel, sediment pond, and diversion pipe will be maintained to preserve their design function. We may request that your community submit a description and schedule of its channel, sediment pond, and diversion pipe maintenance, as outlined in Subparagraph 65.6(a)(12) of the NFIP regulations.

Upon completion of the proposed project, your community should request a revision to the FIRM to assure that the physical change to the flooding conditions is used for flood insurance rating and floodplain management purposes. The revision request should be submitted to our Regional Office in Denton, Texas, and include the data listed below.

1. Evidence of compliance with NFIP regulations Paragraph 65.4(b), which states that "all requests for changes to effective maps...must be made in writing by the community's Chief Executive Officer (CEO) or an official designated by the CEO."
2. As-built plans of all relevant project elements and a statement declaring that the project was built as proposed, both of which must be certified by a Professional Engineer. Please provide digital copies of the as-built plans, if available.
3. Hydrologic analysis for as-built conditions of the 1% annual chance flood for the North La Cueva Arroyo and the El Camino Arroyo.

4. Hydraulic analyses for as-built conditions of the 1% annual chance flood for the North La Cueva Arroyo and the El Camino Arroyo.
5. Certified topographic mapping, delineating the 1% annual chance floodplains for the North La Cueva Arroyo and the El Camino Arroyo, representing as-built conditions.
  - a. Please show this information on a map of suitable scale and topographic definition to provide reasonable accuracy.
  - b. Please label all items for easy cross-referencing to the hydrologic model and summary data.
6. Copies of the Bernalillo County, New Mexico and Incorporated Areas FIRM numbers 35001C0129 E, 35001C0133 E, and 35001C0141 E, annotated to reflect as-built conditions.
7. Please submit documentation of individual legal notices that were sent to property owners who are adversely impacted by any increases in and/or shifting of the 1% annual chance floodplain for the North La Cueva Arroyo and the El Camino Arroyo.
  - a. If you submit notification and acceptance from the adversely impacted property owners, FEMA can issue a Letter of Map Revision (LOMR) effective the date of issuance.
  - b. If you submit notification of, but not acceptance by, the adversely impacted property owners, FEMA may issue a LOMR effective three to six months after the date of issuance.
8. Documentation showing compliance with NFIP regulations Subparagraphs 60.3(b)(7) and 65.6(a)(12) regarding maintenance.

If the project is built as proposed in the data submitted in support of this request, you do not have to resubmit items 3 through 5 listed above; otherwise, please resubmit them.

We have enclosed a copy of our application/certification forms for your reference. The application/certification forms package may be downloaded directly from the FEMA website at [http://www.fema.gov/mit/tsd/en\\_main.htm](http://www.fema.gov/mit/tsd/en_main.htm) or copies may be obtained by contacting the FEMA Map Assistance Center, toll free, at 1-877-FEMA MAP (1-877-336-2627). Typically, we do not require all of these forms if the project is completed as proposed in the data submitted in support of this request. The enclosed document, titled *Requirements for Submitting Application/Certification Forms to Support Requests for NFIP Map Revisions*, describes in detail the circumstances under which the forms are required.

The NFIP is primarily funded by policyholders, not taxes. We recover costs associated with reviewing and processing requests for modifications to published Flood Insurance Studies and FIRMs to minimize the financial burden on the policyholders. The fee for an as-built LOMR



request in follow-up to this CLOMR is \$3,800, which we must receive before we can begin processing. This fee represents the fee schedule effective September 1, 2002. However, the fee schedule is subject to change, and the requester is required to submit the fee in effect at the time of the submission. Your payment must be a check or money order made payable to the National Flood Insurance Program and should be forwarded to:


Federal Emergency Management Agency  
Fee Charge System Administrator  
P.O. Box 3173  
Merrifield, Virginia 22216

Once we receive the processing fee and the items listed above, complete our review, and verify that the completed project meets all applicable NFIP standards, we will revise your community's FIRM to incorporate the effects of the completed project, as appropriate.

Part 65 of the enclosed NFIP regulations further describes the data needed to support a request to revise the FIRM. Your compliance with the criteria outlined in the NFIP regulations will streamline our review, allowing us to expeditiously revise your community's FIRM.

If you have any questions regarding this CLOMR, please contact the FEMA Map Assistance Center, toll free, at 1-877-FEMA MAP (1-877-336-2627).

Sincerely,

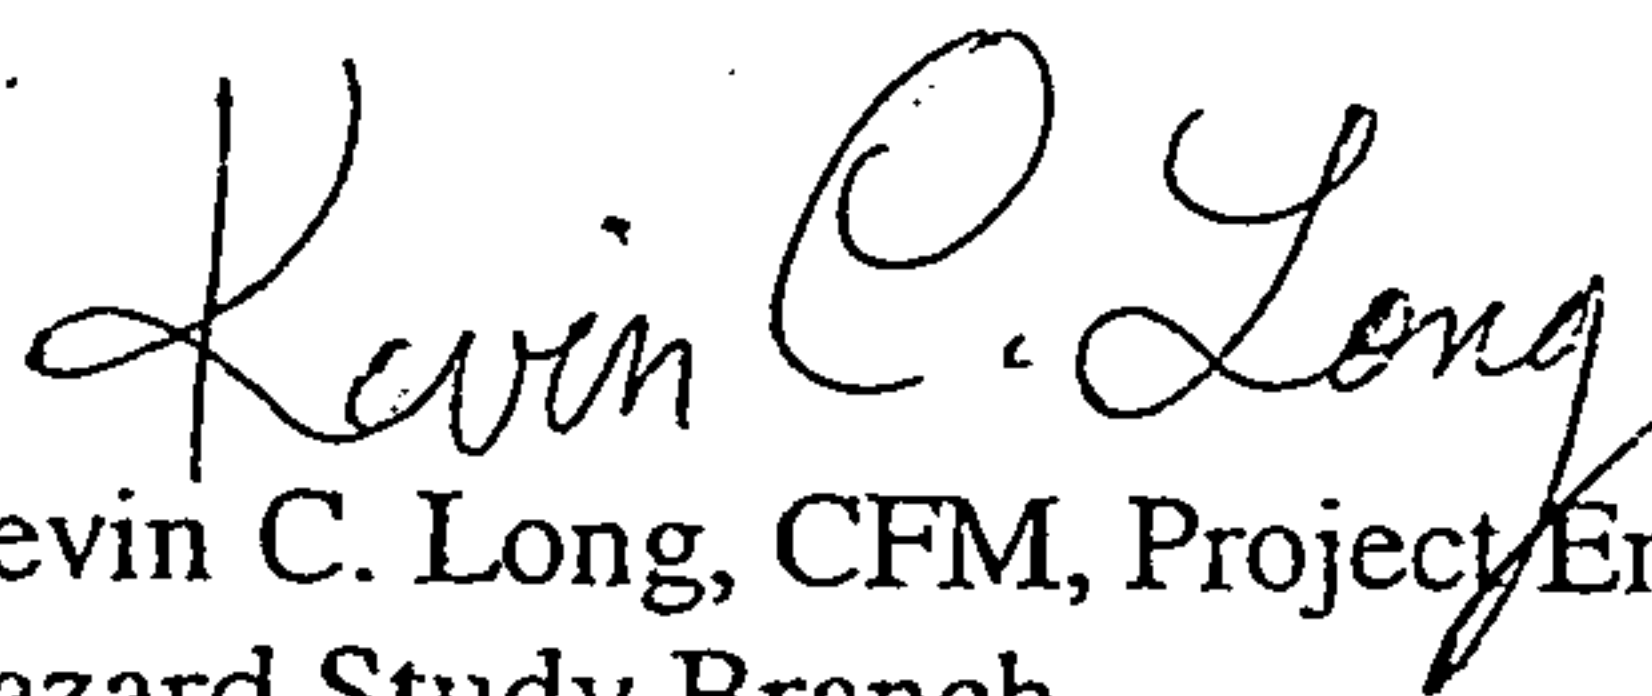

Kevin C. Long, CFM, Project Engineer  
Hazard Study Branch  
Federal Insurance and  
Mitigation Administration

For: Michael M. Grimm, Acting Chief  
Hazard Study Branch  
Federal Insurance and  
Mitigation Administration

Enclosures

cc: Tom Rutherford, County Commissioner, Bernalillo County  
Carlos A. Montoya, Floodplain Administrator, City of Albuquerque  
Susan M. Calongne, P.E., Floodplain Administrator, Bernalillo County  
James D. Hughes, P.E., D. Mark Goodwin & Associates, P.A.



# DESERT RIDGE TRAILS NORTH

## Onsite

**TABLE 2 SUMMARY OF STREET CAPACITIES**

LOCATION	CUR B	CROW N	Width ft.	Slope %	Q cfs	Depth ft.	Veloci ty fps	EG ft.
Enchanted Sky	Mtb	Yes	28' FF	4.215	14.20	0.28	4.41	0.58
Enchanted Sky	Mtb	Yes	28'FF	4.215	13.00	0.27	4.29	0.56
Bear Mountain	Mtb	Yes	28' FF	0.905	12.93	0.35	2.46	0.44
Blue Moon	Mtb	Yes	28' FF	4.295	13.00	0.27	4.32	0.56
Pawnee	Mtb	Yes	28' FF	4.114	13.00	0.27	4.25	0.55
Pecos Trail	Mtb	2%CS	28' FF	4.375	11.26	0.32	5.01	0.71
Pecos Trail	Mtb	2%CS	28'FF	4.375	6.00	0.26	4.28	0.55
Pecos Trail	Std	Yes	28'FF	4.375	11.26	0.31	4.32	0.59
Pecos Trail	Std	Yes	28'FF	3.887	11.26	0.31	4.13	0.58
Pecos Trail	Std	Yes	28'FF	3.887	22.31	0.38	4.97	0.76
Pecos Trail	Std	Yes	28'FF	2.000	46.53	0.52	5.46	0.98
Pawnee	Std	Yes	28'FF	4.114	20.00	0.37	4.85	0.73
Blue Moon	Std	Yes	28'FF	4.295	26.00	0.39	5.45	0.85
Enchanted Sky	Std	Yes	28'FF	3.337	24.22	0.39	4.91	0.77
BlueMoon Culdesac	Std	Yes	28'FF	1.375	31.66	0.49	4.16	0.76

# DESERT RIDGE TRAILS NORTH Onsite

TABLE 3 SUMMARY OF STORM SEWER INLET INTERCEPT

LOCATION	Slope %	Q cfs	Depth ft.	INLET TYPE	INLET INTERCPT	ADD Q	TOTAL Q
Pecos Trail	3.887	22.31	0.38	2 SGL 'A'	12.40	24.22	34.13
Green Mesa	2.000	34.13	0.47	2 SGL 'C'	14.40	5.42	25.15
Green Mesa	0.600	25.15	0.52	2 DBL 'A'	13.20	20.00	31.95
Green Mesa	0.600	31.95	0.57	2 DBL 'A'	16.00	-	15.95
Green Mesa	0.600	15.95	0.46	2 SGL 'C'	9.2	-	(6.75)
Blue Moon	4.295	26.00	0.39	2 SGL 'A'	13.40	2.27	(14.87)
Blue Moon Culdesac	1.375					(9.04)	
Blue Moon Culdesac	1.375	31.66	0.49	2 DBL 'A' 1 SGL 'C'		Sump Inlet	(= 30.66)

F:\Desert Ridge Trails North \ Strm\_sewer.wpd 3-10-03



D. Mark Goodwin & Associates, P.A.  
Consulting Engineers

P.O. BOX 90606, ALBUQUERQUE, NM 87199  
(505) 828-2200 FAX 797-9539  
e-mail: dmgs@swcp.com

PROJECT Desert Ridge Trails North

SUBJECT \_\_\_\_\_

BY DLH DATE 3-10-03

CHECKED \_\_\_\_\_ DATE \_\_\_\_\_

SHEET \_\_\_\_\_ OF \_\_\_\_\_

Offsite Retention Pond - Required Volume Calcs.

$$V_{10DAY} = V_{6HR} + A_D \left( \frac{4.52'' - 2.6''}{12} \right)$$

SUBBASIN

$$204.1C \quad 3.855 AF + (30.21 AC)(.45)(.16) = 6.030 AF \quad \text{subdivin}$$

$$204.1D \quad 0.194 AF + (1.13 AC)(.82)(.16) = 0.342 AF \quad \left. \begin{array}{l} \\ \\ \end{array} \right\} \text{Rd's}$$

$$204.1E \quad 0.236 AF + (1.325 AC)(.85)(.16) = 0.416 AF$$

REQ'D VOLUME 6.788 AF

DESIGN VOLUME = 7.0541 AC-FT

RUNOFF VOLUME TO RETENTION POND FOR 100YR 6HR

SUBBASIN.

$$204.1C \text{ (DEV.) } 3.855 AF - \text{subdivision}$$

$$204.1AE \text{ (EXIST) } 0.771 AF - \text{Bee Hills south}$$

$$204.1BE \text{ (EXIST) } 0.581 AF - \text{soft top}$$


$$204.4AE \text{ (EXIST) } 4.385 AF - \text{Flower}$$

$$204.1D \text{ (DEV) } 0.194 AF - \text{Bee Hill rd}$$

$$204.1E \text{ (DEV) } 0.236 AF - \text{Wyomin rd}$$

10.022 AF



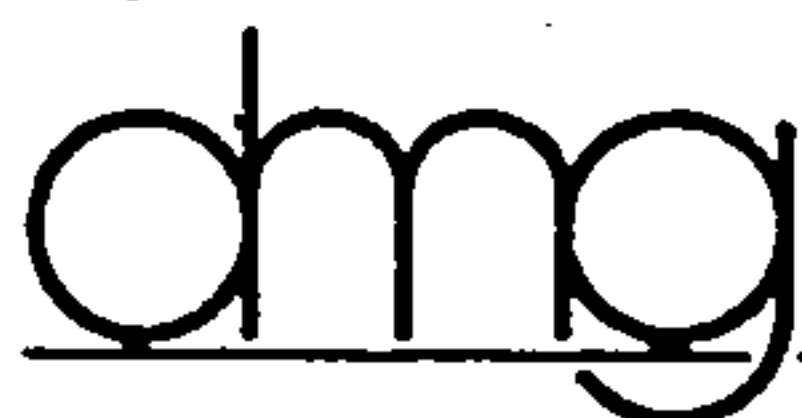

D. Mark Goodwin & Associates, P.A.  
Consulting Engineers

P.O. BOX 90606, ALBUQUERQUE, NM 87199  
(505) 828-2200 FAX 797-9539  
e-mail: dmgs@swcp.com

PROJECT Desert Ridge Trails North  
SUBJECT Offsite Retention Pond  
BY DH DATE 3-10-03  
CHECKED \_\_\_\_\_ DATE \_\_\_\_\_  
SHEET \_\_\_\_\_ OF \_\_\_\_\_

## VOLUME CALCULATIONS

ELEV. FT.	AREA SQ.FT.	VOLUME CU FT	ZVOL. CU FT	ΣVOL. AC FT
5302.	6785	0	0	0
5304	8375	15132.1	15132.1	0.3474
5306	10125	18472.3	33604.4	0.7715
5308	12035	22132.5	55736.9	1.2795
5310	14105	26112.6	81849.5	1.8790
5312	16335	30412.7	112262.2	2.5772
5314	18725	35032.8	147295.0	3.3814
5316	21275	39972.9	187267.9	4.2990
5318	23985	45232.9	232500.8	5.3375
5319	25400	49378.2	281879.0	6.4711
5320	25400	25400.0	307279.	7.0541

$$VOLUME = \frac{1}{3} D(A_1 + A_2 + \sqrt{A_1 \cdot A_2})$$

$$Q(SPILLWAY) = CLH^{3/2}$$

$$47.7 cfs = 3(45)(.5)^{1.5}$$

$$135. cfs = 3(45)(1.0)^{1.5}$$



D. Mark Goodwin & Associates, P.A.  
Consulting Engineers

P.O. BOX 90606, ALBUQUERQUE, NM 87199  
(505) 828-2200 FAX 797-9539  
e-mail: dmgs@swcp.com

PROJECT Desert Ridge Tr. North  
SUBJECT Offsite Tot Conc. Calcs.  
BY \_\_\_\_\_ DATE \_\_\_\_\_  
CHECKED \_\_\_\_\_ DATE \_\_\_\_\_  
SHEET 2 OF 2

### EXISTING CONDITIONS

	AREA (s.f.)	AREA (acres)	AREA (sq.mi.)		
204.1AE	471,287.4	10.81927	0.01691	57.03%	> .02965
204.1BE	355,193.3	8.15412	0.01274	42.97%	
204.4AE	2,681,835.2	61.56646	0.09620	51.57%	> 0.1865
204.4BE	2,518,210.6	57.81016	0.09033	48.43%	

204.1AE

$$t_c = \frac{(1870 \text{ LF})}{(2) 10 \sqrt{.0348}} = 501$$

$$+ \frac{400 \text{ LF}}{(0.7) 10 \sqrt{.0375}} + 295$$

$$796 \text{ secs} = 0.2212 \text{ hrs}$$

$$t_p = \frac{2}{3} \cdot t_c = \frac{2}{3} (.2212 \text{ hrs}) = 0.147 \text{ hrs.}$$

204.1BE

$$t_c = \frac{400 \text{ LF}}{(0.7) 10 \sqrt{.0475}} = 262$$

$$+ \frac{1100 \text{ LF}}{(2.0) 10 \sqrt{.03545}} = 292$$

$$554 \text{ secs} = 0.1539 \text{ hrs}$$


$$t_p = \frac{2}{3} (.15392) = 0.1026 \text{ hrs} \Rightarrow \text{USE } t_p = .1333 \text{ hrs}$$

204.4AE

$$K = 2.0 \quad L = 5170 \text{ LF} \quad L_{CA} = 2020 \quad K_N = 0.033$$

$$S = \frac{5374 - 5518}{4770} = 0.032$$

$$t_c = \left[ \frac{(12000 - 5170)}{72000(2) \cdot (.032)^{.5}} \right] + \frac{(5170 - 4000)(.033) \left( \frac{2020}{5170} \right)^{.33}}{[552.2 (.032)^{.165}]}$$

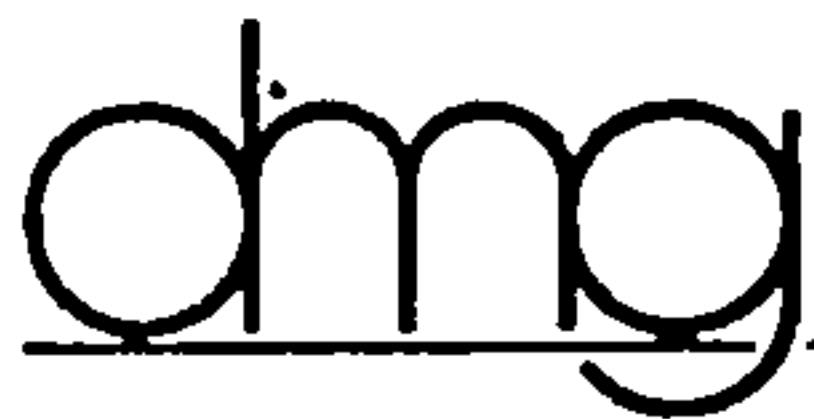

D. Mark Goodwin & Associates, P.A.  
Consulting Engineers

P.O. BOX 90606, ALBUQUERQUE, NM 87199  
(505) 828-2200 FAX 797-9539  
e-mail: dmgs@swcp.com

PROJECT Desert Ridge Trails North  
SUBJECT Offsite Time of Conc. Calcs  
BY \_\_\_\_\_ DATE \_\_\_\_\_  
CHECKED \_\_\_\_\_ DATE \_\_\_\_\_  
SHEET 1 OF 2

$$t_c = \frac{6830}{25,759.5} + \frac{28.315}{312.929} = 0.265 + 0.0905 = 0.355 \text{ hrs}$$

$$t_p = 2/3 (.35548 \text{ hrs}) = 0.237 \text{ hrs.}$$

Existing Land Treatment  
Per NAA Master Drainage  
Plan 10/28/98

A = 80  
C = 10  
D = 10





D. Mark Goodwin & Associates, P.A.  
Consulting Engineers

P.O. BOX 90606, ALBUQUERQUE, NM 87199  
(505) 828-2200 FAX 797-9539  
e-mail: dmgs@swcp.com

PROJECT Desert Ridge North  
SUBJECT Hydrology Calc's  
BY DLH DATE 10-29-02  
CHECKED \_\_\_\_\_ DATE \_\_\_\_\_  
SHEET \_\_\_\_\_ OF \_\_\_\_\_

Florence 40' FF ULTIMATE 60' R/W. SUBBASIN 3A

$$\begin{aligned}\text{Area} &= 26' \text{ wide} \times 1150' \text{ Long} = 29,900 \text{ SF} \\ 200' \text{ taper} \times 16' / 2 &= 1,600 \text{ SF} \\ \text{sdwk } 970 \times 4 &= 3,880 \text{ SF} \\ \text{pvmnt } 16' \times 1150' &= 18,400 \text{ SF}\end{aligned}$$

$$\text{Total Area} = .001130 \text{ sq. mi}$$

$$29,900 + 1,600 = 31,500 \text{ SF}$$

$$\text{L. Tr. D} = 76\% \Rightarrow \text{L. Tr. B} = 24\%$$

$$1,600 + 3,880 + 18,400 = 23,880$$

SUBBASIN 204.1A and 204.4A

Assume 1 DU/Acre 43,560 SF (264' x 165')

Impervious 2,500 SF HOUSE + DWY

Frontage Rd. 2,475 SF

4,975 SF

Use Land Tr. D = 12%

Land Tr. B/C = 44% EA.

AHYMO PROGRAM SUMMARY TABLE (AHYMO\_97) -  
INPUT FILE = DRTR\_N.DAT

- VERSION: 1997.02d

RUN DATE (MON/DAY/YR) =03/10/2003  
USER NO.= AHYMO-I-9702dGoodwinM-AH

COMMAND	HYDROGRAPH IDENTIFICATION	FROM ID NO.	TO ID NO.	AREA (SQ MI)	PEAK DISCHARGE (CFS)	RUNOFF VOLUME (AC-FT)	RUNOFF (INCHES)	TIME TO PEAK (HOURS)	CFS PER ACRE	PAGE = 1 NOTATION
START										TIME= .00
RAINFALL TYPE= 1										RAIN6= 2.550
COMPUTE NM HYD	204.1AE	-	1	.01691	22.46	.771	.85466	1.500	2.075	PER IMP= 10.00
COMPUTE NM HYD	204.1BE	-	1	.01274	18.49	.581	.85466	1.500	2.268	PER IMP= 10.00
COMPUTE NM HYD	204.4AE	-	1	.09620	92.42	4.385	.85466	1.600	1.501	PER IMP= 10.00
COMPUTE NM HYD	204.4BE	-	1	.09033	86.57	4.117	.85466	1.600	1.498	PER IMP= 10.00
COMPUTE NM HYD	204.1A	-	1	.01691	26.22	.896	.99370	1.500	2.423	PER IMP= 12.00
COMPUTE NM HYD	204.1B	-	1	.01274	21.44	.675	.99370	1.500	2.629	PER IMP= 12.00
COMPUTE NM HYD	204.1C	-	1	.04426	109.26	3.855	1.63318	1.500	3.858	PER IMP= 45.00
COMPUTE NM HYD	204.1D	-	1	.00177	5.14	.194	2.06089	1.500	4.539	PER IMP= 82.00
COMPUTE NM HYD	204.1DD	-	1	.00312	9.11	.344	2.06630	1.500	4.563	PER IMP= 80.00
COMPUTE NM HYD	204.2A	-	1	.06870	189.71	7.052	1.92474	1.500	4.315	PER IMP= 70.00
COMPUTE NM HYD	204.1E	-	1	.00207	6.21	.236	2.13768	1.500	4.689	PER IMP= 85.00
COMPUTE NM HYD	204.1EE	-	1	.00414	12.41	.472	2.13768	1.500	4.682	PER IMP= 85.00
COMPUTE NM HYD	204.1F	-	1	.06630	143.85	4.859	1.37423	1.500	3.390	PER IMP= 30.00
COMPUTE NM HYD	204.3A	-	1	.00107	3.01	.113	1.97658	1.500	4.406	PER IMP= 76.00
COMPUTE NM HYD	204.3B	-	1	.02813	68.38	2.395	1.59606	1.500	3.798	PER IMP= 42.00
COMPUTE NM HYD	204.3C	-	1	.02188	53.19	1.862	1.59606	1.500	3.799	PER IMP= 42.00
COMPUTE NM HYD	204.4A	-	1	.05460	91.82	2.894	.99370	1.500	2.628	PER IMP= 12.00
COMPUTE NM HYD	204.10	-	1	.12880	237.45	9.440	1.37423	1.550	2.881	PER IMP= 30.00
COMPUTE NM HYD	204.20	-	1	.06870	189.71	7.052	1.92474	1.500	4.315	PER IMP= 70.00
COMPUTE NM HYD	204.30	-	1	.08700	211.86	7.453	1.60624	1.500	3.805	PER IMP= 45.00
COMPUTE NM HYD	204.40	-	1	.05460	111.98	3.683	1.26487	1.500	3.204	PER IMP= 22.00
FINISH										

Hydrology for Summary Tables 4,5,7

## **APPENDIX C - STORM SEWER**

*Sump Inlet calcs.*

*Storm Sewer Analysis Wyoming / Beverly Hills*

*Storm Sewer Analysis Desert Ridge Trails North Onsite*

*Storm Sewer Analysis Desert Ridge Trails 'Florence Avenue' Diversion*

**CALCULATIONS FOR INLETS AT SUMP**  
**for**  
**Desert Ridge Trails North**  
**Blue Moon culdesac**

Capacity is measured by the weir equation at the lip of the gutter assuming an allowable ponding elevation equal to the lowest adjacent right of way elevation. The length of the double grate facing the street is 6.5' and the maximum depth is 0.725' at the lip of the gutter. The sides are each 2' long and the average depth is 0.892'. These depths assume an 8" curb with right of way 9' behind the curb for an additional depth of 0.18' above the top of curb. From the weir equation:

**BLUE MOON CULDESAC**

**FOR SINGLE 'C' INLET**

Front Q cap =  $(3.0) \times (3.0') \times (0.725) **1.5 = 5.56 \text{ cfs}$

Sides Q cap =  $(3.0) \times (4.0') \times (0.892) **1.5 = 10.11 \text{ cfs}$

Total Q cap =  $5.56 \text{ cfs} + 10.11 \text{ cfs} = 15.67 \text{ cfs}$

**FOR DOUBLE 'C' INLET**

Front Q cap =  $(3.0) \times (6.5') \times (0.725) **1.5 = 12.04 \text{ cfs}$

Sides Q cap =  $(3.0) \times (4.0') \times (0.892) **1.5 = 10.11 \text{ cfs}$

Total Q cap =  $12.04 \text{ cfs} + 10.11 \text{ cfs} = 22.15 \text{ cfs}$

**FOR TRIPLE 'C' INLET**

Front Q cap =  $(3.0) \times (9.75') \times (0.725) **1.5 = 18.06 \text{ cfs}$


Sides Q cap =  $(3.0) \times (4.0') \times (0.892) **1.5 = 10.11 \text{ cfs}$

Total Q cap =  $12.04 \text{ cfs} + 10.11 \text{ cfs} = 22.15 \text{ cfs}$

**Sump inlets are typically designed to intercept 2 times the 100 year flow rate. The 100 year peak discharge to the sump inlets in Blue Moon is 30.66 cfs. In this scenario two double 'A' sump inlets and one single 'C' sump inlet will intercept up to 59.97 cfs which is 1.96 times the 100 year peak discharge.**



# CITY OF ALBUQUERQUE

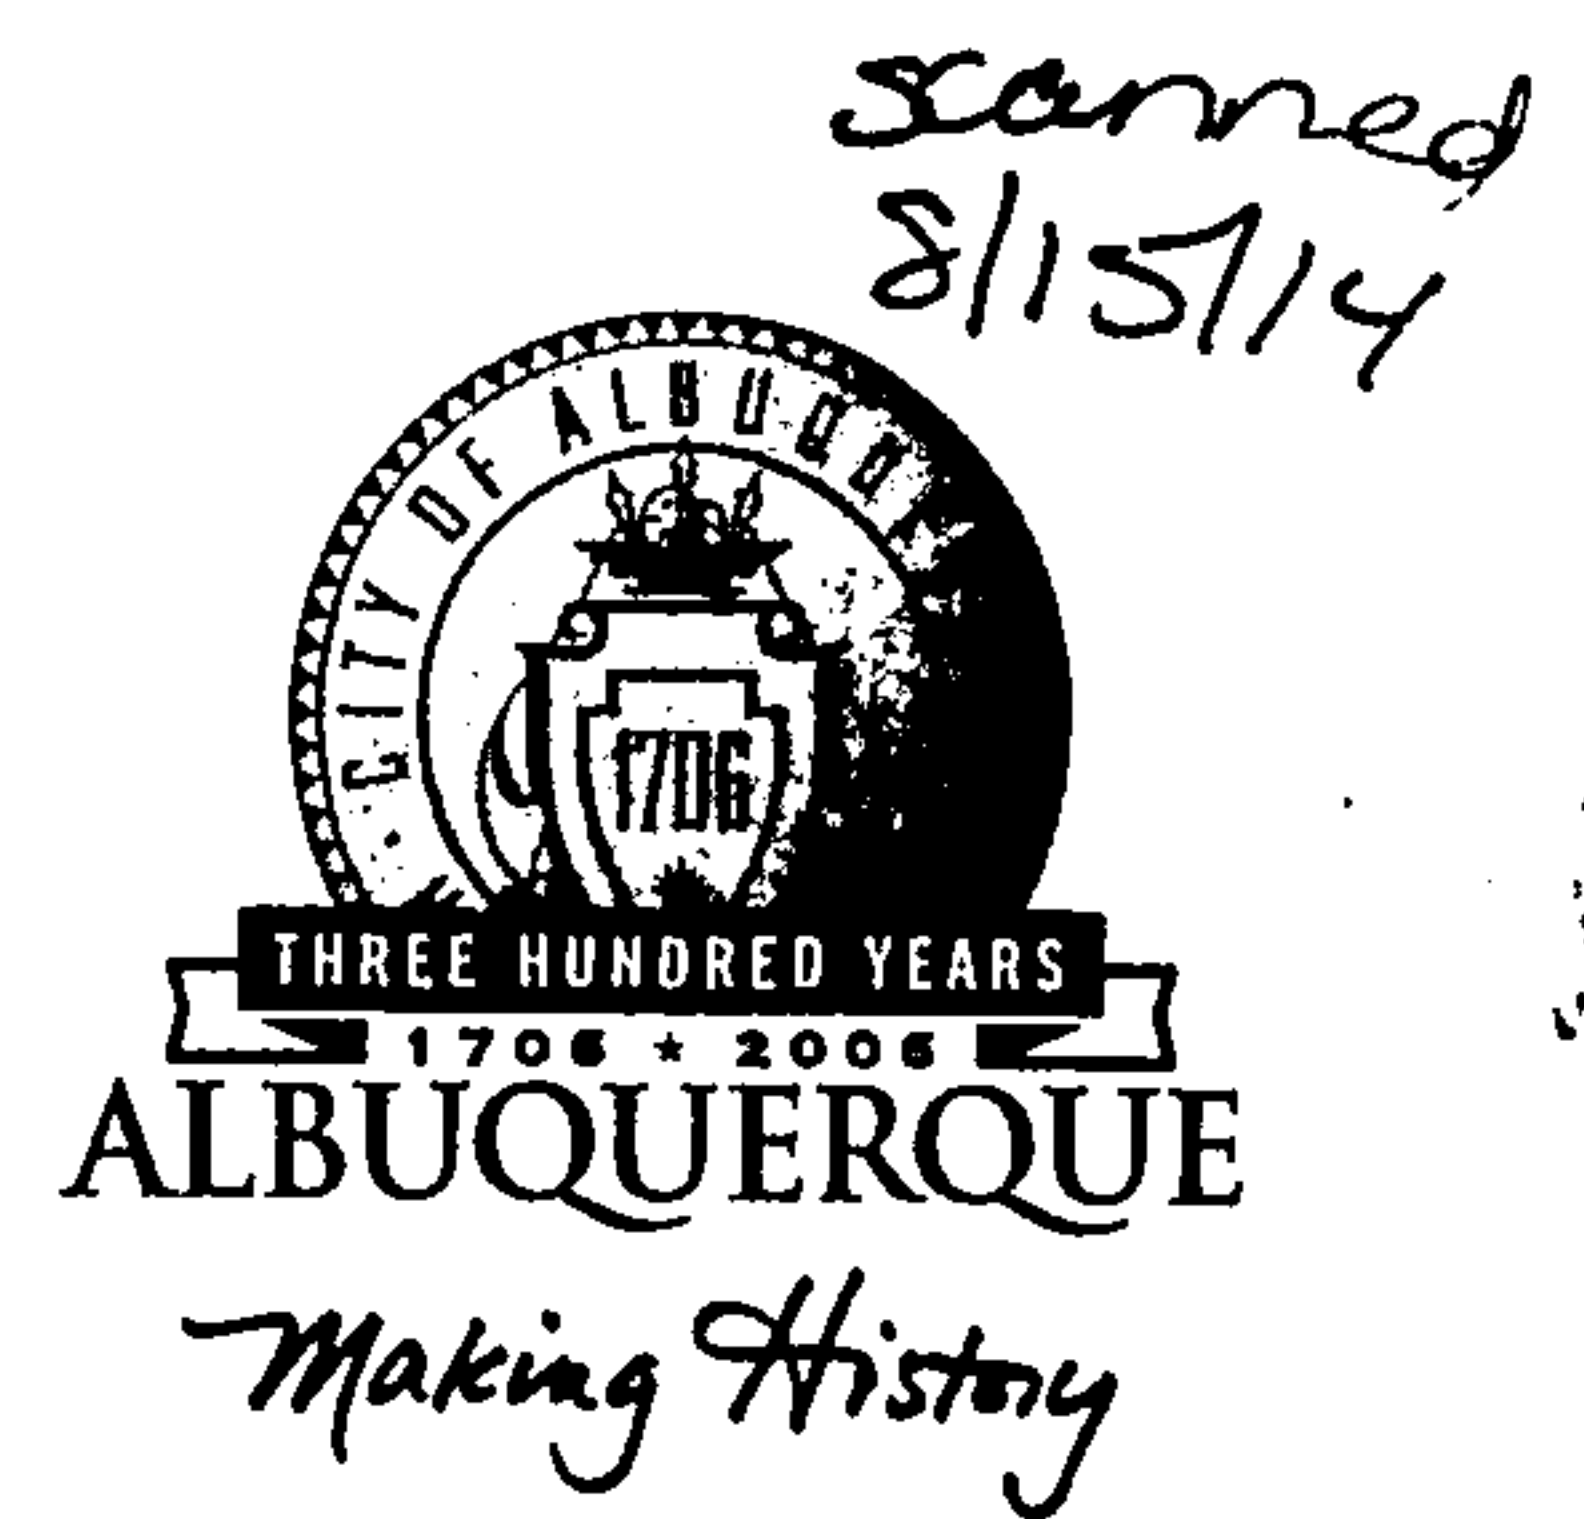

May 6, 2005

Ms. Diane Hoelzer, PE  
**MARK GOODWIN & ASSOCIATES**  
P.O. Box 90606  
Albuquerque, NM 87119

**RE: DESERT RIDGE TRAILS NORTH (B-19/D21)**  
**Engineers Certification for Release of Financial Guaranty**  
**Engineers Stamp dated 08/05/2003**  
**Engineers Certification dated 05/06/2005**

Dear Diane:

P.O. Box 1293  
Albuquerque  
New Mexico 87103  
www.cabq.gov

Based upon the information provided in your Engineer's Certification Submittal dated 05/06/2005, the above referenced plan is adequate to satisfy the Grading and Drainage Certification for Release of Financial Guaranty.

If you have any questions, you can contact me at 924-3982.

Sincerely,

*Arlene V. Portillo*

Arlene V. Portillo  
Plan Checker, Planning Dept.- Hydrology  
Development and Building Services

C: Marilyn Maldonado, COA# 675483  
File