

# CITY OF ALBUQUERQUE



Timothy M. Keller, Mayor

March 9, 2018

Glenn Broughton, P.E.  
Bohannon Huston, Inc.  
7500 Jefferson St NE  
Albuquerque, NM 87109

**RE: Smiles for Kids Dental Office – Site Expansion**  
**Conceptual Grading and Drainage Plan**  
**Stamp Date: 03/07/18**  
**Hydrology File: C12D056**

Dear Mr. Broughton:

PO Box 1293  
Albuquerque  
NM 87103  
www.cabq.gov

Based upon the information provided in your resubmittal received 03/07/2018, the Conceptual Grading and Drainage Plan is approved for action by the DRB on the Site Plan for Building Permit.

As a reminder, prior to obtaining Building Permit approval, please provide a written agreement from Tract F property Owner stating that grading can be conducted on their property for the benefit of Tract H. Also please provide a Private Facility Drainage Covenant for the on-site first flush ponds on Tract H, an Agreement and Covenant for the detention pond on Tract F and a Drainage Covenant for the private storm drain and drainage swales on Tract F. I have attached word documents of these for your use. After the drainage easement is recorded, please place a note stating the recording information on the Grading Plan.

If you have any questions, please contact me at 924-3995 or [rbrissette@cabq.gov](mailto:rbrissette@cabq.gov).

Sincerely,

*Renée C. Brissette*

Renée C. Brissette, P.E. CFM  
Senior Engineer, Hydrology  
Planning Department



# City of Albuquerque

Planning Department

Development & Building Services Division

## DRAINAGE AND TRANSPORTATION INFORMATION SHEET (REV 09/2015)

**Project Title:** \_\_\_\_\_ **Building Permit #:** \_\_\_\_\_ **City Drainage #:** \_\_\_\_\_

**DRB#:** \_\_\_\_\_ **EPC#:** \_\_\_\_\_ **Work Order#:** \_\_\_\_\_

**Legal Description:** \_\_\_\_\_

**City Address:** \_\_\_\_\_

**Engineering Firm:** \_\_\_\_\_ **Contact:** \_\_\_\_\_

**Address:** \_\_\_\_\_

**Phone#:** \_\_\_\_\_ **Fax#:** \_\_\_\_\_ **E-mail:** \_\_\_\_\_

**Owner:** \_\_\_\_\_ **Contact:** \_\_\_\_\_

**Address:** \_\_\_\_\_

**Phone#:** \_\_\_\_\_ **Fax#:** \_\_\_\_\_ **E-mail:** \_\_\_\_\_

**Architect:** \_\_\_\_\_ **Contact:** \_\_\_\_\_

**Address:** \_\_\_\_\_

**Phone#:** \_\_\_\_\_ **Fax#:** \_\_\_\_\_ **E-mail:** \_\_\_\_\_

**Other Contact:** \_\_\_\_\_ **Contact:** \_\_\_\_\_

**Address:** \_\_\_\_\_

**Phone#:** \_\_\_\_\_ **Fax#:** \_\_\_\_\_ **E-mail:** \_\_\_\_\_

Check all that Apply:

**DEPARTMENT:**

- ☐ HYDROLOGY/ DRAINAGE  
☐ TRAFFIC/ TRANSPORTATION  
☐ MS4/ EROSION & SEDIMENT CONTROL

**TYPE OF SUBMITTAL:**

- ☐ ENGINEER/ ARCHITECT CERTIFICATION
- ☐ CONCEPTUAL G & D PLAN  
☐ GRADING PLAN  
☐ DRAINAGE MASTER PLAN  
☐ DRAINAGE REPORT  
☐ CLOMR/LOMR
- ☐ TRAFFIC CIRCULATION LAYOUT (TCL)  
☐ TRAFFIC IMPACT STUDY (TIS)  
☐ EROSION & SEDIMENT CONTROL PLAN (ESC)
- ☐ OTHER (SPECIFY) \_\_\_\_\_

**CHECK TYPE OF APPROVAL/ACCEPTANCE SOUGHT:**



- ☐ BUILDING PERMIT APPROVAL  
☐ CERTIFICATE OF OCCUPANCY
- ☐ PRELIMINARY PLAT APPROVAL  
☐ SITE PLAN FOR SUB'D APPROVAL  
☐ SITE PLAN FOR BLDG. PERMIT APPROVAL  
☐ FINAL PLAT APPROVAL  
☐ SIA/ RELEASE OF FINANCIAL GUARANTEE  
☐ FOUNDATION PERMIT APPROVAL  
☐ GRADING PERMIT APPROVAL  
☐ SO-19 APPROVAL  
☐ PAVING PERMIT APPROVAL  
☐ GRADING/ PAD CERTIFICATION  
☐ WORK ORDER APPROVAL  
☐ CLOMR/LOMR
- ☐ PRE-DESIGN MEETING  
☐ OTHER (SPECIFY) \_\_\_\_\_

IS THIS A RESUBMITTAL?: ☐ Yes ☐ No

**DATE SUBMITTED:** \_\_\_\_\_ **By:** \_\_\_\_\_

COA STAFF: \_\_\_\_\_ ELECTRONIC SUBMITTAL RECEIVED: \_\_\_\_\_



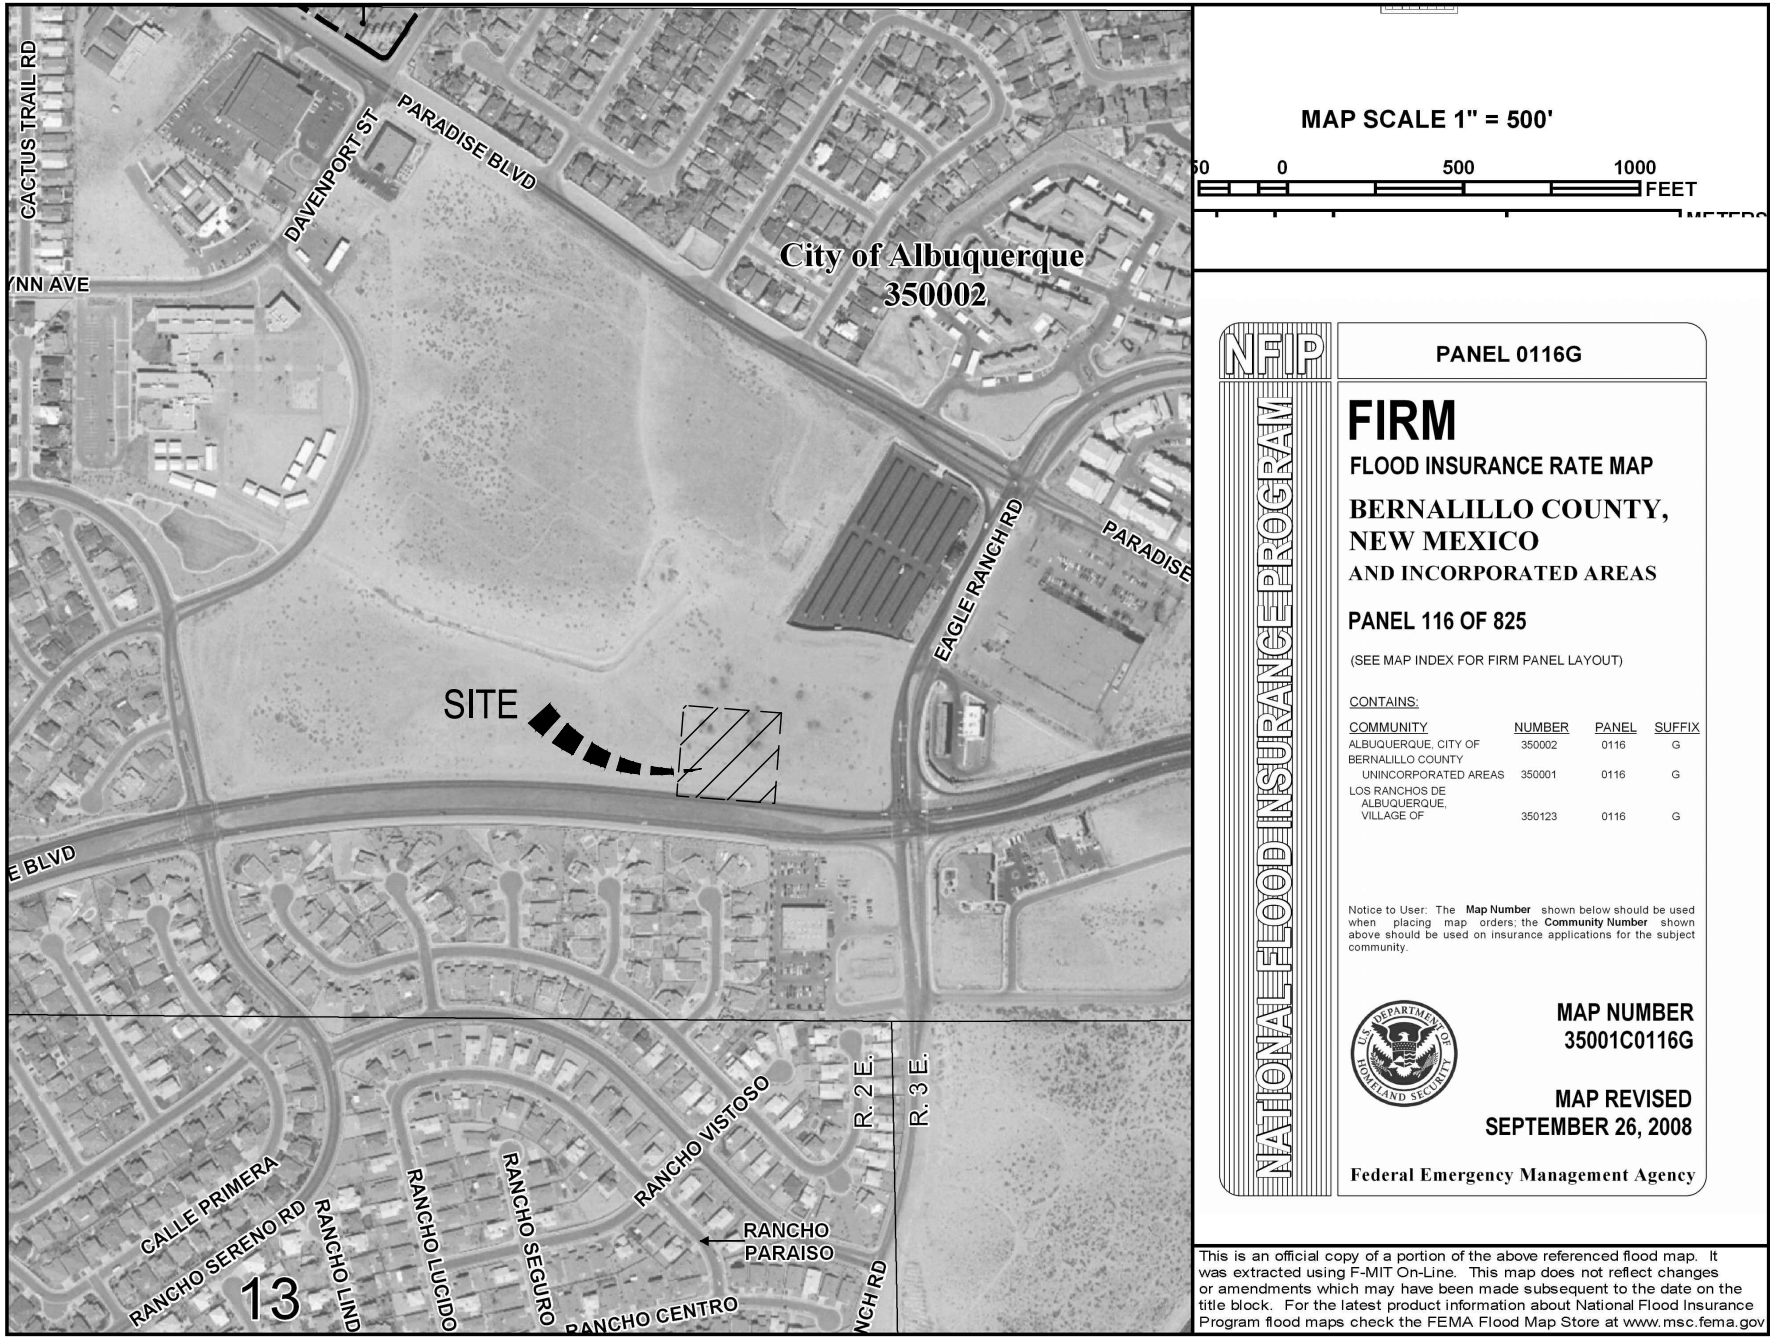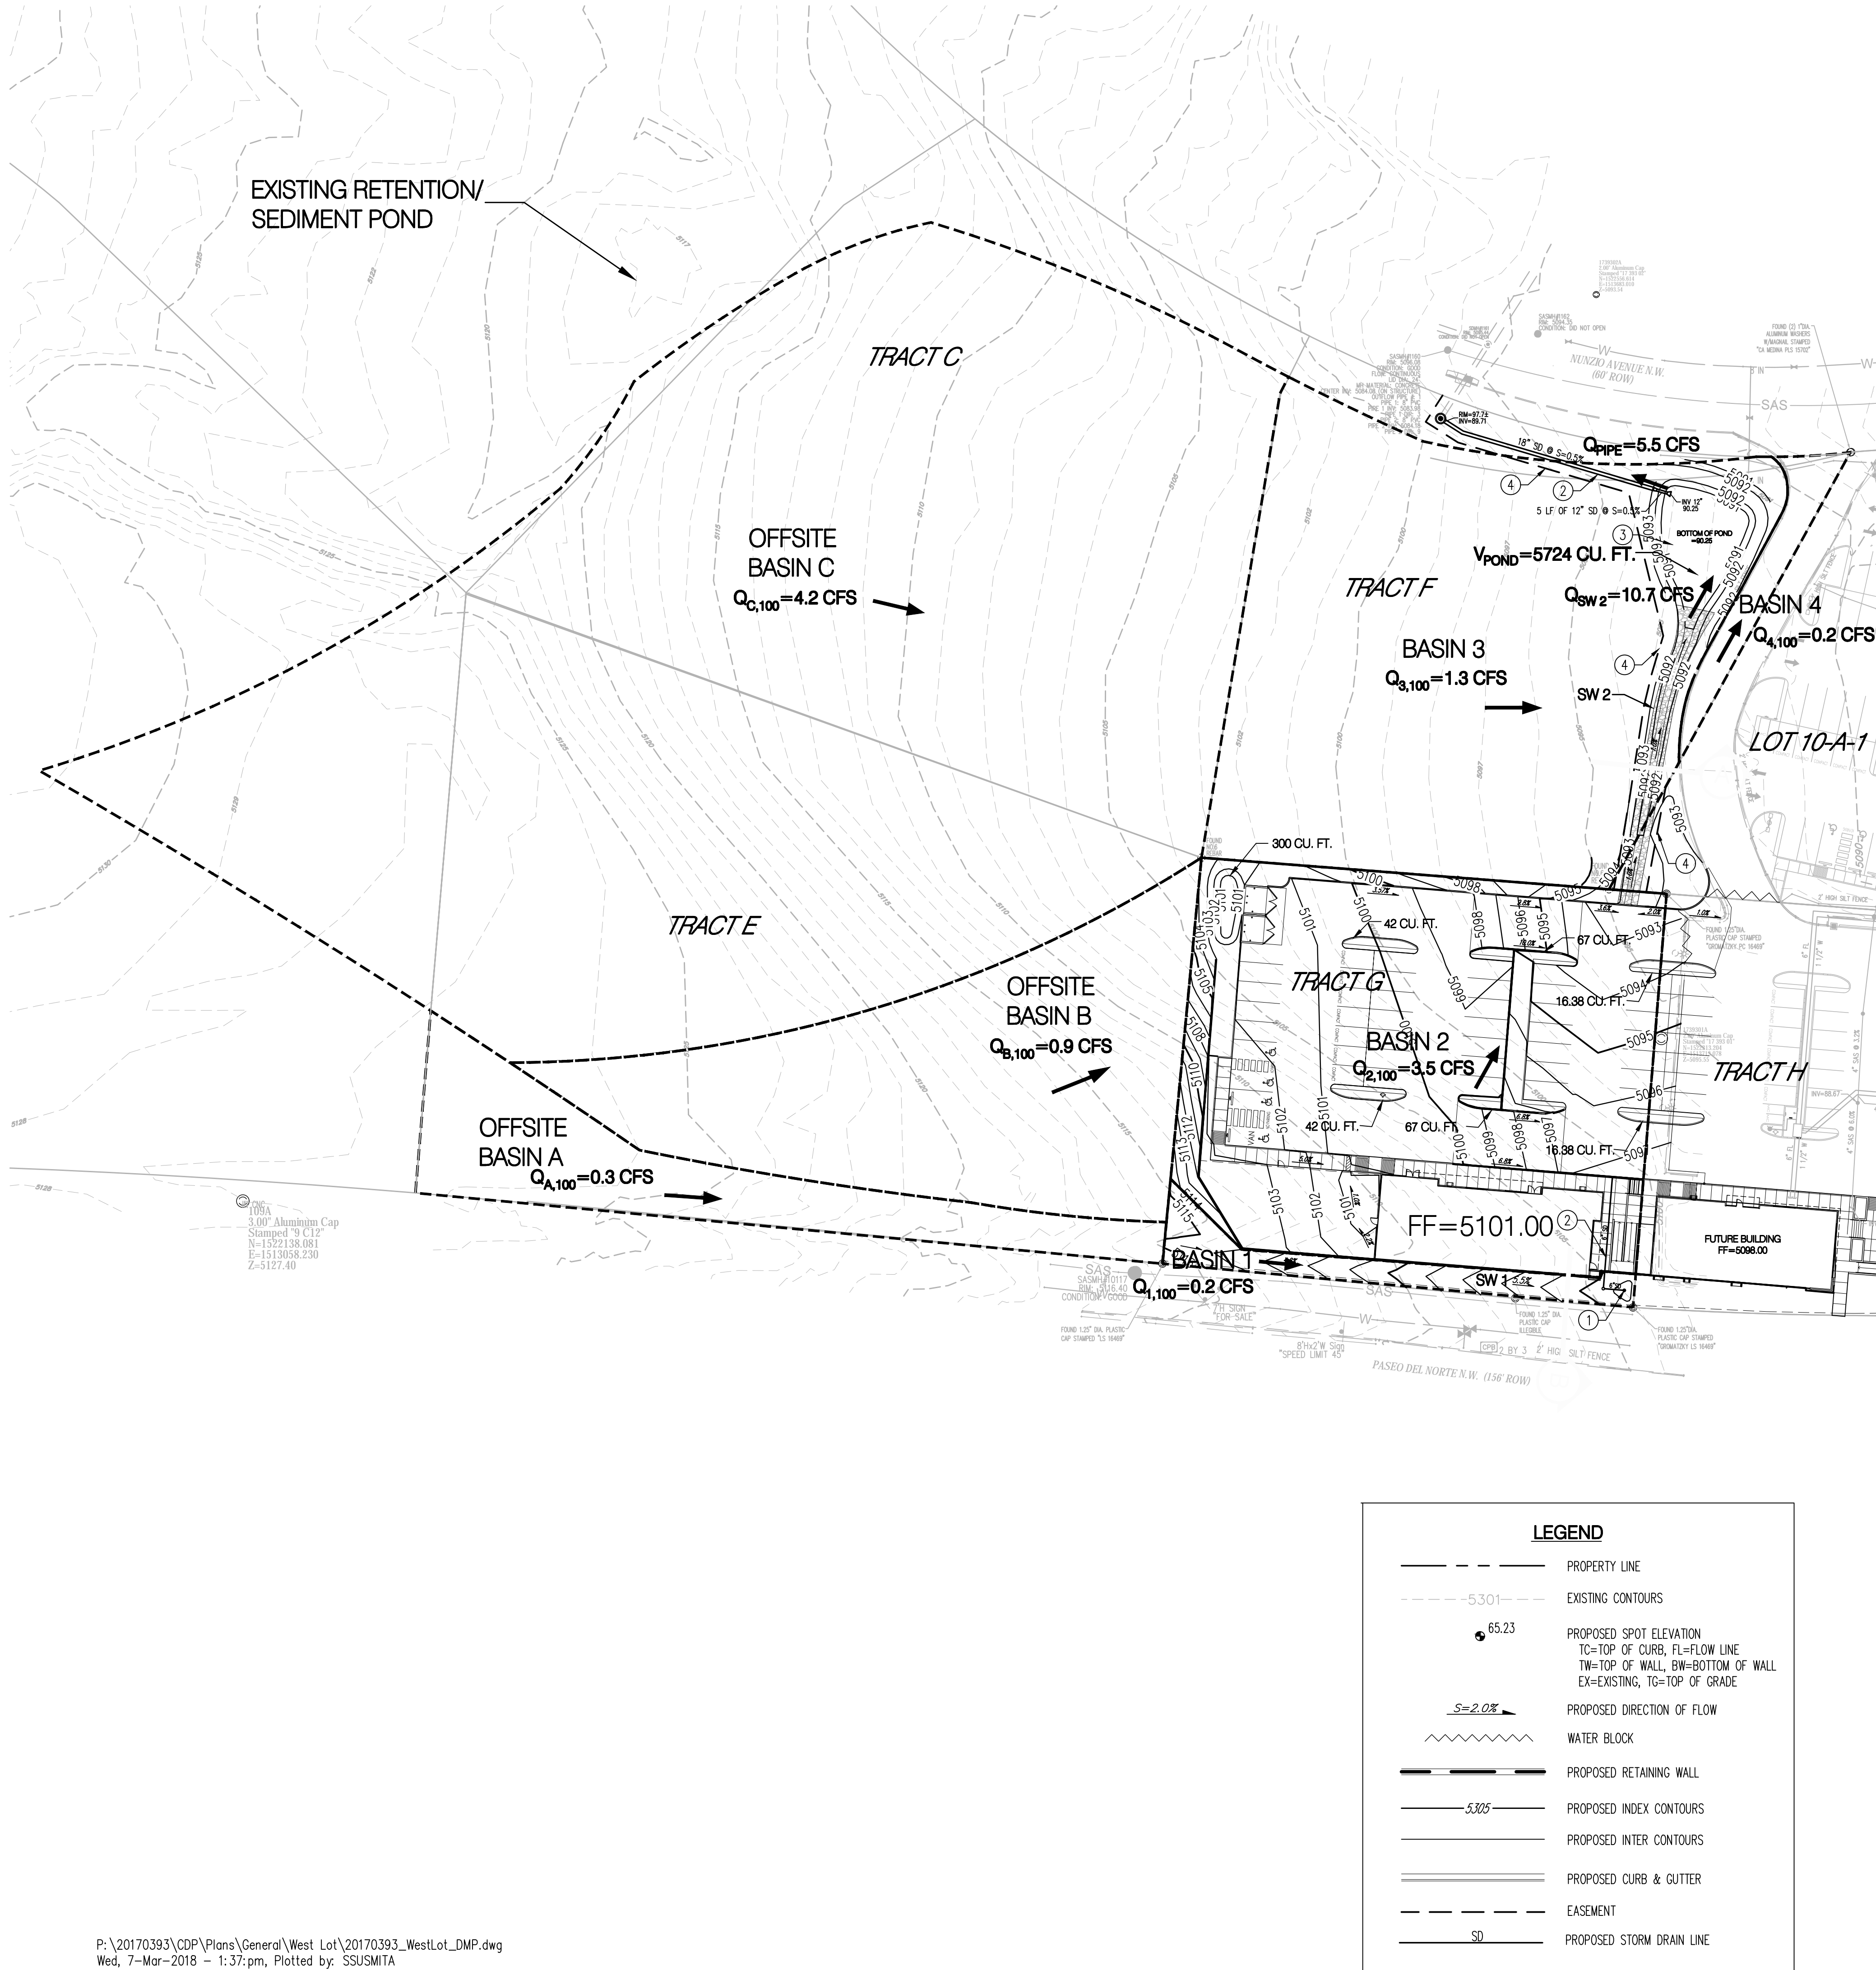

FEMA FIRM MAP # 35001C0116G

LEGAL DESCRIPTION: TRACT G OF FOUNTAIN HILLS PLAZA.

INTRODUCTION:

THE PROJECT IS LOCATED ON TRACT G OF FOUNTAIN HILLS PLAZA WHICH IS NEAR THE NORTHWEST CORNER OF PASEO DEL NORTE AND EAGLE RANCH RD. THE PURPOSE OF THIS SUBMITTAL IS TO PROVIDE A DRAINAGE MANAGEMENT PLAN FOR THE DEVELOPMENT OF SMILES FOR KIDS DENTIST OFFICE SITE EXPANSION AND REQUEST SITE DEVELOPMENT PLAN FOR BUILDING PERMIT APPROVAL.

EXISTING CONDITIONS:

TRACT G OF FOUNTAIN HILLS PLAZA IS A 0.95 ACRE SITE THAT IS CURRENTLY UNDEVELOPED. THE SITE SLOPES TO THE NORTH / NORTHEAST WHERE THE RUNOFF FREE DISCHARGES ONTO TRACT F AND LOT 10-A-1 OF ALBUQUERQUE WEST UNIT 1 AND ULTIMATELY INTO EAGLE RANCH RD AND NUNZIO AVE. THIS SITE IS NOT WITHIN A DEFINED FLOOD ZONE AS SHOWN ON FIRM MAP NUMBER 35001C0116G (THIS SHEET).

BASED ON THE DRAINAGE STUDY FOR FOUNTAIN HILLS (CITY OF ALBUQUERQUE DRAINAGE FILE C12/D3B), BASIN C-1-B1 IS 1.84 ACRES WITH A PEAK DISCHARGE OF 7.21 CFS. THE EQUATES TO AN ALLOWABLE PEAK DISCHARGE FROM THE SITE OF APPROXIMATELY 3.7 CFS.

THE APPROVED DRAINAGE MANAGEMENT PLAN SPECIFIES THAT BASIN C-1-B1 DRAIN NORTH TO NUNZIO. 80% OF THE DEVELOPED FLOWS WILL BE DIVERTED DIRECTLY TO THE STORM DRAIN SYSTEM AND THE REMAINING 20% CAN DISCHARGE TO THE PUBLIC RIGHT OF WAY AND WILL BE INTERCEPTED BY STORM DRAIN INLETS.

METHODOLOGY:

THE HYDROLOGIC ANALYSIS PROVIDED WITH THIS DRAINAGE MANAGEMENT PLAN HAS BEEN PREPARED IN ACCORDANCE WITH SECTION 22.2 OF THE DPM. THE SITE IS LOCATED WEST OF THE RIO GRANDE WITHIN PRECIPITATION ZONE 1. LAND TREATMENT PERCENTAGES WERE CALCULATED BASED ON THE ACTUAL CONDITIONS IN EACH ONSITE BASIN AND ARE SUMMARIZED IN THE "PROPOSED BASIN DATA TABLE".

OFFSITE DRAINAGE WEST OF THE SITE CURRENTLY DRAINS ONTO TRACT G. IN THE INTERIM CONDITION THE OFFSITE DRAINAGE WILL BE CONVEYED THROUGH TRACT G. WITH THE DEVELOPMENT OF UPSTREAM TRACTS, THIS DRAINAGE WILL BE DIVERTED TO THE PUBLIC STORM DRAIN SYSTEM.

PROPOSED CONDITIONS:

THIS DRAINAGE MANAGEMENT PLAN WAS DEVELOPED BASED ON A FULLY DEVELOPED SITE. IT WAS DETERMINED THAT THE MAXIMUM ALLOWABLE PEAK DISCHARGE FROM THE SITE IS 3.7 CFS (AS MENTIONED ABOVE). THIS DMP INCLUDES ANALYSIS OF UNDEVELOPED OFFSITE DRAINAGE FROM BASIN C-A-1 AS SHOWN ON THE FOUNTAIN HILLS PLAZA DMP AS WELL AS RUNOFF FROM TRACT F.

IN ORDER TO CONVEY DRAINAGE FROM TRACT G TO THE PUBLIC STORM DRAIN SYSTEM, A DRAINAGE SWALE ON THE EAST SIDE OF TRACT F IS PROPOSED. THIS DRAINAGE SWALE WILL ALSO INTERCEPT RUNOFF FROM TRACT F AND THE OFFSITE DRAINAGE BASINS. A NEW STORM DRAIN WILL BE EXTENDED EAST FROM THE EXISTING STUBOUT INSTALLED WITH THE FOUNTAIN HILLS PUBLIC STORM DRAIN IMPROVEMENTS. THE FOUNTAIN HILLS DMP SPECIFIED A FLOW RATE OF 5.77 CFS AT THE EXISTING STUBOUT. THE PEAK FLOW FROM TRACTS F, G AND THE OFFSITE BASINS IS 10.7 CFS. A TEMPORARY DETENTION POND WITH A 12" DIAMETER ORIFICE OUTLET PIPE IS PROPOSED TO REDUCE THE PEAK FLOW TO A RATE THAT APPROXIMATELY EQUAL ALLOWABLE PEAK FLOW AT THE EXISTING STORM DRAIN STUBOUT. BASED ON THE DETENTION POND OUTLET FLOW RATE OF 5.53 CFS, THE REQUIRED DETENTION VOLUME IS 3,807 CUBIC FEET. THE VOLUME PROVIDED IS 5,724 CUBIC FEET, SEE DMP FOR PEAK FLOW RATE, STORM DRAIN PIPE, DRAINAGE SWALE AND DETENTION POND CALCULATIONS.

A SMALL DRAINAGE SWALE IS PROPOSED ALONG THE SOUTHERN PROPERTY LINE TO CONVEY A SMALL OFFSITE DRAINAGE BASIN AND THE AREA SOUTH OF THE BUILDING. AN INLET AND 6" STORM DRAIN WILL INTERCEPT THIS RUNOFF AND DRAIN INTO THE PARKING LOT OF TRACT G. SEE DMP CALCULATIONS FOR DRAINAGE SWALE CAPACITY CALCULATIONS.


RETENTION AREAS WITHIN TRACT G WILL BE INCORPORATED INTO THE LANDSCAPE AREAS WHERE POSSIBLE. THE FIRST FLUSH CALCULATIONS FOR THE OVERALL DEVELOPMENT AREA ARE SHOWN ON THE DRAINAGE BASIN CALCULATIONS. DUE TO THE STEEP SITE AND LIMITED OPPORTUNITIES FOR SURFACE PONDING THE ENTIRE FIRST FLUSH RETENTION VOLUME COULD NOT BE ACHIEVED WITH SURFACE PONDING. A TOTAL VOLUME OF 551 CUBIC FEET HAS BEEN PROVIDED. THIS IS APPROXIMATELY 61% OF THE TOTAL REQUIRED VOLUME.

CONCLUSION:

THE PEAK DISCHARGE FROM THE SITE IS 3.7 CFS WHICH IS EQUAL TO THE ALLOWABLE PEAK DISCHARGE RATE. IN ADDITION, OFFSITE FLOWS WILL DRAIN TO A TEMPORARY DETENTION POND LOCATED AT THE NORTHEAST CORNER OF TRACT F. THIS DETENTION POND WILL REDUCE THE PEAK FLOW TO THE PUBLIC STORM DRAIN SYSTEM WHICH IS IN COMPLIANCE WITH THE FOUNTAIN HILLS DMP. THEREFORE, WE ARE IN CONFORMANCE WITH CITY OF ALBUQUERQUE HYDROLOGY REQUIREMENTS AND REQUEST SITE DEVELOPMENT PLAN FOR BUILDING PERMIT APPROVAL.

KEYED NOTES

1. STORM DRAIN INLET.
2. STORM DRAIN PIPE. SEE PLAN FOR SIZE & SLOPE.
3. DETENTION POND.
4. PROPOSED PRIVATE DRAINAGE EASEMENT.

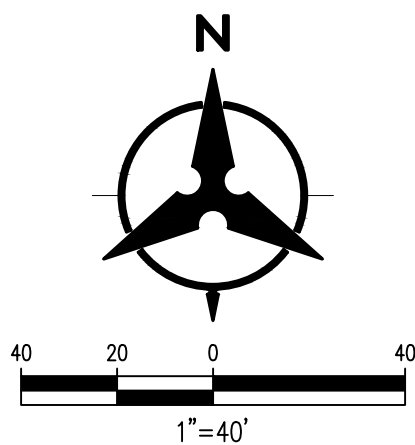



Smiles for Kids Dental Office - Site Expansion								
STORM DRAIN PIPE TABLE								
PIPE #	Contributing Basins & Pipes	Size in.	Slope	Capacity cfs	ACTUAL FLOW cfs	PIPE LENGTH ft	INVERT IN	INVERT OUT
<b>STORM DRAIN PIPE</b>								
P1	BASIN 2 - BASIN 4 & BASIN B -BASIN C	18	0.50%	7.4	5.5	98.6	5090.28	5089.71
CAPACITY IS BASED ON GRAVITY FLOW, USING MANNING'S EQUATION WITH n=0.013								

Orifice Analysis		
Orifice Coef		0.62
Orifice Diam (inches)		12
Outflow (cfs)	Head (ft)	
0.01	1.00	
4.37	1.25	
4.79	1.50	
5.17	1.75	
5.53	2.00	
5.86	2.25	
6.18	2.50	
6.48	2.75	
6.77	3.00	
7.04	3.25	
7.31	3.50	
7.57	3.75	
7.82	4.00	
8.06	4.25	
8.29	4.50	
8.52	4.75	
8.74	5.00	
8.95	5.25	
9.16	5.50	
9.37	5.75	
9.57	6.00	
9.77	6.25	



A cross-section diagram of a drainage ditch. The ditch has a bottom width of 6'-0" and a depth of 6". The side slopes are 12:1. The ditch is lined with a non-woven geotextile filter fabric. A layer of 2" to 6" crushed stone is placed over the filter fabric. The ditch is adjacent to a curb and gutter, which is paved with asphalt pavement.

Labels in the diagram include:

- 12:1 (slope ratio)
- 6'-0" (bottom width)
- 6" (depth)
- 12:1 (slope ratio)
- 12" (height of stone layer)
- NON-WOVEN GEOTEXTILE FILTER FABRIC
- 2" TO 6" CRUSHED STONE PLACED OVER NON-WOVEN FILTER FABRIC
- CURB & GUTTER
- ASPHALT PAVEMENT

CAPACITY CALCULATION OF THE DRAINAGE SWALE SW 1										
MANNING'S N = 0.035					SLOPE = 5.5%					
POINT	DIST	ELEV								
	1	0	0.5							
	2	6	0							
	3	12	0.5							
WSFL (FT)	DEPTH (FT)	FLOW AREA (SQ.FT)	FLOW RATE (CFS)	WETTED PER (FT)	FLOW VEL (FPS)	TOP WIDTH (FT)	TOTAL ENERGY (FT)			
0.05	0.05	0.03	0.025	1.204	0.849	1.2	0.061			
0.1	0.1	0.12	0.162	2.408	1.348	2.4	0.128			
0.15	0.15	0.27	0.427	3.612	1.767	3.6	0.193			
0.2	0.2	0.48	0.72	4.817	2.14	4.8	0.271			
0.25	0.25	0.75	1.065	6.021	2.484	6	0.346			
0.3	0.3	1.08	3.022	7.225	2.805	7.2	0.422			
0.35	0.35	1.47	4.569	8.429	3.108	8.4	0.5			
0.4	0.4	1.92	6.523	9.633	3.397	9.6	0.58			
0.45	0.45	2.43	8.93	10.837	3.675	10.8	0.66			
0.5	0.5	3	11.827	12.042	3.942	12	0.742			



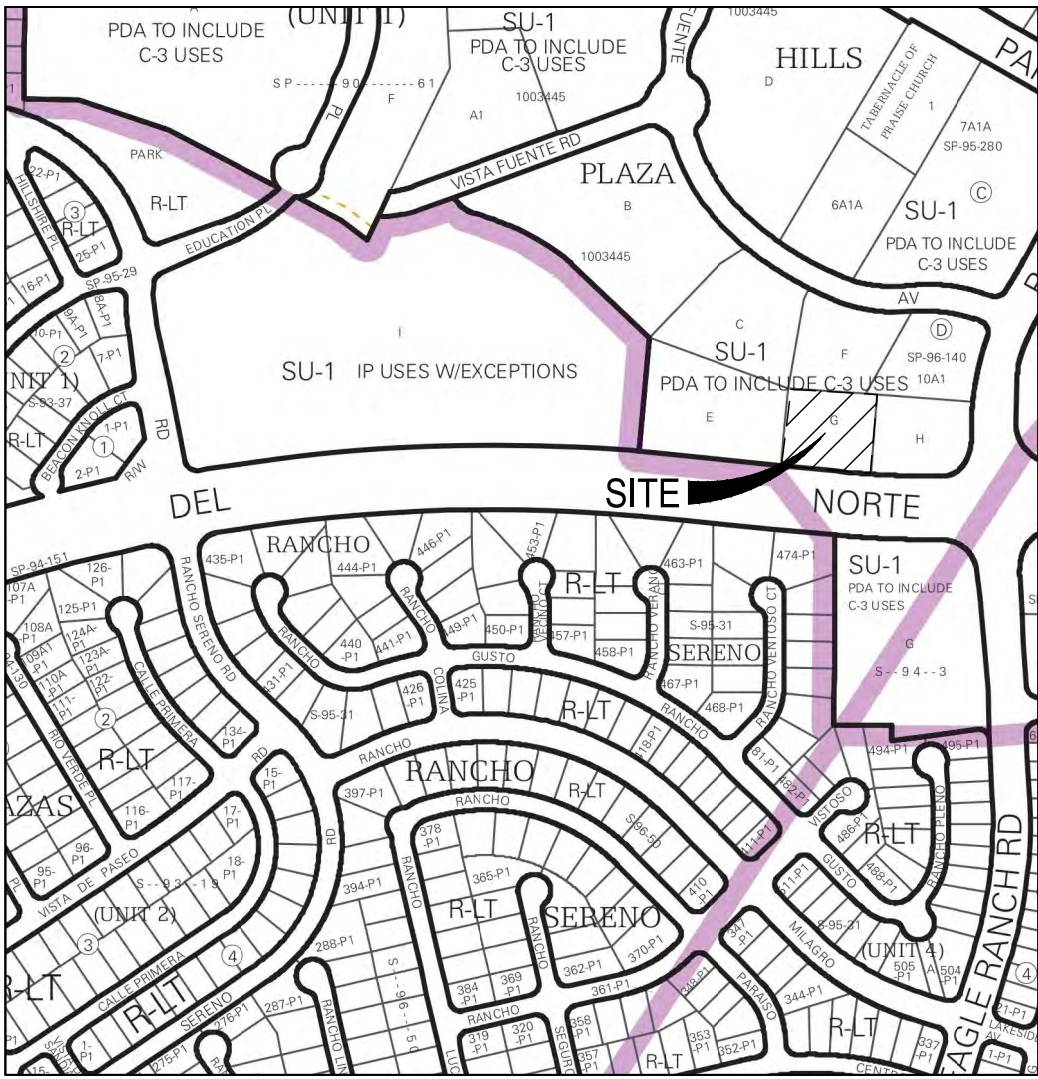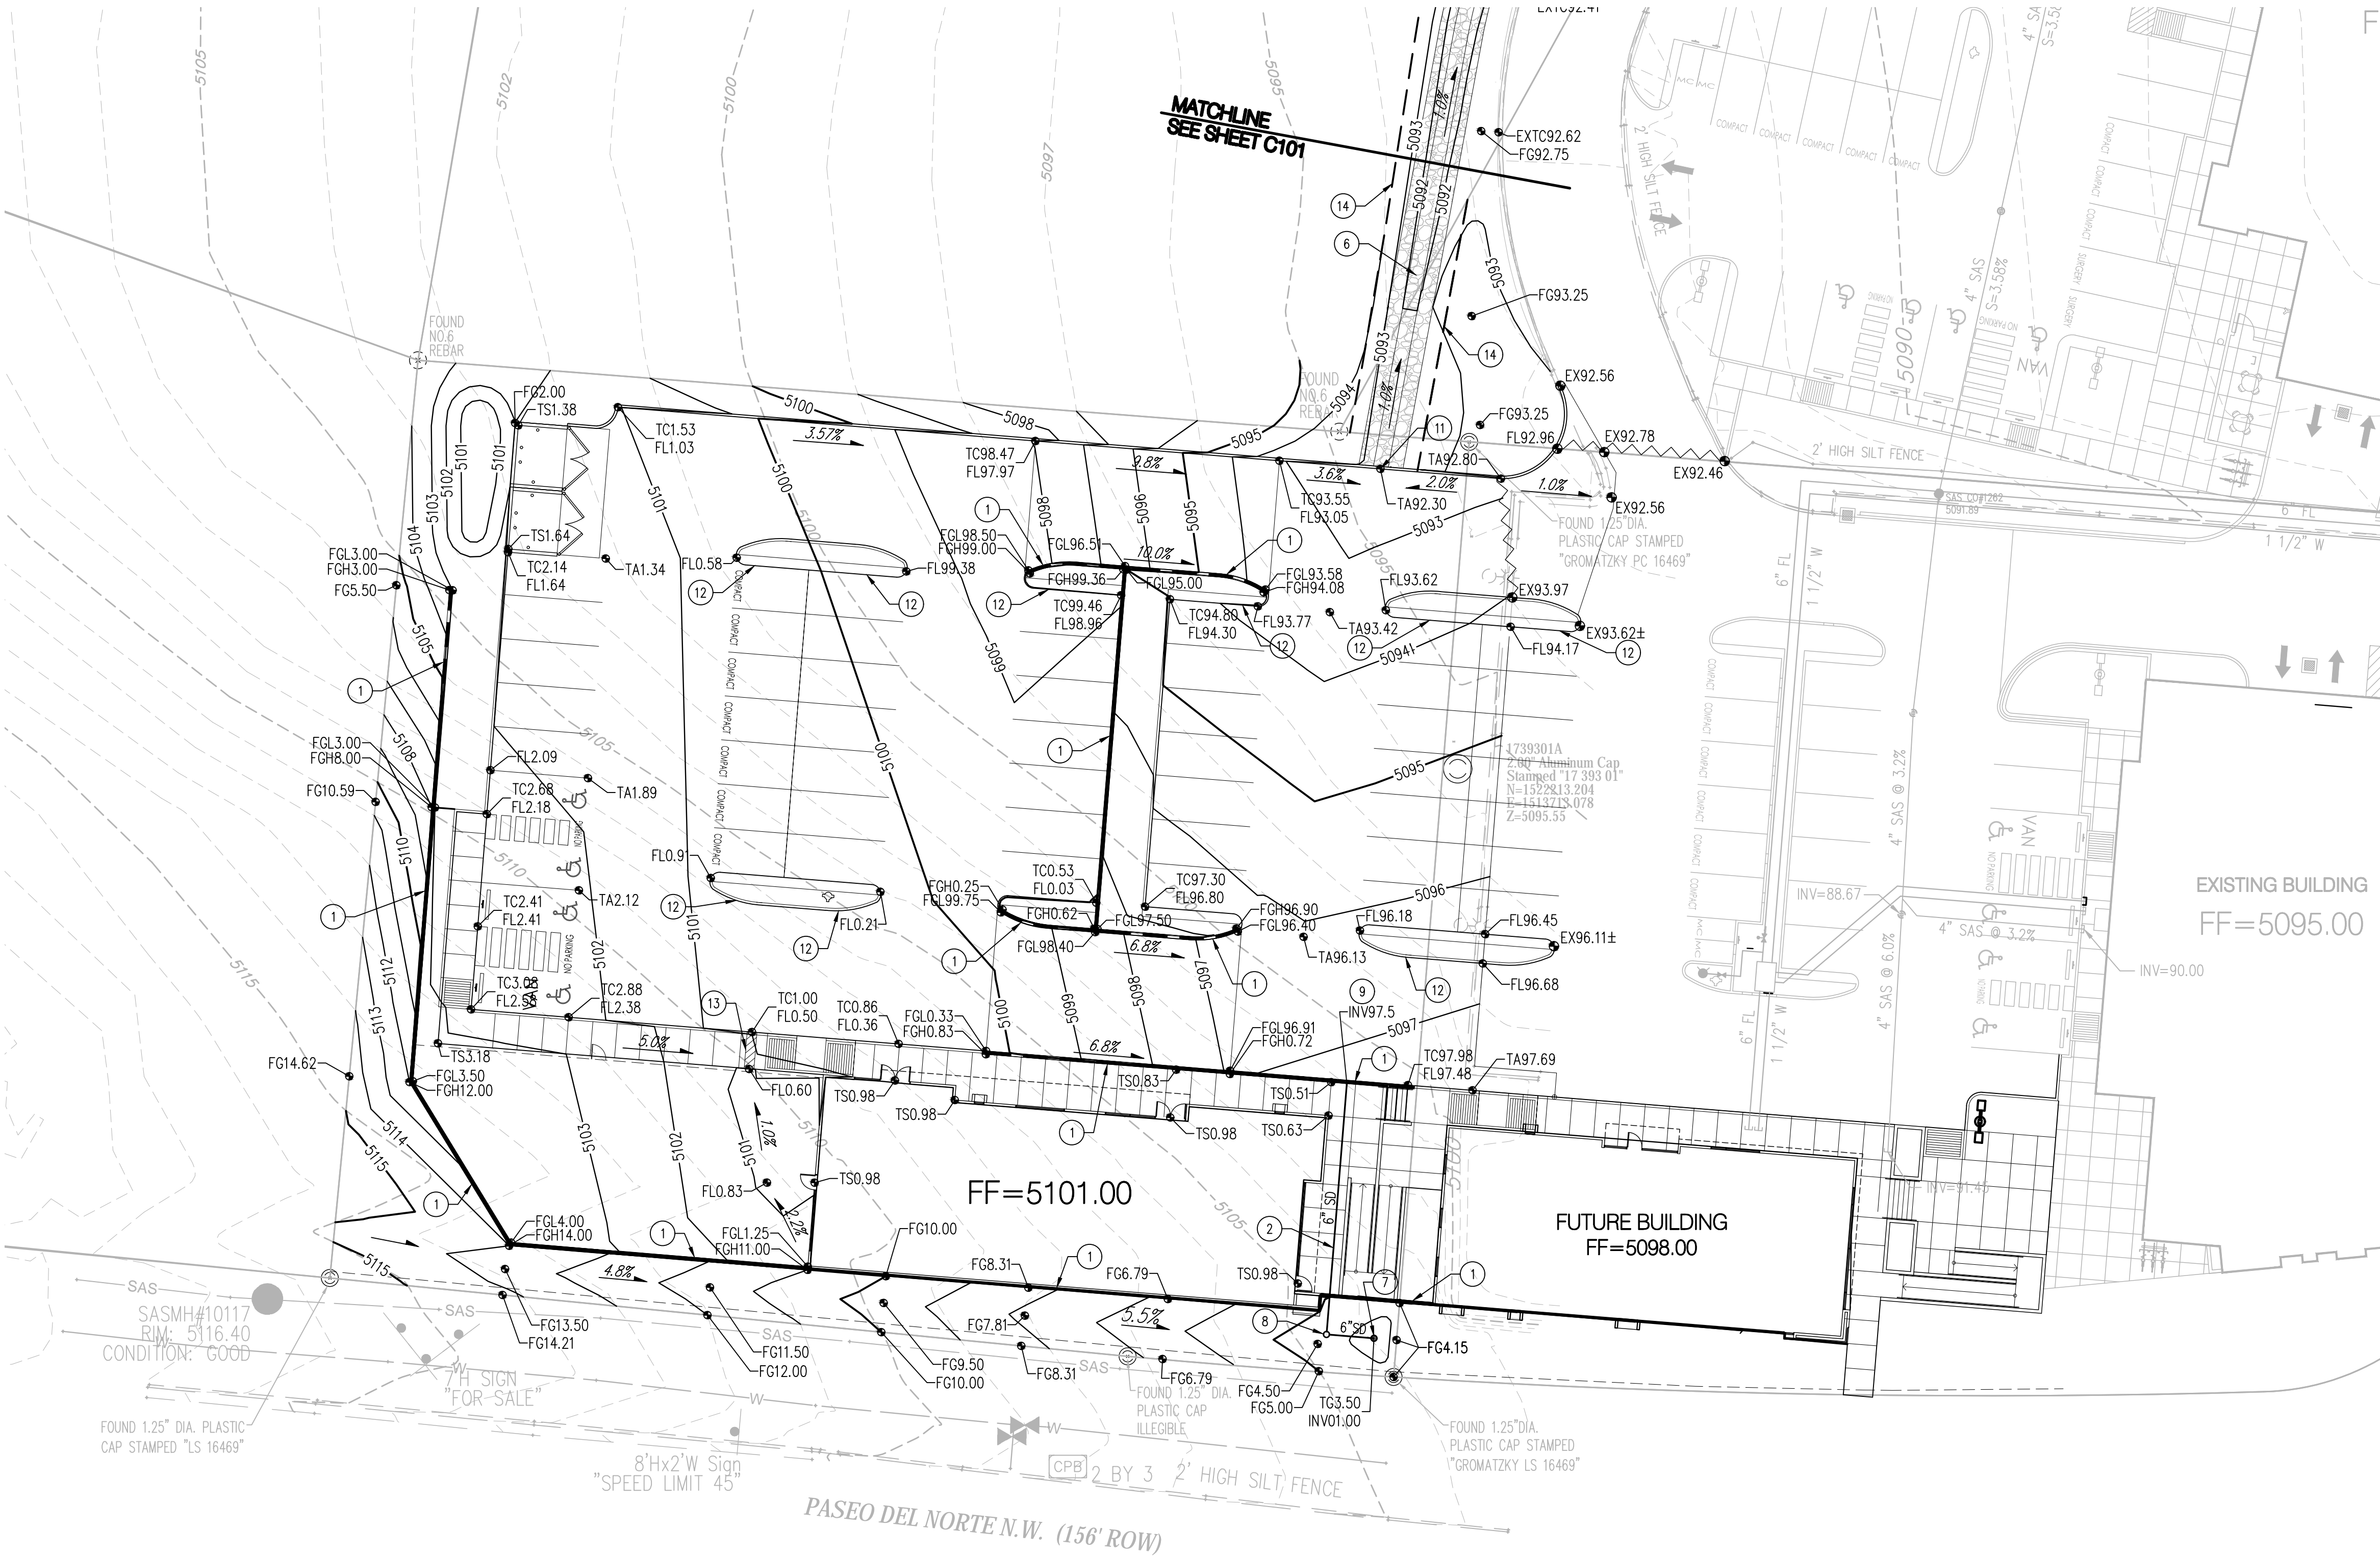

ZONE ATLAS PAGE: C-12


KEYED NOTES

1. PROPOSED RETAINING WALL.
2. PROPOSED STORM DRAIN PIPE. SEE PLAN FOR SIZE & SLOPE.
3. PROPOSED 4' DIA. STORM DRAIN MANHOLE.
4. INSTALL END SECTION.
5. INSTALL STORM DRAIN BEND.
6. PROPOSED RIP RAP LINED SWALE.
7. 12" DRAIN BASIN WITH DOME GRATE.
8. STORM DRAIN CLEANOUT.
9. DAYLIGHT 6" STORM DRAIN THRU RETAINING WALL.
10. 18"x12" ECCENTRIC REDUCER.
11. INSTALL 6' WIDE CURB OPENING.
12. INSTALL 12" WIDE CURB OPENING.
13. INSTALL 12" WIDE SIDEWALK CULVERT PER COA STD. DETAIL 2236.
14. PROPOSED PRIVATE DRAINAGE EASEMENT.

NOTE: NOT ALL KEYED NOTES MAY APPLY TO THIS SHEET.

LEGEND

- PROPERTY LINE
- EXISTING CONTOURS
- PROPOSED SPOT ELEVATION  
TC=TOP OF CURB, FL=FLOW LINE  
TS=TOP OF SIDEWALK, TA=TOP OF ASPHALT  
EX=EXISTING, FG=FINISHED GRADE  
TG=TOP OF GRATE, INV=INVERT  
FGH=FINISHED GRADE HIGH  
FGL=FINISHED GRADE LOW
- PROPOSED DIRECTION OF FLOW
- WATER BLOCK / RIDGE OR HIGH POINT
- PROPOSED RETAINING WALL
- PROPOSED INDEX CONTOURS
- PROPOSED INTER CONTOURS
- PROPOSED CURB & GUTTER

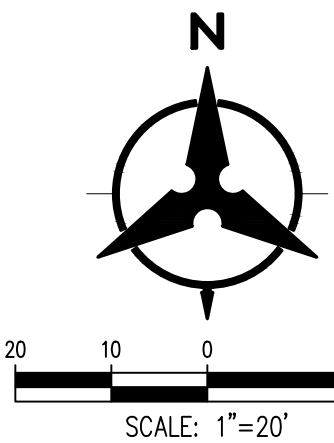

revision	
by	
date	
rev	△△△△△



Mullen Heller  
Architecture P.C.

1718 Central Avenue SW  
Suite D  
Albuquerque 87104  
505 268 4144[p]  
505 268 4244 [f]



job number	17-04
drawn by	AV
project manager	Douglas Heller, AIA
date	02-08-2018

project title	Smiles for Kids Dental Office - Site Expansion
sheet title	CONCEPTUAL GRADING & DRAINAGE PLAN
project address	9201 Eagle Ranch Road NW Albuquerque, New Mexico 87114



