

CITY OF ALBUQUERQUE

Planning Department
David Campbell, Director



Mayor Timothy M. Keller

September 19, 2018

Mike Walla, P.E.
Walla Engineering
6501 Americas Pwky NE, Suite 301
Albuquerque, NM, 87110

**RE: Alameda Development
6100 Alameda NE
Conceptual Grading and Drainage Plan
Engineer's Stamp Date: 09/12/18
Hydrology File: C18D086**

Dear Mr. Walla:

PO Box 1293

Albuquerque

NM 87103

www.cabq.gov

Based upon the information provided in your submittal received 09/12/2018, the Conceptual Grading and Drainage Plan **is not** approved for action by the DRB for Site Plan for Building Permit. The following comments need to be addressed for approval of the above referenced project:

1. Sheet 3. Basin II is missing the northern boundary line along, please add this.
2. Sheet 3. Please reevaluate Basin II's area. It appears that a portion of the building on Lot 2-A and drive entrance should be included in Basin III which discharges into the underground system.
3. Sheet 3. Please add a water block at the entrances to Alameda Blvd and Signal to ensure that drainage does not leave the site.
4. Sheet 3. Please add an inlet within the drive entrances along Alameda to capture the runoff and direct it to Drainage Point "A".
5. Sheet 3. Please add a berm or add a grade line to redirect the runoff to the proposed inlet in Basin IV. The grading as is appears to allow runoff into San Pedro.
6. Sheet 3. Please call out the storm pipe size.
7. Sheet 3. Please show and label the volume provided for the

CITY OF ALBUQUERQUE

Planning Department
David Campbell, Director



Mayor Timothy M. Keller

8. Drainage Report. Each Basin must have its own first flush pond with volume calculations showing what is required and what is provided. These can be provided within the depressed landscaping or detention basin.
9. Drainage Report. Please provide the allowable discharge for each Basin.
10. Drainage Report. Based on the drainage calculations and the allowable discharge, the areas drainage to Alameda and the area draining to Signal will need a detention pond. For example, Basin I (0.915 ac) has an allowable discharge of 3.50 cfs and a runoff of 4.02 cfs. Therefore a detention pond needs to capture the excess of 0.52 cfs. To size the detention pond, please use either the simple hydrograph method for small watersheds to calculate the volume needed for detention (100 year – 24 hour storm event) or a routing program such as AHYMO as outlined in Chapter 22 of the DPM. If you want to use the HEC-HMS model, then please use the following parameters:
 - a. The use of just four CN values, one for each of the land treatments already described in the DPM: A=76, B=80, C=85 and D=98. This way the hydrologic soil groups don't need to be determined to select the CN and the soil maps do not need to be consulted.
 - b. These CNs are for a 24 hour precipitation distribution using NOAA Atlas 14 with the peak at 12 hours.
 - c. $Lag=0.6T_c$ where T_c is calculated using the procedure already in the DPM
11. Drainage Report. Based on some preliminary calculations, it appears that the proposed underground detention system will be too small. Please reevaluate the underground system based on the calculations from item #10.
12. Drainage Report. Please provide the maintenance responsivities for each detention and/or first flush ponds.
13. Drainage Report. It appears that the storm drain system and inlet near the drive entrance to San Pedro Blvd is too low to drain through the underground system and then into the existing storm sewer on Alameda. Please provide the Hydraulic Grade Line in a profile from the existing storm drain truck line in Alameda through the underground system to the sump inlet near the drive entrance to San Pedro Blvd in a profile view.
14. Drainage Report. Please provide hydraulic calculations for all drainage structures (inlets, pipes, and pond outfall structures).
15. Infrastructure List. Please add the storm sewer type at the SW corner of Signal.
16. Infrastructure List. Please add all storm drains from the property line to the existing or proposed inlet. Specifying the pipe size and location.

PO Box 1293

Albuquerque

NM 87103

www.cabq.gov

CITY OF ALBUQUERQUE

Planning Department
David Campbell, Director



Mayor Timothy M. Keller

17. Infrastructure List. Please add the storm drains from the proposed inlet on Signal to the existing manhole. Specifying the pipe size and location.
18. Infrastructure List. Please move note #1 to a line item instead of in the notes. This is to ensure that the item can be initialed as complete during closeout process.

Please note that an approved "For Construction" grading and drainage plan by Hydrology will be required for each lot prior to grading or building permit.

If you have any questions, please contact me at 924-3995 or rbrissette@cabq.gov.

Sincerely,

Renée C. Brissette, P.E. CFM
Senior Engineer, Hydrology
Planning Department

PO Box 1293

Albuquerque

NM 87103

www.cabq.gov



City of Albuquerque

Planning Department
Development & Building Services Division

DRAINAGE AND TRANSPORTATION INFORMATION SHEET (REV 6/2018)

Project Title: ALAMEDA DEVELOPMENT **Building Permit #:** _____ **Hydrology File #:** _____
DRB#: 1000682 **EPC#:** _____ **Work Order#:** _____
Legal Description: REMAINING PORTIONS OF LOTS 1, 2 AND 3 AND ALL OF LOTS 4, 5, 6 AND 29 IN BLOCK 29, TRACT A, UNIT B, NORTH ALBUQUERQUE ACRES,
CITY OF ALBUQUERQUE, BERNALILLO COUNTY, NEW MEXICO, JUNE 2018
City Address: 6100 ALAMEDA NE, ALBUQUERQUE, NEW MEXICO 87113

Applicant: WALLA ENGINEERING **Contact:** MIKE WALLA
Address: 6501 AMERICAS PARKWAY NE, SUITE 301, ALBUQUERQUE, NM 87110
Phone#: 505-881-3008 **Fax#:** 505-881-4025 **E-mail:** mikew@wallaengineering.com

Other Contact: JOE SLAGLE ARCHITECT **Contact:** JOE SLAGLE
Address: 413 2ND ST. SW, ALBUQUERQUE, NM 87102
Phone#: 505-246-0870 **Fax#:** _____ **E-mail:** joe@slaglearchitect.com

TYPE OF DEVELOPMENT: _____ PLAT (# of lots) _____ RESIDENCE ☒ DRB SITE _____ ADMIN SITE

IS THIS A RESUBMITTAL? ☒ Yes _____ No

DEPARTMENT _____ TRANSPORTATION ☒ HYDROLOGY/DRAINAGE

Check all that Apply:

TYPE OF SUBMITTAL:

- ☐ ENGINEER/ARCHITECT CERTIFICATION
☐ PAD CERTIFICATION
☒ CONCEPTUAL G & D PLAN
☐ GRADING PLAN
☒ DRAINAGE REPORT
☐ DRAINAGE MASTER PLAN
☐ FLOODPLAIN DEVELOPMENT PERMIT APPLIC
☐ ELEVATION CERTIFICATE
☐ CLOMR/LOMR
☐ TRAFFIC CIRCULATION LAYOUT (TCL)
☐ TRAFFIC IMPACT STUDY (TIS)
☐ STREET LIGHT LAYOUT
☐ OTHER (SPECIFY) _____
☐ PRE-DESIGN MEETING?

TYPE OF APPROVAL/ACCEPTANCE SOUGHT:

- ☐ BUILDING PERMIT APPROVAL
☐ CERTIFICATE OF OCCUPANCY
☐ PRELIMINARY PLAT APPROVAL
☐ SITE PLAN FOR SUB'D APPROVAL
☒ SITE PLAN FOR BLDG. PERMIT APPROVAL
☒ FINAL PLAT APPROVAL
☐ SIA/ RELEASE OF FINANCIAL GUARANTEE
☐ FOUNDATION PERMIT APPROVAL
☐ GRADING PERMIT APPROVAL
☐ SO-19 APPROVAL
☐ PAVING PERMIT APPROVAL
☐ GRADING/ PAD CERTIFICATION
☐ WORK ORDER APPROVAL
☐ CLOMR/LOMR
☐ FLOODPLAIN DEVELOPMENT PERMIT
☐ OTHER (SPECIFY) _____

DATE SUBMITTED: 9-12-18 **By:** MIKE WALLA

COA STAFF:

ELECTRONIC SUBMITTAL RECEIVED: _____

FEE PAID: _____



**Drainage Report
For**

Alameda & San Pedro Mixed Use


Prepared by:

Walla Engineering, Ltd.
6501 Americas Parkway NE
Suite 301
Albuquerque, New Mexico 87110

Prepared for:
Joe Slagle Architects
413 2nd St. SW
Albuquerque, New Mexico 87109

September, 2018

I certify that this report was prepared under my supervision, and I am a registered professional engineer in the state of New Mexico in good standing.

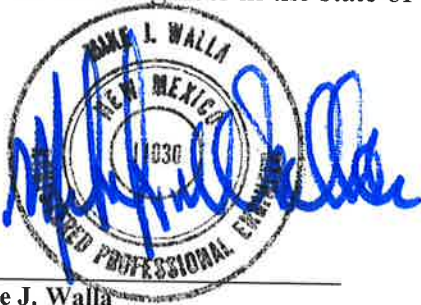

Mike J. Walla
PE No. 11030

Project # S48-0218

6 5 0 1 A m e r i c a s P a r k w a y N E • S u i t e 3 0 1
A l b u q u e r q u e • N e w M e x i c o • 8 7 1 1 0
(5 0 5) 8 8 1 - 3 0 0 8 • F a c s i m i l e (5 0 5) 8 8 1 - 4 0 2 5

TABLE OF CONTENTS

SECTION I – REPORT

Introduction.....	3
Information Sheet.....	4
Infrastructure List.....	5
Flood Hazard Map.....	8
Vicinity Map/Zone Atlas Map	9
Legal Description	10
Existing Drainage Conditions.....	11
Proposed Drainage Conditions.....	12
Calculations.....	13
Summary.....	14

SECTION II – RUNOFF CALCULATIONS.....15

Runoff Calculations
Pond Calculations
Pipe Calculation

SECTION I

REPORT

Introduction

The subject site is located in North Albuquerque Acres at the southeast corner of the intersection of San Pedro Blvd. and Alameda Blvd. NE. The site is currently unimproved but is planned for development into a light commercial center. The site is made up of 7 original lots that total approximately 5.26 acres that will be replatted into 4 lots. The project will require public works improvements on Alameda to widen the road and add sidewalk and a bike lane. San Pedro will be widened as well as part of this work. The site is accessed from San Pedro Blvd. on the west, Signal Avenue on the south and there will be two north entrances off of Alameda Blvd. The attached City of Albuquerque Zone Atlas Map, C-18-Z indicates the site location. The purpose of this report is to describe existing and proposed onsite drainage conditions and how the new development will handle developed storm runoff flows.



City of Albuquerque

Planning Department

Development & Building Services Division

DRAINAGE AND TRANSPORTATION INFORMATION SHEET (REV 6/2018)

Project Title: ALAMEDA DEVELOPMENT **Building Permit #:** _____ **Hydrology File #:** _____
DRB#: 1000682 **EPC#:** _____ **Work Order#:** _____
Legal Description: REMAINING PORTIONS OF LOTS 1, 2 AND 3 AND ALL OF LOTS 4, 5, 6 AND 29 IN BLOCK 29, TRACT A, UNIT B, NORTH ALBUQUERQUE ACRES, CITY OF ALBUQUERQUE, BERNALILLO COUNTY, NEW MEXICO, JUNE 2018
City Address: 6100 ALAMEDA NE, ALBUQUERQUE, NEW MEXICO 87113

Applicant: WALLA ENGINEERING **Contact:** MIKE WALLA
Address: 6501 AMERICAS PARKWAY NE, SUITE 301, ALBUQUERQUE, NM 87110
Phone#: 505-881-3008 **Fax#:** 505-881-4025 **E-mail:** mikew@wallaengineering.com
Other Contact: JOE SLAGLE ARCHITECT **Contact:** JOE SLAGLE
Address: 413 2ND ST. SW, ALBUQUERQUE, NM 87102
Phone#: 505-246-0870 **Fax#:** _____ **E-mail:** joe@slaglearchitect.com

TYPE OF DEVELOPMENT: _____ PLAT (# of lots) _____ RESIDENCE ☒ DRB SITE _____ ADMIN SITE

IS THIS A RESUBMITTAL? ☒ Yes _____ No

DEPARTMENT _____ TRANSPORTATION ☒ HYDROLOGY/DRAINAGE

Check all that Apply:

TYPE OF SUBMITTAL:

- ☐ ENGINEER/ARCHITECT CERTIFICATION
- ☐ PAD CERTIFICATION
- ☒ CONCEPTUAL G & D PLAN
- ☐ GRADING PLAN
- ☒ DRAINAGE REPORT
- ☐ DRAINAGE MASTER PLAN
- ☐ FLOODPLAIN DEVELOPMENT PERMIT APPLIC
- ☐ ELEVATION CERTIFICATE
- ☐ CLOMR/LOMR
- ☐ TRAFFIC CIRCULATION LAYOUT (TCL)
- ☐ TRAFFIC IMPACT STUDY (TIS)
- ☐ STREET LIGHT LAYOUT
- ☐ OTHER (SPECIFY) _____
- ☐ PRE-DESIGN MEETING?

TYPE OF APPROVAL/ACCEPTANCE SOUGHT:

- ☐ BUILDING PERMIT APPROVAL
- ☐ CERTIFICATE OF OCCUPANCY
- ☐ PRELIMINARY PLAT APPROVAL
- ☐ SITE PLAN FOR SUB'D APPROVAL
- ☒ SITE PLAN FOR BLDG. PERMIT APPROVAL
- ☒ FINAL PLAT APPROVAL
- ☐ SIA/ RELEASE OF FINANCIAL GUARANTEE
- ☐ FOUNDATION PERMIT APPROVAL
- ☐ GRADING PERMIT APPROVAL
- ☐ SO-19 APPROVAL
- ☐ PAVING PERMIT APPROVAL
- ☐ GRADING/ PAD CERTIFICATION
- ☐ WORK ORDER APPROVAL
- ☐ CLOMR/LOMR
- ☐ FLOODPLAIN DEVELOPMENT PERMIT
- ☐ OTHER (SPECIFY) _____

DATE SUBMITTED: 9-11-18 **By:** MIKE WALLA

COA STAFF:

ELECTRONIC SUBMITTAL RECEIVED: _____

FEE PAID: _____

FIGURE 12
INFRASTRUCTURE LIST

Project Number 1000682

Date Submitted Sept. 10, 2018

Date Site Plan Approved _____

Date Preliminary Plat Approved _____

Date Preliminary Plat Expires _____

DRB Project No. _____

DRB Application No.: _____

EXHIBIT "A"

TO SUBDIVISION IMPROVEMENTS AGREEMENT

DEVELOPMENT REVIEW BOARD (DRB) REQUIRED INFRASTRUCTURE IMPROVEMENTS LIST

Alameda Blvd. & San Pedro Blvd. Mixed Use Development

PROPOSED NAME OF PLAT AND/OR SITE DEVELOPMENT PLAN

Remaining Portions of Lots 1,2 & 3 and All of Lots 4,5 & 6 and 29 in Block 29, Tract A, Unit B of North Albuquerque Acres, City of Albuquerque, Bernalillo County, New Mexico, 2018

EXISTING LEGAL DESCRIPTION PRIOR TO PLATTING ACTION

Following is a summary of **PUBLIC:PRIVATE** Infrastructure required to be constructed financially guaranteed for the above development. This listing is not necessarily a complete listing. During the S/A process and/or in the review of the construction drawings if the DRC Chair determines that appurtenant items and/or unforeseen items have not been included in the infrastructure listing the DRC Chair may include those items in the listing and related financial guarantee. Likewise, if the DRC Chair determines that appurtenant or non-essential items can be deleted from the listing those items may be deleted as well on the related portions of the financial guarantee. All such revisions require approval from the DRC Chair, the User Department and agent/owner. If such approvals are obtained, those revisions to the listing will be incorporated administratively. In addition, any unforeseen items which arise during construction which are necessary to complete the project and which normally are the Subdivider's responsibility will be required as a condition of project acceptance and close out by the City.

Financially Guaranteed DRC #	Constructed Under DRC #	Size	Type of Improvement	Location	From	To	Construction Certification		
							Inspector	P.E.	City Const Engineer
		12' lane	Arterial AC Pymt, PCC Curb & Gutter	Alameda Blvd.	San Pedro	East P. Line	/	/	/
		6 ft	Sidewalk with landscape buffer	Alameda Blvd.	San Pedro	East P. Line	/	/	/
		6 ft	6' bike lane	Alameda Blvd.	San Pedro	East P. Line	/	/	/
		12' lane	Arterial AC Pymt, PCC Curb & Gutter,	San Pedro Blvd.	South P Line	north of new entrance	/	/	/
		6 ft	Sidewalk for widening of San Pedro	San Pedro Blvd.	South P Line	north of new entrance	/	/	/

FIGURE 12
INFRASTRUCTURE LIST

Financially Guaranteed DRC #	Constructed Under DRC #	Size	Type of Improvement	Location	From	To	Construction Certification	
							Inspector	City Const Engineer
		Std C&G	Standard Curb & Gutter and 6'-0" SW on Signal Ave. - South site boundary	Project Site				
		18" RCP	Remove and replace existing storm drain lateral from replaced inlet to existing manhole in Alameda Blvd.	Alameda Blvd.	Replaced DL	Existing MH		
		24' Wide	Private Drive Entrance w/Valley Gutter	Signal Ave. Alameda Blvd.	Site Entry Drive			
		26' Wide	Private Drive Entrance w/Valley Gutter	San Pedro Blvd. Alameda Blvd.	Site Entry Drive			
		1 Each	Remove/Replace Storm Drain Inlet "Type A"	Alameda Blvd.	Existing curb	New Curb		
		8" dia	New public water line main - 880 LF	Alameda Blvd. ROW	San Pedro Blvd.	East Prop Line		
		8" dia	New public SAS main - 300 LF	San Pedro Blvd.	San Pedro/Signal	New MH		
		8" dia	New public SAS main - 900 LF	Development Drive	San Pedro/New MH	East Parcel		
		6" dia	Fire Hydrants (2-public, 1-private) - 3 ttl	Alameda Blvd.	San Pedro Blvd.	East end		
		4' dia	SAS Manhole - 1 Ea	San Pedro Blvd.				
		1" dia	Commercial water service - 4 Ea	Alameda Blvd.	San Pedro Blvd.	Easternmost		
						<u>Lot</u>		

FIGURE 12
INFRASTRUCTURE LIST

NOTES
Street lights per City requirements

- 1 Engineer's Certification of Private Grading and Drainage will be required prior to ROFG
- 2 20' Public Sanitary Sewer Service Easement required on the developed property
- 3

AGENT/OWNER	DEVELOPMENT REVIEW BOARD MEMBER APPROVALS			

NAME (print)	DRB CHAIR – date	PARKS & GENERAL RECREATION – date
FIRM	TRANSPORTATION DEVELOPMENT – date	AMAFCA – date
SIGNATURE – date	UTILITY DEVELOPMENT – date	-date
	CITY ENGINEER – date	-date

DESIGN REVIEW COMMITTEE REVISIONS			

REVISION	DATE	DRB CHAIR	USER DEPARTMENT	AGENT/OWNER

National Flood Hazard Layer FIRMette



35°11'15.28"N



USGS The National Map: Orthoimagery. Data refreshed October 2017.



106°34'17.53"W

Legend

SEE FIS REPORT FOR DETAILED LEGEND AND INDEX MAP FOR FIRM PANEL LAYOUT

SPECIAL FLOOD HAZARD AREAS	Without Base Flood Elevation (BFE) Zone A, V, A99 With BFE or Depth Zone AE, AH, AO, AR, VE, AR Regulatory Floodway
OTHER AREAS OF FLOOD HAZARD	0.2% Annual Chance Flood Hazard, Area of 1% annual chance flood with average depth less than one foot or with drainage areas of less than one square mile Zone X Future Conditions 1% Annual Chance Flood Hazard Zone X Area with Reduced Flood Risk due to Levee. See Notes. Zone X Area with Flood Risk due to Levee Zone D
OTHER AREAS	Area of Minimal Flood Hazard Zone X Effective LOMRs Area of Undetermined Flood Hazard Zone
GENERAL STRUCTURES	Channel, Culvert, or Storm Sewer Levee, Dike, or Floodwall
OTHER FEATURES	Cross Sections with 1% Annual Chance Water Surface Elevation Coastal Transect Base Flood Elevation Line (BFE) Limit of Study Jurisdiction Boundary Coastal Transect Baseline Profile Baseline Hydrographic Feature
MAP PANELS	Digital Data Available No Digital Data Available Unmapped

The pin displayed on the map is an approximate point selected by the user and does not represent an authoritative property location.


This map complies with FEMA's standards for the use of digital flood maps if it is not void as described below. The basemap shown complies with FEMA's basemap accuracy standards.

The flood hazard information is derived directly from the authoritative NFHL web services provided by FEMA. This map was exported on 9/11/2018 at 10:27:43 AM and does not reflect changes or amendments subsequent to this date and time. The NFHL and effective information may change or become superseded by new data over time.

This map image is void if the one or more of the following map elements do not appear: basemap imagery, flood zone labels, legend, scale bar, map creation date, community identifiers, FIRM panel number, and FIRM effective date. Map images for unmapped and unmodernized areas cannot be used for regulatory purposes.



GRAPHIC SCALE IN FEET



Zone Atlas Page
C-18-Z

Map Amended through
December 20, 1999

LEGAL DESCRIPTION

The current legal description of the subject property (prior to platting action) is:

Remaining portions of Lots 1,2 & 3 and all of Lots 4,5,6 and 29, Tract A, Unit B of North Albuquerque Acres, City of Albuquerque, Bernalillo County, New Mexico, June 2018.

When platted, the legal description will be:

Lots 1-A, 2-A, 4-A & 6-A, Block 29, Tract A, Unit B North Albuquerque Acres within Projected Section 13, T.11N.,R.3E., NMPM Within the Elena Gallegos Grant, City of Albuquerque, Bernalillo County, New Mexico, August 2018.

Existing Drainage Conditions & Offsite Flows

The existing site is an unimproved property with a prevailing slope from east to west that varies from 2 to 5% (3.1% average). Any runoff currently developed on this site is conveyed to Alameda and San Pedro Blvd. NE. The site is bordered on the east by an unimproved property with similar slopes. The adjacent properties to the south of the subject site are developed but do not appear to impact the subject site drainage. The portion of the subject site that borders Signal Blvd. also has an existing east to west slope with some small portion of storm runoff historically flowing into Signal Ave. or adjacent property west of this section of the site. No significant storm runoff developed offsite appears to be conveyed through the subject site.

Proposed Drainage Management

The proposed on-site drainage management plan will be based on the North Albuquerque Acres Master Drainage Plan as outlined in the design analysis report titled “Alameda Blvd. – San Pedro to Wyoming” Project #7663.91, by Thompson Engineering, dated January 2012. In this report the allowable storm runoff discharge to Alameda Blvd. is limited to 3.82 CFS per acre and runoff to San Pedro Blvd. is prohibited. The developed conditions on the subject site will create an increase in developed runoff discharge and underground storage will be used to temporarily store runoff with a controlled release to Alameda while a water block and catch basin will be utilized to intercept flows in the parking area and driveway from San Pedro to direct storm water to underground storage and ultimately the downstream facilities in Alameda as well. Developed storm water from the southern end of the site will be directed to a pond on the west side of this portion of the site where the first flush volume will be retained prior to outlet to Signal Ave. from an onsite catch basin to a new city drop inlet in the new curb and gutter on Signal Ave. which will be constructed per COA Work Order. This will be tied into an existing manhole and 30” storm drain in Signal and the subsequent downstream facilities.

Calculations

The weighted E method from the “City of Albuquerque Development Process Manual Volume 11 – Design Criteria, 1997 Revision” was used to calculate runoff volumes from the project site. The 6-hr, 100-yr developed storm runoff for the portion of the site fronting Alameda Blvd. was calculated to be a total of 20.36 CFS (Basins II, III and IV). The allowable discharge of storm runoff to Alameda Blvd. as defined by the NAA Master Drainage Plan, Project #7663.91, by Thompson engineering dated January 2012 is 3.82 CFS/acre and the area of the site affected by this limitation totals 4.342 acres. Therefore, the total allowable discharge to the Alameda storm drain facilities is 16.59 CFS from the developed site which is less than the total developed flow and an underground storage system will be required to hold storm runoff with a controlled release. Calculations for that runoff and controlled outlet included in the Appendix of this report. The portion of the site that fronts on Signal Ave. (Basin I) will also be sloped to drain towards Signal but this runoff will be detained in a first flush pond on the west side of a new parking lot and will have an onsite catch basin that will then direct discharge storm flow to a new curb inlet and storm drain lateral in Signal that will connect to an existing storm manhole and 30” diameter pipe in Signal Ave.

Summary

The site will be developed to comply with requirements of the NAA Master Drainage Plan by not exceeding runoff limits to Alameda Blvd. and all but eliminating any runoff to San Pedro Blvd. from the developed site. As indicated on the Conceptual Grading & Drainage Plan, a series of catch basins will be constructed to collect storm runoff and direct it to an underground storage tank where it will be released at a controlled rate to existing City facilities in Alameda. As much as possible, the developed first flush storm volumes will be either detained in an open pond, captured and released from an underground tank through a shrouded orifice or collected in roof drains and storm drains which will also be released through a shrouded orifice in an onsite catch basin.

SECTION II

Runoff Calculations

PRECIPITATION ZONE 3

DESIGN STORM: (IN)

					1hr	6hr	24hr	4day	10day
					2.14	2.60	3.10	3.95	4.90
EXISTING CONDITIONS - ALAMEDA LOTS									
LAND	AREA	AREA	P6	Q	Q	V6	V24	V4day	V10day
TRTMNT	(ACRE)	%		(CFS/AC)	(CFS)	(CF)	(CF)	(CF)	(CF)
A	0.000	0%	0.66	1.87	0.00	0	0	0	0
B	4.342	100%	0.92	2.60	11.29	14,501	14,501	14,501	14,501
C	0.000	0%	1.29	3.45	0.00	0	0	0	0
D	0.000	0%	2.36	5.02	0.00	0	0	0	0
TOTALS	4.342	100%			11.29	14,501	14,501	14,501	14,501

EXISTING CONDITIONS - SIGNAL AVE. PORTION

LAND	AREA	AREA	P6	Q	Q	V6	V24	V4day	V10day
TRTMNT	(ACRE)	%		(CFS/AC)	(CFS)	(CF)	(CF)	(CF)	(CF)
A	0.000	0%	0.66	1.87	0.00	0	0	0	0
B	0.915	100%	0.92	2.60	2.38	3,056	3,056	3,056	3,056
C	0.000	0%	1.29	3.45	0.00	0	0	0	0
D	0.000	0%	2.36	5.02	0.00	0	0	0	0
TOTALS	0.915	100%			2.38	3,056	3,056	3,056	3,056

PROPOSED CONDITIONS - BASIN I

LAND	AREA	AREA	P6	Q	Q	V6	V24	V4day	V10day
TRTMNT	(ACRE)	%		(CFS/AC)	(CFS)	(CF)	(CF)	(CF)	(CF)
A	0.000	0%	0.66	1.87	0.00	0	0	0	0
B	0.238	26%	0.92	2.60	0.62	795	795	795	795
C	0.000	0%	1.29	3.45	0.00	0	0	0	0
D	0.677	74%	2.36	5.02	3.40	5,800	7,028	7,889	8,134
TOTALS	0.915	100%			4.02	6,595	7,823	8,683	8,929

PROPOSED CONDITIONS - BASIN II

LAND	AREA	AREA	P6	Q	Q	V6	V24	V4day	V10day
TRTMNT	(ACRE)	%		(CFS/AC)	(CFS)	(CF)	(CF)	(CF)	(CF)
A	0.000	0%	0.66	1.87	0.00	0	0	0	0
B	0.093	15%	0.92	2.60	0.24	311	311	311	311
C	0.000	0%	1.29	3.45	0.00	0	0	0	0
D	0.544	85%	2.36	5.02	2.73	4,660	5,648	6,339	6,536
TOTALS	0.637	100%			2.97	4,971	5,958	6,649	6,847

PROPOSED CONDITIONS - BASIN III

LAND	AREA	AREA	P6	Q	Q	V6	V24	V4day	V10day
TRTMNT	(ACRE)	%		(CFS/AC)	(CFS)	(CF)	(CF)	(CF)	(CF)
A	0.000	0%	0.66	1.87	0.00	0	0	0	0
B	0.270	8%	0.92	2.60	0.70	902	902	902	902
C	0.000	0%	1.29	3.45	0.00	0	0	0	0
D	3.103	92%	2.36	5.02	15.58	26,583	32,215	36,157	37,283
TOTALS	3.373	100%			16.28	27,484	33,116	37,059	38,185

PROPOSED CONDITIONS - BASIN IV

LAND	AREA	AREA	P6	Q	Q	V6	V24	V4day	V10day
TRTMNT	(ACRE)	%		(CFS/AC)	(CFS)	(CF)	(CF)	(CF)	(CF)
A	0.000	0%	0.66	1.87	0.00	0	0	0	0
B	0.232	70%	0.92	2.60	0.60	775	775	775	775
C	0.000	0%	1.29	3.45	0.00	0	0	0	0
D	0.100	30%	2.36	5.02	0.50	857	1,038	1,165	1,202
TOTALS	0.332	100%			1.11	1,631	1,813	1,940	1,976

Allowable discharge to Alameda: 4.342 Acres X 3.82 CFS/AC = 16.59 CFS

Calculated direct discharge to Alameda: Basin II + Basin IV = 2.97 CFS + 1.11 CFS = 4.08 CFS

Basin III discharge allowed: 16.59 CFS - 4.08 CFS = 12.51 CFS

Use 18" dia PVC discharge pipe installed at 0.7% slope - Capacity = 12.29 CFS

First Flush Pond Required: Alameda Lots Trtmnt D Area = 3.554 AC x 0.34in = 4386 CF

First Flush Pond Required: Signal Ave. Sect'n Trtmnt D Area = 0.677 AC x 0.34in = 835 CF

	contour	area	volume
Pond 1 Capacity:	43	3000 sf	
	42	1710 sf	2355 cf
	41	540 sf	1125 cf
	Total Volume = 3480 CF		
Total First Flush Capacity =	<u>3480 CF</u> > 835 CF		
			OK



6501 Americas Parkway NE • Suite 301
Albuquerque • New Mexico • 87110
881-3008 • Facsimile 881-4025

SHEET NO. _____ OF _____
JOB ALAMEDA & SAN PEDRO MIXED USE
SUBJECT STORM WATER OUTLET PIPE
CLIENT SAGUE JOB NO. _____
BY ALW DATE 9/10/13
CHECKED BY _____ DATE _____

Alameda & San Pedro Mixed Use


Outlet Pipe

Set units:

Pipe diameter, d_0	18 in ▼
Manning roughness, n ? (http://www.engineeringtoolbox.com/mannings-roughness-d_799.html)	0.01
Pressure slope (possibly ? (../pressureslope.php) equal to pipe slope), S_0	.7 % rise/run ▼
Percent of (or ratio to) full depth (100% or 1 if flowing full)	94 % ▼

Results

Flow, Q	12.2886	cfs ▼
Velocity, v	7.1288	ft/sec ▼
Velocity head, h_v	9.4779	in ▼
Flow area	248.2360	sq. in. ▼
Wetted perimeter	47.6399	in ▼
Hydraulic radius	5.2107	in ▼
Top width, T	8.5495	in ▼
Froude number, F	0.81	
Shear stress (tractive force), τ	0.6163	psf ▼

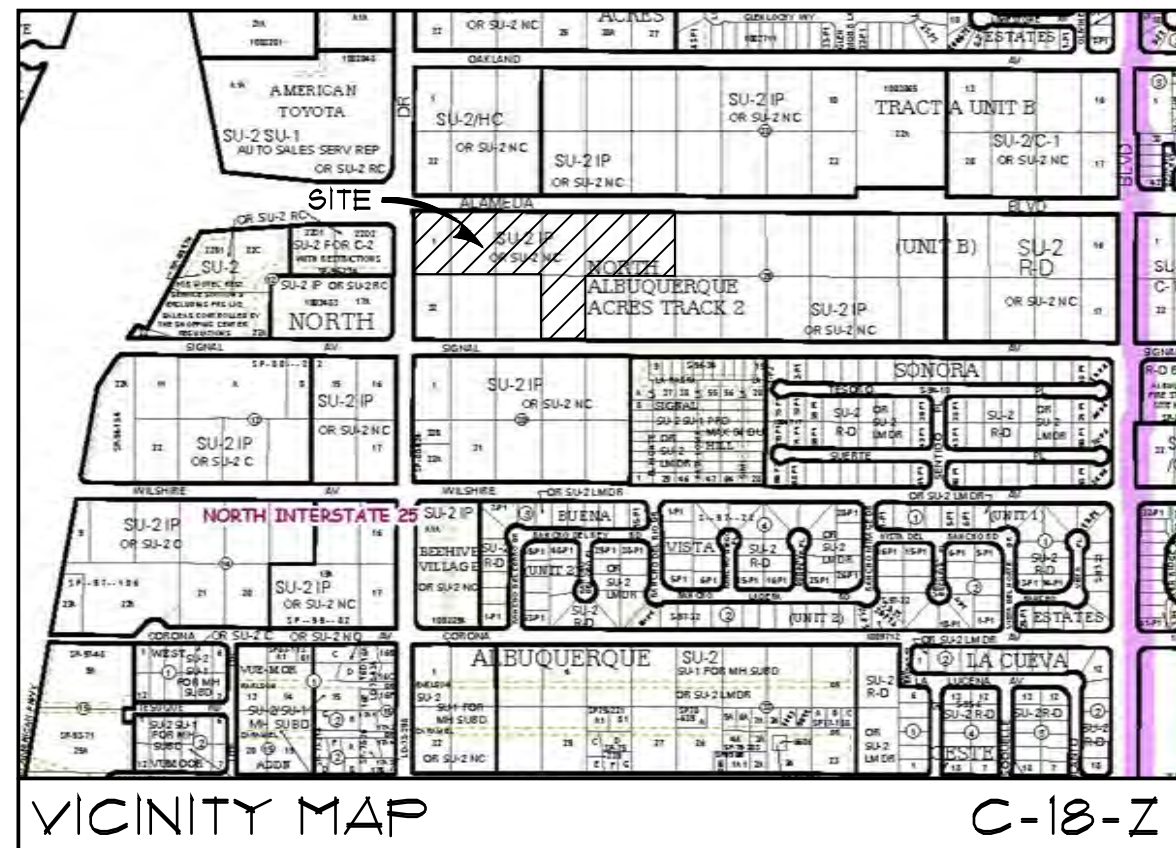

DRAINAGE NOTES

- FLOOD PLAIN DESIGNATION ZONE X PER FIRM MAP 350002, OCTOBER 2011
- SUBJECT SITE IS WITHIN THE NORTH ALBUQUERQUE ACRES MASTER DRAINAGE PLAN - DESIGN ANALYSIS REPORT "ALAMEDA BLVD. - SAN PEDRO TO WYOMING, PROJECT #166393" BY THOMPSON ENGINEERING DATED JANUARY, 2012 - THE ALLOWABLE DISCHARGE FOR THIS SITE IS 3.82 CFS/AC

DRAINAGE POINTS

- A 2.91 CFS
- B 1.11 CFS
- C 12.22 CFS
- D 4.02 CFS


LEGAL DESCRIPTION

REMAINING PORTIONS OF LOTS 1, 2 AND 3 AND ALL OF LOTS 4, 5, 6 AND 29 IN BLOCK 29 TRACT A UNIT B, NORTH ALBUQUERQUE ACRES CITY OF ALBUQUERQUE, BERNALILLO COUNTY, NEW MEXICO JUNE, 2018


BASIS OF ELEVATIONS

ELEVATIONS ARE BASED ON CITY OF ALBUQUERQUE STATION No. "S-CIB 1988", HAVING AN ELEVATION OF 5232.41, NAVD 1988

A MIXED USE DEVELOPMENT
at alameda and
san pedro ne.
abq, nm

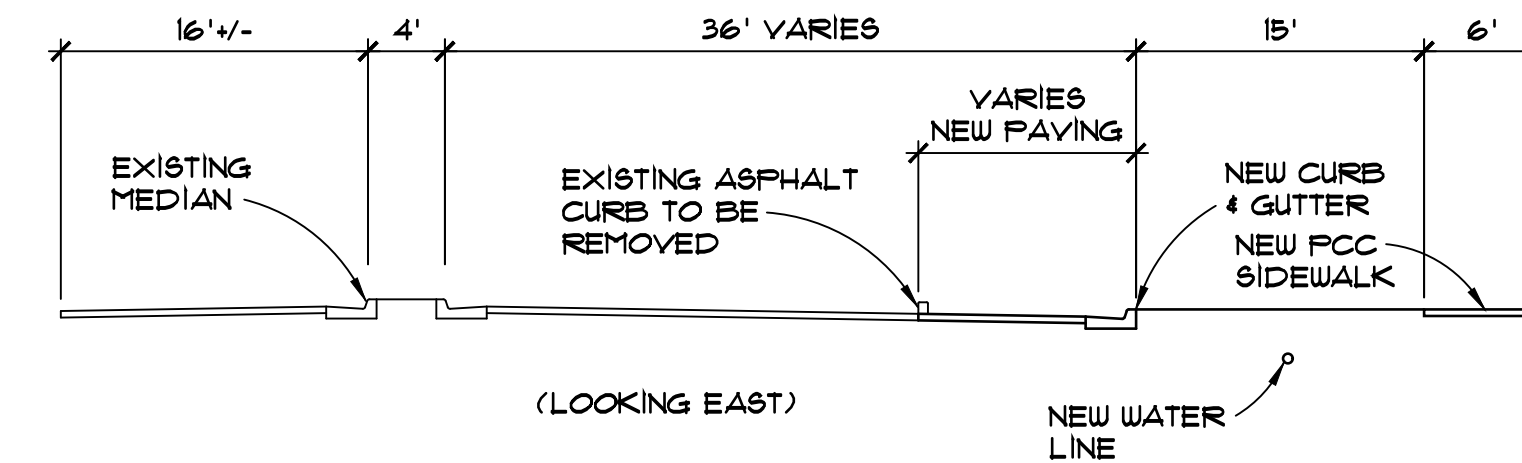

2 | section alameda blvd. w/ turn lane
3 | 1"=10'
ALAMEDA BOULEVARD N.E.
R/W VARIES

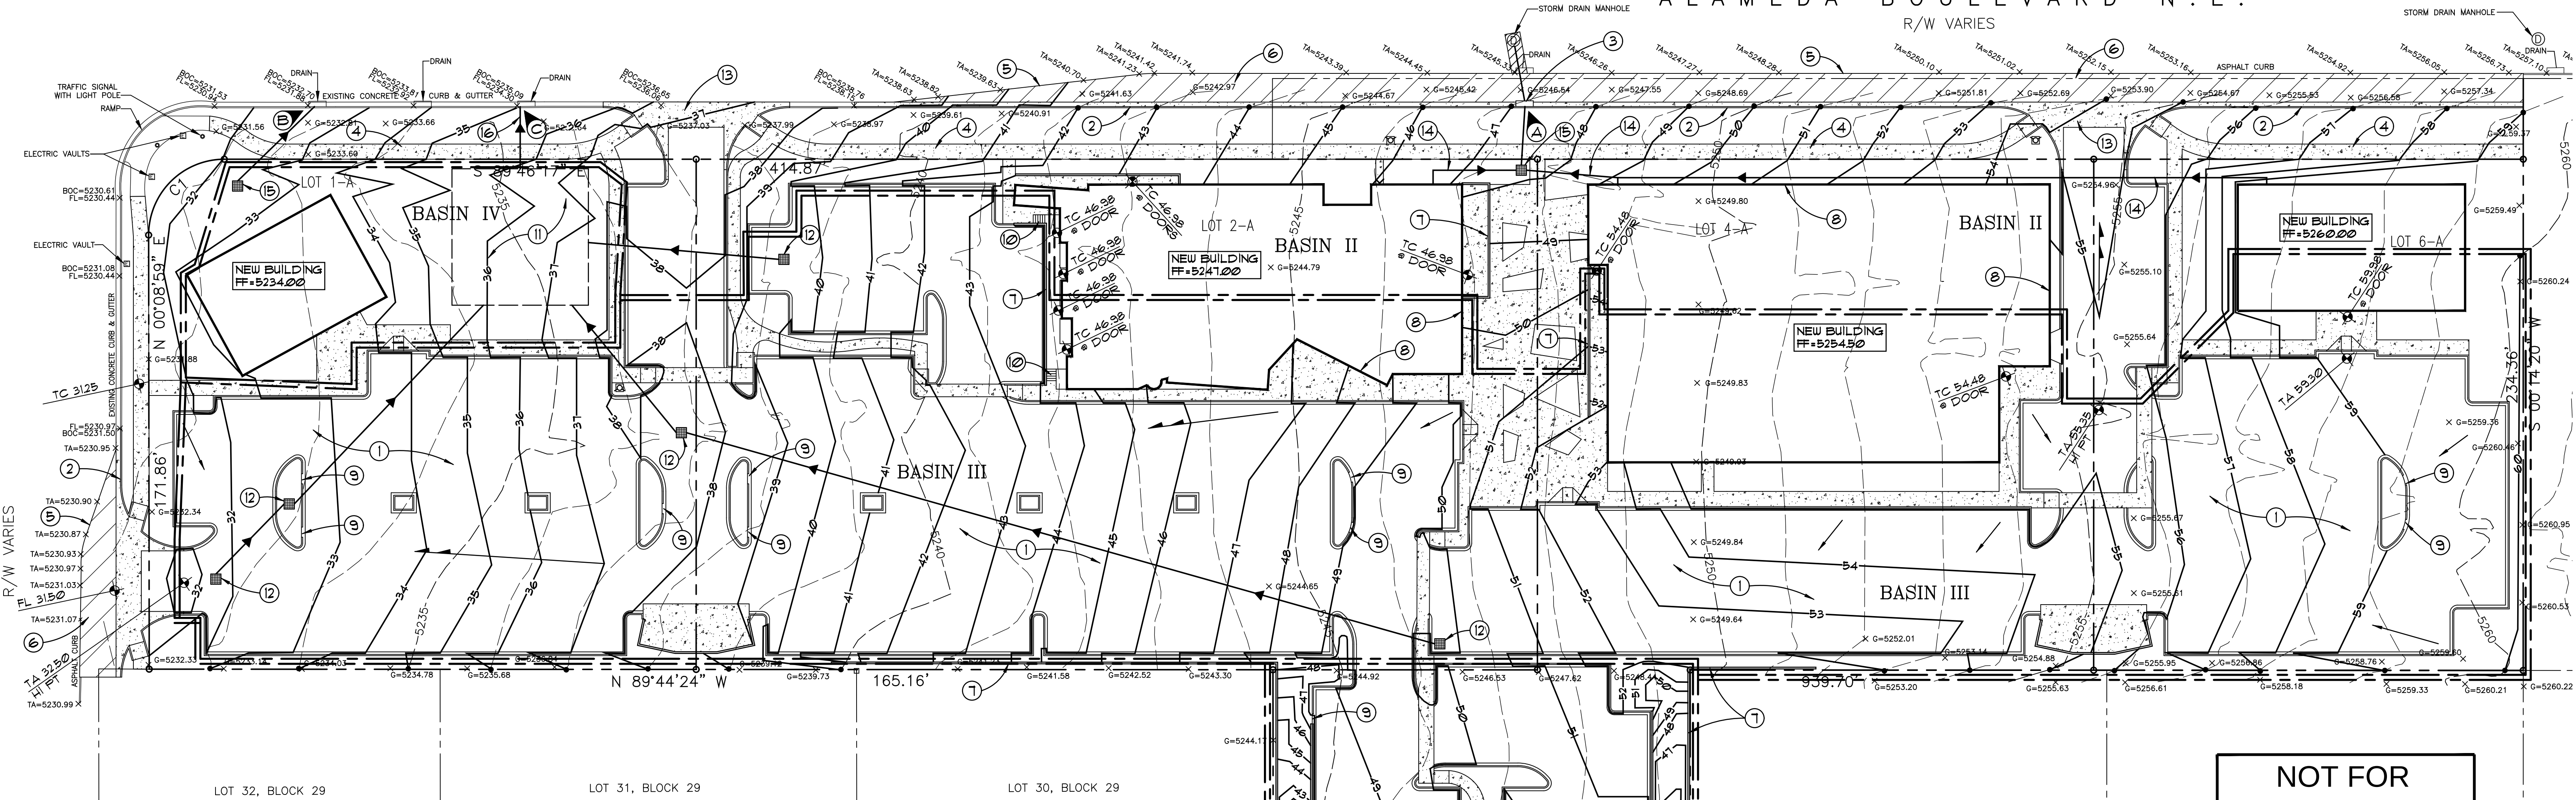

NOT FOR CONSTRUCTION

KEYED NOTES

- ASPHALT PAVED PARKING AND DRIVE
- NEW C.O.A. CURB AND GUTTER PER WORK ORDER
- NEW CATCH BASIN AND CONNECTION TO EXISTING STORM DRAIN MANHOLE PER C.O.A. WORK ORDER
- NEW C.O.A. 6'-0" SIDEWALK PER WORK ORDER
- EXISTING ASPHALT CURB TO BE REMOVED
- ARTERIAL STREET PAVING SECTION BY WORK ORDER
- SITE RETAINING WALL
- RETAINING FOUNDATION STEM WALL
- 4'-0" WIDE CURB BREAK FOR DRAINAGE
- CONCRETE STEPS
- 10,000 GALLON BELOW GRADE WATER STORAGE TANK WITH CONTROLLED RELEASE TO EXISTING STORM DRAIN
- CONCRETE CATCH BASIN
- NEW CONCRETE DRIVE PAD
- ROOF DRAIN LINE
- CONCRETE CATCH BASIN WITH SHROUD
- 18" PVC OUTLET PIPE AT 0.1% SLOPE

LEGEND

- PROPERTY LINE
- NEW BUILDING LINE
- EXISTING CONTOUR
- PROPOSED CONTOUR
- PROPOSED SPOT ELEVATION
- EXISTING SPOT ELEVATION
- BASIN LINE
- FLOW DIRECTION ARROW
- SUWALE
- FINISH FLOOR
- TOP OF CONCRETE
- TOP OF ASPHALT
- FLOWLINE
- NEW CONCRETE PAVING/SIDEWALK

TRACT A, UNIT B
NORTH ALBUQUERQUE ACRES
FILED: APRIL 24, 1936
VOLUME D, FOLIO 130



LOT 28, BLOCK 29
TRACT A, UNIT B
NORTH ALBUQUERQUE ACRES
FILED: APRIL 24, 1936
VOLUME D, FOLIO 130

LOT 27, BLOCK 29
TRACT A, UNIT B
NORTH ALBUQUERQUE ACRES
FILED: APRIL 24, 1936
VOLUME D, FOLIO 130

revisions:



Conceptual
Grading Plan
date:
9-12-18
sheet:

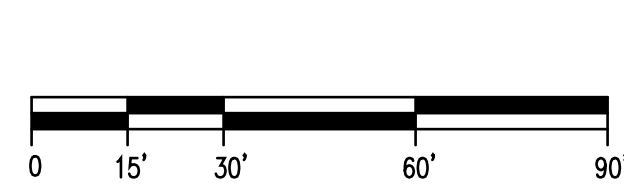

1 | conceptual grading plan
3 | 1"=30'

