

C18D101

Elliott, Stanice

From: Biazar, Shahab
Sent: Tuesday, September 13, 2016 10:41 AM
To: Elliott, Stanice
Cc: Carrillo, Abiel X.; Harmon Rita T.; David Soule; 'Tim Helmick'; Ortiz, Monica
Subject: 8815 Silver Oak Lane NE
Attachments: lot 6 silver oaks drainage certification submittal package.pdf

Stanice,

Would you please release the building permit for 8815 Silver Oak Lane NE. Attached are the electronic copy of the certification

David,

Would you please submit a hard copy of your certification.

Thanks

Shahab Biazar, P.E.

City Engineer

Planning Department

Development Review Services Division

600 2nd St. NW, Suite 201

Albuquerque, NM 87102


t 505-924-3999

f 505-924-3864

NOTES FOR DRC Set:

• Make sure sidewalk
culvert is built to
drains towards pond.

• South SD is fully detailed
• Landscaping plan needs
to show first flush.

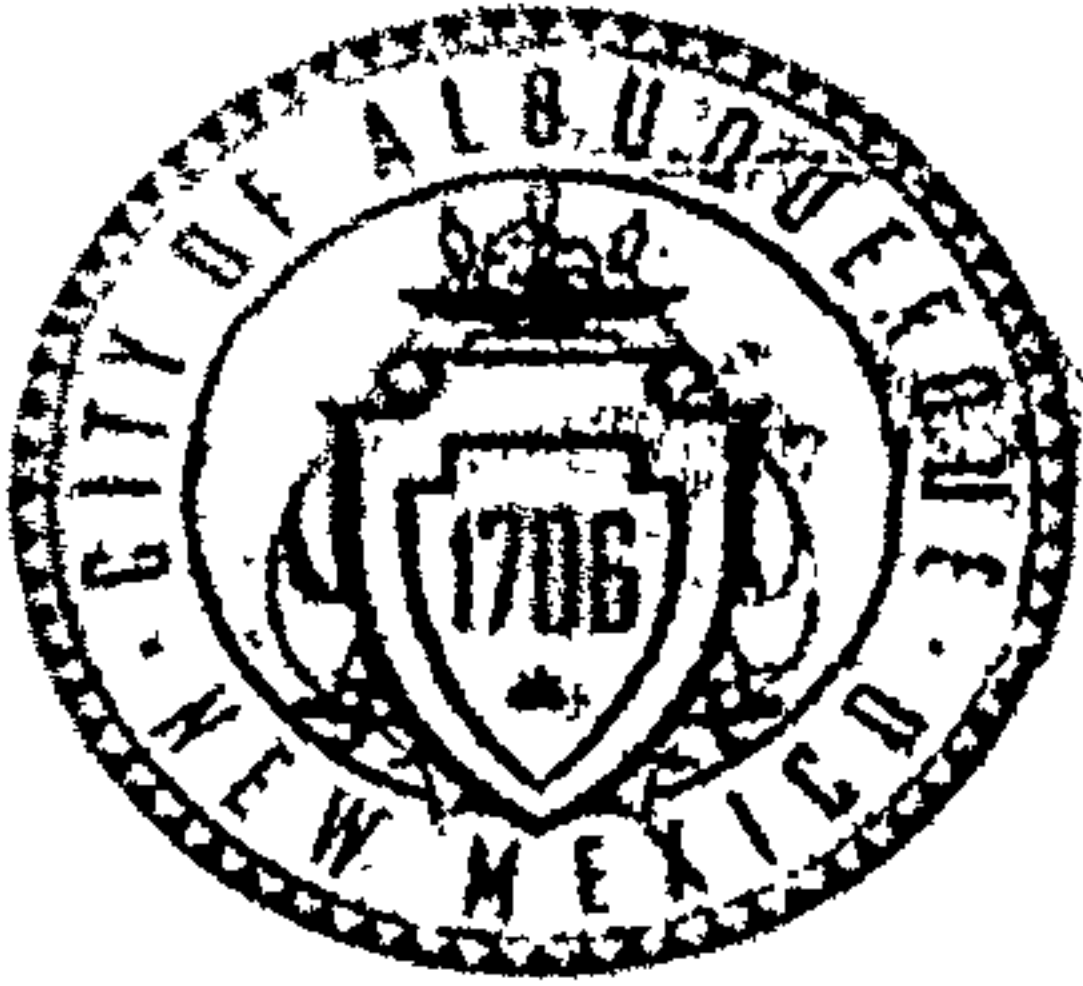

City of Albuquerque

Planning Department

Development & Building Services Division

DRAINAGE AND TRANSPORTATION INFORMATION SHEET (REV 09/2015)

Project Title: SILVER OAK SUBDIVISION lot 6 Building Permit #: _____ City Drainage #: C18D101
DRB#: 1010644 EPC#: _____ Work Order#: _____
Legal Description: SILVER OAKS
City Address: 8815 SILVER OAK

Engineering Firm: RIO GRANDE ENGINEERING Contact: DAVID SOULE
Address: PO BOX 93924, ALBUQUERQUE, NM 87199
Phone#: 505.321.9099 Fax#: 505.872.0999 E-mail: DAVID@RIOGRANDEENGINEERING.COM

Owner: SILVER OAK DEVELOPERS Contact: _____
Address: PO BOX 20688, ALB NM 87154
Phone#: _____ Fax#: _____ E-mail: _____

Architect: none Contact: _____
Address: _____
Phone#: _____ Fax#: _____ E-mail: _____

Other Contact: _____ Contact: _____
Address: _____
Phone#: _____ Fax#: _____ E-mail: _____

Check all that Apply:

DEPARTMENT:

☒ HYDROLOGY/ DRAINAGE
☐ TRAFFIC/ TRANSPORTATION
☐ MS4/ EROSION & SEDIMENT CONTROL

TYPE OF SUBMITTAL:

☒ ENGINEER/ ARCHITECT CERTIFICATION
☐ CONCEPTUAL G & D PLAN
☐ GRADING PLAN
☐ DRAINAGE MASTER PLAN
☐ DRAINAGE REPORT
☐ CLOMR/LOMR
☐ TRAFFIC CIRCULATION LAYOUT (TCL)
☐ TRAFFIC IMPACT STUDY (TIS)
☐ EROSION & SEDIMENT CONTROL PLAN (ESC)


☐ OTHER (SPECIFY) _____

IS THIS A RESUBMITTAL?: ☒ Yes ☐ No


DATE SUBMITTED: 9/12/16 By: _____

CHECK TYPE OF APPROVAL/ACCEPTANCE SOUGHT:

☒ BUILDING PERMIT APPROVAL
☐ CERTIFICATE OF OCCUPANCY
☐ PRELIMINARY PLAT APPROVAL
☐ SITE PLAN FOR SUB'D APPROVAL
☐ SITE PLAN FOR BLDG. PERMIT APPROVAL
☐ FINAL PLAT APPROVAL
☐ SIA/ RELEASE OF FINANCIAL GUARANTEE
☐ FOUNDATION PERMIT APPROVAL
☐ GRADING PERMIT APPROVAL
☐ SO-19 APPROVAL
☐ PAVING PERMIT APPROVAL
☐ GRADING/ PAD CERTIFICATION
☐ WORK ORDER APPROVAL
☐ CLOMR/LOMR
☐ PRE-DESIGN MEETING
☐ OTHER (SPECIFY) _____

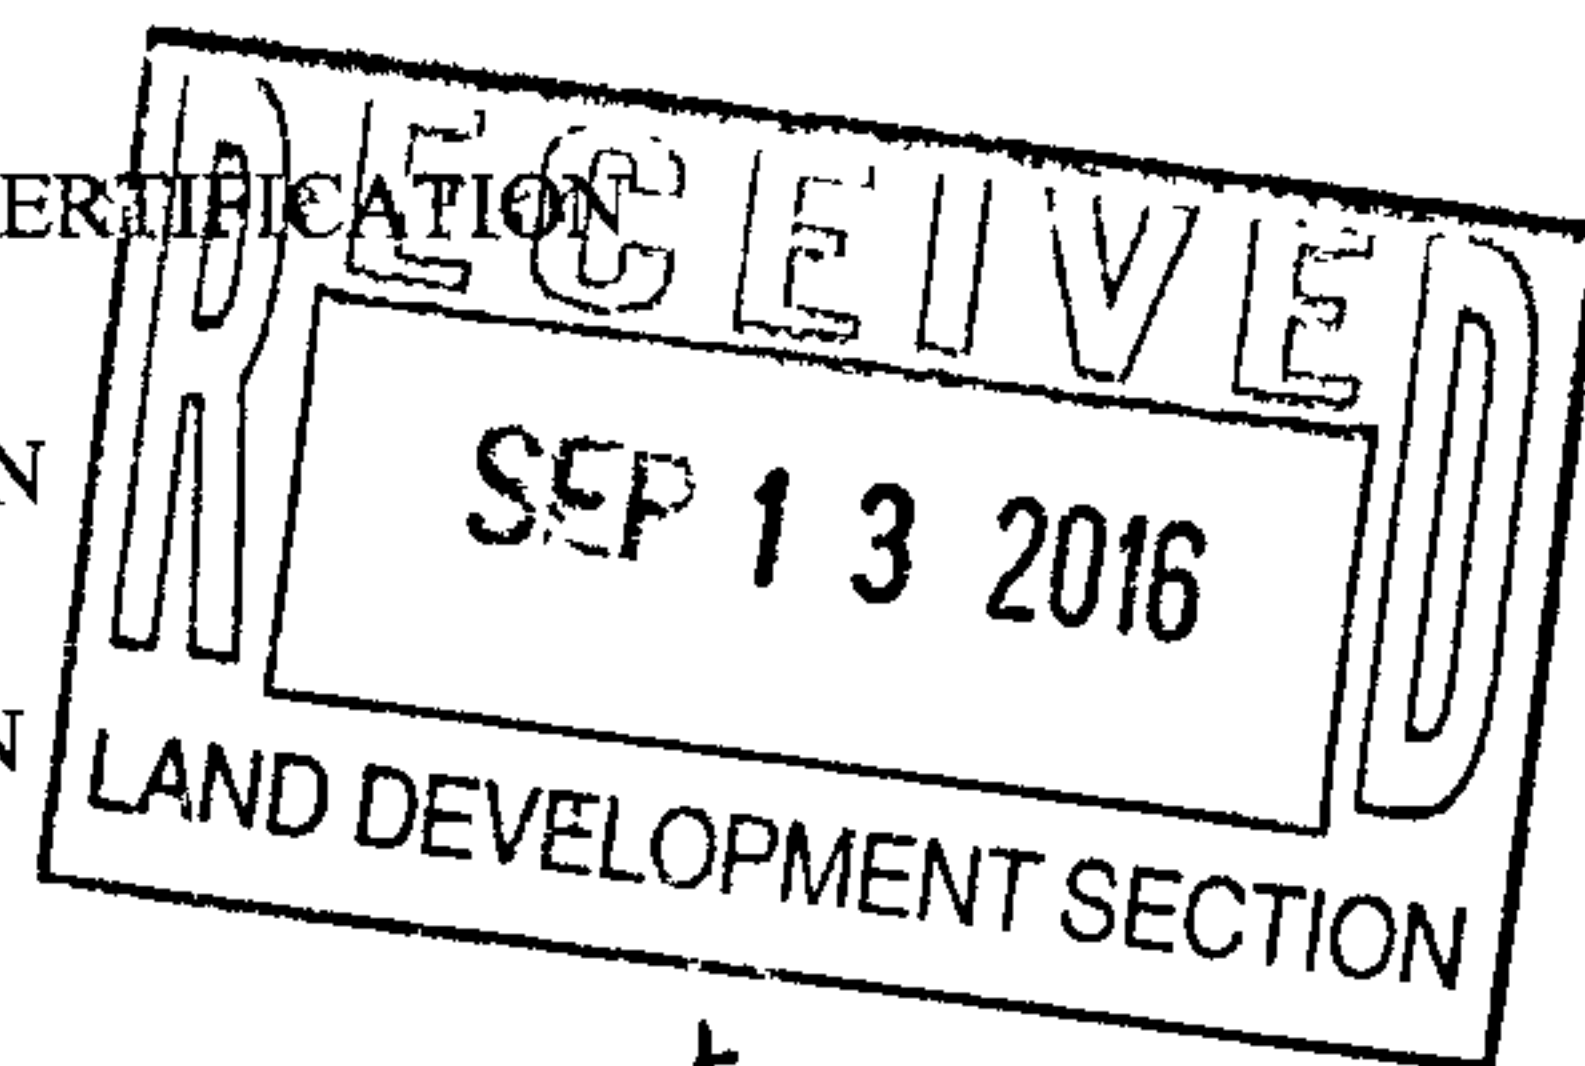

COA STAFF: _____ ELECTRONIC SUBMITTAL RECEIVED: _____

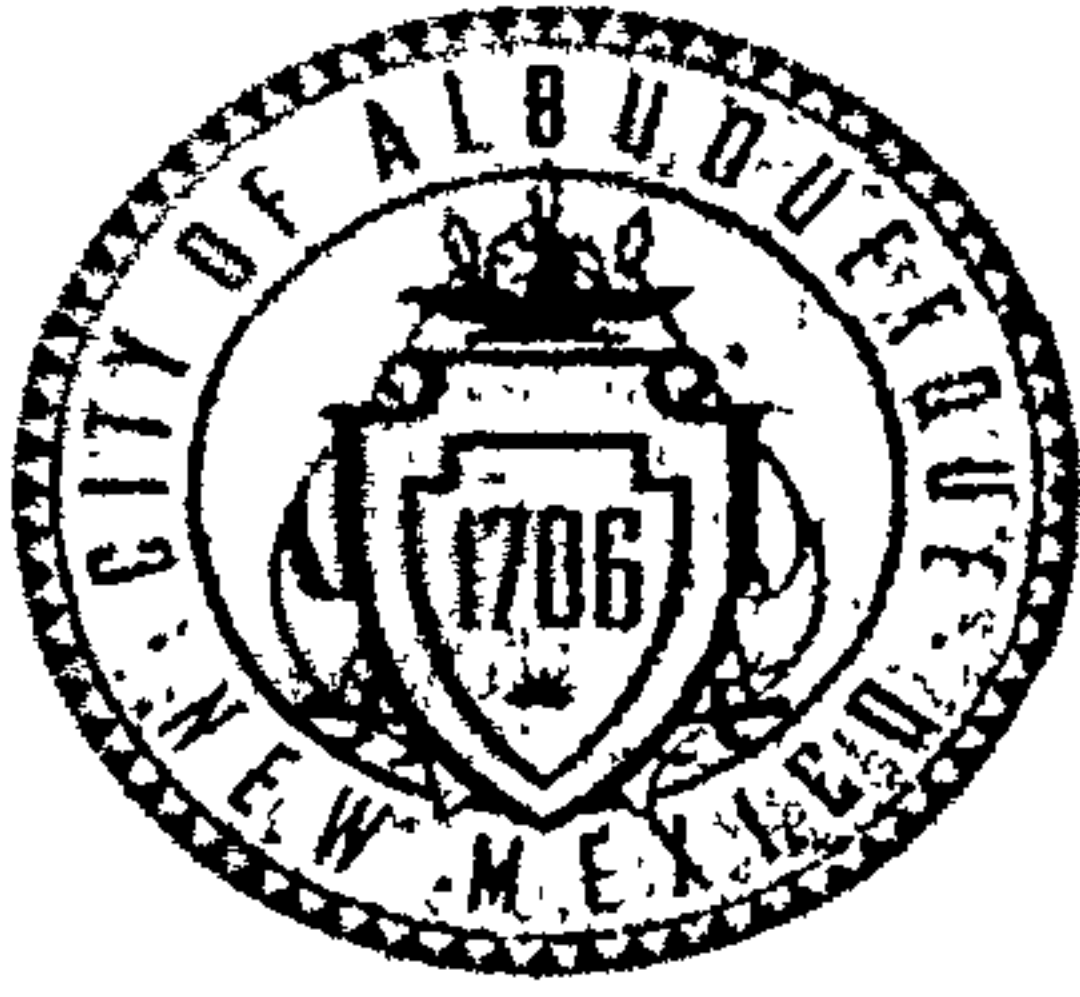

City of Albuquerque

Planning Department

Development & Building Services Division

DRAINAGE AND TRANSPORTATION INFORMATION SHEET (REV 09/2015)

Project Title: SILVER OAK SUBDIVISION Building Permit #: _____ City Drainage #: C18D101
DRB#: 1010644 EPC#: _____ Work Order#: _____
Legal Description: LOT 13,14,19,20 BLOCK 28, TRACT A, UNIT B ,NAA
City Address: OAKLAND NE

Engineering Firm: RIO GRANDE ENGINEERING Contact: DAVID SOULE
Address: PO BOX 93924, ALBUQUERQUE, NM 87199
Phone#: 505.321.9099 Fax#: 505.872.0999 E-mail: DAVID@RIOGRANDEENGINEERING.COM

Owner: SILVER OAK DEVELOPERS Contact: _____
Address: PO BOX 20688, ALB NM 87154
Phone#: _____ Fax#: _____ E-mail: _____

Architect: none Contact: _____
Address: _____
Phone#: _____ Fax#: _____ E-mail: _____

Other Contact: _____ Contact: _____
Address: _____
Phone#: _____ Fax#: _____ E-mail: _____

Check all that Apply:

DEPARTMENT:

- ☒ HYDROLOGY/ DRAINAGE
☐ TRAFFIC/ TRANSPORTATION
☐ MS4/ EROSION & SEDIMENT CONTROL

TYPE OF SUBMITTAL:

- ☐ ENGINEER/ ARCHITECT CERTIFICATION
☐ CONCEPTUAL G & D PLAN
☒ GRADING PLAN
☐ DRAINAGE MASTER PLAN
☐ DRAINAGE REPORT
☐ CLOMR/LOMR
☐ TRAFFIC CIRCULATION LAYOUT (TCL)
☐ TRAFFIC IMPACT STUDY (TIS)
☐ EROSION & SEDIMENT CONTROL PLAN (ESC)

☐ OTHER (SPECIFY) _____


IS THIS A RESUBMITTAL? ☒ Yes ☐ No

DATE SUBMITTED: 12/11/15 By: _____

CHECK TYPE OF APPROVAL/ACCEPTANCE SOUGHT:

- ☐ BUILDING PERMIT APPROVAL
☐ CERTIFICATE OF OCCUPANCY
☒ PRELIMINARY PLAT APPROVAL
☒ SITE PLAN FOR SUB'D APPROVAL
☐ SITE PLAN FOR BLDG. PERMIT APPROVAL
☐ FINAL PLAT APPROVAL
☐ SIA/ RELEASE OF FINANCIAL GUARANTEE
☐ FOUNDATION PERMIT APPROVAL
☒ GRADING PERMIT APPROVAL
☐ SO-19 APPROVAL
☐ PAVING PERMIT APPROVAL
☐ GRADING/ PAD CERTIFICATION
☐ WORK ORDER APPROVAL
☐ CLOMR/LOMR


☐ PRE-DESIGN MEETING
☐ OTHER (SPECIFY) _____

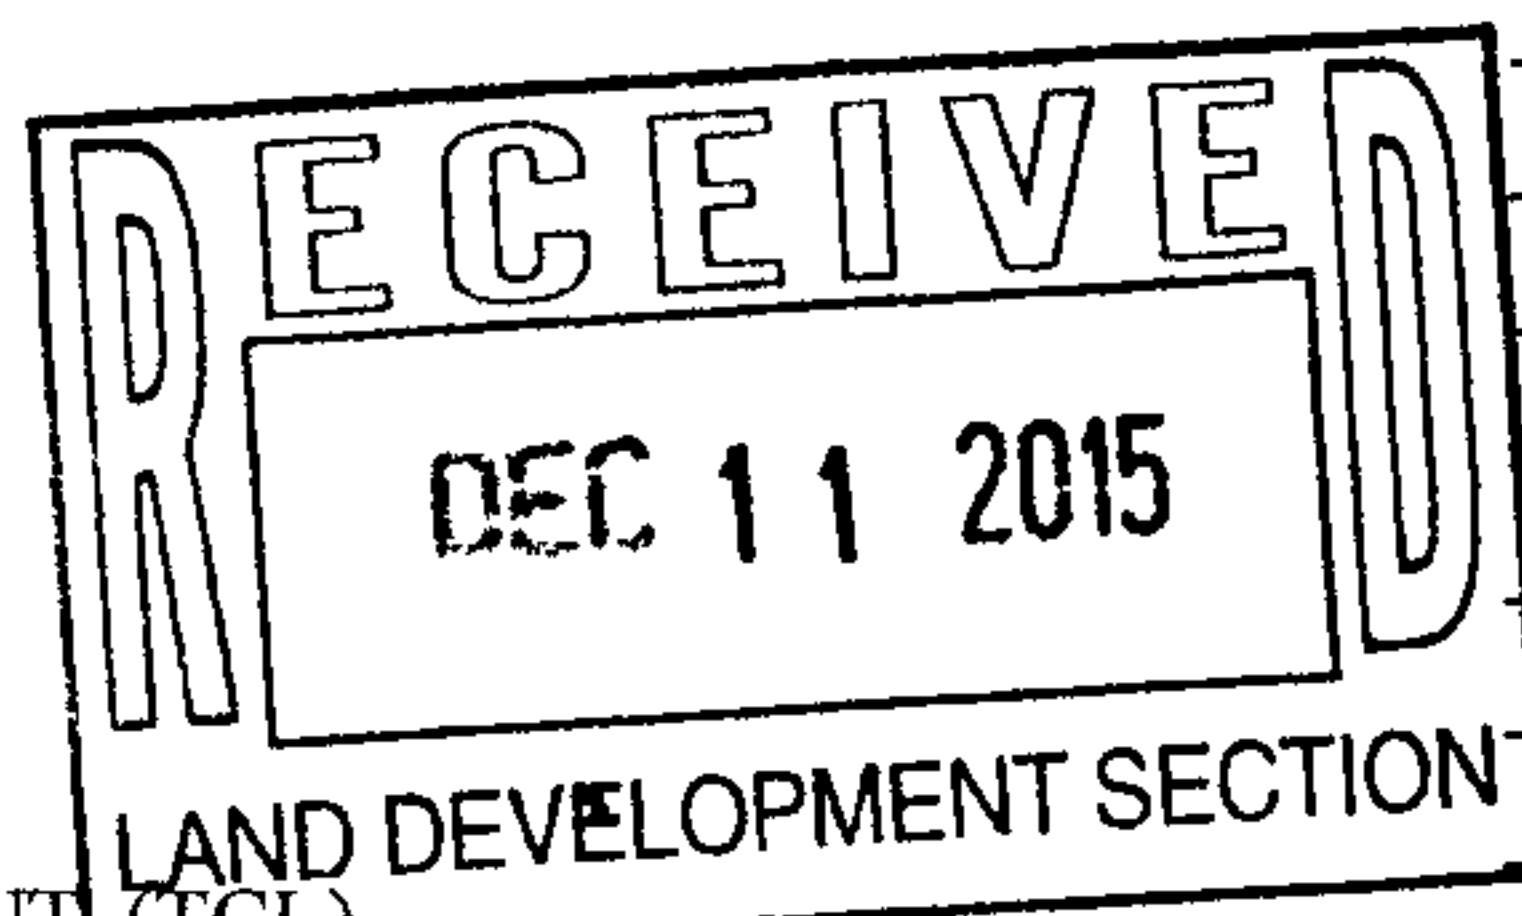

COA STAFF ELECTRONIC SUBMITTAL RECEIVED _____

EROSION CONTROL NOTES:

1. CONTRACTOR IS RESPONSIBLE FOR OBTAINING A TOPSOIL DISTURBANCE PERMIT PRIOR TO BEGINNING WORK.
2. CONTRACTOR IS RESPONSIBLE FOR MAINTAINING RUN-OFF ON SITE DURING CONSTRUCTION
3. CONTRACTOR IS RESPONSIBLE FOR CLEANING ALL SEDIMENT THAT GETS INTO EXISTING RIGHT-OF-WAY
4. REPAIR OF DAMAGED FACILITIES AND CLEANUP OF SEDIMENT ACCUMULATIONS ON ADJACENT PROPERTIES AND IN PUBLIC FACILITIES IS THE RESPONSIBILITY OF THE CONTRACTOR
5. ALL EXPOSED EARTH SURFACES MUST BE PROTECTED FROM WIND AND WATER EROSION PRIOR TO FINAL ACCEPTANCE OF ANY PROJECT

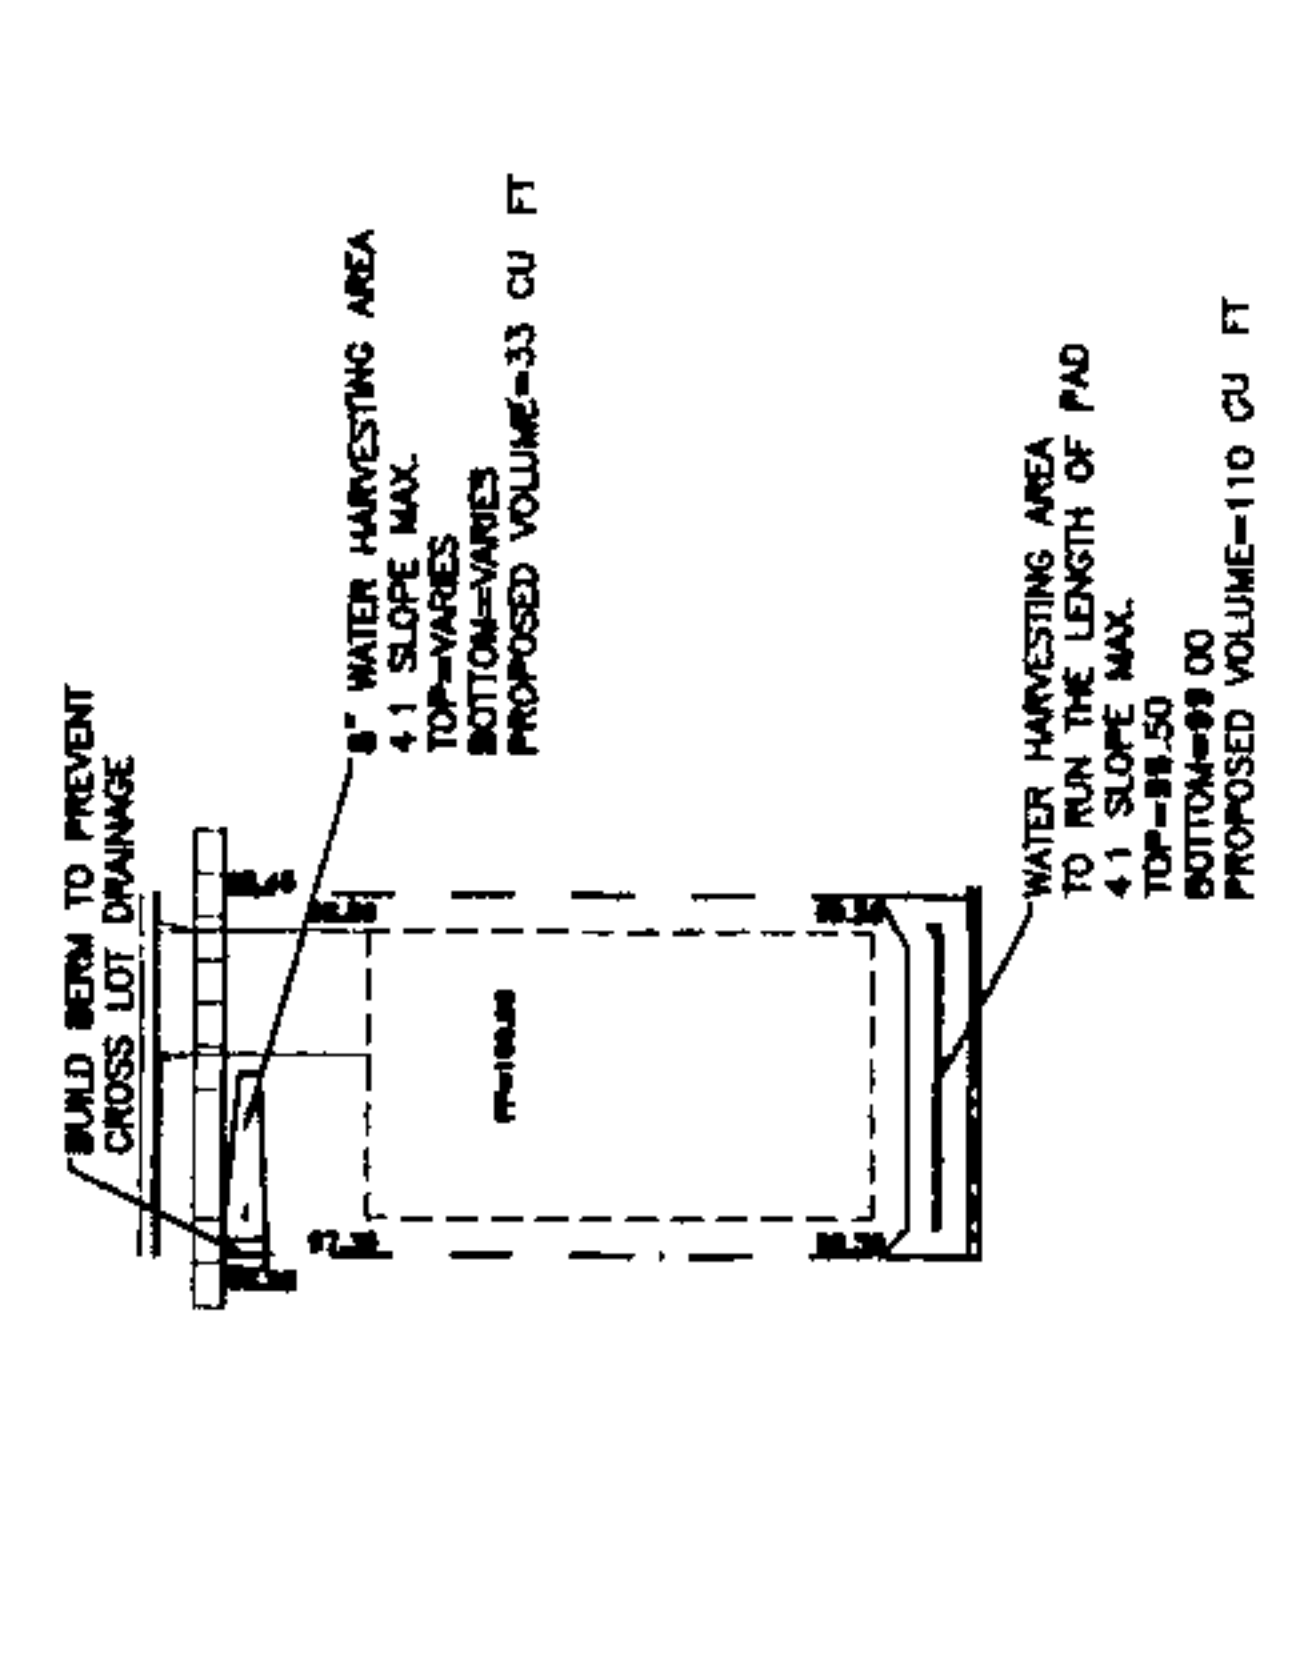

TYPICAL WATER HARVESTING AREAS


LEGAL DESCRIPTION:
LOTS 13, 14, 19, 20, BLK 28, TR A, UNIT B, NORTH ALBUQUERQUE ACRES

NOTES:
1 ALL SPOT ELEVATIONS REPRESENT FLOWLINE ELEVATION UNLESS OTHERWISE NOTED


LEGEND

EXISTING CURB
 EXISTING INDEX CONTOUR
 PROPOSED INDEX CONTOUR
 3:1 SLOPE TIE MAX.
 EXISTING SPOT ELEVATION
 PROPOSED SPOT ELEVATION
 BOUNDARY
 PROPOSED LOT LINE
 RIGHT-OF-WAY
 PROPOSED CURB AND GUTTER
 EXISTING CURB
 PROPOSED SCREEN WALL
 PROPOSED RETAINING WALL
 DESIGN BY OTHERS


4048.25
 X

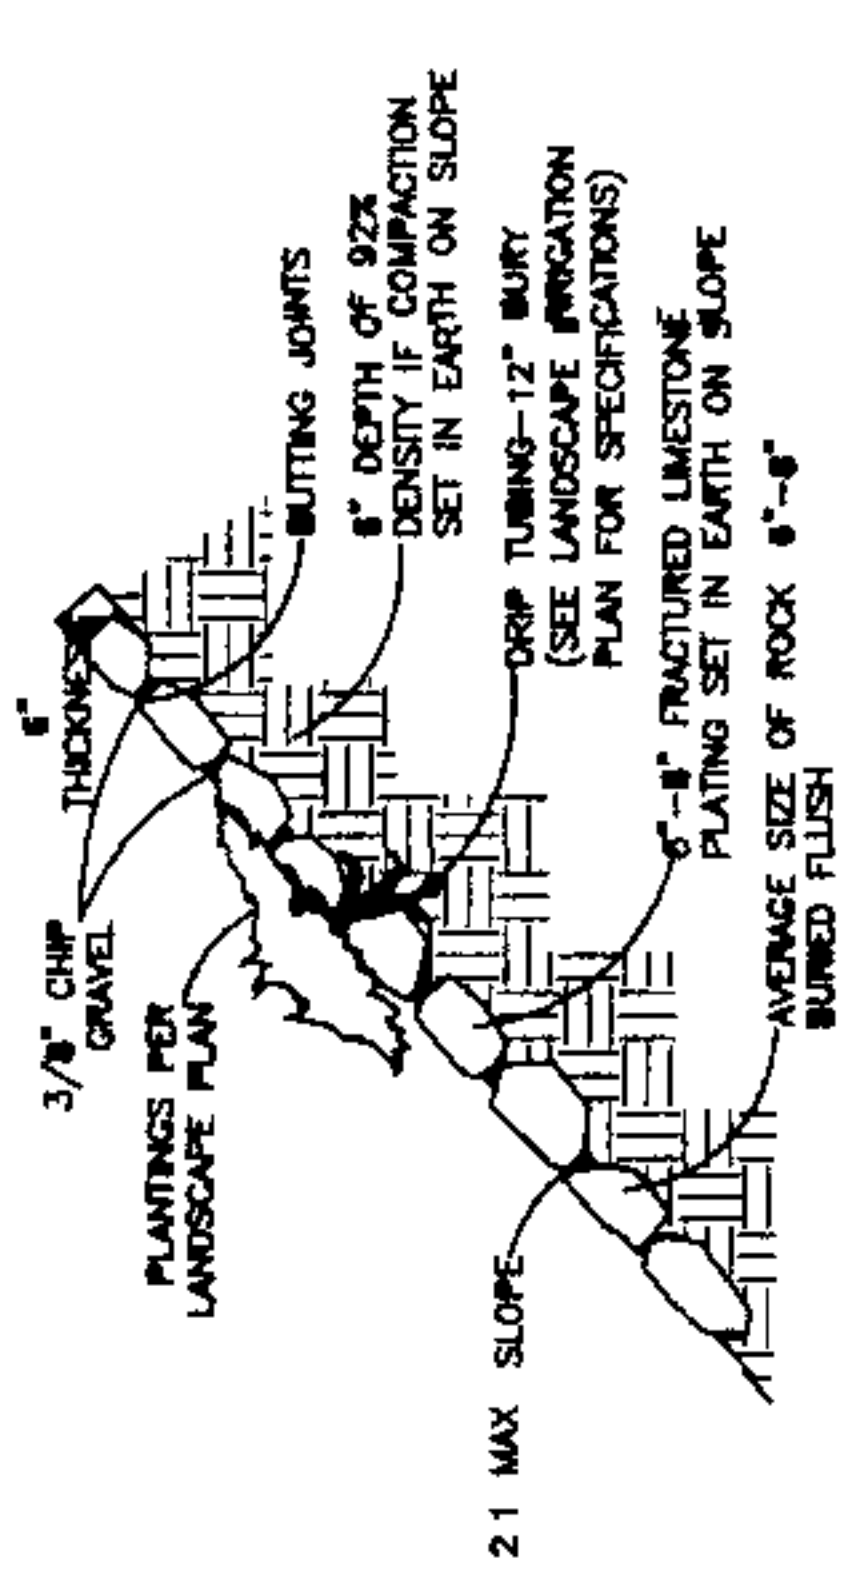


ROCK PLATING DETAIL
NTS

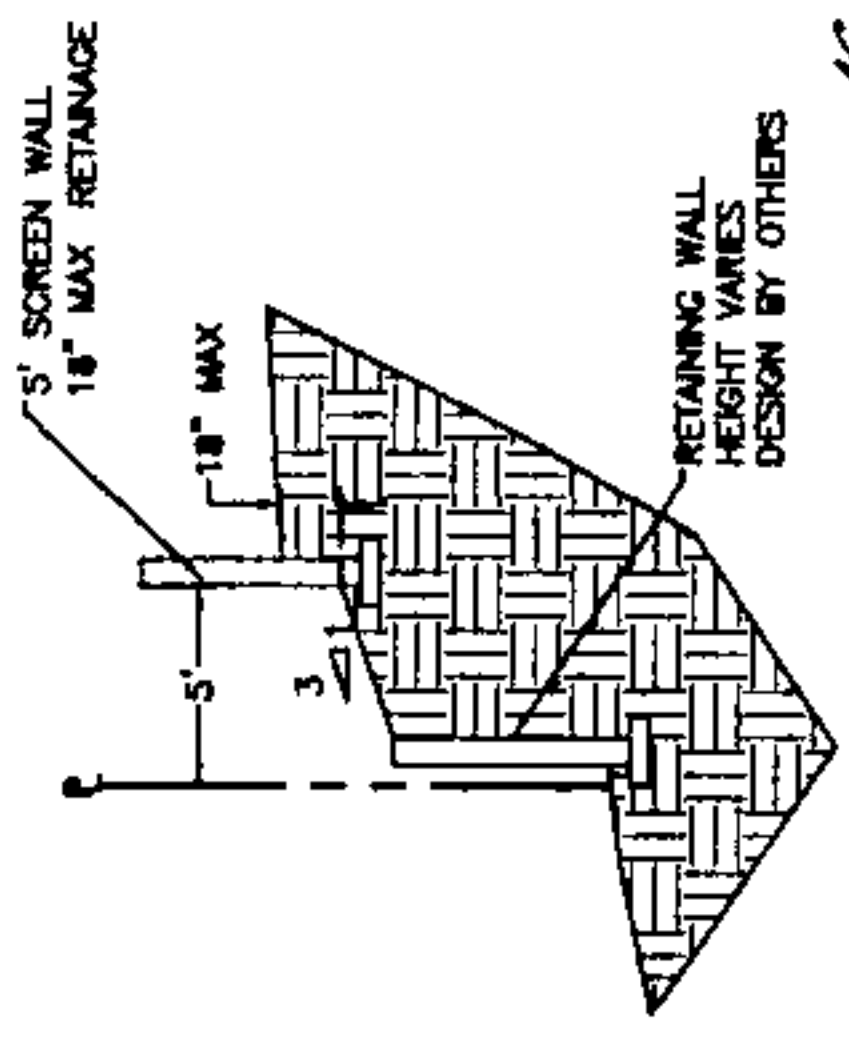

SECTION A-A
NTS

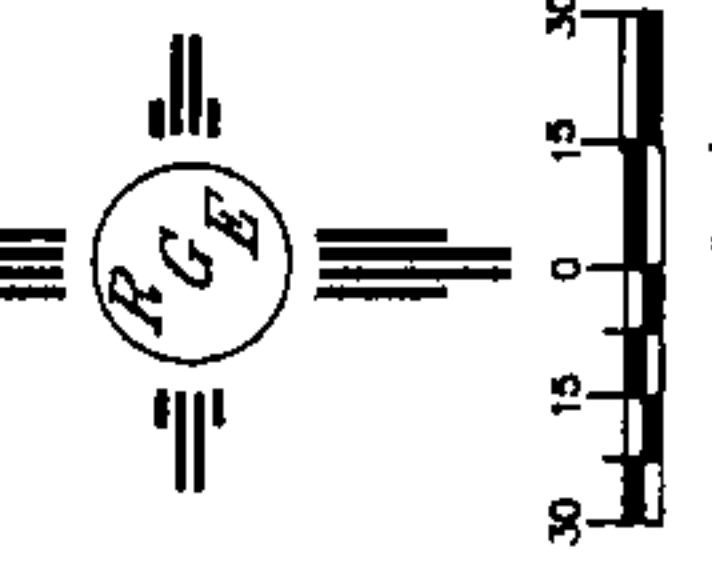

ENGINEER'S SEAL		SILVEROAK ESTATES GRADING AND DRAINAGE PLAN	 <i>Rio Grande</i> <i>Engineering</i> 1700 CENTRAL AVENUE SUITE 201 ALBUQUERQUE, NM 87104 PHONE (505) 275-1000	SHEET # 3	JOB # 215525
				DRAWN BY MCM/ DATE 12-11-15 PENDING - LAYOUT - 12-15-15	
DANAO SOLE P.E. #14322					

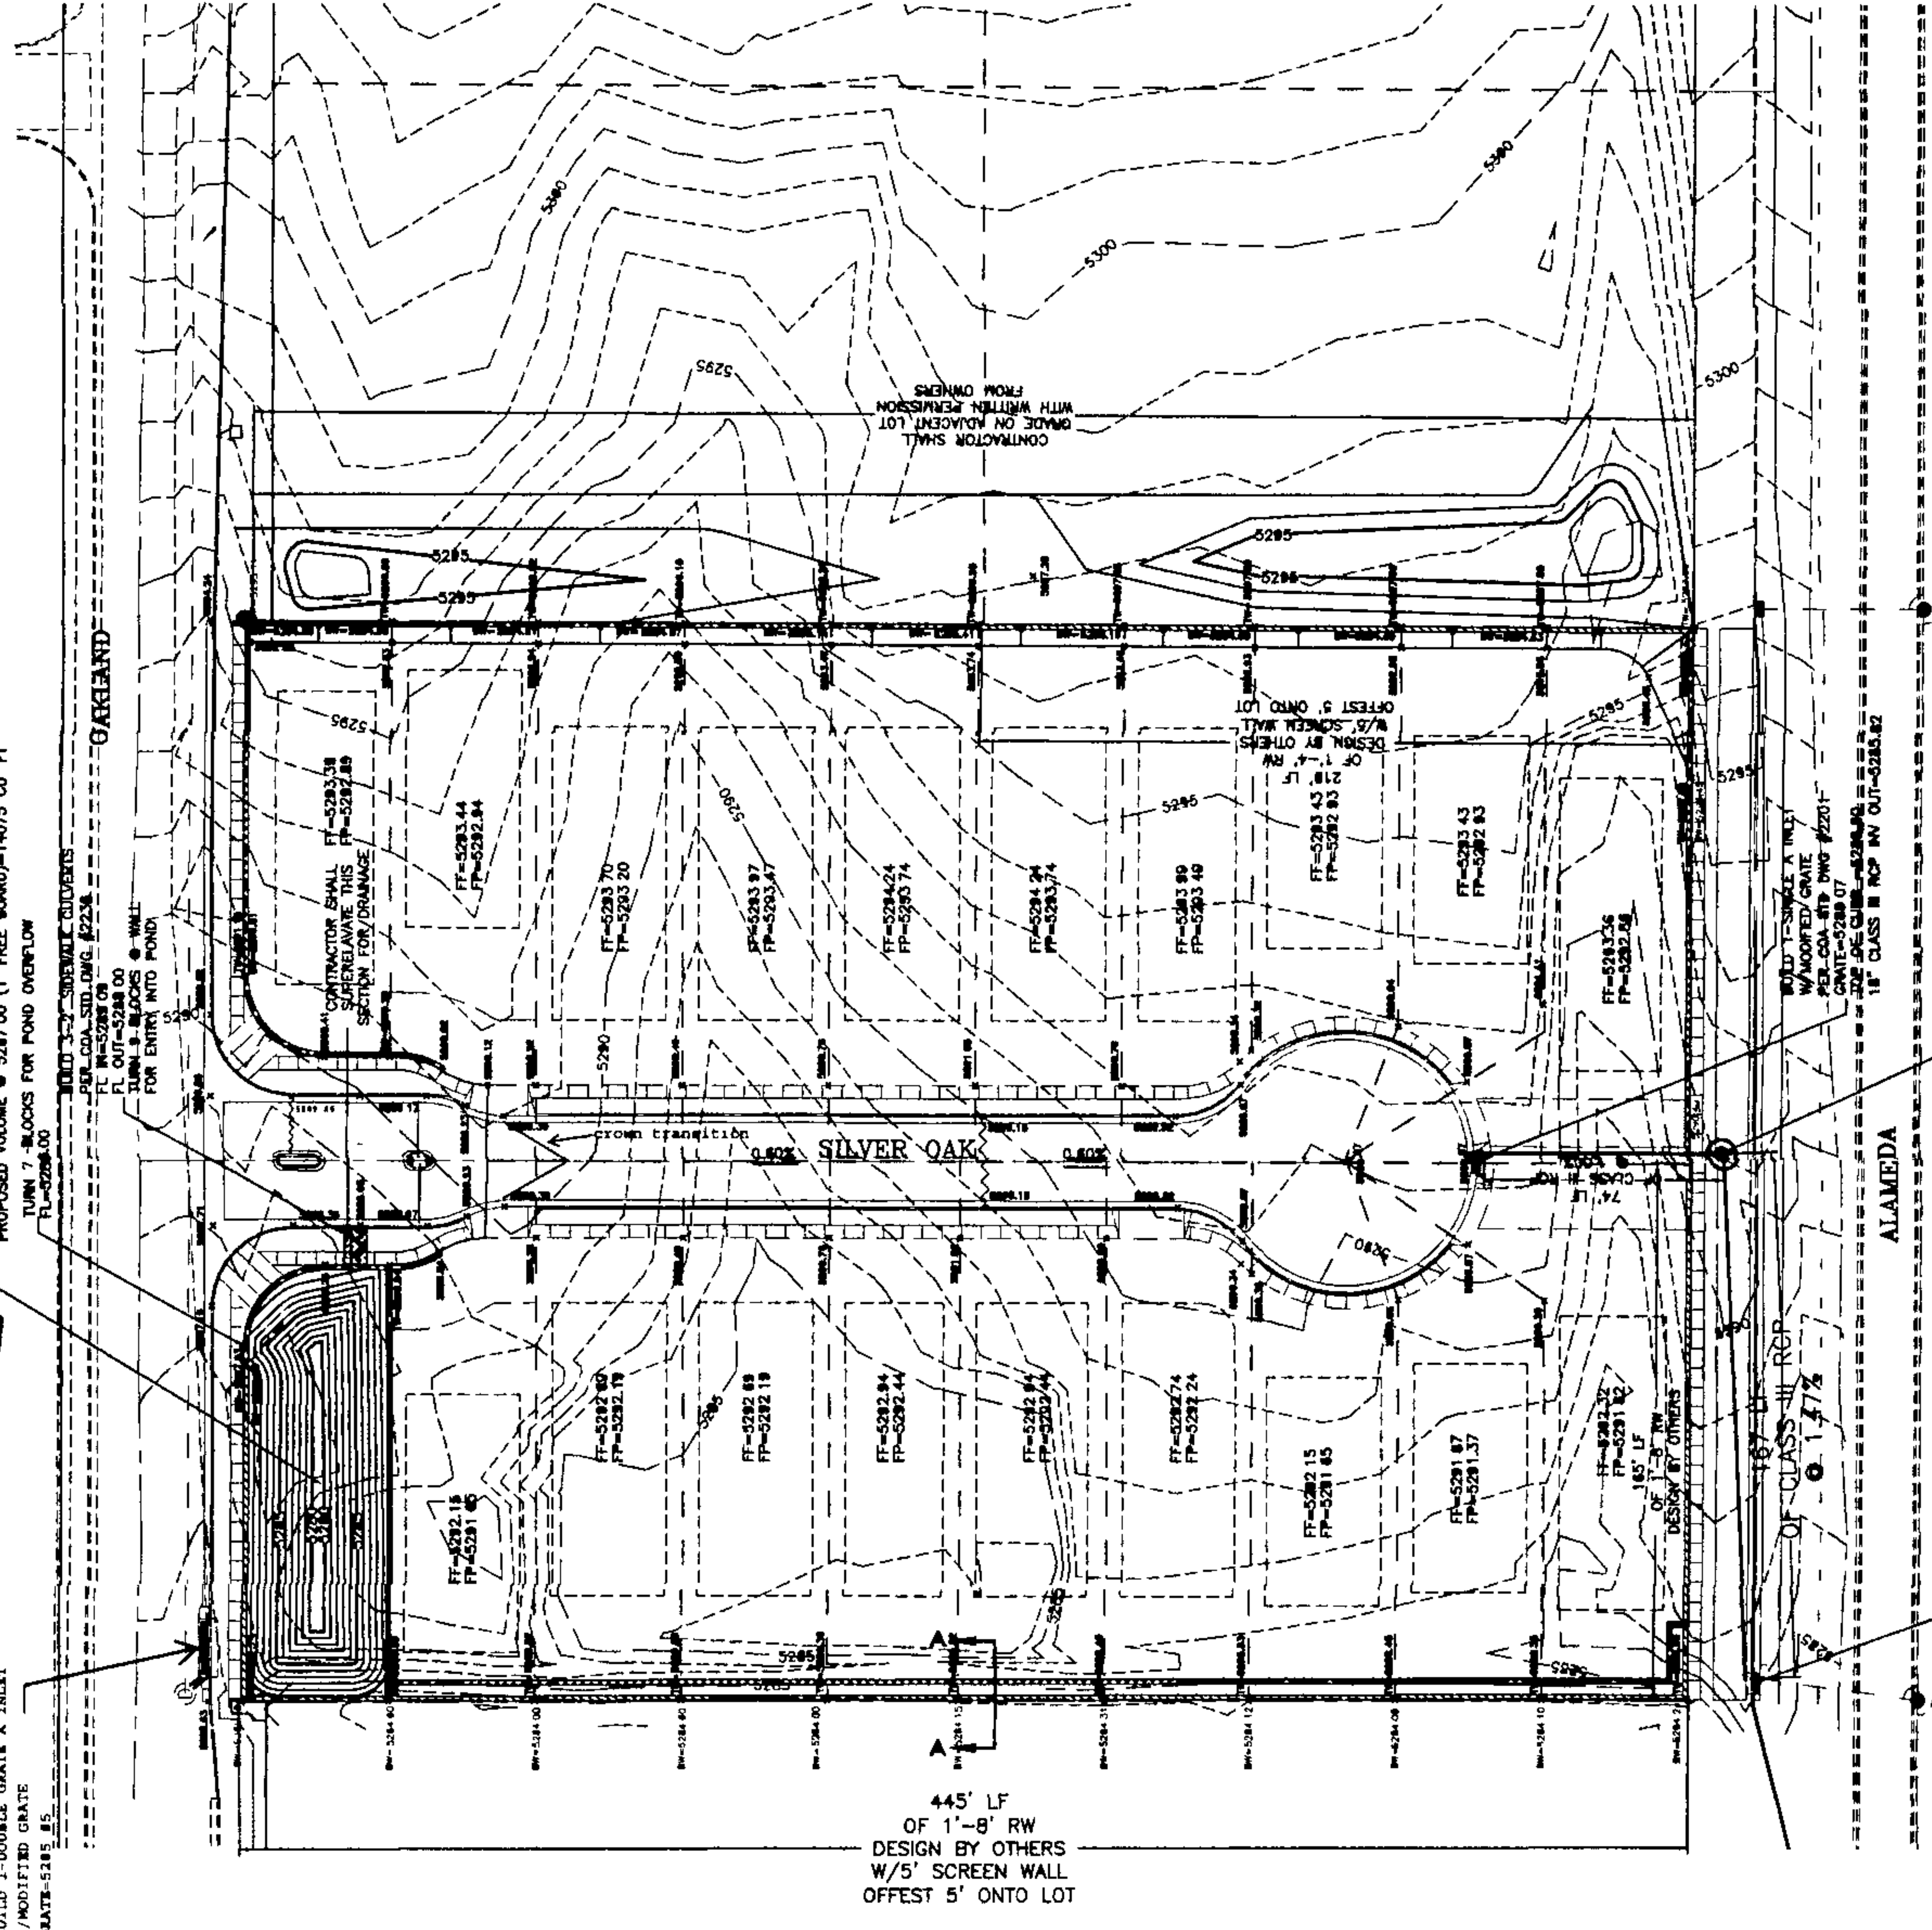

CAUTION: EXISTING UTILITIES ARE NOT SHOWN. THE CONTRACTOR TO CONDUCT ALL NECESSARY FIELD INVESTIGATIONS PRIOR TO ANY EXCAVATION TO DETERMINE THE LOCATION OF UTILITIES & OTHER IMPROVEMENTS.

December 11, 2015


Abiel Carrillo, PE
Principal Engineer, Planning Department
City of Albuquerque
600 2nd street NW
Albuquerque, NM 87102

**RE: Drainage Resubmittal
Silver Oak Subdivision- (C18D101)
Albuquerque, New Mexico**

Dear Mr. Carrillo:

Rio Grande Engineering requests approval of the enclosed grading plan in support of the proposed site plan for subdivision, preliminary plat, vacation of right of way and deferral of internal sidewalks. The submittal has been revised to address the your comments dated December 32, 2015. The following is a summary of the comment and an explanation as to how it was addressed.

1. Clarify easement dimensions between cul-de-sac and Alameda
We have corrected the preliminary plat. There are three easements, one is a 20' private drainage easement on the east, a 20' public water line is on the west and a 10' private access easement straddles the two. The access easement is for pedestrian connectivity to alameda. It also serves as an emergency overflow.
2. The inlet at the cul-de-sac conflicts with access to southern lots
We have reduced the inlet to a single A, the inlet is in sump and has double the capacity. This inlet calculation has been included. We have shown the driveways to confirm the geometry
3. Correct low spot at entrance
We have provided a transition for super elevated roadway to provide water block to Oakland as well as allowing onsite water to be captured by the temporary pond. The detailed road profiles and median flow lines at DRC will assure proper flow. We have eliminated the low spot.
4. Inlets in Oakland and Alameda shall have build notes. The plans and report need to be consistent. The location needs to account for Alameda ultimate section
We have added the build notes and corrected plan to conform to the report. The proposed inlet in Alameda is being placed where an existing stub was constructed. The inlet is being placed at the ultimate curb location.
5. Show emergency overflow
We have modified the contours to identify the overflow. We have labeled the turned blocks at the wall. Since this is an emergency overflow for a temporary pond we are not proposing culverts. We have included the capacity calculation for each turned block. The pond inflow is 6.89 cfs and each turned block has a capacity of 1.04.
6. Call out wall opening
We have placed build notes for the wall openings.
7. Show elevation points at rear yard pond, landscape plan should show front yard pond
We have added a typical section for the rear yard and front yard ponds. To add points to grading plan will make the document illegible. We have added pond to the landscape plans

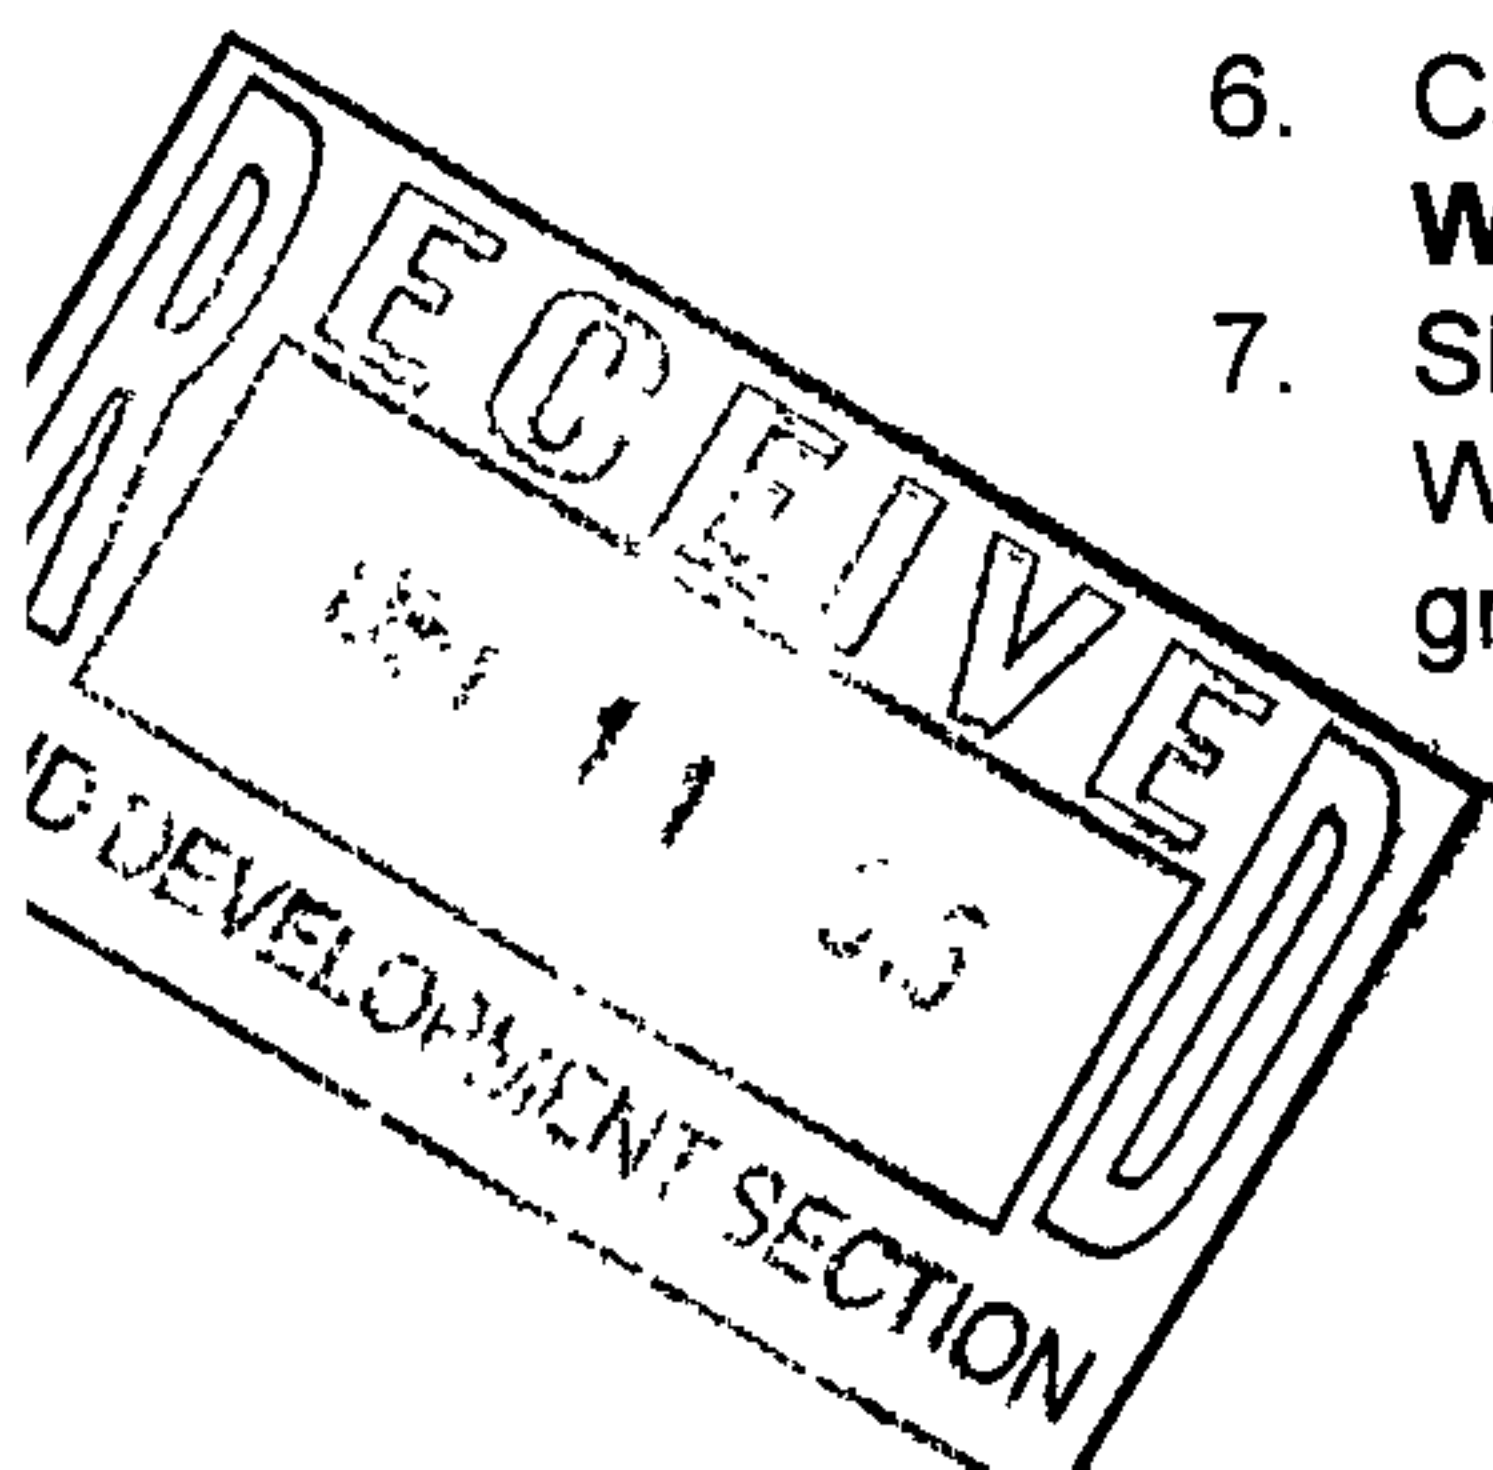

6K


8. Show calculations that provide 95 cubic feet for first flush volume
We have enclosed the end area calculation for each rear yard pond. The front yard ponds provide additional volume.

It is out intent to modify the plans to address your comments. Should you have any questions regarding this matter, please do not hesitate to call me.


Sincerely,

David Soule, PE
RIO GRANDE ENGINEERING
PO Box 93924
ALBUQUERQUE, NM 87199
321-9099

Enclosures

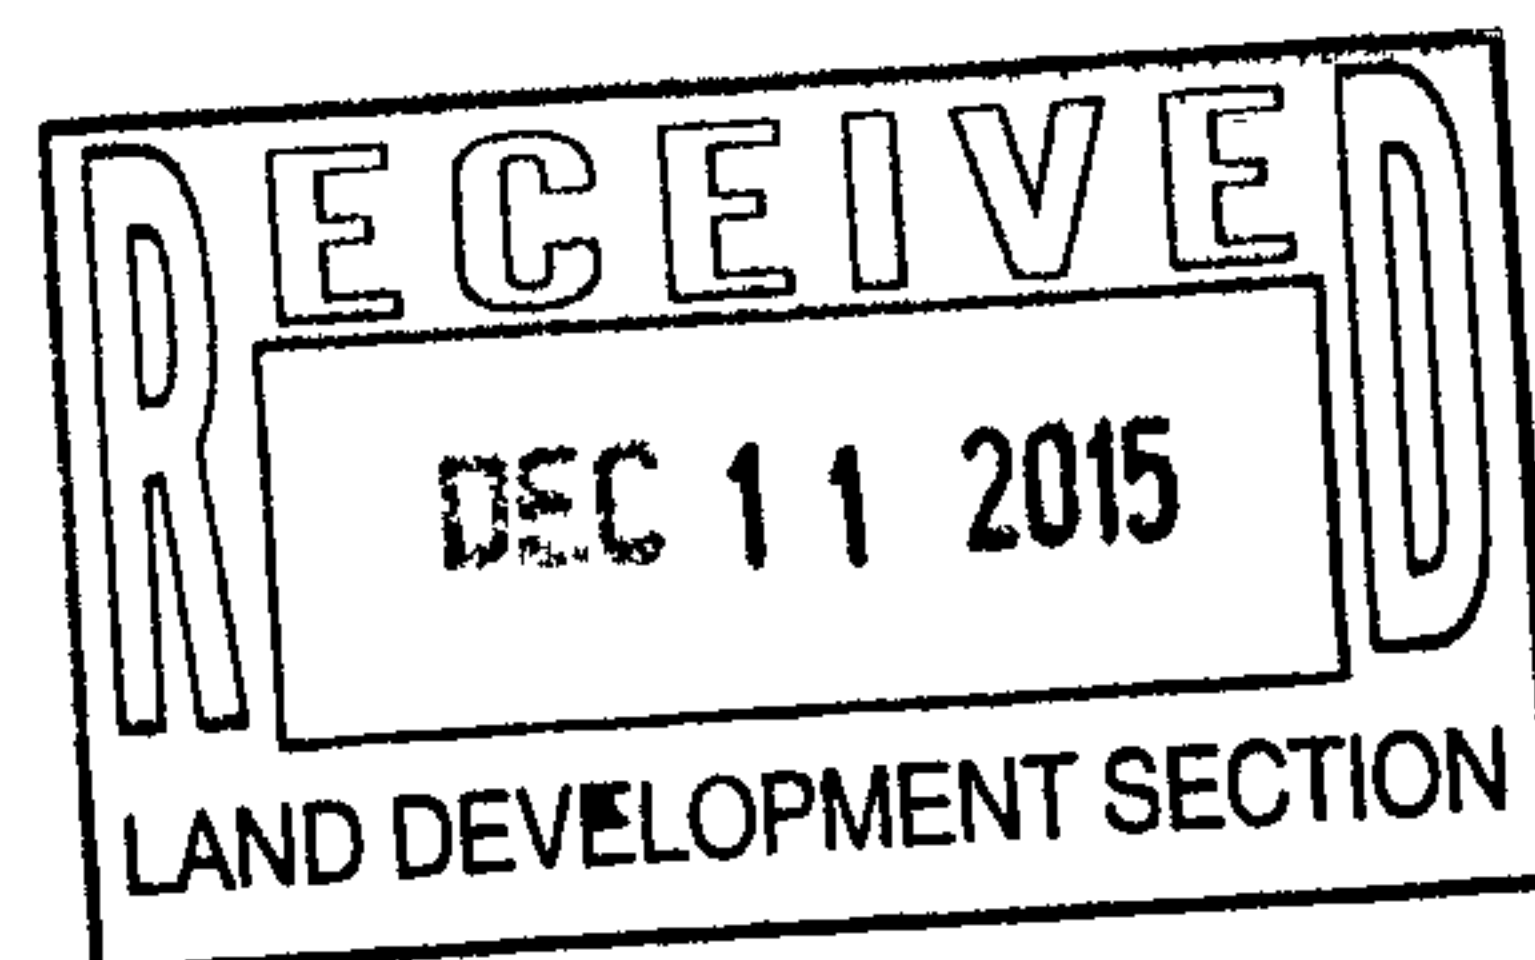

CITY OF ALBUQUERQUE

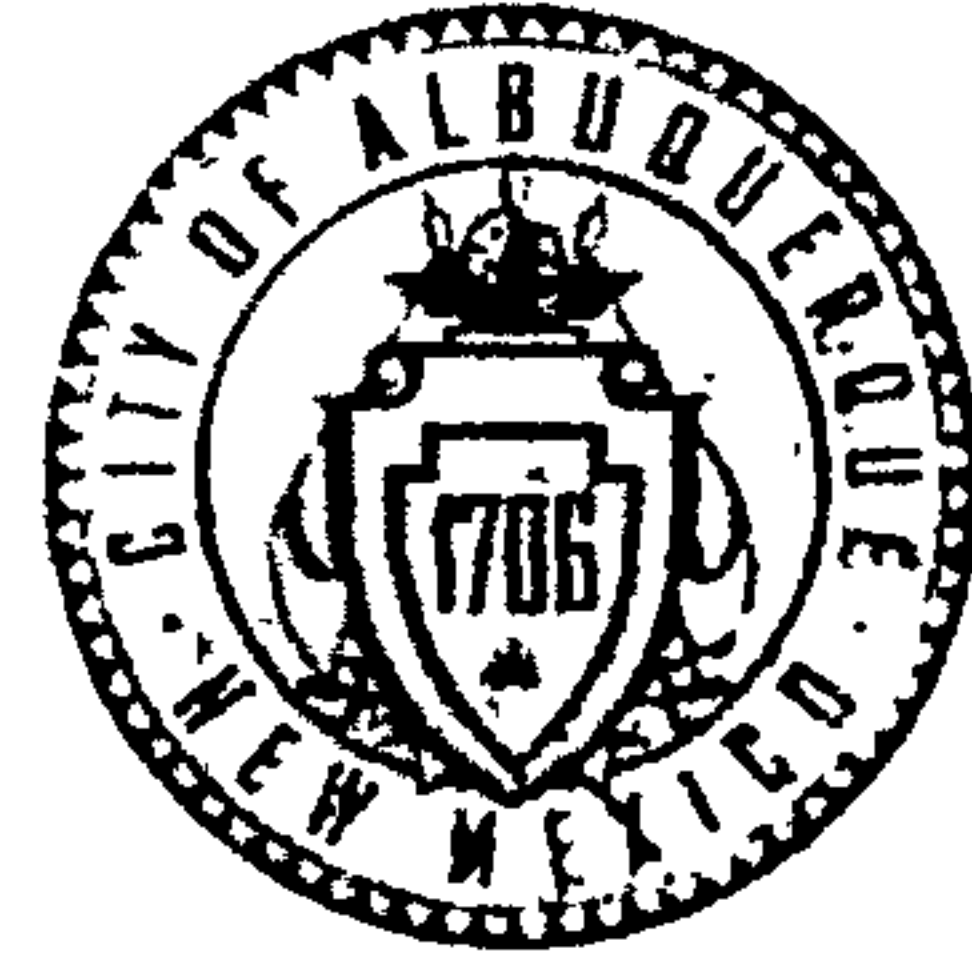

December 3, 2015

Richard J. Berry, Mayor

David Soule, P.E.
Silver Oak Estates
1606 Central Avenue Suite 201
Albuquerque, NM, 87106

RE: Silver Oak Estates | Grading and Drainage Plan | Stamp 10-21-15 (File: C18D101)

Dear Mr. Soule:

Based upon the information provided in your submittal received 10/28/2015, and information discussed at the December 2, 2015 Development Review Board Meeting, the Site Plan for Subdivision cannot be approved until the following comments are addressed:

1. Clarify the easement dimensions between the cul-de-sac and Alameda Blvd. The Utility Plan shows a different layout than the Site/Grading Plan.
2. The inlet at the end of the cul-de-sac bulb appears to conflict with the intent to have an access easement to the southernmost lots.
3. At the entrance, there is a low spot on the northbound side curb and gutter; it appears that the intent is to convey flows west into the temporary pond. The plan should clarify to the Contractor that the crown of the road is to be warped so as not to create a sump.
4. The inlets on Oakland and Alameda should have build notes
 - a. The inlet on Alameda is referenced as a single grate Type D inlet to capture flows at the flowline of the roadside swale, but shown differently on the plan. Furthermore, this inlet and pipe needs to be planned with the future expanded section of Alameda Blvd in mind.
5. Show the emergency spillway for the pond as referenced in the drainage report.
6. Call out the wall opening that will be needed to convey flows into the pond.
7. Show elevation points at the rear lots that show the intent to install rear lot ponds.
 - a. The rear and front yard ponds and typical lot layout showing the first flush ponds should also be shown on the landscaping sheets, since it appears that the fine grading of those facilities might be completed with the installation of graveling and plantings, not with the grading of the lots.
8. Show the calculation that arrives at the 95 cubic foot volume for the first flush management on the worksheet in the Appendix.

PO Box 1293

Albuquerque

New Mexico 87103

www.cabq.gov

If you have any questions, you can contact me at 924-3986.

Sincerely,

Abiel Carrillo, P.E.
Principal Engineer, Planning Dept.
Development Review Services
Orig: Drainage file



DROP INLET CALCULATIONS

Inlet	TYPE OF INLET	AREA (SF)	Q (CFS)	H (FT)	H ALLOW (FT)
culdesac	SINGLE	4.43	13.74	0.4149	0.67

ORIFICE EQUATION

$$Q = CA \sqrt{2gH} \quad H = (Q/CA)^2 / 2G$$

$$C = 0.6$$

$$g = 32.2$$

INLET GRATE=40"X25"

CALCULATE FOR BARS


40-(11*.5) 34.5"

25-(13*.5) 18.5"

OPENING IS 4.43 SF PER GRATE

USING DOUBLE FLOW DUE TO SUMP

100-YEAR, 6-HOUR STORM DISCHARGE IS 6.87 CFS

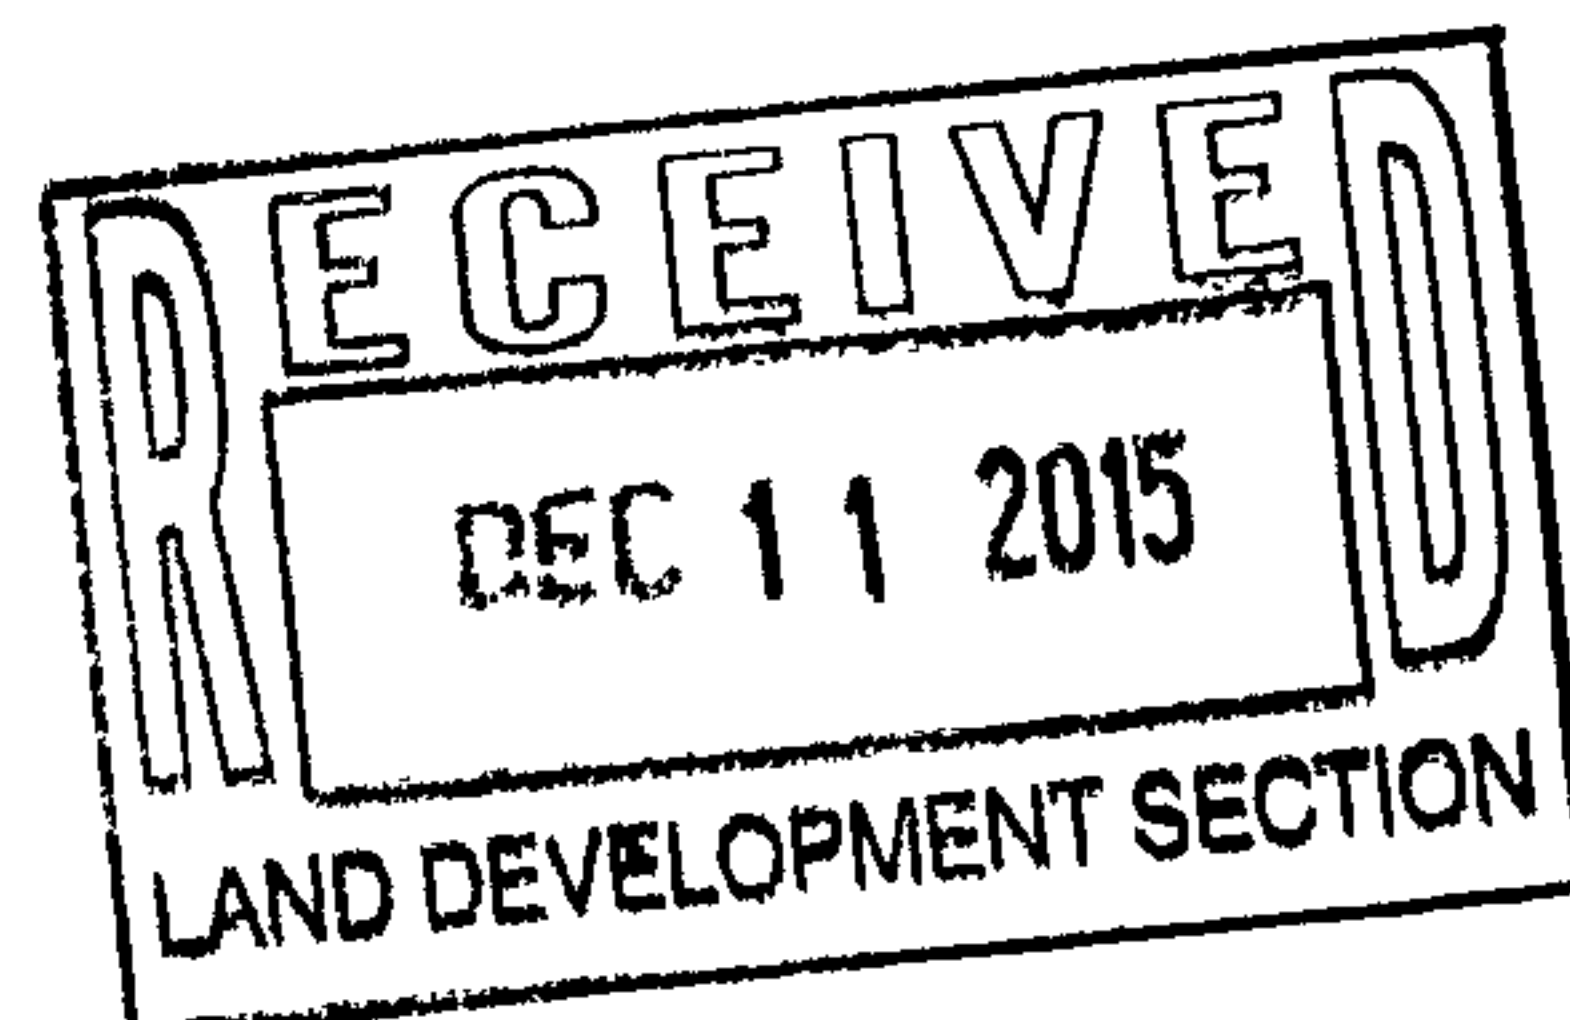


POND VOLUME CALCULATION

TOP WIDTH 15' X 30' = 450
BOTTOM WIDTH 10' X 25' = 250

AVERAGE AREA = 350
DEPTH = .5
VOLUME = AREA X DEPTH = 175 CF

DUE TO LANDSCAPING AND CONTRACTOR ALLOWANCES, WE FEEL THE
175 CF SHOWN WILL AMOUNT TO ATLEAST POST CONSTRUCTION

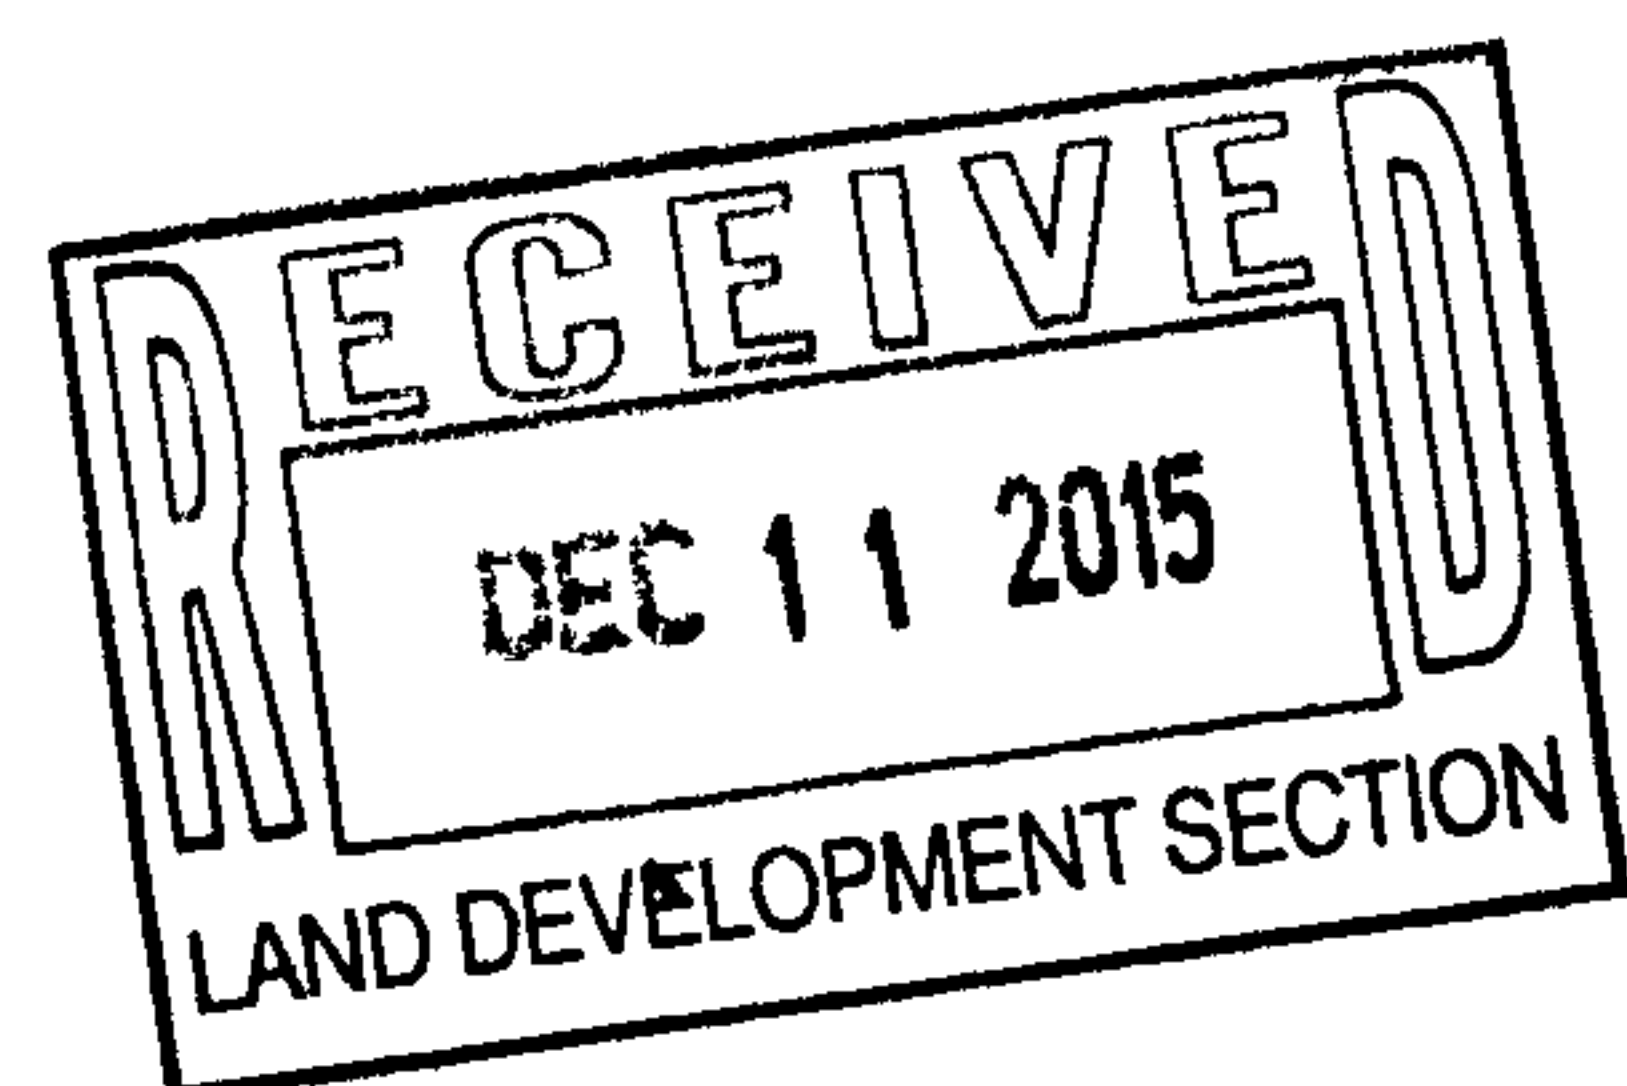

TURNED BLOCKS

Weir Equation:

$$Q = CLH^{3/2}$$

~~Q = 2.92 cfs~~

Q = 2.92 cfs

C = 2.95

H = 0.5 ft

L = Length of weir


$$Q = 2.95 * .5 * ((0.5)^{(3/2)})$$

Each opening is 6"x6"


Each block has two openings

Each opening has .52 cfs capacity

Each turned block has 1.04 cfs capacity

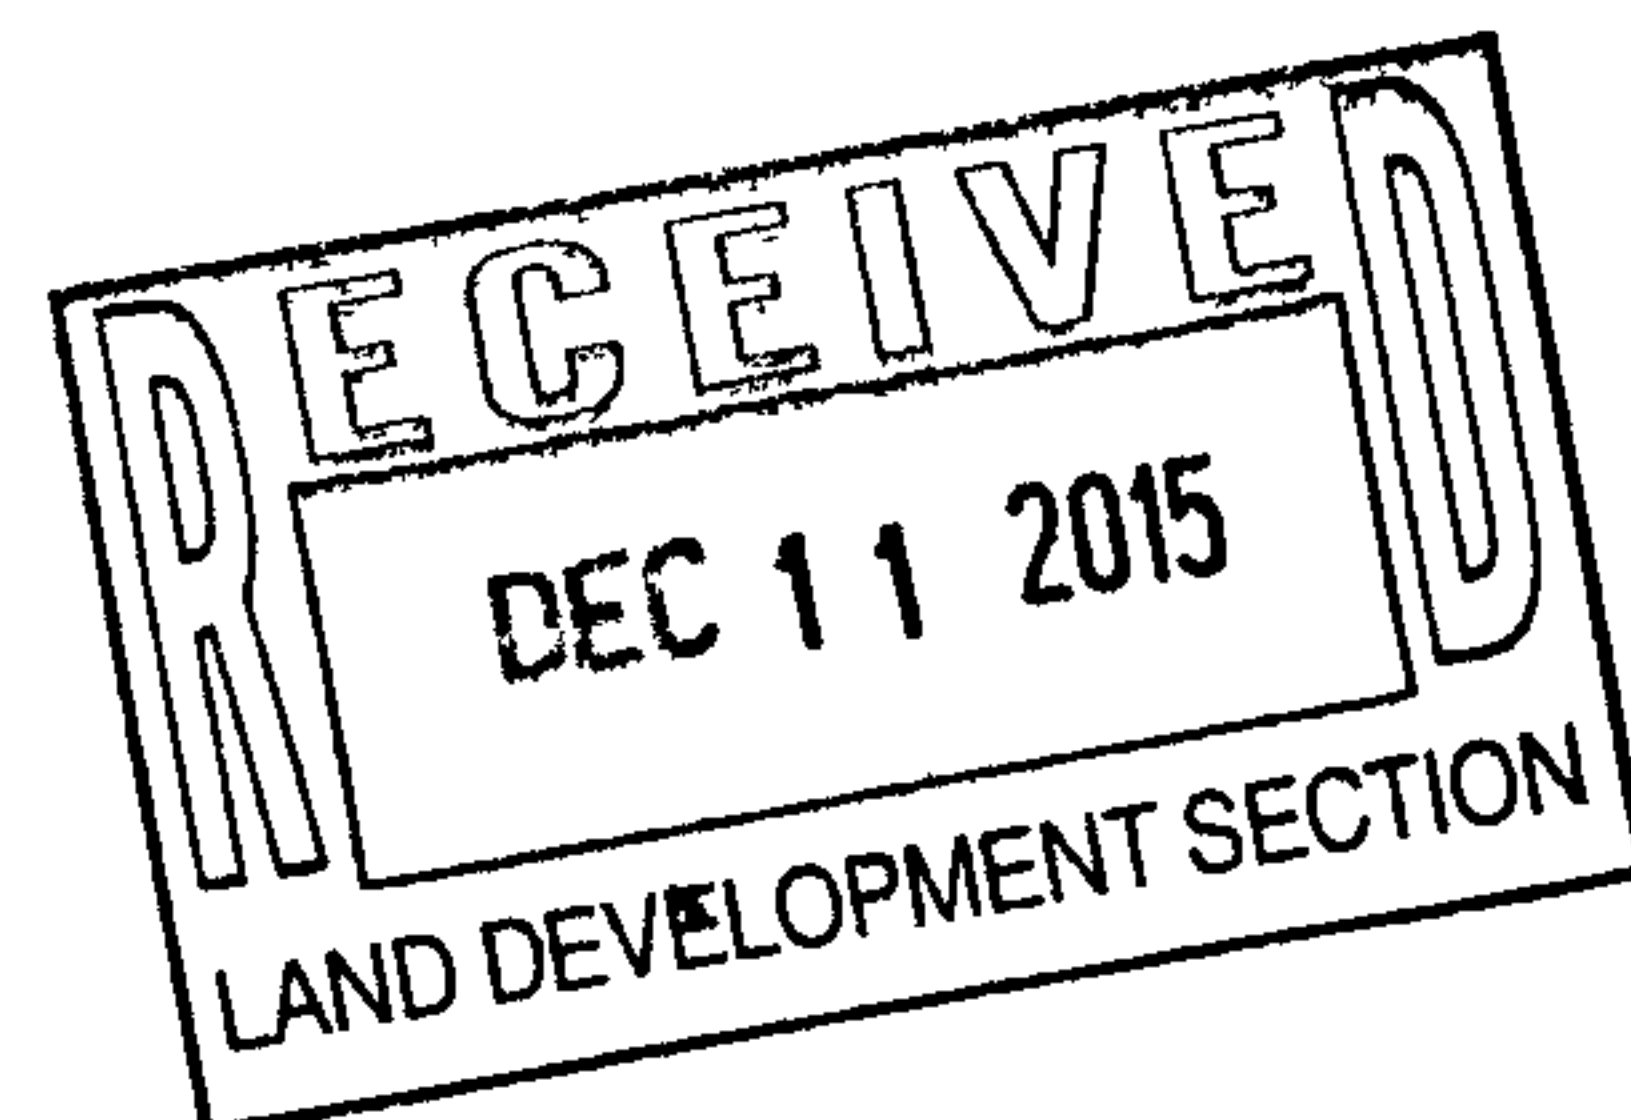

CITY OF ALBUQUERQUE

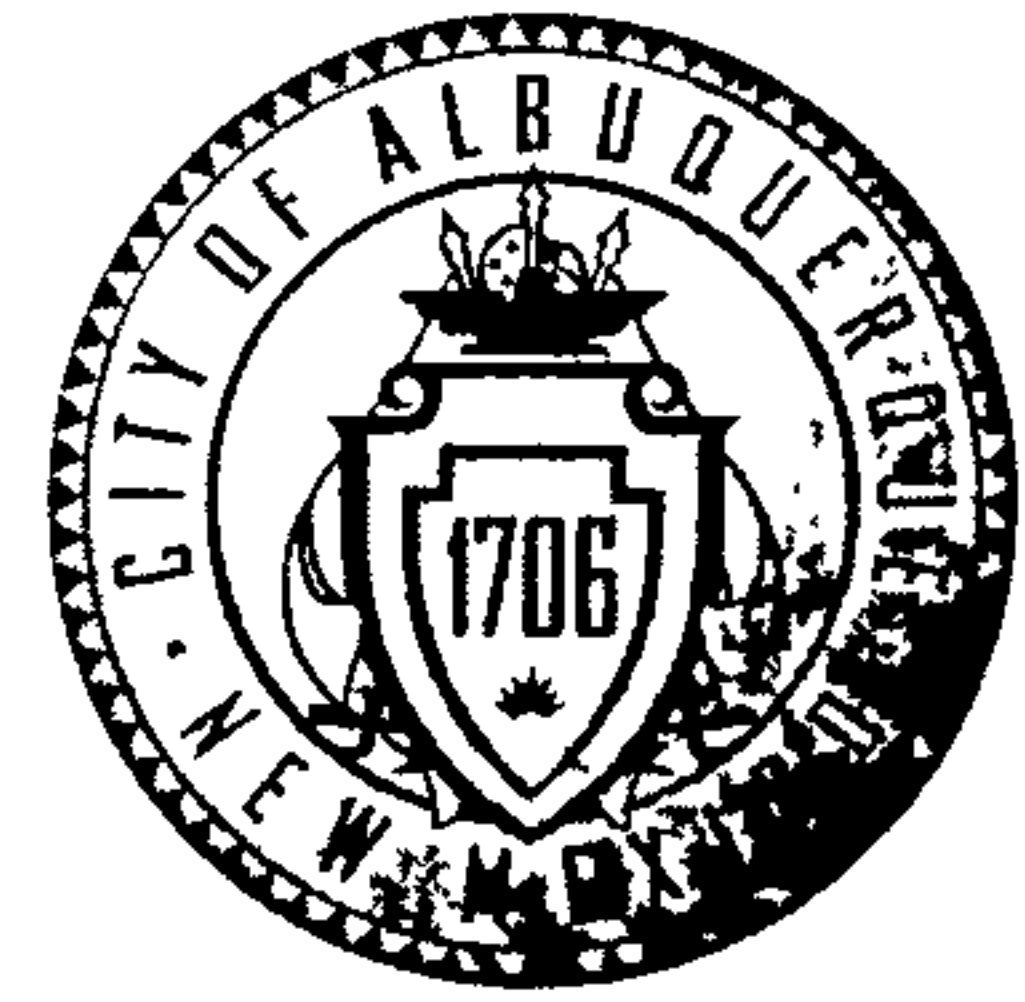

December 3, 2015

Richard J. Berry, Mayor

David Soule, P.E.
Silver Oak Estates
1606 Central Avenue Suite 201
Albuquerque, NM, 87106

RE: Silver Oak Estates | Grading and Drainage Plan | Stamp 10-21-15 (File: C18D101)

Dear Mr. Soule:

Based upon the information provided in your submittal received 10/28/2015, and information discussed at the December 2, 2015 Development Review Board Meeting, the Site Plan for Subdivision cannot be approved until the following comments are addressed:

1. Clarify the easement dimensions between the cul-de-sac and Alameda Blvd. The Utility Plan shows a different layout than the Site/Grading Plan. ✓
2. The inlet at the end of the cul-de-sac bulb appears to conflict with the intent to have an access easement to the southernmost lots.
3. At the entrance, there is a low spot on the northbound side curb and gutter; it appears that the intent is to convey flows west into the temporary pond. The plan should clarify to the Contractor that the crown of the road is to be warped so as not to create a sump.
4. The inlets on Oakland and Alameda should have build notes
 - a. The inlet on Alameda is referenced as a single grate Type D inlet to capture flows at the flowline of the roadside swale, but shown differently on the plan. Furthermore, this inlet and pipe needs to be planned with the future expanded section of Alameda Blvd in mind.
5. Show the emergency spillway for the pond as referenced in the drainage report.
6. Call out the wall opening that will be needed to convey flows into the pond.
7. Show elevation points at the rear lots that show the intent to install rear lot ponds.
 - a. The rear and front yard ponds and typical lot layout showing the first flush ponds should also be shown on the landscaping sheets, since it appears that the fine grading of those facilities might be completed with the installation of graveling and plantings, not with the grading of the lots.
8. Show the calculation that arrives at the 95 cubic foot volume for the first flush management on the worksheet in the Appendix.

PO Box 1293

Albuquerque


New Mexico 87103

www.cabq.gov

If you have any questions, you can contact me at 924-3986.

Sincerely,

Abiel Carrillo, P.E.
Principal Engineer, Planning Dept.
Development Review Services
Orig: Drainage file

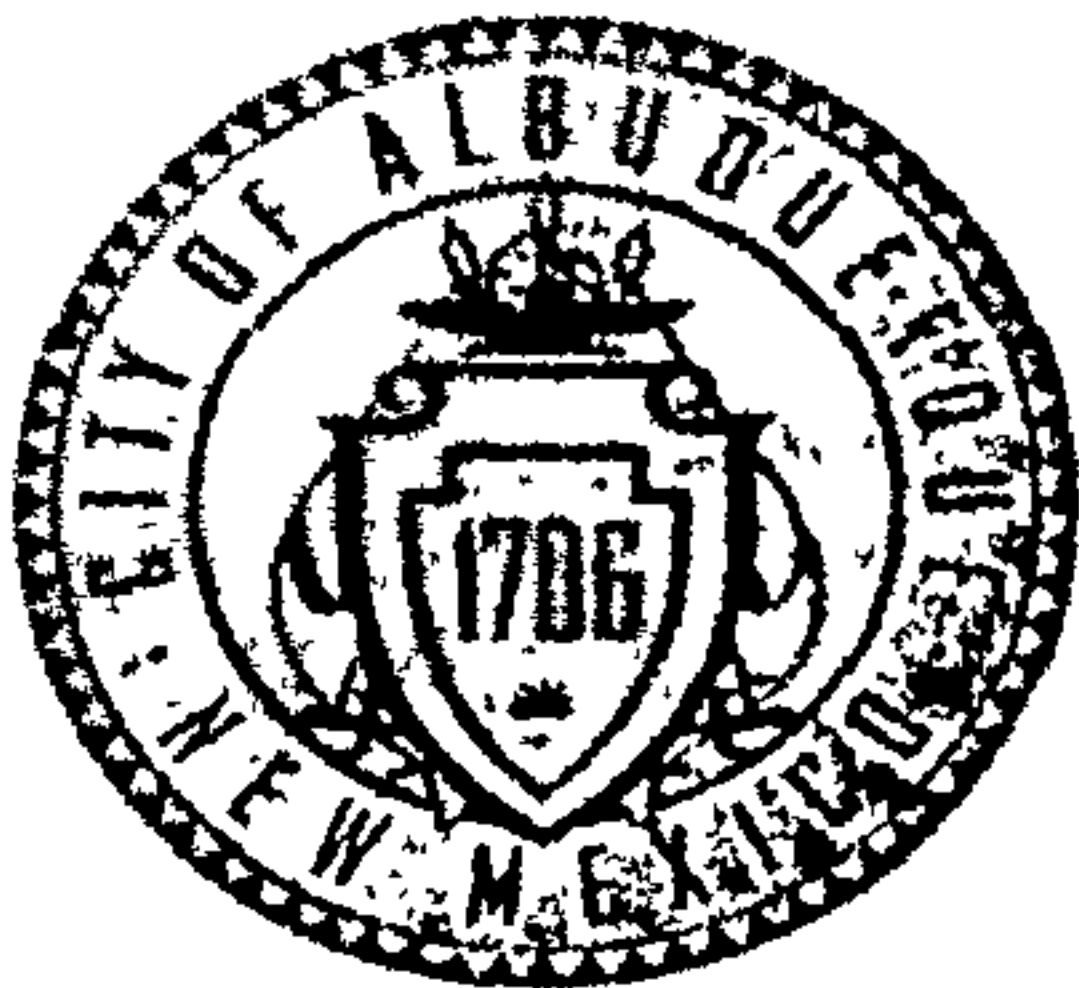

City of Albuquerque

Planning Department

Development & Building Services Division

DRAINAGE AND TRANSPORTATION INFORMATION SHEET (REV 09/2015)

Project Title: SILVER OAK SUBDIVISION Building Permit #: City Drainage #: C18D101
DRB#: 1010644 EPC#: Work Order#:
Legal Description: LOT 13,14,19,20 BLOCK 28, TRACT A, UNIT B ,NAA
City Address: OAKLAND NE

Engineering Firm: RIO GRANDE ENGINEERING Contact: DAVID SOULE
Address: PO BOX 93924, ALBUQUERQUE, NM 87199
Phone#: 505.321.9099 Fax#: 505.872 0999 E-mail: DAVID@RIOGRANDEENGINEERING.COM

Owner: SILVER OAK DEVELOPERS Contact:
Address: PO BOC 20688, ALB NM 87154
Phone#: Fax#: E-mail:

Architect: none Contact:
Address:
Phone#: Fax#: E-mail:

Other Contact: Contact:
Address:
Phone#: Fax#: E-mail:

Check all that Apply

DEPARTMENT:

- ☒ HYDROLOGY/ DRAINAGE
☐ TRAFFIC/ TRANSPORTATION
☐ MS4/ EROSION & SEDIMENT CONTROL

TYPE OF SUBMITTAL:

- ☐ ENGINEER/ ARCHITECT CERTIFICATION

☐ CONCEPTUAL G & D PLAN
☒ GRADING PLAN
☐ DRAINAGE MASTER PLAN
☐ DRAINAGE REPORT
☐ CLOMR/LOMR

☐ TRAFFIC CIRCULATION LAYOUT (TCL)
☐ TRAFFIC IMPACT STUDY (TIS)
☐ EROSION & SEDIMENT CONTROL PLAN (ESC)

☐ OTHER (SPECIFY) _____

IS THIS A RESUBMITTAL? ☐ Yes ☒ No


DATE SUBMITTED: 10/23/15 By: _____

CHECK TYPE OF APPROVAL/ACCEPTANCE SOUGHT:

- ☐ BUILDING PERMIT APPROVAL
☐ CERTIFICATE OF OCCUPANCY

☒ PRELIMINARY PLAT APPROVAL
☒ SITE PLAN FOR SUB'D APPROVAL
☐ SITE PLAN FOR BLDG. PERMIT APPROVAL
☐ FINAL PLAT APPROVAL
☐ SIA/ RELEASE OF FINANCIAL GUARANTEE
☐ FOUNDATION PERMIT APPROVAL
☐ GRADING PERMIT APPROVAL
☐ SO-19 APPROVAL
☐ PAVING PERMIT APPROVAL
☐ GRADING/ PAD CERTIFICATION
☐ WORK ORDER APPROVAL
☐ CLOMR/LOMR

☐ PRE-DESIGN MEETING
☐ OTHER (SPECIFY) _____

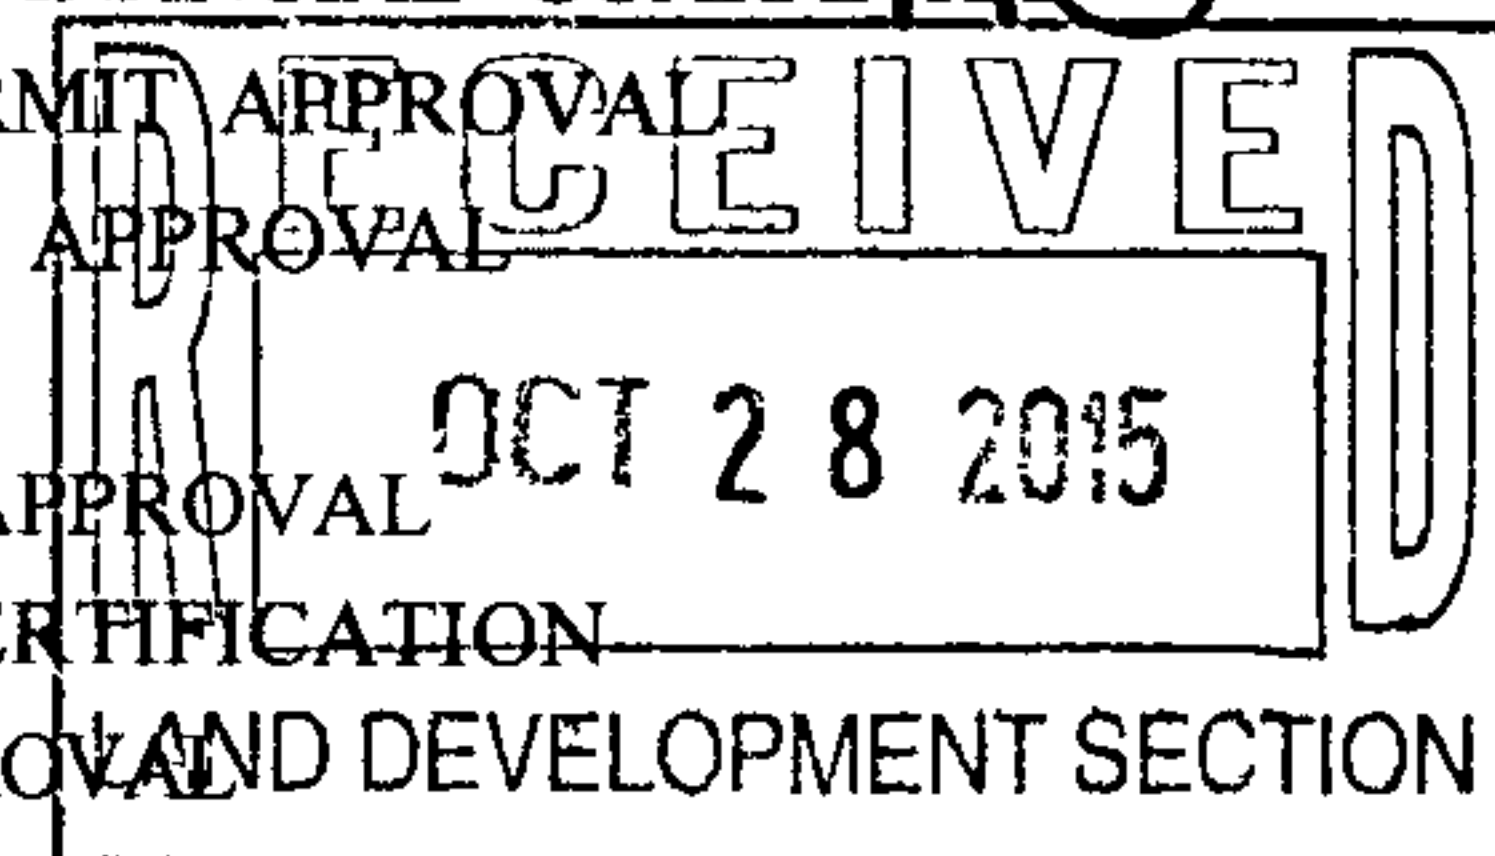

COA STAFF ELECTRONIC SUBMITTAL RECEIVED _____

DRAINAGE REPORT

For

SILVER OAK SUBDIVISION
Albuquerque, New Mexico

Prepared by

Rio Grande Engineering
PO Box 93924
Albuquerque, New Mexico 87199

October 2015



David Soule P.E. No. 14522

TABLE OF CONTENTS

Purpose	3
Introduction.....	3
Existing Conditions.....	3
Exhibit A-Vicinity Map	4
Proposed Conditions	5
Summary	6

Appendix

NAAMDP, Alameda storm drain asbuilts	A
Site Hydrology	B
Hydraulic calculations.....	C

Map

Site Grading and Drainage Plan

PURPOSE




The purpose of this report is to provide the Drainage Management Plan for the development of a 20-lot subdivision located on Oakland Avenue between San Pedro and Louisiana NE. This plan was prepared in accordance with the City of Albuquerque design regulations, utilizing the City of Albuquerque's Development Process Manual drainage guidelines. This report will demonstrate that the grading does not adversely affect the surrounding properties, nor the upstream or downstream facilities.

INTRODUCTION

The subject of this report, as shown on the Exhibit A, is a 3.66-acre parcel of land located on the south side of Oakland Avenue and the north side of Alameda Boulevard between San Pedro and Louisiana. The legal description of this site is Lots 13-14 and 19-20, block 28, tract A, unit B, North Albuquerque Acres. As shown on FIRM map35013C0137H, the entire site is located within Flood Zone X. The site has had significant grading activities upon it over the past years. The site is not in native condition, there are several borrow pits and there are berms and diversion ponds along the west property line. The site is affected by upland flow from 4 undeveloped lots. The site free discharges to the northwest and southwest. The development of the site will require the site to discharge at a rate equal to or less than the fully developed conditions assumed for this site in the governing North Albuquerque Acres Master Drainage Plan (NAAMDP), which relevant excerpts can be found in appendix A.

EXISTING CONDITIONS

The site currently does not have structures on it and has been impacted by human development over the years. The site was graded with the adjacent storage facility, such that berms and desiltation ponds were created to divert the north half of the site to Oakland and the

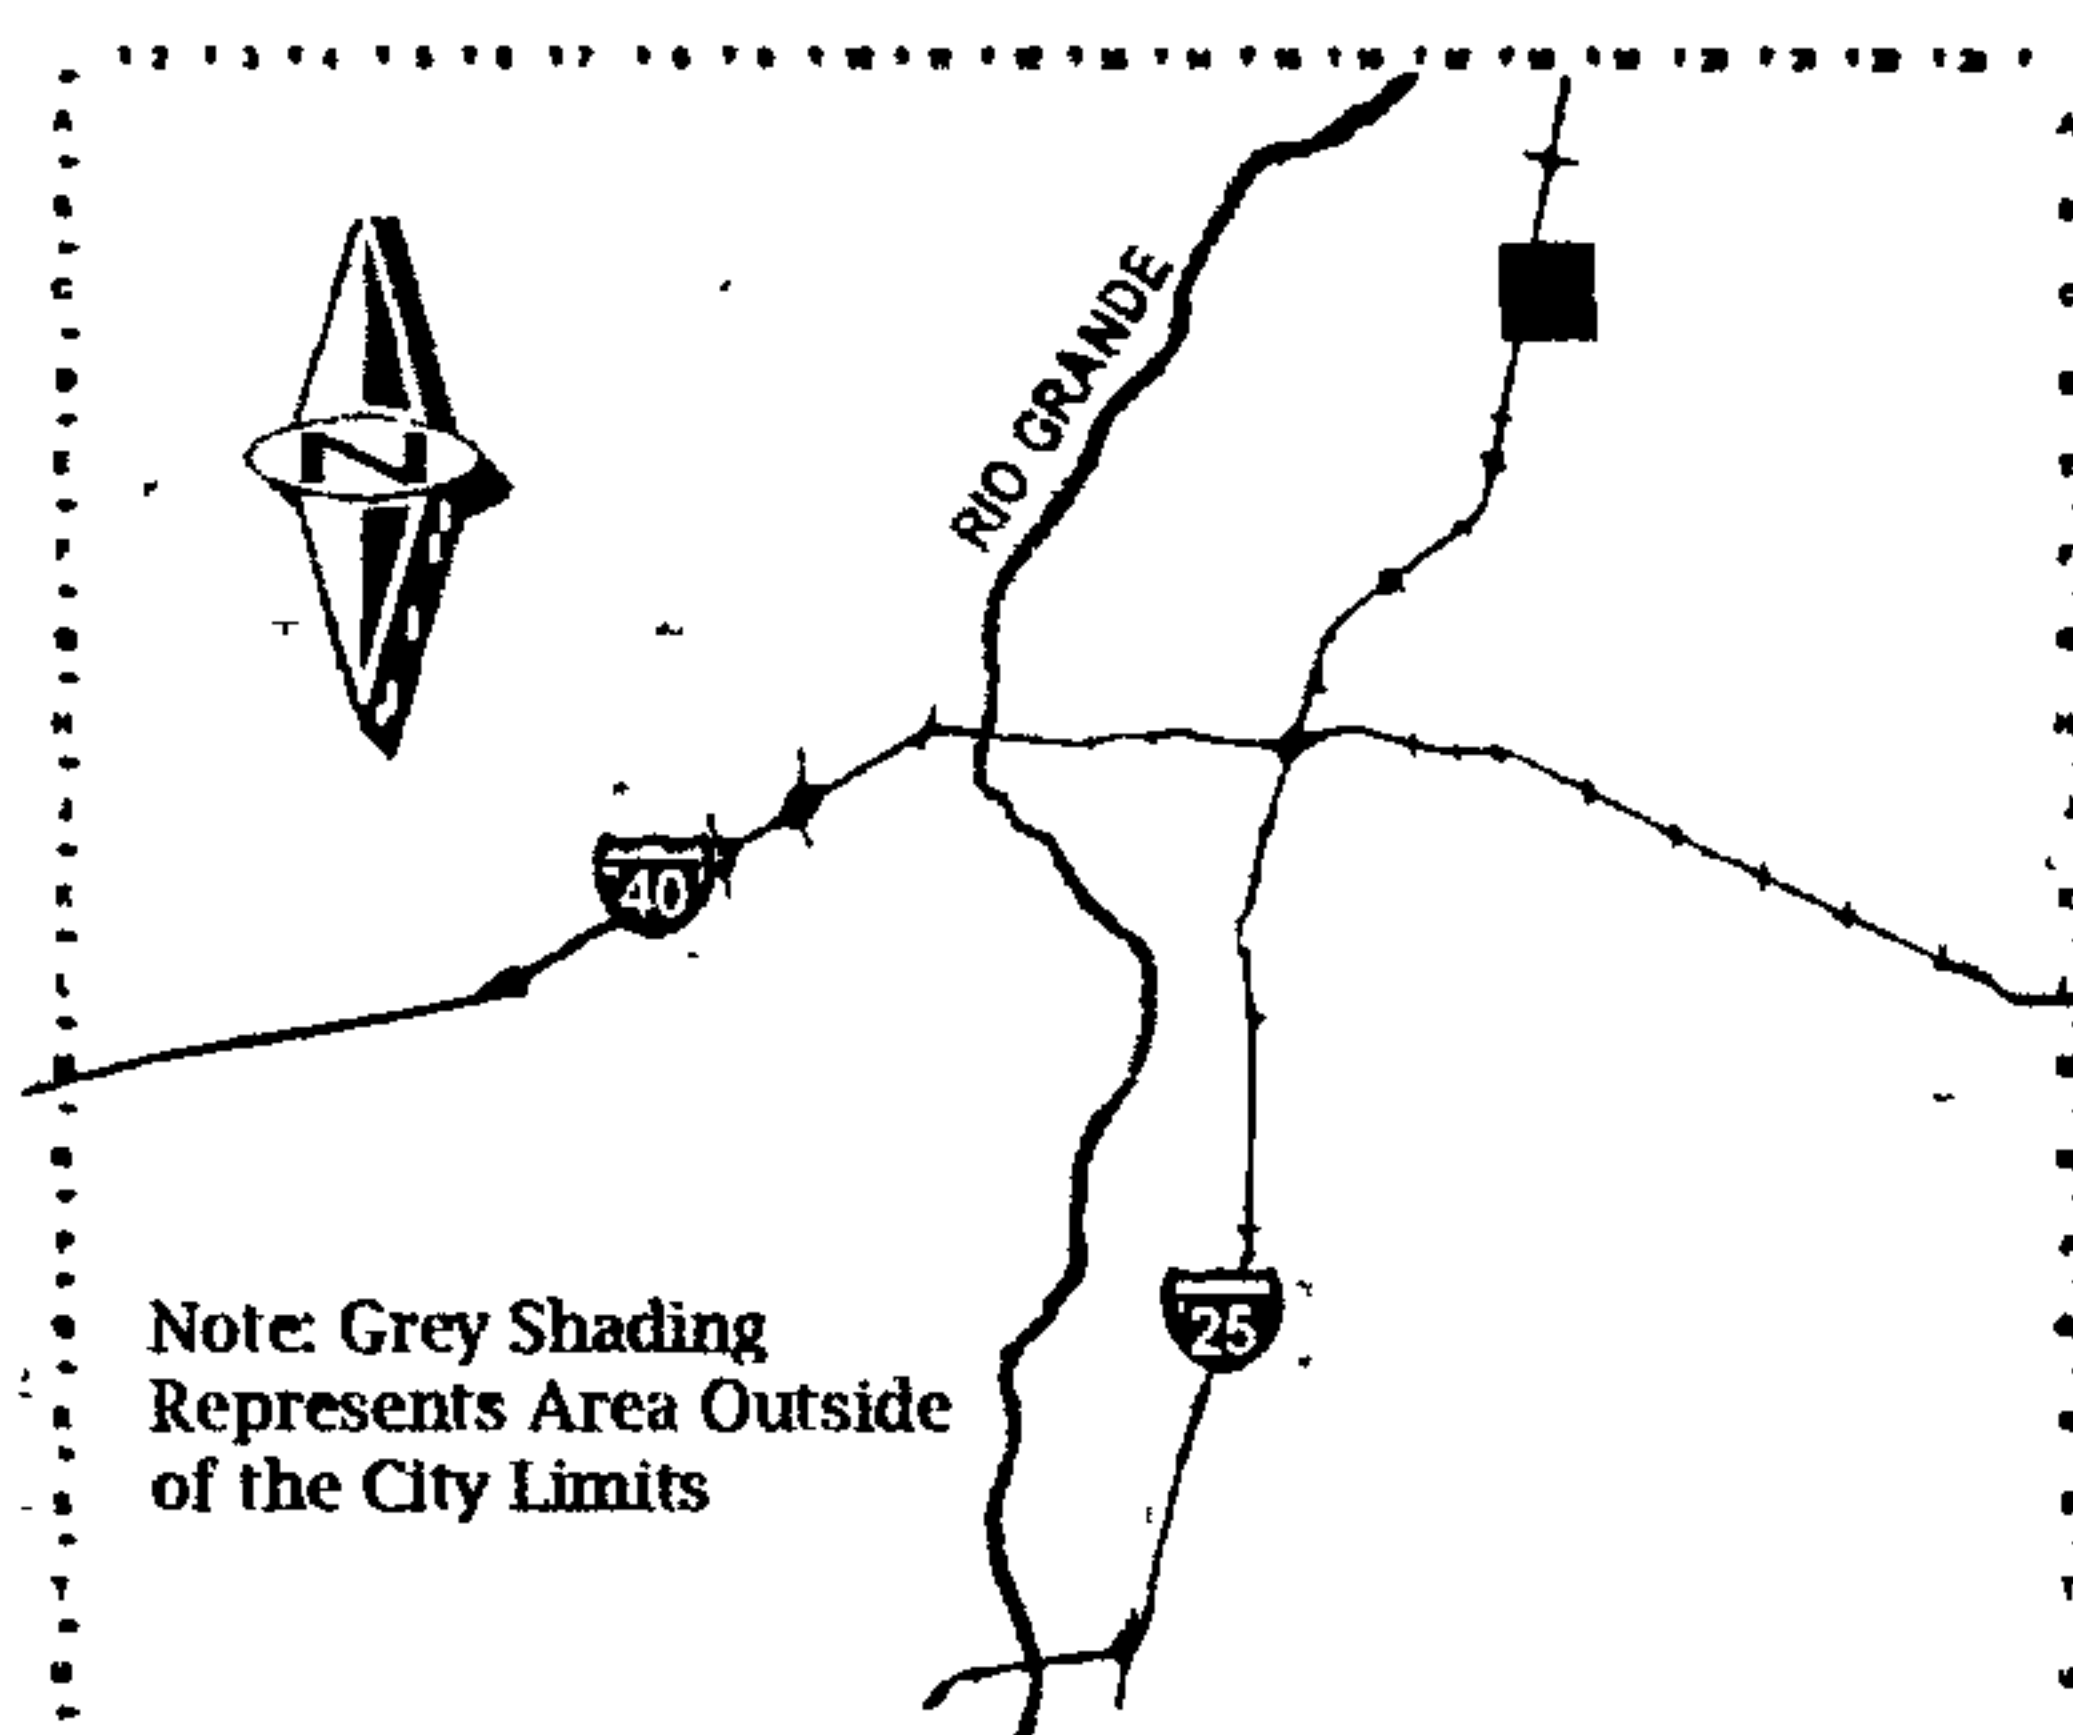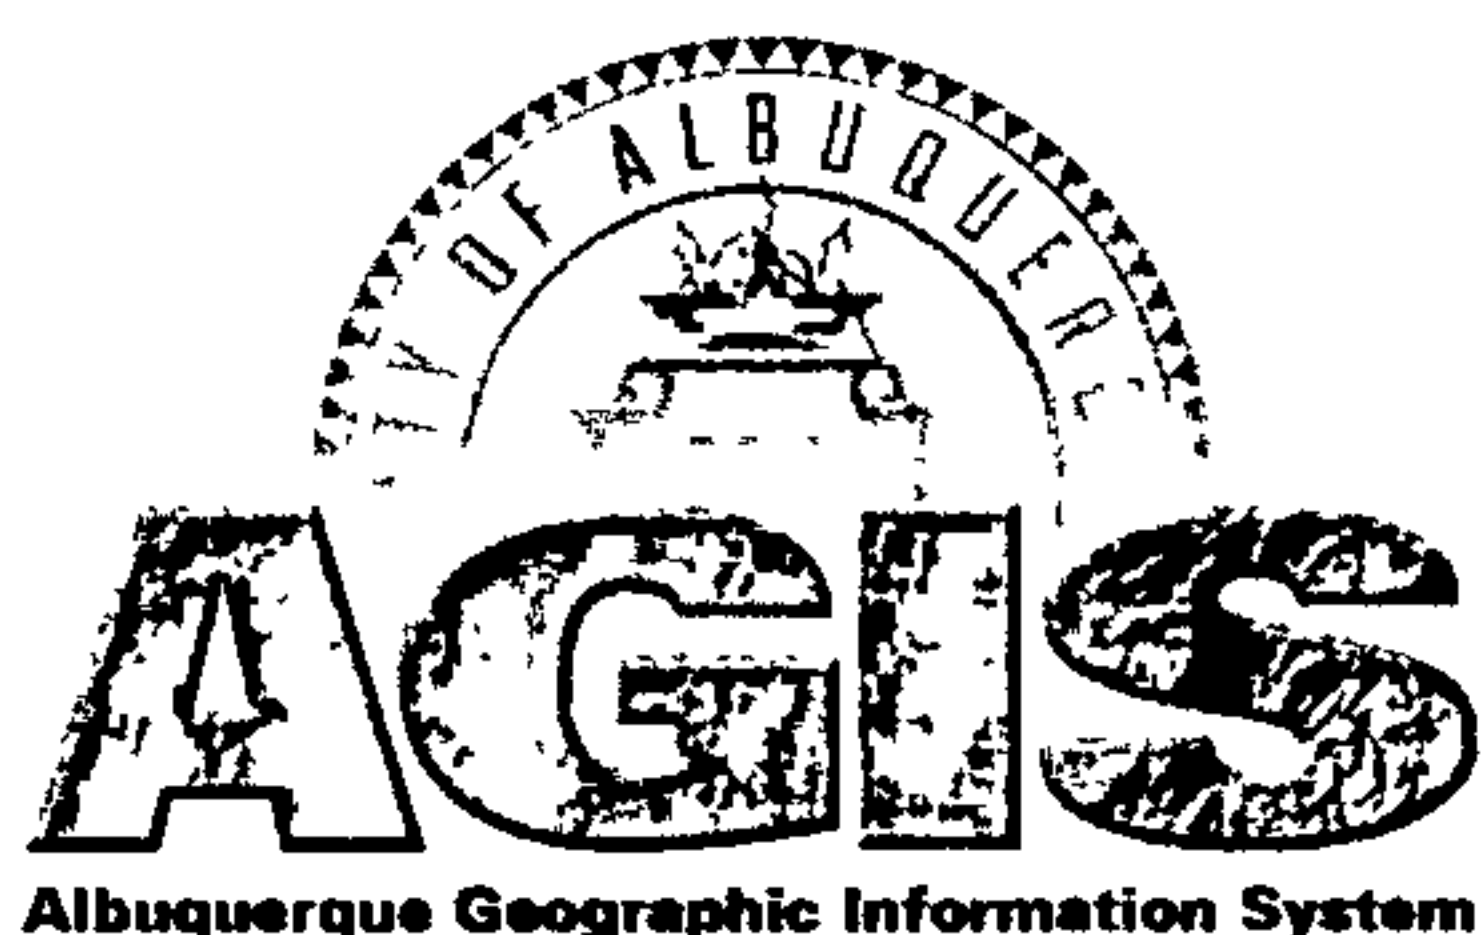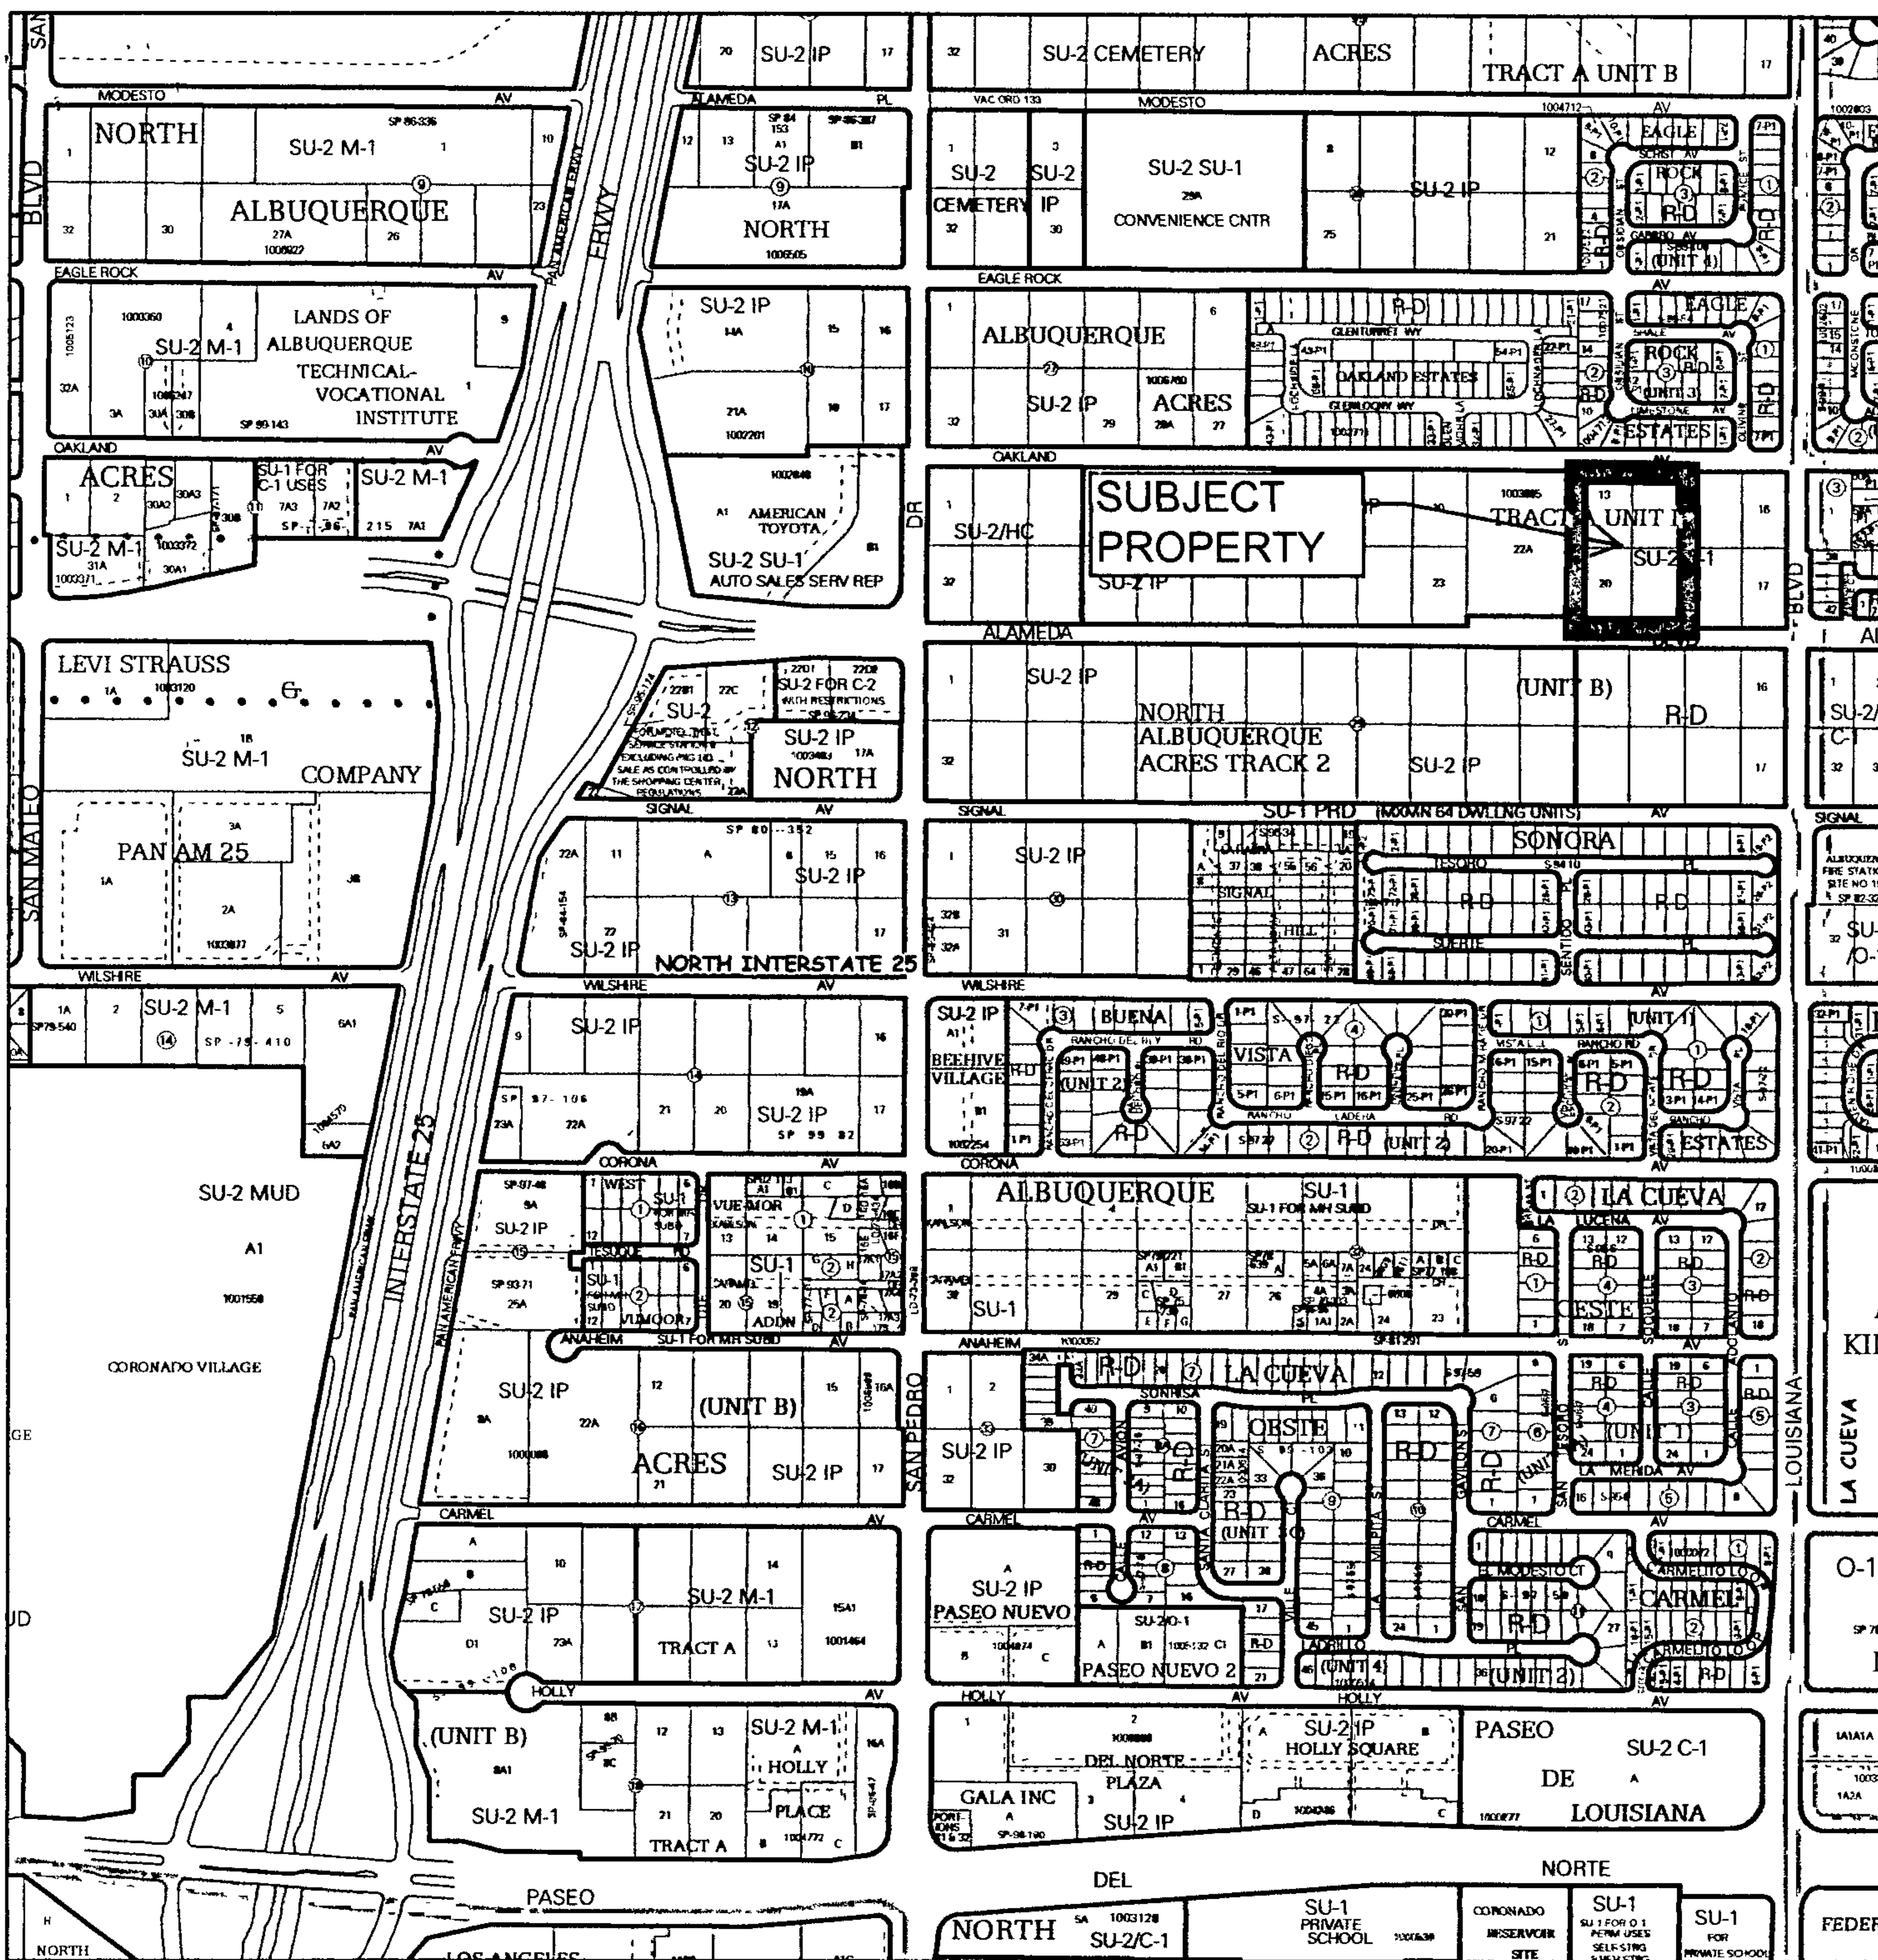

Zone Atlas Page:

C-18-Z

Selected Symbols

- SECTOR PLANS**
- Design Overlay Zones
- City Historic Zones
- H-1 Buffer Zone
- Petroglyph Mon.
- Escarpment
- 2 Mile Airport Zone
- Airport Noise Contours
- Wall Overlay Zone

south half of the site to Alameda. The site is impacted by upland flows in the amount of 6.5 cfs from the adjacent lots to the east. The flow enters the site as sheet flow. The site currently generates 7.66 cfs. The site currently discharge the 14.16 cfs of combined onsite and upland flows, of which 7.08 cfs discharges to Alameda and 7.08 cfs discharges to Oakland at the west property line.

PROPOSED CONDITIONS

The proposed improvements consist of a new 20-lot subdivision serviced by private paved roadway. The site contains two basins; the northern half contains Basin A, which discharges via surface flow to Oakland. Basin A is located within the NAA developed basin 117.2, and basin B is located within basin 117.2. As shown in appendix A, the anticipated land treatments for these basins are both 0%A, 34%B, 16%C, 50% D. Due to the lack of down stream storm drain connectivity, basin A shall be retained on site in a temporary drainage pond located on lot 1. Basin B contains the southern half and discharges to the Alameda Storm drain via an 18" connection to an existing lateral. The drainage plan calls for rear yard retention for water quality as well as reducing the peak flow leaving the site. Each rear yard will contain a 6" deep 12x45' pond with a volume of 110 cubic feet. This pond will retain the rear yard and harvest this water. The removal of this development area from the contributing site discharge reduces the peak for each onsite basin to less than what is allowed within the North Albuquerque Acres Drainage Master Plan. The NAADMP allows for 7.09 cfs to be discharged for each basin. As shown in appendix B, Basin A will discharge 6.89 cfs, which is .2 cfs less than allowed, and basin B will discharge 6.87 cfs which is .22 cfs less than allowed. In addition to the rear yard ponds, additional 33 cubic foot ponds will be provided in the front yards to further improve the first flush treatment. As shown in appendix B, basin A generates 0.389 acre feet during a 100-year, 10-day event. The pond provides for this volume with one foot of freeboard. The pond has an emergency overflow to Oakland The sidewalk culverts have a capacity of 9.7 cfs, which is

Not shown

greater than the 6.96 cfs anticipated. The inlet located at Oakland has the capacity to convey the 15.28 cfs that will ultimately discharge to it. In the interim it will be plugged. The cul-de-sac inlet collecting the flow from basin b has a capacity of 34.9 cfs which exceeds the 6.93 cfs anticipated. The 18" rcp has a capacity of 12.91 cfs and is connected to an existing 18" lateral which is designed to accept fully developed flow from this site. The connection to the existing lateral will utilize a single grated D inlet for a junction. This will collect the street flows generated

along our frontage, as well as capacity for future basin D. The calculation for these items as well as for the street capacity is located in appendix C

Where? There's only a type A shown on Alameda and a manhole suggested at the interim junction

~~Wouldn't it be better to install the pipe where it needs to be in the future?~~

ow

The upland flow consists of 4 undeveloped lots; these lots will be diverted to the streets at this sites east property line. The 3.25 cfs currently discharging from each half will enter the Alameda and Oakland roadways via surface flow. The swale will include sediment basins prior to discharging to the streets.

SUMMARY AND RECOMMENDATIONS

This project is a development of a 20-lot residential subdivision with the North Albuquerque Acres Master Drainage plan. The development is consistent with the land use assumptions of the plan. The site includes water quality volumes in excess of the .34" required. The peak discharge is less than allowed. The inlets, pipes and roadways, culverts and ponds have been shown to provide the required capacity. The site has been designed in accordance with City of Albuquerque Drainage ordinance. This drainage plan and report conforms to the governing drainage regulations of the City. Since the effected area site encompasses more than 1 acre, a NPDES permit will be required prior to any construction activity.

APPENDIX A

North Albuquerque Acres Master Drainage Plan

And

Alameda storm drain design excerpts

FINAL
NORTH ALBUQUERQUE ACRES
MASTER DRAINAGE PLAN

Prepared For:




City of Albuquerque



Prepared By:



ENGINEERS AND ENVIRONMENTAL SCIENTISTS
1720-B Randolph Road SE, Albuquerque, NM 87106
Telephone (505) 243-7300
Fax (505) 243-7400
rti@nmia.com

October 1998

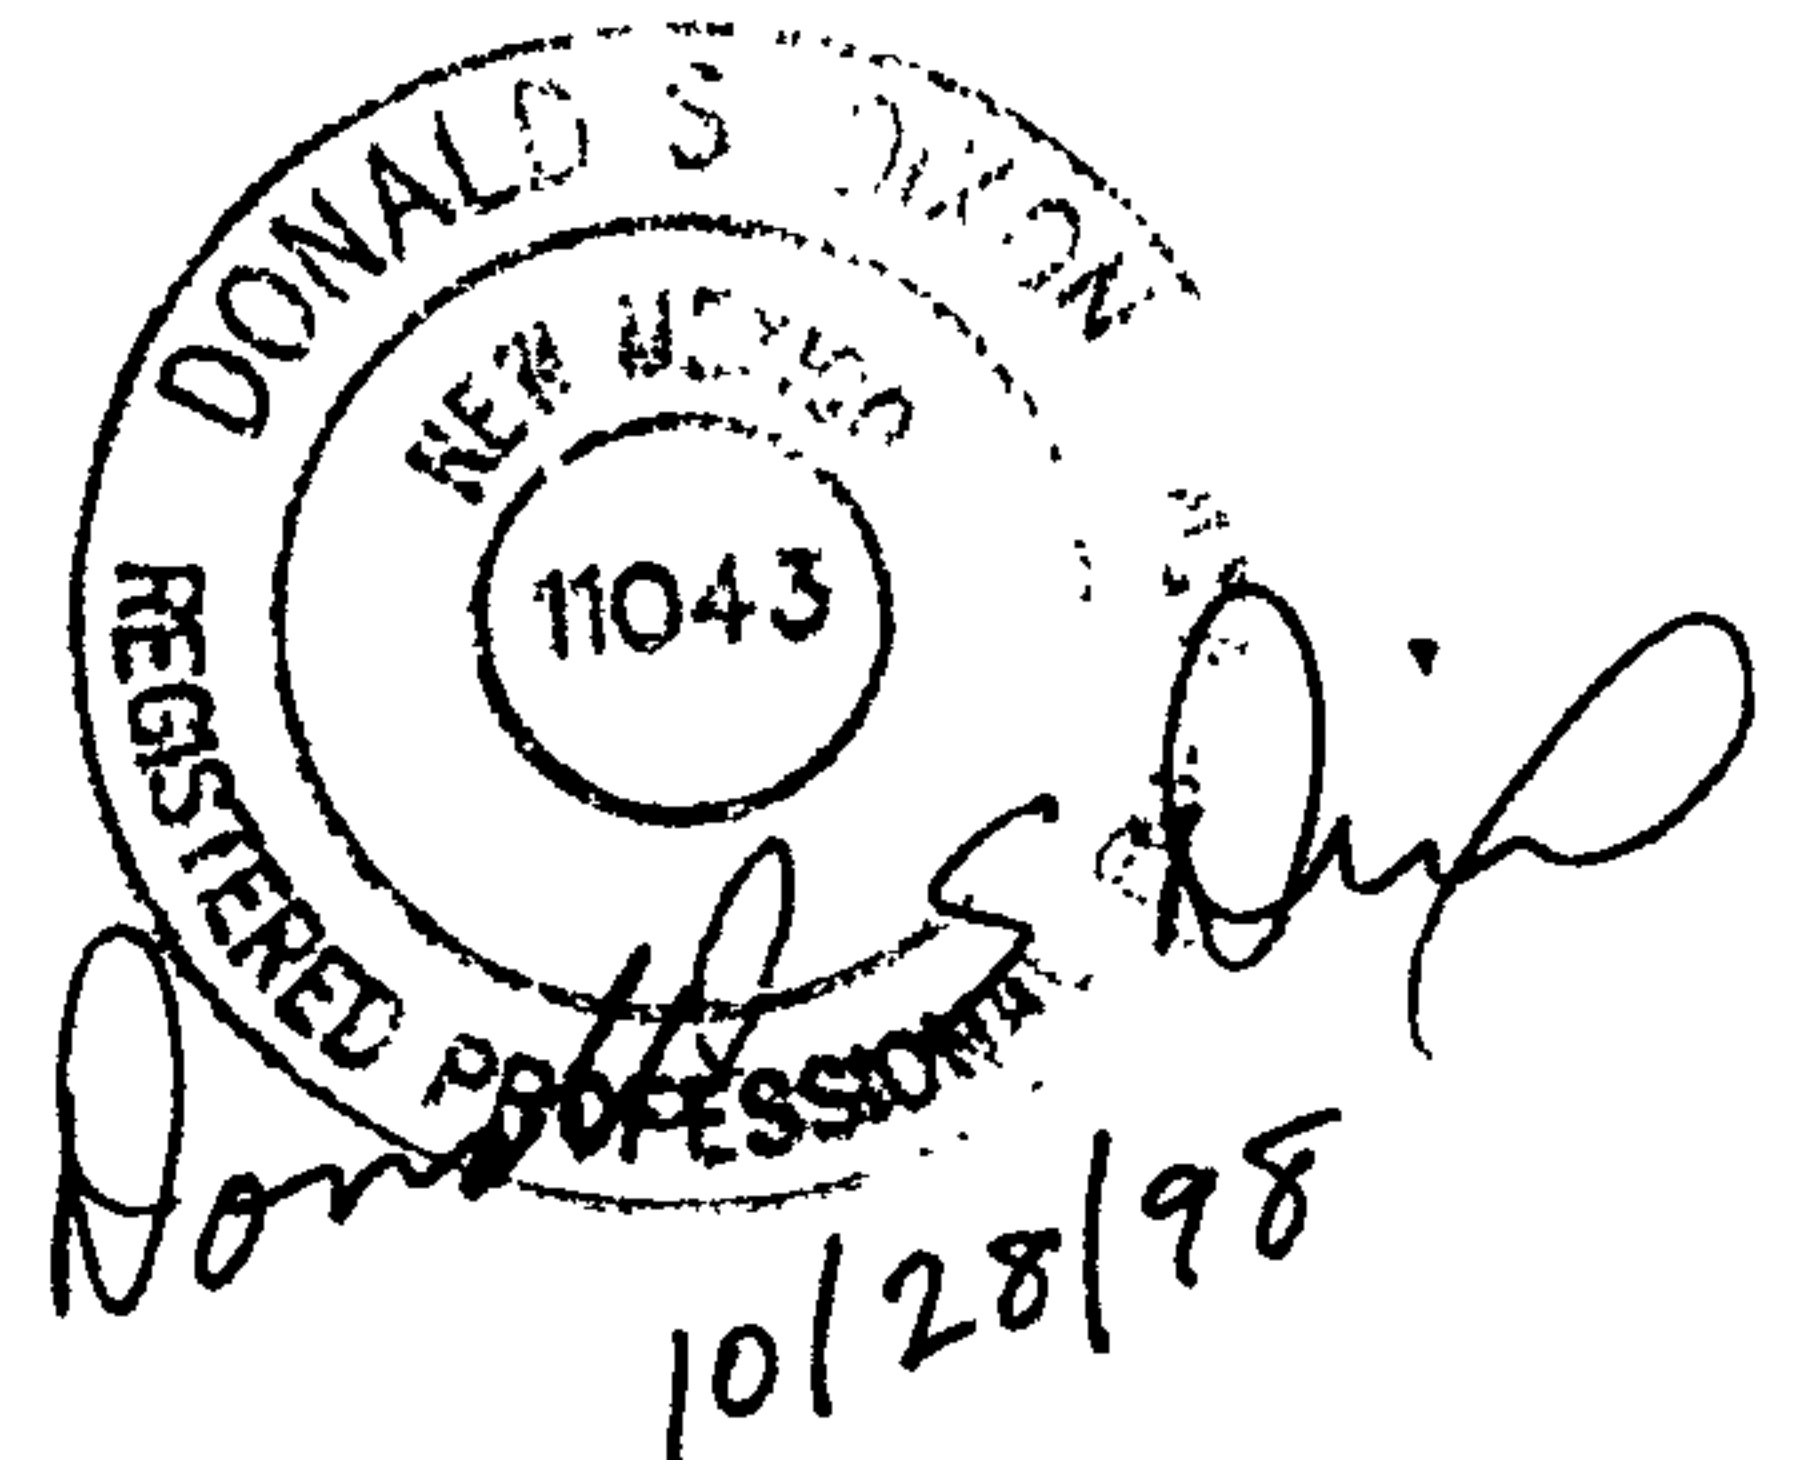

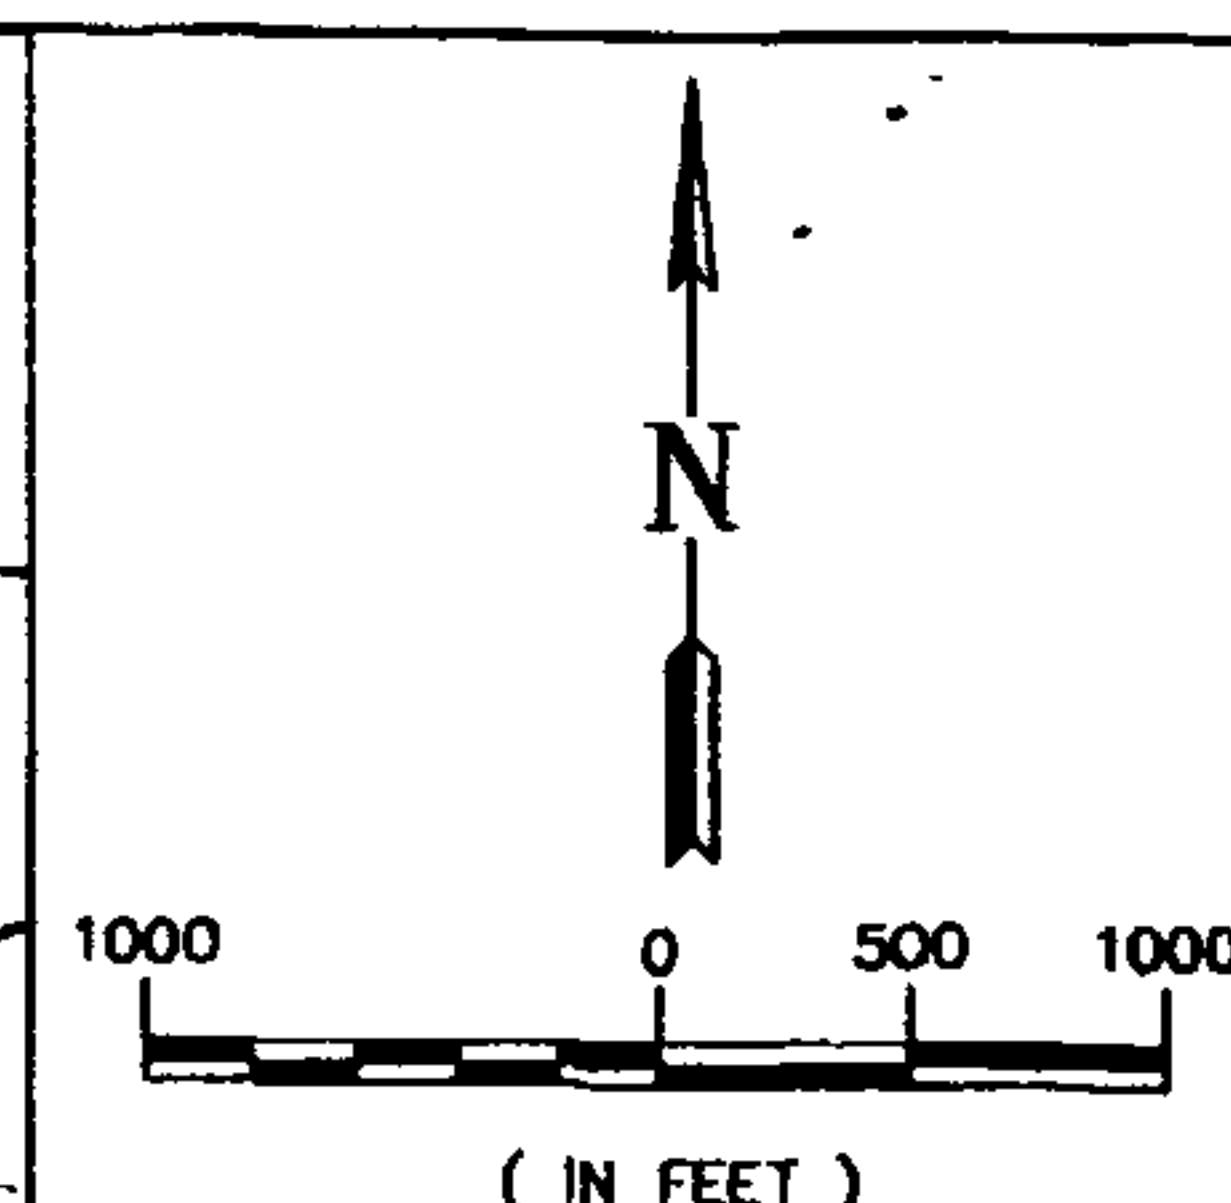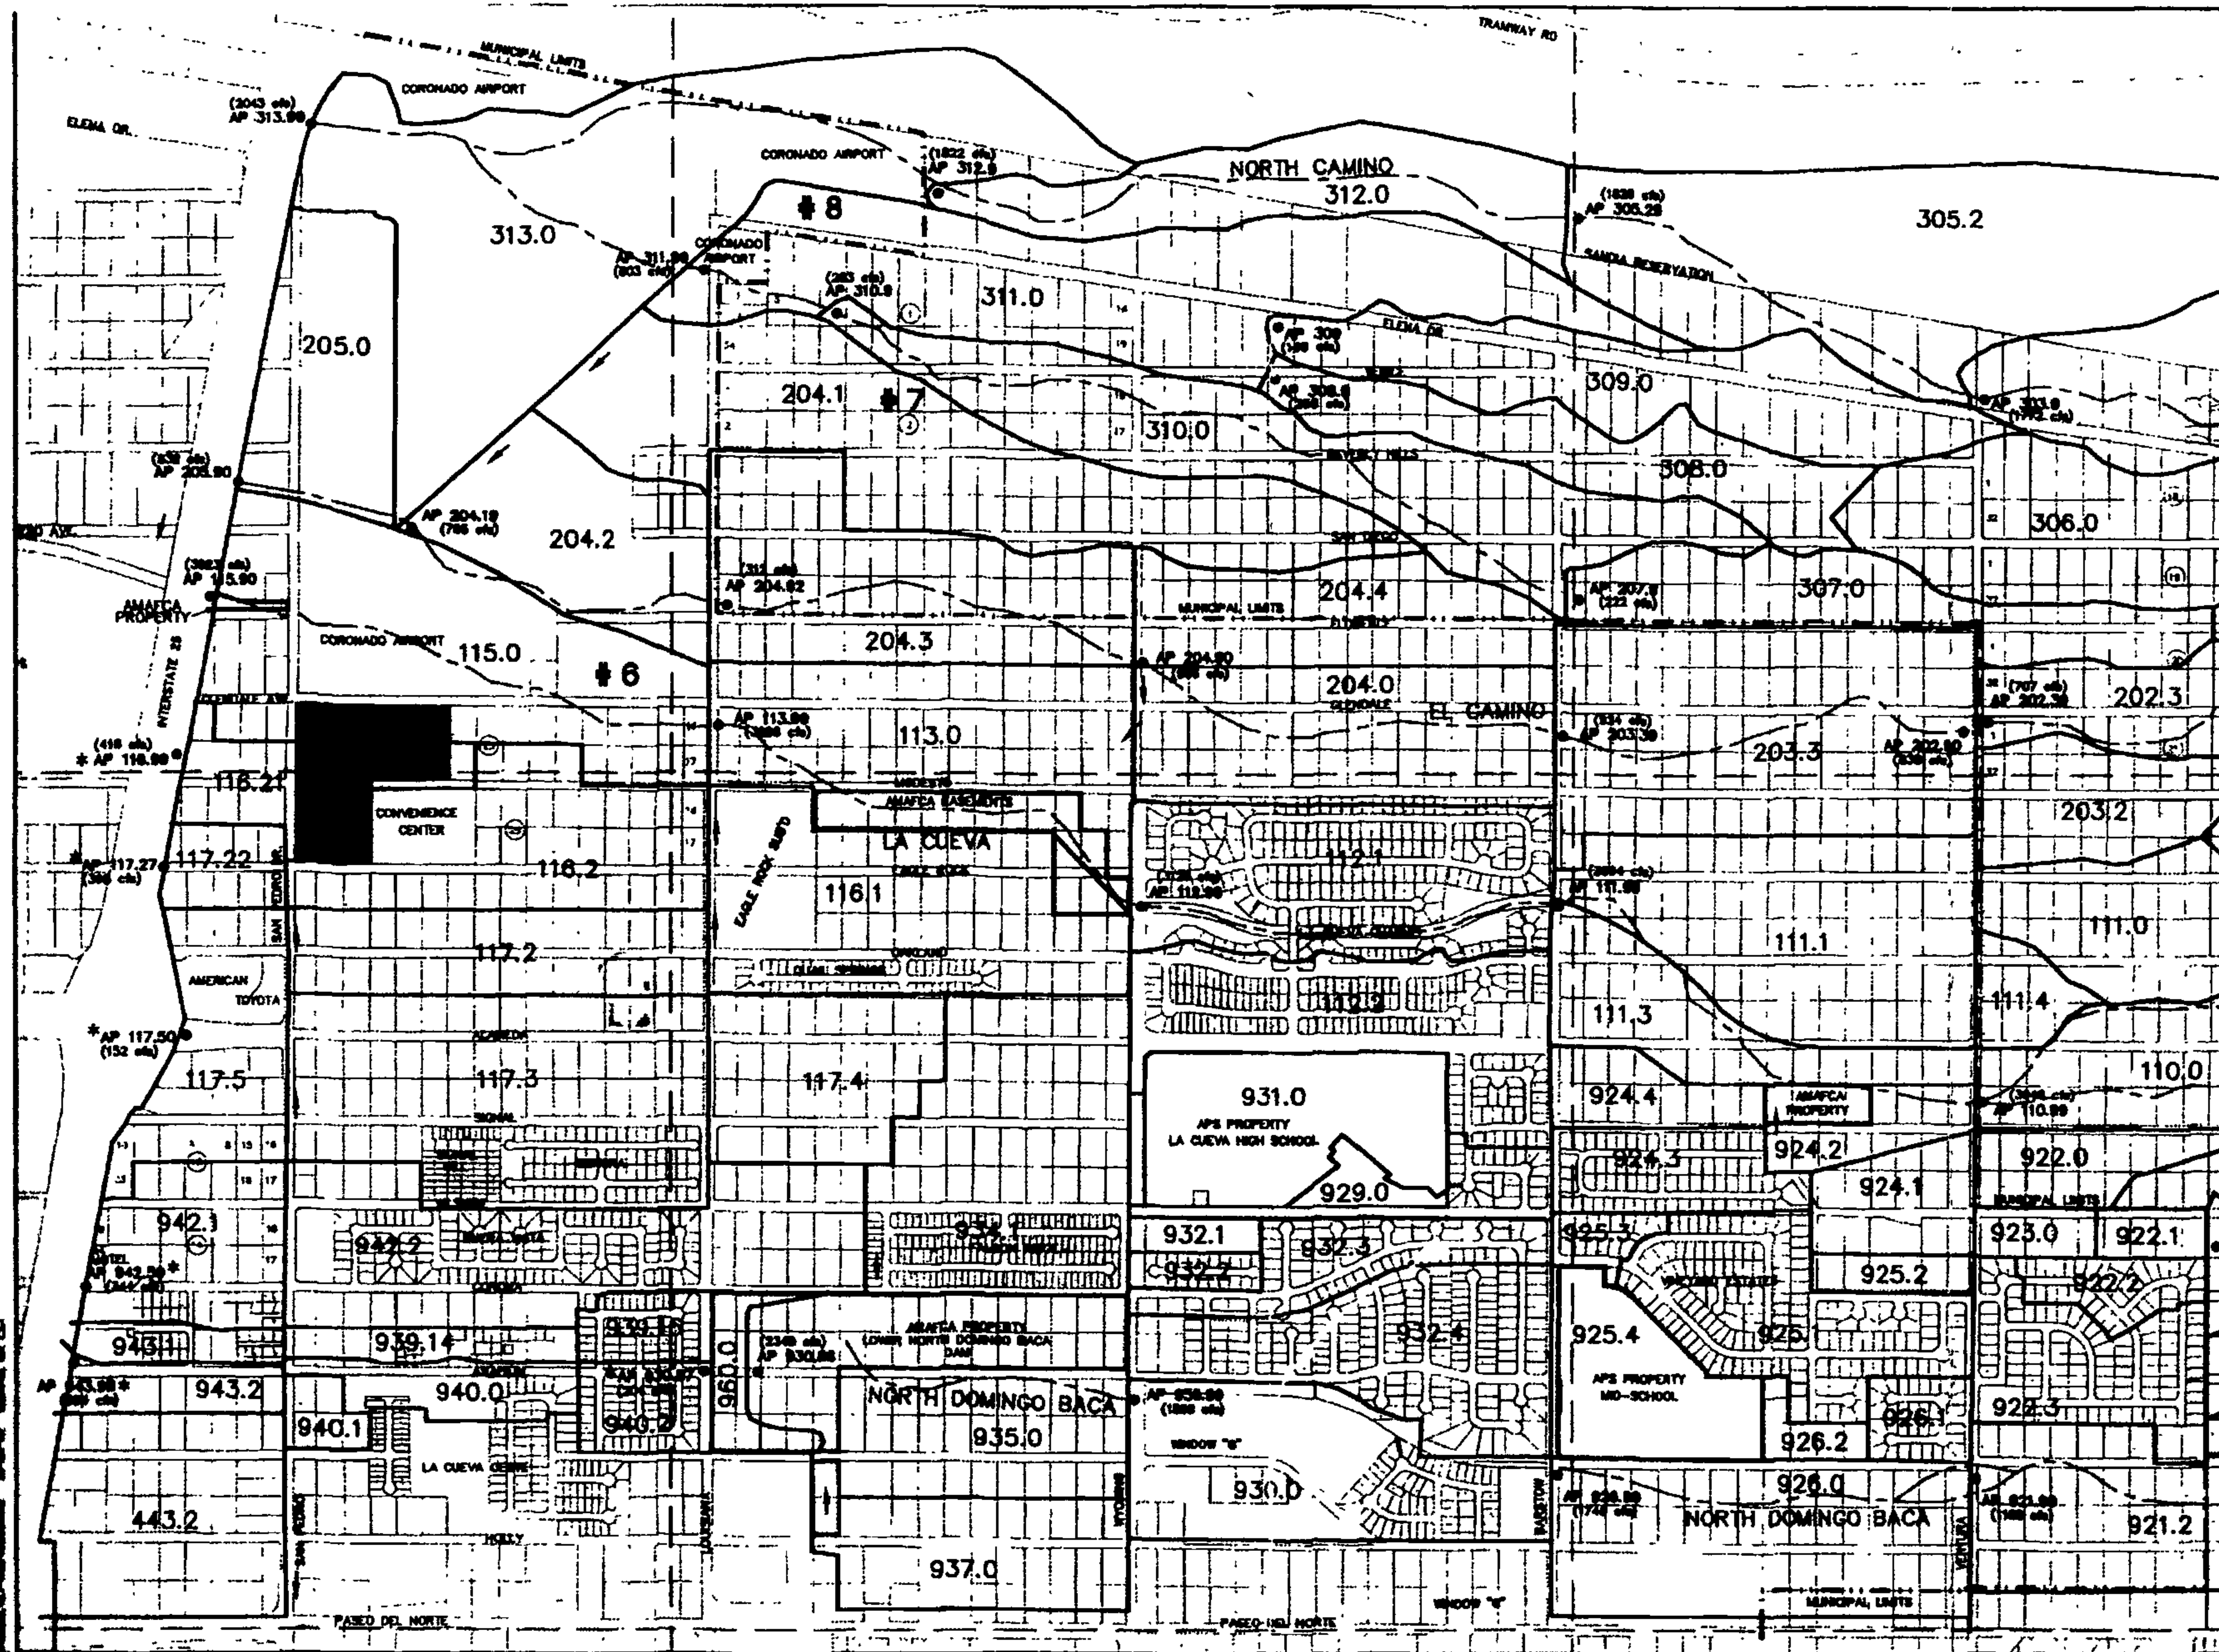


LEGEND

- 107.1 SUBBASIN DESIGNATION
- SUBBASIN BOUNDARY
- EXISTING PLATTING
- EXISTING ARROYO FLOW PATH
- ANALYSIS POINT AND FUTURE CONDITION FLOW RATE
- * FLOW RATE NOT BULKED FOR SEDIMENT
- 2 POTENTIAL AVULSION LOCATION
- MUNICIPAL LIMITS

NORTH ALBUQUERQUE ACRES
MASTER DRAINAGE PLAN
FUTURE CONDITION
FIGURE 4A
CITY OF ALBUQUERQUE
PUBLIC WORKS DEPARTMENT



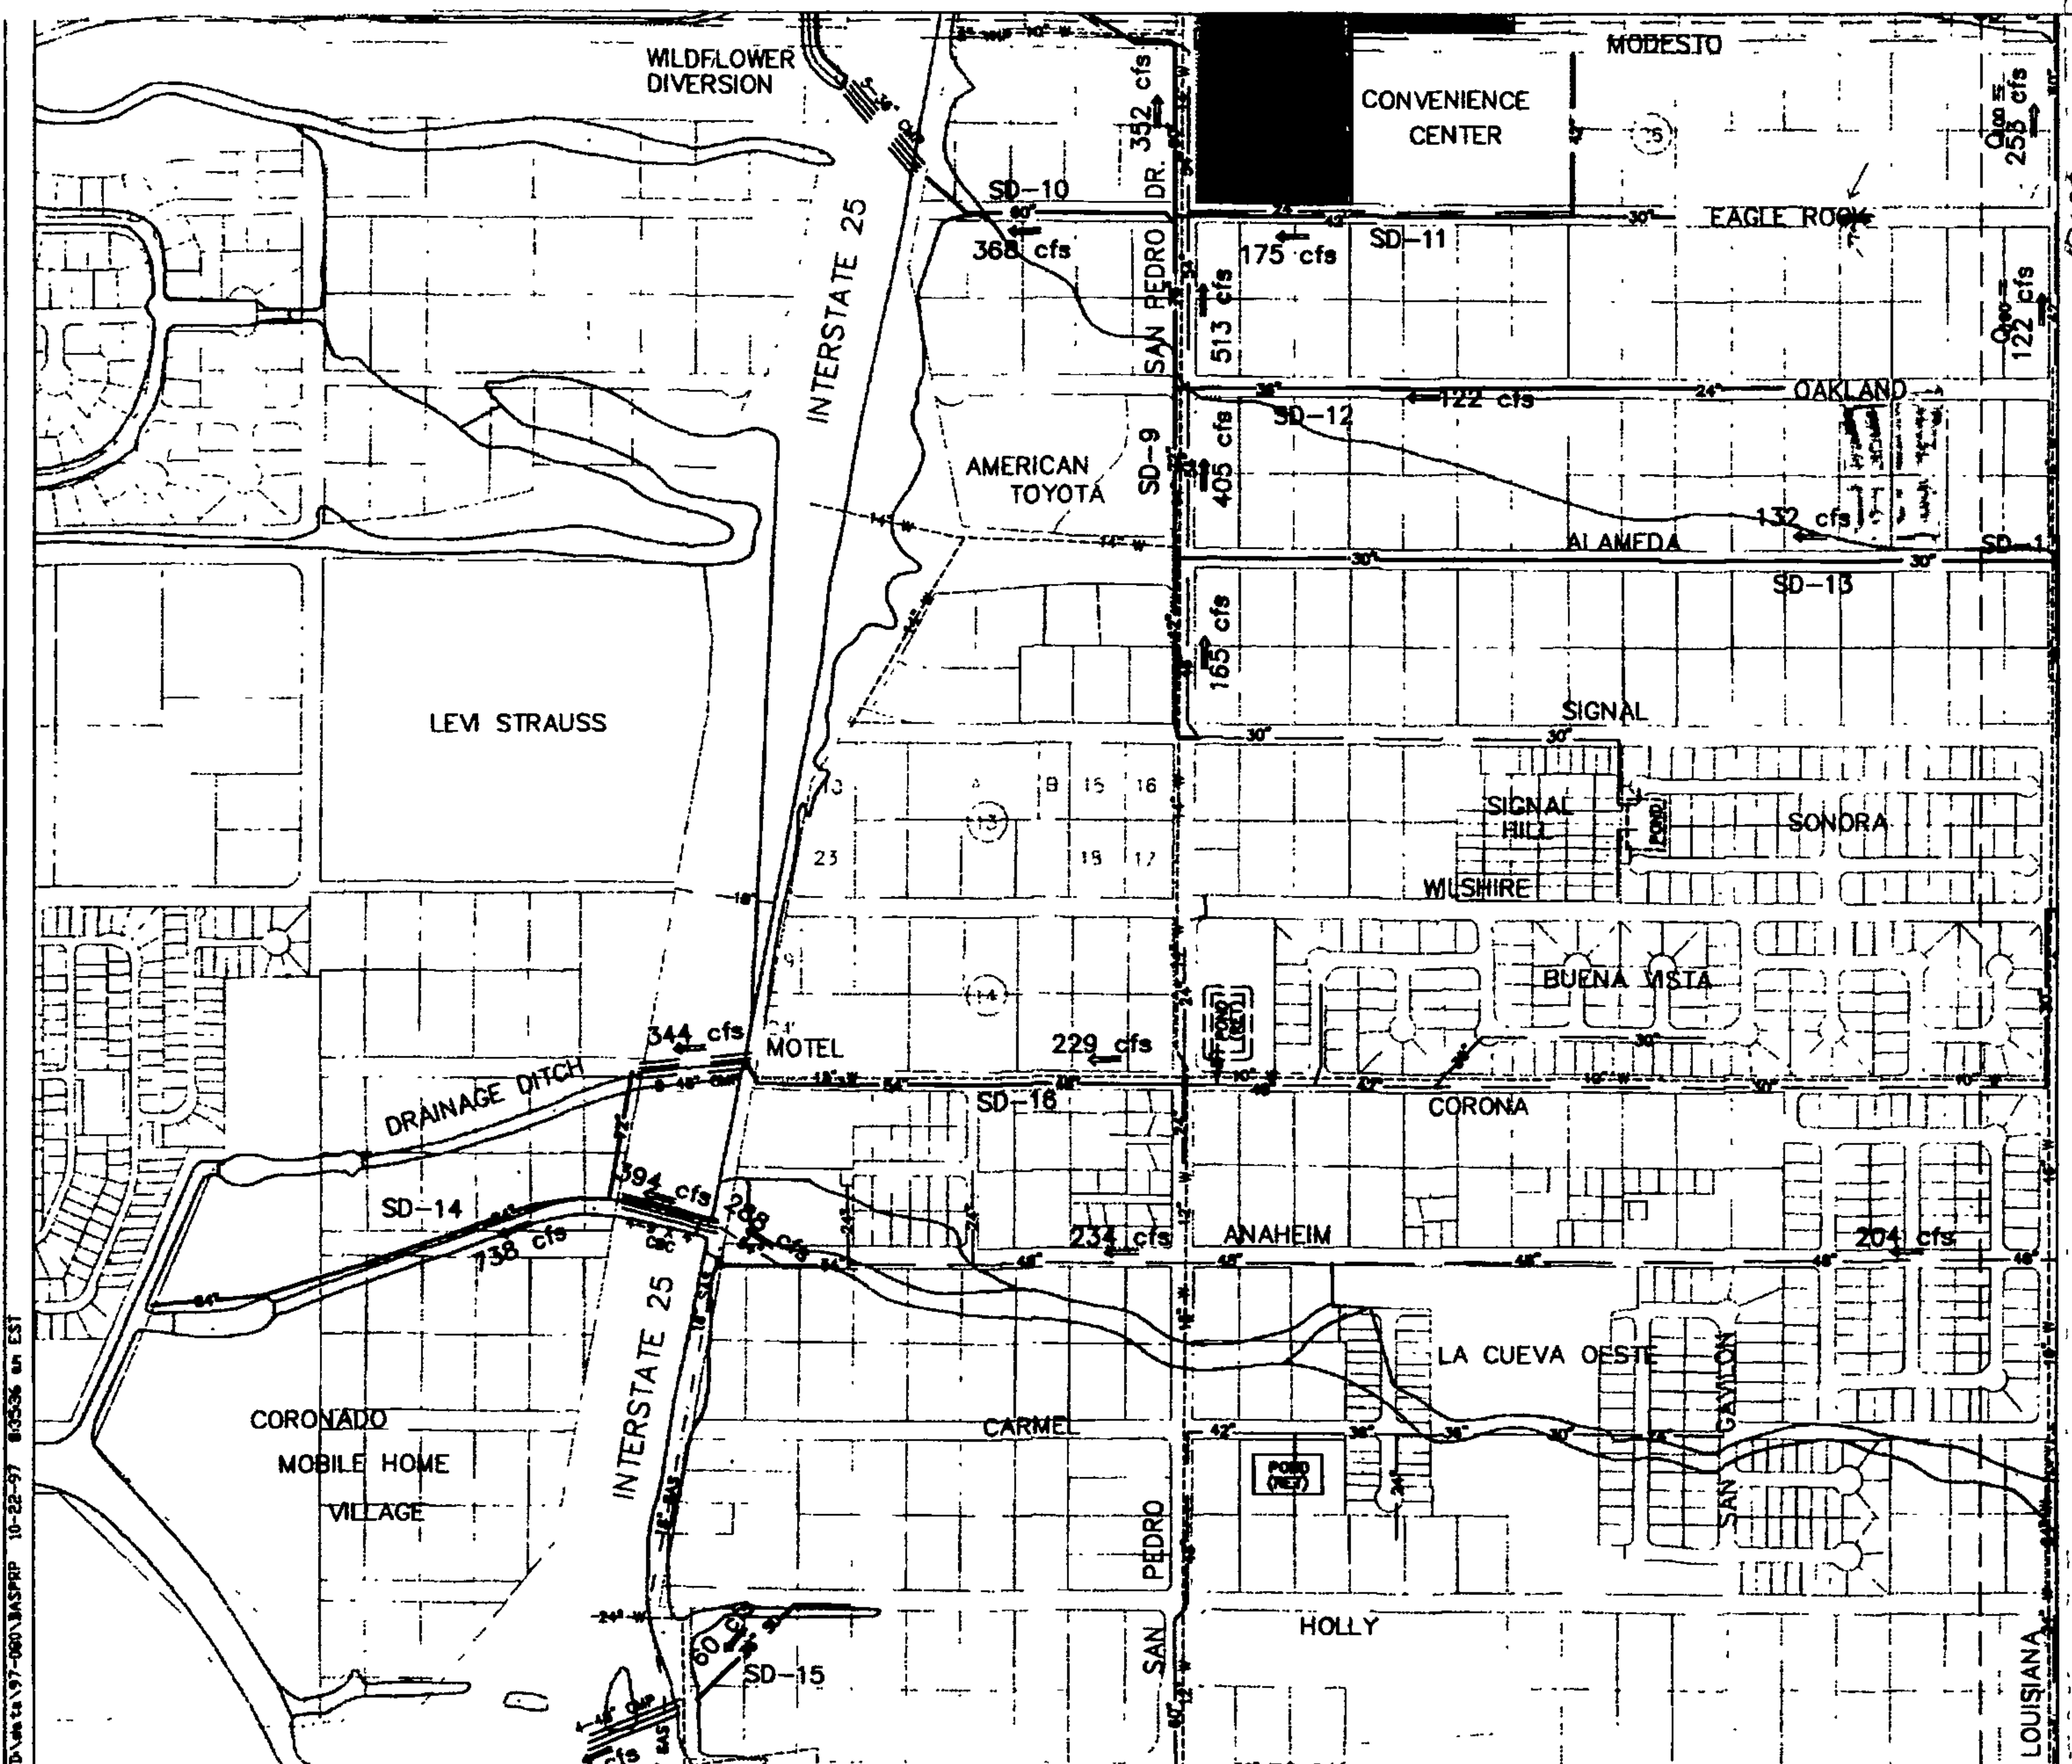

500 0 250 500
(IN FEET)

LEGEND

- MUNICIPAL LIMITS
- EXISTING PLATTING
- EXISTING ARROYO FLOW PATH
- EXISTING WATER LINE
- EXISTING SANITARY SEWER
- EXISTING GAS LINE
- EXISTING STORM DRAIN
- PROPOSED STORM DRAIN
- PROPOSED CHANNEL
- PROPOSED STRUCTURE OR ROAD
- PROPOSED DIKE
- POTENTIAL AVULSION

NOTE:
All flow rates shown are future condition 100-year.

**NORTH ALBUQUERQUE ACRES
MASTER DRAINAGE PLAN**



**STORM DRAIN FACILITIES
C-18**

FIGURE 5D

**CITY OF ALBUQUERQUE
PUBLIC WORKS DEPARTMENT**

Resource Technology, Inc.
Civil Engineering 1720 - B Randolph Road SE
Environmental Sciences Albuquerque, New Mexico 87106
Water Resources E-mail: rti@rti.com
Landscape Architecture Telephone: (505) 243-7300
Planning Facsimile: (505) 243-7400

Date: 10/22/97 10:22:57 10/22/97 10:22:57

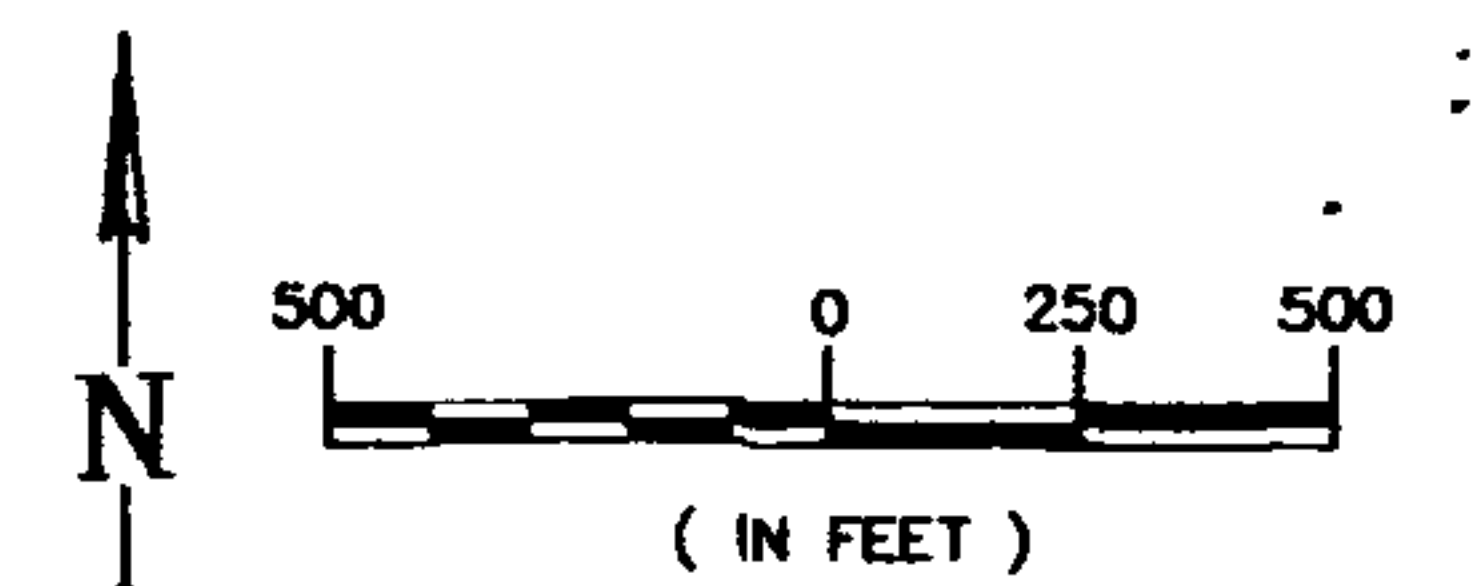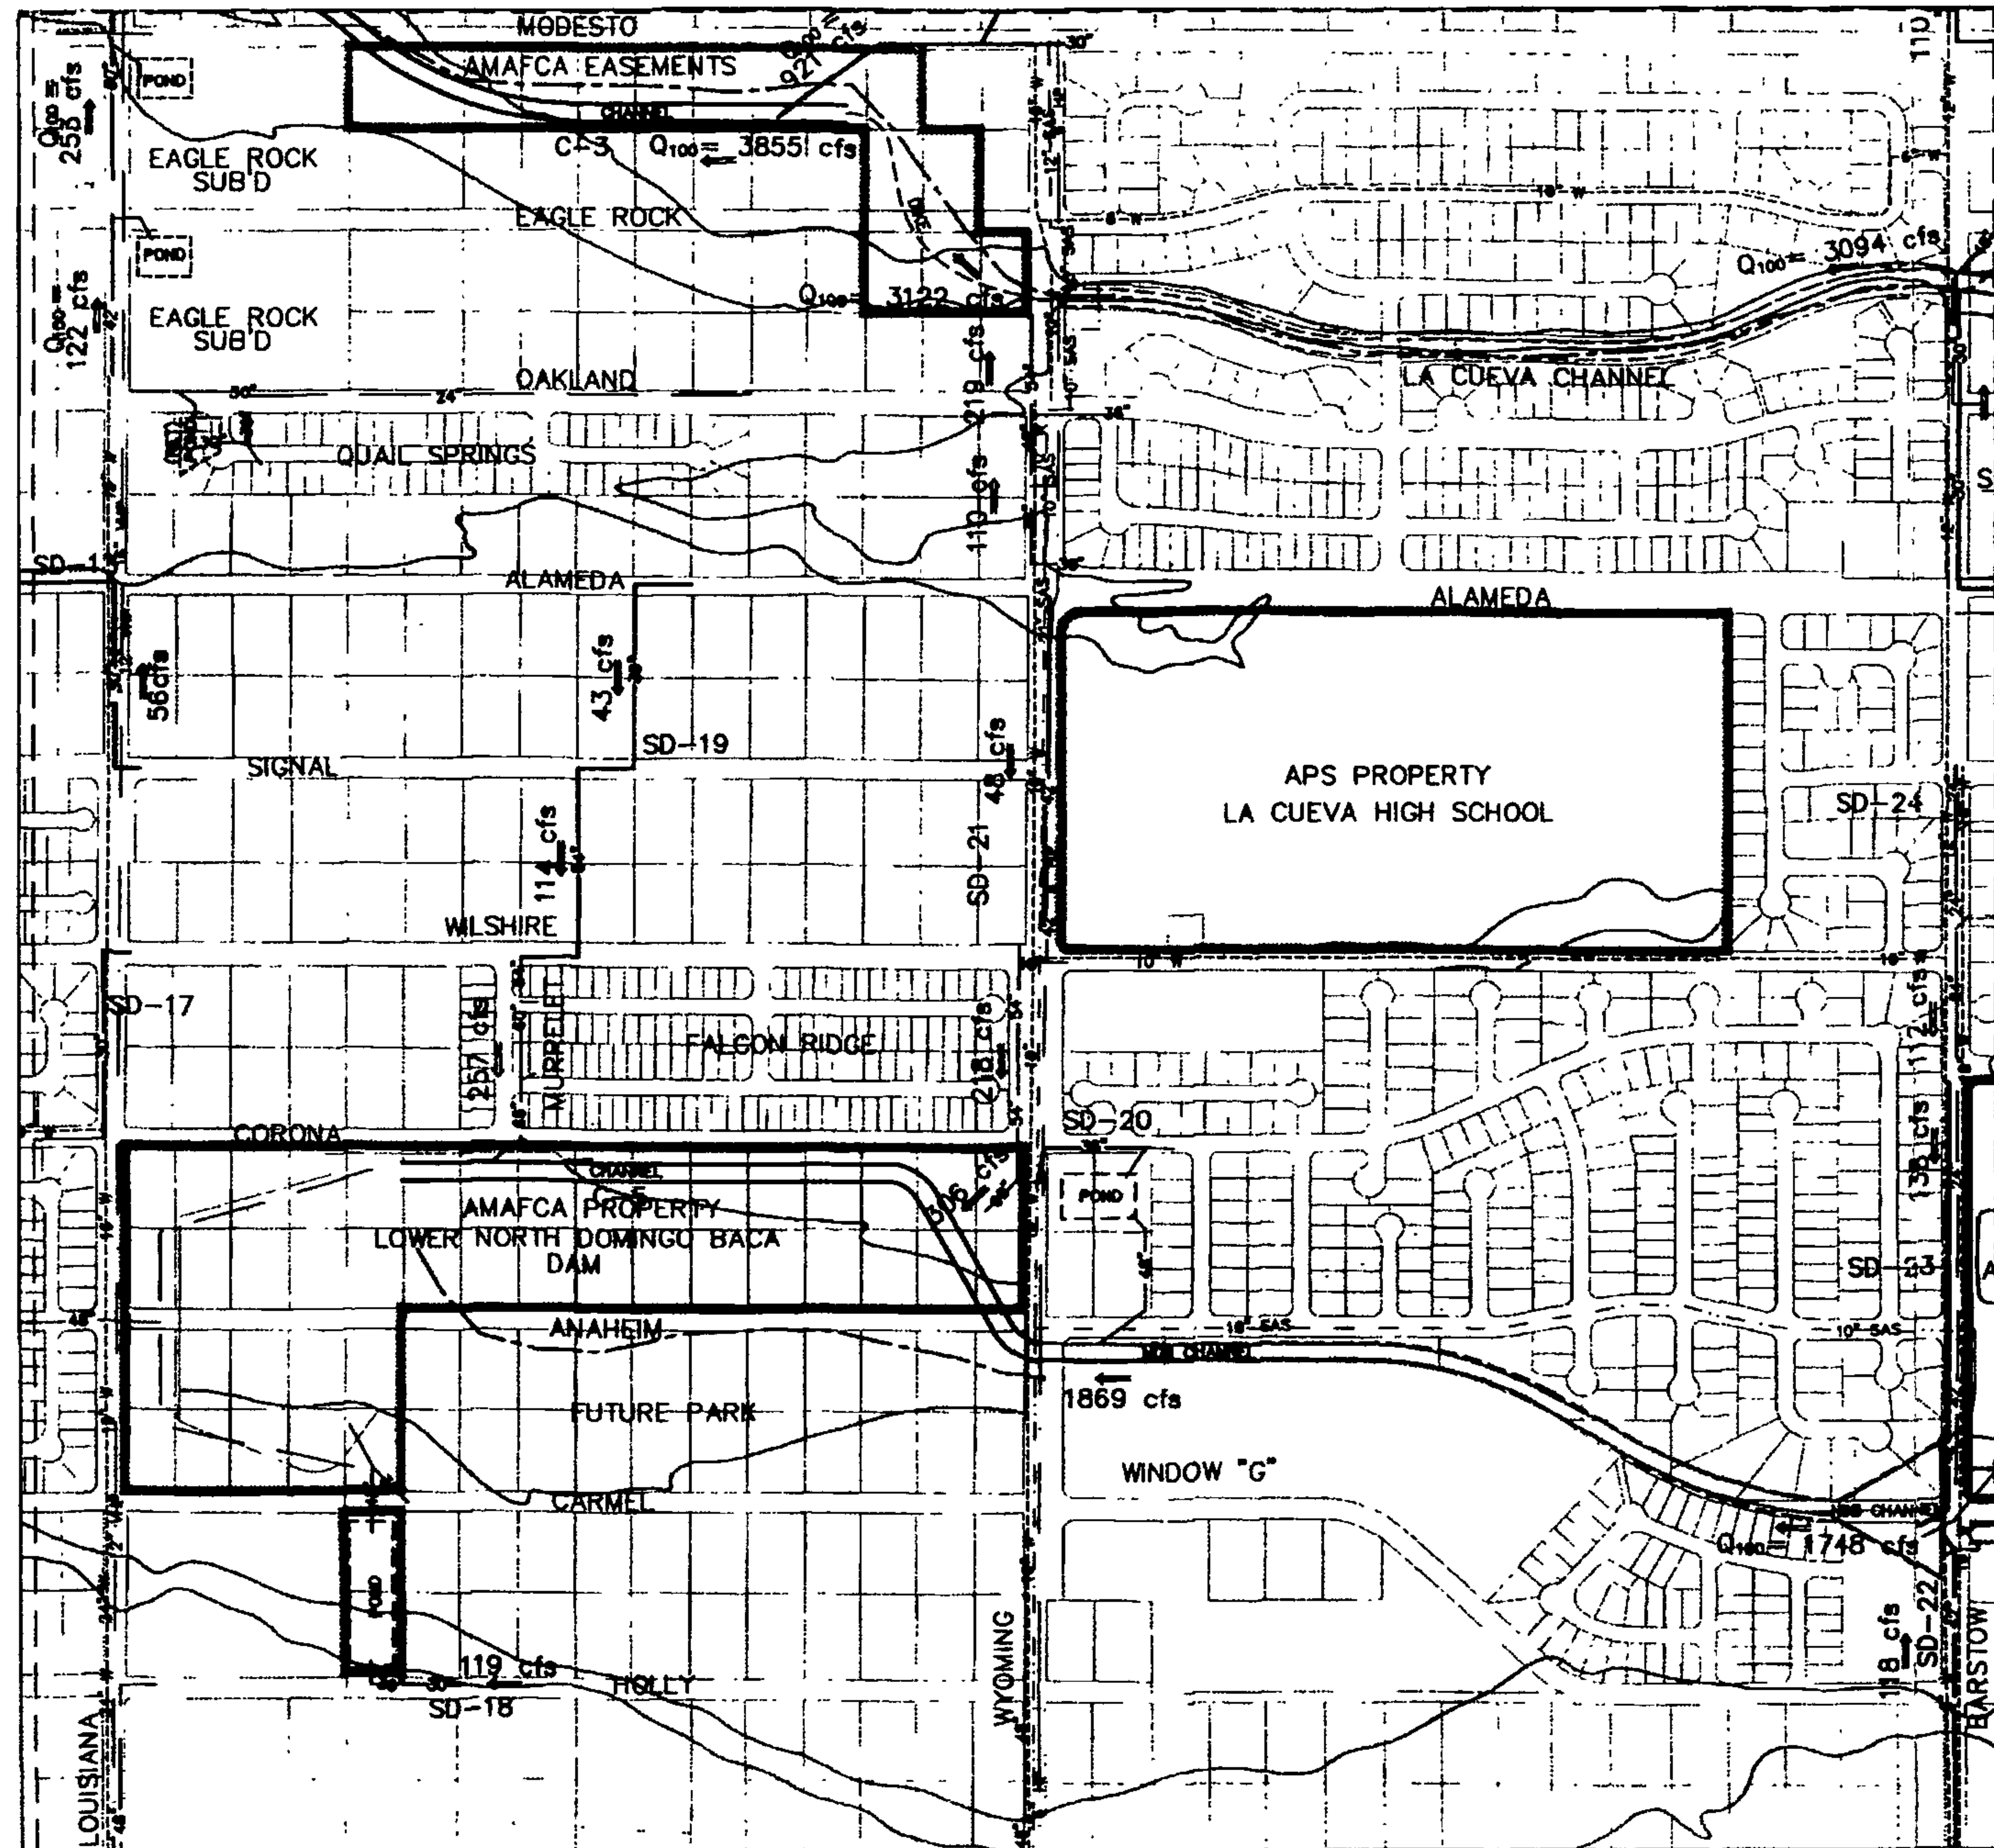

LEGEND

- MUNICIPAL LIMITS
- EXISTING PLATTING
- EXISTING ARROYO FLOW PATH
- EXISTING WATER LINE
- EXISTING SANITARY SEWER
- EXISTING GAS LINE
- EXISTING STORM DRAIN
- PROPOSED STORM DRAIN
- PROPOSED CHANNEL
- PROPOSED STRUCTURE OR ROAD
- PROPOSED DIKE
- POTENTIAL AVULSION

NOTE:
All flow rates shown are
future condition 100-year.

NORTH ALBUQUERQUE ACRES
MASTER DRAINAGE PLAN

STORM DRAIN FACILITIES
C-19

FIGURE 5E

CITY OF ALBUQUERQUE
PUBLIC WORKS DEPARTMENT



Resource Technology, Inc.

Civil Engineering
Environmental Sciences
Water Resources
Landscape Architecture
Planning


1720 - B Randolph Road SE
Albuquerque, New Mexico 87106
E-mail: rti@rti.com
Telephone: (505) 243-7300
Facsimile: (505) 243-7400

TABLE A-2 (cont.)

LA CUEVA ARROYO SUB-BASIN CHARACTERISTICS

Basin ID	Hydrologic Condition	Basin Area (mi ²)	Land Treatment (%)				TP (hrs)
			A	B	C	D	
113*	Existing	.1136	80	0	15	5	.133
	Future	.1000	0	25	15	60	.133
115*	Existing	.1337	80	0	15	5	.133
	Future	.1202	0	26	12	62	.133
116*	Existing	.1309	80	0	5	15	.133
116.1	Future	.1000	0	25	15	50	.133
116.2	Future	.0719	0	25	15	60 50	.133
116.21	Future	.0344	0	40	20	40	.133
117.2*	Existing	.1391	73	0	7	20	.22
	Future	.0500	0	34	16	50	.133
117.21*	Existing	.0234	0	34	16	50	.133
117.22*	Future	.0156	0	20	10	70	.133
117.3*	Existing	.0863	65	5	15	15	.133
	Future	.1172	0	34	16	50	.133
117.31*	Existing	.0250	0	34	16	50	.133
117.32*	Existing	.0090	0	34	16	50	.133
117.4*	Existing	.0750	85	0	5	10	.133
	Future	.0512	0	25	15	60	.133
117.5*	Existing	.0550	0	10	20	70	.133
	Future	.0550	0	10	20	70	.133
118	Existing	.0649	0	20	10	70	.133
	Future	.0649	0	20	10	70	.133
118.1	Existing	.0306	75	5	10	10	.133
	Future	.0306	0	20	30	50	.133
119	Existing	.0549	0	20	10	70	.133
	Future	.0549	0	20	10	70	.133
120	Existing	.0268	50	0	0	50	.133
	Future	.0268	0	20	10	70	.133
121	Existing	.0489	80	0	15	5	.133
	Future	.0489	0	20	10	70	.133

*Modified for COA NAA MDP 9/97

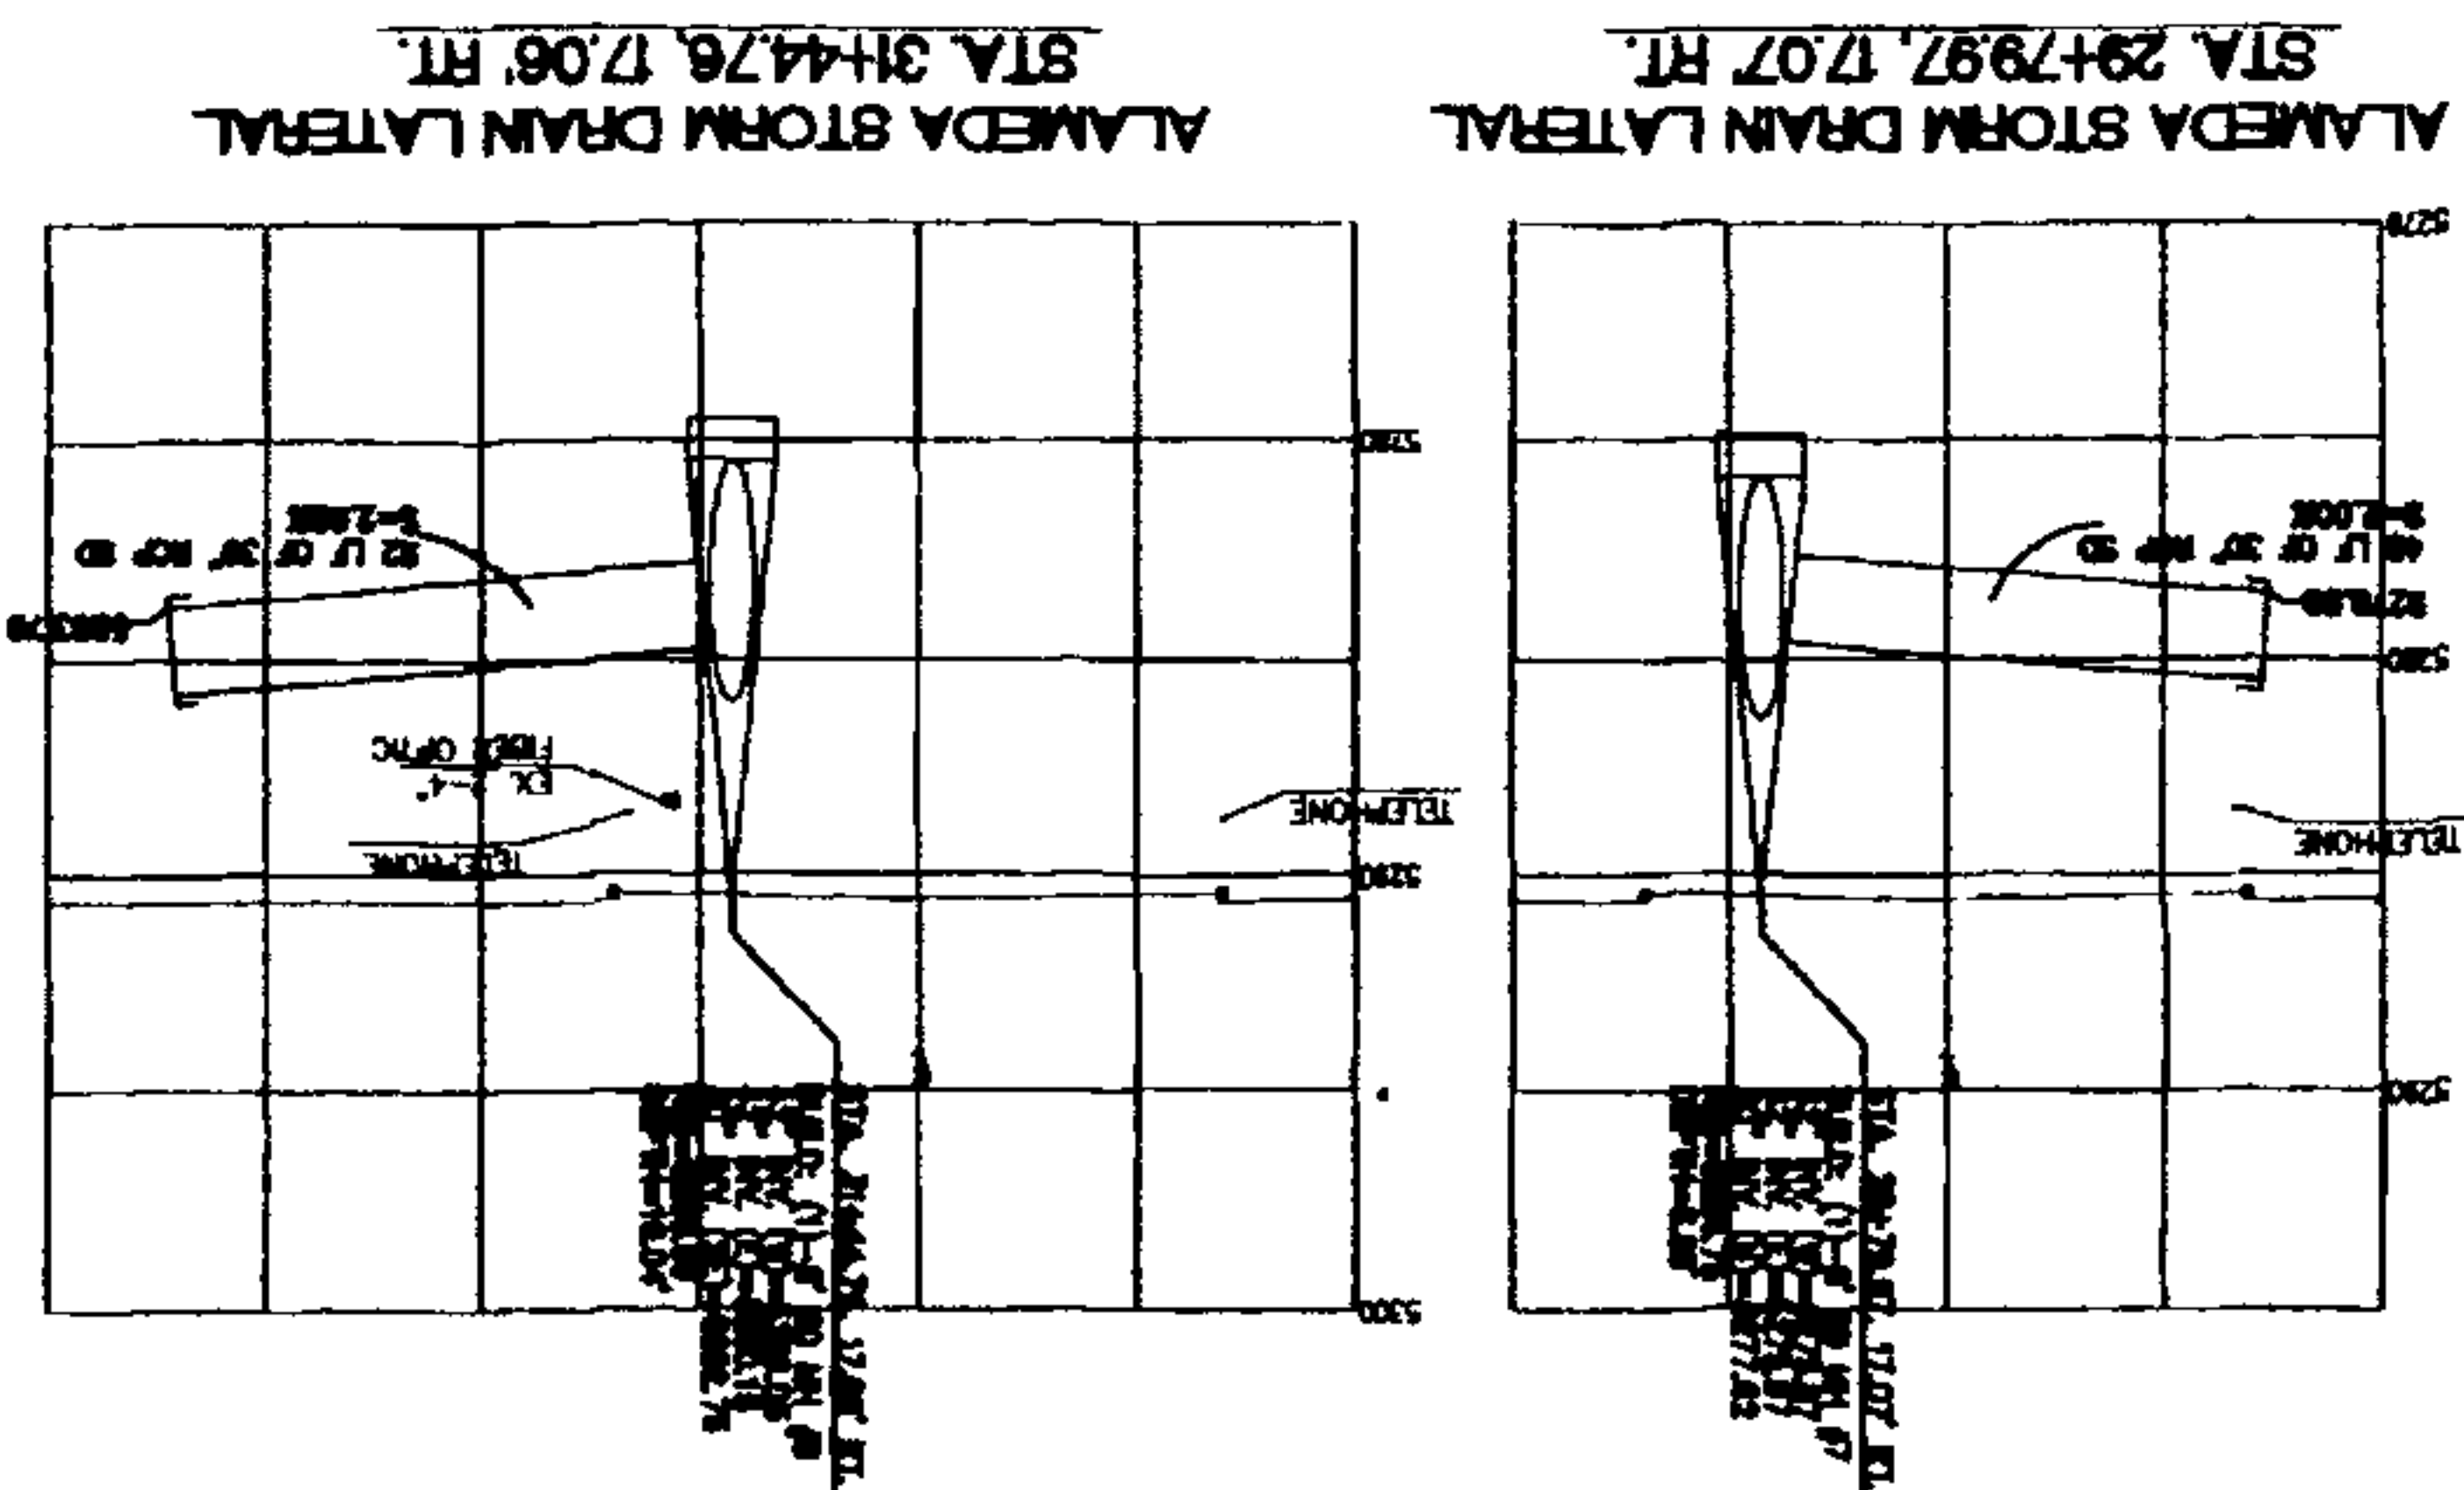


NOTE:
ALL LATERAL STORM DRAINS
ARE CLASS IV.

City Project No. 70833M Design Review Committee APPROVED JAN 11 2013		Zone Map No. C-8/C-9 City Engineer APPROVED JAN 11 2013		Sheet 11-A-1 of 11	
TITLE: ALAMEDA BLVD. WIDENING LATERALS CITY OF ALBUQUERQUE DEPARTMENT OF ALTERNATE DEVELOPMENT ENGINEERING DIVISION					
DESIGNED BY: DBT DRAWN BY: DBT CHECKED BY: DBT					
NO. DATE 11501 12-2012 11502 12-2012 11503 12-2012					
REMARKS: REVISIONS BY: DBT DATE: 12-2012					
ENGINEER'S SEAL 1-4713					
SURVEY INFORMATION FIELD NOTES NO. BY DATE 11501 SURVEY CONTROL NO. 11-2010 11502 11503					
BENCH MARKS Coordinates shown herein are modified (surface) NAD 83 and were derived by leveling station from grid coordinates by the project survey on or after 12/1/2010. Elevation was 1140.00 and are adjusted to the NGS Control Station 10-518 1140.00 (published elevation = 1140.00) The coordinates and elevations are US Survey Feet					
AS BUILT INFORMATION CONTRACTOR DATE 11501 11502 11503					

APPENDIX B

SITE HYDROLOGY

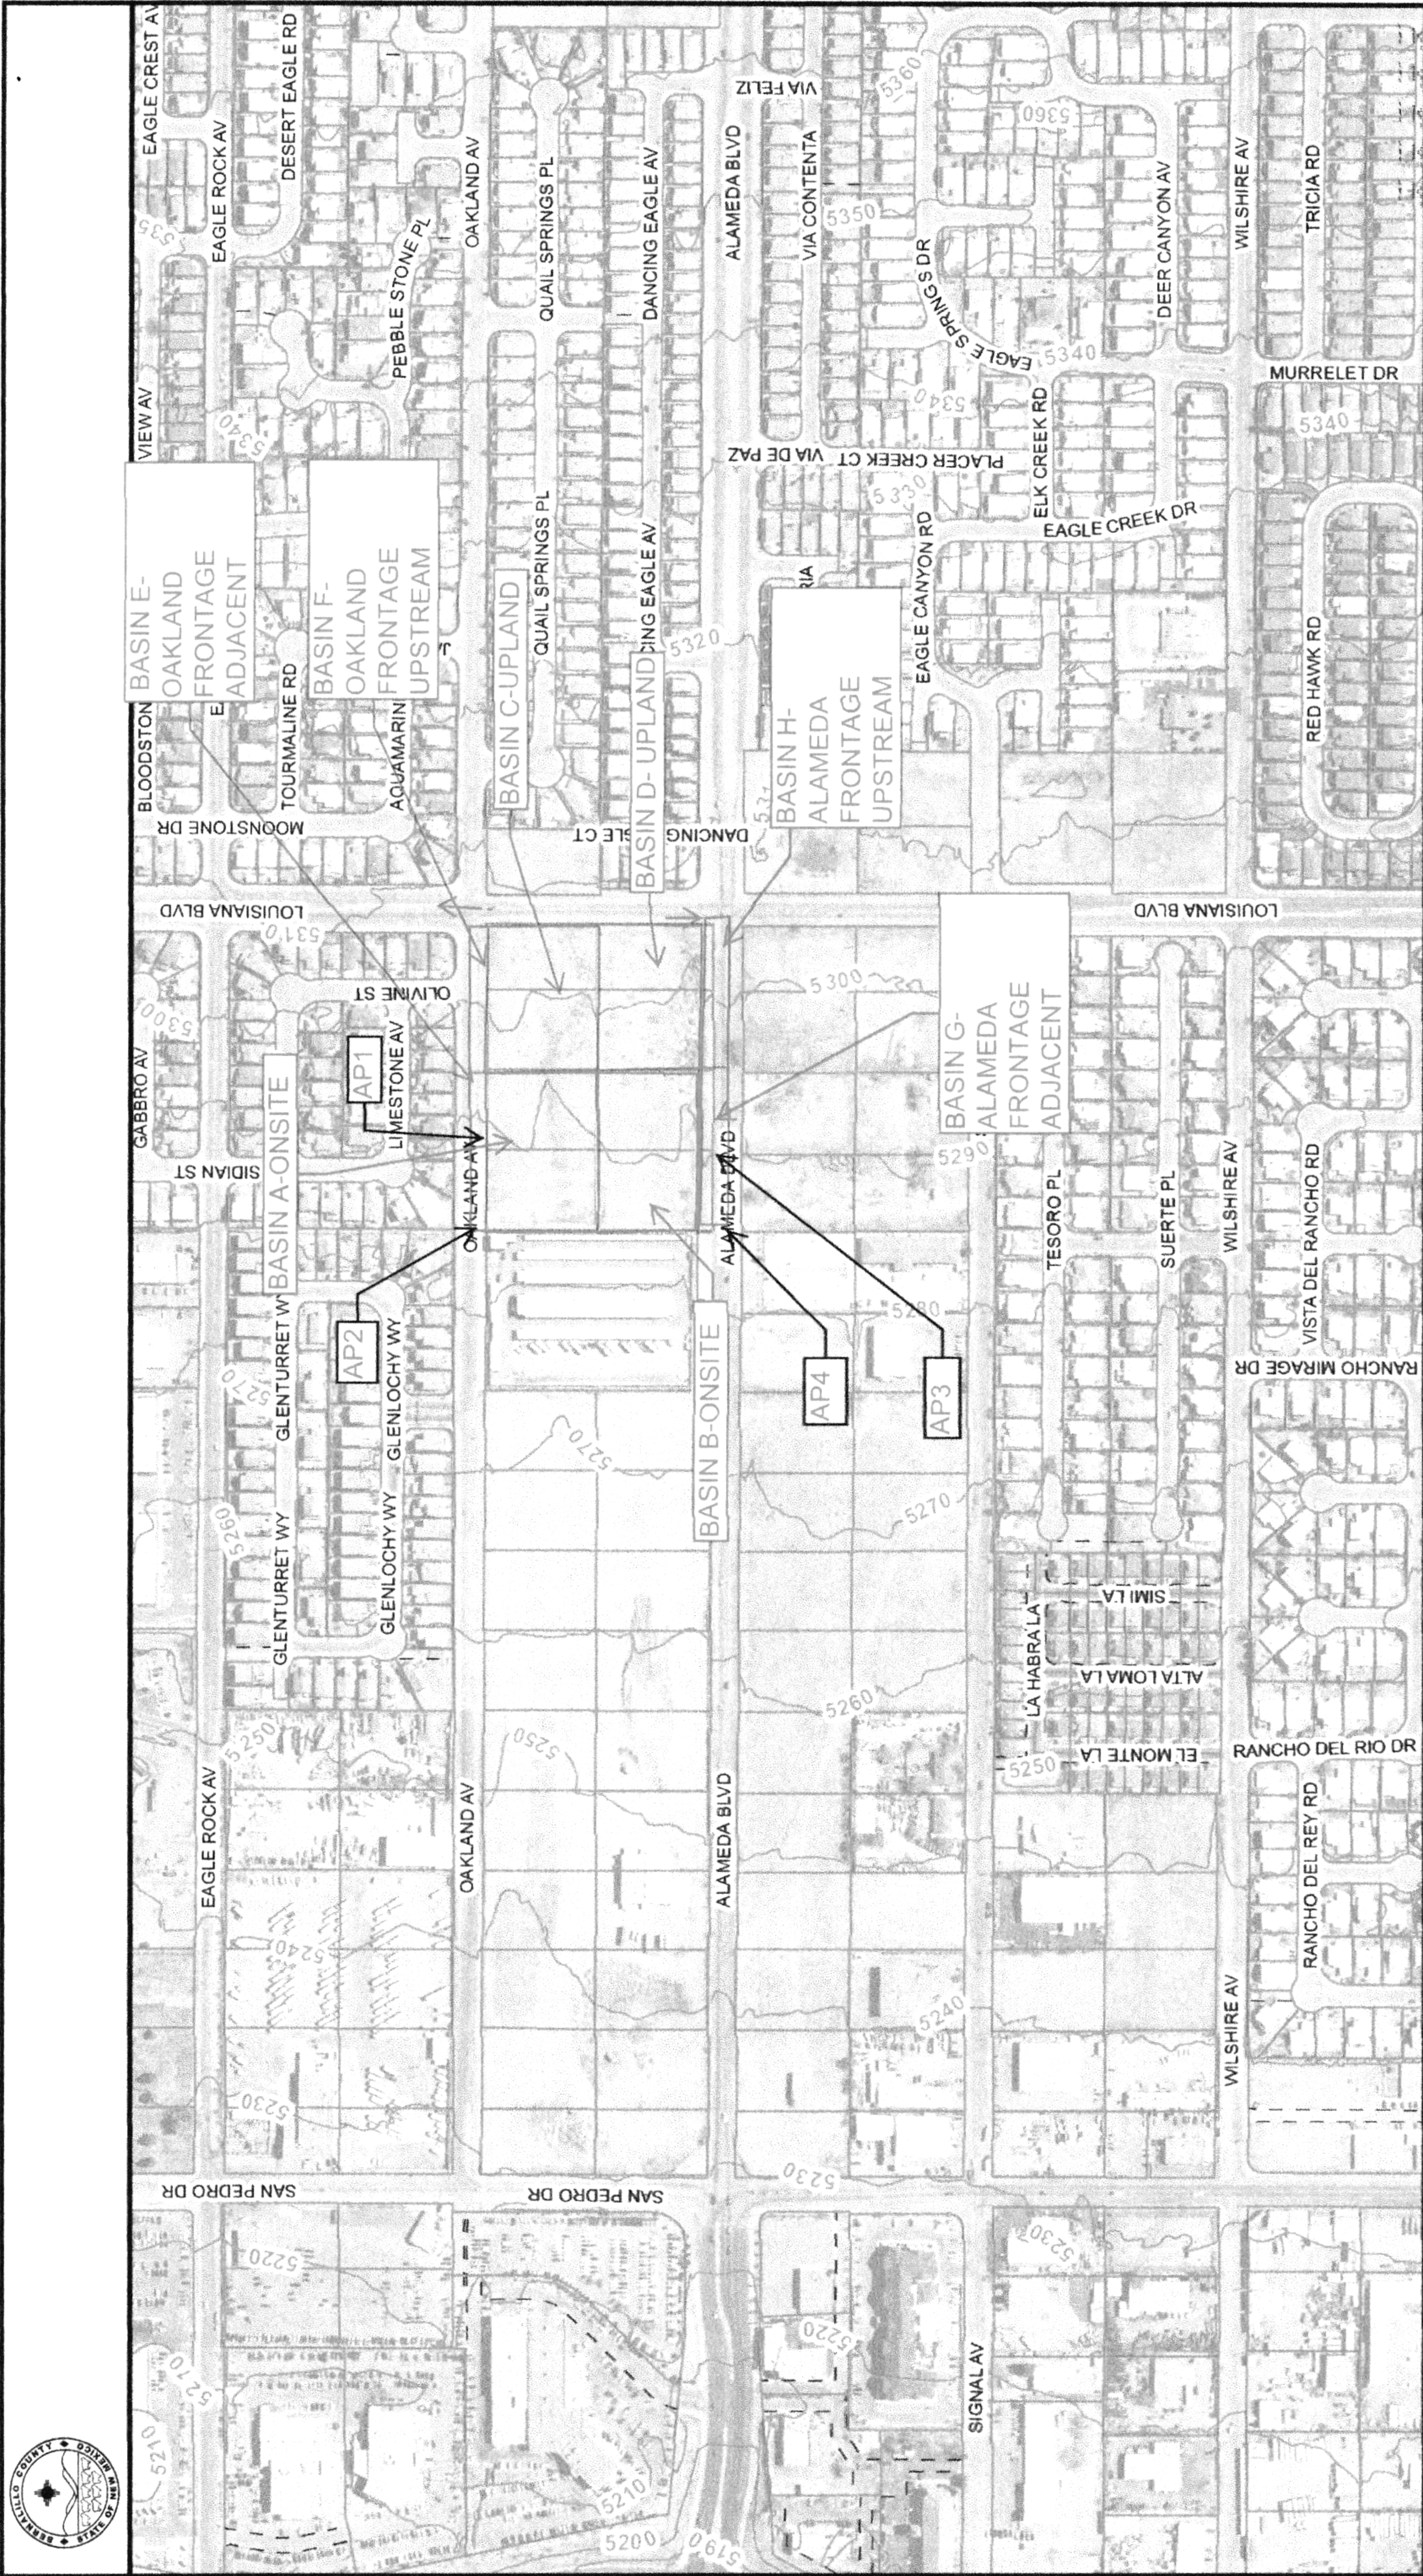

8/15/14	This information is for reference only. Bernalillo County assumes no liability for errors associated with the use of these data. Users are solely responsible for confirming data accuracy when necessary. For current information visit www.bermco.gov/gis-program .	Notes
	0 373.20 746.4 Feet	

Weighted E Method **SIVER OAK SUBDIVISION**

Existing Basins

											100-Year, 6-hr.			10-day
Basin	Area (sf)	Area (acres)	Treatment A		Treatment B		Treatment C		Treatment D		Weighted E (ac-ft)	Volume (ac-ft)	Flow cfs	Volume (ac-ft)
			%	(acres)	%	(acres)	%	(acres)	%	(acres)				
BASIN A	77220	1.773	60%	1.06364	40.0%	0.709	0 0%	0	0%	0.000	0.764	0.113	3.83	0.113
BASIN B	77220	1.773	60%	1.06364	40.0%	0.709	0 0%	0	0%	0.000	0.764	0.113	3.83	0.113
BASIN C	70200	1.612	80%	1.28926	20.0%	0.322	0.0%	0	0%	0.000	0.712	0.096	3.25	0.096
BASIN D	70200	1.612	80%	1.28926	20.0%	0.322	0.0%	0	0%	0.000	0.712	0.096	3.25	0.096
BASIN E	9900	0.227	0%	0	50.0%	0.114	0.0%	0	50%	0.114	1.640	0.031	0.87	0.046
BASIN F	9000	0.207	0%	0	50.0%	0.103	0 0%	0	50%	0.103	1.640	0.028	0.79	0.042
BASIN G	19800	0.455	0%	0	50.0%	0.227	0 0%	0	50%	0.227	1.640	0.062	1.73	0.092
BASIN H	18000	0.413	0%	0	50.0%	0.207	0.0%	0	50%	0.207	0.645	0.022	1.50	0.050

Equations:

Weighted E = Ea*Aa + Eb*Ab + Ec*Ac + Ed*Ad / (Total Area)

Volume = Weighted D * Total Area

Flow = Qa * Aa + Qb * Ab + Qc * Ac + Qd * Ad

4916.34

Where for 100-year, 6-hour storm (zone 3)

Ea= 0.66	Qa= 1.87
Eb= 0.92	Qb= 2.6
Ec= 1.29	Qc= 3.45
Ed= 2.36	Qd= 5.02

FLOW SUMMARY

TOTAL FLOW AT AP1- FLOW LEAVING SITE AT OAKLAND (ULTIMATE)	3.83	CFS	
TOTAL FLOW AT AP2- NEW INLET AT OAKLAND NW AT SITE	8.73	CFS	
TOTAL FLOW AT AP3. LEAVING SITE TO EXISTING STUB	3.83	CFS	
TOTAL FLOW AT AP4- NEW INLET AT ALAMEDA, SW AT SITE	8.81	CFS	* BASIN CAPTURED BY UPSTREAM INLET
TOTAL ALLOWABLE FLOW AT A PER NAA	160	CFS	

Not necessarily the
 "allowable" for this site

Weighted E Method

SIVER OAK SUBDIVISION

Developed Basins

Basin	Area (sf)	Area (acres)	Treatment A		Treatment B		Treatment C		Treatment D		100-Year, 6-hr.			10-day
			%	(acres)	%	(acres)	%	(acres)	%	(acres)	Weighted E (ac-ft)	Volume (ac-ft)	Flow cfs	Volume (ac-ft)
BASIN A*	69220	1.589	0%	0	26.0%	0.413	13.0%	0.20658	64%	1.017	1.917	0.254	6.89	0.389
BASIN B*	69220	1.589	0%	0	26.0%	0.413	14.0%	0.22247	63%	1.001	1.907	0.252	6.87	0.386
BASIN C	70200	1.612	0%	0	34.0%	0.548	17.0%	0.27397	50%	0.806	1.712	0.230	6.41	0.337
BASIN D	70200	1.612	0%	0	34.0%	0.548	16.0%	0.25785	50%	0.806	1.699	0.228	6.36	0.336
BASIN E	9900	0.227	0%	0	20.0%	0.045	0.0%	0	80%	0.182	2.072	0.039	1.03	0.063
BASIN F	9000	0.207	0%	0	20.0%	0.041	0.0%	0	80%	0.165	2.072	0.036	0.94	0.058
BASIN G	19800	0.455	0%	0	30.0%	0.136	0.0%	0	70%	0.318	1.928	0.073	1.95	0.115
BASIN H	18000	0.413	0%	0	30.0%	0.124	0.0%	0	70%	0.289	0.387	0.013	2.42	0.052

Equations:

Weighted E = $E_a \cdot A_a + E_b \cdot A_b + E_c \cdot A_c + E_d \cdot A_d$ / (Total Area)

Volume = Weighted D * Total Area

Flow = $Q_a \cdot A_a + Q_b \cdot A_b + Q_c \cdot A_c + Q_d \cdot A_d$

Where for 100-year, 6-hour storm (zone 3)

$E_a = 0.66$
 $E_b = 0.92$
 $E_c = 1.29$
 $E_d = 2.36$

$Q_a = 1.87$
 $Q_b = 2.6$
 $Q_c = 3.45$
 $Q_d = 5.02$

Show how the first flush vol. is arrived at, otherwise ≤ 7.0 is 124.5

FIRST FLUSH PER LOT-95 CFS

* rear yard ponds do not discharge, so area (8,000sf) removed from basins
land treatments updated based upon rear yard pond not contributing

FLOW SUMMARY

TOTAL FLOW AT AP1- FLOW LEAVING SITE AT OAKLAND (ULTIMATE)	proposed 6.89 CFS	allowed 7.09
TOTAL FLOW AT AP2- NEW INLET AT OAKLAND NW AT SITE	15.28 CFS	
TOTAL FLOW AT AP3- LEAVING SITE TO EXISTING STUB	6.87 CFS	7.09
TOTAL FLOW AT AP4- NEW INLET AT ALAMEDA, SW AT SITE	15.18 CFS	** BASIN CAPTURED BY UPSTREAM INLE

INLET FLOWS(ULTIMATE)

INLET AT AP2- 15.28CFS
INLET AT AP4- =6.87 CFS IN PIPE, 8.31 SURFACE FLOW ASSUMING BASIN D IS NOT PLACED IN PIPE
INLET AT CULDESAC =6.87 CFS

$$\%D = 1.017 + 1.001 = 2.018 \text{ ac}$$

$$(2.018 \text{ ac})(.34 \text{ in}) = 124.5 \text{ CF}$$

Weighted E Method **SIVER OAK SUBDIVISION**

NAA ALLOWED

											100-Year, 6-hr.			10-day
Basin	Area (sf)	Area (acres)	Treatment A		Treatment B		Treatment C		Treatment D		Weighted E (ac-ft)	Volume (ac-ft)	Flow cfs	Volume (ac-ft)
			%	(acres)	%	(acres)	%	(acres)	%	(acres)				
BASIN A	77220	1.773	0%	0	36.0%	0.638	16.0%	0.28364	50%	0.886	1.718	0.254	7.09	0.372
BASIN B	77220	1.773	0%	0	36.0%	0.638	16.0%	0.28364	50%	0.886	1.718	0.254	7.09	0.372
BASIN C	70200	1.612	0%	0	36.0%	0.580	16.0%	0.25785	50%	0.806	1.718	0.231	6.44	0.338
BASIN D	70200	1.612	0%	0	36.0%	0.580	16.0%	0.25785	50%	0.806	1.718	0.231	6.44	0.338
BASIN E	9900	0.227	0%	0	36.0%	0.082	16.0%	0.03636	50%	0.114	1.718	0.033	0.91	0.048
BASIN F	9000	0.207	0%	0	36.0%	0.074	16.0%	0.03306	50%	0.103	1.718	0.030	0.83	0.043
BASIN G	19800	0.455	0%	0	36.0%	0.164	16.0%	0.07273	50%	0.227	1.718	0.065	1.82	0.095
BASIN H	18000	0.413	0%	0	36.0%	0.149	16.0%	0.06612	50%	0.207	0.842	0.029	2.31	0.057

Equations:

Weighted E = Ea*Aa + Eb*Ab + Ec*Ac + Ed*Ad / (Total Area)

Volume = Weighted D * Total Area

Flow = Qa * Aa + Qb * Ab + Qc * Ac + Qd * Ad

16200.76

Where for 100-year, 6-hour storm (zone 3)

Ea= 0.66	Qa= 1.87
Eb= 0.92	Qb= 2.6
Ec= 1.29	Qc= 3.45
Ed= 2.36	Qd= 5.02

APPENDIX C

HYDRAULIC CALCULATIONS

SIDEWALK CULVERT

Weir Equation:

$$Q = CLH^{3/2}$$

$$Q = 7 \text{ cfs}$$

$$C = 2.95$$

$$H = 0.5 \text{ ft}$$

L = Length of weir

$$Q = 2.95 * 2 * .67^{1.5} = 3.23$$

Q = 6.89, therefore use 3 with capacity of 9.7 cfs

DROP INLET CALCULATIONS

Inlet	TYPE OF INLET	AREA (SF)	Q (CFS)	H (FT)	H ALLOW (FT)
culdesac	double	8.86	34.9	0.6693	0.67

ORIFICE EQUATION

$$Q = CA \sqrt{2gH} \quad H = (Q/CA)^2 / 2G$$

$$C = 0.6$$

$$g = 32.2$$

INLET GRATE=40"X25"

CALCULATE FOR BARS

40-(11*.5) 34.5"

25-(13*.5) 18.5"

OPENING IS 4.43 SF PER GRATE

USING DOUBLE FLOW DUE TO SUMP

In plan dated 12-11-15
 only ~~1~~ ² grates a single
 grate is shown,
 so $\frac{34.9}{2} \approx$ new capacity
 $= 17.45$ cfs cap
 Q for Basin B = 7.09
 50% clogging = $(7.09)^2 =$
 14.18 cfs needed
 ✓

Pipe Capacity

Pipe	D	Slope	Area	R	Q Provided	Q Required	Velocity
	(in)	(%)	(ft^2)		(cfs)	(cfs)	(ft/s)
18rcp	18	2	1.77	0.375	12.91	6.03	3.41

Manning's Equation:

$Q = 1.49/n * A * R^{(2/3)} * S^{(1/2)}$

A = Area


R = D/4

S = Slope

n = 0.015

GRATING CAPACITIES FOR TYPE DOUBLE

"C," AND "D"

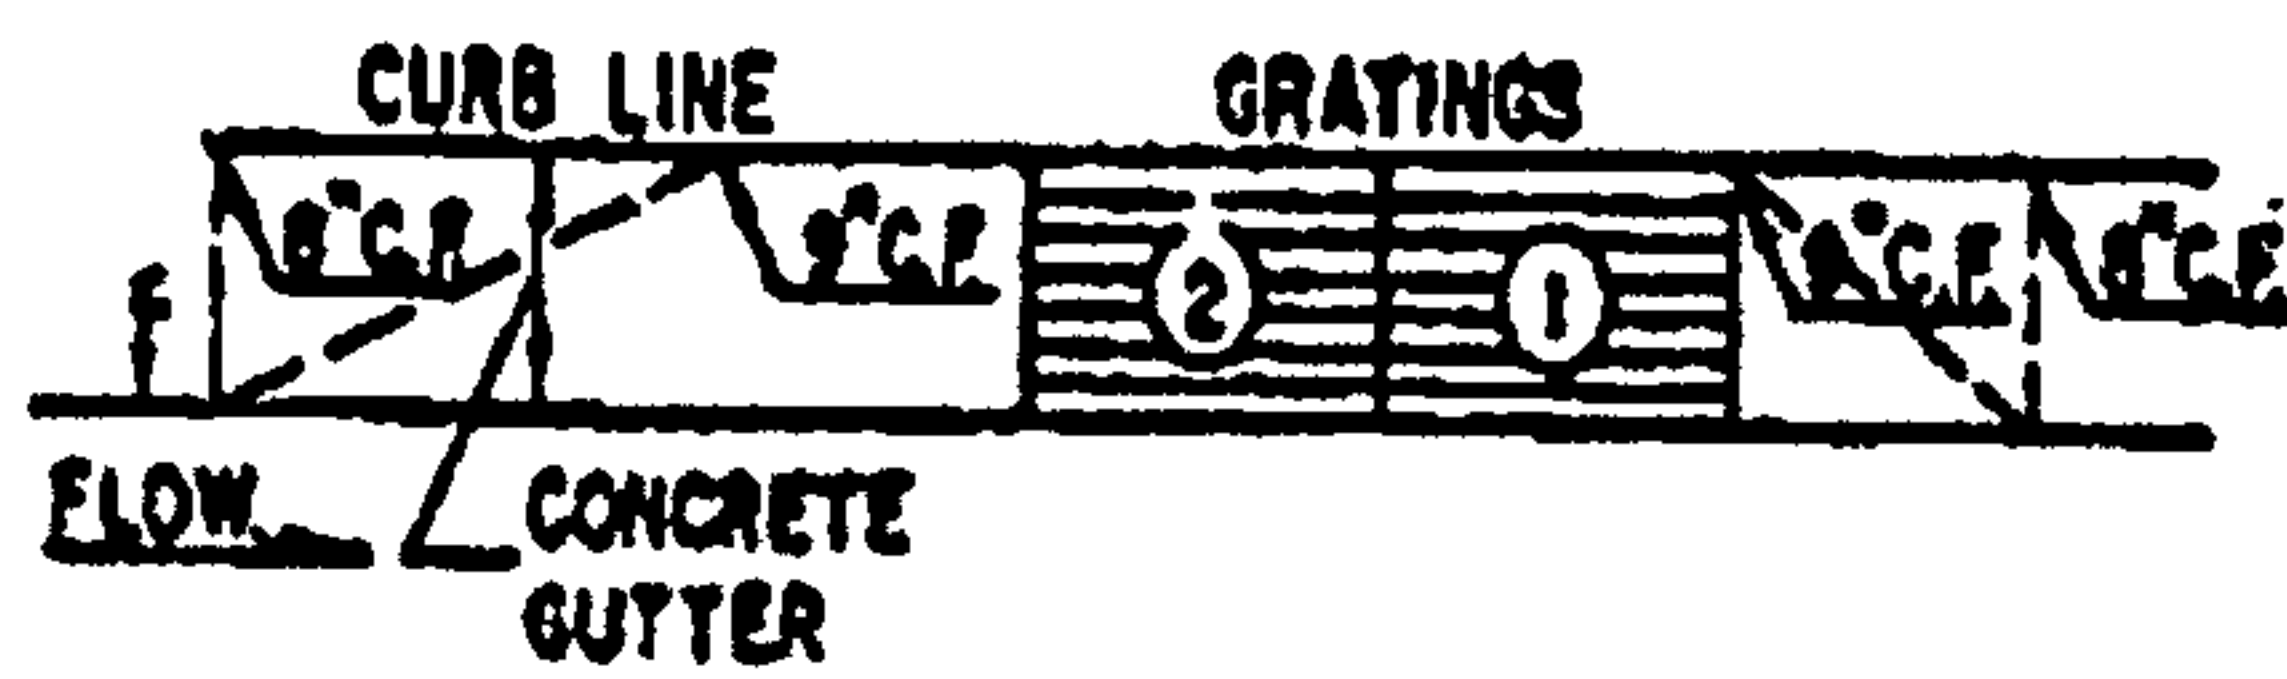

GRATING & GUTTER PLAN



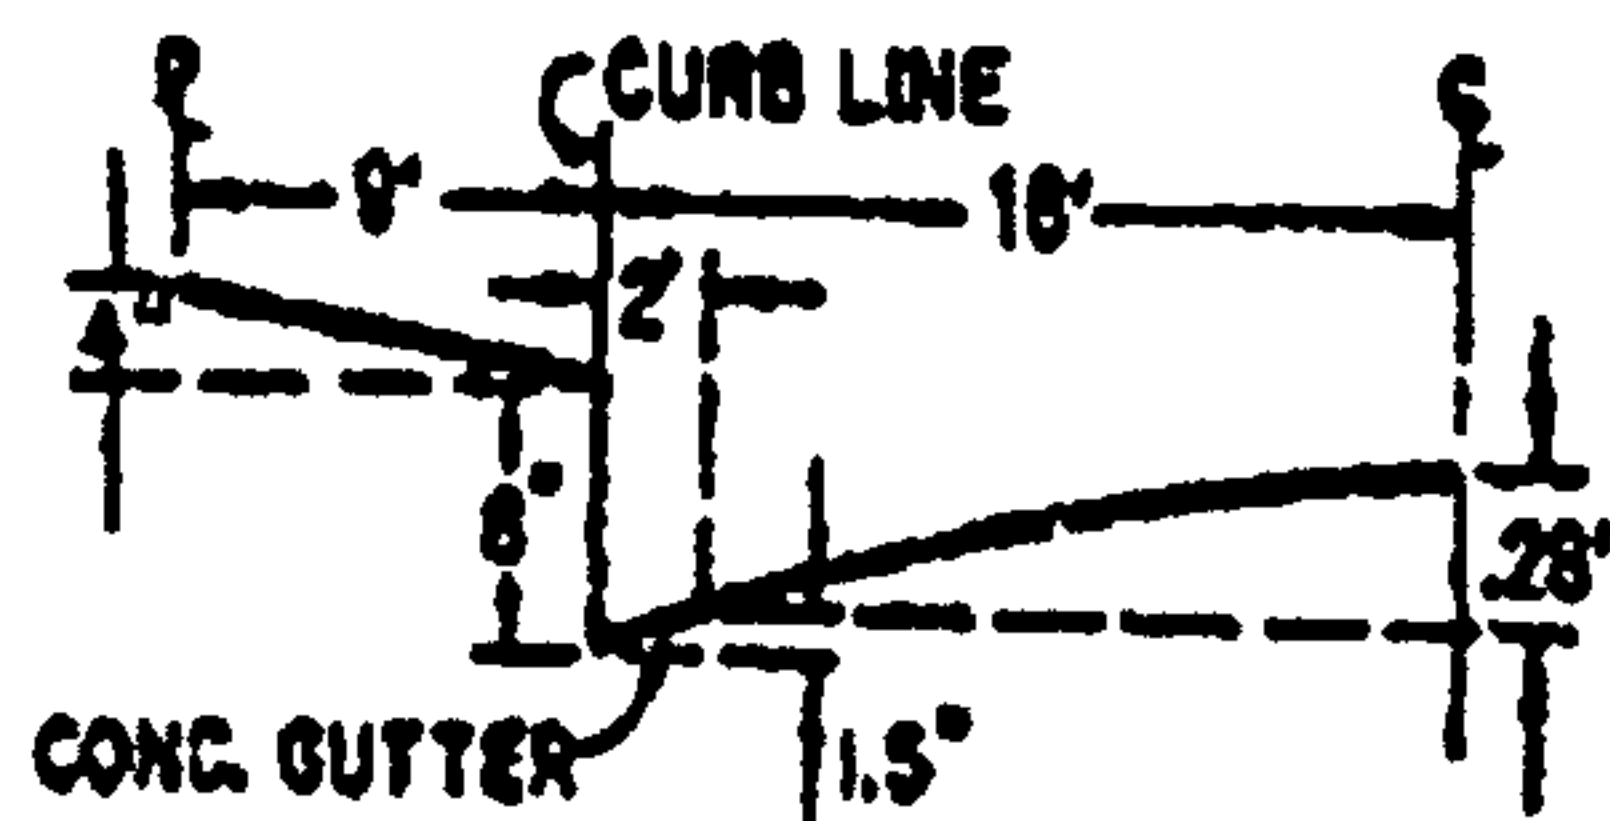
TYPICAL HALF STREET SECTION
(ABOVE BASIN)


PLATE 22.3 D-6

 $Q = 15.28 \text{ CFS}$, $\text{SLOPE} = 2.5\%$, $\text{DEPTH} = .66$


GRATING CAPACITIES FOR TYPE 'A' , 'C' and 'D'

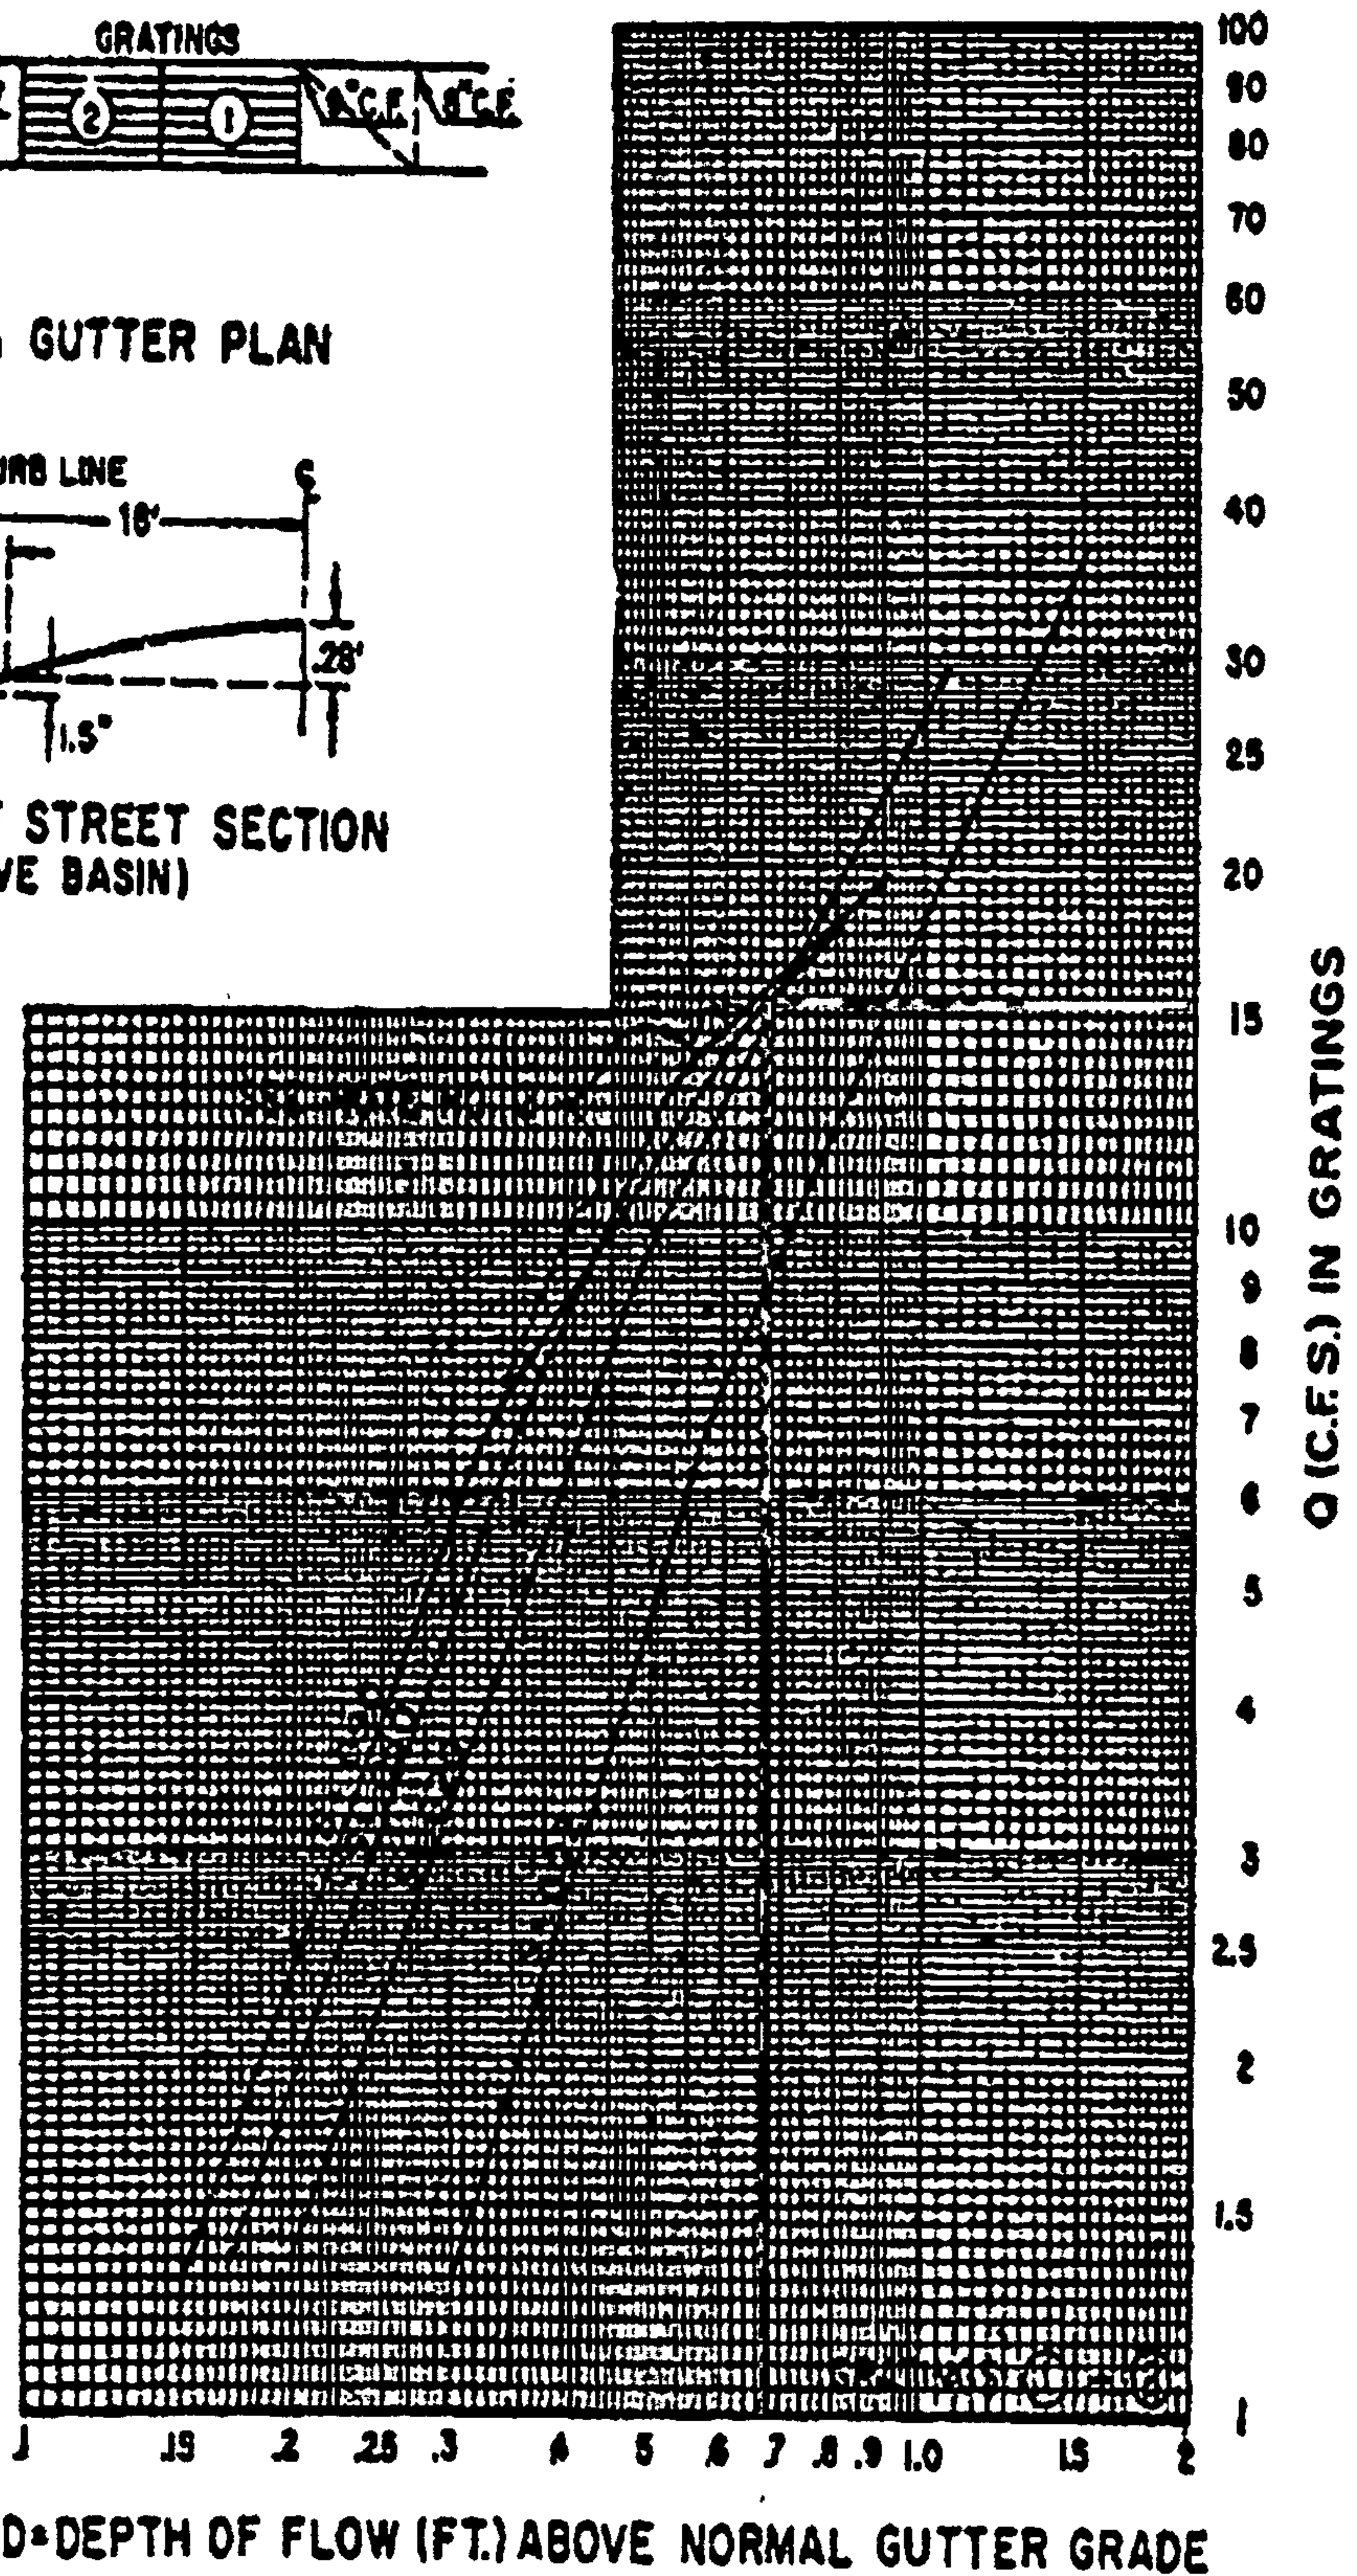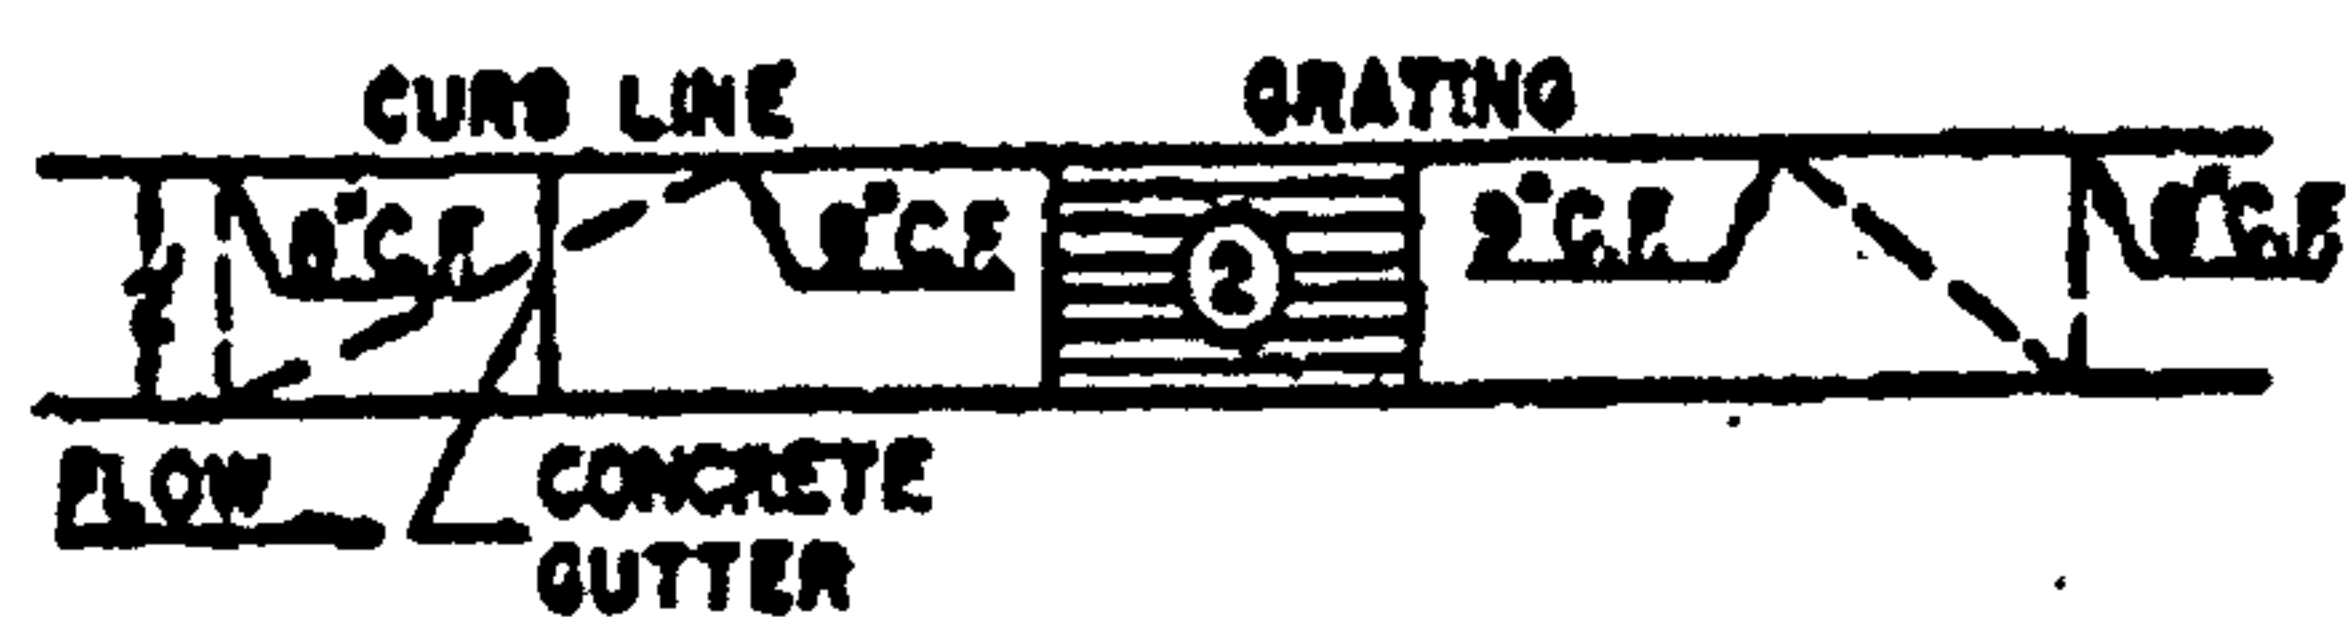

GRATING & GUTTER PLAN

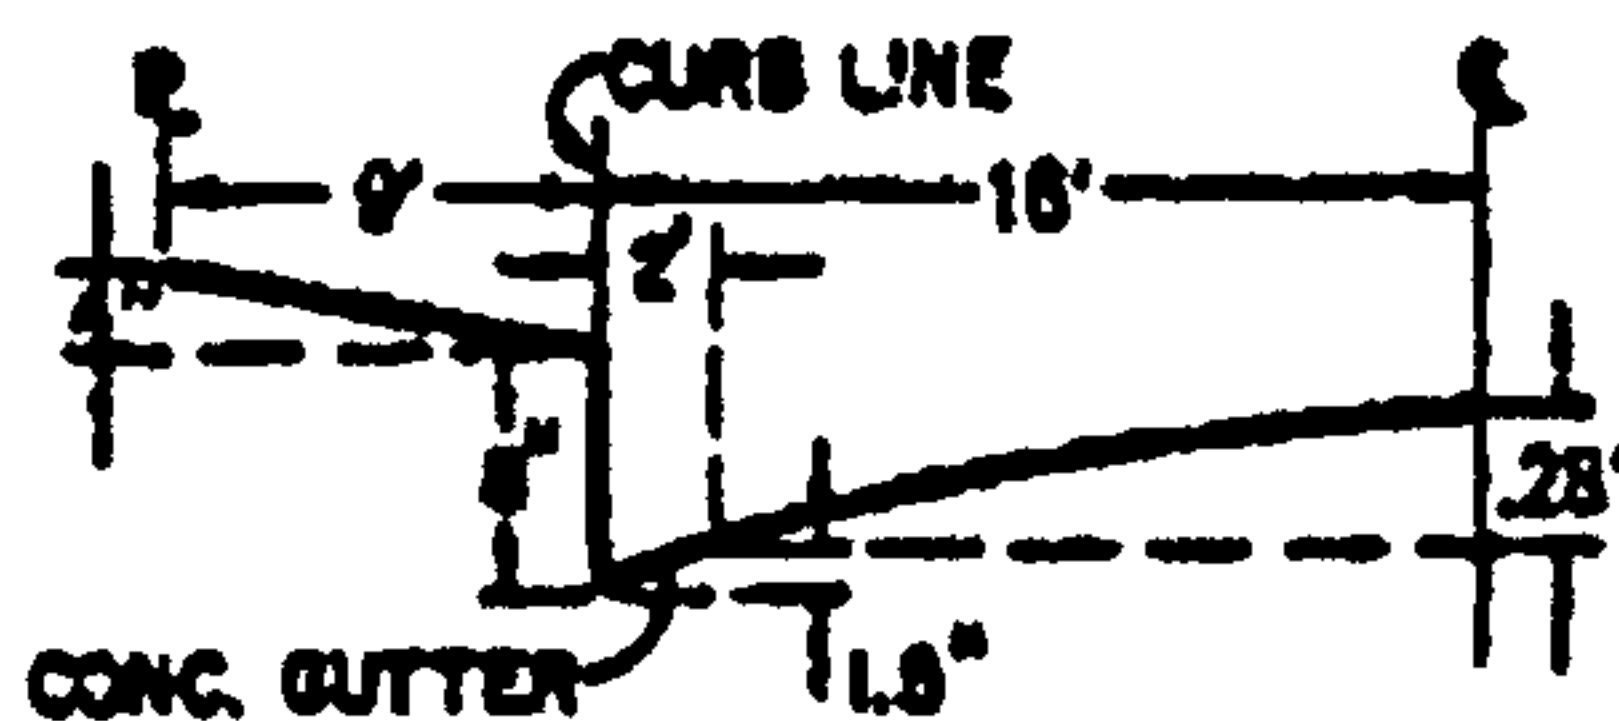

TYPICAL HALF STREET SECTION
(ABOVE BASIN)

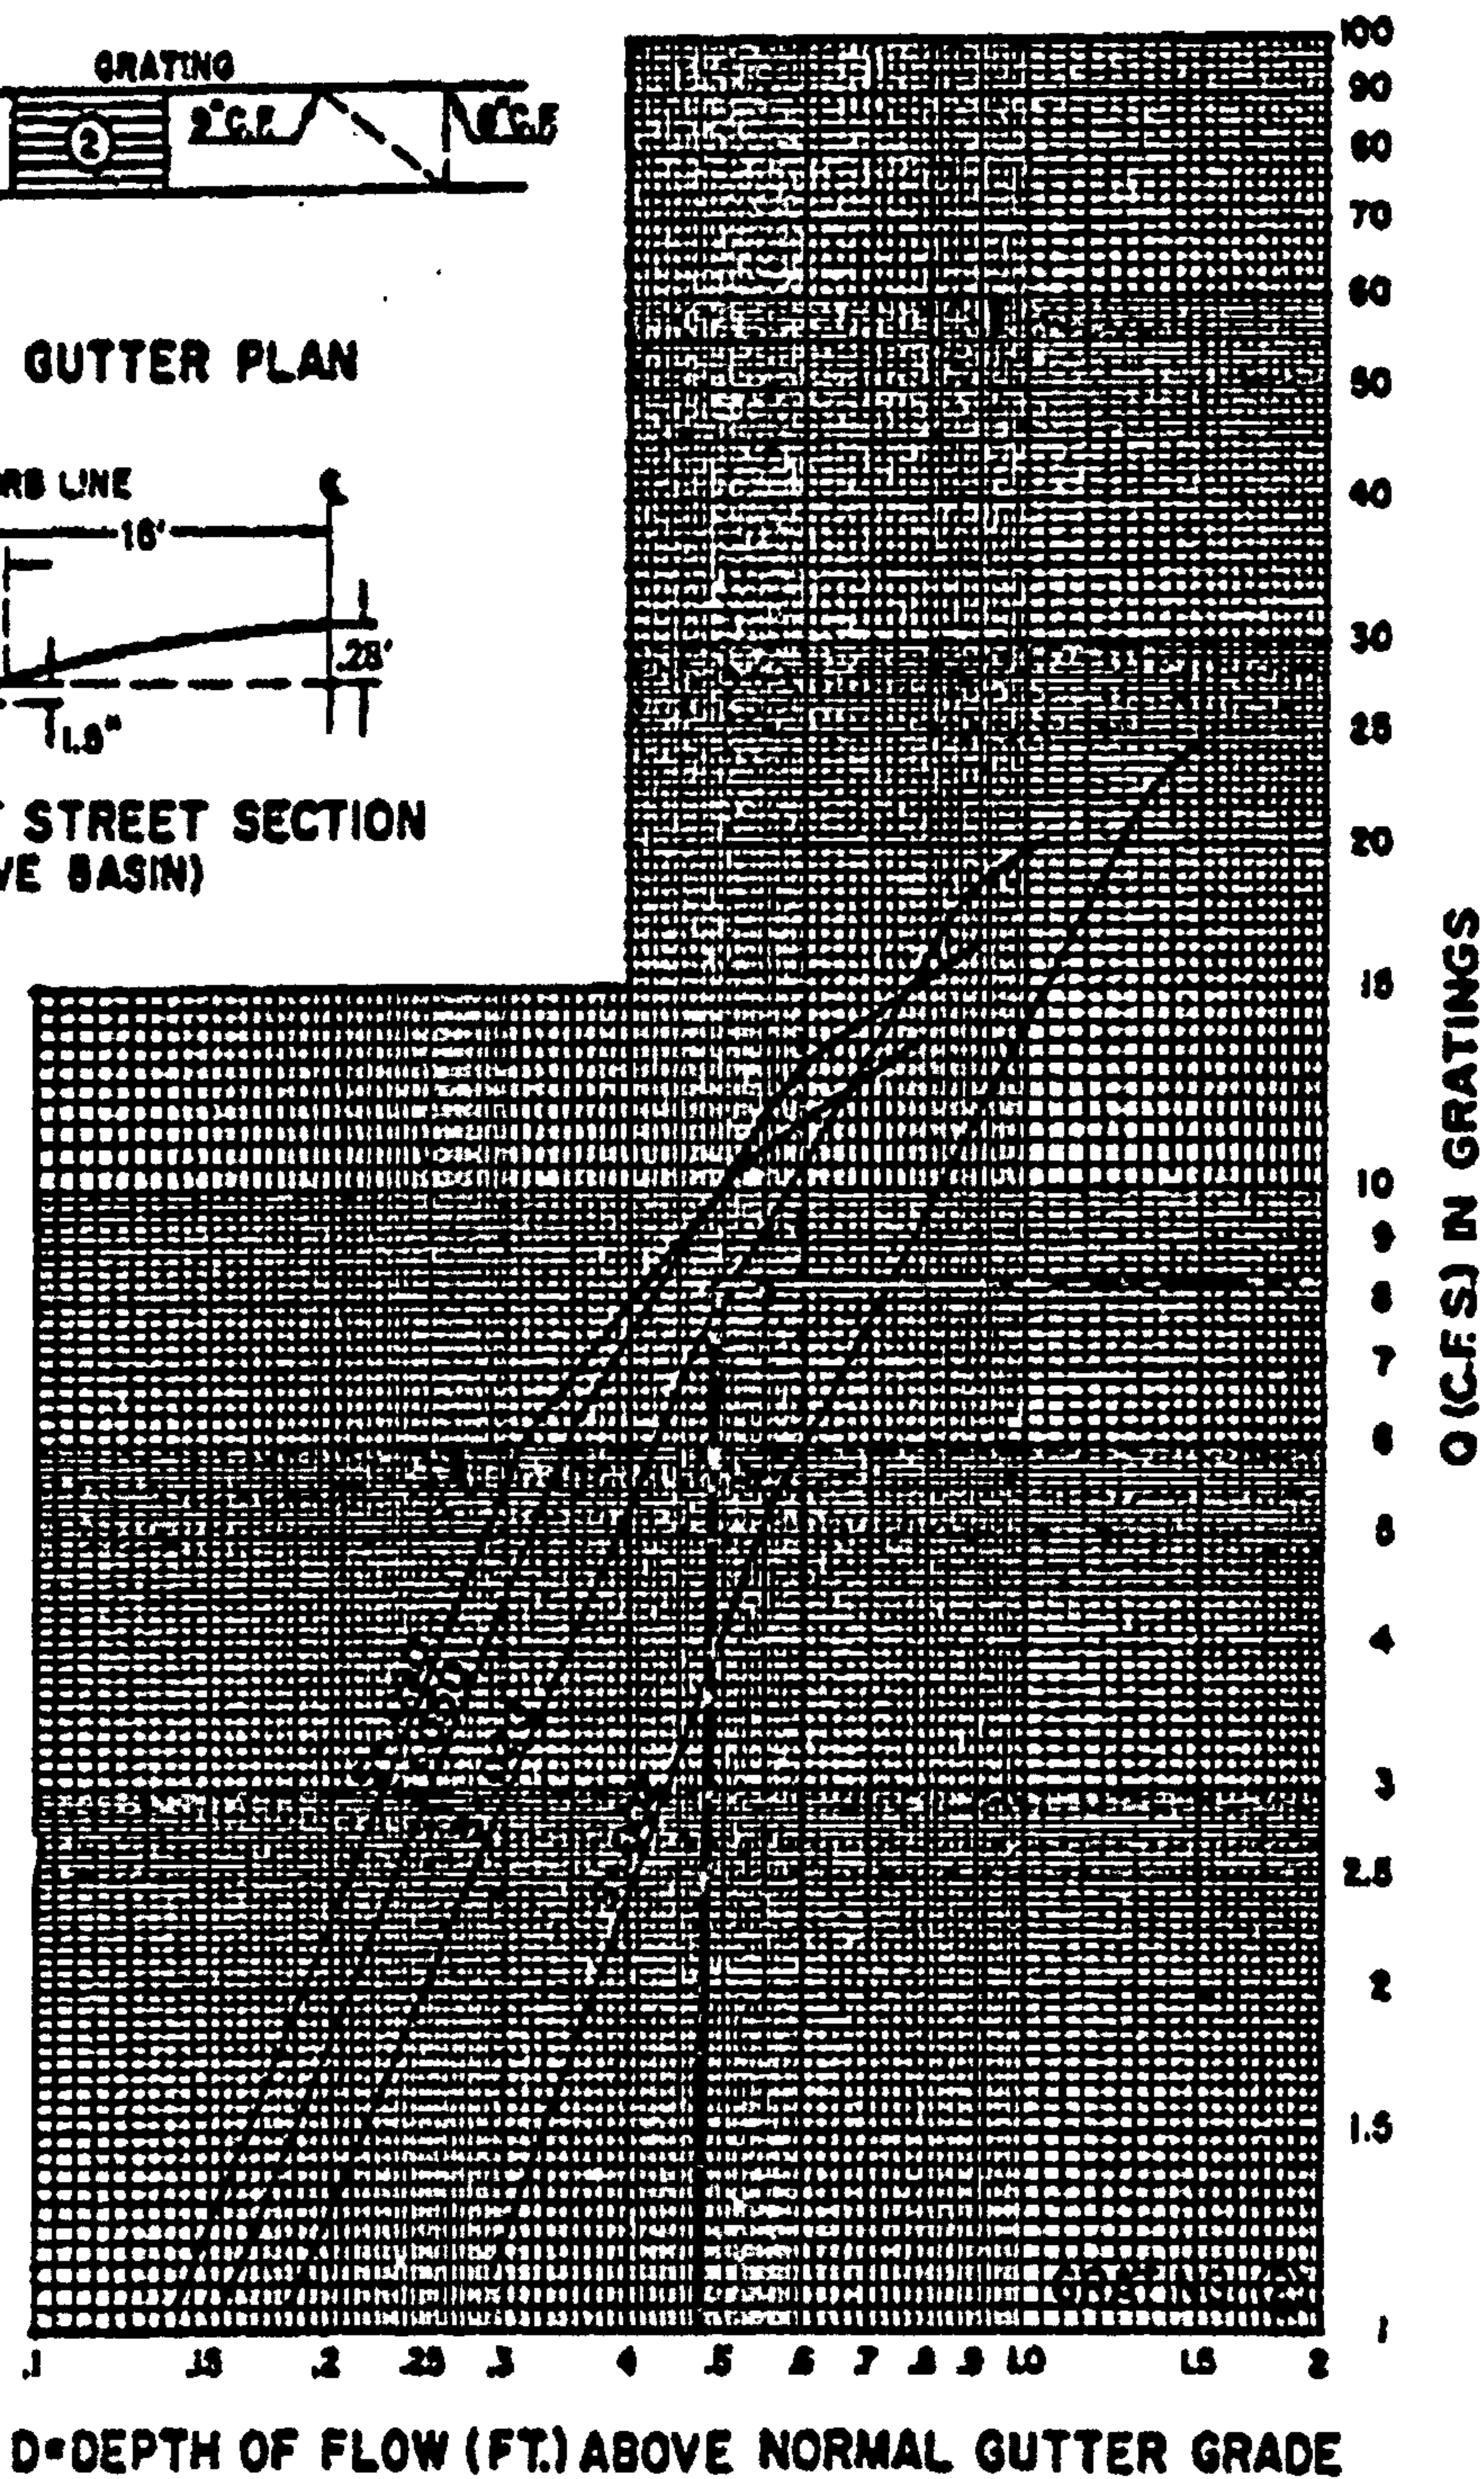

$$Q = 8.31 \text{ CFS, SLOPE} = .03, \text{ DEPT} = .475'$$

Street Capacity Calculations

SILVER OAKS

28' F-F Street Section with 8" curb

Slope= 0.006

For water depths less than 0.125 feet

Y= Water depth
Area = $8 \cdot Y^2$
P= $\text{SQRT}(257 \cdot Y^2) + Y$
n= 0.017

Depth (ft)	Area (ft^2)	P (ft)	R (A/P)	Q (cfs)	2Q (cfs)	Vel (ft/s)	D*V	Fr	D2 (ft)
0.01	0.00	0.17	0.00	0.00	0.00	0.19	0.00	0.33	0.0018848
0.02	0.00	0.34	0.01	0.00	0.00	0.30	0.01	0.38	0.0045908
0.04	0.01	0.68	0.02	0.01	0.01	0.48	0.02	0.42	0.0111278
0.06	0.03	1.02	0.03	0.02	0.04	0.63	0.04	0.45	0.0186349
0.08	0.05	1.36	0.04	0.04	0.08	0.76	0.06	0.47	0.0268376
0.1	0.08	1.70	0.05	0.07	0.14	0.88	0.09	0.49	0.0355923
0.12	0.12	2.04	0.06	0.11	0.23	1.00	0.12	0.51	0.0448091
0.125	0.13	2.13	0.06	0.13	0.26	1.02	0.13	0.51	0.0471777

For water depths greater than 0.125 ft but less than 0.365 ft

Y1= Y-0.125
A2= $A1 + 2 \cdot Y1 + 25 \cdot Y1^2$
P2= $P1 + \text{SQRT}(2501 \cdot Y1^2) + Y1$

Depth (ft)	Area (ft^2)	P (ft)	R (A/P)	Q (cfs)	2Q (cfs)	Vel (ft/s)	D*V	Fr	D2 (ft)
0.13	0.14	2.38	0.06	0.14	0.27	1.00	0.13	0.49	0.0460163
0.16	0.23	3.91	0.06	0.23	0.46	1.01	0.16	0.45	0.0486259
0.2	0.42	5.95	0.07	0.48	0.95	1.15	0.23	0.45	0.0623776
0.24	0.69	8.00	0.09	0.90	1.81	1.32	0.32	0.47	0.0806096
0.2846	1.08	10.27	0.11	1.63	3.26	1.51	0.43	0.50	0.1037171
0.32	1.47	12.08	0.12	2.43	4.87	1.66	0.53	0.52	0.1234692
0.3551	1.91	13.87	0.14	3.45	6.89	1.81	0.64	0.53	0.1440036
0.365	2.05	14.37	0.14	3.77	7.55	1.85	0.67	0.54	0.1499436

For water depths greater than 0.365 ft but less than 0.667 ft

Y2= Y - 0.365
A3= $A2 + Y2^2$
P3= $P2 + Y2$

Depth (ft)	Area (ft^2)	P (ft)	R (A/P)	Q (cfs)	2Q (cfs)	Vel (ft/s)	D*V	Fr	D2 (ft)
0.37	2.12	14.38	0.15	3.99	7.98	1.89	0.70	0.55	0.1556607
0.4556	3.31	14.46	0.23	8.40	16.80	2.54	1.16	0.66	0.2556985
0.4848	3.72	14.49	0.26	10.18	20.37	2.74	1.33	0.69	0.2906669
0.5	3.94	14.51	0.27	11.16	22.33	2.84	1.42	0.71	0.3090234
0.54	4.50	14.55	0.31	13.91	27.82	3.09	1.67	0.74	0.357805
0.5584	4.75	14.56	0.33	15.25	30.50	3.21	1.79	0.76	0.3804643
0.63	5.76	14.64	0.39	20.91	41.83	3.63	2.29	0.81	0.4698487
0.667	6.27	14.67	0.43	24.10	48.21	3.84	2.56	0.83	0.5167338

For water depths greater than 0.667 ft but less than 0.847 ft

Y3= Y - 0.667
A4= $A3 + 14 \cdot Y3 + 25 \cdot Y3^2$
P4= $P3 + \text{SQRT}(2501 \cdot Y3^2)$

Depth (ft)	Area (ft^2)	P (ft)	R (A/P)	Q (cfs)	2Q (cfs)	Vel (ft/s)	D*V	Fr	D2 (ft)
0.7	6.76	16.32	0.41	25.44	50.89	3.76	2.63	0.79	0.5090958
0.72	7.09	17.32	0.41	26.43	52.87	3.73	2.69	0.77	0.5071856
0.74	7.43	18.32	0.41	27.55	55.10	3.71	2.74	0.76	0.5069788
0.76	7.79	19.32	0.40	28.79	57.58	3.70	2.81	0.75	0.508251
0.78	8.17	20.32	0.40	30.16	60.31	3.69	2.88	0.74	0.5108175
0.8	8.58	21.32	0.40	31.64	63.29	3.69	2.95	0.73	0.5145251
0.847	9.60	23.68	0.41	35.63	71.26	3.71	3.14	0.71	0.5270333

CITY OF ALBUQUERQUE



October 28, 2016

Richard J. Berry, Mayor

David Soule, PE
Rio Grande Engineering
P.O. Box 93924
Albuquerque, NM 87199

**RE: Silver Oaks Subdivision
Release of Financial Guarantee
Grading Plan Certification – 10-15-16
Hydrology File: C18D101**

Dear Mr. Soule:

Based upon the information provided in the submittal received 10-18-2016, the above-referenced plan is adequate and satisfies the Grading and Drainage Certification for Release of Financial Guaranty.

If you have any questions, you can contact me at 924-3986.

PO Box 1293

Albuquerque


New Mexico 87103

www.cabq.gov

Sincerely,

Abiel Carrillo, P.E.
Principal Engineer, Planning Dept.
Development Review Services

Orig: Drainage file

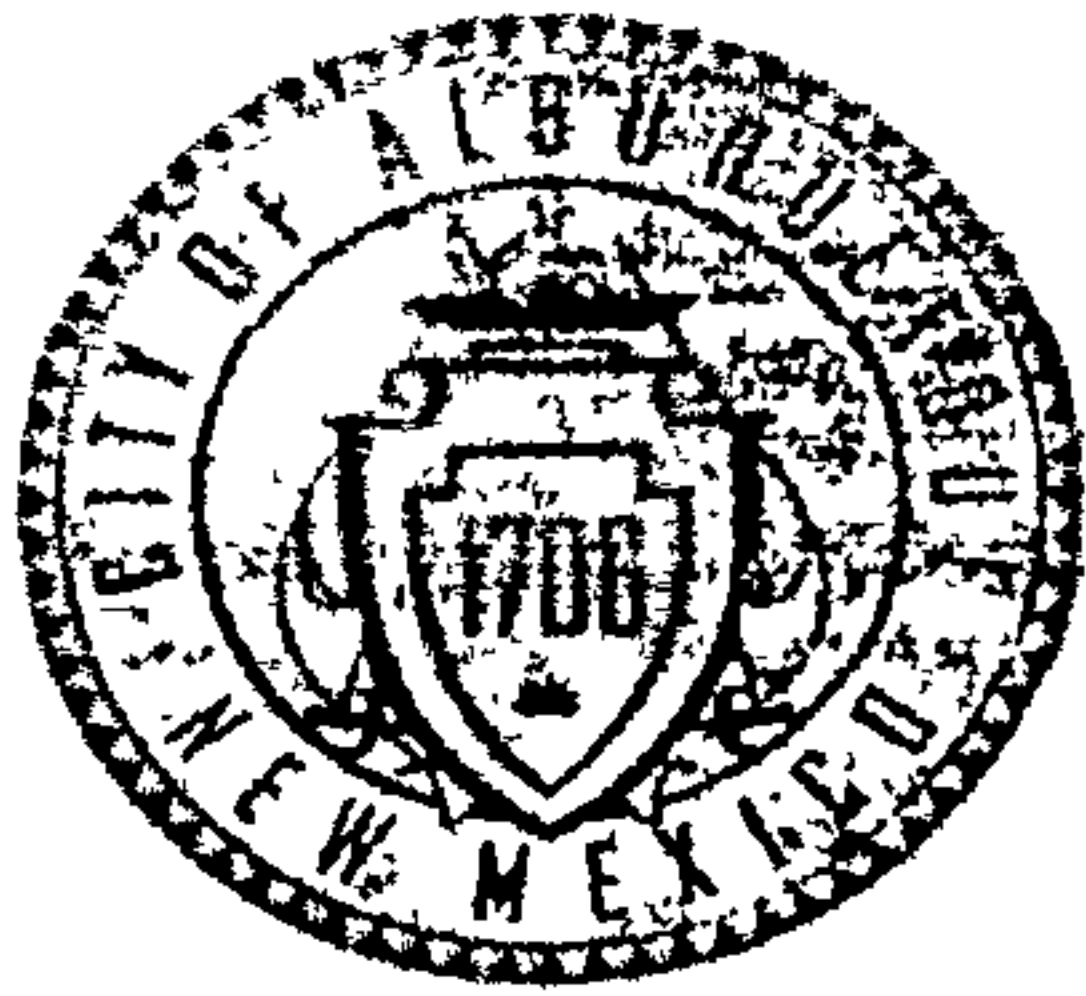

City of Albuquerque

Planning Department
Development & Building Services Division

DRAINAGE AND TRANSPORTATION INFORMATION SHEET (REV 09/2015)

Project Title: SILVER OAK SUBDIVISION Building Permit # City Drainage #: C18D101
DRB#: 1010644 EPC# Work Order#:
Legal Description: LOT 13,14,19,20 BLOCK 28, TRACT A, UNIT B ,NAA
City Address: OAKLAND NE

Engineering Firm: RIO GRANDE ENGINEERING Contact: DAVID SOULE
Address: PO BOX 93924, ALBUQUERQUE, NM 87199
Phone#: 505.321.9099 Fax#: 505 872.0999 E-mail: DAVID@RIOGRANDEENGINEERING.COM

Owner: SILVER OAK DEVELOPERS Contact:
Address: PO BOC 20688, ALB NM 87154
Phone#: Fax#: E-mail:

Architect: none Contact:
Address:
Phone#: Fax#: E-mail:

Other Contact: Contact:
Address:
Phone#: Fax#: E-mail:

Check all that Apply:

DEPARTMENT:

- ☒ HYDROLOGY/ DRAINAGE
☐ TRAFFIC/ TRANSPORTATION
☐ MS4/ EROSION & SEDIMENT CONTROL

TYPE OF SUBMITTAL:

- ☒ ENGINEER/ ARCHITECT CERTIFICATION

☐ CONCEPTUAL G & D PLAN
☐ GRADING PLAN
☐ DRAINAGE MASTER PLAN
☐ DRAINAGE REPORT
☐ CLOMR/LOMR

☐ TRAFFIC CIRCULATION LAYOUT (TCL)
☐ TRAFFIC IMPACT STUDY (TIS)
☐ EROSION & SEDIMENT CONTROL PLAN (ESC)

☐ OTHER (SPECIFY)

IS THIS A RESUBMITTAL? ☒ Yes ☐ No


DATE SUBMITTED: 10/15/16 By:

CHECK TYPE OF APPROVAL/ACCEPTANCE SOUGHT:

- ☐ BUILDING PERMIT APPROVAL
☐ CERTIFICATE OF OCCUPANCY

☐ PRELIMINARY PLAT APPROVAL
☐ SITE PLAN FOR SUB'D APPROVAL
☐ SITE PLAN FOR BLDG. PERMIT APPROVAL
☐ FINAL PLAT APPROVAL
☒ SIA/ RELEASE OF FINANCIAL GUARANTEE
☐ FOUNDATION PERMIT APPROVAL
☐ GRADING PERMIT APPROVAL
☐ SO-19 APPROVAL
☐ PAVING PERMIT APPROVAL
☒ GRADING/ PAD CERTIFICATION
☐ WORK ORDER APPROVAL
☐ CLOMR/LOMR

☐ PRE-DESIGN MEETING
☐ OTHER (SPECIFY)

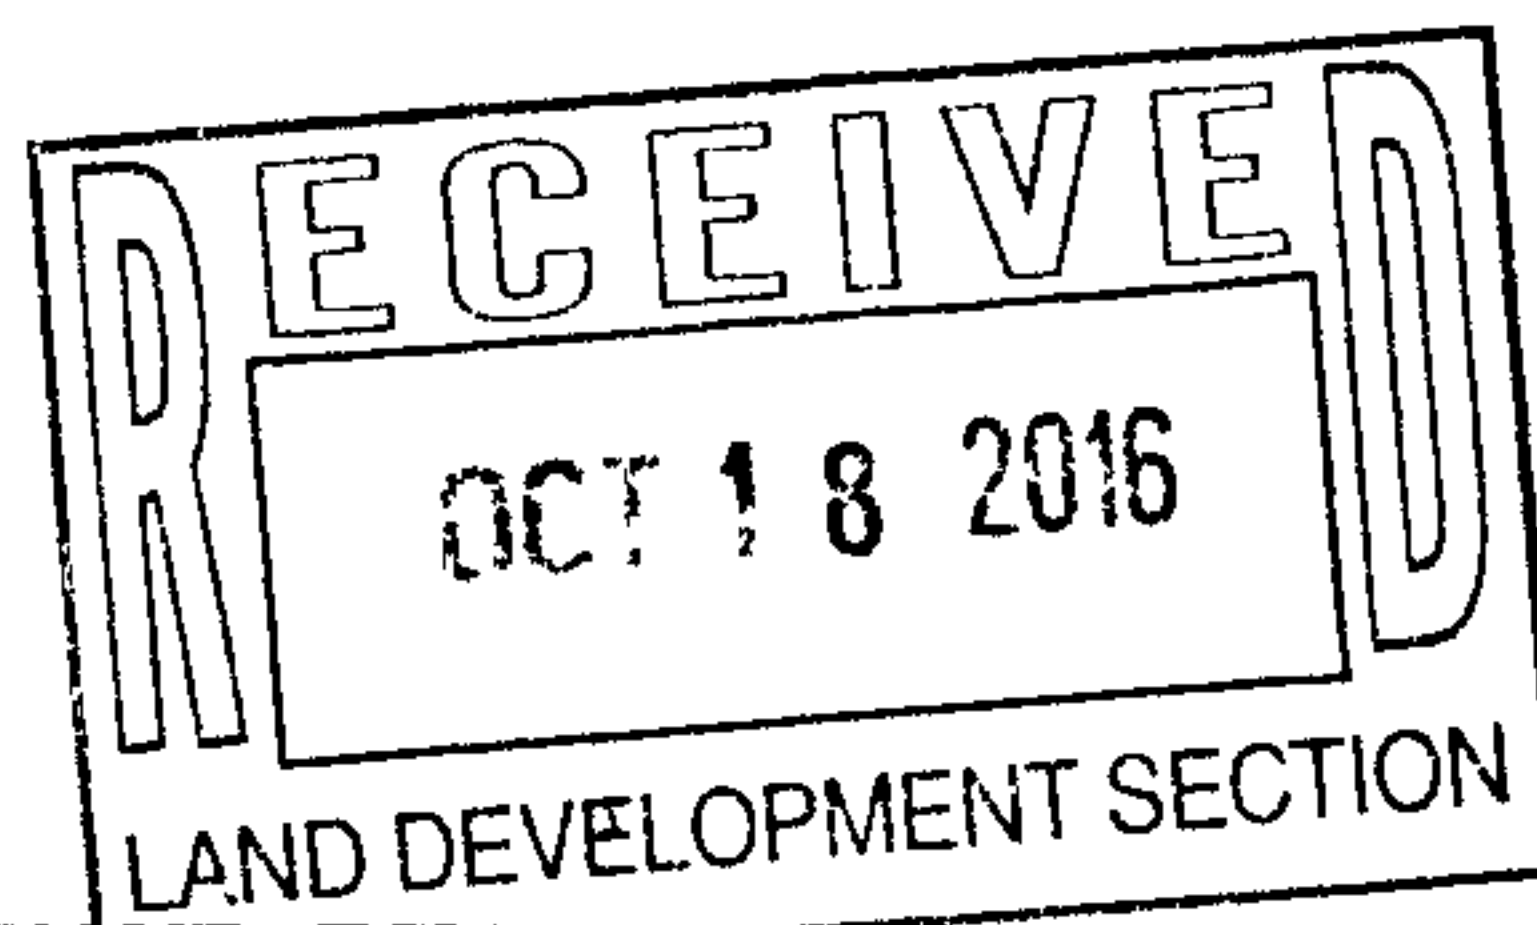

COA STAFF ELECTRONIC SUBMITTAL RECEIVED ☐

Carrillo, Abiel X.

From: David Soule <david@riograndeengineering.com>
Sent: Thursday, October 27, 2016 4:44 PM
To: Carrillo, Abiel X.
Cc: Elliott, Stanice
Subject: RE: Grading certification silver oaks c18d101

Abiel, yes, the culverts dont have the lip that is standard at the front and have a 2% slope back into pond, there is a small indention from the forms, but we will grind a bit.

The connection to alameda is made. the inlets at alameda does not collect water because dmd is planning on building alameda, so we were allowed to not build the road but we built all of the storm drain, storm drain maintenance has accepted all the inlets and pipes. I will have them add water some grout right at the edges and grind and invert better. The legacy apts will go to construction in the next few months and this pond goes away. We had a private precon to go over everything and Franklins hopes to pull grading permit in a few weeks, and hopefully i can get my plans ready for approval in a few weeks as well. Thank you very much
David

From: Carrillo, Abiel X. [<mailto:acarrillo@cabq.gov>]
Sent: Thursday, October 27, 2016 4:34 PM
To: David Soule
Cc: Elliott, Stanice
Subject: RE: Grading certification silver oaks c18d101

Hey David,

I checked it out today, so we won't hold the building permit anymore.

I do have a couple of questions though:

1. Did the sidewalk culverts get built to drain INTO the pond as was intended? I couldn't tell if they were sloping towards or away from the road.
2. Was the connection of the inlet on Alameda completed? The inlet was covered so I couldn't tell.
3. Could you have one of the home builders place a tiny water block (just a small bump with cold mix or concrete) in the gutter pan just downstream of the sidewalk culverts to help funnel flows into the pond? I noticed a little bit of a lip on the street side, and I want to make sure we maximize the use of the temp pond.

Thanks,

Abiel Carrillo, PE, CFM

Principal Engineer - Hydrology
Planning Department
Development Review Services Division
City of Albuquerque
505-924-3986
acarrillo@cabq.gov
600 2nd Street NW
Albuquerque, NM 87102

From: David Soule [<mailto:david@riograndeengineering.com>]
Sent: Wednesday, October 26, 2016 11:18 AM

To: Carrillo, Abiel X.
Cc: Elliott, Stanice
Subject: Grading certification silver oaks c18d101

Abiel, we submitted an asbuilt certification for this subdivision last week. I know with Rita gone you are very understaffed and over worked. My client has asked me to follow up with the city on this submittal. There are several lots he sold that the builders are trying to permit. I am just inquiring to fulfill my obligation to my client. I understand how busy you must be and I appreciate how much you all do.

David

CITY OF ALBUQUERQUE



August 17, 2016

Richard J. Berry, Mayor

David Soule, P.E.
Rio Grande Engineering
PO BOX 93924
Albuquerque, NM, 87199

**RE: Silver Oak Estates
Grading and Drainage Plan
~~Stamp Date 12-18-2015 (File: C18D101)~~
Stamp Date 3-30-2016 (C18D101)**

Dear Mr. Soule:

Based upon the information provided in your submittal received 8-15-2016, the above referenced Grading and Drainage Plan is approved for DRB action for Site Plan for Subdivision Amendment and Preliminary Plat. The plan is also approved for Grading Permit, but an Erosion and Sediment Control Permit must be processed prior to any earthwork (and prior to Building Permit approval).

PO Box 1293

This plan replaces the previously approved Grading and Drainage Plan dated 12-18-2015.

Albuquerque

Prior to Pad Certification and/or Release of Financial Guarantee approval, Engineer Certification per the DPM checklist will be required.

If you have any questions, you can contact me at 924-3986.


New Mexico 87103

Sincerely,

www.cabq.gov

Abiel Carrillo, P.E.
Principal Engineer, Planning Dept.
Development Review Services

Orig: Drainage file

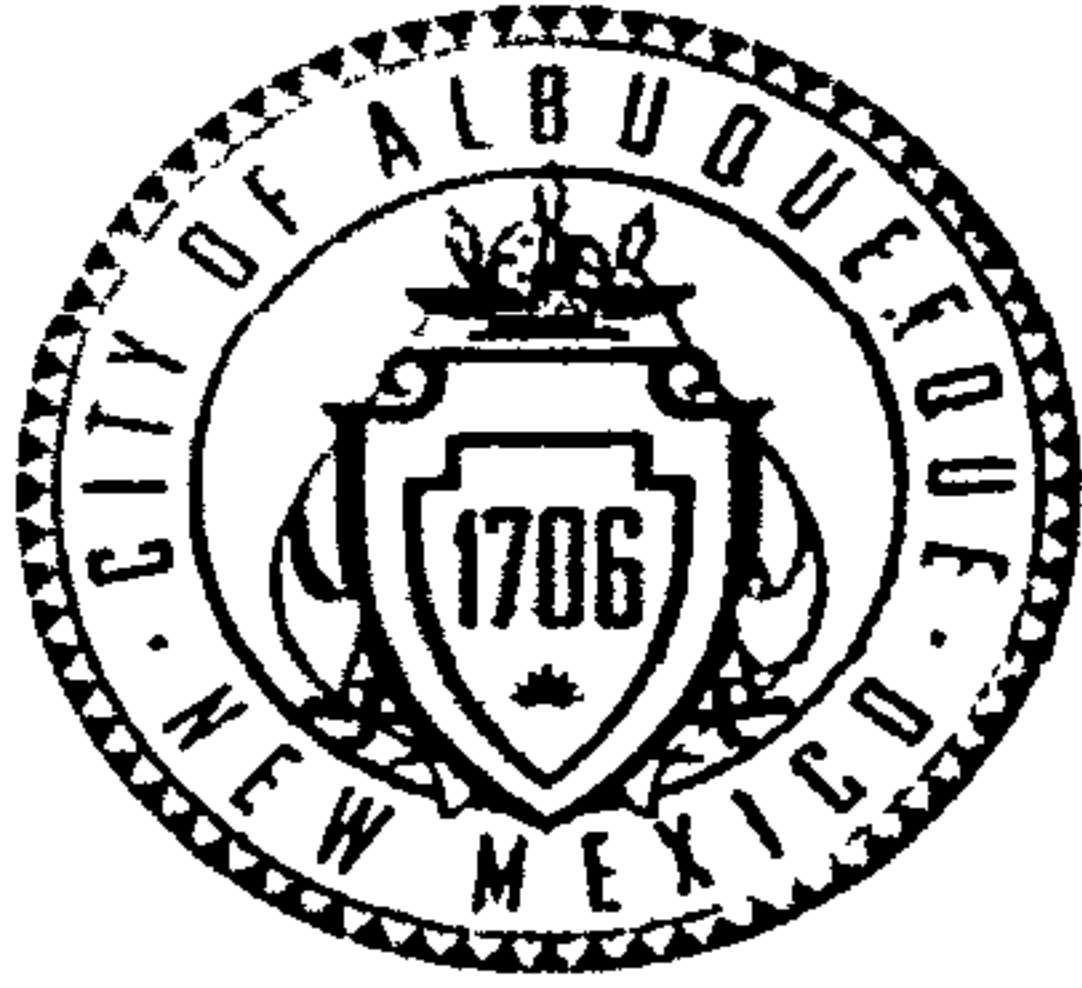

City of Albuquerque

Planning Department

Development & Building Services Division

DRAINAGE AND TRANSPORTATION INFORMATION SHEET (REV 09/2015)

Project Title: SILVER OAK SUBDIVISION Building Permit #: _____ City Drainage #: C18D101
DRB#: 1010644 EPC#: _____ Work Order#: _____
Legal Description: LOT 13,14,19,20 BLOCK 28, TRACT A, UNIT B ,NAA
City Address: OAKLAND NE

Engineering Firm: RIO GRANDE ENGINEERING Contact: DAVID SOULE
Address: PO BOX 93924, ALBUQUERQUE, NM 87199
Phone#: 505.321.9099 Fax#: 505.872.0999 E-mail: DAVID@RIOGRANDEENGINEERING.COM

Owner: SILVER OAK DEVELOPERS Contact: _____
Address: PO BOX 20688, ALB NM 87154
Phone#: _____ Fax#: _____ E-mail: _____

Architect: none Contact: _____
Address: _____
Phone#: _____ Fax#: _____ E-mail: _____

Other Contact: _____ Contact: _____
Address: _____
Phone#: _____ Fax#: _____ E-mail: _____

Check all that Apply:

DEPARTMENT:

- ☒ HYDROLOGY/ DRAINAGE
☐ TRAFFIC/ TRANSPORTATION
☐ MS4/ EROSION & SEDIMENT CONTROL

TYPE OF SUBMITTAL:

- ☐ ENGINEER/ ARCHITECT CERTIFICATION
☐ CONCEPTUAL G & D PLAN
☒ GRADING PLAN
☐ DRAINAGE MASTER PLAN
☐ DRAINAGE REPORT
☐ CLOMR/LOMR
☐ TRAFFIC CIRCULATION LAYOUT (TCL)
☐ TRAFFIC IMPACT STUDY (TIS)
☐ EROSION & SEDIMENT CONTROL PLAN (ESC)
☐ OTHER (SPECIFY) _____


IS THIS A RESUBMITTAL?: ☒ Yes ☐ No

DATE SUBMITTED: 8/15/16 By: _____

CHECK TYPE OF APPROVAL/ACCEPTANCE SOUGHT:

- ☐ BUILDING PERMIT APPROVAL
☐ CERTIFICATE OF OCCUPANCY
☒ PRELIMINARY PLAT APPROVAL
☒ SITE PLAN FOR SUB'D APPROVAL
☐ SITE PLAN FOR BLDG. PERMIT APPROVAL
☐ FINAL PLAT APPROVAL
☐ SIA/ RELEASE OF FINANCIAL GUARANTEE
☐ FOUNDATION PERMIT APPROVAL
☒ GRADING PERMIT APPROVAL
☐ SO-19 APPROVAL
☐ PAVING PERMIT APPROVAL
☐ GRADING/ PAD CERTIFICATION
☐ WORK ORDER APPROVAL
☐ CLOMR/LOMR


- ☐ PRE-DESIGN MEETING
☐ OTHER (SPECIFY) _____

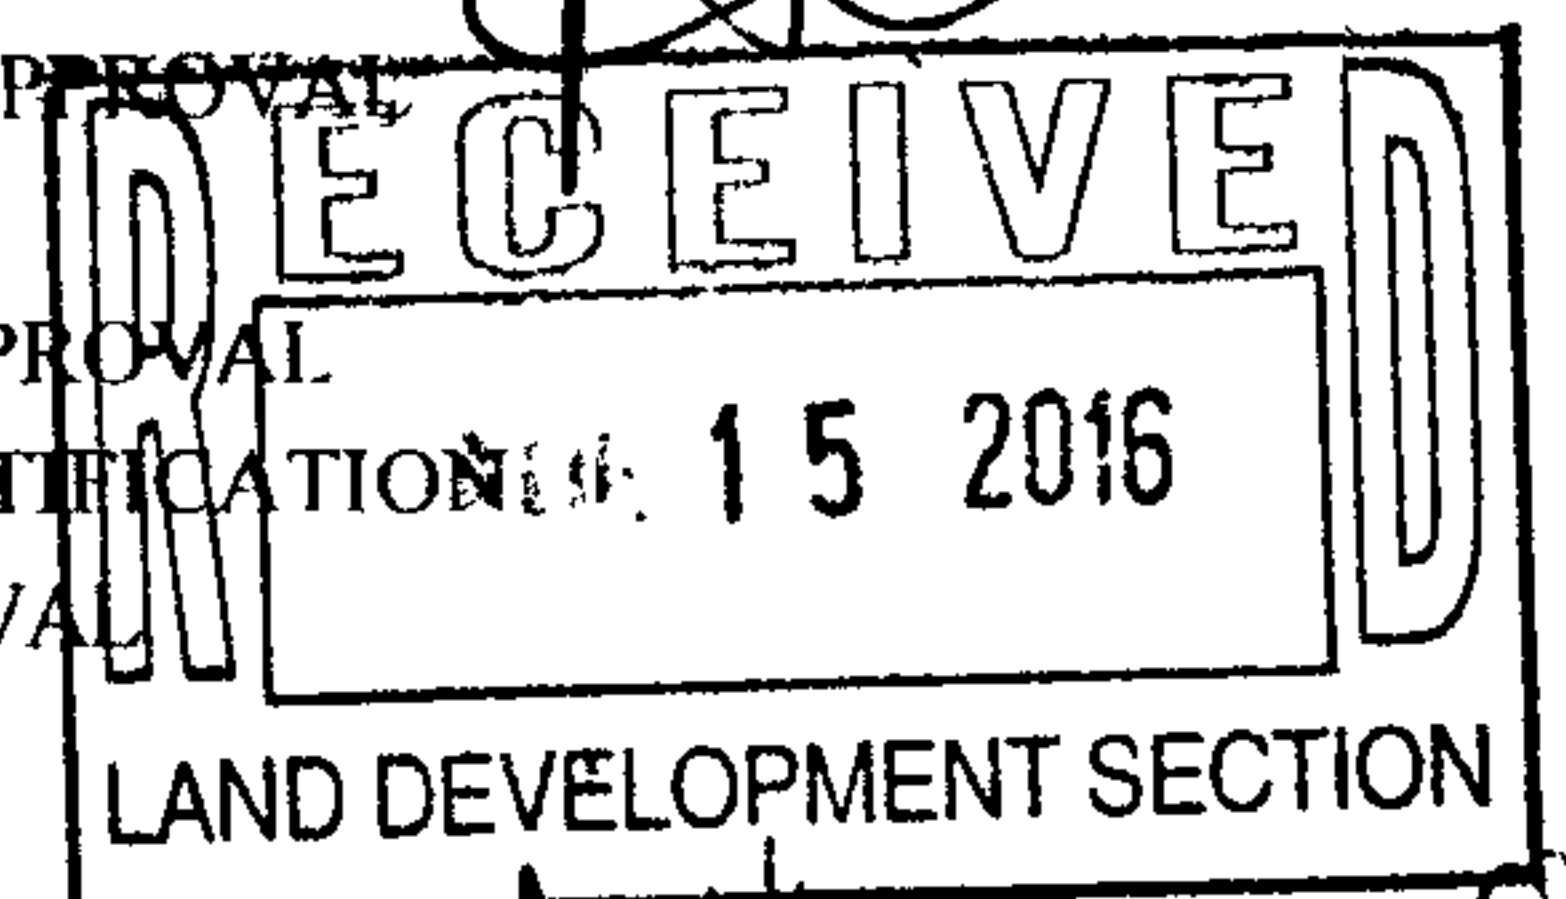

David \$100.00

COA STAFF: ELECTRONIC SUBMITTAL RECEIVED

CITY OF ALBUQUERQUE

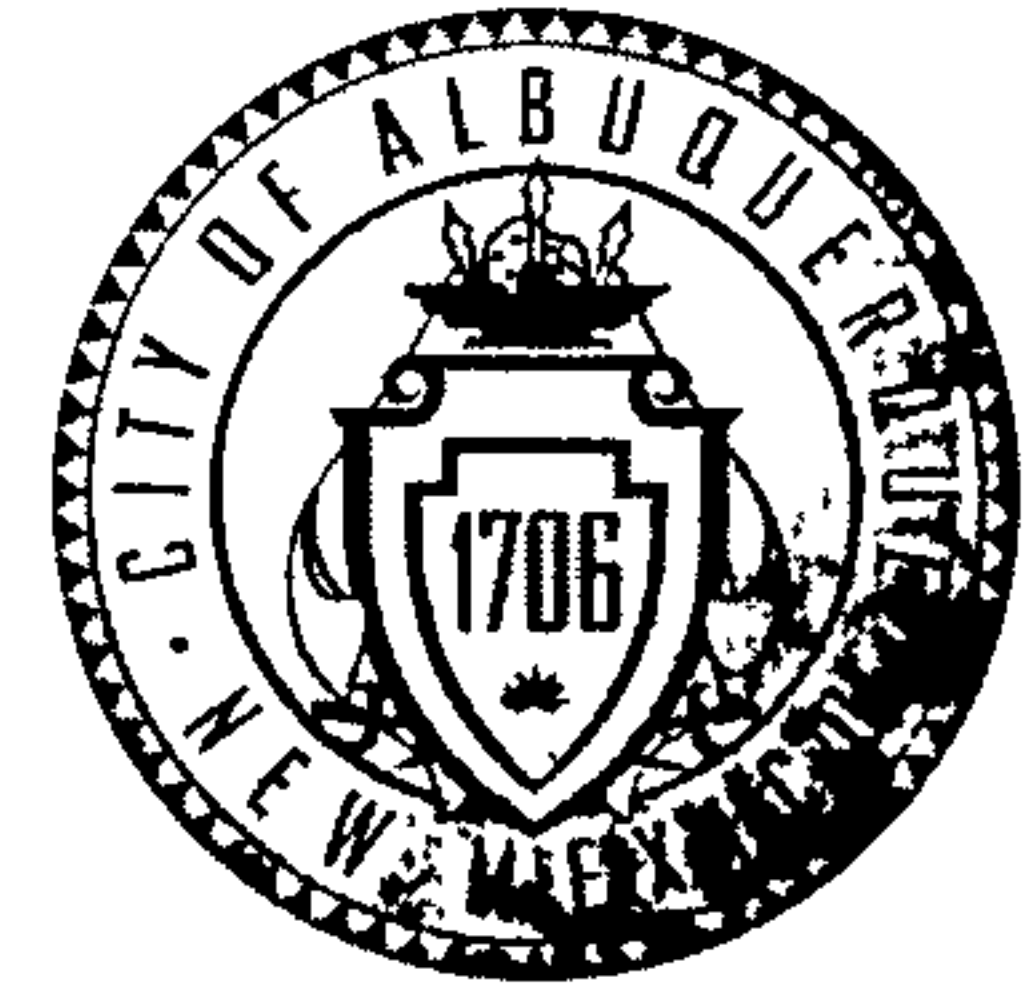

December 22, 2015

Richard J. Berry, Mayor

David Soule, P.E.
Silver Oak Estates
1606 Central Avenue Suite 201
Albuquerque, NM, 87106

**RE: Silver Oak Estates
Grading and Drainage Plan
Stamp Date 12-18-2015 (File: C18D101)**

Dear Mr. Soule:

Based upon the information provided in your submittal received 12/18/2015, the above referenced Grading and Drainage Plan is approved for DRB action for Site Plan for Subdivision and Preliminary Plat. The plan is also approved for Grading Permit, but an Erosion and Sediment Control Permit must be processed prior to any earthwork (and prior to Building Permit approval).

PO Box 1293

If you have any questions, you can contact me at 924-3986; and Mr. Curtis Cherne at 924-3420 for questions regarding the ESC permit.

Albuquerque

Sincerely,


New Mexico 87103

Abiel Carrillo, P.E.
Principal Engineer, Planning Dept.
Development Review Services

www.cabq.gov

Orig: Drainage file

C18D101_SPSP_PP_GP_APPR.docx

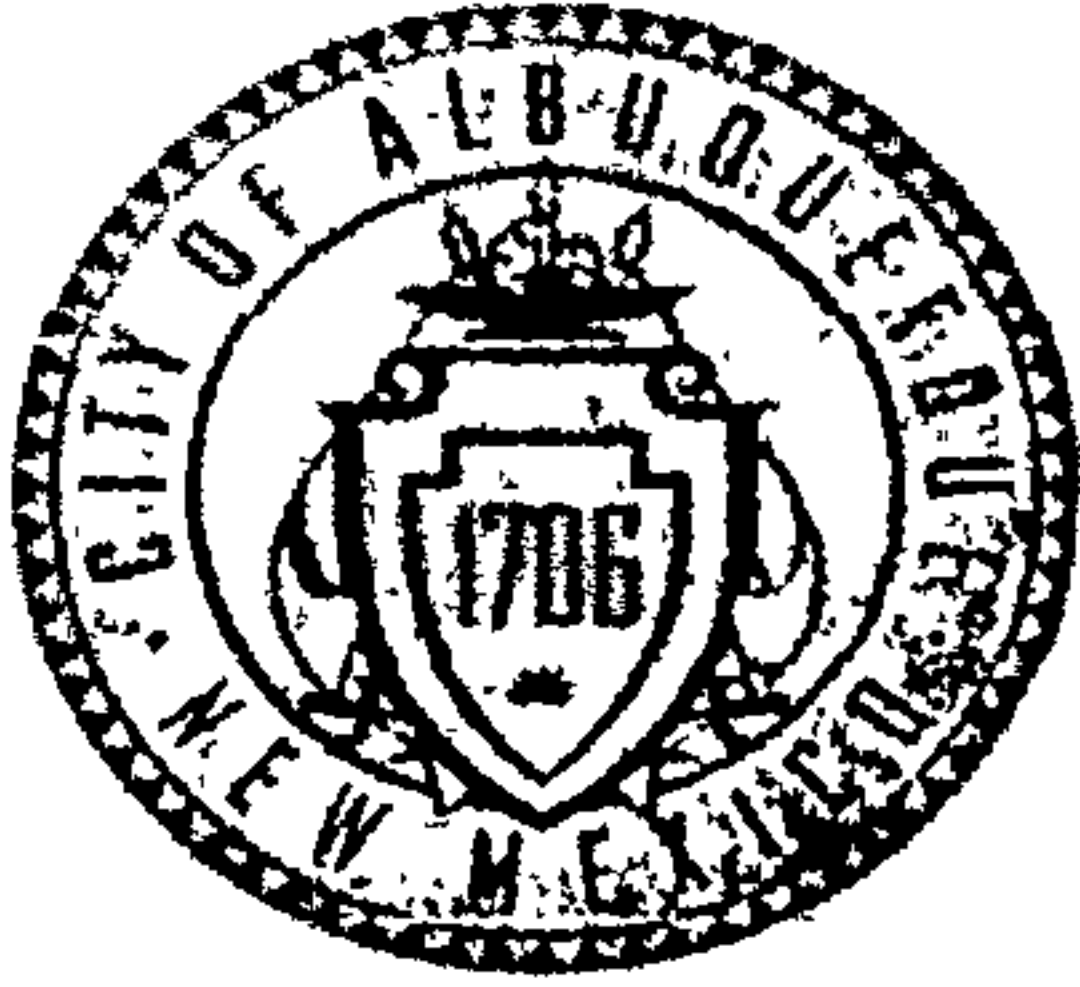

City of Albuquerque

Planning Department

Development & Building Services Division

DRAINAGE AND TRANSPORTATION INFORMATION SHEET (REV 09/2015)

Project Title: SILVER OAK SUBDIVISION Building Permit #: _____ City Drainage #: C18D101
DRB#: 1010644 EPC#: _____ Work Order#: _____
Legal Description: LOT 13,14,19,20 BLOCK 28, TRACT A, UNIT B ,NAA
City Address: OAKLAND NE

Engineering Firm: RIO GRANDE ENGINEERING Contact: DAVID SOULE
Address: PO BOX 93924, ALBUQUERQUE, NM 87199
Phone#: 505.321.9099 Fax#: 505.872.0999 E-mail: DAVID@RIOGRANDEENGINEERING.COM

Owner: SILVER OAK DEVELOPERS Contact: _____
Address: PO BOX 20688, ALB NM 87154
Phone#: _____ Fax#: _____ E-mail: _____

Architect: none Contact: _____
Address: _____
Phone#: _____ Fax#: _____ E-mail: _____

Other Contact: _____ Contact: _____
Address: _____
Phone#: _____ Fax#: _____ E-mail: _____

Check all that Apply:

DEPARTMENT:

- ☒ HYDROLOGY/ DRAINAGE
☐ TRAFFIC/ TRANSPORTATION
☐ MS4/ EROSION & SEDIMENT CONTROL

TYPE OF SUBMITTAL:

- ☐ ENGINEER/ ARCHITECT CERTIFICATION

☐ CONCEPTUAL G & D PLAN
☒ GRADING PLAN
☐ DRAINAGE MASTER PLAN
☐ DRAINAGE REPORT
☐ CLOMR/LOMR

☐ TRAFFIC CIRCULATION LAYOUT (TCL)
☐ TRAFFIC IMPACT STUDY (TIS)
☐ EROSION & SEDIMENT CONTROL PLAN (ESC)

☐ OTHER (SPECIFY) _____

CHECK TYPE OF APPROVAL/ACCEPTANCE SOUGHT:

- ☐ BUILDING PERMIT APPROVAL
☐ CERTIFICATE OF OCCUPANCY

☒ PRELIMINARY PLAT APPROVAL
☒ SITE PLAN FOR SUB'D APPROVAL
☐ SITE PLAN FOR BLDG PERMIT APPROVAL
☐ FINAL PLAT APPROVAL
☐ SIA/ RELEASE OF FINANCIAL GUARANTEE
☐ FOUNDATION PERMIT APPROVAL
☒ GRADING PERMIT APPROVAL
☐ SO-19 APPROVAL
☐ PAVING PERMIT APPROVAL
☐ GRADING/ PAD CERTIFICATION
☐ WORK ORDER APPROVAL
☐ CLOMR/LOMR

- ☐ PRE-DESIGN MEETING
☐ OTHER (SPECIFY) _____

IS THIS A RESUBMITTAL?: ☒ Yes ☐ No

DATE SUBMITTED: 12/18/15 By: _____

COA STAFF. ELECTRONIC SUBMITTAL RECEIVED _____

