

Mayor Timothy M. Keller

April 12, 2022

David Soule, P.E. Rio Grande Engineering PO Box 93924 Albuquerque, New Mexico 87199

RE: RE: Lot 13 Block 5 Volcano Cliffs Unit 19 SAD 228 6605 Petirrojo Rd. NW

Grading and Drainage Plan

Engineers Stamp Date 3/1/2021 (D10D003I2)

Pad Certification Date 4/8/2022

Mr. Soule,

Based upon the information provided in your submittal received 4/12/2022, this plan is approved for Building Permit.

PO Box 1293

Please inform the builder/owner to attach a copy of this approved plan and this letter to the construction sets in the permitting process prior to sign-off by Hydrology.

Albuquerque

Reiterate to the Owner/Contractor that a separate permit for a garden/retaining wall must be obtained, with the approved G&D plan and Pad Certification. Also, let the owner/contractor know that if a pool is to be added in the future the G&D plan will need to be modified showing the location of the pool and the land treatment differences. Also advise the owner & Contractor that dirt is not allowed in the public right of way to climb the curb. Crusher fines or lumber is allowed. If dirt is used this will delay going forward with the construction of the home.

www.cabq.gov

NM 87103

Prior to Certificate of Occupancy release, Engineer Certification per the DPM checklist of this plan will be required.

If you have any questions, please contact me at 924-3986 or Rudy Rael at 924-3977.

Sincerely,

Ernest Armijo, P.E.

Principal Engineer, Planning Dept. Development Review Services



City of Albuquerque

Planning Department

Development & Building Services Division

DRAINAGE AND TRANSPORTATION INFORMATION SHEET (REV 6/2018)

Project Title: 6605 PETIRROJO	Hydrology File #:						
DRR#·	Work Ordorth						
Legal Description: LOT 2, Block	9 VOLCANO	CLIFFS	UNIT 18				
City Address: 6605 PETIRROJO							
Applicant:			Contact:				
Address:							
Phone#:	Fax#:		E-mail:				
Other Contact: RIO GRANDE ENGIN	EERING		Contact:	DAVID SOULE			
Address: PO BOX 93924 ALB NM Phone#: 505.321.9099	8/199 - # 505.872	2.0999	u d	avid@riograndeengineering.com			
TYPE OF DEVELOPMENT: PLAT	X RESIDI	ENCE	DRB SITE	ADMIN SITE			
Check all that Apply:							
DEPARTMENT: X HYDROLOGY/ DRAINAGE TRAFFIC/ TRANSPORTATION		TYPE OF APPROVAL/ACCEPTANCE SOUGHT: X BUILDING PERMIT APPROVAL CERTIFICATE OF OCCUPANCY					
TYPE OF SUBMITTAL: ENGINEER/ARCHITECT CERTIFICATION PAD CERTIFICATION CONCEPTUAL G & D PLAN GRADING PLAN DRAINAGE REPORT DRAINAGE MASTER PLAN FLOODPLAIN DEVELOPMENT PERMIT		SITE SITE FINA SIA/ I	L PLAT APPROVAI	APPROVAL PERMIT APPROVAL L VCIAL GUARANTEE			
ELEVATION CERTIFICATE CLOMR/LOMR TRAFFIC CIRCULATION LAYOUT (TCI TRAFFIC IMPACT STUDY (TIS) STREET LIGHT LAYOUT OTHER (SPECIFY)		GRADING PERMIT APPROVAL SO-19 APPROVAL PAVING PERMIT APPROVAL GRADING/ PAD CERTIFICATION WORK ORDER APPROVAL CLOMR/LOMR					
PRE-DESIGN MEETING?	_	FLOODPLAIN DEVELOPMENT PERMIT					
IS THIS A RESUBMITTAL?: X Yes1	No	OTHE	ER (SPECIFY)				
DATE SUBMITTED:	· · · · · · · · · · · · · · · · · · ·						
COA STAFF:	ELECTRONIC SU	BMITTAL RECI	EIVED:	-			

Weighted E Method

							100-Year, 6-hr.			24 hour				
Basin	Area	Area	Treat	ment A	Treat	ment B	Treatr	ment C	Treatr	ment D	Weighted E	Volume	Flow	Volume
	(sf)	(acres)	%	(acres)	%	(acres)	%	(acres)	%	(acres)	(ac-ft)	(ac-ft)	cfs	(ac-ft)
ALLOWED	27355.00	0.628	0%	0	20%	0.126	46%	0.2889	34%	0.214	1.259	0.066	2.02	0.074
PROPOSED	27355.00	0.628	0%	0	20%	0.126	34%	0.2135	46%	0.289	1.377	0.072	2.13	0.083
COMPARISON												0.006		0.009

Fnd "X" Scribe in Sidewalk Elev=5325.83

Weighted E = Ea*Aa + Eb*Ab + Ec*Ac + Ed*Ad / (Total Area)

Volume = Weighted D * Total Area

Flow = Qa * Aa + Qb * Ab + Qc * Ac + Qd * Ad

Where for 100-year, 6-hour storm-zone 1 Qa= 1.29 Ea= 0.44 Qb= 2.03

Eb= 0.67 Ec= 0.99 Qc= 2.87 Ed= 1.97 Qd= 4.37

ONSITE Conditions
FIRST FLUSH WATER QUALITY VOLUME

REQUIRED PROVIDED (CF) 706 WATER QUALITY FLOOD CONTROL 706 394

Narrative


This site is within the SAD 228 Master Drainage plan boundaries. The site is to maintain existing patterns and drain to the adjacent roadway. The site does exceed the SAD 228 developed conditions assumptions therefore ponding is required Upland flow has the ability to enter the site from the rear yard of the lot to the north and west, this flow is allowed to pass. This plan is in conformance to the master drainage plan

I, DAVID SOULE HAVE PERSONALLY INPECTED THE SITE. I HEREBY CERTIFY THE PAD HAS BEEN CONSTRUCTED SUCH THAT IT IS IN SUBSTANTIAL CONFORMANCE TO THE APPROVED GRADING PLAN DATED 3/1/21




EROSION CONTROL NOTES:

- 1. CONTRACTOR IS RESPONSIBLE FOR OBTAINING A TOPSOIL DISTURBANCE PERMIT PRIOR TO BEGINNING WORK.
- 2. CONTRACTOR IS RESPONSIBLE FOR MAINTAINING RUN-OFF ON SITE DURING CONSTRUCTION.
- 3. CONTRACTOR IS RESPONSIBLE FOR CLEANING ALL SEDIMENT THAT GETS INTO EXISTING RIGHT-OF-WAY.
- 4. REPAIR OF DAMAGED FACILITIES AND CLEANUP OF SEDIMENT ACCUMULATIONS ON ADJACENT PROPERTIES AND IN PUBLIC FACILITIES IS THE RESPONSIBILITY OF THE CONTRACTOR.
- 5. ALL EXPOSED EARTH SURFACES MUST BE PROTECTED FROM WIND AND WATER EROSION PRIOR TO FINAL ACCEPTANCE OF ANY PROJECT.

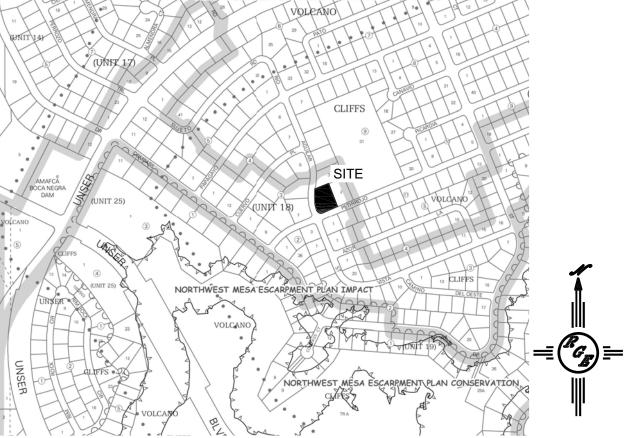



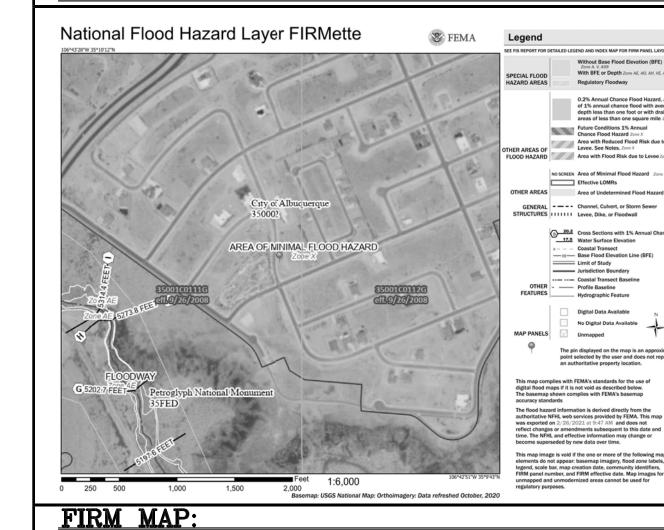

LEGAL DESCRIPTION:

LOT 02 BLOCK 09 UNIT 18 VOLCANO CLIFFS SUBDIVISON CITY OF ALBUQUERQUE, BERNALILLO COUNTY, NEW MEXICO

NOTES:


- 1. ALL SPOT ELEVATIONS REPRESENT FLOWLINE ELEVATION UNLESS OTHERWISE NOTED.
- 2. ALL SLOPES SHALL BE 3:1 MAX. AND GRAVEL OR NATIVE SEEDING PRIOR TO CO.
- 3. ANY PERIMETER WALLS MUST BE PERMITED SEPARATELY ALL RETAINING WALL DESIGN SHALL BE BY OTHERS.
- DATUM 1988.

4. SURVEY INFORMATION PROVIDED BY COMMUNITY SCIENCES CORPORATION USING NAVD


5. A PAD ELEVATION CERTIFICATION SHALL BE REQUIRED PRIOR TO RELEASE OF BUILDING

LEGEND

	EXISTING CONTOUR
	EXISTING INDEX CONTOUR
	PROPOSED CONTOUR
→XXXX	PROPOSED INDEX CONTOUR
× XXXX	EXISTING SPOT ELEVATION
■ XXXX	PROPOSED SPOT ELEVATION
	BOUNDARY
	ADJACENT BOUNDARY
=========	EXISTING CURB AND GUTTER
	PROPOSED EARTHEN SWALE
	PROPOSED RETAINING WALL
	PROPOSED CONCRETE

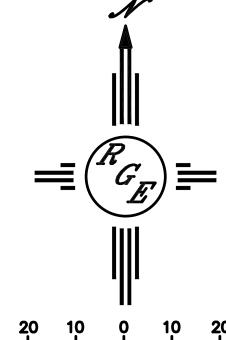

SCALE: 1"=20'

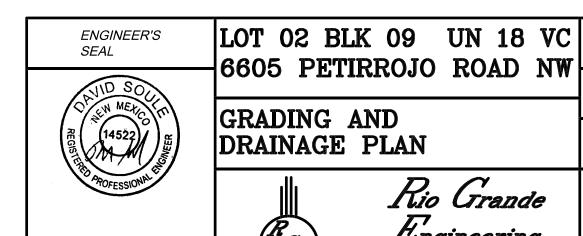

DAVID SOULE P.E. #14522

3/1/2

6605 PETIRROJO ROAD NW GRADING AND DRAINAGE PLAN

PO BOX 93924

Rio Grande Lingineering ALBUQUERQUE, NM 87199 (505) 321-9099

DRAWN

 BY DEM

DATE

2-27-21

Lot 02 Blk 09 Un 18 VC.DWG

SHEET#

JOB#

C1

END RETAINING WALL WATER QUALITY POND 5325.40 3.**TOP = 5323**.25 TOP = 5327.00BOTTOM = 5322.75 ×5323.31 BOTTOM = 5326.00 5325.77 VOLUME = 249CF RETAINING √5323.52**** 5325.16 BEGIN RETAINING WALL TOP = 5327.00 BOTTOM = 5326.005322.81 FF = 5325.00 5324.29 $5^{321.73}$ FP = 5324.50 5324.62⁾ TURN BLOCK 320.84**@ 5324.25 `** 5324.77 5323.32 5323.06 5323.71 LOT OUTFALL @ 5323.00 WATER QUALITY POND TOP = 5323.00BOTTOM = 5322.00 VOLUME = 457 CF 4 CONSTRUCT ALL SWALES AND EROSION PROTECTION (SHOWN HATCHED) BELOW ADJACENT GRADE TO ENDSURE RUNOFF CAN BE CAPTURED AND CONVEYED PROPERLY. -----2" LAYER OF GRAVEL AT FLOW LINE

EARTHEN SWALE

CAUTION: EXISTING UTILITIES ARE NOT SHOWN. IT SHALL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR TO CONDUCT ALL **NECESSARY FIELD INVESTIGATIONS PRIOR** TO ANY EXCAVATION TO DETERMINE THE ACTUAL LOCATION OF UTILITIES & OTHER IMPROVEMENTS.

