


CITY OF ALBUQUERQUE



March 16, 2018

Scott M. McGee, P.E.
SMMPE, LLC
9700 Tanoan Dr. NE
Albuquerque, NM 87111

RE: **Explore Academy**
5100 Masthead NE
Conceptual Grading and Drainage Plan
Engineer's Stamp Date 3/12/18
Hydrology File: D17D003N

Dear Mr. McGee,

Based on the information provided in your submittal received 3/14/18, the above referenced plan is approved for Site Plan for Building Permit.

Prior to Building Permit:

1. Provide a detail for the 6" pipe inlets. Will these have a concrete apron and end section? Will they be grated? Will there be a local depression to prevent bypass flows?
2. A Private Facility Drainage Covenant is required for the stormwater quality pond. The original notarized form, exhibit A (legible on 8.5x11 paper), and recording fee (\$25, payable to City of Albuquerque) must be turned into DRC (4th, Plaza del Sol) for routing. Please contact Charlotte LaBadie (clabadie@cabq.gov, 924-3996) or Madeline Carruthers (mtafoya@cabq.gov, 924-3997) regarding the routing and recording process for covenants.
3. Additional comments may be provided at Building Permit, based on the outcome of the above remarks and level of detail shown on plans.



Prior to Certificate of Occupancy:

4. The Private Facility Drainage Covenant must be recorded with Bernalillo County and a copy included with the drainage certification.

If you have any questions, please contact me at 924-3695 or dpeterson@cabq.gov.

Sincerely,

Dana Peterson, P.E.
Senior Engineer, Planning Dept.
Development Review Services

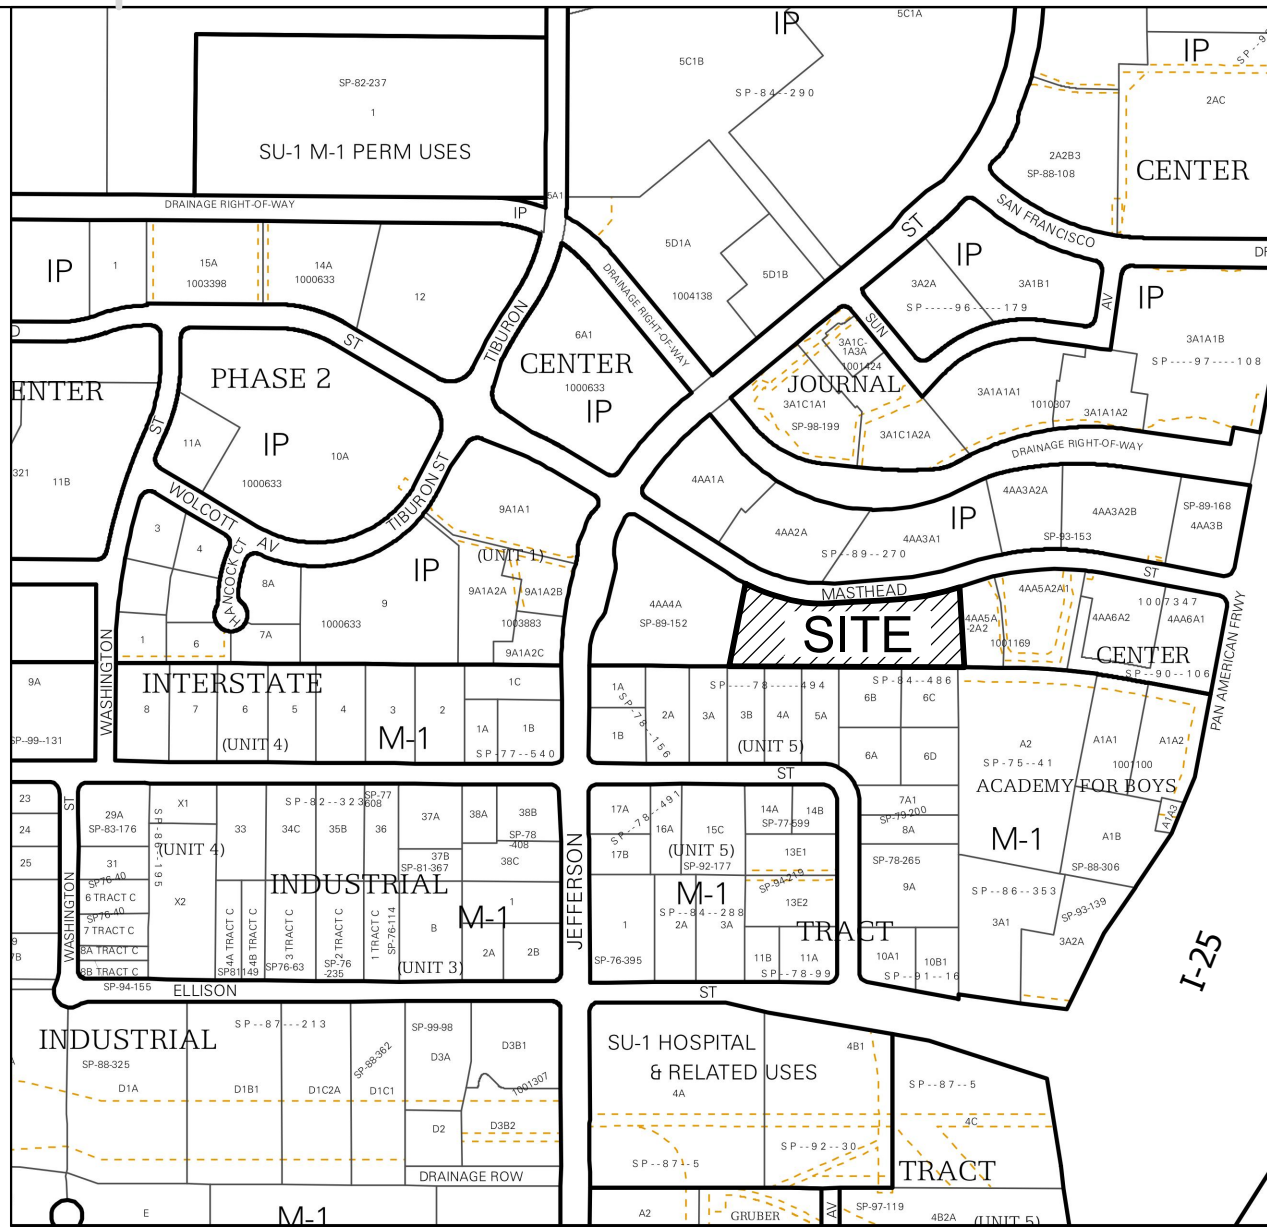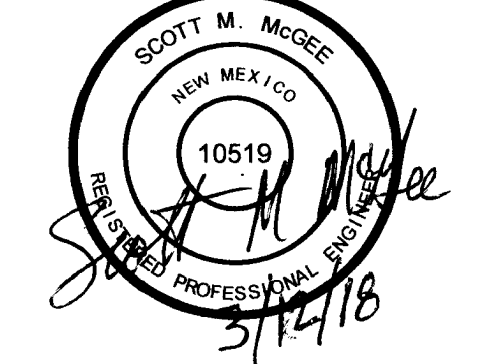

VICINITY MAP D-17
N.T.S.

DRAINAGE

LEGAL DESCRIPTION: Tract 4AA5A1 JOURNAL CENTER

AREA: 3.3001 acres (Project Area: 0.831 Acre = 36,200 SF)

SURVEYOR: Topographic survey by Precision Surveys, Inc. January, 2018

BENCHMARK: AGRS Monument "ZAB_B" ELEVATION = 5195.09 (NAVD 1988)

FLOOD HAZARD: From FEMA Map Panel 35001C0137H (effective 8/16/12), this site is within Zone "X"; areas determined to be subject to the 0.2% annual chance flood.

EXISTING CONDITIONS: The site is developed with a single-story school building, paved parking, walkways, and landscaping. A recent playground and grass field area have been constructed at the west end of the site which replaced asphalt paving. Site runoff surface flows to the west on both the north and south sides of the building and then discharges north to Masthead NE.

OFFSITE FLOW: No offsite flows enter the project site.

PROPOSED IMPROVEMENTS: The project includes two proposed single-story additions. A 4,180 SF addition is proposed at the NW corner and a 5,770 SF addition is proposed east of the building. The additions replace both paved and landscaped areas.


DRAINAGE APPROACH: The drainage concept will honor historic flow patterns. The west addition roof runoff will be directed to the west where it will discharge to grade and flow toward the new onsite retention area shown north of the grass field area. Runoff from the east addition will be carried north and then flow west on the paved surface.

RUNOFF: Precipitation Zone 2
Existing Q = $((.23)(2.28)+(.12)(3.14)+(.65)(4.70))(3.3 \text{ acre}) = 13.0 \text{ CFS}$
Proposed Q = $((.22)(2.28)+(.11)(3.14)+(.67)(4.70))(3.3 \text{ acre}) = 13.2 \text{ CFS}$

There is only a minor increase in site runoff which is mitigated to some extent by the onsite retention 1st flush volume.
For the proposed redevelopment area:
FIRST FLUSH V = $(9,950 \text{ SF})(0.26"/12) = 216 \text{ CF}$
VOLUME PROVIDED = 240 CF (@ 6" DEPTH)


Legend

- EXISTING CONTOUR — MAJOR
- EXISTING CONTOUR — MINOR
- NEW CONTOUR
- BASIN BOUNDARY
- SPOT ELEVATION
- FINISH FLOOR ELEVATION
- TOP OF CONCRETE FLOWLINE
- FLOW DIRECTION
- ROOF DRAIN

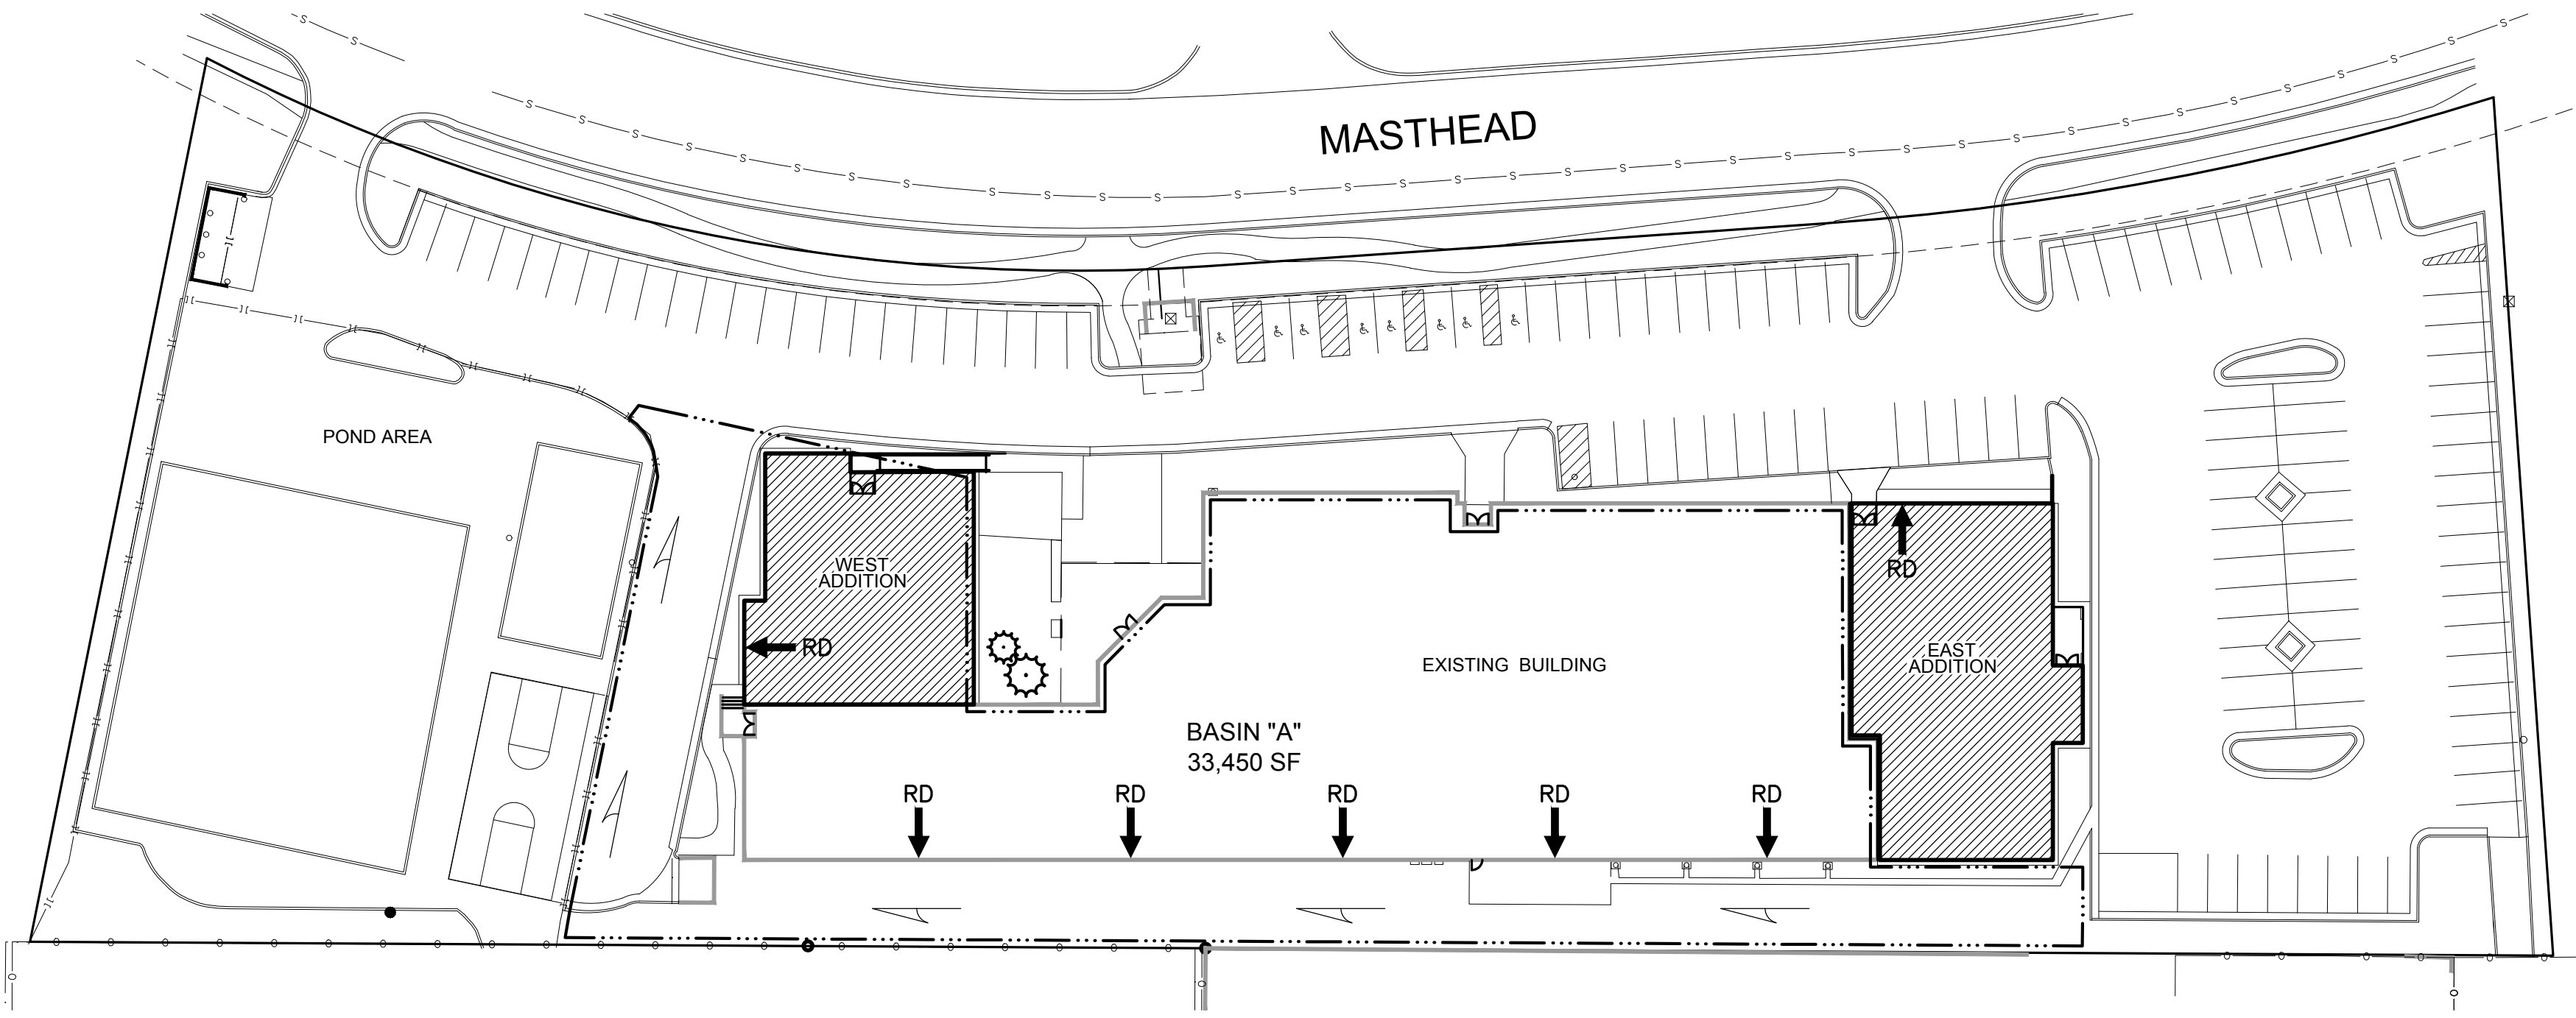


SITE LOCATION PLAN

1" = 40'-0"

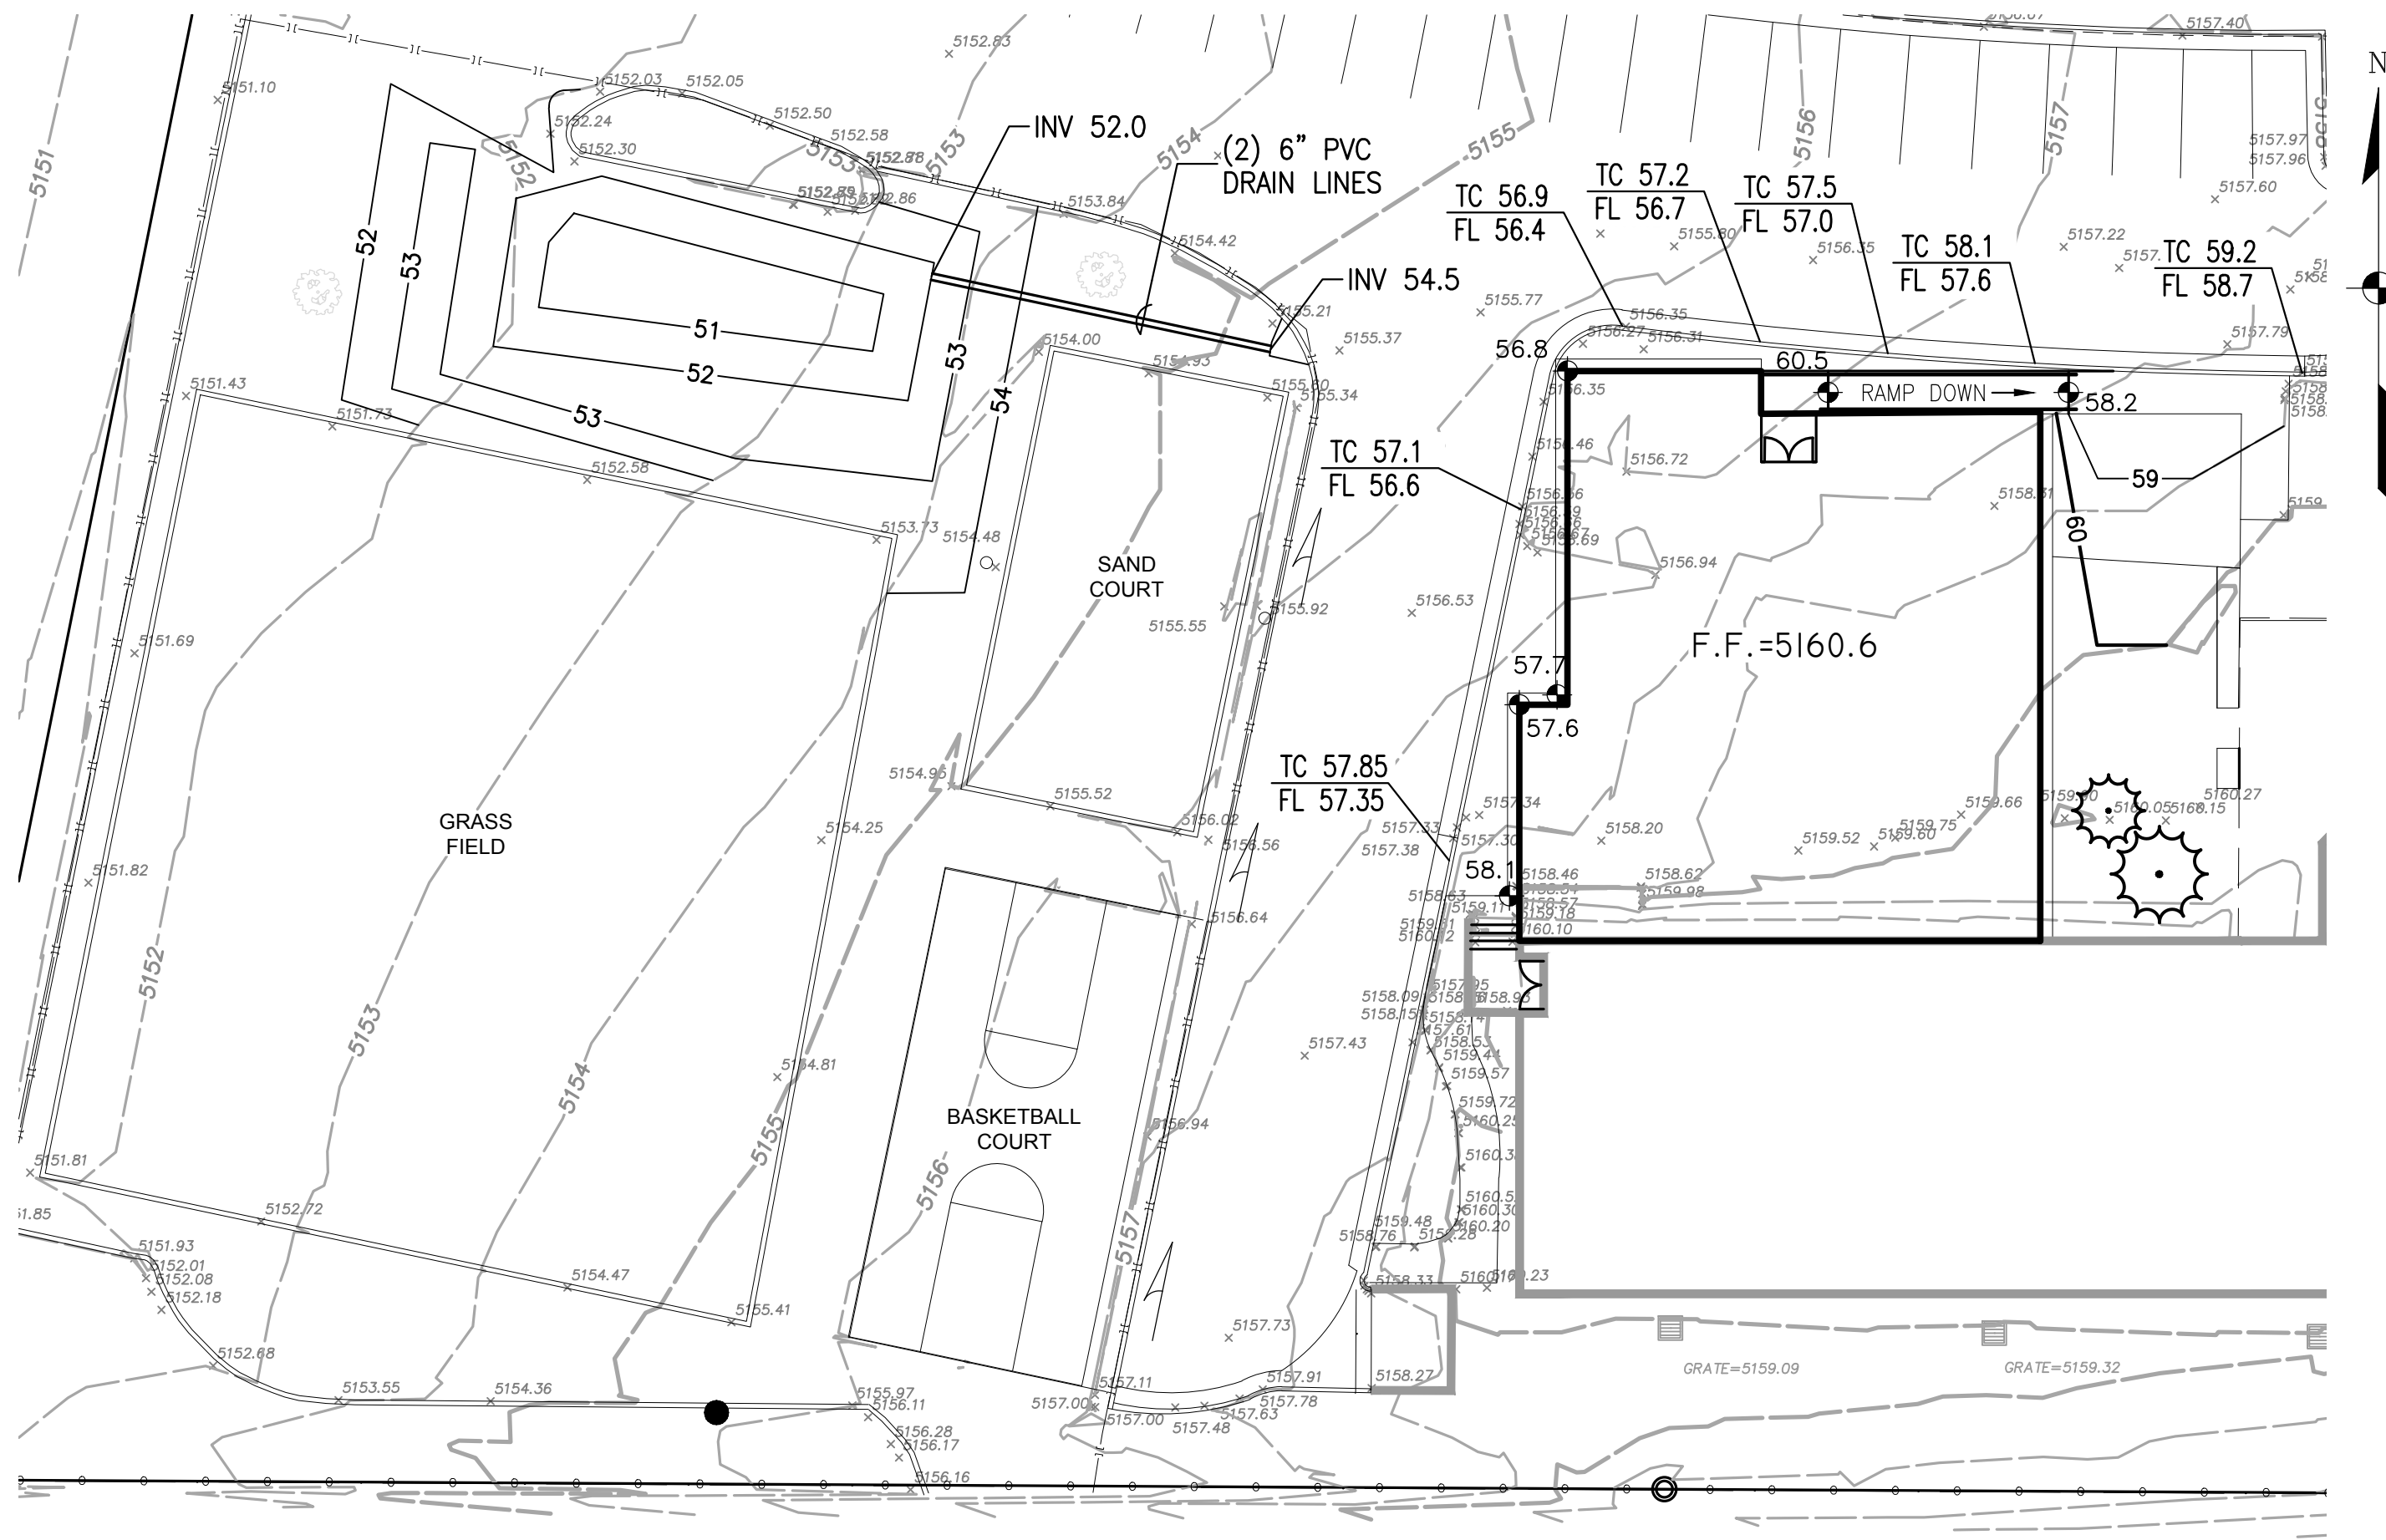

GRADING AND DRAINAGE PLAN
WEST ADDITION

1" = 20'-0"

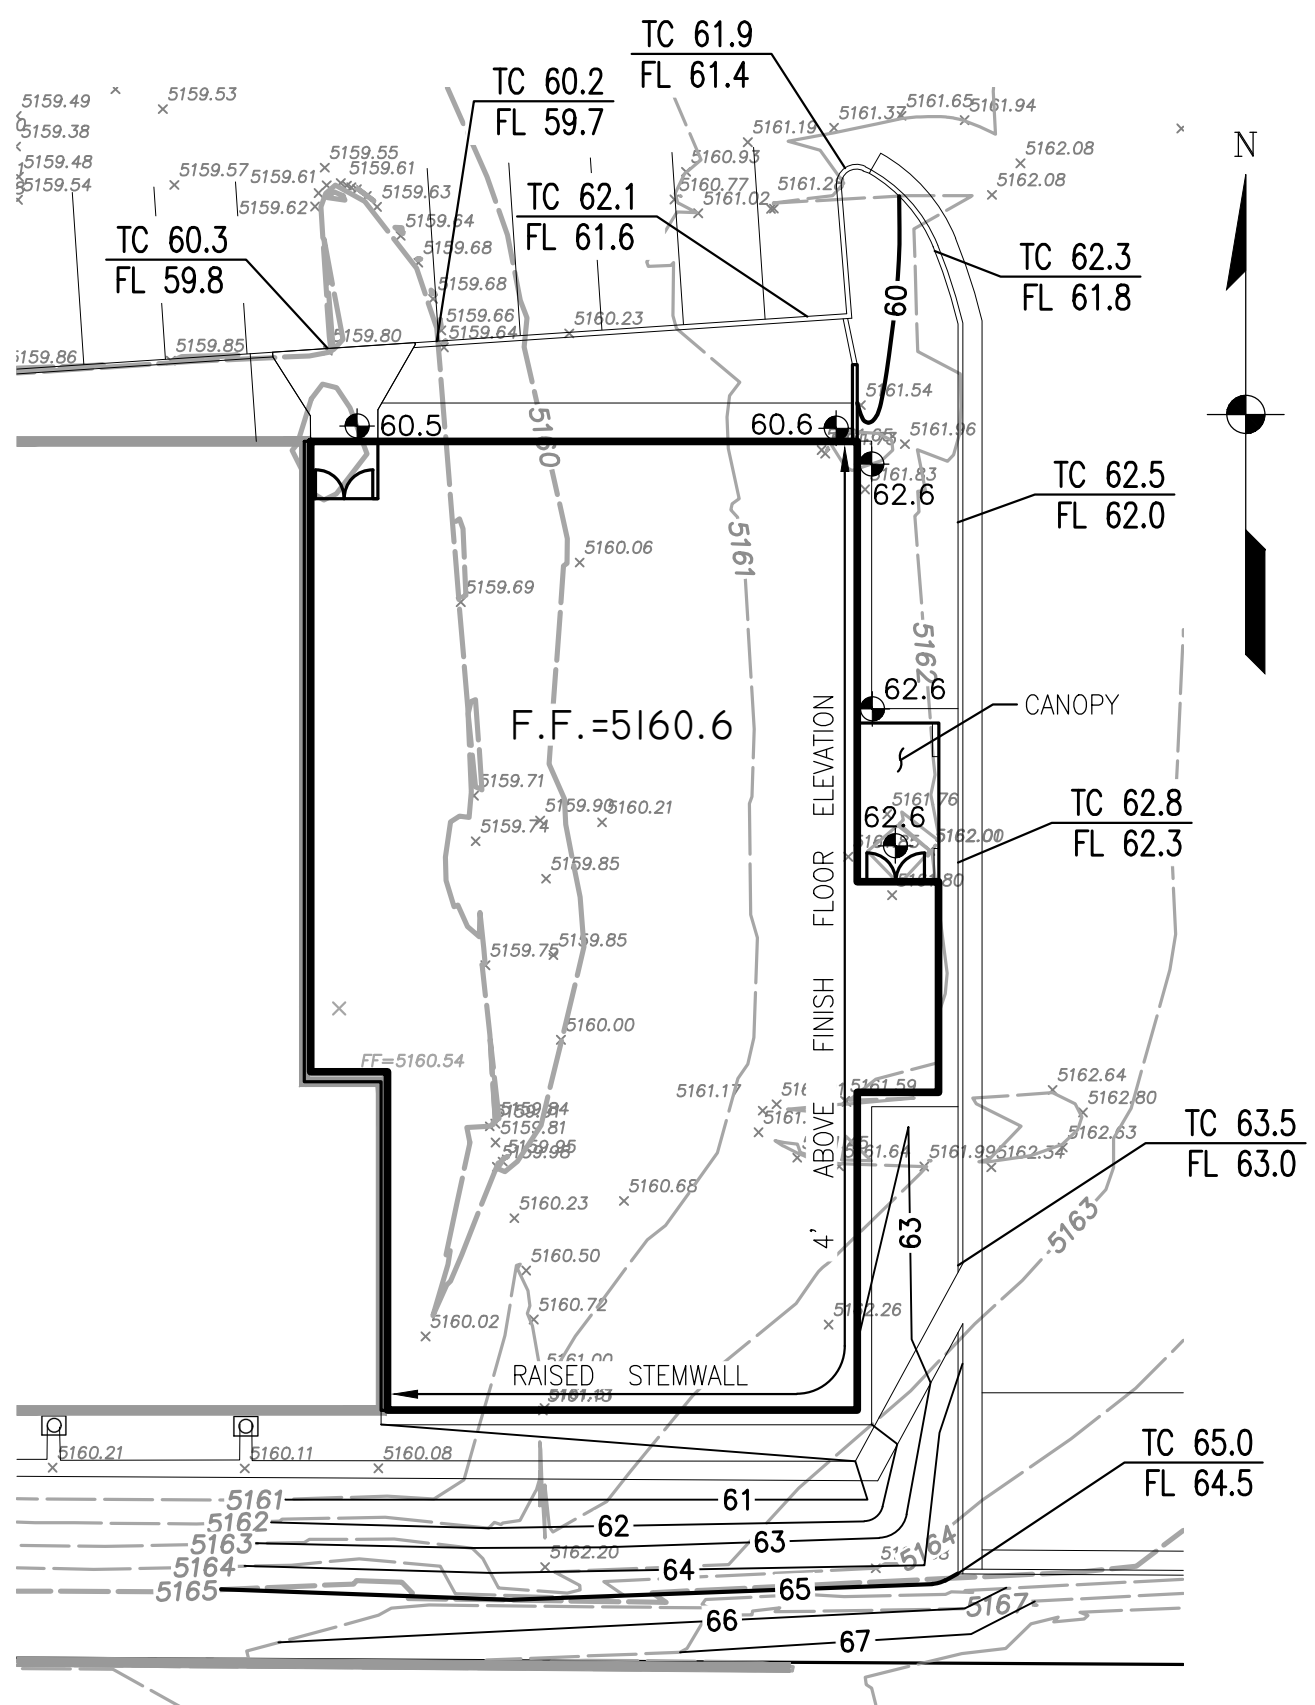

GRADING AND DRAINAGE PLAN
EAST ADDITION

1" = 20'-0"