

CITY OF ALBUQUERQUE



March 2, 2012

J. Arthur Blessen, P.E.
J. Arthur Blessen Engineering
11930 Menaul Blvd NE, Suite 109
Albuquerque, NM 87112

**Re: Gate of Heaven Cemetery
Site Grading Plan
Engineer's Stamp dated 6-9-12 (D19/D001A)**

Dear Mr. Blessen,

Based upon the information provided in your submittal received 2-24-12, the above referenced plan cannot be approved for Building Permit until the following comments are addressed.

- Per approved grading plans dated 6/4/2002 and 11/21/94 basins B & C were to drain into ponds B & C which was then piped to the outfall at Bob White Lane at a rate of 13.7cfs. This plan should propose the same drainage scheme.
- Provide basin, pipe and pond calculations to support the above mentioned drainage scheme.

Albuquerque's MS4 Permit became effective March 1st, 2012. Grading and Drainage Plans and Drainage Reports will have to comply with the requirements of the new permit. The permit is available online at www.cabq.gov/Planning/landcoord/Hydrology

If you have any questions, you can contact me at 924-3986 or Rudy Rael at 924-3977.

Sincerely,

Curtis A. Cherne, P.E.
Principal Engineer, Planning Dept.
Development and Building Services

C: RER/CAC
file

DRAINAGE AND TRANSPORTATION INFORMATION SHEET
(REV 12/2005)

PROJECT TITLE: GATE OF HEAVEN CEMETERY ZONE MAP: D19/001A
DRB#: _____ EPC#: _____ WORK ORDER#: _____

LEGAL DESCRIPTION: LOTS A, B, & C of Rancho de Palomas Manufactured Housing
CITY ADDRESS: 7999 Wyoming Blvd. NE

ENGINEERING FIRM: Soleil West Architects CONTACT: Arthur Blessen
ADDRESS: 11930 Menard NE Suite 109 PHONE: 293-1477
CITY, STATE: Albuquerque, NM 87112 ZIP CODE: 87112

OWNER: _____ CONTACT: JAB Engineering, com
ADDRESS: _____ ARCHITECTS @ soleilwest.com
CITY, STATE: _____ PHONE: _____
ZIP CODE: _____

ARCHITECT: _____ CONTACT: _____
ADDRESS: _____ PHONE: _____
CITY, STATE: _____ ZIP CODE: _____

SURVEYOR: _____ CONTACT: _____
ADDRESS: _____ PHONE: _____
CITY, STATE: _____ ZIP CODE: _____

CONTRACTOR: _____ CONTACT: _____
ADDRESS: _____ PHONE: _____
CITY, STATE: _____ ZIP CODE: _____

TYPE OF SUBMITTAL:

- ☒ DRAINAGE REPORT
- ☒ DRAINAGE PLAN 1st SUBMITTAL
- ☐ DRAINAGE PLAN RESUBMITTAL
- ☐ CONCEPTUAL G & D PLAN
- ☒ GRADING PLAN
- ☐ EROSION CONTROL PLAN
- ☐ ENGINEER'S CERT (HYDROLOGY)
- ☐ CLOMR/LOMR
- ☐ TRAFFIC CIRCULATION LAYOUT
- ☐ ENGINEER'S CERT (TCL)
- ☐ ENGINEER'S CERT (DRB SITE PLAN)
- ☐ OTHER (SPECIFY) _____

CHECK TYPE OF APPROVAL SOUGHT:

- ☐ SIA/FINANCIAL GUARANTEE RELEASE
- ☐ PRELIMINARY PLAT APPROVAL
- ☐ S. DEV. PLAN FOR SUB'D APPROVAL
- ☐ S. DEV. FOR BLDG. PERMIT APPROVAL
- ☐ SECTOR PLAN APPROVAL
- ☐ FINAL PLAT APPROVAL
- ☐ FOUNDATION PERMIT APPROVAL
- ☒ BUILDING PERMIT APPROVAL
- ☐ CERTIFICATE OF OCCUPANCY (PERM)
- ☐ CERTIFICATE OF OCCUPANCY (TEMP)
- ☐ GRADING PERMIT APPROVAL
- ☐ PAVING PERMIT APPROVAL
- ☐ WORK ORDER APPROVAL
- ☐ OTHER (SPECIFY) _____


WAS A PRE-DESIGN CONFERENCE ATTENDED:

- ☐ YES
- ☒ NO
- ☐ COPY PROVIDED

DATE SUBMITTED: _____ BY: FEB 24 2012

Requests for approvals of Site Development Plans and/or Subdivision Plats shall be accompanied by a drainage submittal. The particular nature, location, and scope to the proposed development defines the degree of drainage detail. One or more of the following level of submittal may be required based on the following:


1. **Conceptual Grading and Drainage Plan:** Required for approval of Site Development Plans greater than five (5) acres and Sector Plans.
2. **Drainage Plans:** Required for building permits, grading permits, paving permits and site plans less than five (5) acres.
3. **Drainage Report:** Required for subdivision containing more than ten (10) lots or constituting five (5) acres or more.

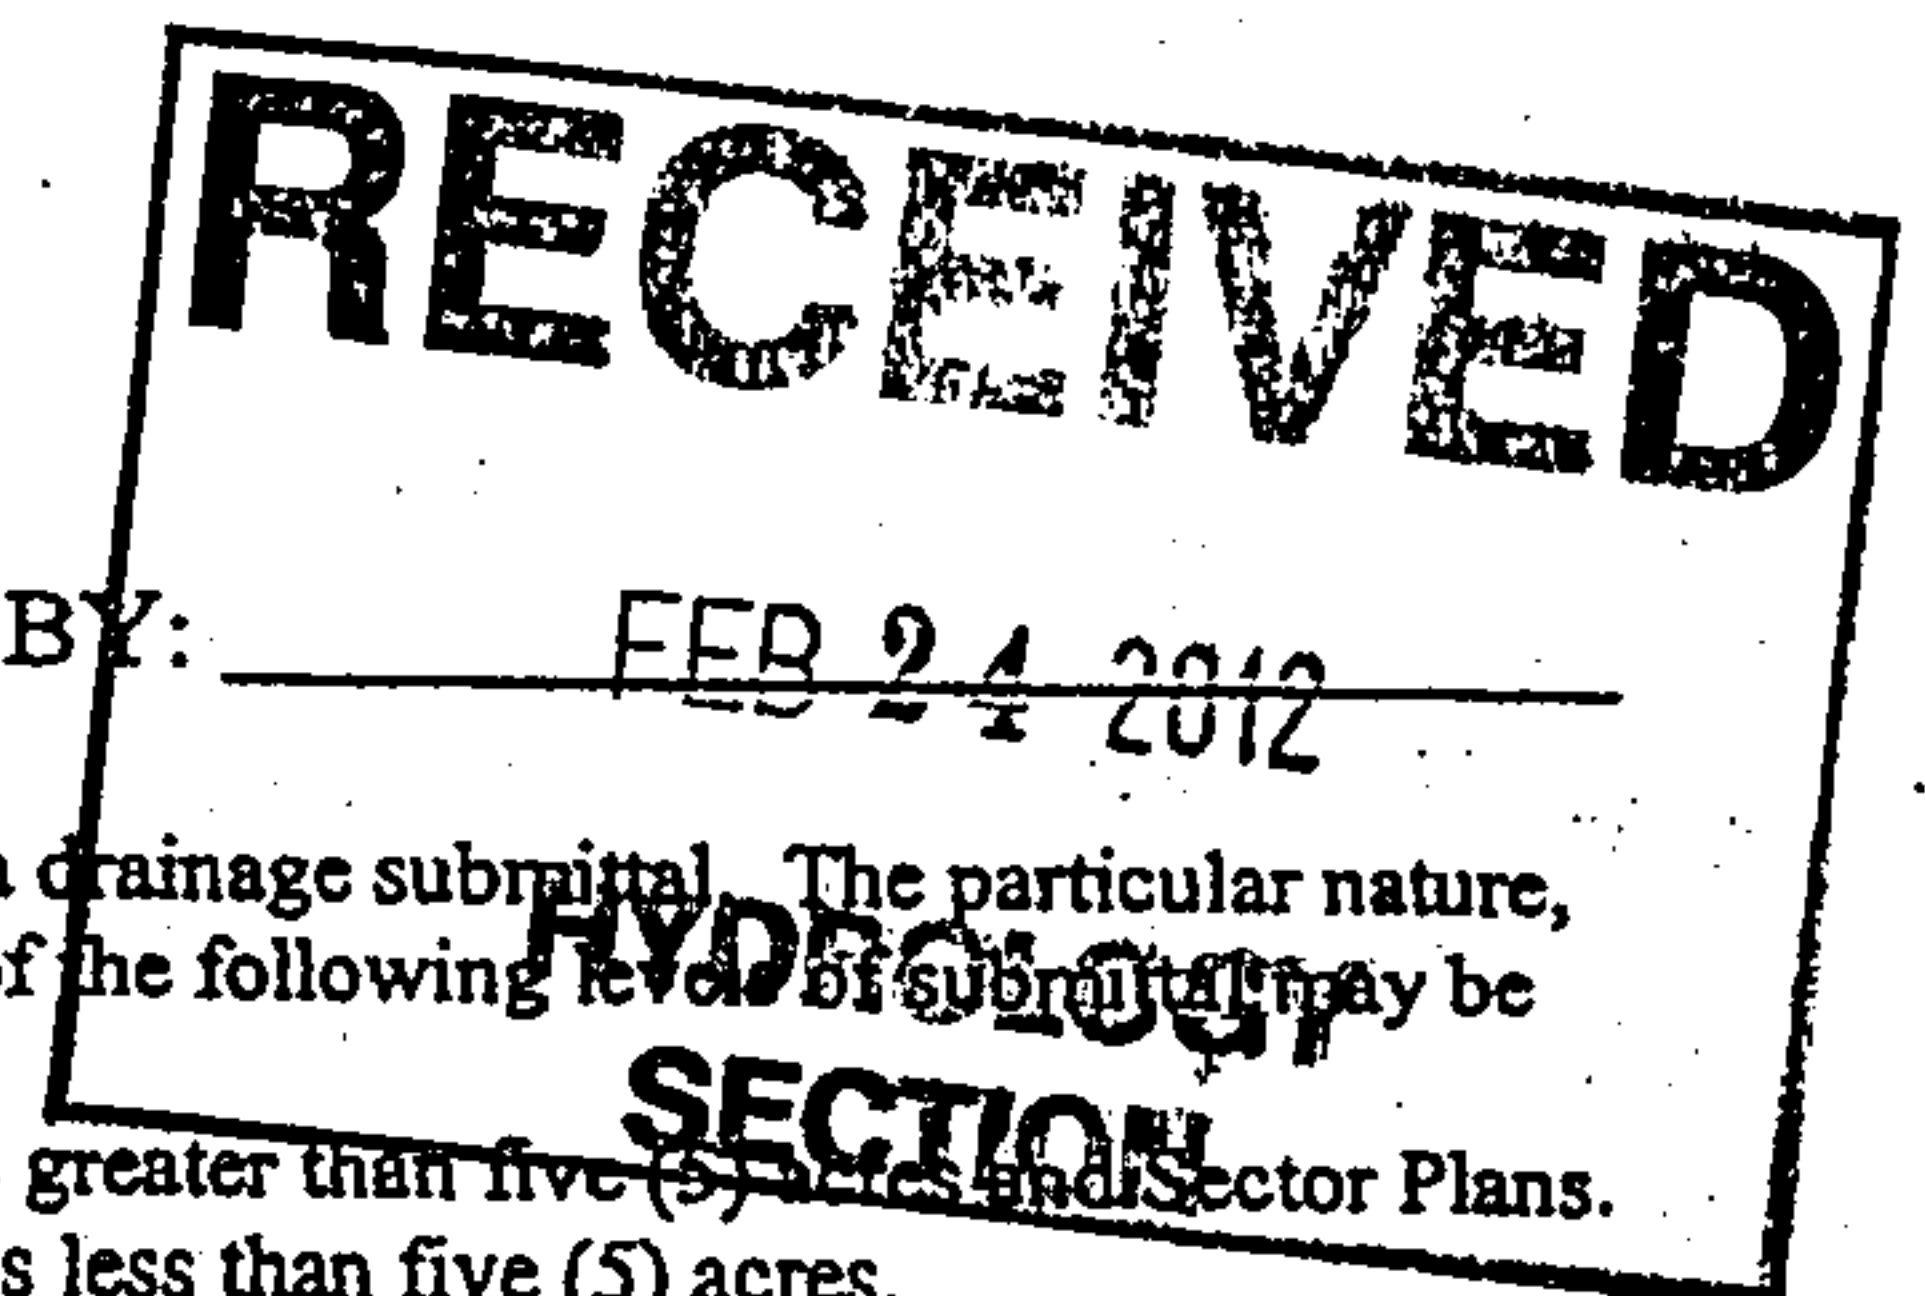

Drainage Report
for
Gate of Heaven Cemetery

7999 Wyoming Blvd. NE
Albuquerque, NM

February 15, 2012

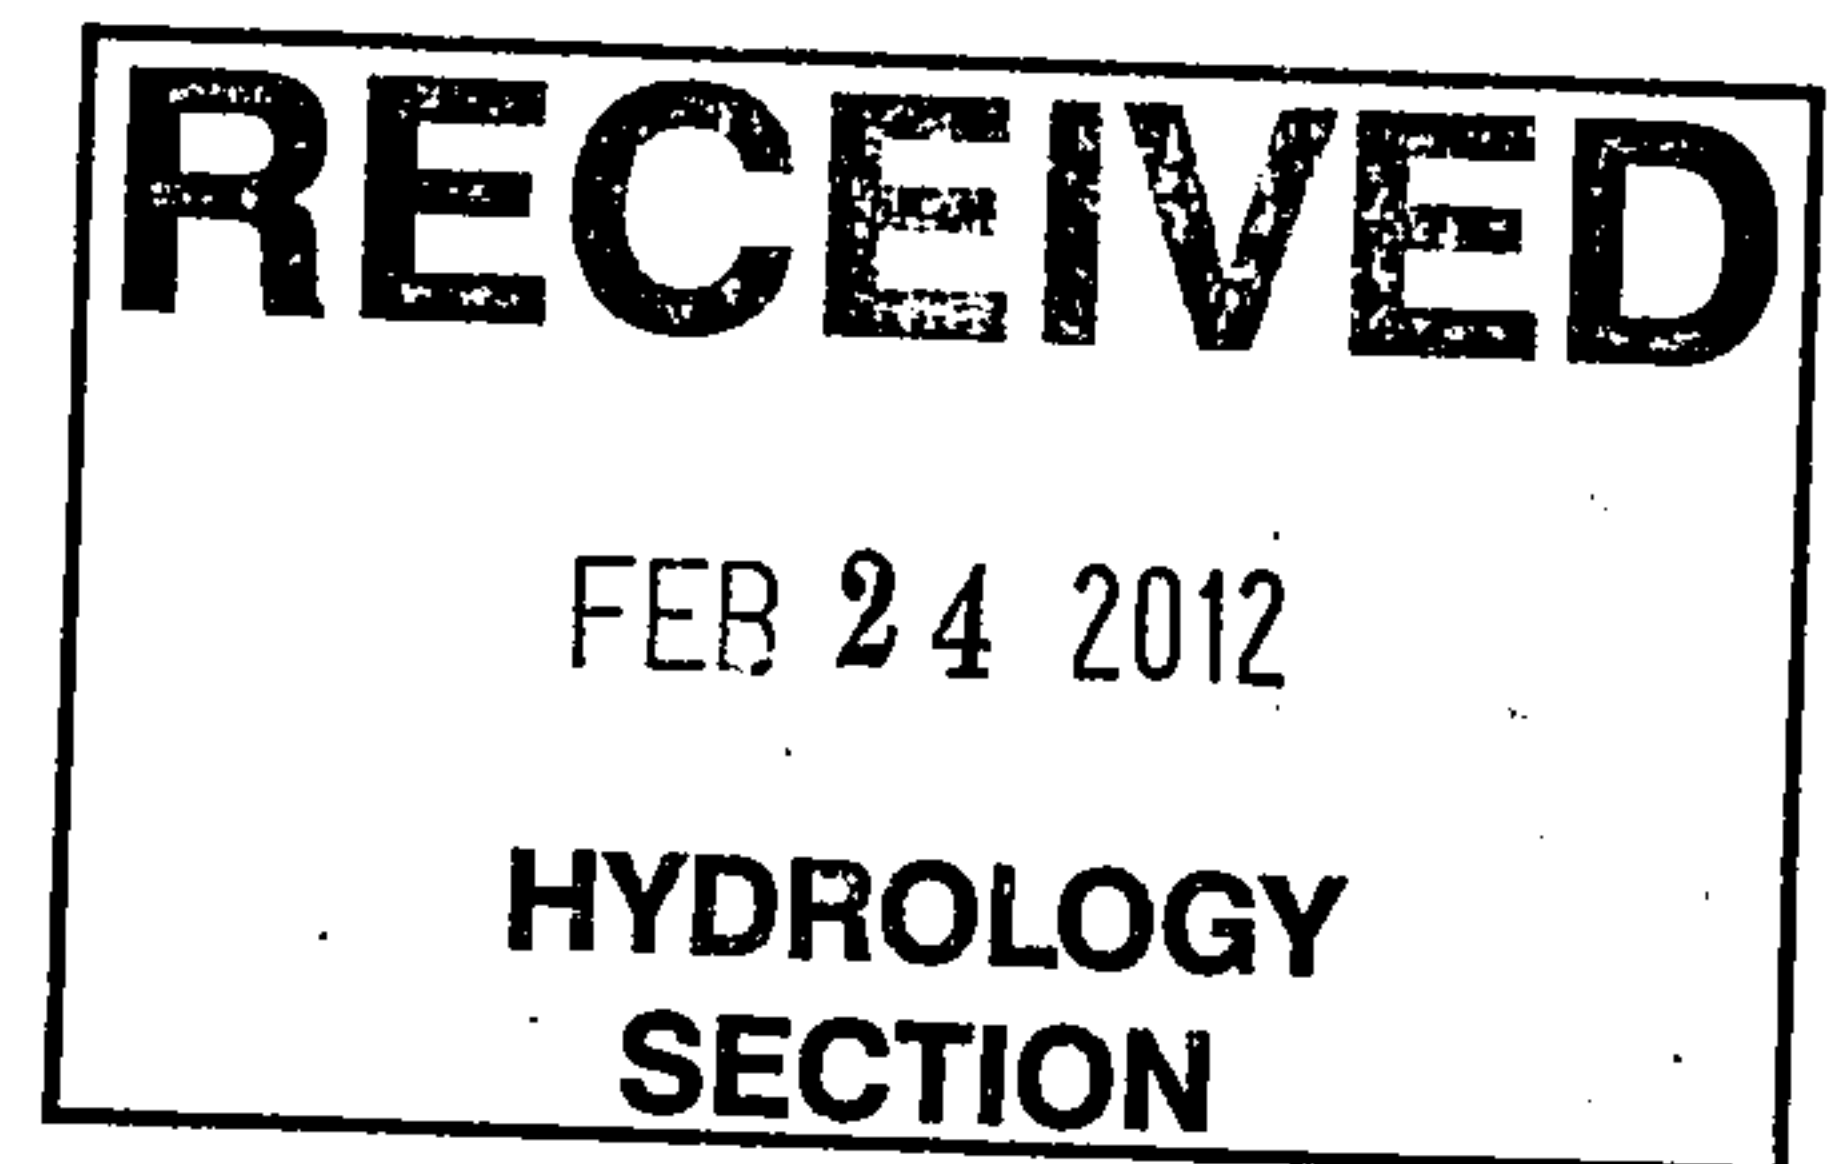

Location:

Lots A, B and C of Rancho de Palomas Manufactured Housing
7999 Wyoming Blvd, NE

Zone map D-19-Z file: D19-001A

East side of Edith NE, north of Indian School NE.

Perception Zone 3

Existing Conditions:

The existing site is comprised of two tracts totaling 19.9 acres. The majority of the site is developed as a cemetery with several support buildings. The site do not lie within a flood hazard zone (Panel 35001C0137G and Panel 35001C0141G) and no offsite flows past through the site.

The master drainage plan for the site was prepared C A Coonce & Associates, dated November 1994. An updated drainage plan, prepared by Advanced Engineering & Consulting was approved in June 2002. The drainage plan includes several facilities, roads, and drainage structures that have not been developed at this time. The site has been divided into three drainage basins. Basin A (23% of the site) located along the north property line, Basin B (49% of the site) contains the middle section of the site, and Basin C (29% of the site) located along the south property line.

Basin A slopes to the west at a 3% slope. The excess runoff flows to an existing drainage pond located at the west end of the site, and discharges to Rancho de Palomas at a controlled rate of 9.9 cfs. The majority of the basin remains undeveloped. No new development is proposed to basin A under this submittal.

Basin B slopes to the west at a 3% slope. The excess runoff flows to an existing drainage pond, Pond B, located along the west property line, and discharges to the existing 24" CMP from Bob White Lane via a 12" CMP at a controlled rate of 13.7 CFS. The allowable discharge established by the original drainage plan by C A Coonce is 14.5 cfs. The proposed development will not increase the flows to the Pond B.

Basin C slopes to the west at a 3% slope. The excess runoff flows to an existing drainage pond, Pond C, located at the south west corner of the site. The basin currently discharges to Rancho de Palomas at a rate of 10.8 cfs per the original drainage plan by by C A Coonce. The updated drainage plan proposed the development of larger detention pond with a controlled discharge to the 24" CMP from Bob White Lane. The east end of the basin remains undeveloped, The west end of the site is being used as a maintenance yard. The proposed development will increase the flows to Pond C.

where
to pull line

see it wrong

which pond
by how much
is flow at
the same
rate?

Developed Conditions:

The proposed development includes the construction of an addition to the west end of the Chapel and Mausoleum Building. The proposed addition was included in the master drainage plan prepared Advanced Engineering & Consulting. The runoff from the proposed addition will be routed to Basin C and to detention Pond C. The proposed improvements will increase the runoff from the site. A temporary pond will be created to contain the excess runoff. The runoff will continue to discharge to Rancho de Palomas at a controlled rate of 10.6 cfs.

Discharge Summary

		Discharge Rate	Historic Rate
Basin A	area 4.6 acres	9.9 csf (2.2 csf/acre)	8.5 cfs (1)
Basin B	area 9.4 acres	13.7 cfs (1.5 csf/acre)	18.1 cfs (1)
Basin C	area 5.8 acres	10.6 cfs (1.8 csf/acre)	10.6 cfs (1)

(1) From Advanced Engineering & Consulting drainage report June 2002

Calculation:

The calculations analyze the historic, existing and proposed conditions for the 6-hour, 100 year rainfall event. The analysis is in accordance with the City of Albuquerque Development Process Manual Volume II.

Pond C orifice

$$Q = 0.6 A (2 g h)^{0.5}$$

$$Q_{all} = 10.6 \text{ cfs}$$

$$h = 2.5 \text{ ft}$$

$$\text{Dia discharge pipe 16" (A pipe = 1.40 sf)}$$

$$Q = 0.6 (1.4) [2 (32.2) (2)]^{0.5} = 10.6 \text{ csf}$$

Pond C Volume

$$\begin{array}{ll} \text{surface area at 68.0} & 3108 \text{ sf} & \text{top} \\ \text{surface area at } 65.5 & 760 \text{ sf} & \text{bottom } 65.8 \end{array}$$

$$\text{Volume} = 0.5 (3108 + 760) (2.5) = 4835 \text{ cf}$$

Increase from	Historic	Existing
Excess Volume	0.246 acre ft	0.025 acre ft
Excess Rate	7.07 cfs	0.51 csf

Drainage Calculation

City of Albuquerque DPM 1997 edition

Gates of Heaven Basin C - Proposed

Precipitation Zone

3

Basin Area = 5.802 acres

Historic

Treatment

Area of A = 252756 sf 100%
Area of B = 0 sf 0%
Area of C = 0 sf 0%
Area of D = 0 sf 0%

Proposed Conditions

Treatment

Area of A = sf 0%
Area of B = 157511 sf 62%
Area of C = 68068 sf 27%
Area of D = 27177 sf 11%

Excess Precipitation, E (inches) 6 hr - 100 yr storm table A-8

Existing Conditions

Treatment	% of Area	En
A	1.00 x	0.66 = 0.66
B	0.00 x	0.912 = 0.00
C	0.00 x	1.29 = 0.00
D	0.00 x	2.36 = 0.00
E		E = 0.66

Improved Conditions

Treatment	% of Area	En
A	0.00 x	0.66 = 0.00
B	0.62 x	0.912 = 0.57
C	0.27 x	1.29 = 0.35
D	0.11 x	2.36 = 0.25
E		E = 1.17

Volume V = E A / 12

Ve	Vi
0.660 x 5.8025 / 12 = 0.319 acre ft	1.169 x 5.8025 / 12 = 0.565 acre ft
13902 cf	24633 cf

Discharge Rate, Q (cfs / acre) 100 yr storm table A-9

Treatment	% of Area	Q
A	1.00 x	1.87 = 1.87
B	0.00 x	2.6 = 0.00
C	0.00 x	3.45 = 0.00
D	0.00 x	5.02 = 0.00
q		q = 1.87

Treatment	% of Area	Q
A	0.00 x	1.87 = 0.00
B	0.62 x	2.6 = 1.62
C	0.27 x	3.45 = 0.93
D	0.11 x	5.02 = 0.54
q		q = 3.09

Peak Rate Qp = q A

Qp(e)	Qp(i)
1.87 x 5.8025 = 10.85 cfs	3.09 x 5.8025 = 17.92 cfs

Excess Volume = 0.246 acre ft
Excess Rate = 7.07 cfs

tc	tb	tp
0.2 hr	(2.107 * E * At / Qp) - (0.25 * Ad / At) = 0.771 hr	(0.7 * tc) + ((1.6 - (Ad / At)) / 12) = 0.264 hr

Discharge Rate 10.60 cfs

Volume 25736 cf
Discharged - 21020 cf

Pond Volume 4717 cf

Drainage Calculation

City of Albuquerque DPM 1997 edition

Gates of Heaven Basin C

Precipitation Zone 3
Basin Area = 5.802 acres

Existing Conditions Treatment

Area of A = 0 sf 0%
Area of B = 166711 sf 66%
Area of C = 68068 sf 27%
Area of D = 17977 sf 7%

Proposed Conditions Treatment

Area of A = sf 0%
Area of B = 157511 sf 62%
Area of C = 68068 sf 27%
Area of D = 27177 sf 11%

Excess Precipitation, E (inches) 6 hr - 100 yr storm table A-8

Existing Conditions Treatment

Treatment	% of Area	En
A	0.00 x	0.66 = 0.00
B	0.66 x	0.912 = 0.60
C	0.27 x	1.29 = 0.35
D	0.07 x	2.36 = 0.17
		E = 1.12

Improved Conditions Treatment

Treatment	% of Area	En
A	0.00 x	0.66 = 0.00
B	0.62 x	0.912 = 0.57
C	0.27 x	1.29 = 0.35
D	0.11 x	2.36 = 0.25
		E = 1.17

Volume V = E A / 12

Volume	Existing Conditions	Improved Conditions
Ve =	1.117 x 5.8025 / 12 = 0.540 acre ft	23523 cf
Vi =	1.169 x 5.8025 / 12 = 0.565 acre ft	24633 cf

Discharge Rate, Q (cfs / acre) 100 yr storm table A-9

Treatment	% of Area	Q
A	0.00 x	1.87 = 0.00
B	0.66 x	2.6 = 1.71
C	0.27 x	3.45 = 0.93
D	0.07 x	5.02 = 0.36
		q = 3.00

Treatment	% of Area	Q
A	0.00 x	1.87 = 0.00
B	0.62 x	2.6 = 1.62
C	0.27 x	3.45 = 0.93
D	0.11 x	5.02 = 0.54
		q = 3.09

Peak Rate Qp = q A

Peak Rate	Existing Conditions	Improved Conditions
Qp(e) =	3.00 x 5.8025 = 17.41 cfs	
Qp(i) =	3.09 x 5.8025 = 17.92 cfs	

Excess Volume = 0.025 acre ft
Excess Rate = 0.51 cfs


Time	Existing Conditions	Improved Conditions
tc =	0.2 hr	
tb =	(2.107 * E * At / Qp) - (0.25 * Ad / At) =	0.771 hr
tp =	(0.7 * tc) + ((1.6 - (Ad / At)) / 12) =	0.264 hr

Discharge Rate 10.60 cfs


Volume 25736 cf
Discharged - 21020 cf

Pond Volume 4717 cf

JOINS PANEL 0137

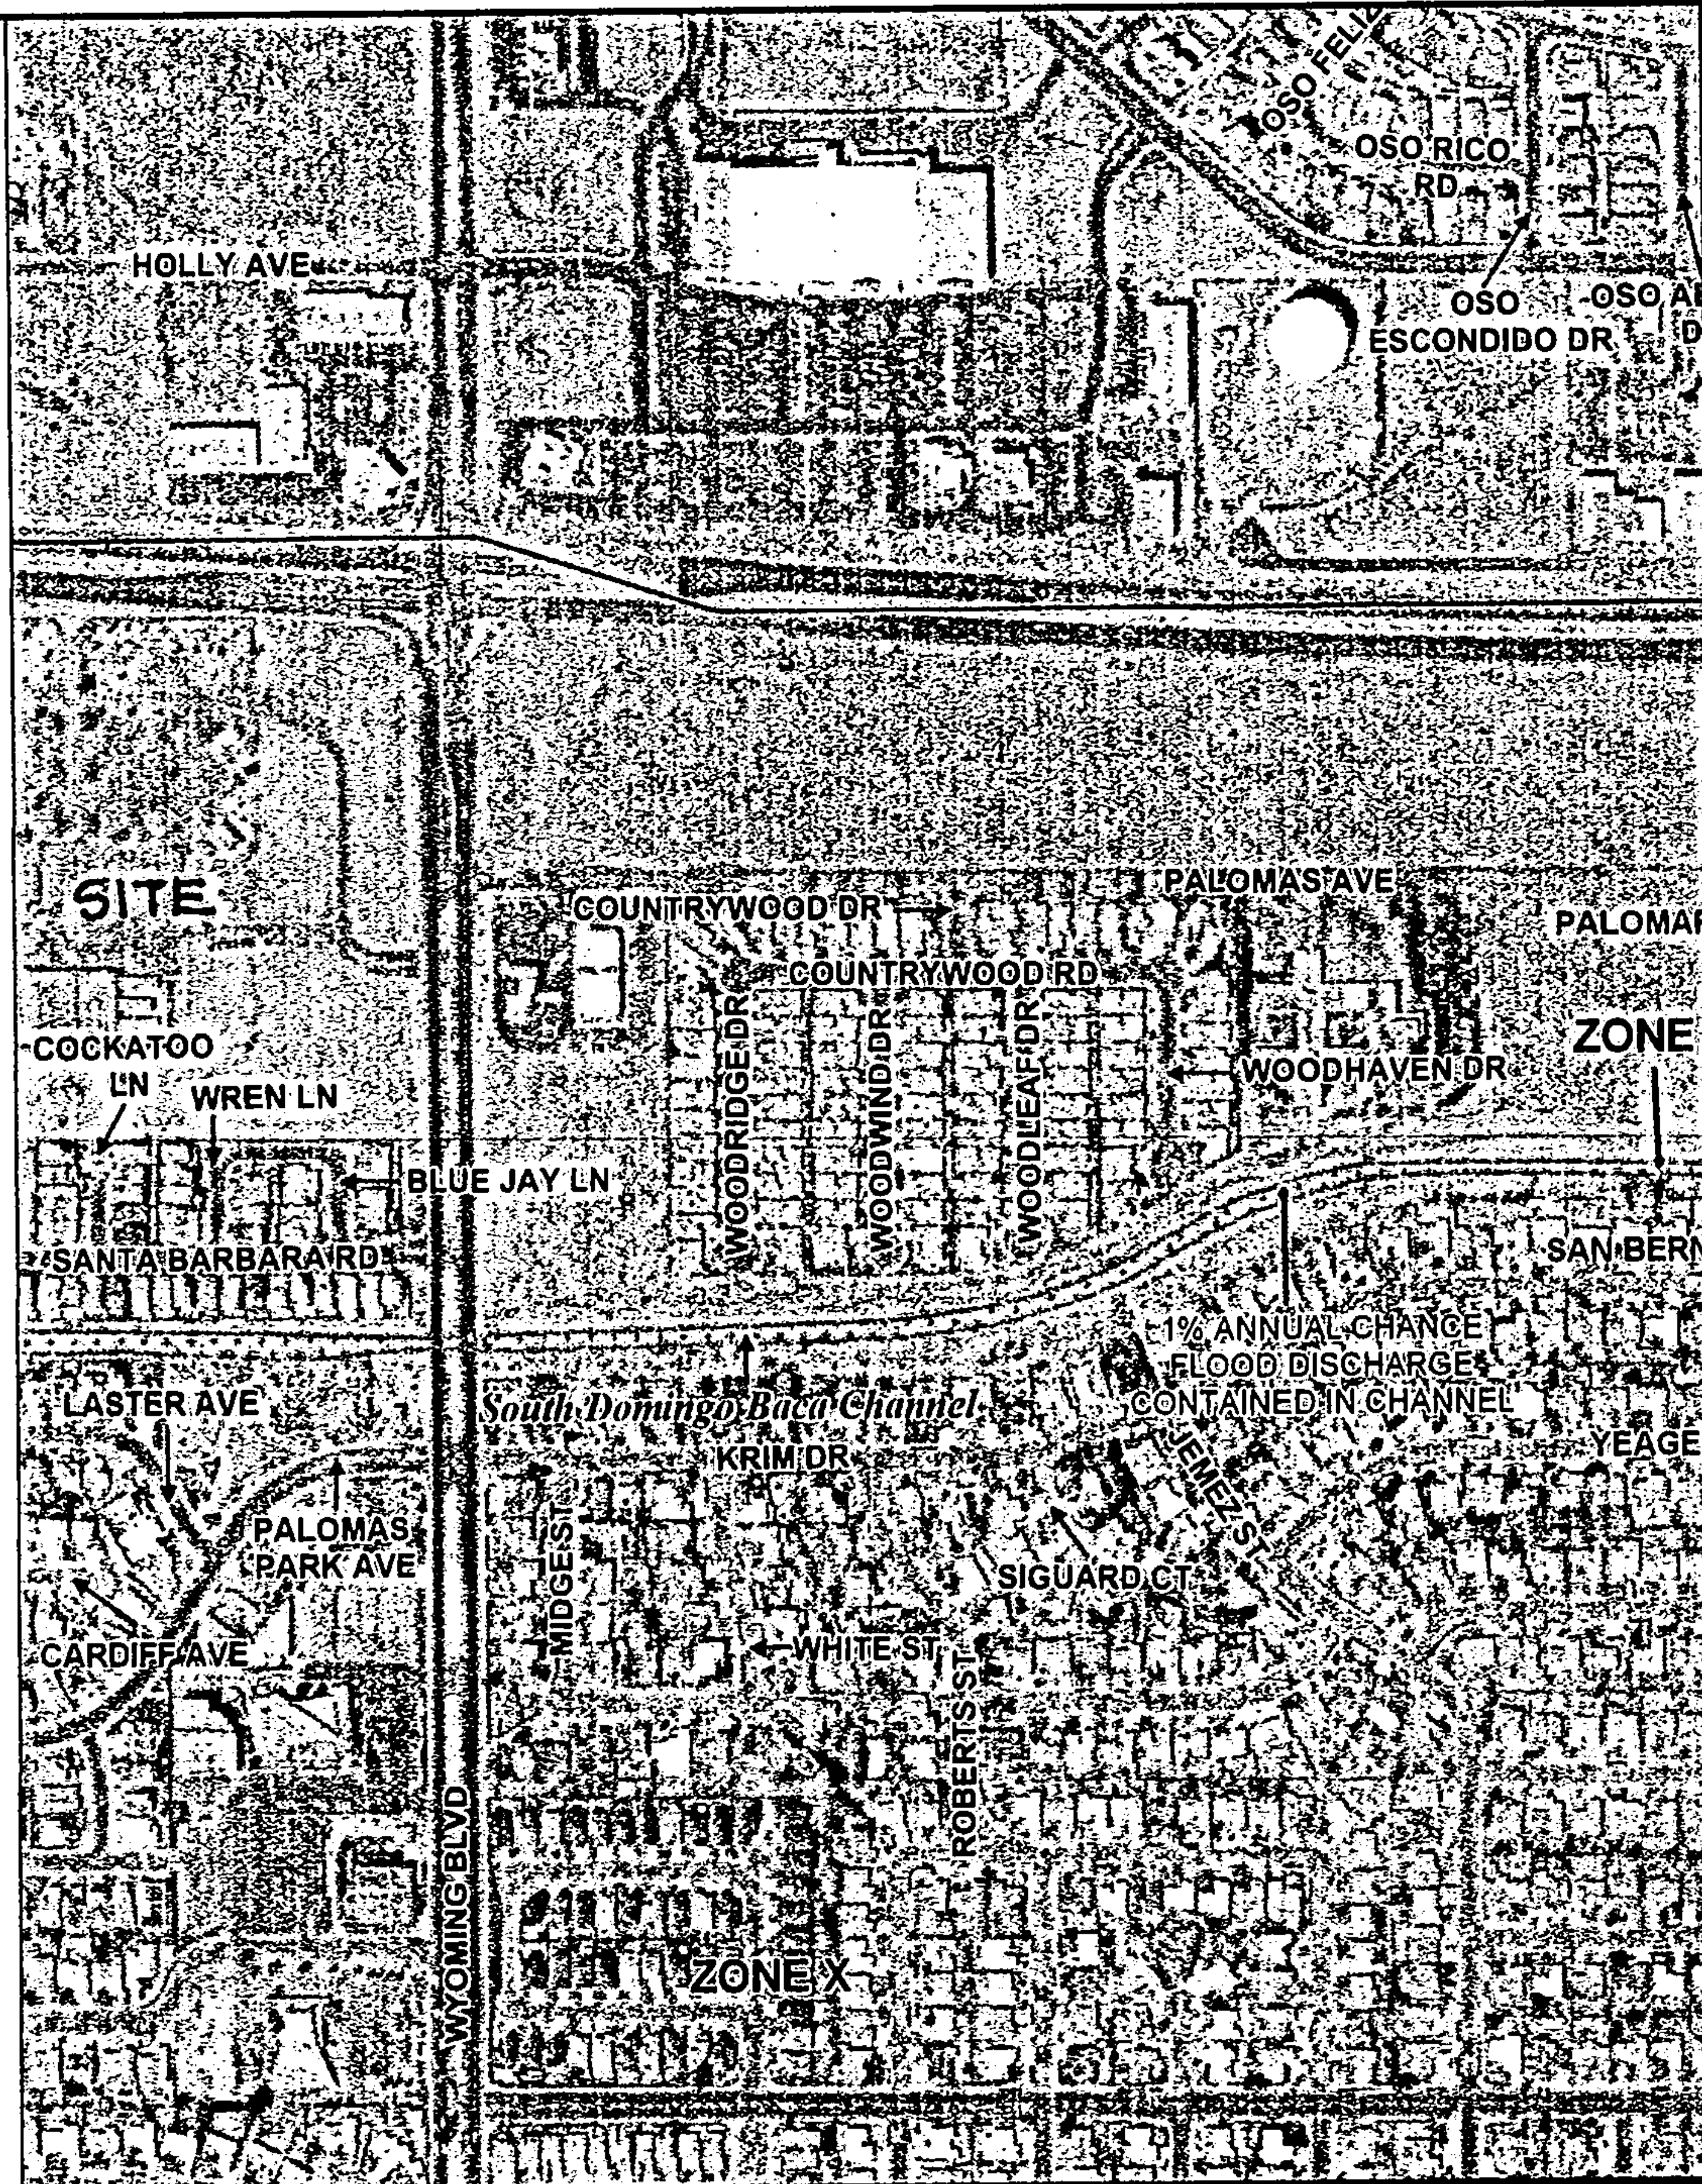

MAP SCALE 1" = 500'

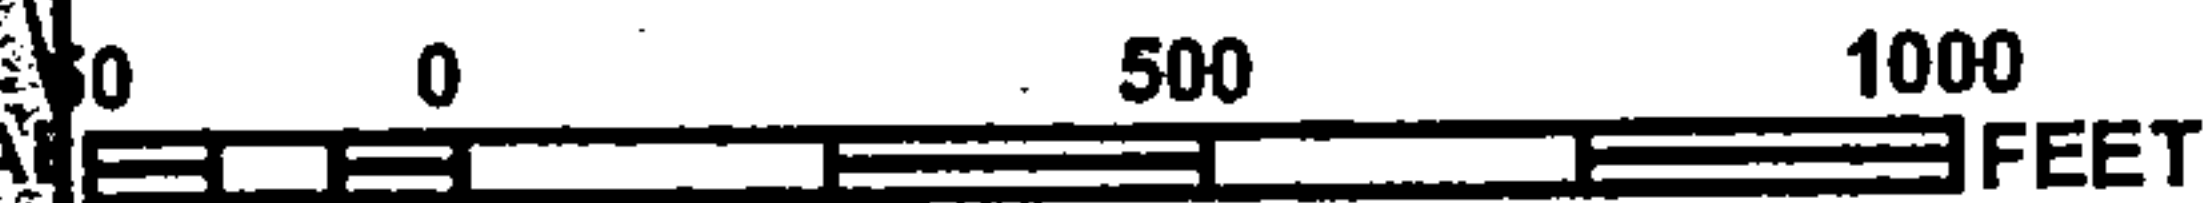

NFIP

NATIONAL FLOOD INSURANCE PROGRAM

PANEL 0141G

FIRM

FLOOD INSURANCE RATE MAP
BERNALILLO COUNTY,
NEW MEXICO
AND INCORPORATED AREAS

PANEL 141 OF 825

(SEE MAP INDEX FOR FIRM PANEL LAYOUT)

CONTAINS:

COMMUNITY	NUMBER	PANEL	SUFFIX
ALBUQUERQUE, CITY OF	350002	0141	G
BERNALILLO COUNTY UNINCORPORATED AREAS	350001	0141	G

Notice to User: The Map Number shown below should be used when placing map orders the Community Number shown above should be used on insurance applications for the subject community.



MAP NUMBER
35001C0141G

MAP REVISED
SEPTEMBER 26, 2008

Federal Emergency Management Agency

This is an official copy of a portion of the above referenced flood map. It was extracted using F-MIT On-Line. This map does not reflect changes or amendments which may have been made subsequent to the date on the title block. For the latest product information about National Flood Insurance Program flood maps check the FEMA Flood Map Store at www.msc.fema.gov

AL CHANGE
DISCHARGE
AINED IN
DEL NORTE
RAIN SYSTEM

HOLLY AVE

Bernalillo County
Unincorporated Areas
350001

AA3130 X

SITE

JOINS PANEL 0141

MAP SCALE 1" = 500'

0 500 1000
FEET

NFIP

PANEL 0137G

FIRM

FLOOD INSURANCE RATE MAP
BERNALILLO COUNTY,
NEW MEXICO
AND INCORPORATED AREAS

PANEL 137 OF 825

(SEE MAP INDEX FOR FIRM PANEL LAYOUT)

CONTAINS:

COMMUNITY	NUMBER	PANEL	SUFFIX
ALBUQUERQUE CITY OF	350002	0137	G
BERNALILLO COUNTY			
UNINCORPORATED AREAS 350001		0137	G

Notice to User: The Map Number shown below should be used when placing map orders. The Community Number shown above should be used on insurance applications for the subject community.



MAP NUMBER
35001C0137G

MAP REVISED
SEPTEMBER 26, 2008

Federal Emergency Management Agency

This is an official copy of a portion of the above referenced flood map. It was extracted using F-MIT On-Line. This map does not reflect changes or amendments which may have been made subsequent to the date on the title block. For the latest product information about National Flood Insurance Program flood maps check the FEMA Flood Map Store at www.mec.fema.gov

JOY PL

1% ANNUAL CHANGE
FLOOD DISCHARGE
CONTAINED IN CHANNEL

SPENGER RD

SPRINGFIELD DR

South Domingo

Baca Channel Easter Ave

BROWNING RD

STORRIE PL

GARDIFF AVE

PALOMAS PARK AVE

GATLING DR

WHIPPOORWILL LN

CHICKADEE LN

GOLDEN EAGLE DR

CANARY LN


BOBWHITE LN

LEONARD DR

SANFRANCISCO RD

ZONE X

CITY OF ALBUQUERQUE

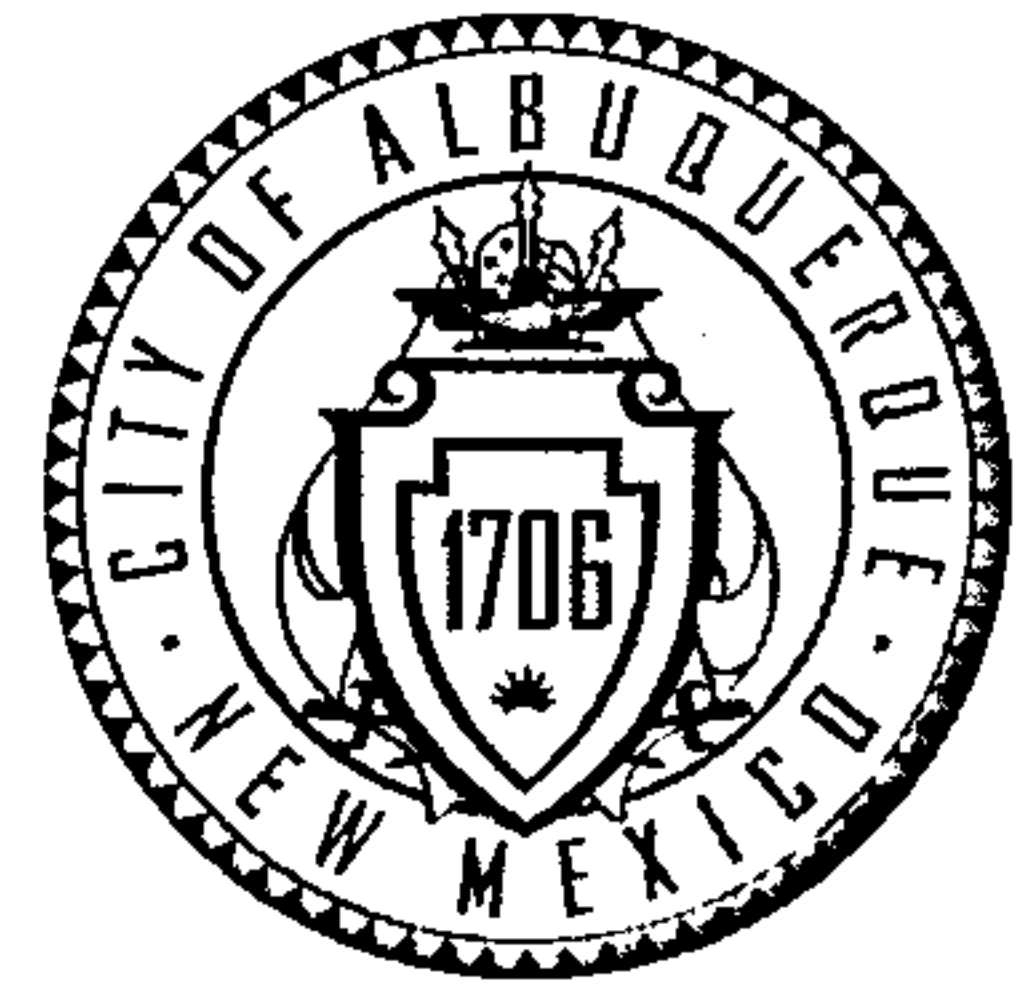

December 1, 2014

Art Blessen, PE
J. Arthur Blessen Engineering
2429 Zena Lona
Albuquerque, NM 87112

**Re: Gate Of Heaven Addition
7999 Wyoming Blvd NE
Request Permanent C.O. - Accepted
Engineer's Stamp dated: 3-26-12 (D19D001A)
Certification dated: 11-14-14**

Dear Mr. Eddings,

Based on the Certification received 11/20/2014, the site is acceptable for release of Certificate of Occupancy by Hydrology.

If you have any questions, you can contact me at 924-3695 or Rudy Rael at 924-3977.

PO Box 1293

Albuquerque

New Mexico 87103

Sincerely,

Curtis Cherne, P.E.
Principal Engineer, Planning Dept.
Development and Review Services

www.cabq.gov

C: RR/CC
email

DRAINAGE AND TRANSPORTATION INFORMATION SHEET

(REV 01/06 - KDM)

D19D001A

PROJECT TITLE: Gate of Heaven Addition ZONE MAP: D19/
DRB#: _____ EPC#: _____ WORK ORDER#: _____

LEGAL DESCRIPTION: Lots A, B, and C of Rancho de Palomas Manufactured Homes
CITY ADDRESS: 7999 Wyoming Blvd., N.E.

ENGINEERING FIRM: J. Arthur Blessen Engineering CONTACT: Art Blessen
ADDRESS: 2429 Zena Lona PHONE: (505) 401-4142
CITY, STATE: Albuquerque, NM ZIP CODE: 87112

OWNER: _____ CONTACT: _____
ADDRESS: _____ PHONE: _____
CITY, STATE: _____ ZIP CODE: _____

ARCHITECT: Soleil West Architects CONTACT: Kevin Balciar
ADDRESS: 2625 Pennsylvania Suite 600 PHONE: (505) 293-1477
CITY, STATE: Albuquerque, N M ZIP CODE: 87110

SURVEYING FIRM: _____ LICENSED SURVEYOR: _____
ADDRESS: _____ PHONE: _____
CITY, STATE: _____ ZIP CODE: _____

PROFESSIONAL LICENSED SURVEYOR SIGNATURE	LICENSE NO.	DATE
--	-------------	------


CONTRACTOR: _____ CONTACT: _____
ADDRESS: _____ PHONE: _____
CITY, STATE: _____ ZIP CODE: _____

TYPE OF SUBMITTAL:	CHECK TYPE OF APPROVAL SOUGHT:
☐ DRAINAGE REPORT	☐ SIA/FINANCIAL GUARANTEE RELEASE
☐ DRAINAGE PLAN 1 st SUBMITTAL	☐ PRELIMINARY PLAT APPROVAL
☐ DRAINAGE PLAN RESUBMITTAL	☐ S. DEV. PLAN FOR SUB'D APPROVAL
☐ CONCEPTUAL G & D PLAN	☐ S. DEV. FOR BLDG. PERMIT APPROVAL
☒ GRADING PLAN	☐ SECTOR PLAN APPROVAL
☐ EROSION CONTROL PLAN	☐ FINAL PLAT APPROVAL
☒ ENGINEER'S CERT (HYDROLOGY)	☐ FOUNDATION PERMIT APPROVAL
☐ CLOMR/LOMR	☐ BUILDING PERMIT APPROVAL
☐ TRAFFIC CIRCULATION LAYOUT	☒ CERTIFICATE OF OCCUPANCY
☐ ENGINEER'S CERT (TCL)	☐ GRADING PERMIT APPROVAL
☐ ENGINEER'S CERT (DRB SITE PLAN)	☐ PAVING PERMIT APPROVAL
☐ OTHER-	☐ WORK ORDER APPROVAL
	☐ OTHER (SPECIFY)

WAS A PRE-DESIGN CONFERENCE ATTENDED:

☐ YES
☒ NO
☐ COPY PROVIDED

DATE SUBMITTED: 11/20/14 BY: J Arthur Blessen

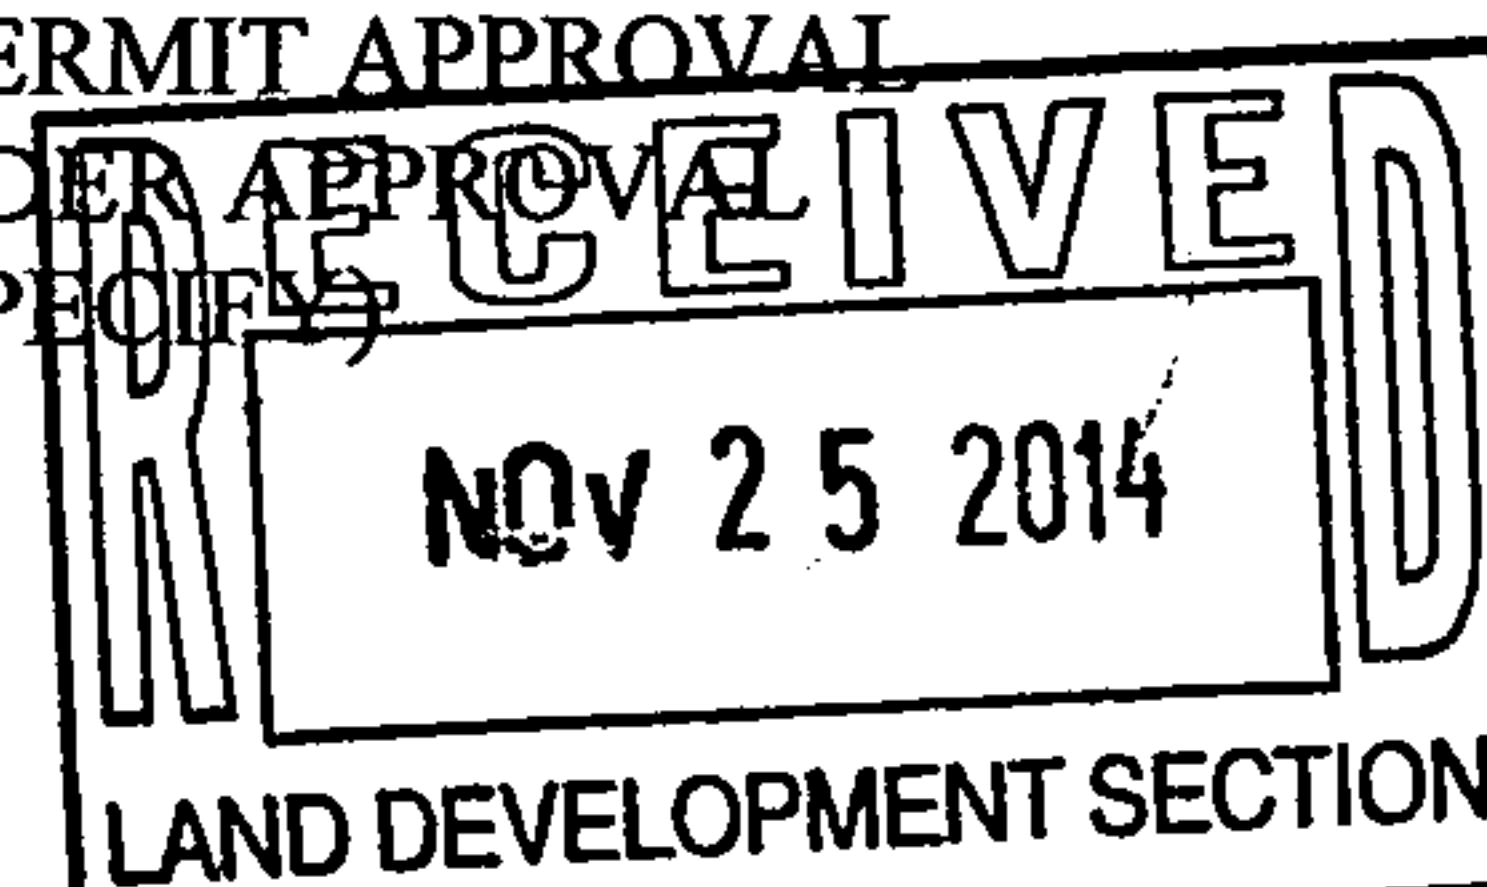

Requests for approvals of Site Development Plans and/or Subdivision Plats shall be accompanied by a drainage submittal. The particular nature, location, and scope to the proposed development defines the degree of drainage detail. One or more of the following levels of submittal may be required based on the following:

1. **Conceptual Grading and Drainage Plan:** Required for approval of Site Development Plans greater than five (5) acres and Sector Plans.
2. **Drainage Plans:** Required for building permits, grading permits, paving permits and site plans less than five (5) acres.
3. **Drainage Report:** Required for subdivision containing more than ten (10) lots or constituting five (5) acres or more.

DRAINAGE AND TRANSPORTATION INFORMATION SHEET
(REV 12/2005)

PROJECT TITLE: GATE OF HEAVEN CEMETERY ZONE MAP: D19/001A
DRB#: _____ EPC#: _____ WORK ORDER#: _____

LEGAL DESCRIPTION: LOTS A, B, & C of Rancho de Palomas Manufactured Housing
CITY ADDRESS: 1999 Wyoming Blvd. NE.

ENGINEERING FIRM: Soleil West Architects CONTACT: Arthur Blessen
ADDRESS: 11930 Menaul NE Suite 109 PHONE: 293-1477
CITY, STATE: Albuquerque, NM 87112 ZIP CODE: 87112

OWNER: _____ CONTACT: _____
ADDRESS: _____ PHONE: _____
CITY, STATE: _____ ZIP CODE: _____

ARCHITECT: _____ CONTACT: _____
ADDRESS: _____ PHONE: _____
CITY, STATE: _____ ZIP CODE: _____

SURVEYOR: _____ CONTACT: _____
ADDRESS: _____ PHONE: _____
CITY, STATE: _____ ZIP CODE: _____


CONTRACTOR: _____ CONTACT: _____
ADDRESS: _____ PHONE: _____
CITY, STATE: _____ ZIP CODE: _____

TYPE OF SUBMITTAL:
____ DRAINAGE REPORT
____ DRAINAGE PLAN 1st SUBMITTAL
☒ DRAINAGE PLAN RESUBMITTAL
____ CONCEPTUAL G & D PLAN
☒ GRADING PLAN
____ EROSION CONTROL PLAN
____ ENGINEER'S CERT (HYDROLOGY)
____ CLOMR/LOMR
____ TRAFFIC CIRCULATION LAYOUT
____ ENGINEER'S CERT (TCL)
____ ENGINEER'S CERT (DRB SITE PLAN)
____ OTHER (SPECIFY) _____

CHECK TYPE OF APPROVAL SOUGHT:
____ SIA/FINANCIAL GUARANTEE RELEASE
____ PRELIMINARY PLAT APPROVAL
____ S. DEV. PLAN FOR SUB'D APPROVAL
____ S. DEV. FOR BLDG. PERMIT APPROVAL
____ SECTOR PLAN APPROVAL
____ FINAL PLAT APPROVAL
____ FOUNDATION PERMIT APPROVAL
☒ BUILDING PERMIT APPROVAL
____ CERTIFICATE OF OCCUPANCY (PERM)
____ CERTIFICATE OF OCCUPANCY (TEMP)
____ GRADING PERMIT APPROVAL
____ PAVING PERMIT APPROVAL
____ WORK ORDER APPROVAL
____ OTHER (SPECIFY) _____

WAS A PRE-DESIGN CONFERENCE ATTENDED:
____ YES
____ NO
____ COPY PROVIDED


DATE SUBMITTED: 3-27-12

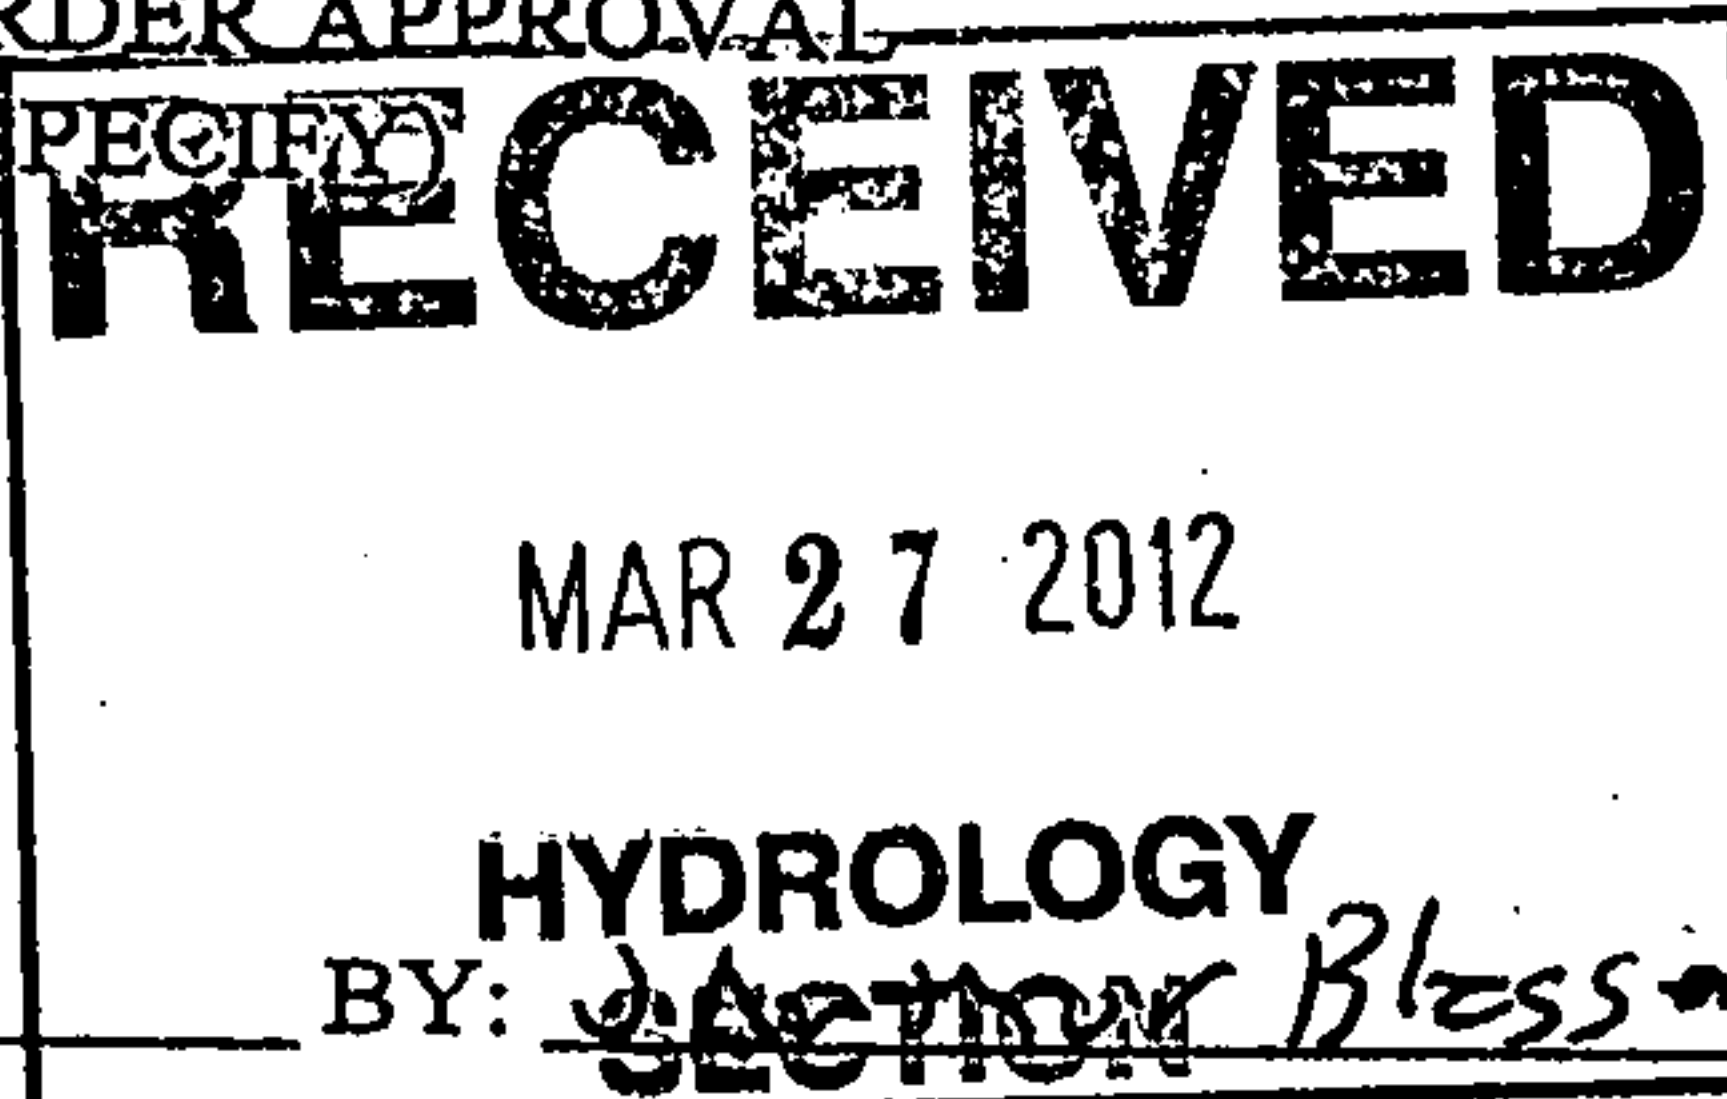

Requests for approvals of Site Development Plans and/or Subdivision Plats shall be accompanied by a drainage submittal. The particular nature, location, and scope to the proposed development defines the degree of drainage detail. One or more of the following levels of submittal may be required based on the following:

1. **Conceptual Grading and Drainage Plan:** Required for approval of Site Development Plans greater than five (5) acres and Sector Plans.
2. **Drainage Plans:** Required for building permits, grading permits, paving permits and site plans less than five (5) acres.
3. **Drainage Report:** Required for subdivision containing more than ten (10) lots or constituting five (5) acres or more.

CITY OF ALBUQUERQUE

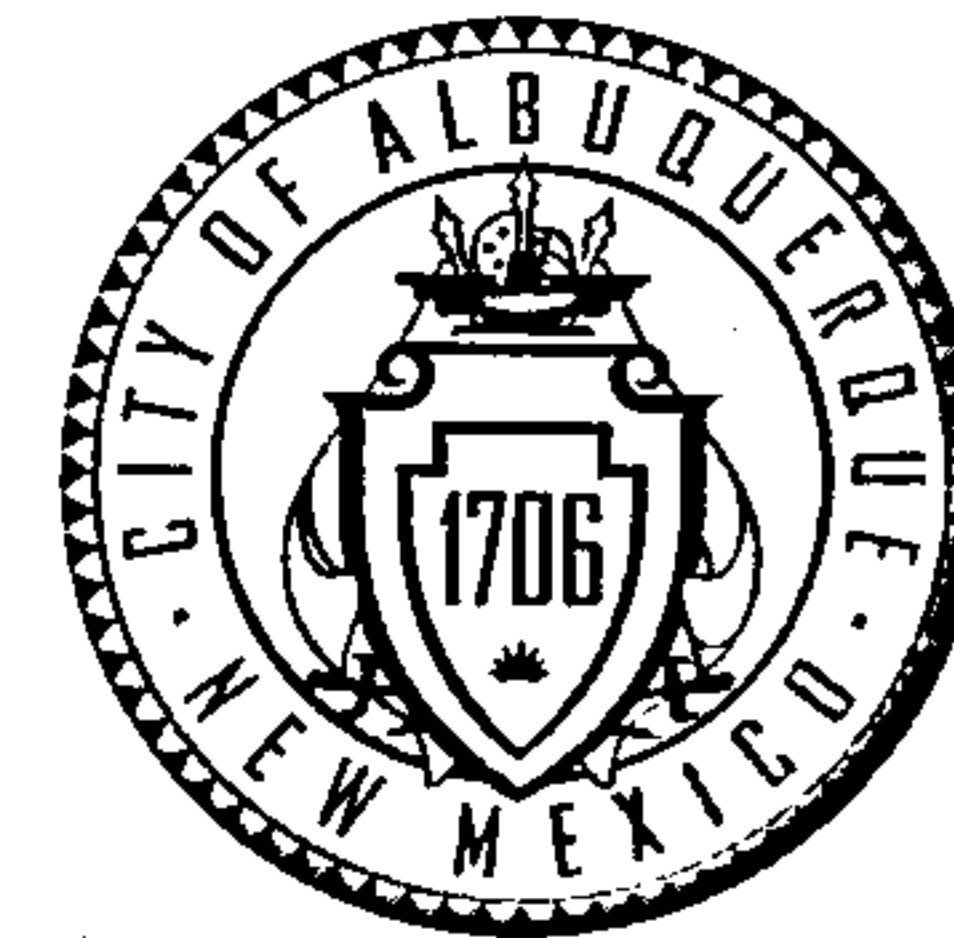

March 26, 2012

J. Arthur Blessen, P.E.
J. Arthur Blessen Engineering
11930 Menaul Blvd NE, Suite 109
Albuquerque, NM 87112

**Re: Gate of Heaven Cemetery
Site Grading Plan
Engineer's Stamp dated 3-5-12 (D19/D001A)**

Dear Mr. Blessen,

Based upon the information provided in your submittal received 3-06-12, the above referenced plan cannot be approved for Building Permit until the following comments are addressed.

- Per approved grading plans dated 6/4/2002 and 11/21/94 ponds B & C drained into Bob White Lane at a rate of 13.7cfs. This rate should remain unless it is proven that the rate of 24.2cfs will not cause adverse effects to the drainage system in Bob White Lane.
- Provide discharge calculations for pond C.

PO Box 1293

Albuquerque

NM 87103

www.cabq.gov

Albuquerque's MS4 Permit became effective March 1st, 2012. Grading and Drainage Plans and Drainage Reports will have to comply with the requirements of the new permit. The permit is available online at www.cabq.gov/Planning/landcoord/Hydrology

If you have any questions, you can contact me at 924-3986 or Rudy Rael at 924-3977.

Sincerely,

Curtis A. Cherne, P.E.
Principal Engineer, Planning Dept.
Development and Building Services

C: RER/CAC
file

March 5, 2012

re: Gate of Heaven Cemetery
file D19/D001A

Curtis Cherne PE
Principal Engineer, Planning Department, City of Albuquerque
PO Box 1293
Albuquerque, NM 87103

Dear Mr. Cherne,

I have received your letter of March 2, 2012. The grading plan has been revised to include a discharge pipe from Pond C to the existing culvert discharging to Bob White Lane. The rate of discharge from Basin C has been limited to 10.6 cfs established by the approved master plan for the site. The total discharge to Bob White Lane when the discharge for Basin C is combined with the existing discharge from Basin B (13.7 cfs) will be 24.2 cfs.

The discharge from Pond C will remain 10.6 csf, therefore the required pond volume will be the same as previously calculated. The size of the discharge pipe and depth of pond C will also remain the same as previously proposed. The revised pond C volume calculation are as follows:


Invert depth 5364.5 ft top of water elevation 5367 ft

Volume = $(0.5)(3902 + (2)(2020) + 1008) + (0.5)(.05)(1008) = 4727$ cf

Should you have any questions or require addition information please call.


J Arthur Blessen PE

Page 1 of 1

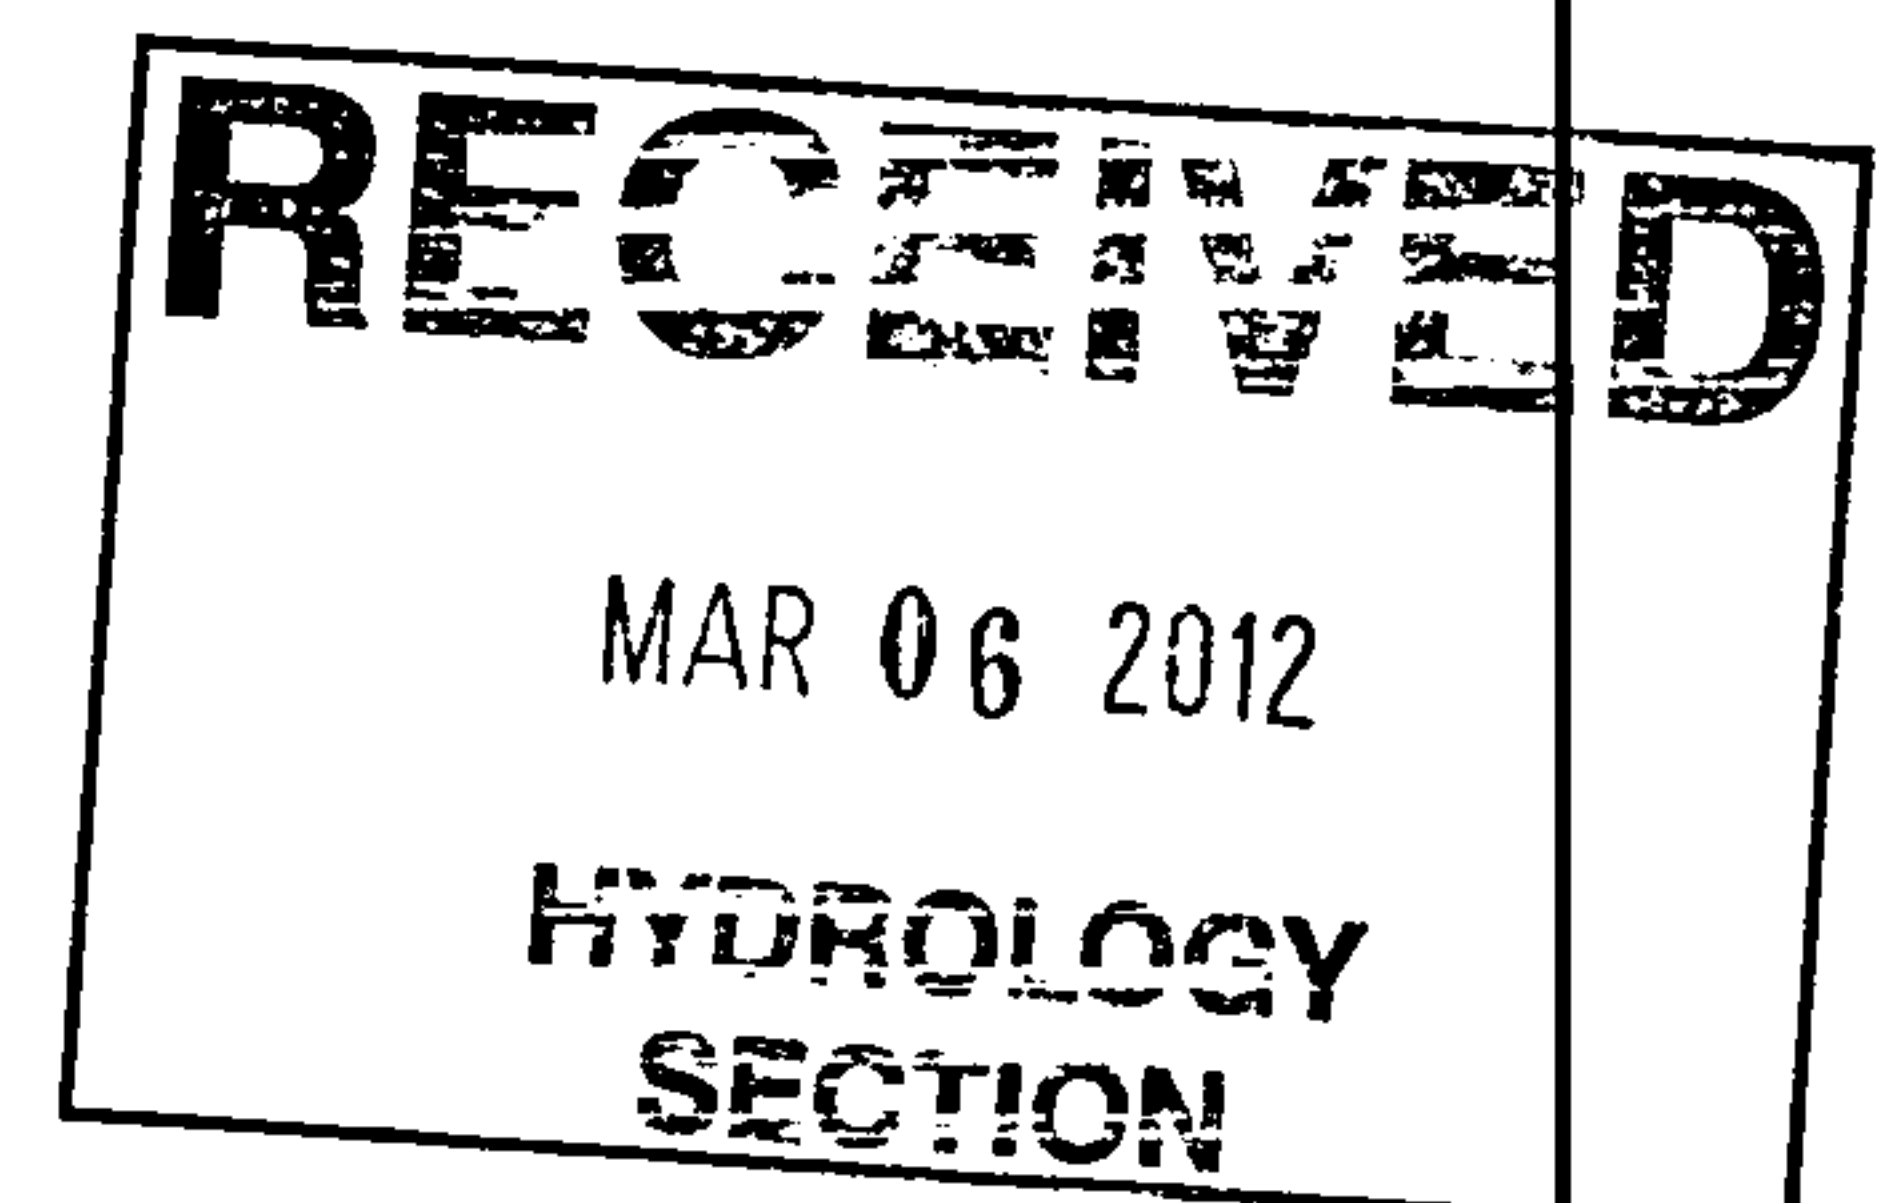

DRAINAGE AND TRANSPORTATION INFORMATION SHEET
(REV 12/2005)

PROJECT TITLE: GATE OF HEAVEN CEMETERY ZONE MAP: D19/001A
DRB#: _____ EPC#: _____ WORK ORDER#: _____

LEGAL DESCRIPTION: LOTS A, B, & C of Rancho de Palomas Manufactured Housing
CITY ADDRESS: 7999 Wyoming Blvd. NE

ENGINEERING FIRM: Soleil West Architects CONTACT: Arthur Blessen
ADDRESS: 11930 Menaul NE Suite 109 PHONE: 293-1477
CITY, STATE: Albuquerque, NM 87112 ZIP CODE: 87112

OWNER: _____ CONTACT: _____
ADDRESS: _____ PHONE: _____
CITY, STATE: _____ ZIP CODE: _____

ARCHITECT: _____ CONTACT: _____
ADDRESS: _____ PHONE: _____
CITY, STATE: _____ ZIP CODE: _____

SURVEYOR: _____ CONTACT: _____
ADDRESS: _____ PHONE: _____
CITY, STATE: _____ ZIP CODE: _____

CONTRACTOR: _____ CONTACT: _____
ADDRESS: _____ PHONE: _____
CITY, STATE: _____ ZIP CODE: _____

TYPE OF SUBMITTAL:
____ DRAINAGE REPORT
____ DRAINAGE PLAN 1st SUBMITTAL
☒ DRAINAGE PLAN RESUBMITTAL
____ CONCEPTUAL G & D PLAN
____ GRADING PLAN
____ EROSION CONTROL PLAN
____ ENGINEER'S CERT (HYDROLOGY)
____ CLOMR/LOMR
____ TRAFFIC CIRCULATION LAYOUT
____ ENGINEER'S CERT (TCL)
____ ENGINEER'S CERT (DRB SITE PLAN)
____ OTHER (SPECIFY) _____


CHECK TYPE OF APPROVAL SOUGHT:
____ SIA/FINANCIAL GUARANTEE RELEASE
____ PRELIMINARY PLAT APPROVAL
____ S. DEV. PLAN FOR SUB'D APPROVAL
____ S. DEV. FOR BLDG. PERMIT APPROVAL
____ SECTOR PLAN APPROVAL
____ FINAL PLAT APPROVAL
____ FOUNDATION PERMIT APPROVAL
☒ BUILDING PERMIT APPROVAL
____ CERTIFICATE OF OCCUPANCY (PERM)
____ CERTIFICATE OF OCCUPANCY (TEMP)
____ GRADING PERMIT APPROVAL
____ PAVING PERMIT APPROVAL
____ WORK ORDER APPROVAL
____ OTHER (SPECIFY) _____

WAS A PRE-DESIGN CONFERENCE ATTENDED:
____ YES
☒ NO
____ COPY PROVIDED

DATE SUBMITTED: 3-6-12 BY: J Arthur Blessen

Requests for approvals of Site Development Plans and/or Subdivision Plats shall be accompanied by a drainage submittal. The particular nature, location, and scope to the proposed development defines the degree of drainage detail. One or more of the following levels of submittal may be required based on the following:

1. **Conceptual Grading and Drainage Plan:** Required for approval of Site Development Plans greater than five (5) acres and Sector Plans.
2. **Drainage Plans:** Required for building permits, grading permits, paving permits and site plans less than five (5) acres.
3. **Drainage Report:** Required for subdivision containing more than ten (10) lots or constituting five (5) acres or more.

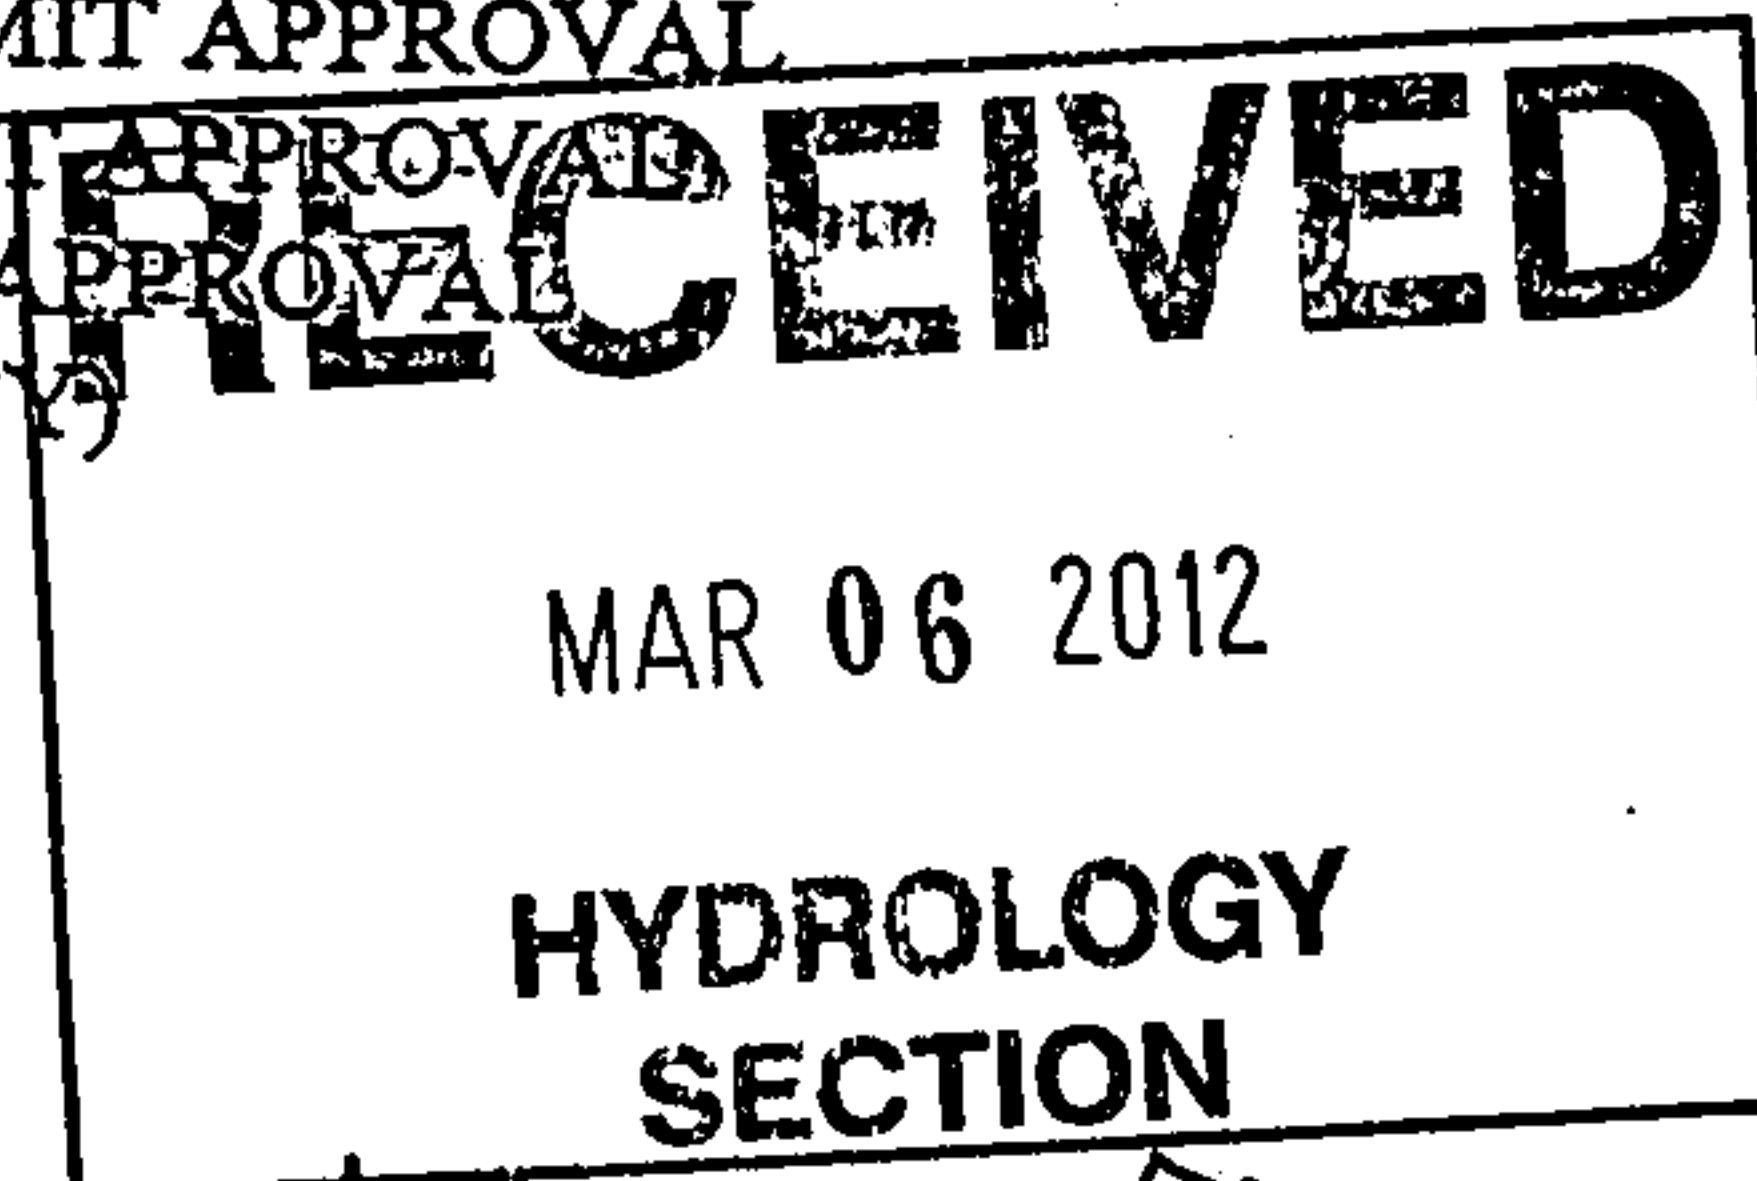



City of Albuquerque

P.O. BOX 1293 ALBUQUERQUE, NEW MEXICO 87103

December 8, 1994

C.A. Coonce
C.A. Coonce & Assoc.
12324 Pineridge, NE
Albuquerque, NM 87122

RE: GATE OF HEAVEN CEMETERY AND MAUSOLEUM (D-19/D1A)
ENGINEER'S STAMP DATED 11/21/94

Dear Mr. Coonce:

Based upon the revised Master Drainage Plan you have presented in your 11/28/94 submittal, the Site Development Plan for Building Permit is approved for the referenced project. I look forward to reviewing your future Building Permit submittal.

If I can be of further assistance, feel free to contact me at 768-3622.

Cordially,

Scott Davis
PWD, Hydrology Division

c: Andrew Garcia
File



City of Albuquerque

P.O. BOX 1293 ALBUQUERQUE, NEW MEXICO 87103

April 26, 1994

Mr. C.A. Coonce
C.A. Coonce & Assoc.
12324 Pineridge NE
Albuquerque, NM 87112

RE: SITE DEVELOPMENT PLAN & MASTERPLAN APPROVAL FOR GATE OF HEAVEN CEMETERY &
MAUSOLEUM (D-19/D1A) ENGINEER'S STAMP DATED 4/14/94

Dear Mr. Coonce:

Based upon your 4/1/94 submittal for the referenced project, Site Development Plan for Building Permit & Masterplan approval is granted at this time. Please keep in mind that prior to gaining actual Building Permit approval it will be necessary to obtain the required Drainage Easement.


If I can be of further assistance, feel free to contact me at 768-3622.

Cordially,

Scott Davis
PWD, Hydrology Division

(WP+8480)

c: ~~File~~

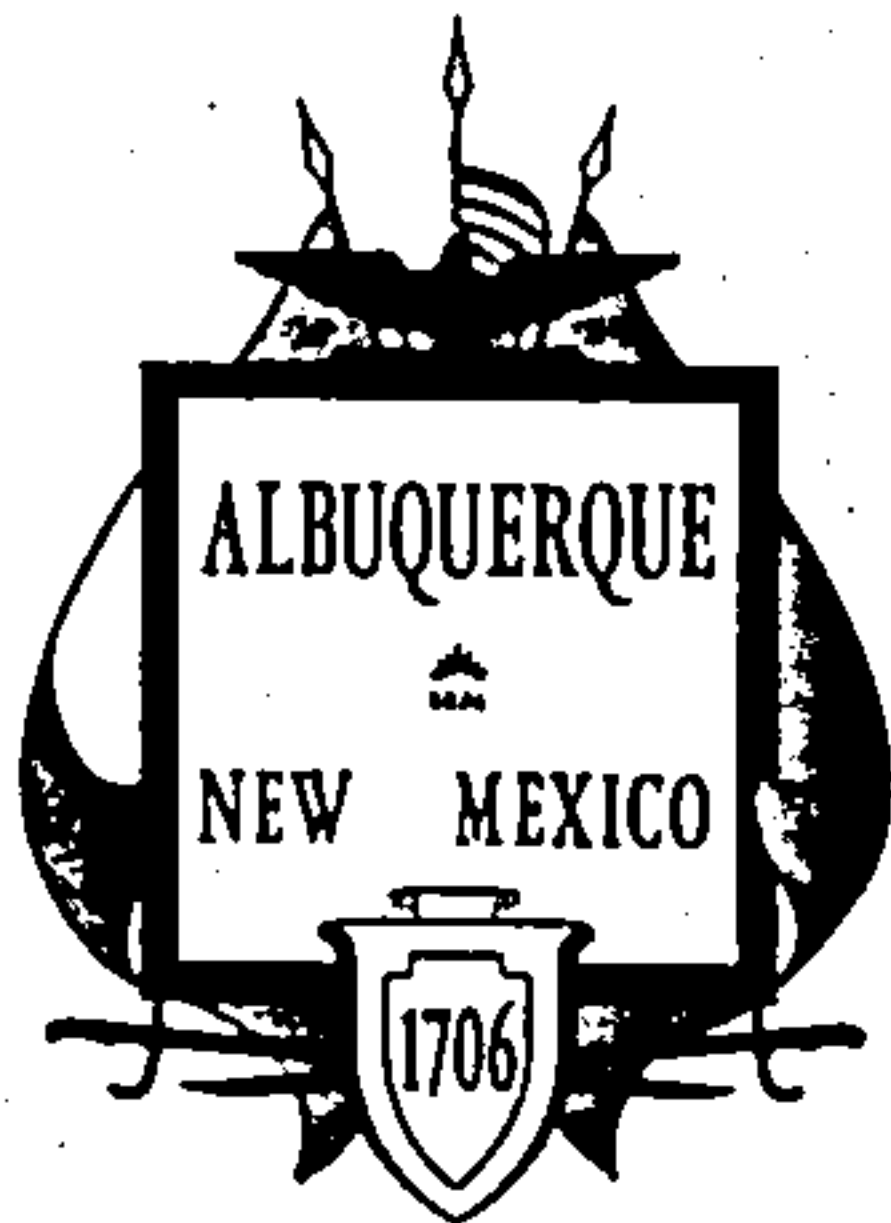

City of Albuquerque

P.O. BOX 1293 ALBUQUERQUE, NEW MEXICO 87103

January 20, 1994

C.A. Pat Coonce
C.A. Coonce & Assoc. Inc.
12324 Pineridge NE
Albuquerque, NM 87122

RE: ENGINEER CERTIFICATION FOR GATE OF HEAVEN CEMETERY OFFICE BUILDING
(D19-D1A) LETTER DATED 1/14/94.

Dear Mr. Coonce:

Based on the information provided on your January 14, 1994 letter, Engineer Certification for the above referenced site is acceptable.

Please be advised that no further construction will be allowed until a Master Drainage Plan is submitted for review and approval. The Master Plan must address as-built pond volumes along with all other drainage requirements.

If I can be of further assistance, please feel free to contact me at 768-2667.

Sincerely,

Bernie J. Montoya

Bernie J. Montoya, CE
Engineering Associate

BJM/d1/WPHYD/7466

xc: Inspector
File

PUBLIC WORKS DEPARTMENT



City of Albuquerque

P.O. BOX 1293 ALBUQUERQUE, NEW MEXICO 87103

January 25, 1993

C.A. Coonce
Coonce & Associates, Inc.
12324 Pineridge NE
Albuquerque, NM 87122

RE: DRAINAGE PLAN FOR GATE OF HEAVEN OFFICE & PAVING (D19-D1A) REVISION
DATED 1/11/93.

Dear Mr. Coonce:

Based on the information provided on your January 13, 1993 resubmittal, the above referenced site is approved for Building Permit.

As you are already aware of the past requirement for a Master Drainage Plan for the Gate of Heaven site, no further Building Permits will be granted.

Also, the existing pond must be cleaned so that no debris will plug the outlet pipe and cause problems downstream.

If I can be of further assistance, please feel free to contact me at 768-2667.

Sincerely,

Bernie J. Montoya
Bernie J. Montoya, CE

BJM/d1/WPHYD/7466

xc: Alan Martinez
Charles Lucero
David Dekker
File

PUBLIC WORKS DEPARTMENT

FILE COPY



City of Albuquerque

P.O. BOX 1293 ALBUQUERQUE, NEW MEXICO 87103

October 17, 1989

KEN SCHULTZ
MAYOR

J. David Dekker
Design Collaborative Southwest
105 Fourth Street, SW
Albuquerque, New Mexico 87102

RE: DRAINAGE PLAN FOR GARDEN CRYPT @ GATE OF HEAVEN CEMETARY
(D-19/D1A) RECEIVED OCTOBER 3, 1989

Dear Mr. Dekker:

Based on the information provided on your submittal of October 3, 1989, the above referenced plan is approved for Building Permit.

Please attach a copy of this plan to the construction sets prior to sign-off by Hydrology.

Any future development within this area will require a master drainage plan identifying the phases of construction.

If I can be of further assistance, please feel free to call me at 768-2650.

Cordially,

Bernie J. Montoya
Bernie J. Montoya, C.E.
Engineering Assistant

BJM/bsj
(WP+1343)

PUBLIC WORKS DEPARTMENT

Walter H. Nickerson, Jr., P.E.
Assistant Director Public Works

ENGINEERING GROUP

Telephone (505) 768-2500


AN EQUAL OPPORTUNITY EMPLOYER

GATE OF HEAVEN CEMETERY AND MAUSOLEUM

MASTER DRAINAGE AND GRADING PLAN

REPORT

APRIL, 1994

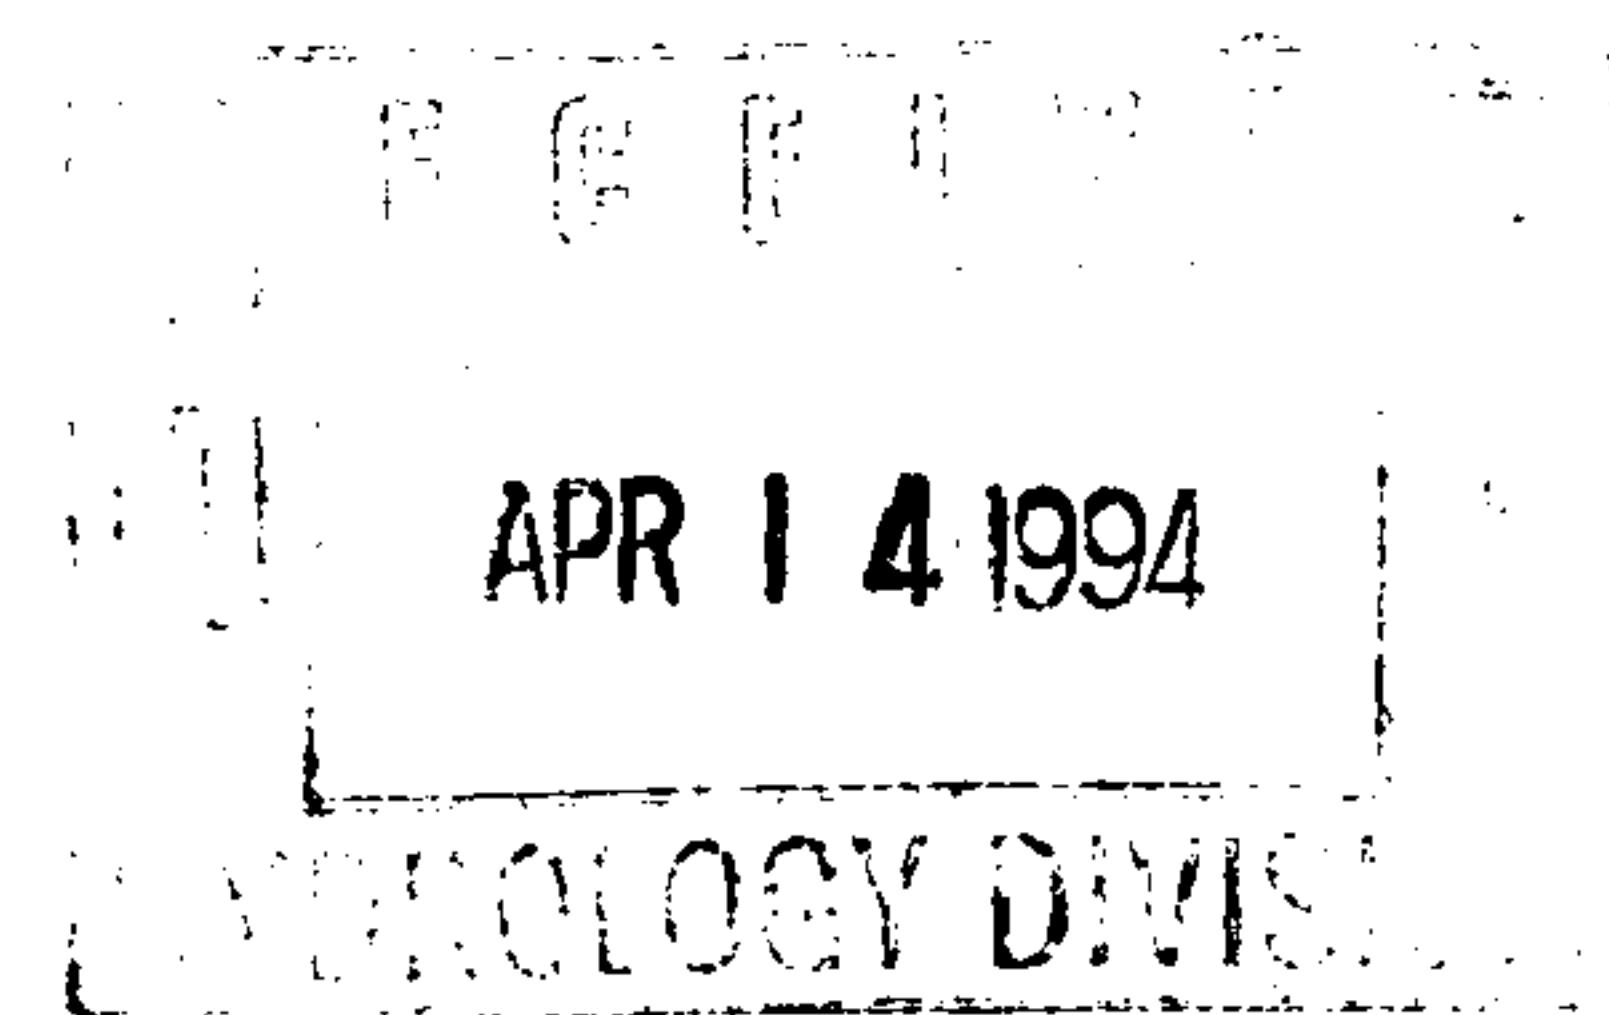

**PREPARED BY: C. A. COONCE & ASSOC.
PREPARED FOR: GATE OF HEAVEN CEMETERY
AND MAUSOLEUM**

GATE OF HEAVEN CEMETERY AND MAUSOLEUM MASTER DRAINAGE AND GRADING PLAN

INTRODUCTION:

Design Collaborative Southwest has prepared a master plan for the Gate of Heaven Cemetery and Mausoleum. This 20.06-acre tract is located on the S.W. corner of Paseo del Norte and Wyoming streets, N.E. The facility is bounded on the west and south by the Santa Barbara Subdivision.

The master plan incorporates a new entrance from Wyoming Blvd., N.E. This is required because the City of Albuquerque will not allow entrance from Paseo del Norte when it is upgraded to a limited access roadway. The master plan will be constructed in several phases over a number of years. The exact time frame will depend upon the economic conditions, and the demand for the facility. Temporary paving is proposed to the existing Wyoming Blvd. temporary paving, since Wyoming will also be upgraded as a divided boulevard during the Paseo del Norte construction. The new entrance to the Gate of Heaven Cemetery and Mausoleum is essentially in line with the Palomas Ave. entrance onto Wyoming Blvd., N.E. When fully developed in accordance with the architectural master plan, the facility will be 27% impervious and 73% lawn and garden area.

EXISTING RUNOFF:

The runoff from this site occurs primarily from three basins. One is sheet flow from the northern portion, which is all pervious, being either grass, natural grass or bare soil. This runoff goes to Rancho de Palomas, N.E. and via Quail Hollow Lane and Turtle Dove Lane to the lined channel east of the Federal Aviation Authority facility. The runoff from the central basin, which currently takes most of the runoff from the existing developed area, is via a retention pond and a 24" CMP to Bob White Lane, and thence to the lined channel east of the FAA facility. The south basin drains primarily along the south side and at the southwest corner. When the Santa Barbara Subdivision was first approved, Chickadee Lane bordered the south of the Gate of Heaven Cemetery. This provided an outlet for future development of the cemetery. The subdivision was re-platted, and Chickadee Lane was vacated from Rancho de Palomas eastward, thus creating a drainage outlet problem.

PROPOSED DRAINAGE:

The master plan was divided into three drainage basins, which conform with the existing flow patterns. The land treatment areas were measured for each basin, and the AHYMO computer program was run to obtain a hydrograph for each basin. In the master plan only two land treatments are planned: either D as impervious area, or B as lawn and garden areas. Copies of all hydrographs are included.

Basin I encompasses 5.02 acres along the northern (Paseo del Norte) section. It will be all garden level burial sites with grass. The treatment is 100% B. Currently this area is treatments A, B, C, and D. The runoff from this basin goes in the same pattern as it currently does, and that is primarily to Ranch de Palomas, thence via Quail Hollow Land and Turtle Dove Lane to the paved drainage ditch at the west side of the Santa Barbara Subdivision. The 100 year peak Q is 9.91 CFS at 1.567 hours.

Basin II, which drains to Bob White Lane, is routed through a retention pond to reduce the peak 100 year flow to Bob White Lane to 14.5 CFS. Copies of the reservoir routing solution are included. The low slope (0.5%) and distance from the Basin II retention pond to Bob White Lane outfall causes the flow to be outlet controlled. A 21" diameter pipe is required to give 14.5 CFS peak flow at the maximum retention pond headwater. An enlarged detail design is provided for this detention and outfall area.

Basin III, which is largely undeveloped at the present time and drains to the south boundary and at the southwest corner, is routed to a retention pond in the low (S.W.) corner. From there it is designed to flow at a maximum rate of 10.8 CFS at the north edge of the swimming pool parking area to Rancho de Palomas Street, and thence to the Rancho de Palomas outfall into the Domingo Baca lined channel. Rancho de Palomas is a forty foot wide street, with a standard 8" curb. It was built in accordance with the approved 1982 design by Huston and Bohannon. This section of Rancho de Palomas, from 100' north of Chickadee Lane to the Domingo Baca outfall presently drains 1.65 acres. The existing peak 100 year Q is estimated at 6.69 CFS. This existing peak Q would be over before the peak Q from the cemetery could arrive.

Copies of the design for the Rancho de Palomas to Domingo Baca Arroyo outfall were obtained from Brasher Engineering Co. The fully developed flow to this outfall is computed as 31.3 CFS by Brasher Engineering Co. The Brasher Engineering Co. calculated 31.5 CFS flow included 5 CFS from this site, which, when this plan is implemented, will reduce to 26.3 CFS. The total depth of flow, adding 10.8 CFS from the Gate of Heaven Cemetery to the 31.3 CFS existing, is 0.9 ft. The channel depth is two feet.

The outfall from Basin III to Rancho de Palomas, due to its short length, will act as an orifice. The required size for 10.8 CFS with the calculated retention pond headwater is 18" diameter. Copies of the reservoir routing and orifice solutions are attached.

In order to implement this drainage plan, a drainage easement will be obtained from the Santa Barbara Home Owners Association. It will also be necessary to obtain an as-built X, Y, and Z survey of the Rancho de Palomas Street to the Domingo Baca outfall, in order to make a final detail design of the outfall from Basin III to Rancho de Palomas.

18" ORIFICE OUTLET

ORIFICES

Enter up to 10 orifices.

Enter <Return> only for flowrate and area to end.

FLOWRATE (CFS)	AREA (SF)	COEFF (-)	E L E V A T I O N S		
			HEADWATER (FT)	CENTER (FT)	TAILWATER (FT)
14.37	1.77	0.610	67.50	64.00	64.74
15.62	1.77	0.610	68.00	64.00	64.74
4.41	1.77	0.610	65.00	64.00	64.74
7.54	1.77	0.610	65.50	64.00	64.74
9.71	1.77	0.610	66.00	64.00	64.74
13.03	1.77	0.610	67.00	64.00	64.74

EXISTING 24" OUTFALL @ 16' LENGTH TO 6' MANHOLE W/3" TAILWATER CULVERTS

		RESULTS	
DIAMETER (IN)	? 24	HEADWATER (FT)	FLOWRATE (CFS)
LENGTH (FT)	? 16	=====	
		64.64	OC 13.86
FRICTION COEFF (FT ^{1/6})	? .015	64.74	IC 16.13
ENT+EXIT COEFF	? 0	64.84	IC 16.85
INLET CONTROL COEFF	? .61	64.94	IC 17.53
		65.04	IC 18.20
INV ELEV OUT (FT)	? 62.56	65.14	IC 18.94
INV ELEV IN (FT)	? 62.64	65.24	IC 19.45
TAILWATER ELEV (FT)	? 62.81	65.34	IC 20.05
ELEV INCREMENT (FT)	? .1	65.44	IC 20.63
		65.54	IC 21.20
		65.64	IC 21.75
		65.74	IC 22.29
		65.84	IC 22.81
		65.94	IC 23.32
		66.04	IC 23.82
		66.14	IC 24.32

<Shift> <Prt Sc> print

<Return> repeat

<Space Bar> back to menu

PONDS CONNECTED W/ 30" RCP; $n = 0.013$ CULVERTS

DIAMETER (IN)	LENGTH (FT)		RESULTS	
			HEADWATER (FT)	FLOWRATE (CFS)
	? 30		66.50	IC 0.00
	? 444		66.60	OC 6.16
FRICTION COEFF (FT ^{1/6})	? .013		66.70	OC 8.71
ENT+EXIT COEFF	? 0		66.80	OC 10.65
INLET CONTROL COEFF	? .61		66.90	OC 12.31
INV ELEV OUT (FT)	? 64		67.00	OC 13.76
INV ELEV IN (FT)	? 64		67.10	OC 15.08
TAILWATER ELEV (FT)	? 66.5		67.20	OC 16.29
ELEV INCREMENT (FT)	? .1		67.30	OC 17.41
			67.40	OC 18.47
			67.50	OC 19.47
			67.60	OC 20.42
			67.70	OC 21.32
			67.80	OC 22.19
			67.90	OC 23.03
			68.00	OC 23.84

<Shift> <Prt Sc> print <Return> repeat <Space Bar> back to menu

PONDS CONNECTED W/ 30" CMP; $n = 0.015$ CULVERTS

DIAMETER (IN)	LENGTH (FT)		RESULTS	
			HEADWATER (FT)	FLOWRATE (CFS)
	? 30		66.50	IC 0.00
	? 444		66.60	OC 5.33
FRICTION COEFF (FT ^{1/6})	? .015		66.70	OC 7.54
ENT+EXIT COEFF	? 0		66.80	OC 9.24
INLET CONTROL COEFF	? .61		66.90	OC 10.67
INV ELEV OUT (FT)	? 64		67.00	OC 11.93
INV ELEV IN (FT)	? 64		67.10	OC 13.07
TAILWATER ELEV (FT)	? 66.5		67.20	OC 14.11
ELEV INCREMENT (FT)	? .1		67.30	OC 15.09
			67.40	OC 16.00
			67.50	OC 16.87
			67.60	OC 17.69
			67.70	OC 18.48
			67.80	OC 19.24
			67.90	OC 19.96
			68.00	OC 20.66

<Shift> <Prt Sc> print <Return> repeat <Space Bar> back to menu

INFLOW HYDROGRAPH		CAPACITY/OUTFLOW RATING		
TIME-min	FLOW-cfs	STAGE-ft	VOLUME-cf	OUTFLOW-cfs
0	2	64	0	0
8	15.8	65	57.16	4.41
12	46.3	66	12330	9.71
14	46.4	67	22697	14.37
16	51.4	68	38373	15.62
18	50			
20	44.6			
22	38.2			
34	16.5			
74	1.7			

TIME INCREMENT (min) = 2

TIME (MIN)	INFLOW (CFS)	STAGE (FT)	VOLUME (CF)	OUTFLOW (CFS)
36.0		68.0	37,658	15.6

<<< MAXIMUM VALUES

<Shift> <Prt Sc> print <P> hydrograph <Ret> repeat <Space> back to menu

TIME (MIN)	INFLOW (CFS)	STAGE (FT)	VOLUME (CF)	OUTFLOW (CFS)
0.0	2.0	64.0	0	0.0
2.0	5.4	65.0	179	4.5
4.0	8.9	65.0	496	4.6
6.0	12.4	65.1	1,201	4.9
8.0	15.8	65.2	2,274	5.4
10.0	31.0	65.4	4,386	6.3
12.0	46.3	65.7	8,175	7.9
14.0	46.4	66.0	12,671	9.9
16.0	51.4	66.5	17,232	11.9
18.0	50.0	66.9	21,764	14.0
20.0	44.6	67.2	25,727	14.6
22.0	38.2	67.4	28,926	14.9
24.0	34.6	67.6	31,497	15.1
26.0	31.0	67.7	33,611	15.2
28.0	27.3	67.8	35,273	15.4
30.0	23.7	67.9	36,487	15.5
32.0	20.1	67.9	37,258	15.5
34.0	16.5	68.0	37,590	15.6
36.0	15.8	68.0	37,658	15.6
38.0	15.0	68.0	37,638	15.6
40.0	14.3	67.9	37,529	15.6
42.0	13.5	67.9	37,333	15.5
44.0	12.8	67.9	37,050	15.5
46.0	12.1	67.9	36,682	15.5
48.0	11.3	67.9	36,228	15.4
50.0	10.6	67.8	35,691	15.4
52.0	9.8	67.8	35,071	15.4
54.0	9.1	67.7	34,368	15.3
56.0	8.4	67.7	33,583	15.2
58.0	7.6	67.6	32,717	15.2
60.0	6.9	67.6	31,771	15.1
62.0	6.1	67.5	30,746	15.0
64.0	5.4	67.4	29,643	14.9
66.0	4.7	67.4	28,461	14.8
68.0	3.9	67.3	27,202	14.7
70.0	3.2	67.2	25,867	14.6
72.0	2.4	67.1	24,456	14.5
74.0	1.7	67.0	22,971	14.4
76.0	1.7	66.9	21,482	13.8
78.0	1.7	66.7	20,065	13.2
80.0	1.7	66.6	18,723	12.6
82.0	1.7	66.5	17,451	12.0
84.0	1.7	66.4	16,246	11.5
86.0	1.7	66.3	15,104	11.0
88.0	1.7	66.2	14,023	10.5
90.0	1.7	66.1	12,998	10.0
92.0	1.7	66.0	12,027	9.6
94.0	1.7	65.9	11,105	9.2
96.0	1.7	65.8	10,230	8.8
98.0	1.7	65.8	9,399	8.4
100.0	1.7	65.7	8,610	8.1



City of Albuquerque

P.O. BOX 1293 ALBUQUERQUE, NEW MEXICO 87103

June 27, 2002

Shahab Biazar PE
Advanced Engineering and Consulting
10205 Snowflake Ct NW
Albuquerque, NM 87114

**Re: Gate of Heaven Cemetery and Mausoleum Grading and Drainage Plan
Engineer's Stamp dated 6-4-02 (D19/D1A)**

Dear Mr. Biazar,

Based upon the information provided in your submittal dated 6-4-02, the above referenced plan is approved for Grading Permit and SO#19 Permit.

Please provide a mylar copy for my signature in order to obtain the Grading Permit. A separate permit is required for construction within City R/W. A copy of this approval letter must be on hand when applying for the excavation permit.

If you have any questions, you can contact me at 924-3986.

Sincerely,

Bradley L. Bingham

Bradley L. Bingham, PE
Sr. Engineer, PWD
Development and Building Services


C: file

DRAINAGE REPORT
FOR

Gate of Heaven Cemetery and Mausoleum

8001 WYOMING BLVD., ALBUQUERQUE, NM


Prepared by:

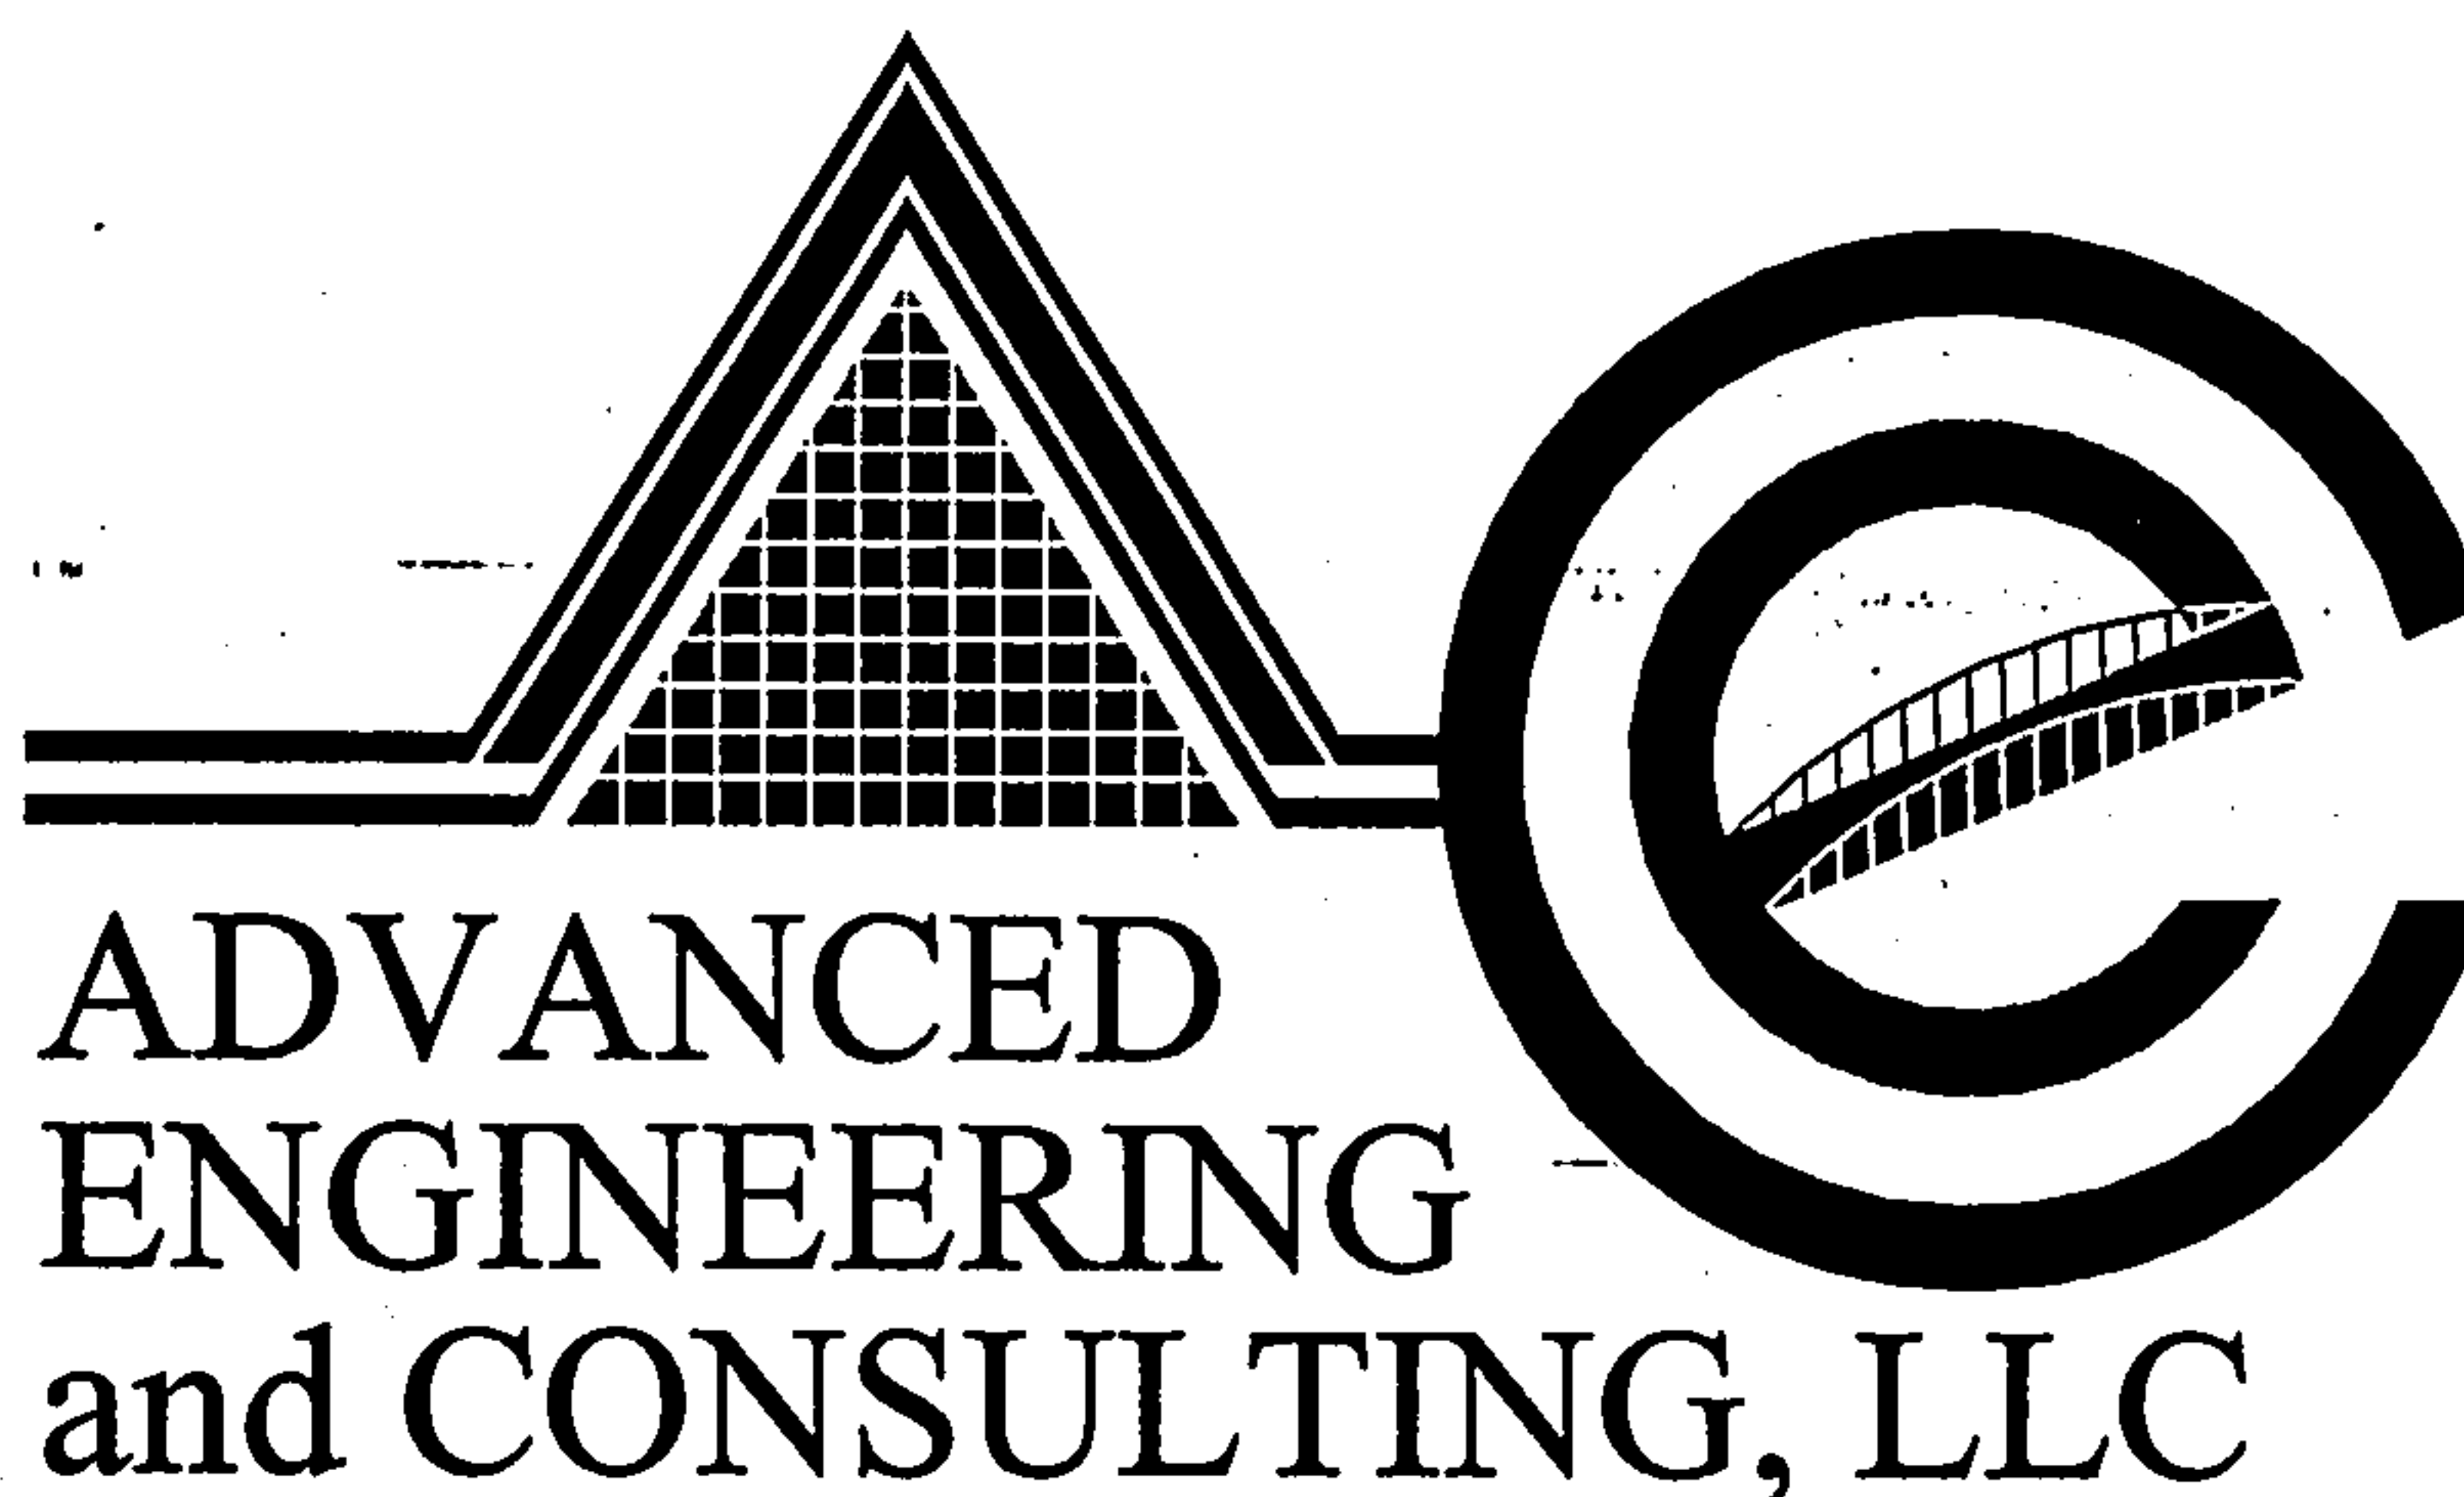


10205 Snowflake Ct. NW
Albuquerque, New Mexico 87114

Prepared For:

Mt. Calvary Cemetery
1900 Edith Blvd. NE, 2B
Albuquerque, NM 87102

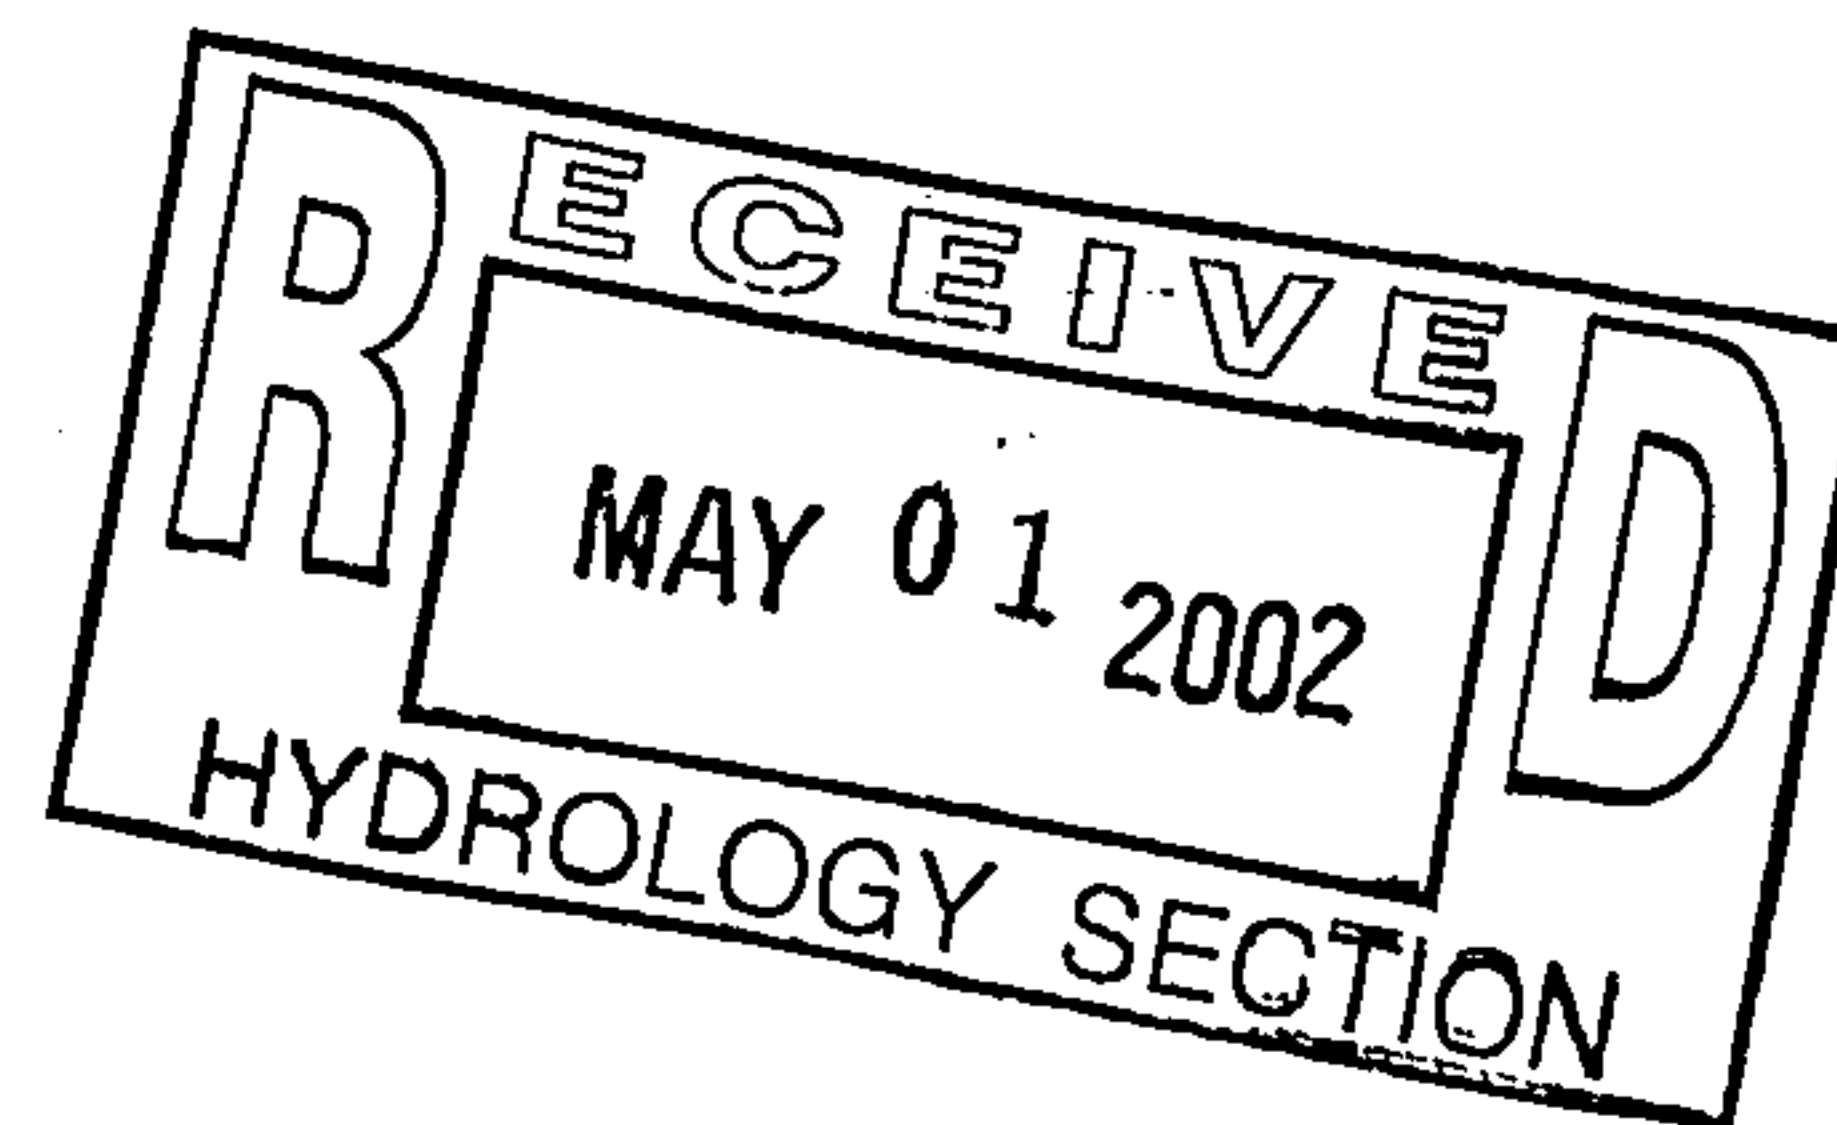

May, 2002

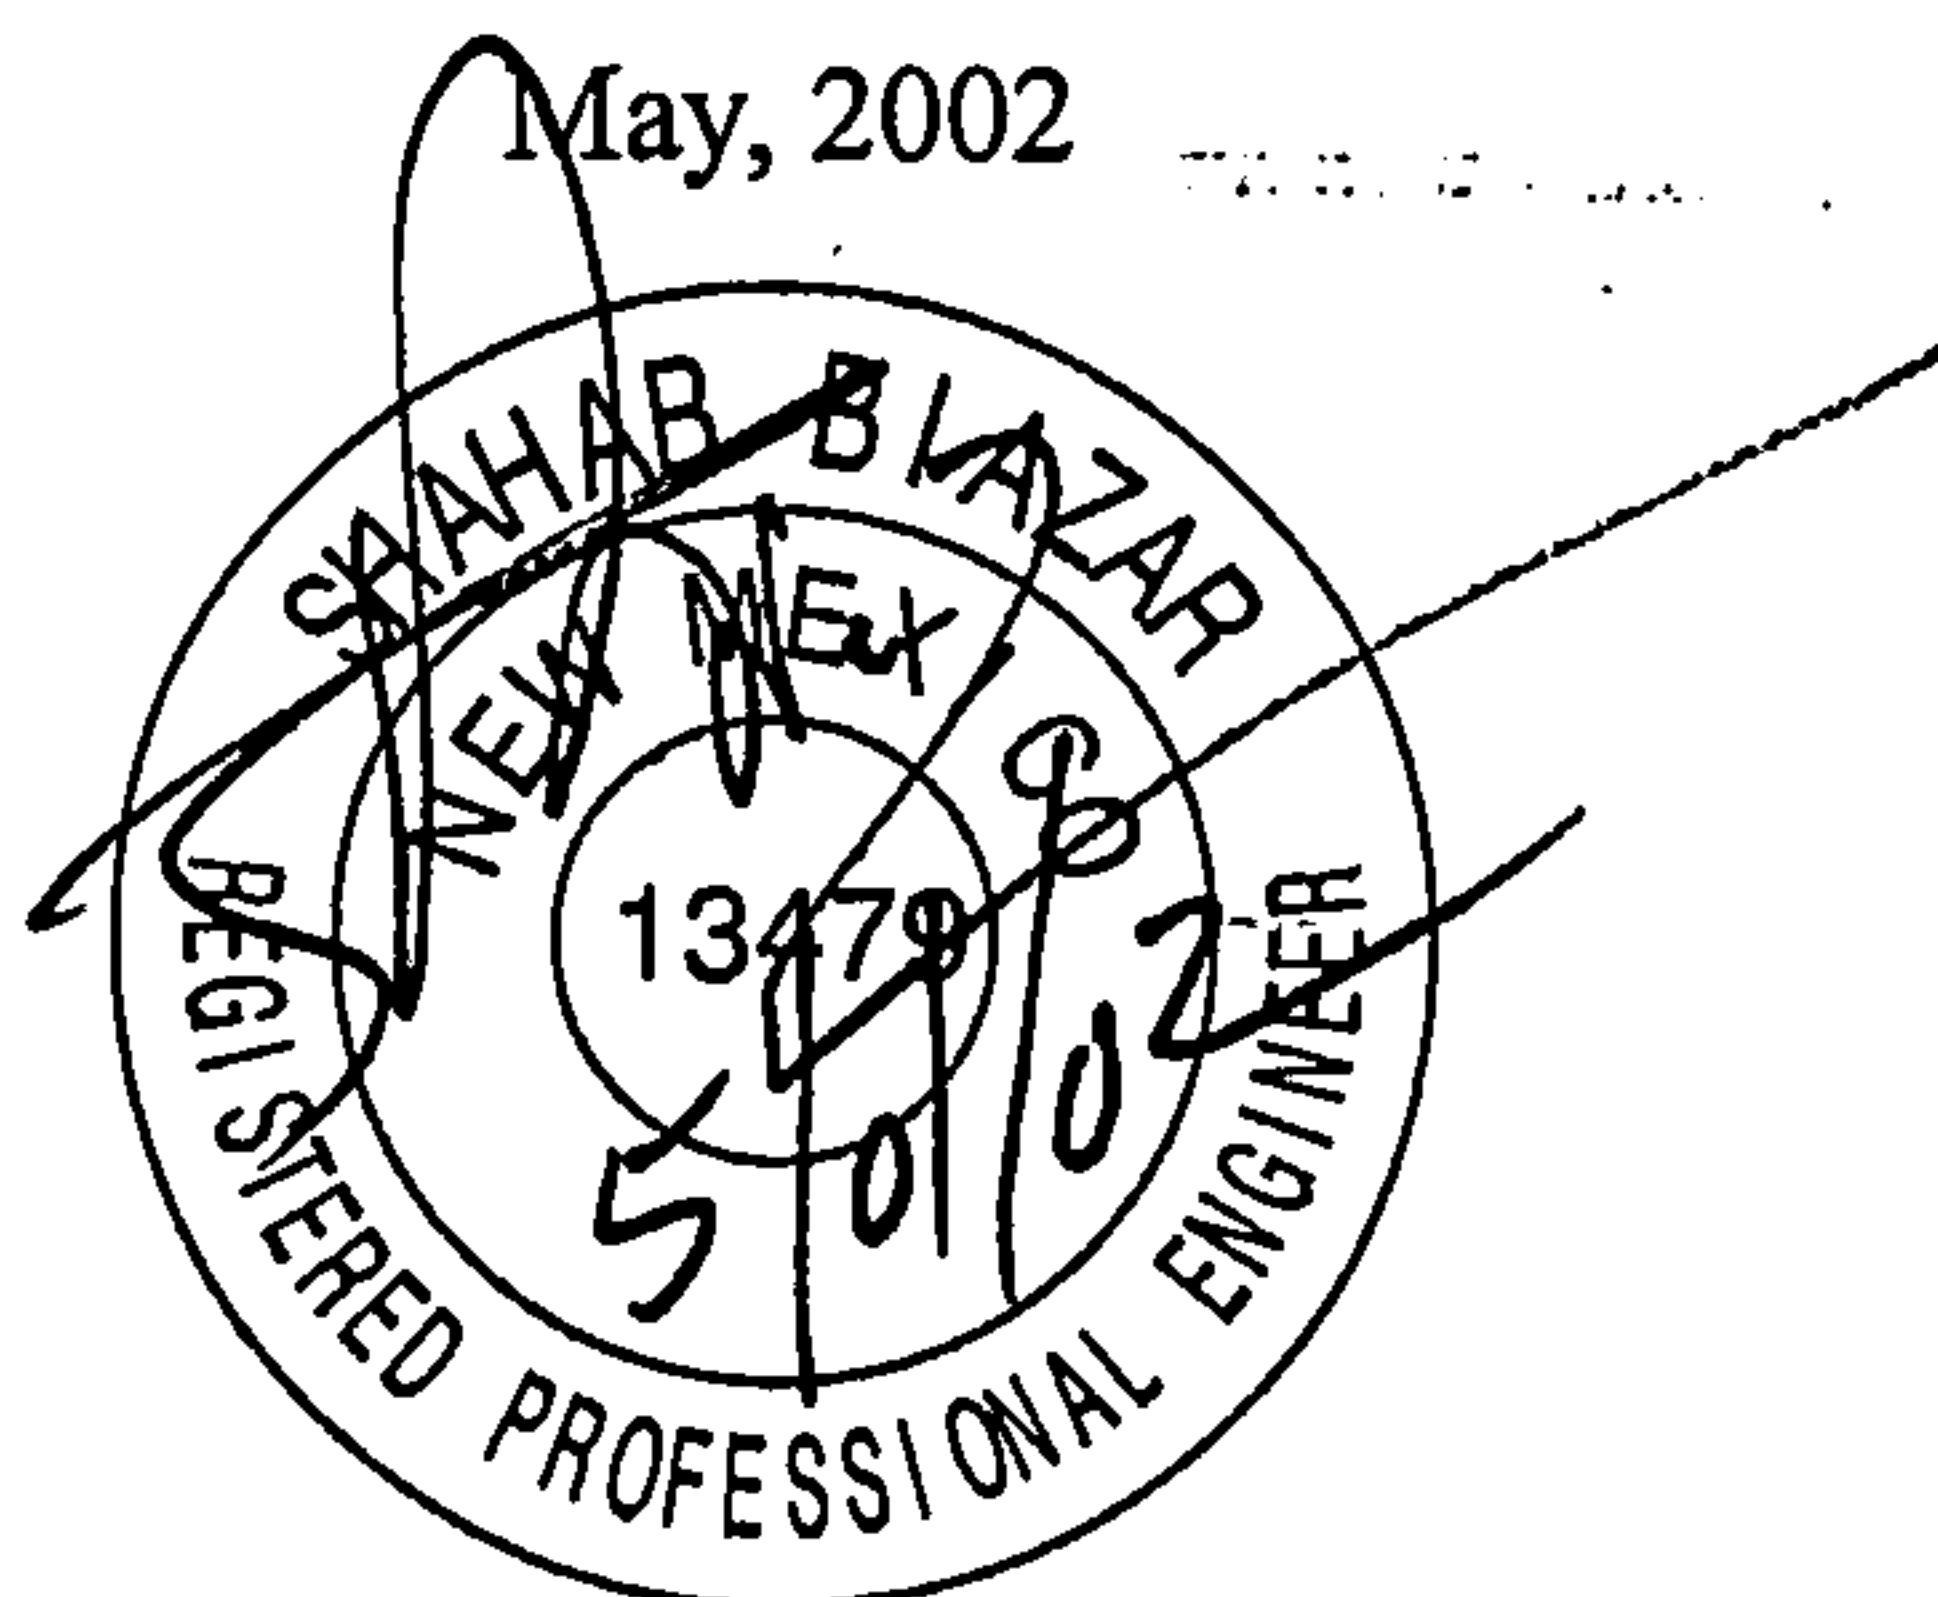

Shahab Biazar
PE NO. 13479

Location

Gate of Heaven Cemetery is located at 8001 Wyoming Boulevard. See attached Zone Atlas page number D-19-Z for exact location.

Purpose

The purpose of this drainage report is to update the overall grading and drainage plan for the above referenced site and to build the required ponds as shown on the new plans. The originally approved grading plan is fairly old, and it has an engineering stamp date of 11/21/94. We have enclosed a copy of this grading and drainage plan.

Existing Drainage Conditions

The site drains ~~east~~ to west. There are no offsite runoff which enter the site. The drainage plan for the new plan will have the same drainage pattern as the original grading plan with some modification to the basins and discharge rates. The site drains to an existing detention pond and an existing retention pond located on the west end of the project. The site does not fall within a 100 year floodplain. See attached floodplain map for location of the site.

Proposed Conditions and On-Site Drainage Management Plan

The runoff on site will continue to drain West. The site is analyzed under three basins A, B and C. Basin A drains west at a flow rate of 12.38 cfs. And discharges to Rancho De Palomas at a control discharge rate of 9.90 cfs (based on the originally approved grading plan). Basin B and C drain west to two detention ponds located on the west end of the property, and then will discharge via two 12" pipes at a total control discharge rate of 13.66 cfs which is less than 15.60 cfs (based on the originally approved grading plan). There is an existing 24" CMP pipe which extends to site from Bob White Lane. From the existing 24" pipe we will extend two 12" CMP pipes to detention ponds B and C in order to discharge the runoff from the ponds.

Calculations

City of Albuquerque, Development Process Manual, Section 22.2, Hydrology Section, revised January, 1993, was used for runoff calculations. See this report for the Summary Table on the runoff results, the AHYMO input, AHYMO summary output files for the runoff.

RUNOFF DRAINAGE DATA

The site is @ Zone 3

DEPTH (INCHES) @ 100-YEAR STORM

$$P_{60} = 2.14 \text{ inches}$$

$$P_{360} = 2.60 \text{ inches}$$

$$P_{1440} = 3.10 \text{ inches}$$

DEPTH (INCHES) @ 10-YEAR STORM

$$P_{60} = 2.14 \times 0.667 \\ = 1.43 \text{ inches}$$

$$P_{360} = 1.73$$

$$P_{1440} = 2.07$$

See the summary output from AHYMO calculations.

Also see the following summary tables.

RUNOFF CALCULATION RESULTS

BASIN	AREA (SF)	AREA (AC)	AREA (MI ²)
BASIN A	198257.90	4.5514	0.007112
BASIN B	420272.49	9.6481	0.015075
BASIN C	247452.28	5.6807	0.008876

HISTORICAL

BASIN	Q-100 CFS	Q-10 CFS
BASIN A	8.53	2.55
BASIN B	18.06	5.41
BASIN C	10.64	3.19

PROPOSED

BASIN	Q-100 CFS	Q-10 CFS
BASIN A	12.38	5.77
BASIN B	26.04	12.21
BASIN C	15.34	7.19

SUMMARY OUTPUT FILE

AHYMO PROGRAM SUMMARY TABLE (AHYMO_97) -
INPUT FILE = 200210

- VERSION: 1997.02d

RUN DATE (MON/DAY/YR) =04/30/2002
USER NO.= AHYMO-I-9702c01000R31-AH

[illegible]

VOLUME CALCULATIONS

DETENTION POND - B

Ab - Bottom Of The Pond Surface Area

At - Top Of The Pond Surface Area

D - Water Depth

Dt - Total Pond Depth

C - Change In Surface Area / Water Depth

$$\text{Volume} = \text{Ab} * \text{D} + 0.5 * \text{C} * \text{D}^2$$

$$\text{C} = (\text{At} - \text{Ab}) / \text{Dt}$$

$$\text{Ab} = 4,822.65$$

$$\text{At} = 15,545.60$$

$$\text{Dt} = 4.00$$

$$\text{C} = 2680.74$$

ACTUAL ELEV.	DEPTH (FT)	VOLUME (AC-FT)	Q (CFS)
5364.00	0.00	0.00000	0.00
5365.00	1.00	0.11071	2.67
5365.50	1.50	0.17376	3.78
5366.00	2.00	0.25220	4.63
5366.50	2.50	0.34602	5.35
5367.00	3.00	0.45522	5.98
5367.50	3.50	0.57981	6.55
5368.00	4.00	0.71979	7.07

Orifice Equation

$$Q = \text{CA} \text{ SQRT}(2gH)$$

$$\text{C} = 0.6$$

$$\text{Diameter (in)} = 12$$

$$\text{Area (ft}^2\text{)} = 0.7854$$

$$g = 32.2$$

$$H \text{ (Ft)} = \text{Depth of water above center of orifice}$$

$$Q \text{ (CFS)} = \text{Flow}$$

VOLUME CALCULATIONS

DETENTION POND - C

ACTUAL ELEV.	DEPTH (FT)	VOLUME (AC-FT)	Q (CFS)
5364.00	0.00	0.00000	0.00
5365.00	1.00	0.03556	2.67
5365.50	1.50	0.05879	3.78
5366.00	2.00	0.08755	4.63
5366.50	2.50	0.12471	5.35
5367.00	3.00	0.17314	5.98
5367.50	3.50	0.23521	6.55
5368.00	4.00	0.31330	7.07

Orifice Equation

$$Q = CA \text{ SQRT}(2gH)$$

$$C = 0.6$$

$$\text{Diameter (in)} = 12$$

$$\text{Area (ft}^2\text{)} = 0.7854$$

$$g = 32.2$$

$$H \text{ (Ft)} = \text{Depth of water above center of orifice}$$

$$Q \text{ (CFS)} = \text{Flow}$$

POND CALCULATIONS

POND #B			
ELEVATION FT	SURFACE AREA SF	VOLUME CF	VOLUME AC-FT
5,368.00	15,545.60		
4.00		40,736.50	0.93518
5,364.00	4,822.65		

TOTAL VOLUME = 40,736.50 CF

POND #C			
ELEVATION FT	SURFACE AREA SF	VOLUME CF	VOLUME AC-FT
5,368.00	7,500.49		
0.50		3,401.46	0.07809
5,367.50	6,105.33		
0.50		2,703.88	0.06207
5,367.00	4,710.17		
0.50		2,109.61	0.04843
5,366.50	3,728.28		
0.50		1,618.66	0.03716
5,366.00	2,746.38		
0.50		1,252.79	0.02876
5,365.50	2,264.77		
0.50		1,011.98	0.02323
5,365.00	1,783.16		
0.50		833.05	0.01912
5,364.50	1,549.04		
0.50		715.99	0.01644
5,364.00	1,314.91		

TOTAL VOLUME = 13,647.41 CF

SUMMARY OUTPUT FILE (DETENTION PONDS)

AHYMO PROGRAM SUMMARY TABLE (AHYMO_97) -
INPUT FILE = 200210PD

- VERSION: 1997.02d

RUN DATE (MON/DAY/YR) =04/30/2002
USER NO.= AHYMO-I-9702C01000R31-AH

[illegible]

SPILLWAY CALCULATIONS

SPILLWAY WIDTH

Weir Equation: $Q = CLH^{3/2}$

$Q = 9.90$ cfs (maximum allowable runoff)


$C = 3.10$

$h = 0.50'$

Opening = $9.00'$

$Q = 3.1(9.00)(0.50)^{3/2}$

$Q = 9.86$ cfs > 9.90 cfs

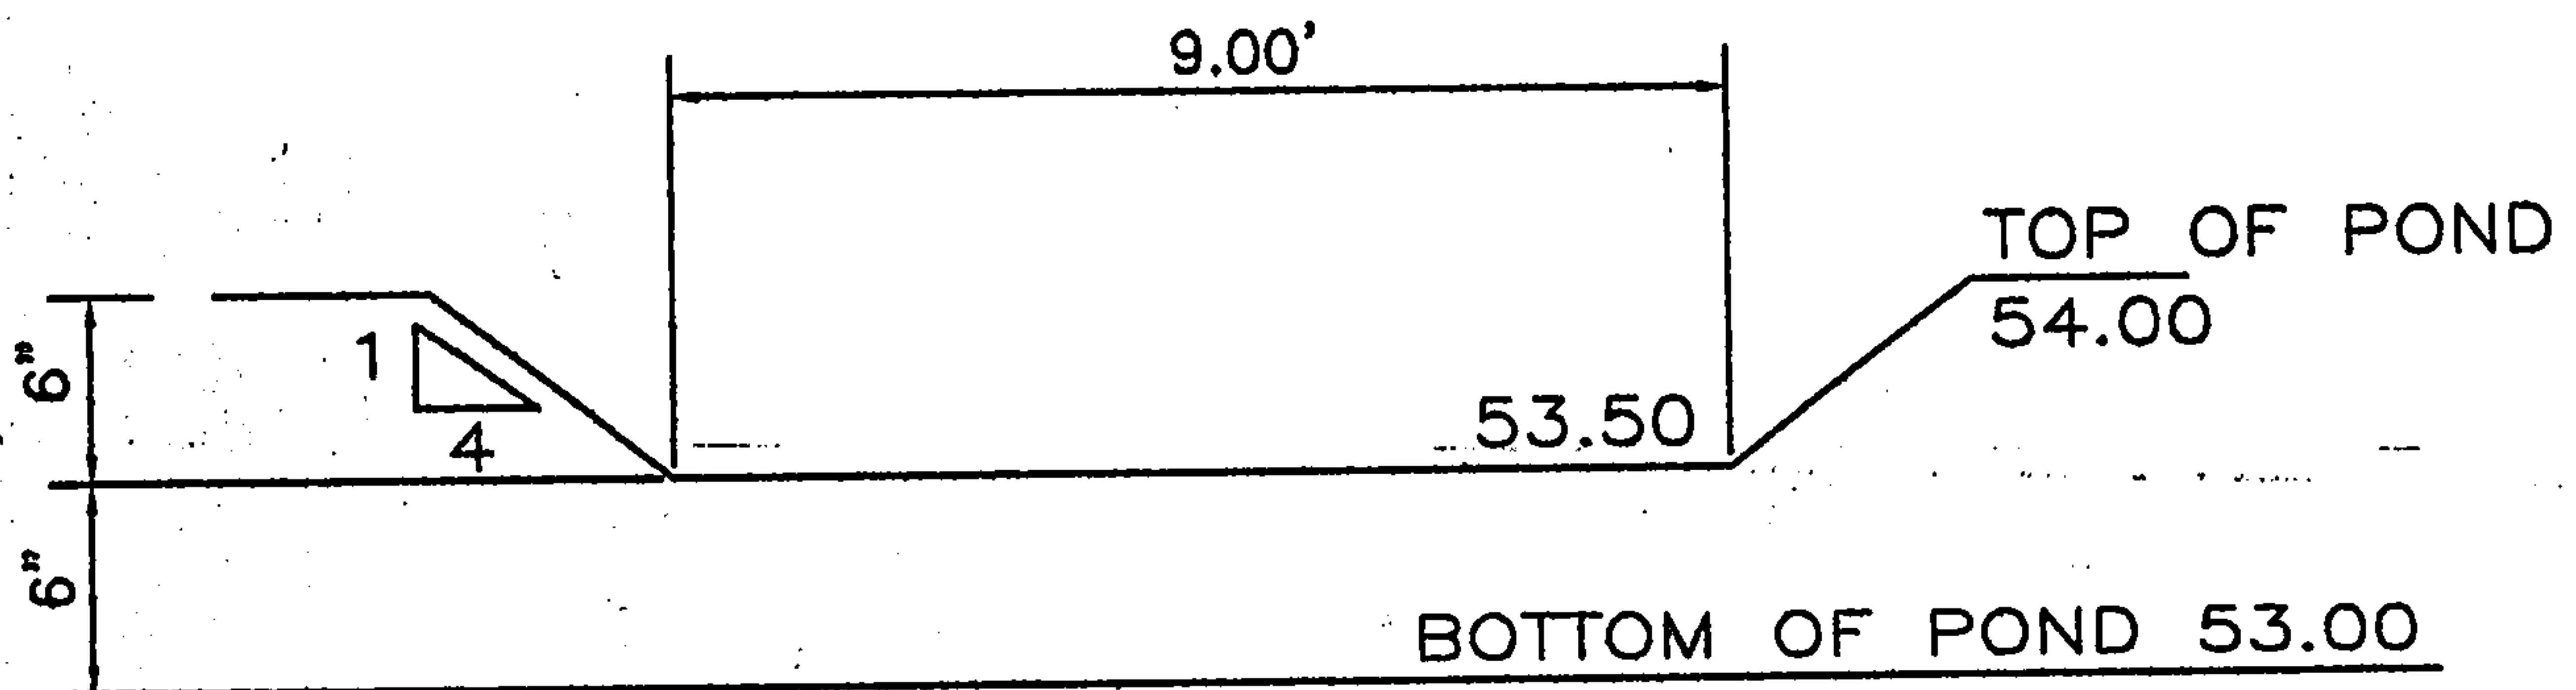


SPILLWAY DETAIL

NTS

POND A

CITY OF ALBUQUERQUE

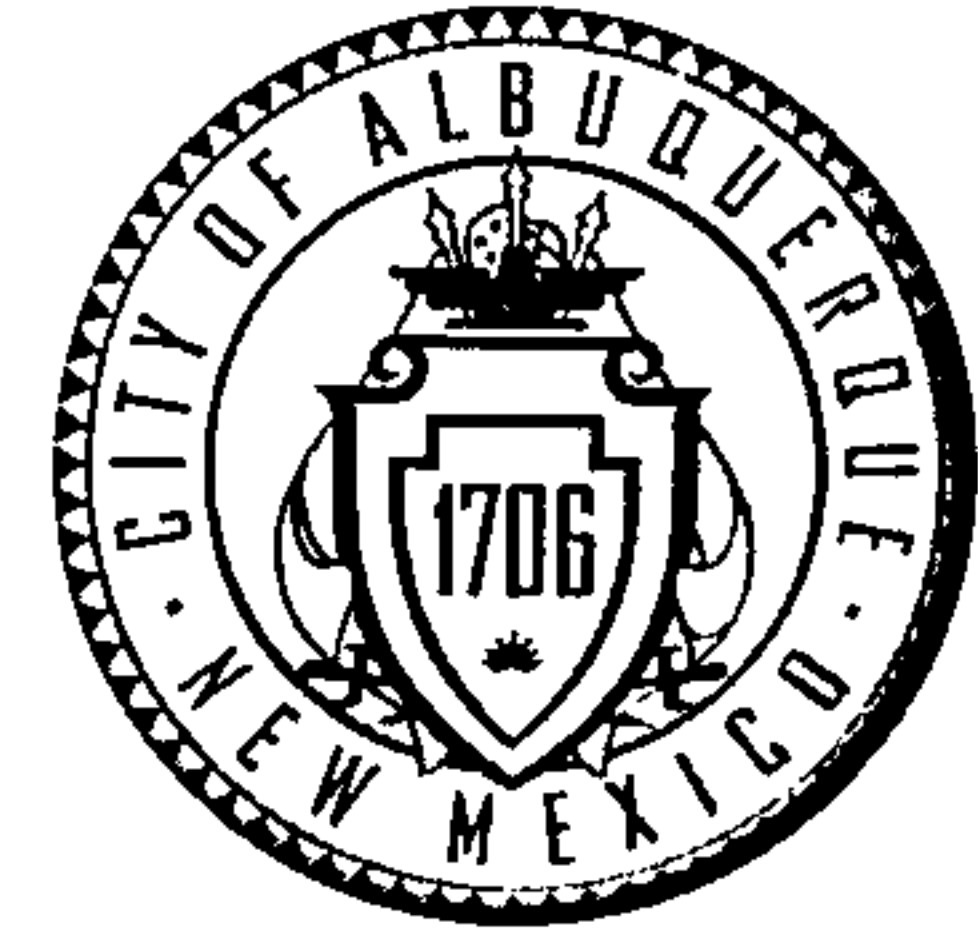

March 26, 2012

J. Arthur Blessen, P.E.
J. Arthur Blessen Engineering
11930 Menaul Blvd NE, Suite 109
Albuquerque, NM 87112

**Re: Gate of Heaven Cemetery
Site Grading Plan
Engineer's Stamp dated 3-26-12 (D19/D001A)**

Dear Mr. Blessen,

Based upon the information provided in your submittal received 3-27-12, the above referenced plan is approved for Grading Permit and Building Permit. Please attach a copy of this approved plan to the construction sets prior to sign-off by Hydrology.

Prior to Certificate of Occupancy release, Engineer Certification per the DPM checklist will be required.

Albuquerque's MS4 Permit became effective March 1st, 2012. Grading and Drainage Plans and Drainage Reports will have to comply with the requirements of the new permit. The permit is available online at www.cabq.gov/Planning/landcoord/Hydrology

If you have any questions, you can contact me at 924-3986 or Rudy Rael at 924-3977.

Sincerely,

Curtis A. Cherne, P.E.
Principal Engineer, Planning Dept.
Development and Building Services

C: RER/CAC
file

March 26, 2012

re: Gate of Heaven Cemetery
file D19/D001A

Curtis Cherne PE
Principal Engineer, Planning Department, City of Albuquerque
PO Box 1293
Albuquerque, NM 87103

Dear Mr. Cherne,

I have received your letter of March 26, 2012. The drainage plan has been revised to limit the combined discharge to Bob White Lane at 13.7 cfs. The discharge from the existing pond B (7.1 cfs) has been corrected on the grading plan. The design of pond C has been revised to limit the rate of discharge from Basin C to limited to 6.6 cfs.

Pond C discharge:

bottom of pond elevation 64.5 ft
surface of water elevation 66.75 ft
depth of pond $66.75 - 64.5 = 2.25$ ft
dia of pipe 14" (1.167 ft) Area pipe = 1.07 sf
 $h = \text{pond depth} - \frac{1}{2} \text{Pipe dia} = 2.25 - 0.58 = 1.67$ ft

$$Q_{\text{pipe}} = 0.6 A (2 * 32.2 * h)^{0.5} = 6.6 \text{ cfs}$$

Pond C volume calculation:

Area bottom of pond 64.5 = 1188 sf
Area elev 65 = 3784 sf
Area elev 66 = 5598 sf
Area water surface 66.75 ft = 7034 sf


$$\text{Vol} = 0.5 * 0.5 * (1188 + 3784) + 0.5(3784 + 5598) + 0.75 * 0.5(5598 + 7034)$$

$$\text{Vol} = 10671 \text{ cf at } 66.75 \text{ ft}$$

Should you have any questions or require addition information please call.


✓ Arthur Blessen PE

attached revised basin C calculations

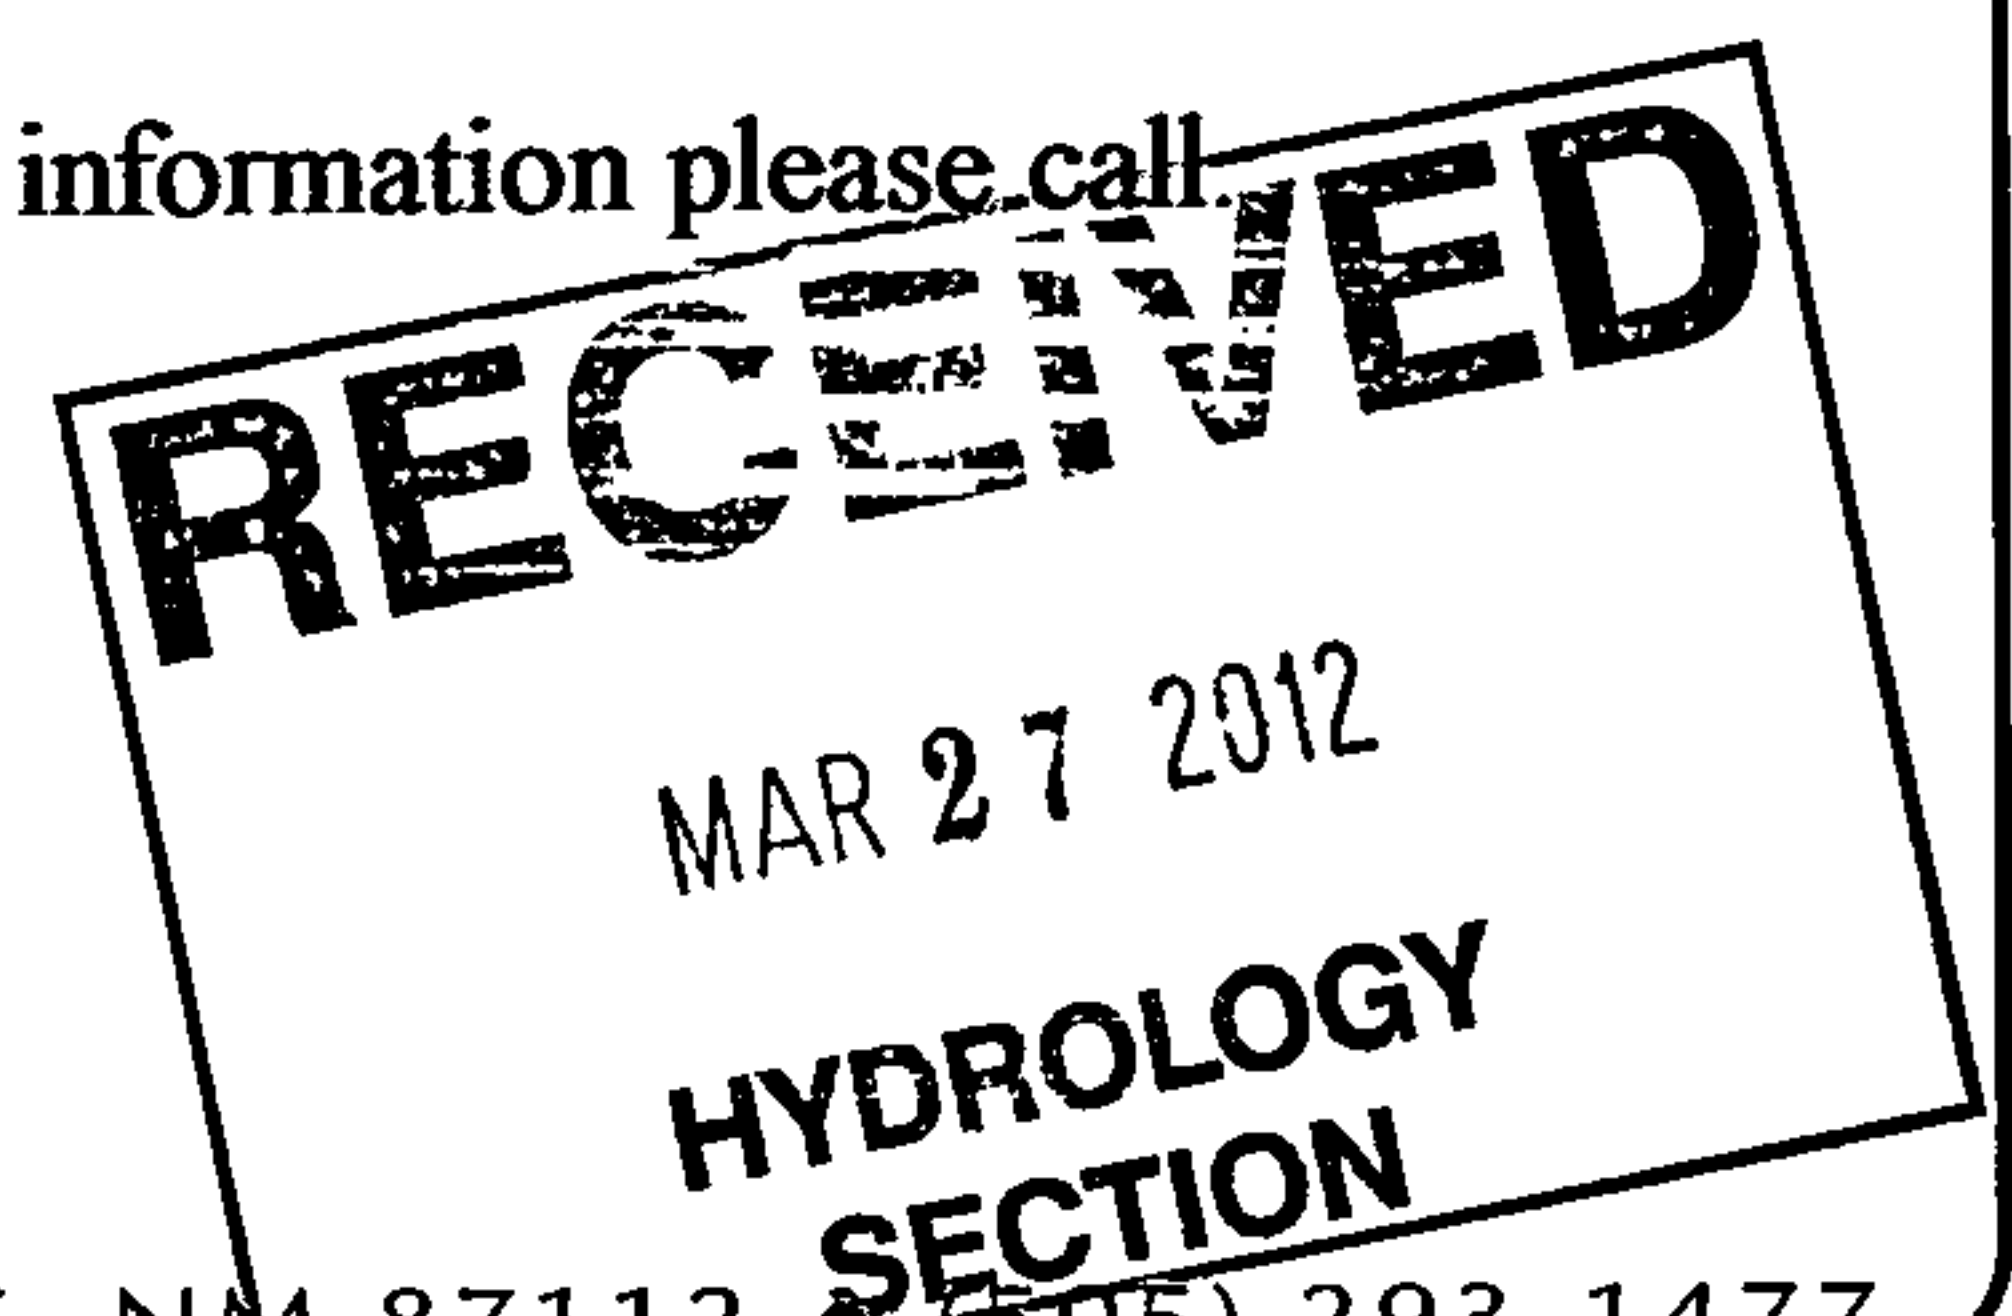

Drainage Calculation

City of Albuquerque DPM 1997 edition

Gate of Heaven Basin C - Revised

Precipitation Zone 3
Basin Area = 5.802 acres

Existing Treatment

Area of A = 252756 sf 100%
Area of B = 0 sf 0%
Area of C = 0 sf 0%
Area of D = 0 sf 0%

Improved Conditions Treatment

Area of A = sf 0%
Area of B = 157511 sf 62%
Area of C = 68068 sf 27%
Area of D = 27177 sf 11%

Excess Precipitation, E (inches) 6 hr - 100 yr storm table A-8

Existing Conditions

Treatment	% of Area	En
A	1.00 x 0.66 =	0.66
B	0.00 x 0.912 =	0.00
C	0.00 x 1.29 =	0.00
D	0.00 x 2.36 =	0.00
E		0.66

Improved Conditions

Treatment	% of Area	En
A	0.00 x 0.66 =	0.00
B	0.62 x 0.912 =	0.57
C	0.27 x 1.29 =	0.35
D	0.11 x 2.36 =	0.25
E		1.17

Volume V = E A / 12

Ve =	0.660 x 5.8025 / 12 =	0.319 acre ft	13902 cf
Vi =	1.169 x 5.8025 / 12 =	0.565 acre ft	24633 cf

Discharge Rate, Q (cfs / acre) 100 yr storm table A-9

Treatment	% of Area	Q
A	1.00 x 1.87 =	1.87
B	0.00 x 2.6 =	0.00
C	0.00 x 3.45 =	0.00
D	0.00 x 5.02 =	0.00
q		1.87

Treatment	% of Area	Q
A	0.00 x 1.87 =	0.00
B	0.62 x 2.6 =	1.62
C	0.27 x 3.45 =	0.93
D	0.11 x 5.02 =	0.54
q		3.09

Peak Rate Qp = q A

Qp(e) =	1.87 x 5.8025 =	10.85 cfs
Qp(i) =	3.09 x 5.8025 =	17.92 cfs

Excess Volume = 0.246 acre ft
Excess Rate = 7.07 cfs

tc =	0.2 hr	
tb =	(2.107 * E * At / Qp) - (0.25 * Ad / At) =	0.771 hr
tp =	(0.7 * tc) + ((1.6 - (Ad / At)) / 12) =	0.264 hr

Discharge Rate 6.63 cfs 1.14 cfs/ac

Volume 25736 cf
Discharged - 15114 cf

Pond Volume 10623 cf

