


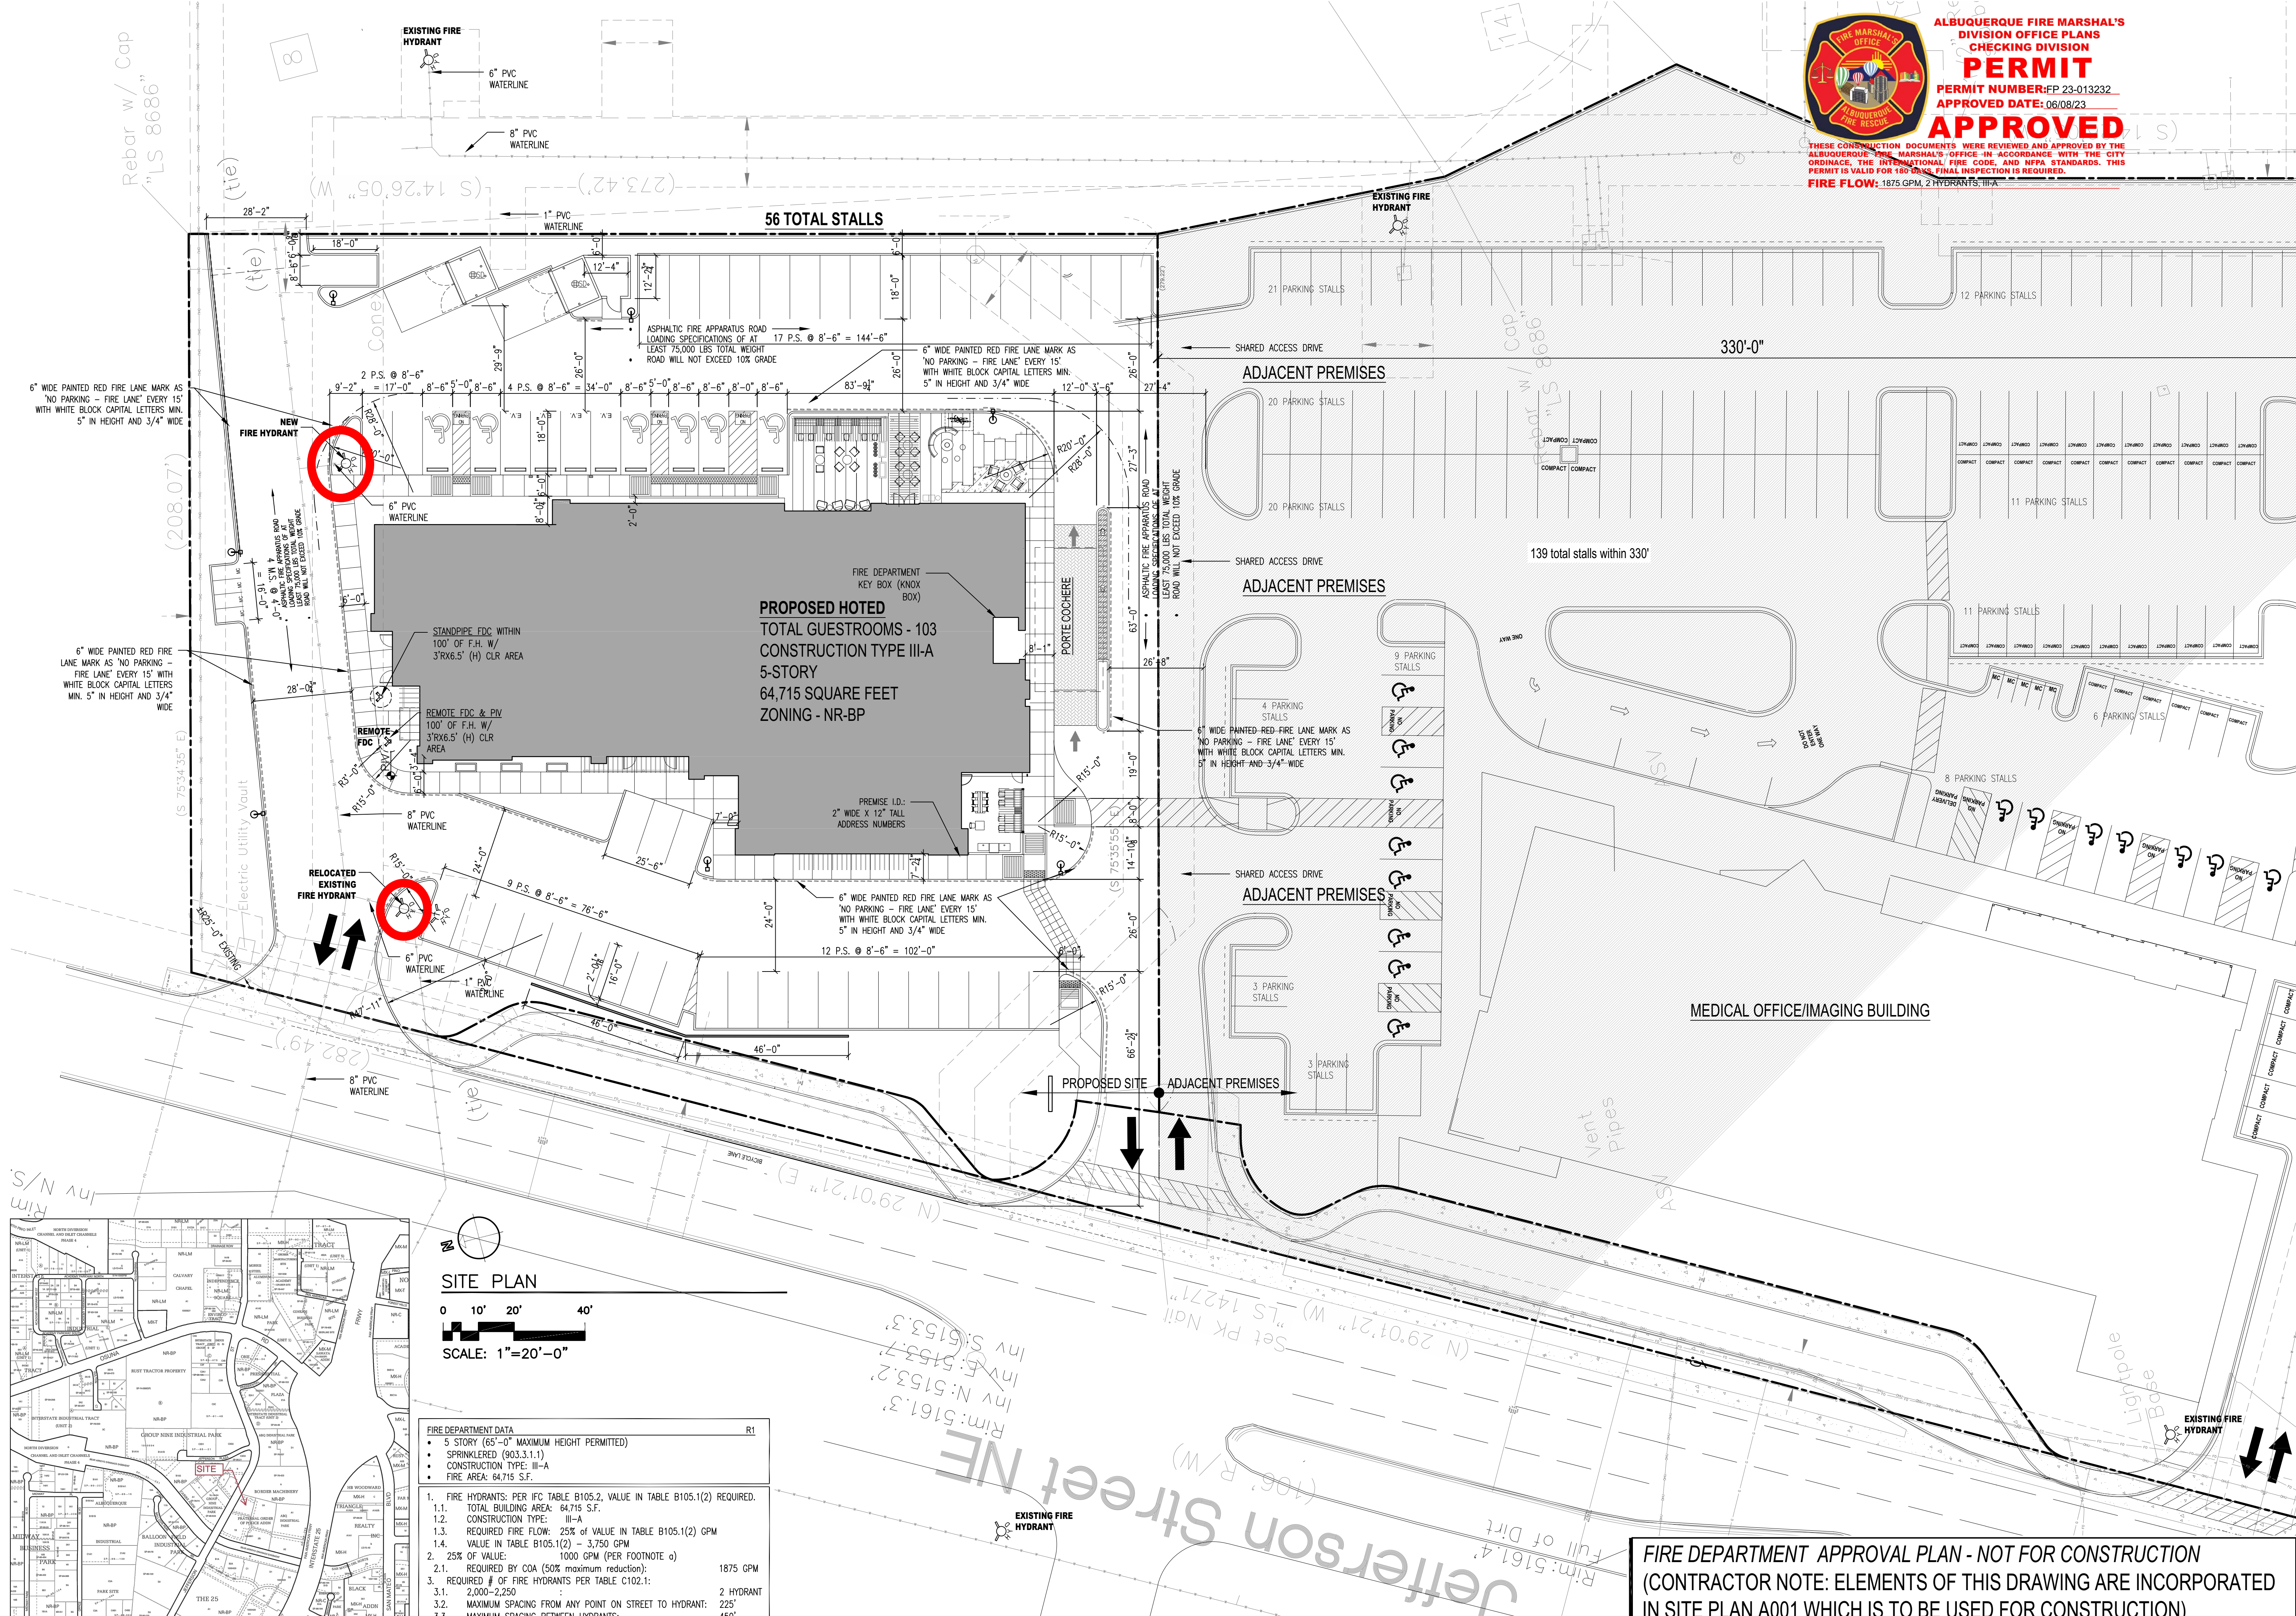

ALBUQUERQUE FIRE MARSHAL'S
DIVISION OF OFFICE PLANS
CHECKING DIVISION
PERMIT
PERMIT NUMBER: EP 23-013232
APPROVED DATE: 06/08/23
APPROVED

THESE CONSTRUCTION DOCUMENTS WERE REVIEWED AND APPROVED BY THE ALBUQUERQUE FIRE MARSHAL'S OFFICE IN ACCORDANCE WITH THE CITY ORDINANCE, THE INTERNATIONAL FIRE CODE, AND NFPA STANDARDS. THIS PERMIT IS VALID FOR 180 DAYS. FINAL INSPECTION IS REQUIRED.
FIRE FLOW: 1875 GPM, 2 HYDRANTS, III-A

pba
peter butterfield architect
13013 glenwood hills ct. ne
albuquerque nm 87111
(ph) 505 514 1364
STATE OF NEW MEXICO
PETER BUTTERFIELD
NO. 3850
2/2/23
REGISTERED ARCHITECT

DRAWING NAME
REVISIONS

Proposed Hotel - Home 2 Suites
5910 Jefferson St NE
Albuquerque, NM
Fire-1
5/25/23 Fire 1

FIRE DEPARTMENT APPROVAL PLAN - NOT FOR CONSTRUCTION
(CONTRACTOR NOTE: ELEMENTS OF THIS DRAWING ARE INCORPORATED IN SITE PLAN A001 WHICH IS TO BE USED FOR CONSTRUCTION)