

CITY OF ALBUQUERQUE

Planning Department
Alan Varela, Director



Mayor Timothy M. Keller

September 5, 2025

Jeffrey T. Wooten
Wooten Engineering
PO Box 15814
Rio Rancho NM 87174

**RE: Griegos Farms
4540 Guadalupe Church St. NW
Permanent Certificate of Occupancy – Lot 6 - Accepted
Engineer's Certification Date: 8/27/2025
Engineer's Stamp Date: 3/15/2023
Hydrology File: F13D028A**

Dear Mr. Wooten:

PO Box 1293
Albuquerque
NM 87103


Based on the Engineer's Grading and Drainage Certification received 8/27/2025 and site visit on 9/5/2025, this letter serves an approval of the certification in support of a Permanent Certificate of Occupancy for **Lot 6 of the Griegos Farms** located at 4540 Guadalupe Church St. NE to be issued by the Building and Safety Division.

Albuquerque
NM 87103

If you have any questions, please contact me at 505-924-3314 or amontoya@cabq.gov.

Sincerely,

www.cabq.gov
Anthony Montoya, Jr., P.E., C.F.M.
Senior Engineer, Hydrology
Planning Department, Development Review Services

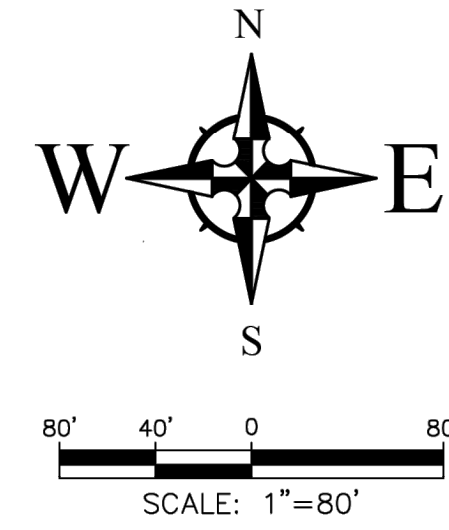

DRAINAGE CERTIFICATION

I, JEFFREY T. WOOTEN, NMPE 16892, OF THE FIRM WOOTEN ENGINEERING, HEREBY CERTIFY THAT THIS PROJECT HAS BEEN GRADED AND WILL DRAIN IN SUBSTANTIAL COMPLIANCE WITH AND IN ACCORDANCE WITH THE DESIGN INTENT OF THE APPROVED PLAN DATED 3/15/2023. THE RECORD INFORMATION EDITED ONTO THE ORIGINAL DESIGN DOCUMENT HAS BEEN OBTAINED BY BRIAN J. MARTINEZ, NMPS 18374, OF THE FIRM CARTESIAN SURVEYS, INC. I FURTHER CERTIFY THAT I PERSONALLY VISITED THE PROJECT SITE ON 8/19/2025 AND HAVE DETERMINED BY VISUAL INSPECTION THAT THE SURVEY DATA PROVIDED IS REPRESENTATIVE OF ACTUAL SITE CONDITIONS AND IS TRUE AND CORRECT TO THE BEST OF MY KNOWLEDGE AND BELIEF. THIS CERTIFICATION IS SUBMITTED IN SUPPORT OF A REQUEST FOR FINAL CERTIFICATE OF OCCUPANCY (FINAL C.O.) FOR LOT 6 ONLY.

THE RECORD INFORMATION PRESENTED HEREON IS NOT NECESSARILY COMPLETE AND INTENDED ONLY TO VERIFY SUBSTANTIAL COMPLIANCE OF THE GRADING AND DRAINAGE ASPECTS OF THIS PROJECT. THOSE RELYING ON THIS RECORD DOCUMENT ARE ADVISED TO OBTAIN INDEPENDENT VERIFICATION OF ITS ACCURACY BEFORE USING IT FOR ANY OTHER PURPOSE.

JEFFREY T. WOOTEN, NMPE 16892



LEGEND

- RETENTION POND
- DRAINAGE DIVIDE
- FLOW ARROWS
- DRAINAGE AREA A-1
- 1.10 ACRES

DRAINAGE MANAGEMENT PLAN

INTRODUCTION

The purpose of this submittal is to provide a final grading and drainage plan for the subject site located on Tract 2, Our Lady of Guadalupe subdivision and Tract 144-A-1, MRGCD Map No 31 in Albuquerque, NM. The overall development contains approximately 10.18 acres and is located in the southwest quadrant of Griegos Rd NW and San Ysidro St NW. The site is being developed as a Single Family Cottage Court development. The City Drainage File Number is F13-D028. It is our understanding that the 100-Yr, 10-Day storm must be retained on-site per the Valley Drainage Requirements in the DPM.

EXISTING HYDROLOGIC CONDITIONS


The site currently does not have a discharge point and drainage is retained on-site.

PROPOSED HYDROLOGIC CONDITIONS

Both the existing Our Lady of Guadalupe Church and the new Single Family Cottage Court development will retain the 100-Yr, 10-Day storm within their own properties. The locations of the new ponds serving the Cottage Court development are shown in these plans. The Drainage Calculations table show that adequate ponding is being provided to retain the 100-Yr, 10-Day runoff volume.

CONCLUSION

This final Grading and Drainage Plan conforms to the requirements of the City of Albuquerque DPM, Chapter 6.2. With this submittal, we are requesting Grading Permit and Site Plan for Building Permit approval.

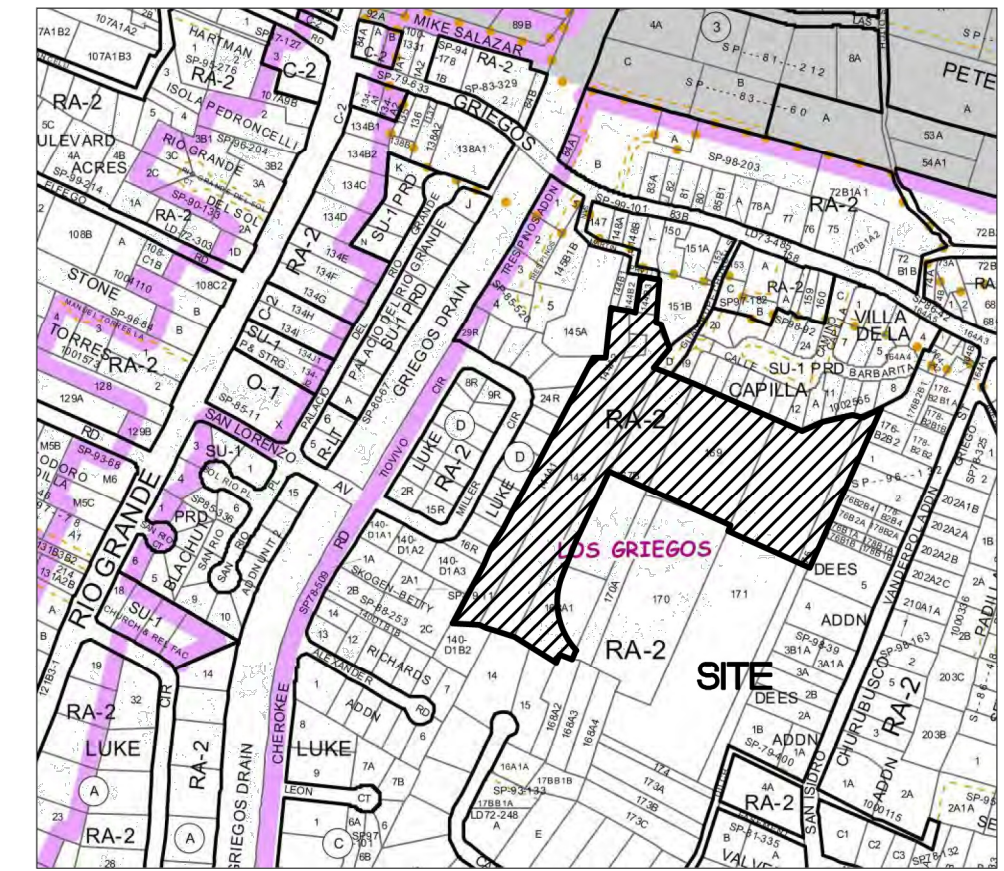

VICINITY MAP - Zone Map F-13-Z

Legal Description: Tract 2, Our Lady of Guadalupe and Tract 144A1, Cordova's Subdivision City of Albuquerque, NM. 10.19 Acres.



FIRM MAP 35001CXXXXH

Per FIRM Map 35001C0555H, dated August 16, 2012, the site is not located in the Floodplain and determined to be outside the 0.2% chance Annual Floodplain.



NOTE: BOTH THE RESIDENTIAL & THE CHURCH PROPERTY HAVE NO DISCHARGE AND WILL PROVIDE PONDING FOR THE 100-YR, 10-DAY STORM PER THE DPM.

| Existing Drainage Calculations | | | | | | | | | | | | | | |
|--|-----------|--------------------------------|-----|-------|------|------------|----------|-----------------|--------------|--------------|-------------|-----------------|-----------------|----------------------|
| This table is based on the ODA DPM Chapter 6.2 (A), Zone 2 | | | | | | | | | | | | | | |
| BASIN | Area (AC) | Land Treatment Percentages (%) | | | | Weighted C | Tc (min) | I (100) (in/hr) | Q(100) (cfs) | Q(100) (cfs) | WTE (in/hr) | V(100)24hr (CF) | V(100)24hr (CF) | Comments |
| | | A | B | C | D | | | | | | | | | |
| A-1 | 0.43 | 0.0 | 0.0 | 100.0 | 0.0 | 0.63 | 12.00 | 3.05 | 1.92 | 0.83 | 1.03 | 1609 | 1609 | Retained within site |
| A-2 | 0.43 | 0.0 | 0.0 | 90.0 | 10.0 | 0.66 | 12.00 | 3.18 | 2.09 | 0.90 | 1.16 | 1811 | 2060 | Retained within site |
| A-3 | 0.70 | 0.0 | 0.0 | 95.0 | 5.0 | 0.64 | 12.00 | 3.11 | 2.00 | 1.40 | 1.10 | 2782 | 2986 | Retained within site |
| A-4 | 0.40 | 0.0 | 0.0 | 100.0 | 0.0 | 0.63 | 12.00 | 3.05 | 1.92 | 0.77 | 1.03 | 1496 | 1496 | Retained within site |
| A-5 | 0.20 | 0.0 | 0.0 | 100.0 | 0.0 | 0.63 | 12.00 | 3.05 | 1.92 | 0.38 | 1.03 | 748 | 748 | Retained within site |
| A-6 | 0.76 | 0.0 | 0.0 | 95.0 | 5.0 | 0.64 | 12.00 | 3.11 | 2.00 | 1.52 | 1.10 | 3021 | 3242 | Retained within site |
| A-7 | 0.60 | 0.0 | 0.0 | 100.0 | 0.0 | 0.63 | 12.00 | 3.05 | 1.92 | 1.15 | 1.03 | 2243 | 2243 | Retained within site |
| A-8 | 0.94 | 0.0 | 0.0 | 60.0 | 40.0 | 0.74 | 12.00 | 3.57 | 2.63 | 2.47 | 1.55 | 5289 | 7473 | Retained within site |
| A-9 | 0.39 | 0.0 | 0.0 | 100.0 | 0.0 | 0.63 | 12.00 | 3.05 | 1.92 | 0.75 | 1.03 | 1458 | 1458 | Retained within site |
| A-10 | 0.31 | 0.0 | 0.0 | 90.0 | 10.0 | 0.66 | 12.00 | 3.18 | 2.09 | 0.65 | 1.16 | 1305 | 1485 | Retained within site |
| B-1 | 0.11 | 0.0 | 0.0 | 100.0 | 0.0 | 0.63 | 12.00 | 3.05 | 1.92 | 0.21 | 1.03 | 411 | 411 | Retained within site |
| B-2 | 0.40 | 0.0 | 0.0 | 100.0 | 0.0 | 0.63 | 12.00 | 3.05 | 1.92 | 0.77 | 1.03 | 1496 | 1496 | Retained within site |
| B-3 | 0.61 | 0.0 | 0.0 | 100.0 | 0.0 | 0.63 | 12.00 | 3.05 | 1.92 | 1.17 | 1.03 | 2281 | 2281 | Retained within site |
| B-4 | 0.14 | 0.0 | 0.0 | 100.0 | 0.0 | 0.63 | 12.00 | 3.05 | 1.92 | 0.27 | 1.03 | 523 | 523 | Retained within site |
| B-5 | 0.55 | 0.0 | 0.0 | 90.0 | 10.0 | 0.66 | 12.00 | 3.18 | 2.09 | 1.15 | 1.16 | 2316 | 2635 | Retained within site |
| B-6 | 0.83 | 0.0 | 0.0 | 100.0 | 0.0 | 0.63 | 12.00 | 3.05 | 1.92 | 1.59 | 1.03 | 3103 | 3103 | Retained within site |
| B-7 | 0.88 | 0.0 | 0.0 | 90.0 | 10.0 | 0.66 | 12.00 | 3.18 | 2.09 | 1.84 | 1.16 | 3706 | 4217 | Retained within site |
| B-8 | 0.49 | 0.0 | 0.0 | 100.0 | 0.0 | 0.63 | 12.00 | 3.05 | 1.92 | 0.94 | 1.03 | 1832 | 1832 | Retained within site |
| B-9 | 1.31 | 0.0 | 0.0 | 95.0 | 5.0 | 0.44 | 12.00 | 3.11 | 1.38 | 1.81 | 1.10 | 5207 | 5587 | Retained within site |
| C | 5.17 | 0.0 | 0.0 | 60.0 | 40.0 | 0.74 | 12.00 | 3.70 | 2.73 | 14.11 | 1.55 | 29089 | 41100 | Retained within site |
| D | 4.72 | 0.0 | 0.0 | 50.0 | 50.0 | 0.77 | 12.00 | 3.70 | 2.83 | 13.34 | 1.68 | 28784 | 42491 | Retained within site |
| TOTAL | 20.37 | | | | | | | | | 48.03 | | 100509 | 130475 | |

| Proposed Drainage Calculations | | | | | | | | | | | | | | | | | |
|--|-----------|--------------------------------|-----|-------|------|------------|----------|-----------------|--------------|--------------|-------------|-----------------|-----------------------|-----------------------|-----------------------|----------------------|----------------------|
| This table is based on the ODA DPM Chapter 6.2 (A), Zone 2 | | | | | | | | | | | | | | | | | |
| BASIN | Area (AC) | Land Treatment Percentages (%) | | | | Weighted C | Tc (min) | I (100) (in/hr) | Q(100) (cfs) | Q(100) (cfs) | WTE (in/hr) | V(100)24hr (CF) | Ponding Required (CF) | Ponding Proposed (CF) | Ponding Provided (CF) | Excess Ponding (CF) | Comments |
| | | A | B | C | D | | | | | | | | | | | | |
| A-1 | 0.43 | 0.0 | 0.0 | 100.0 | 0.0 | 0.63 | 12.00 | 3.02 | 3.03 | 1.21 | 1.81 | 2918 | 4022 | 4122 | 1104 | Retained within site | |
| A-2 | 0.43 | 0.0 | 0.0 | 40.0 | 60.0 | 0.79 | 12.00 | 4.08 | 3.45 | 1.48 | 2.07 | 3231 | 5300 | 5922 | 693 | Overflows to A-1 | |
| A-3 | 0.70 | 0.0 | 0.0 | 70.0 | 30.0 | 0.82 | 12.00 | 3.44 | 2.81 | 1.97 | 1.42 | 3808 | 4826 | 10257 | 8197 | 3369 | Retained within site |
| A-4 | 0.40 | 0.0 | 0.0 | 80.0 | 20.0 | 0.68 | 12.00 | 3.31 | 2.26 | 0.91 | 1.29 | 1873 | 2338 | 3050 | 2617 | 279 | Retained within site |
| A-5 | 0.20 | 0.0 | 0.0 | 90.0 | 10.0 | 0.66 | 12.00 | 3.18 | 2.09 | 0.42 | 1.16 | 842 | 968 | 1027 | 69 | Retained within site | |
| A-6 | 0.76 | 0.0 | 0.0 | 40.0 | 60.0 | 0.79 | 12.00 | 3.82 | 3.03 | 2.30 | 1.81 | 4993 | 7642 | 6350 | 5833 | -1809 | Overflows to A-7 |
| A-7 | 0.60 | 0.0 | 0.0 | 30.0 | 70.0 | 0.82 | 12.00 | 3.86 | 3.24 | 1.94 | 1.94 | 4225 | 6665 | 8474 | 9295 | 621 | Retained within site |
| A-8 | 0.94 | 0.0 | 0.0 | 25.0 | 75.0 | 0.83 | 12.00 | 4.02 | 3.34 | 3.14 | 2.91 | 6841 | 10936 | 10936 | 11456 | 520 | Retained within site |
| A-9 | 0.39 | 0.0 | 0.0 | 80.0 | 20.0 | 0.68 | 12.00 | 3.31 | 2.26 | 0.86 | 1.29 | 1826 | 2279 | 2308 | 3451 | 1171 | Retained within site |
| A-10 | 0.31 | 0.0 | 0.0 | 80.0 | 20.0 | 0.68 | 12.00 | 3.31 | 2.26 | 0.70 | 1.29 | 1452 | 1812 | 3382 | 4215 | 2403 | Retained within site |
| B-1 | 0.11 | 0.0 | 0.0 | 40.0 | 60.0 | 0.79 | 12.00 | 3.82 | 3.03 | 0.33 | 1.81 | 723 | 1106 | 1145 | 1145 | 39 | Retained within site |
| B-2 | 0.40 | 0.0 | 0.0 | 40.0 | 60.0 | 0.79 | 12.00 | 3.82 | 3.03 | 1.21 | 1.81 | 2918 | 4022 | 4122 | 4122 | 100 | Retained within site |
| B-3 | 0.61 | 0.0 | 0.0 | 60.0 | 40.0 | 0.74 | 12.00 | 3.57 | 2.63 | 1.61 | 1.55 | 3432 | 4949 | 4219 | 4968 | 59 | Retained within site |
| B-4 | 0.14 | 0.0 | 0.0 | 40.0 | 60.0 | 0.79 | 12.00 | 3.82 | 3.03 | 0.42 | 1.81 | 920 | 1408 | 1397 | 1770 | 362 | Retained within site |
| B-5 | 0.55 | 0.0 | 0.0 | 60.0 | 40.0 | 0.74 | 12.00 | 3.57 | 2.63 | 1.45 | 1.55 | 3095 | 4372 | 3230 | 3230 | -1142 | Overflows to B-6 |
| B-6 | 0.83 | 0.0 | 0.0 | 60.0 | 40.0 | 0.74 | 12.00 | 3.57 | 2.63 | 2.18 | 1.55 | 4670 | 6598 | 7583 | 7583 | 985 | Retained within site |
| B-7 | 0.88 | 0.0 | 0.0 | 60.0 | 40.0 | 0.74 | 12.00 | 3.57 | 2.63 | 2.32 | 1.55 | 4957 | 6996 | 11455 | 11455 | 4689 | Retained within site |
| B-8 | 0.49 | 0.0 | 0.0 | 60.0 | 40.0 | 0.74 | 12.00 | 3.70 | 2.73 | 1.34 | 1.55 | 2757 | 3895 | 6383 | 7455 | 3580 | Retained within site |
| B-9 | 1.31 | 0.0 | 0.0 | 70.0 | 30.0 | 0.71 | 12.00 | 3.82 | 2.72 | 3.56 | 1.42 | 6753 | 9035 | 9057 | 9057 | 22 | Retained within site |
| C | 5.17 | 0.0 | 0.0 | 60.0 | 40.0 | 0.74 | 12.00 | 3.57 | 2.63 | 13.61 | 1.55 | 29089 | 41100 | 46000 | 46000 | 4900 | Retained within site |
| D | 4.72 | 0.0 | 0.0 | 60.0 | 40.0 | 0.74 | 12.00 | 3.57 | 2.63 | 12.42 | 1.55 | 26557 | 37523 | 45600 | 45600 | 8077 | Retained within site |
| TOTAL | 20.37 | | | | | | | | | 55.50 | | 117292 | 214825 | 197382 | 253865 | 36329 | |

AS DETERMINED BY THE DRAINAGE AGREEMENT - OUR LADY OF GUADALUPE DATED JUNE 17, 2022 BY AND BETWEEN ARCHDIOCESE OF SANTA FE REAL ESTATE CORP / OUR LADY OF GUADALUPE ("TRACT 1 OWNER") AND REMBE PROPERTIES, LLC OR ASSIGNS ("TRACT 2 OWNER"), THE DRAINAGE PONDS SHOWN ON TRACT 1 ARE TEMPORARY AND WILL BE EXCAVATED BY THE DEVELOPER OF TRACT 2.


| NO. | DATE | REMARKS | BY |
|-----|---------------------|-----------|----|
| | DESIGNED BY: JW | REVISIONS | |
| | DRAWN BY: RC | DESIGN | |
| | CHECKED BY: JW | | |
| | DATE: February 2023 | | |
| | DATE: February 2023 | | |
| | JOB NO.: 2020016 | | |
| | DATE: February 2023 | | |



Wooten Engineering
 PO Box 15814
 Rio Rancho, N.M. 87174
 Phone: (505) 980-3560

Griegos Farms
 Tract 2, Our lady of Guadalupe
 Albuquerque, NM 87107

Drainage Management Plan


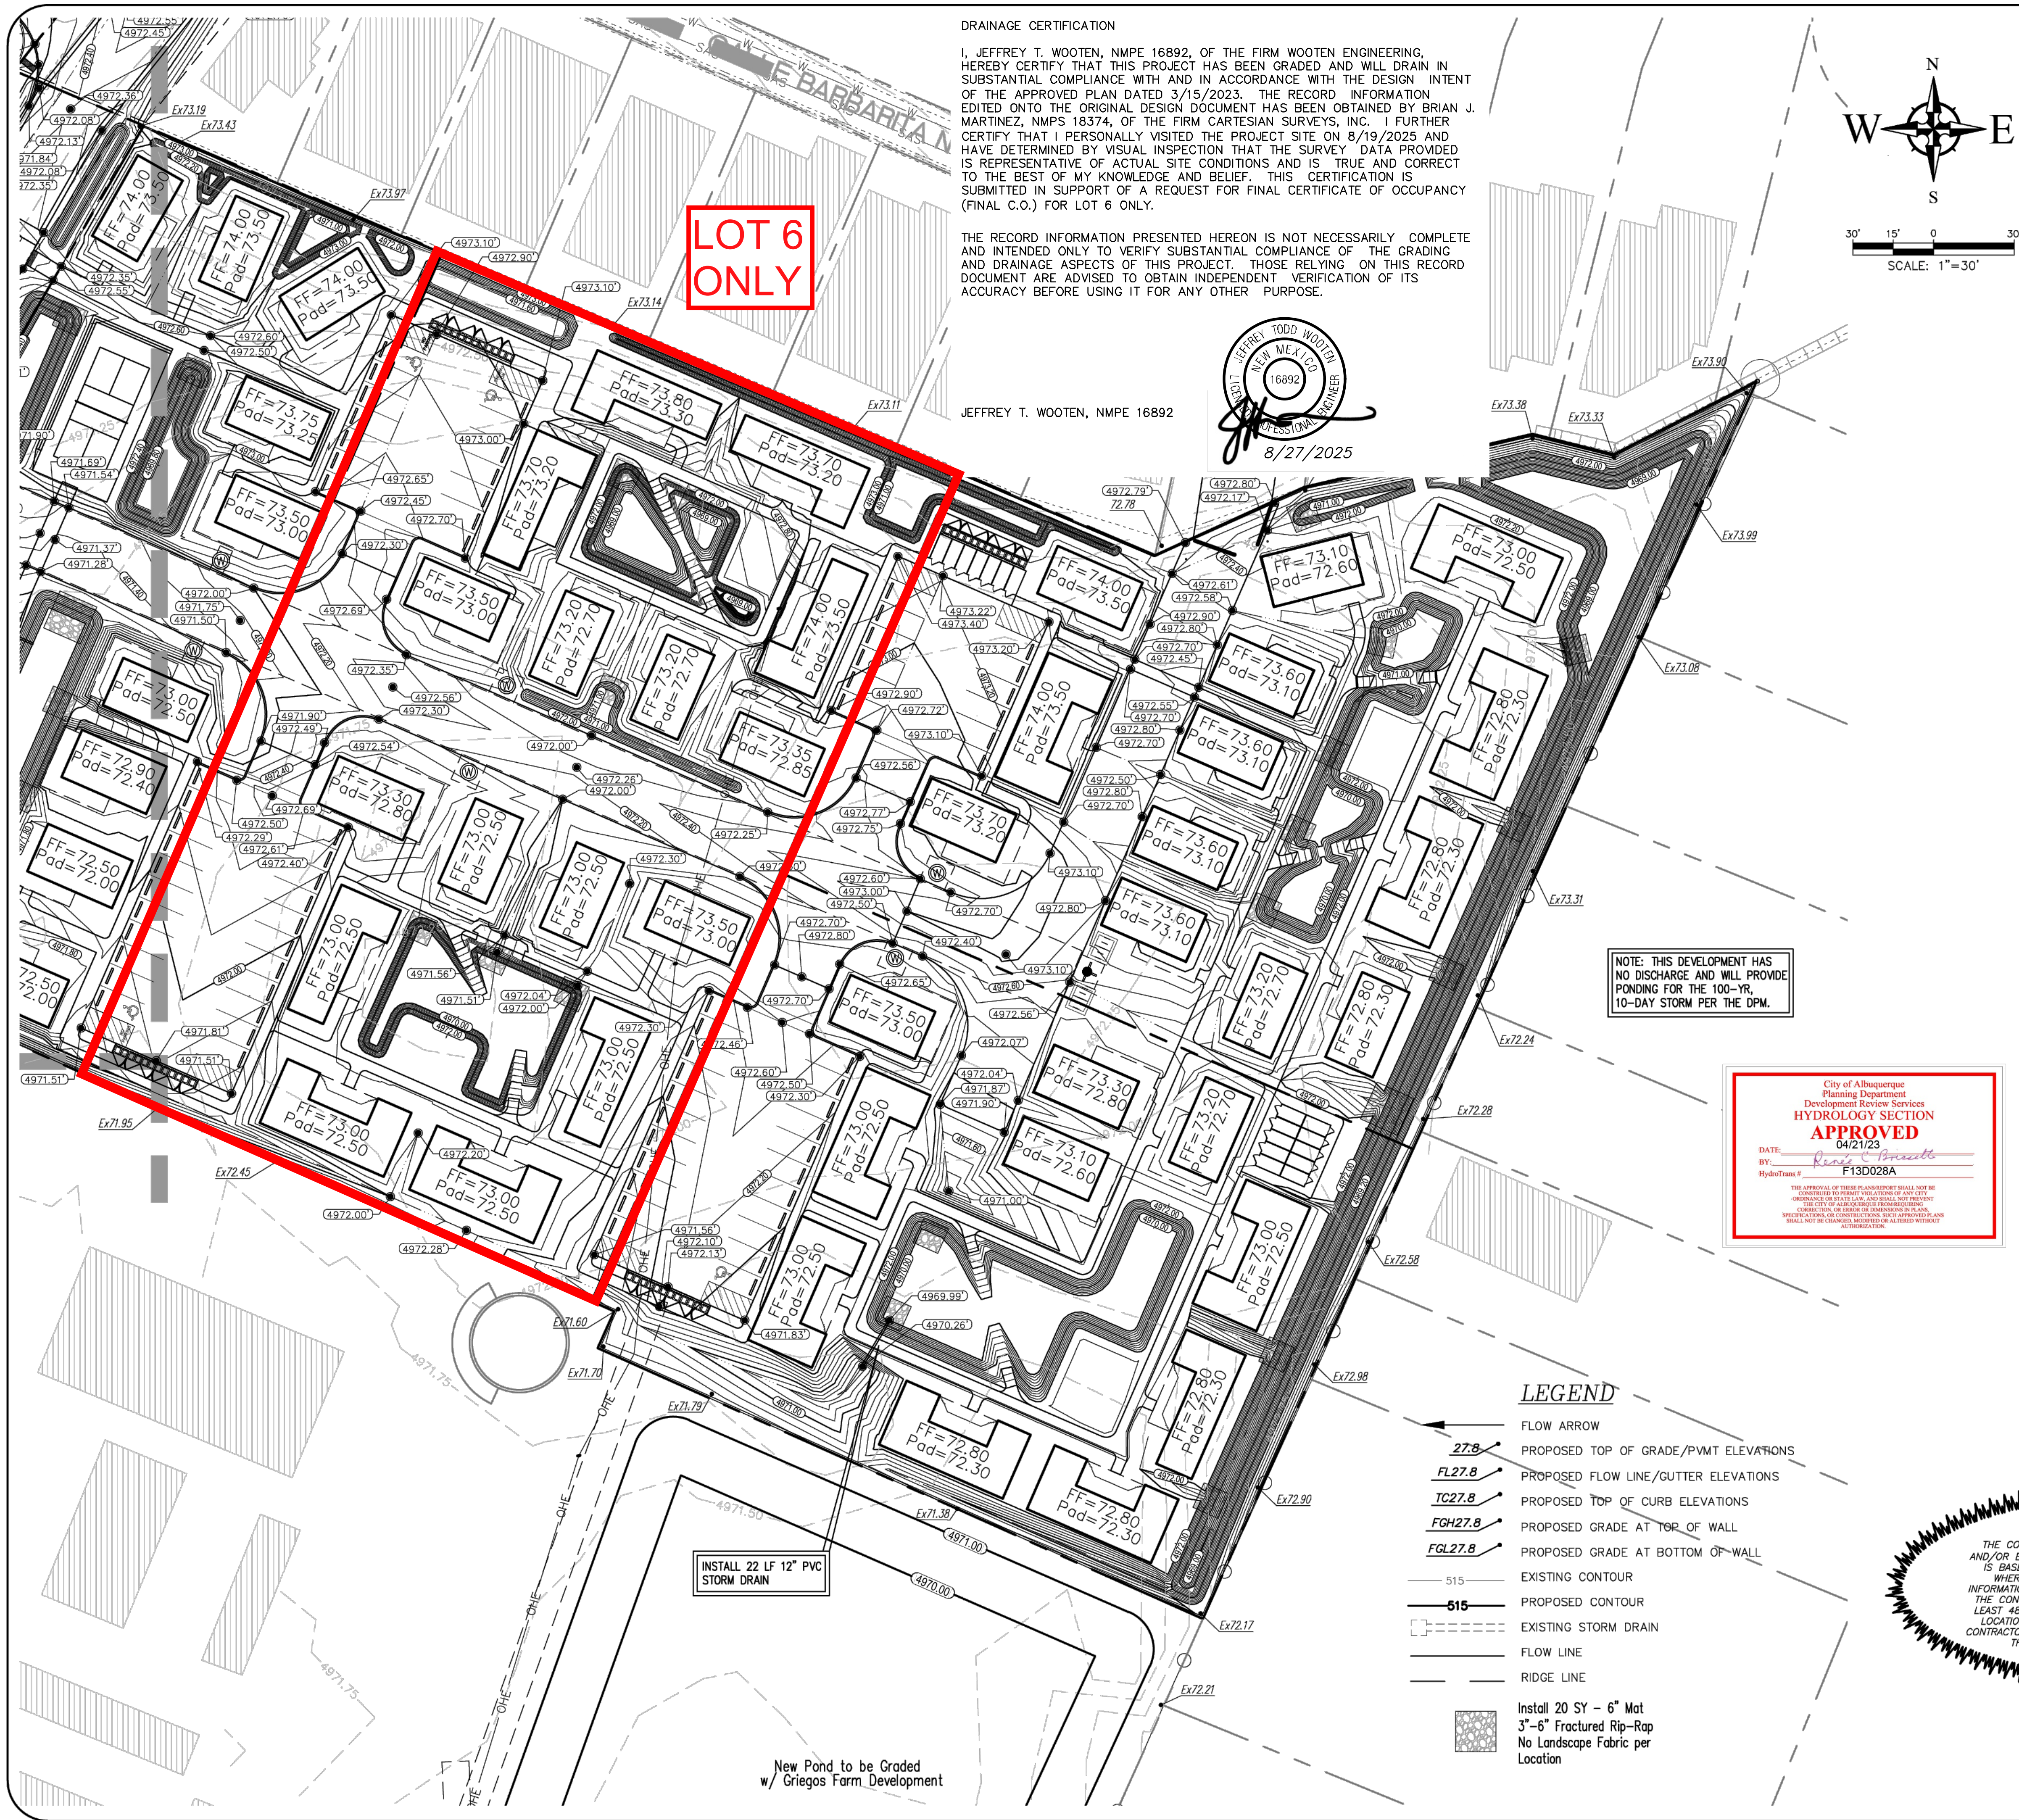


LOT 6 ONLY

DRAINAGE CERTIFICATION
 I, JEFFREY T. WOOTEN, NMPE 16892, OF THE FIRM WOOTEN ENGINEERING, HEREBY CERTIFY THAT THIS PROJECT HAS BEEN GRADED AND WILL DRAIN IN SUBSTANTIAL COMPLIANCE WITH AND IN ACCORDANCE WITH THE DESIGN INTENT OF THE APPROVED PLAN DATED 3/15/2023. THE RECORD INFORMATION EDITED ONTO THE ORIGINAL DESIGN DOCUMENT HAS BEEN OBTAINED BY BRIAN J. MARTINEZ, NMPS 18374, OF THE FIRM CARTESIAN SURVEYS, INC. I FURTHER CERTIFY THAT I PERSONALLY VISITED THE PROJECT SITE ON 8/19/2025 AND HAVE DETERMINED BY VISUAL INSPECTION THAT THE SURVEY DATA PROVIDED IS REPRESENTATIVE OF ACTUAL SITE CONDITIONS AND IS TRUE AND CORRECT TO THE BEST OF MY KNOWLEDGE AND BELIEF. THIS CERTIFICATION IS SUBMITTED IN SUPPORT OF A REQUEST FOR FINAL CERTIFICATE OF OCCUPANCY (FINAL C.O.) FOR LOT 6 ONLY.

THE RECORD INFORMATION PRESENTED HEREON IS NOT NECESSARILY COMPLETE AND INTENDED ONLY TO VERIFY SUBSTANTIAL COMPLIANCE OF THE GRADING AND DRAINAGE ASPECTS OF THIS PROJECT. THOSE RELYING ON THIS RECORD DOCUMENT ARE ADVISED TO OBTAIN INDEPENDENT VERIFICATION OF ITS ACCURACY BEFORE USING IT FOR ANY OTHER PURPOSE.

JEFFREY T. WOOTEN, NMPE 16892

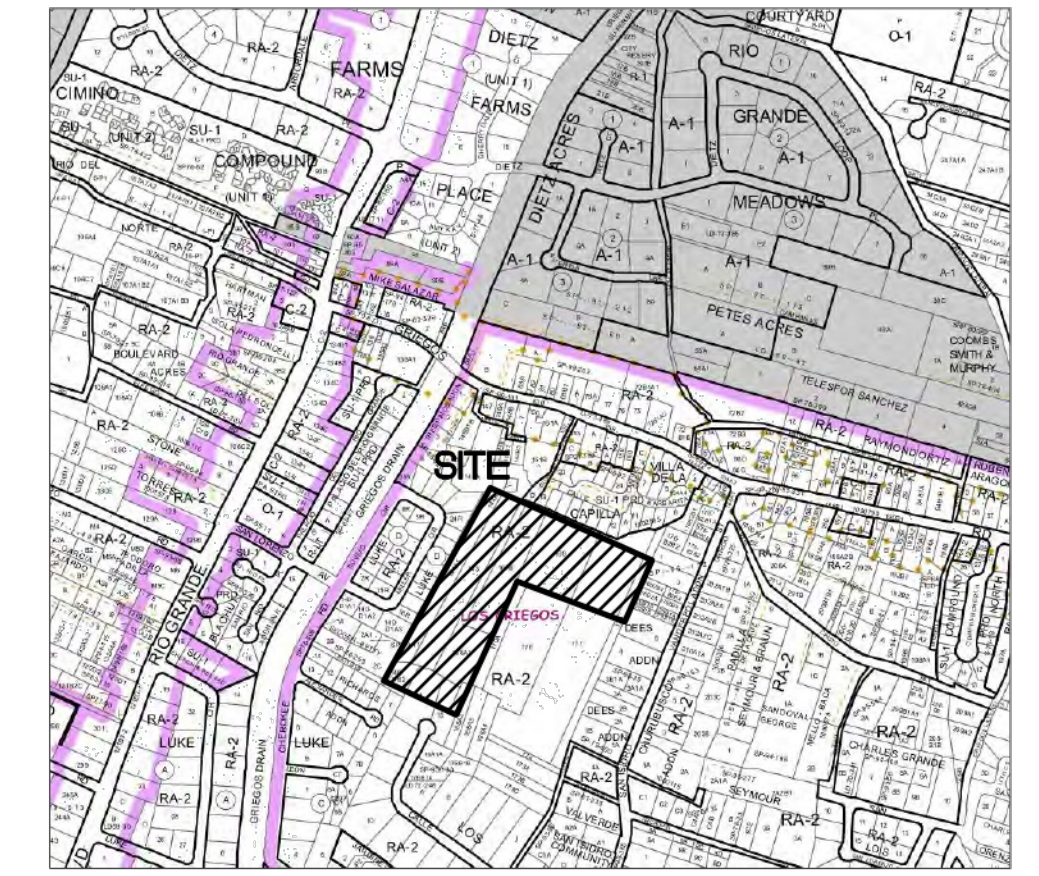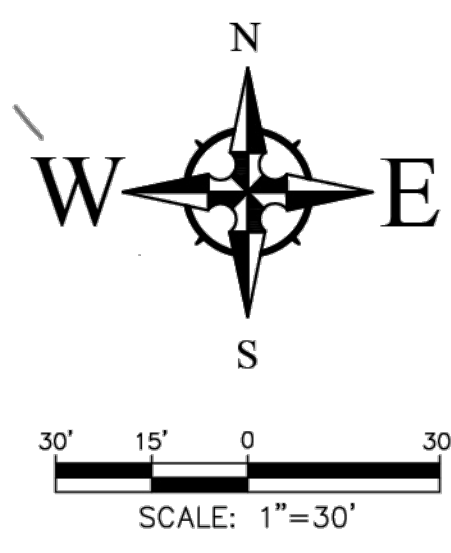

VICINITY MAP - Zone Map F-13-Z
 Legal Description: Tract 2, Our Lady of Guadalupe and Tract 144A1, Cordova's Subdivision City of Albuquerque, NM. 10.19 Acres.



FIRM MAP 35001C018G
 Per FIRM Map 35001C018G, dated September 26, 2008, the site is located in Zone X of the Floodplain and determined to be inside the 0.25 chance Annual Floodplain. Areas of 1% annual chance flood with average depths of less than 1 square mile; and areas protected by levees from 1% annual chance flood.


GRADING NOTES

- EXCEPT AS PROVIDED HEREIN, GRADING SHALL BE PERFORMED AT THE ELEVATIONS AND IN ACCORDANCE WITH THE DETAILS SHOWN ON THIS PLAN.
- THE COST FOR REQUIRED CONSTRUCTION DUST AND EROSION CONTROL MEASURES SHALL BE INCIDENTAL TO THE PROJECT COST.
- ALL WORK RELATIVE TO FOUNDATION CONSTRUCTION, SITE PREPARATION, AND PAVEMENT INSTALLATION, AS SHOWN ON THIS PLAN, SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE "GEOTECHNICAL INVESTIGATION," AS PROVIDED BY THE ARCHITECT OR OWNER. ALL OTHER WORK SHALL, UNLESS OTHERWISE STATED OR PROVIDED FOR HEREON, BE CONSTRUCTED IN ACCORDANCE WITH THE PROJECT, (FIRST PRIORITY) SPECIFICATIONS, AND/OR THE CITY OF ALBUQUERQUE (COA) STANDARD SPECIFICATIONS FOR PUBLIC WORKS (SECOND PRIORITY).
- EARTH SLOPES SHALL NOT EXCEED 3 HORIZONTAL TO 1 VERTICAL UNLESS SHOWN OTHERWISE.
- IT IS THE INTENT OF THESE PLANS THAT THIS CONTRACTOR SHALL NOT PERFORM ANY WORK OUTSIDE OF THE PROPERTY BOUNDARIES EXCEPT AS REQUIRED BY THIS PLAN.
- THE CONTRACTOR IS TO ENSURE THAT NO SOIL ERODES FROM THE SITE ONTO ADJACENT PROPERTY OR PUBLIC RIGHT-OF-WAY. THIS SHOULD BE ACHIEVED BY CONSTRUCTING TEMPORARY BERMS OR SILT FENCE AT THE PROPERTY LINES AND WETTING THE SOIL TO PROTECT IT FROM WIND EROSION.
- A DISPOSAL SITE FOR ANY & ALL EXCESS EXCAVATION MATERIAL, AND UNSUITABLE MATERIAL AND/OR A BORROW SITE CONTAINING ACCEPTABLE FILL MATERIAL SHALL BE OBTAINED BY THE CONTRACTOR IN COMPLIANCE WITH APPLICABLE ENVIRONMENTAL REGULATIONS AND APPROVED BY THE OBSERVER. ALL COSTS INCURRED IN OBTAINING A DISPOSAL OR BORROW SITE AND HAUL TO OR FROM SHALL BE CONSIDERED INCIDENTAL TO THE PROJECT AND NO SEPARATE MEASUREMENT OR PAYMENT SHALL BE MADE.
- PAVING AND ROADWAY GRADES SHALL BE +/- 0.05' FROM PLAN ELEVATIONS. PAD ELEVATION SHALL BE +/- 0.05' FROM BUILDING PLAN ELEVATION.
- ALL PROPOSED CONTOURS AND SPOT ELEVATIONS REFLECT TOP OF PAVEMENT ELEVATIONS IN THE PARKING AREA AND MUST BE ADJUSTED FOR PAVEMENT, MEDIANS, AND ISLANDS.
- VERIFY ALL ELEVATIONS SHOWN ON PLAN FROM BASIS OF ELEVATION CONTROL STATION (IF APPLICABLE) PRIOR TO BEGINNING CONSTRUCTION.
- THE CONTRACTOR SHALL PROVIDE THE SWPPP DOCUMENT (IF NECESSARY) AND SHALL ABIDE BY ALL LOCAL, STATE, AND FEDERAL LAWS, RULES AND REGULATIONS WHICH APPLY TO THE CONSTRUCTION OF THESE IMPROVEMENTS, INCLUDING EPA REQUIREMENTS WITH RESPECT TO STORM WATER DISCHARGE.



LEGEND

- 27.8 FLOW ARROW
- FL27.8 PROPOSED TOP OF GRADE/PVMT ELEVATIONS
- FL27.8 PROPOSED FLOW LINE/GUTTER ELEVATIONS
- TC27.8 PROPOSED TOP OF CURB ELEVATIONS
- FGH27.8 PROPOSED GRADE AT TOP OF WALL
- FGL27.8 PROPOSED GRADE AT BOTTOM OF WALL
- 515 EXISTING CONTOUR
- 515 PROPOSED CONTOUR
- EXISTING STORM DRAIN
- FLOW LINE
- RIDGE LINE
- Install 20 SY - 6" Mat 3"-6" Fractured Rip-Rap No Landscape Fabric per Location

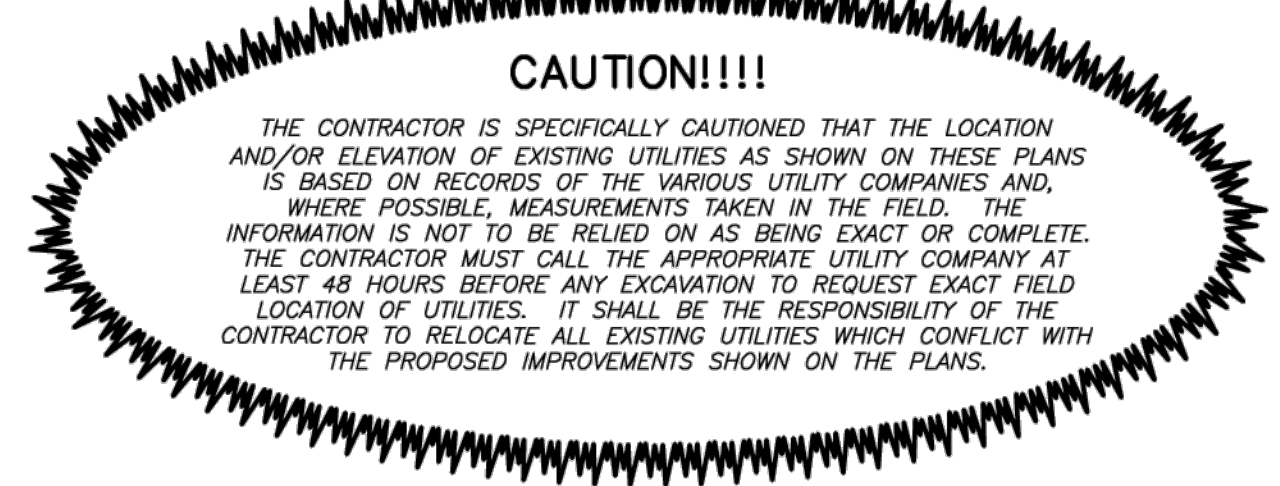

| NO. | DATE | REVISIONS | BY |
|--------------|---------------|-----------|----|
| DESIGNED BY: | JW | DESIGN | |
| DRAWN BY: | OG | | |
| CHECKED BY: | JW | | |
| DATE: | February 2023 | | |
| DATE: | February 2023 | | |
| JOB NO.: | 2022014 | | |
| DATE: | February 2023 | | |



Wooten Engineering
 PO Box 15814
 Rio Rancho, N.M. 87174
 Phone: (505) 980-3560

Griegos Farms
 Griegos Rd & Guadalupe Church St Nw
 Albuquerque, NM 87107

Grading Plan - East

C-203