

1. WOVEN WIRE FENCE TO BE FASTENED SECURELY TO FENCE POSTS WITH WIRE TIES
2. GEOTEXTILE TO BE FASTENED SECURELY TO WOVEN WIRE FENCE WITH TIES SPACED EVERY 24" AT TOP AND MID SECTION.
3. WHEN TWO SECTIONS OF GEOTEXTILE ADJOIN EACH OTHER THEY SHALL BE OVERLAPPED BY SIX INCHES AND FOLDED.
4. MAINTENANCE SHALL BE PERFORMED AS NOTED IN THE EROSION CONTROL PLAN. COLLECTED MATERIAL SHALL BE REMOVED WHEN "BULGES" DEVELOP IN THE SILT FENCE.
5. ALL SILT FENCE SHALL INCLUDE WIRE SUPPORT UNLESS INDICATED OTHERWISE

Technical drawings of the fence assembly showing side and end views with dimensions and labels.

Side View Labels:

- 2" X 4" WOOD FRAME
- DROP INLET WITH GRATE
- 6" MIN. (TYP.)
- 1/2" MAX.
- 1/2" MIN.
- CROSS BRACE
- 3" MIN.

End View Labels:

- 2" X 4" STAKE
- WOVEN WIRE FENCE WITH SILT FENCE MATERIAL COVER
- EXTEND WIRE FENCE A MIN. OF 3" INTO GROUND
- EXTEND SILT FENCE MATERIAL A MIN. OF 1'-0" INTO GROUND

Assembly Instructions:

- ATTACH THE WOVEN WIRE FENCE TO EACH POST WITH THREE WIRE TIES OR OTHER FASTENERS (SEE NOTE 1)
- 6" MIN. OVERLAP
- SECURELY FASTEN OVERLAPPING ENDS OF SILT FENCE MATERIAL TO ADJACENT STAKES WITH THREE WIRE TIES OR OTHER FASTENERS
- SILT FENCE MATERIAL TO BE FASTENED SECURELY TO WOVEN WIRE FENCE WITH THREE TIES SPACED AT 30" ON CENTER (SEE NOTE 1)


POSTS: 2 X 4 WOODEN STAKE

FENCE: WOVEN WIRE, 1-1/2 GA., 6" MAX. MESH OPENING

FABRIC: IN ACCORDANCE WITH ASTM D 6481 LATEST EDITION.


1. ATTACH THE WOMEN WIRE FENCE TO EACH POST AND THE GEOTEXTILE TO THE WOMEN WIRE FENCE (SPACED EVERY 30") WITH THREE WIRE TIES OR OTHER FASTENERS, ALL SPACED WITHIN THE TOP 8" OF THE FABRIC. ATTACH EACH TIE DIAGONALLY AS DEGREES THROUGH THE FABRIC, WITH EACH PUNCTURE AT LEAST 1" VERTICALLY APART.
2. WHEN TWO SECTIONS OF SILT FENCE MATERIAL ADJACENT EACH OTHER, THEY SHALL BE OVERLAPPED ACROSS TWO POSTS.
3. THE FENCE SHALL BE MAINTAINED AT ALL TIMES TO THE SURFACE DEPTH OF ACCUMULATED SEDIMENT. WHEN THE SEDIMENT REACHES ONE-HALF THE HEIGHT OF THE FABRIC, MAINTENANCE CLEANOUT MUST BE CONDUCTED REGULARLY TO PREVENT ACCUMULATED SEDIMENTS FROM REACHING ONE-HALF THE HEIGHT OF THE SILT FENCE MATERIAL ABOVE GRADE.
4. ALL SILT FENCE INLETS SHALL INCLUDE WIRE SUPPORT.

N.T.S

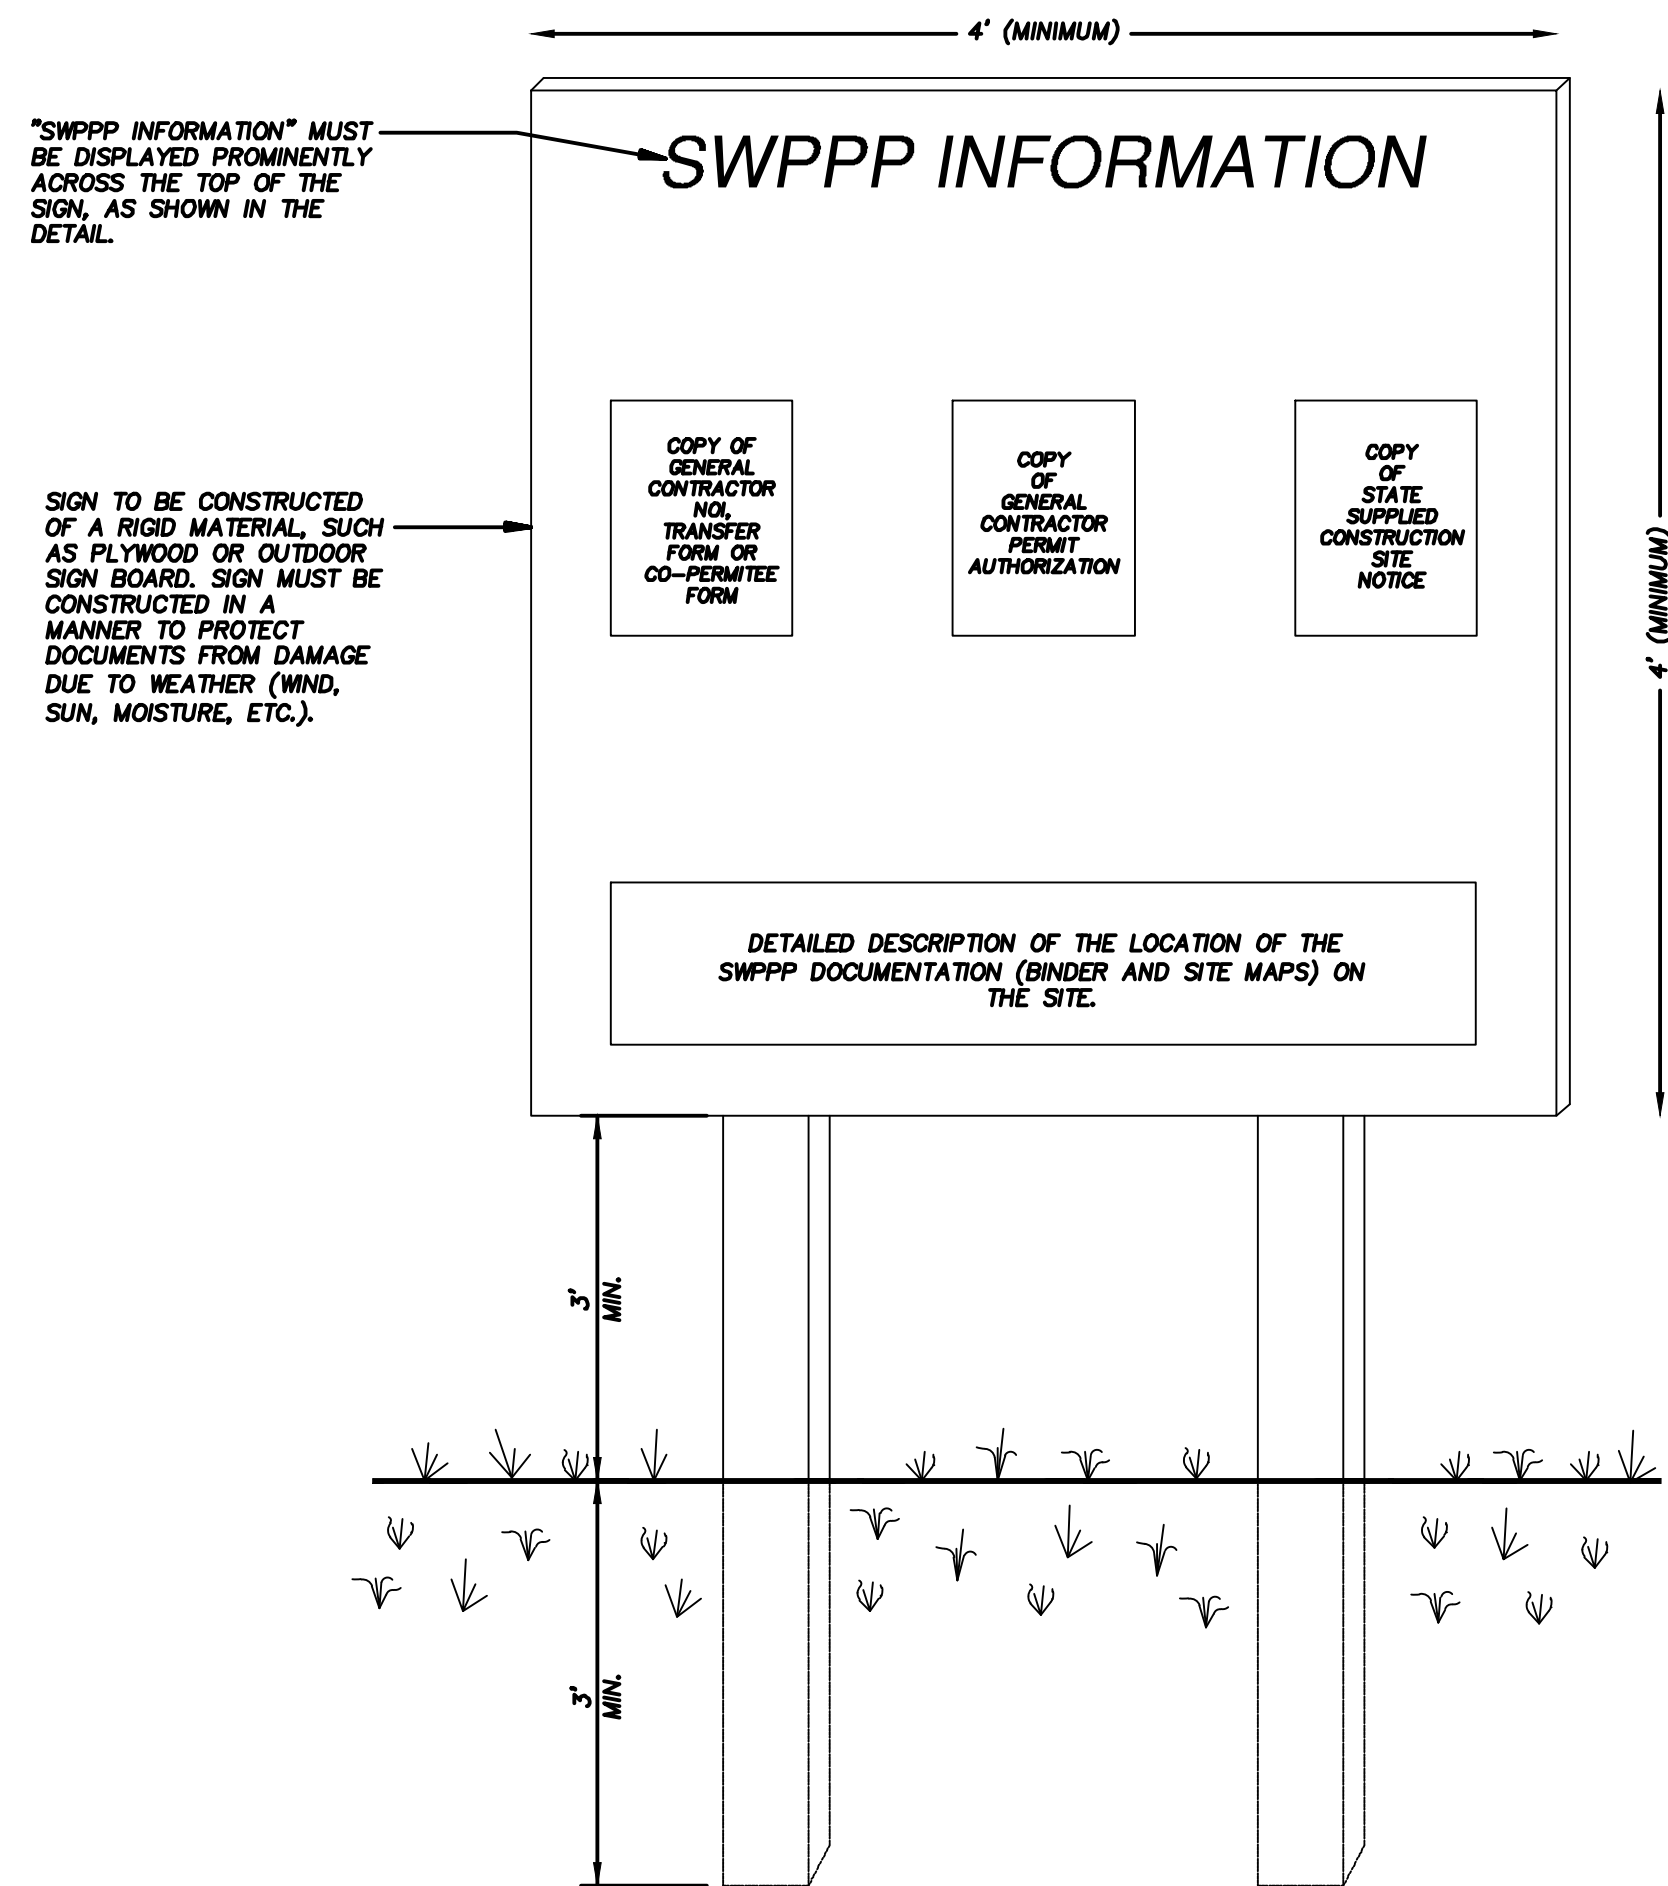


- 1) THE SWPPP INFORMATION SIGN MUST BE LOCATED NEAR THE CONSTRUCTION EXIT OF THE SITE. SIGNIFY THAT IT IS ACCESSIBLE AND VIEWABLE BY THE GENERAL PUBLIC, BUT NOT OBSTRUCTING VIEWS AS TO CAUSE A SAFETY HAZARD.
- 2) ALL POSTED DOCUMENTS MUST BE MAINTAINED IN A CLEARLY READABLE CONDITION AT ALL TIMES THROUGHOUT THE PROJECT AND UNTIL THE NOTICE OF TERMINATION (NOT) IS FILED FOR THE PERMIT.
- 3) CONTRACTOR SHALL POST OTHER STORE WATER AND/OR EROSION AND SEDIMENT CONTROL RELATED PERMITS ON THE SIGN AS REQUIRED BY THE GOVERNING AGENCY.
- 4) SIGN SHALL BE LOCATED OUTSIDE OF PUBLIC RIGHT-OF-WAY AND EASEMENTS UNLESS APPROVED BY THE GOVERNING AGENCY.
- 5) CONTRACTOR IS RESPONSIBLE FOR ENSURING STABILITY OF THE SWPPP INFORMATION SIGN.

N.T.S

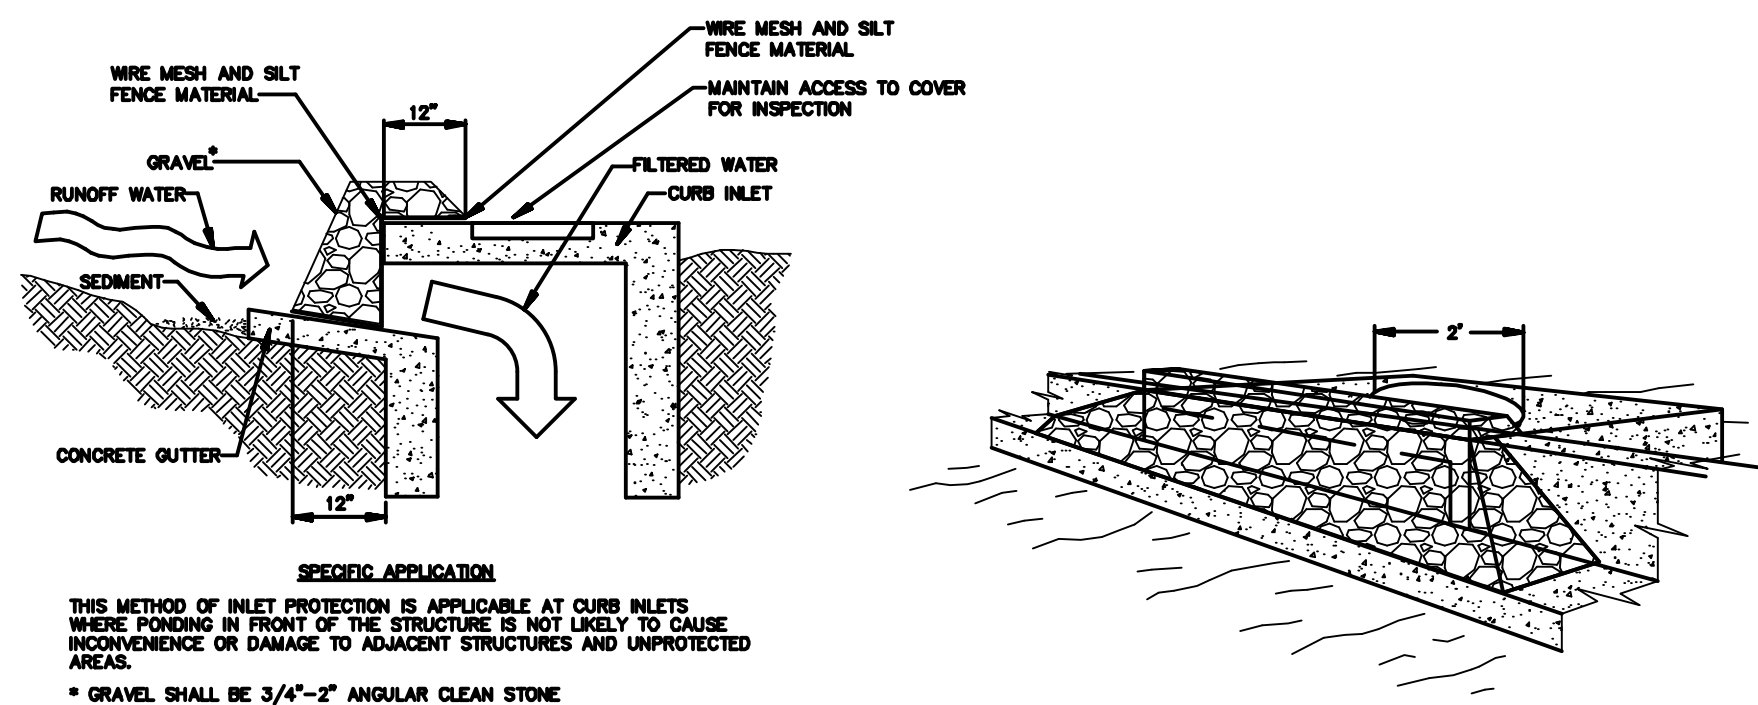

N.T.S

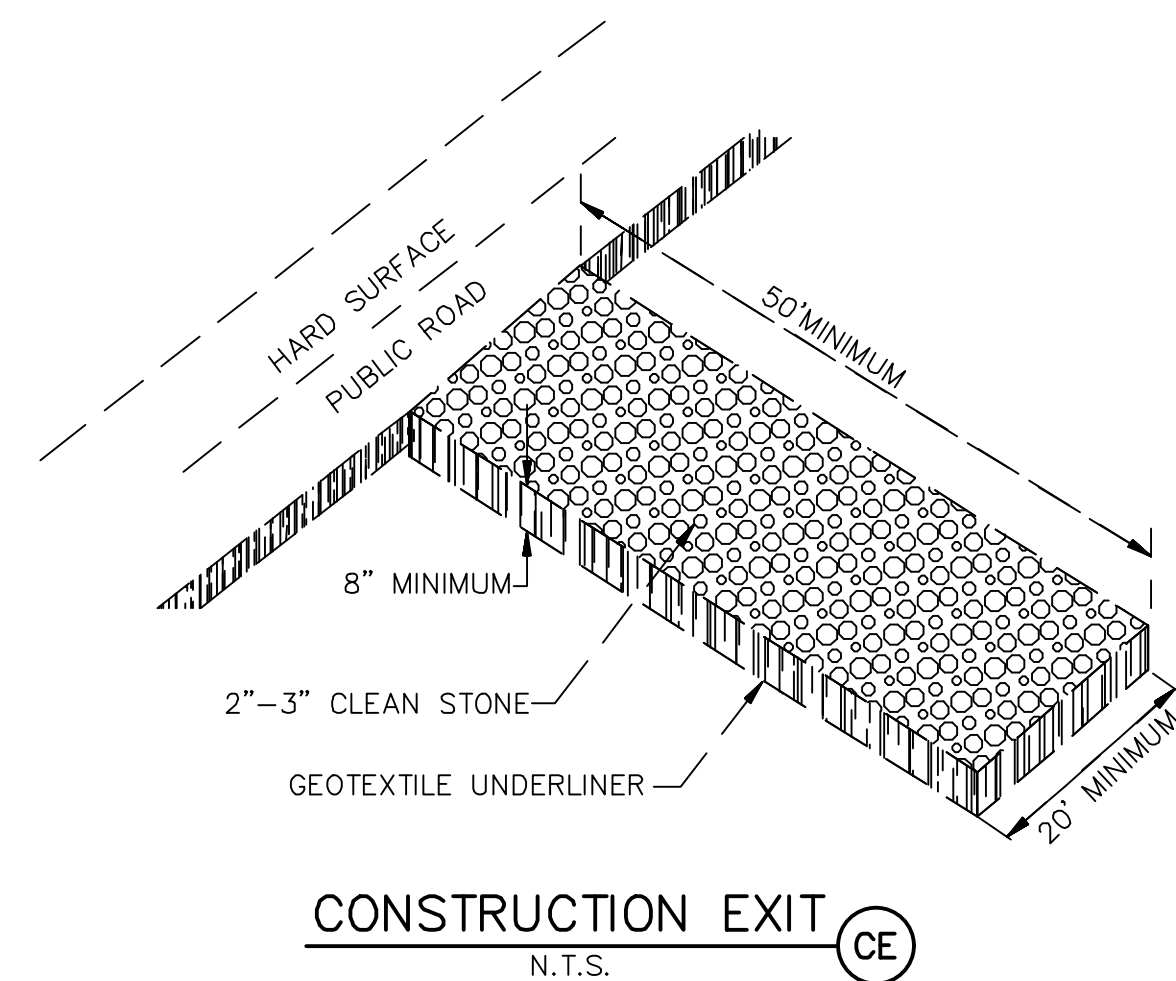[illegible][illegible]