


| SITE LEGEND                                                                         |                   |                                                                                     |                          |
|-------------------------------------------------------------------------------------|-------------------|-------------------------------------------------------------------------------------|--------------------------|
| SYMBOL                                                                              | SIGN              | SYMBOL                                                                              | SIGN                     |
|    | FIRE HYDRANT      |    | LIGHT POLE (2" DIA BASE) |
|    | WATER VALVE       |   | BOLLARD                  |
|  | SAS MANHOLE       |  | WATER LINE               |
|  | TELEPHONE MANHOLE |  | UNDERGROUND POWER LINE   |
|                                                                                     |                   |  | GAS LINE                 |
|  | WATER METER       |  | SAS LINE                 |
|  | POWER POLE        |  | OVERHEAD POWER LINE      |

| FIRE DEPARTMENT DATA                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                  |  | OCCUPANCY TYPE-A2 |
|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--|-------------------|
| <ul style="list-style-type: none"> <li>• 1 STORY (±20'-0" TO 25'-0" MAXIMUM HEIGHT)</li> <li>• NON-SPRINKLERED (903.3.1.1)</li> <li>• CONSTRUCTION TYPE: V-B</li> <li>• FIRE AREA: 775 S.F. S.F.</li> </ul>                                                                                                                                                                                                                                                                                                                                                                                                           |  |                   |
| <p>1. FIRE HYDRANTS: PER IFC TABLE B105.2, VALUE IN TABLE B105.1(2) REQUIRED.</p> <p>1.1. TOTAL BUILDING AREA: 774 S.F. SF</p> <p>1.2. CONSTRUCTION TYPE: V-B</p> <p>1.3. REQUIRED FIRE FLOW: VALUE IN TABLE B105.1(2)</p> <p>1.4. VALUE IN TABLE B105.1(2) - 1,500 GPM</p> <p>2. REQUIRED: VALUE IN TABLE B105.1(2)</p> <p>2.1. (N/A - 25% OF VALUE IN SPRINKLERED BLDGS ONLY)</p> <p>3. REQUIRED # OF FIRE HYDRANTS PER TABLE C102.1:</p> <p>3.1. 1,750 OR LESS REQUIREMENT: 1 HYDRANT</p> <p>3.2. MAXIMUM SPACING FROM ANY POINT ON STREET TO HYDRANT: 250'</p> <p>3.3. MAXIMUM SPACING BETWEEN HYDRANTS: 500'</p> |  |                   |

REF. DRAWING NAME

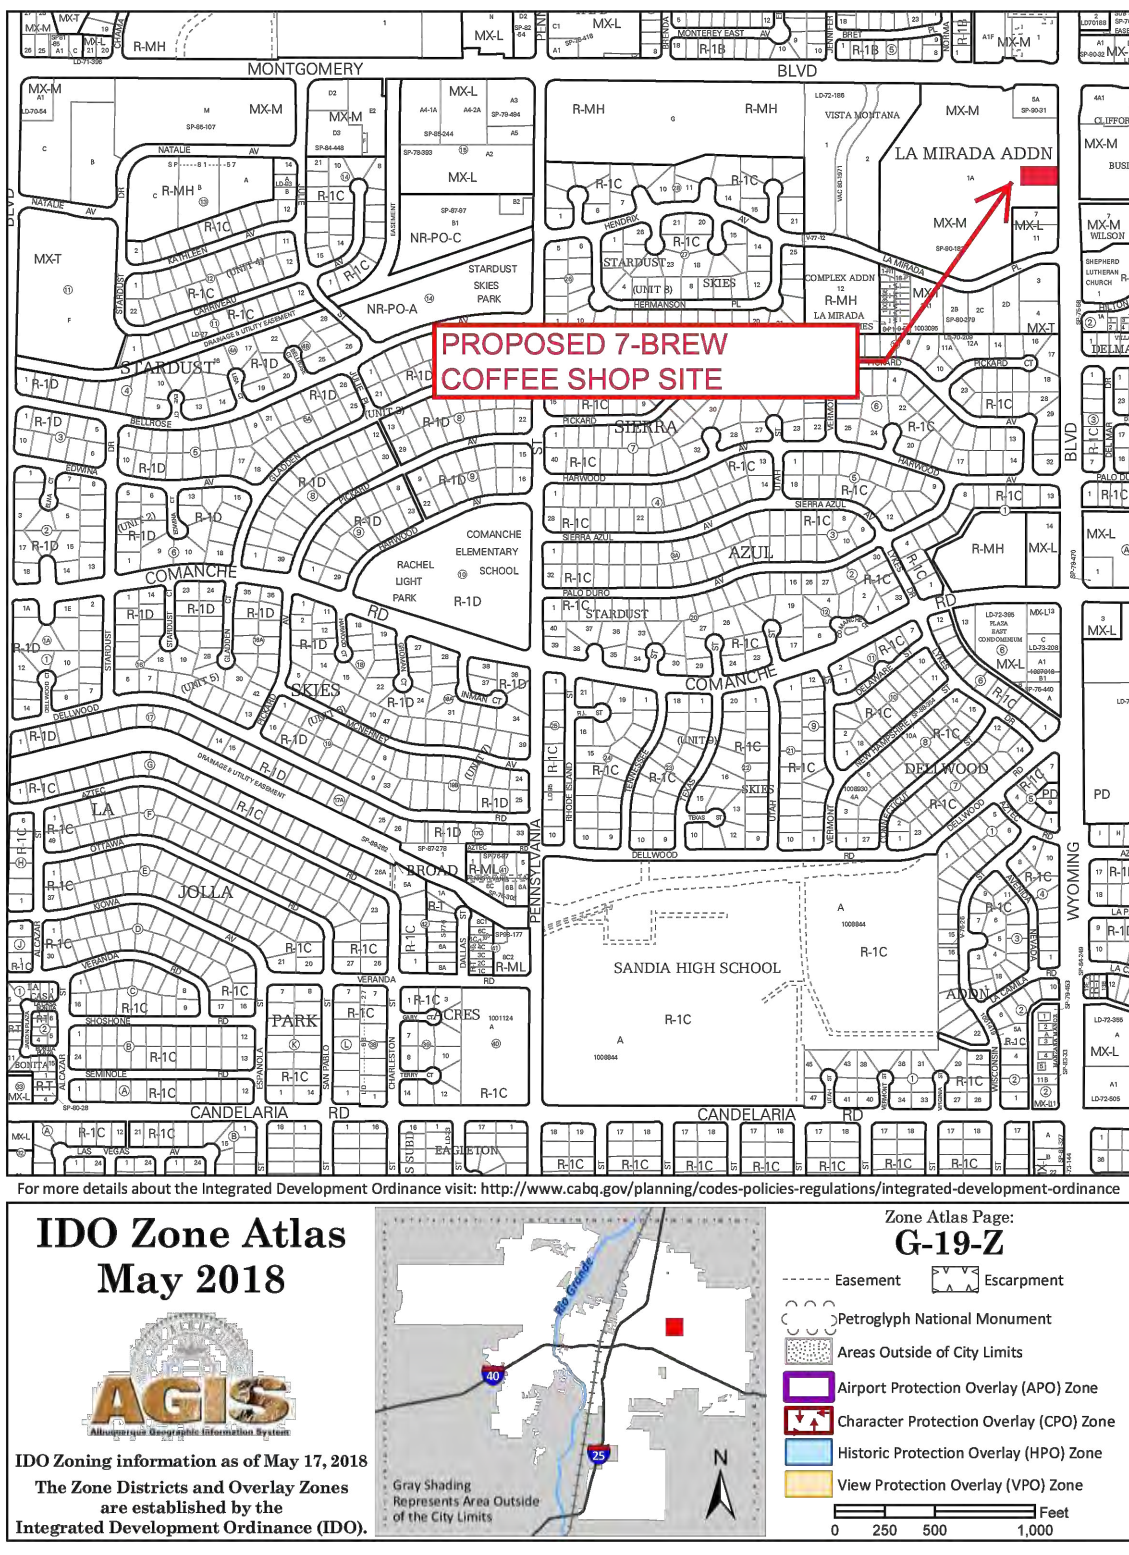

SHEET NO.

7-Brews Coffee  
4331 Wyoming Blvd. NE  
Albuquerque NIM

Fire 1

