



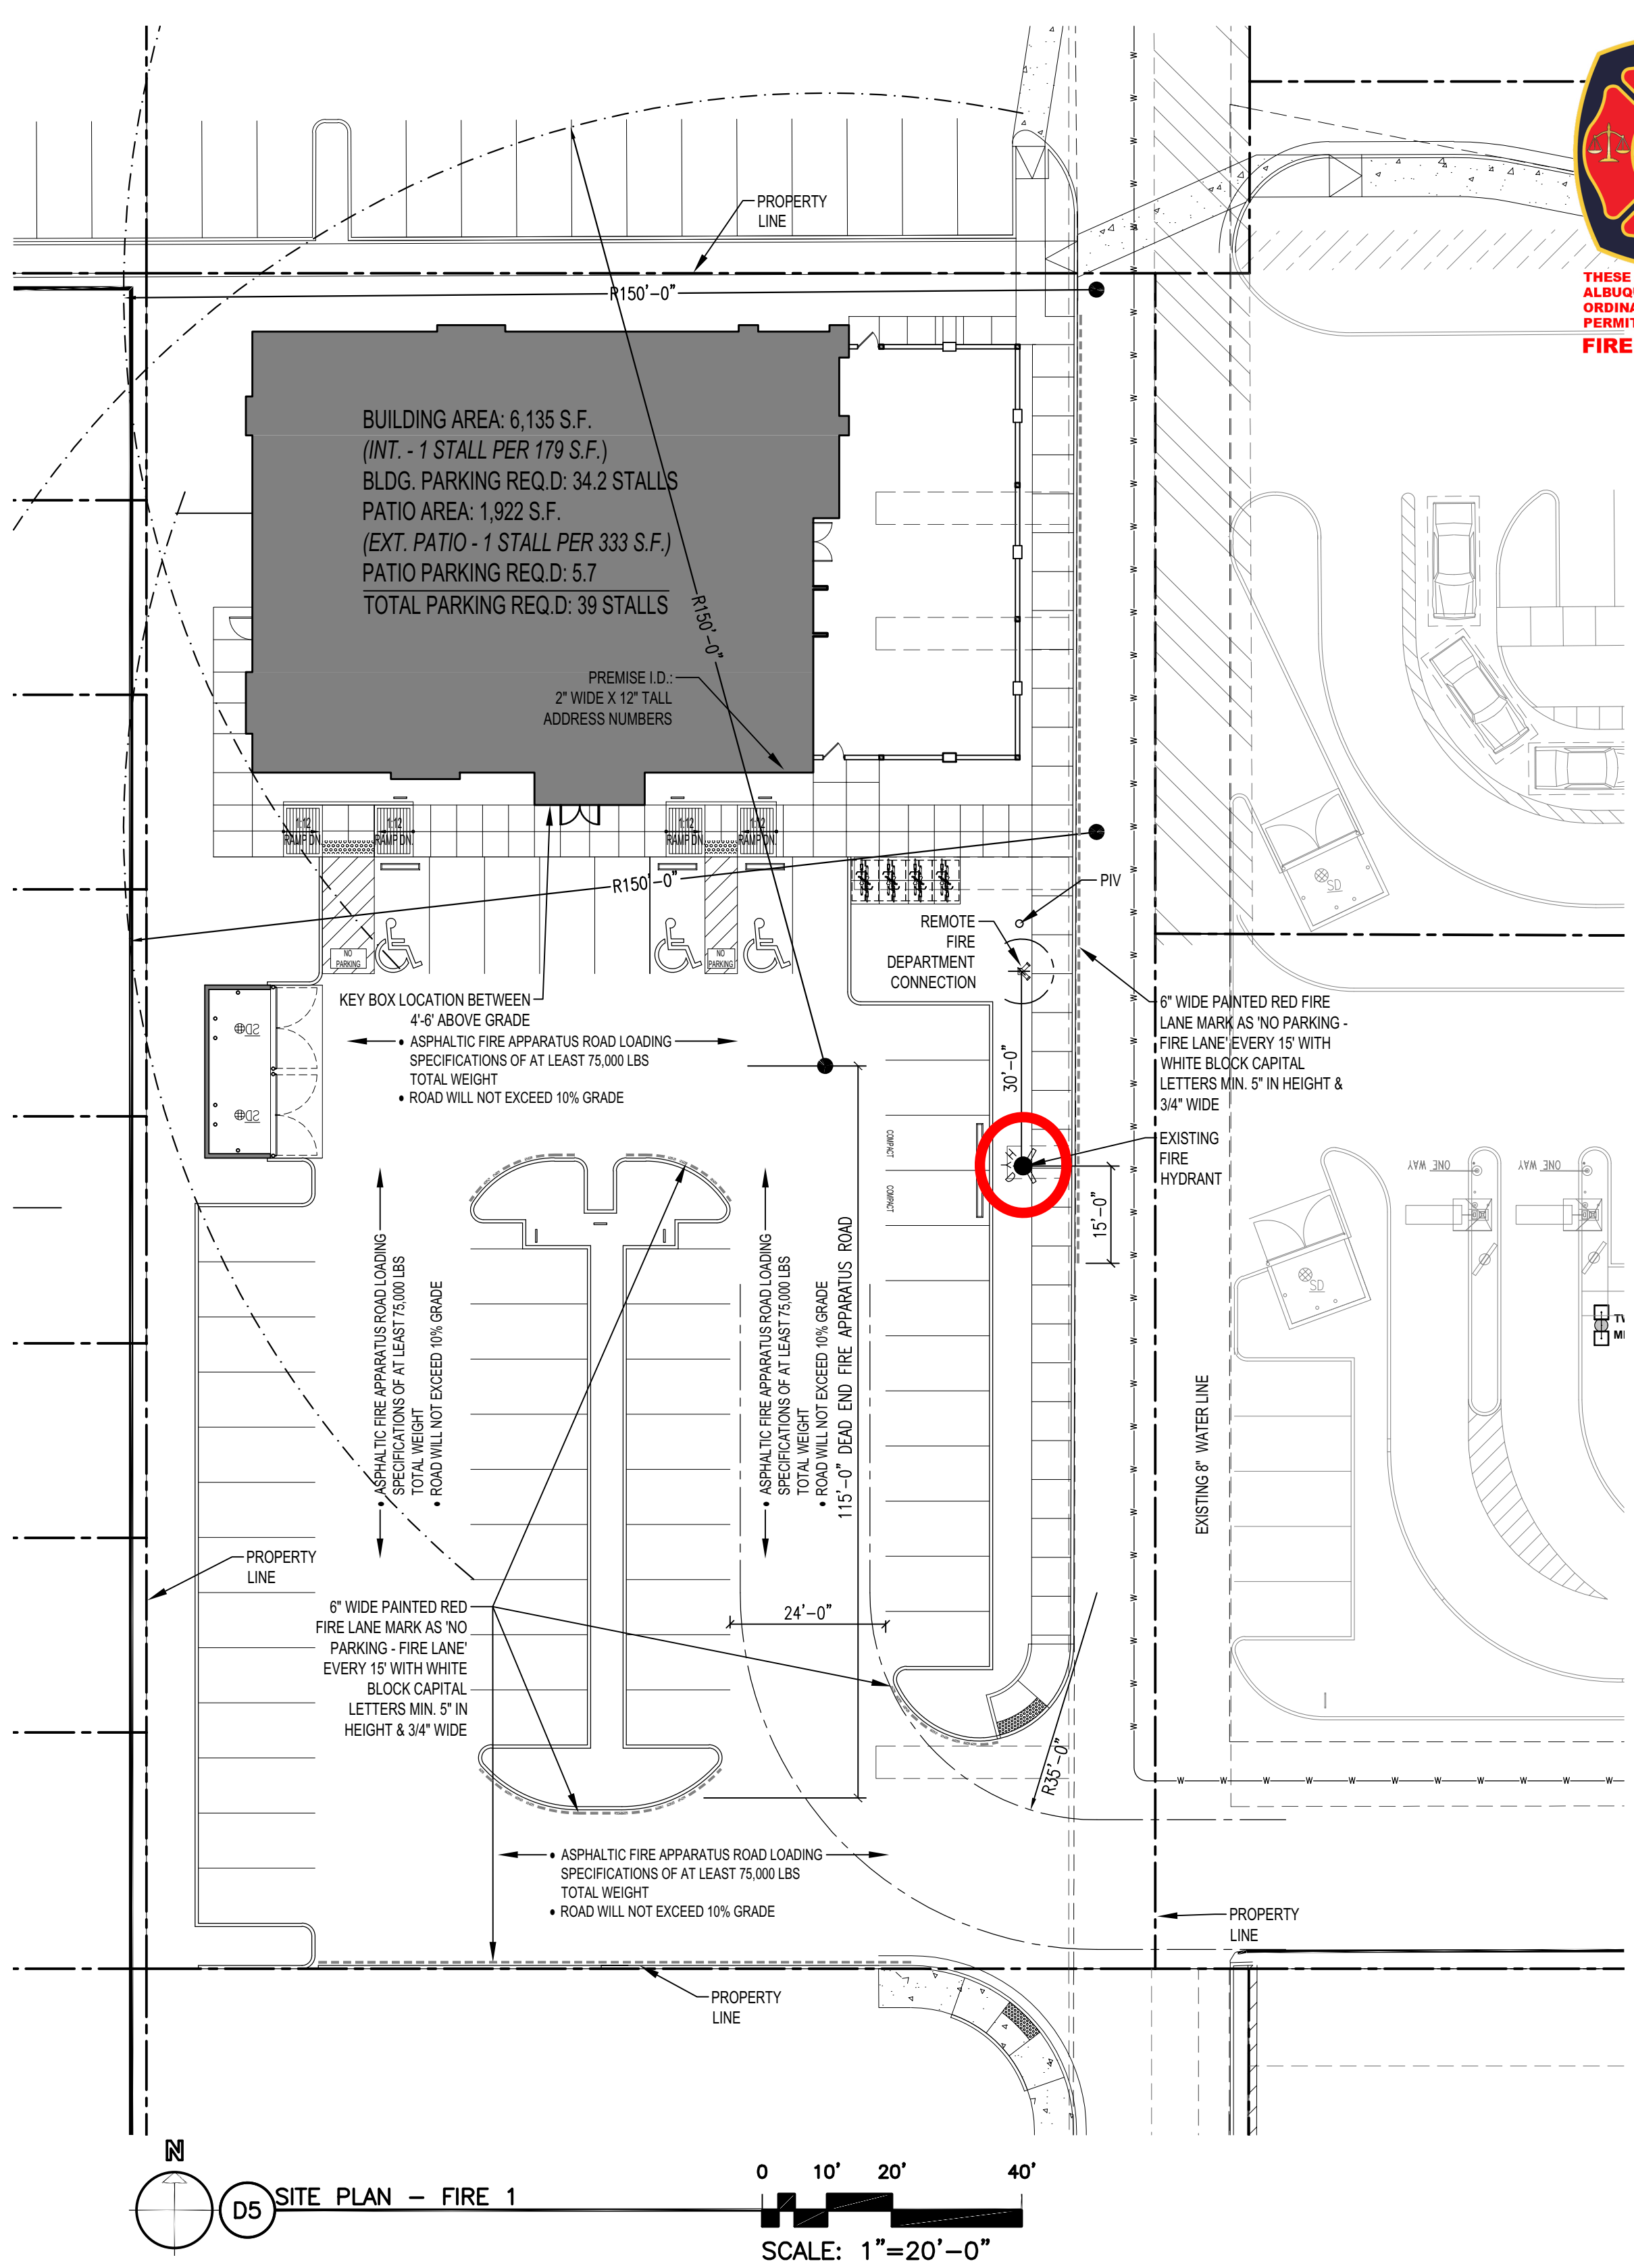

SITE LEGEND			
[Symbol]	SIGN	[Symbol]	LIGHT POLE (2' DIA BASE)
[Symbol]	FIRE HYDRANT	[Symbol]	BOLLARD
[Symbol]	WATER VALVE	[Symbol]	WATER LINE
[Symbol]	SAS MANHOLE	[Symbol]	UNDERGROUND POWER LINE
[Symbol]	TELEPHONE MANHOLE	[Symbol]	GAS LINE
[Symbol]	WATER METER	[Symbol]	SAS LINE
[Symbol]	POWER POLE	[Symbol]	OHL - OVERHEAD POWER LINE
[Symbol]	EXISTING LINE OF ASPHALT	[Symbol]	UTILITY EASEMENT

FIRE DEPARTMENT APPROVAL PLAN - NOT FOR CONSTRUCTION
(CONTRACTOR NOTE: ELEMENTS OF THIS DRAWING ARE INCORPORATED IN SITE PLAN A001 WHICH IS TO BE USED FOR CONSTRUCTION)

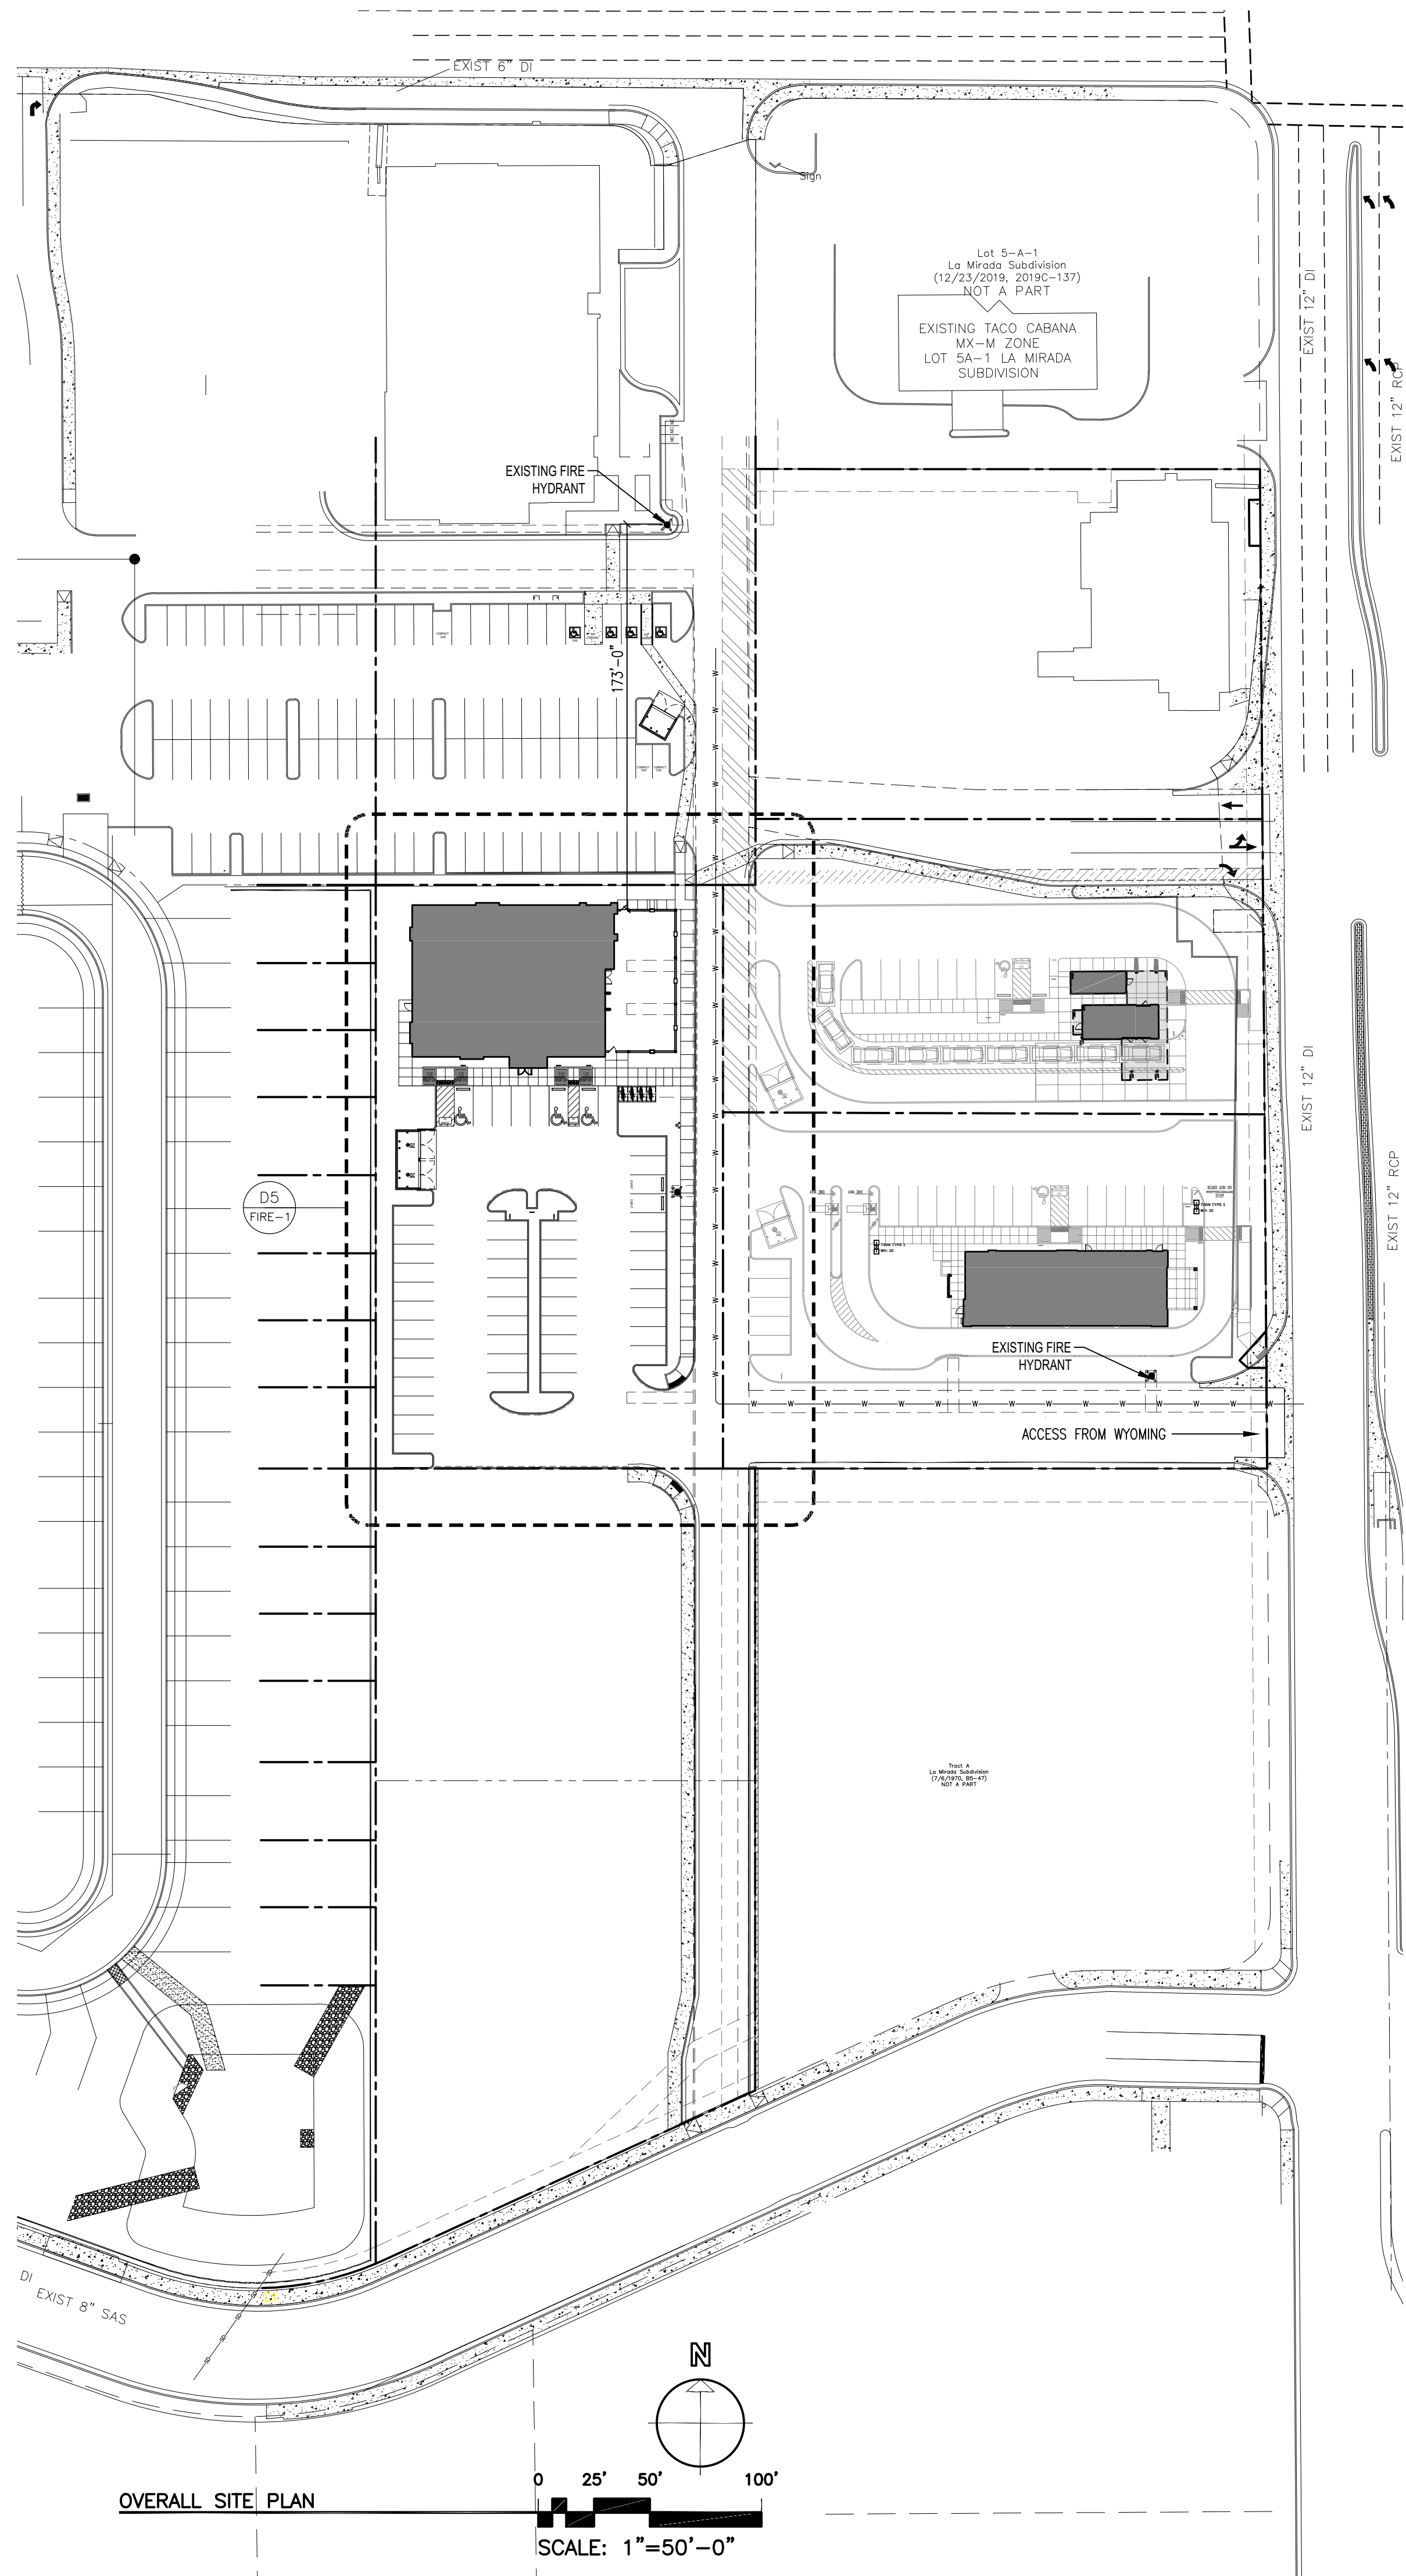

**ALBUQUERQUE FIRE MARSHAL'S
DIVISION OFFICE PLANS
CHECKING DIVISION**
PERMIT
PERMIT NUMBER: EP-24-020624
APPROVED DATE: 07/16/24
APPROVED
THESE CONSTRUCTION DOCUMENTS WERE REVIEWED AND APPROVED BY THE
ALBUQUERQUE FIRE MARSHAL'S OFFICE IN ACCORDANCE WITH THE CITY
ORDINANCE, THE INTERNATIONAL FIRE CODE, AND NFPA STANDARDS. THIS
PERMIT IS VALID FOR 180 DAYS. FINAL INSPECTION IS REQUIRED.
FIRE FLOW: 1750 GPM, 1 HYDRANT. VB

FIRE DEPARTMENT DATA		OCCUPANCY TYPE: A2 (RESTAURANT)
• 1 STORY (+30'-0" MAXIMUM HEIGHT)		
• SPRINKLERED (903.3.1.1)		
• CONSTRUCTION TYPE: V-B		
• FIRE FLOW CALCULATION AREA: 8,057 S.F.		
1. FIRE HYDRANTS: PER IFC TABLE B105.2, VALUE IN TABLE B105.1(2) REQUIRED.		
1.1. TOTAL BUILDING AREA: 8,057 S.F.		
1.2. CONSTRUCTION TYPE: V-B		
1.3. REQUIRED FIRE FLOW: VALUE IN TABLE B105.1(2)		
1.4. VALUE IN TABLE B105.1(2) ~ 2,500 GPM		
1.5. FIRE FLOW DURATION: 2 HRS		
2. REQUIRED: VALUE IN TABLE B105.1(2)		
2.1. (50% OF VALUE IN SPRINKLERED BLDGS ONLY)		
3. REQUIRED # OF FIRE HYDRANTS PER TABLE C102.1:		
3.1. 1,750 OR LESS REQUIREMENT:	1 HYDRANT	
3.2. MAXIMUM SPACING FROM ANY POINT ON STREET TO HYDRANT: 250'		
3.3. MAXIMUM SPACING BETWEEN HYDRANTS: 500'		

