



December 27, 2025

Anthony Montoya, Jr., P.E.  
Senior Engineer, Hydrology  
Planning Department, Development Review Services


RE: RESPONSE TO COMMENTS DATED September 22, 2025

Please consider the following responses that were incorporated with this revised plan to address your comments:

1. See the attached approved DHO waiver #PR-2019-002186 dated December 3, 2025 that does not require curb/gutter and sidewalk.
2. The Benchmark information is now shown on the drawing, COA Control Station 3-G12 NAD83 with Elevation = 4965.946 us ft NAVD 1988 for establishing the contour information.
3. The pond bottom area, top area are now shown as dashed contour lines along with a note regarding the pond depth have now been included.
4. As we discussed and agreed per our telephone call back in September, the site drainage has been designed to contain the 100 year – 10 day storm for the proposed impervious conditions, there will no impact to downstream conditions.

If you should have any questions, please do not hesitate to call me at 505-480-8125.

Sincerely,

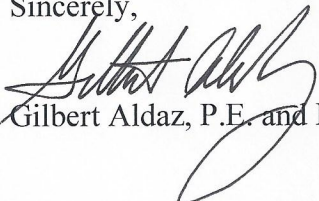

Gilbert Aldaz, P.E. and P.S.