
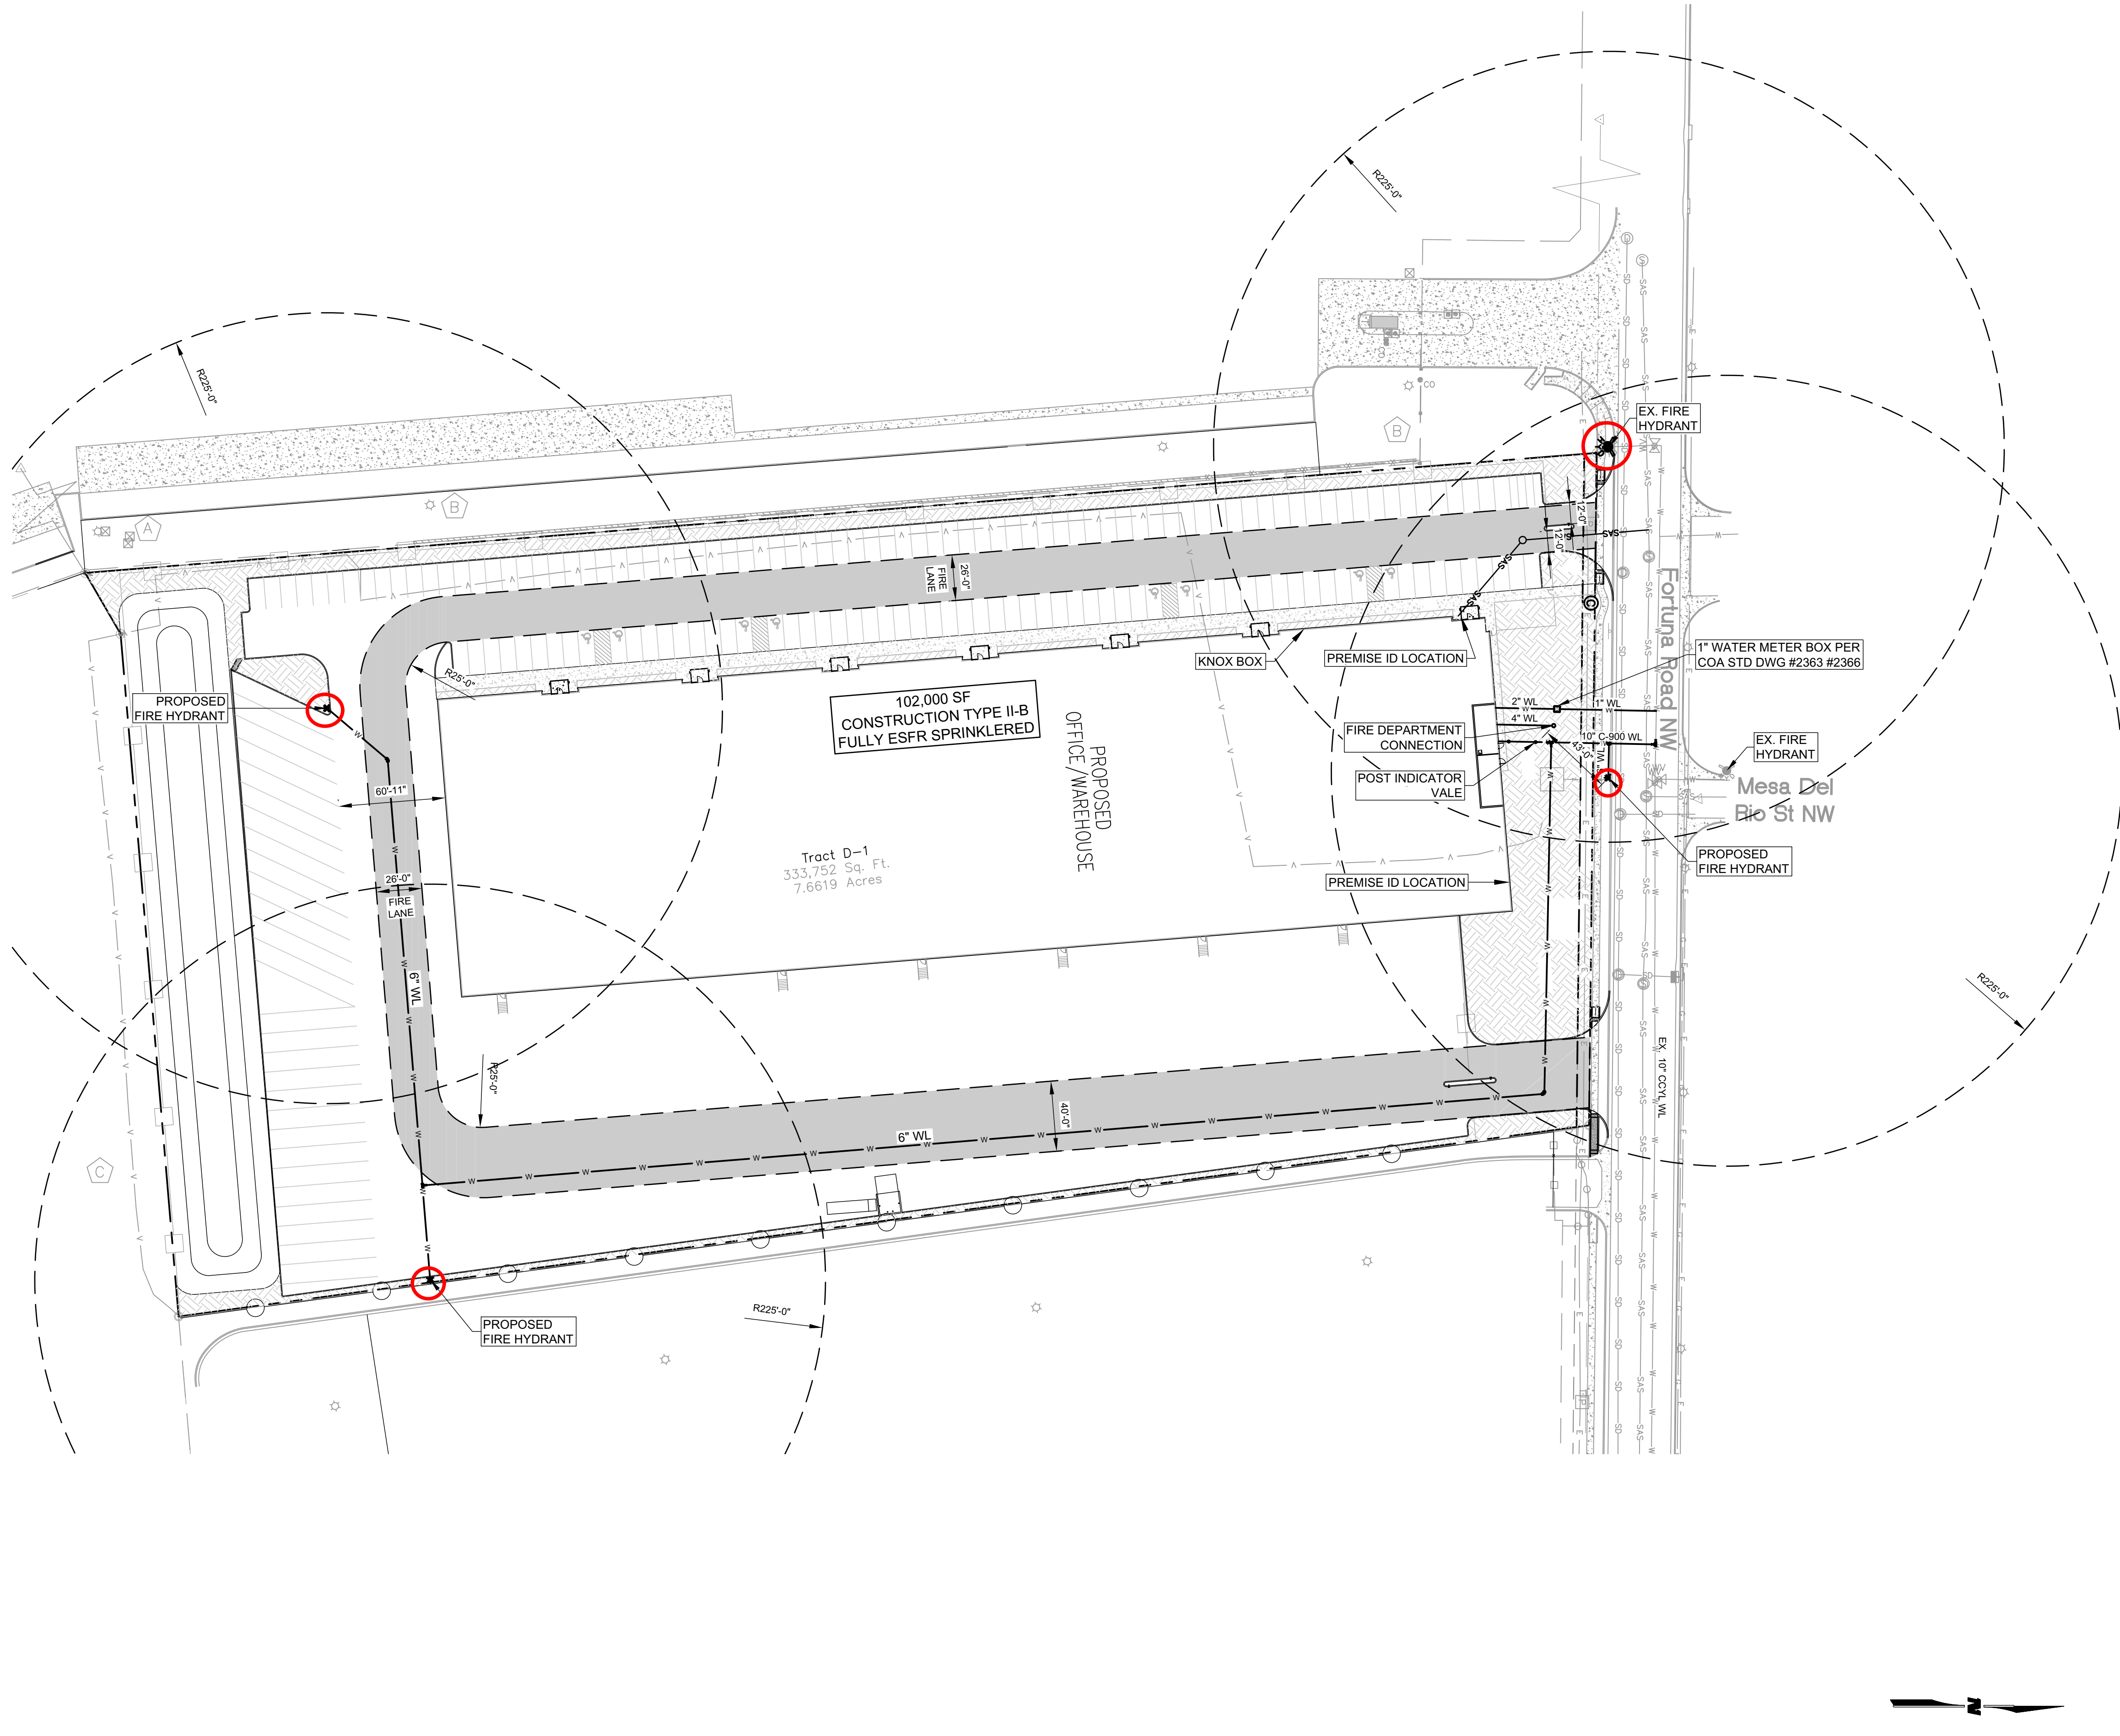


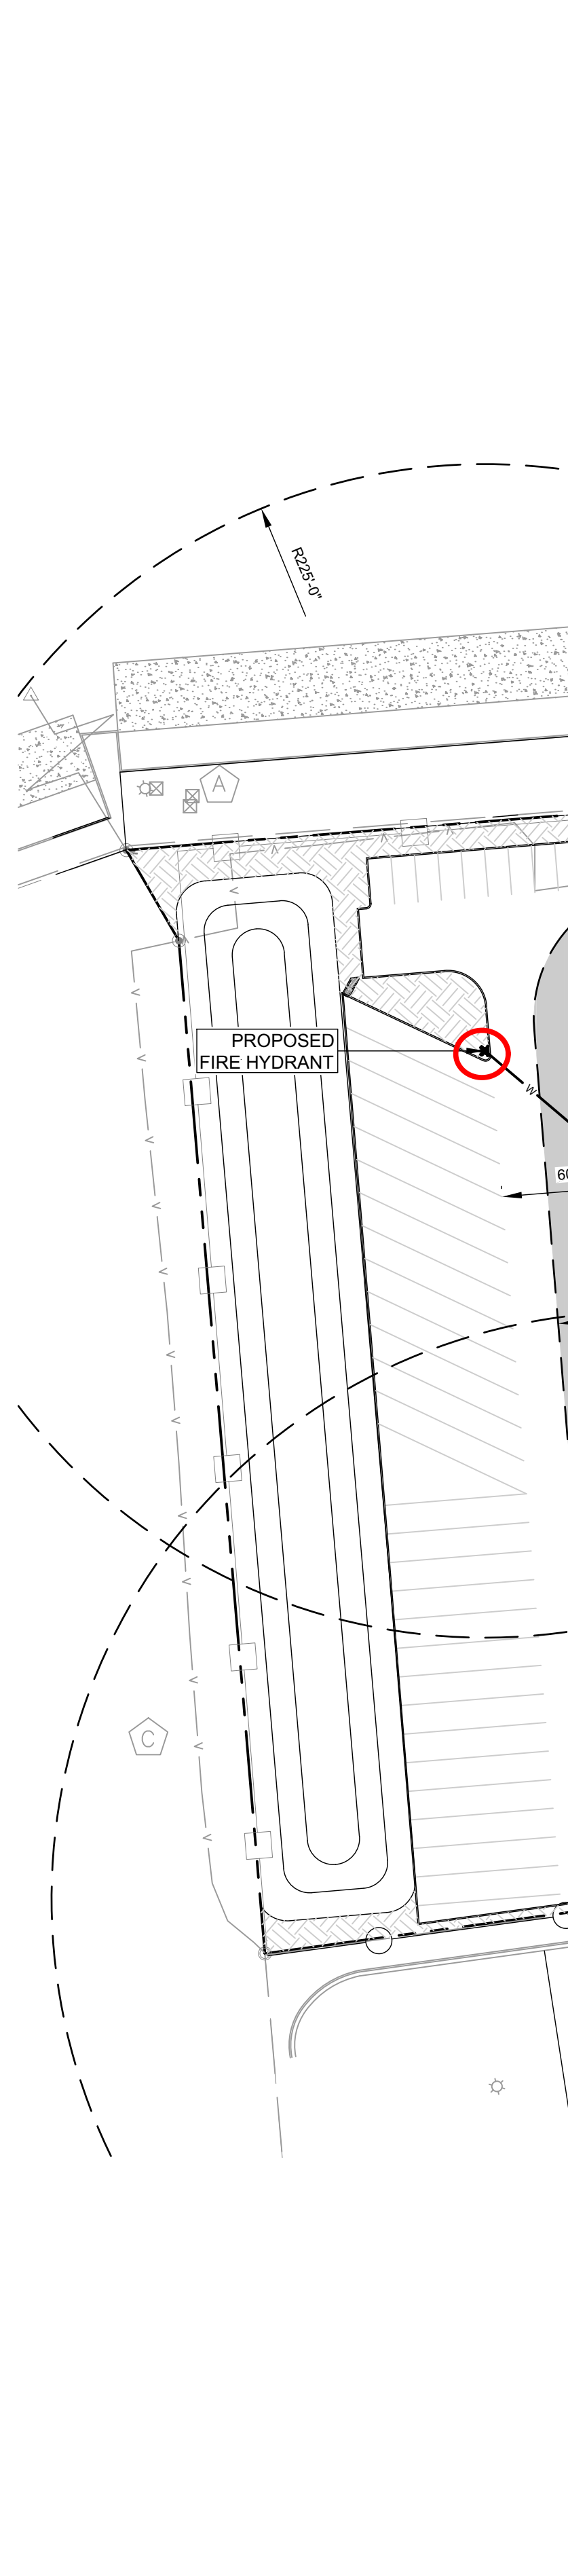

**ALBUQUERQUE FIRE MARSHAL'S
OFFICE PLANS
CHECKING DIVISION**

SUBJECT: **PERMIT**
SUSPENDED BY: [REDACTED] WILL BE CLEARLY DESIGNATED AND
ON FIRE MARSHAL'S OFFICE PLANS.

PERMIT NUMBER: FP-22-011123
ION TYPE: UL-B CULY ESFR SPRINKLERED.
APPROVED DATE: 09/02/22

APPROVED

GATES SOURCE FOR INFORMATION ON THE CROSS FIRE
HALL CORRIDORS CRIMINAL APPARATUS ACCESS SHALL
BE IN MEANS OF RECORD TO ALLOW FIRE DEPARTMENT
ITS FP-3375

5. ALL DRIVING SURFACES SHALL BE ASPHALT OR CONCRETE.
6. FIRE APPARATUS ROAD DIMENSIONS: FIRE APPARATUS ROADS SHALL HAVE AN UNOBSTRUCTED WIDTH NOT LESS THAN 20 FEET AND AN UNOBSTRUCTED HEIGHT NOT LESS THAN 13 FEET 6 INCHES. THEY SHALL HAVE AN UNOBSTRUCTED WIDTH NOT LESS THAN 26 FEET IN WIDTH WHEN FIRE DEPARTMENT ACCESS ROAD EXCEEDS 300 FEET.
7. ACCESS AND LOADING: AN APPROVED FIRE APPARATUS ACCESS ROADS SHALL HAVE AN ASPHALT, CONCRETE, OR OTHER APPROVED DRIVING SURFACE CAPABLE OF SUPPORTING THE IMPOSED LOAD OF FIRE APPARATUS WEIGHING AT LEAST 75,000 POUNDS.
8. ENGINEERING DATA: ENGINEERING DATA SHALL BE SUBMITTED TO SUBSTANTIATE WEIGHT BEARING CAPACITY AND ALL WEATHER DRIVING CAPABILITIES FOR FIRE APPARATUS ACCESS ROADS.
9. GRADE: FIRE APPARATUS ACCESS ROADS SHALL NOT EXCEED 10 PERCENT IN GRADE.
10. SECURITY GATES: SECURITY GATES THAT EXTEND ACROSS FIRE APPARATUS ACCESS ROADS OR IMPEDE FIRE APPARATUS ACCESS SHALL HAVE AN APPROVED MEANS OF OPERATION TO ALLOW FIRE DEPARTMENT ACCESS.

WILSON
& COMPANY

4401 WASTHEAD ST. NE., SUITE 150
ALBUQUERQUE, NM 87109
PHONE: 505-348-4000
FAX: 505-348-4055
www.wilsonco.com

CONSULTANTS

SEAL

XX% SUBMITTAL
NOT FOR
CONSTRUCTION

PROJECT NAME
NEW OFFICE/WAREHOUSE
FOR BRUNACINI DEVELOPMENT
7500 FORTUNA RD, NW
ALBUQUERQUE, NM 87121

[illegible]

PROJECT NO:	22-600-285-00
DESIGNED BY:	JEL
DRAWN BY:	DY
CHECKED BY:	JEL
DATE:	AUGUST 2022
SHEET TITLE	

FIRE 1 PLAN

SHEET NO:
C-102