


GENERAL NOTES:

1. THE CITY DOES NOT ACCEPT RESPONSIBILITY FOR MAINTENANCE FOR ANY DRAIN LINES INSTALLED BY OR FOR PRIVATE PROPERTY OWNERS.
2. FOR DOUBLE "C" OR "D" STORM INLETS THE PRIVATE DRAIN LINE CONNECTION MUST BE ALIGNED WITH THE LONGITUDINAL CENTER OF EITHER GRATE FRAME.


CONSTRUCTION NOTES:

- A. CORE DRILL INTO BACK OF EXIST. CATCH BASIN WITH INVERT OF DRILLED OPENING 2" ABOVE EXIST. CONC. FILL. GROUT WITH NONSHRINK, NONMETALLIC GROUT.
- B. NEW DRAIN LINE TO BE SCH. 40 P.V.C., REIN. CONC. OR DUCTILE IRON PIPE. DRAIN SIZE TO BE AT LEAST ONE SIZE SMALLER THAN OUTLET PIPE WITH A MAX. SIZE OF 12".
- C. EXIST. CONC. FILL.
- D. SLOPE .02 FT. PER FT. MIN. WITHIN R.O.W.
- E. FRAME & GRATE.

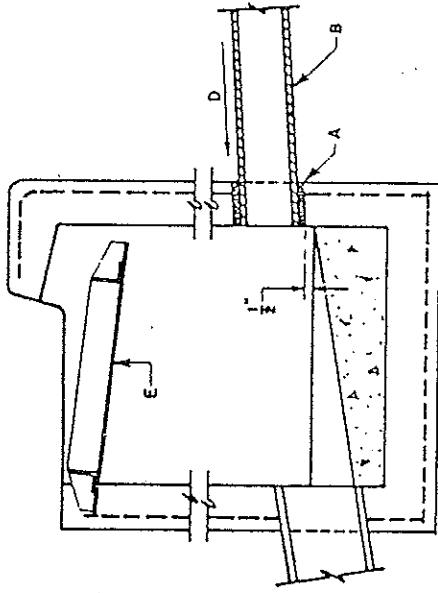


SECTION B-B

RECEIVED
MAY 18 1987
BUREAU OF
HYDROLOGY SECTION

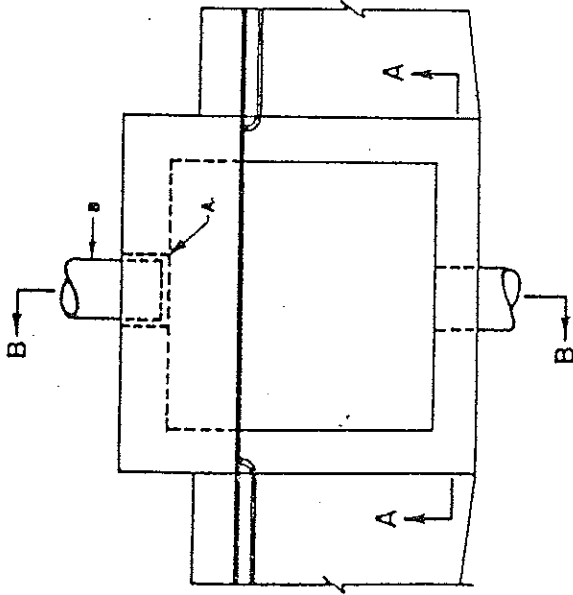

PLAN

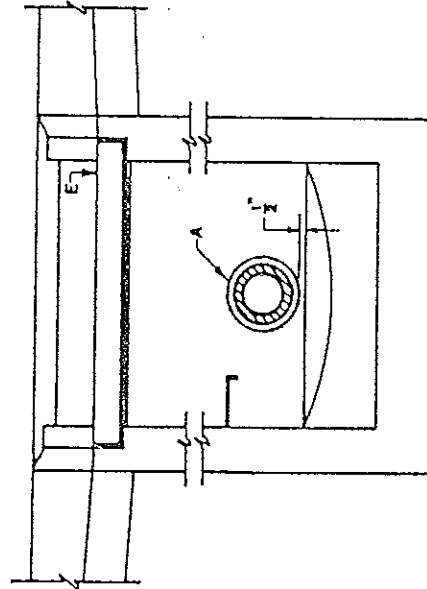

SECTION A-A

REVISIONS	CITY OF ALBUQUERQUE
	DRAINAGE DRAIN LINE CONNECTION TO EXIST. STORM INLET DWG. 2237
	AUG. 1986