


# CITY OF ALBUQUERQUE

Hydrology Section Planning Department  
David S. Campbell, Director



Timothy M. Keller, Mayor

March 4, 2019

Richard Stevenson  
Tierra West, LLC  
5571 Midway Park Place NE  
Albuquerque, NM, 87109

**RE: 1401 Wyoming Blvd NE - Maverick**  
**Grading Plan Engineer's Stamp Date: 2/25/2019**  
**Drainage Report Engineer's Stamp Date: 2/6/2019**  
**Hydrology File: J19D049**

Based upon the information provided in your submittal received 2/6/2019 and 2-25-2019 and the SWQV Payment in-lieu of \$4376.00, the Grading and Drainage Plan is approved for Building Permit, and/or Grading Permit.

PO Box 1293

Please attach a copy of this approved plan in the construction sets when submitting for a building permit. Prior to Certificate of Occupancy release, Engineer Certification per the DPM checklist will be required.

Albuquerque

NM 87103

As a reminder, if the project total area of disturbance (including the staging area and any work within the adjacent Right-of-Way) is 1 acre or more, then an Erosion and Sediment Control (ESC) Plan and Owner's certified Notice of Intent (NOI) is required to be submitted to the Stormwater Quality Engineer (Curtis Cherne, PE, [ccherne@cabq.gov](mailto:ccherne@cabq.gov), 924-3420) 14 days prior to any earth disturbance.

[www.cabq.gov](http://www.cabq.gov)

Please provide a Drainage Covenant for onsite inlets, storm drains, oil/water separator, and BMPs prior to Certificate of Occupancy. Please submit this on the 4th floor of Plaza de Sol with a \$25 check payable to Bernalillo County.

If you have any questions, please contact me at 924-3986 or e-mail [jhughes@cabq.gov](mailto:jhughes@cabq.gov).

Sincerely,

James D. Hughes, P.E.  
Principal Engineer, Planning Dept.



# City of Albuquerque

Planning Department  
Development & Building Services Division

## DRAINAGE AND TRANSPORTATION INFORMATION SHEET (REV 6/2018)

**Project Title:** Maverik- 1401 Wyoming Blvd. **Building Permit #:** \_\_\_\_\_ **Hydrology File #:** J19D049  
**DRB#:** \_\_\_\_\_ **EPC#:** \_\_\_\_\_ **Work Order#:** \_\_\_\_\_  
**Legal Description:** \_\_\_\_\_  
**City Address:** 1401 Wyoming Blvd. NE Albuquerque NM 87112

**Applicant:** Tierra West, LLC **Contact:** Richard Stevenson  
**Address:** 5571 Midway Park Place NE Albuquerque NM 87109  
**Phone#:** 505-858-3100 **Fax#:** 505-858-1118 **E-mail:** rstevenson@tierrawestllc.com

**Other Contact:** \_\_\_\_\_ **Contact:** \_\_\_\_\_  
**Address:** \_\_\_\_\_  
**Phone#:** \_\_\_\_\_ **Fax#:** \_\_\_\_\_ **E-mail:** \_\_\_\_\_

**TYPE OF DEVELOPMENT:** \_\_\_\_\_ PLAT (# of lots) \_\_\_\_\_ RESIDENCE \_\_\_\_\_ DRB SITE ☒ ADMIN SITE

IS THIS A RESUBMITTAL? ☒ Yes \_\_\_\_\_ No

**DEPARTMENT** \_\_\_\_\_ TRANSPORTATION ☒ HYDROLOGY/DRAINAGE

Check all that Apply:

### TYPE OF SUBMITTAL:

- ☐ ENGINEER/ARCHITECT CERTIFICATION
- ☐ PAD CERTIFICATION
- ☐ CONCEPTUAL G & D PLAN
- ☒ GRADING PLAN
- ☒ DRAINAGE REPORT
- ☐ DRAINAGE MASTER PLAN
- ☐ FLOODPLAIN DEVELOPMENT PERMIT APPLIC
- ☐ ELEVATION CERTIFICATE
- ☐ CLOMR/LOMR
- ☐ TRAFFIC CIRCULATION LAYOUT (TCL)
- ☐ TRAFFIC IMPACT STUDY (TIS)
- ☐ STREET LIGHT LAYOUT
- ☐ OTHER (SPECIFY) \_\_\_\_\_
- ☐ PRE-DESIGN MEETING?

### TYPE OF APPROVAL/ACCEPTANCE SOUGHT:

- ☒ BUILDING PERMIT APPROVAL
- ☐ CERTIFICATE OF OCCUPANCY
- ☐ PRELIMINARY PLAT APPROVAL
- ☐ SITE PLAN FOR SUB'D APPROVAL
- ☐ SITE PLAN FOR BLDG. PERMIT APPROVAL
- ☐ FINAL PLAT APPROVAL
- ☐ SIA/ RELEASE OF FINANCIAL GUARANTEE
- ☐ FOUNDATION PERMIT APPROVAL
- ☐ GRADING PERMIT APPROVAL
- ☐ SO-19 APPROVAL
- ☐ PAVING PERMIT APPROVAL
- ☐ GRADING/ PAD CERTIFICATION
- ☐ WORK ORDER APPROVAL
- ☐ CLOMR/LOMR
- ☐ FLOODPLAIN DEVELOPMENT PERMIT
- ☐ OTHER (SPECIFY) \_\_\_\_\_

**DATE SUBMITTED:** 2/6/2019 **By:** Richard Stevenson

COA STAFF:

ELECTRONIC SUBMITTAL RECEIVED: \_\_\_\_\_

FEE PAID: \_\_\_\_\_

REV 2 DRAINAGE REPORT  
For



**Maverik Fuel Center**  
1401 Wyoming Blvd. NE  
Albuquerque, NM 87112

Prepared for:

Maverik, Inc.  
185 South State Street,  
Salt Lake City, Utah 84111

Prepared by:

Tierra West, LLC  
5571 Midway Park Place NE  
Albuquerque, New Mexico 87109

February, 2019

I certify that this report was prepared under my supervision, and I am a registered Professional Engineer in the State of New Mexico in good standing.



2/6/19

PAGE LEFT BLANK

**TABLE OF CONTENTS**

**Contents**

Purpose.....	1
Location and Background .....	2
Flood Plain .....	4
Calculations .....	5
Existing Developed Conditions .....	5
Proposed Conditions.....	7
Stormwater Quality Volume Management .....	9
Post Construction Maintenance Responsibility .....	9
Summary.....	10

**Appendices**

Drainage Basin Maps & Hydrology Tables/Calculations.....	APPENDIX A
--	------------


PAGE LEFT BLANK

## Purpose

The purpose of this report is to outline the Drainage Plan and present a solution for the re-development of two parcels to be a Maverik Gas Station and Convenience Store. The site will consist of a single-story 4,300 square foot c-store with ten gasoline refueling pumps for passenger vehicles users. The parcels will not be consolidated and therefore a cross access and drainage easement for the benefit of both tracts will be granted for each tract by the Plat. No truck refueling is proposed.

This report outlines the developed flows associated in redeveloping the 0.969 acre site and describes the on-site surface improvements needed to safely convey the developed flows. As the site is a gas station with fueling activities, the design is required to demonstrate control of oil from vehicle refueling areas and will be addressing the 80<sup>th</sup> percentile flows from the site. These provisions are included in the proposed drainage solution.

In the pre-submittal meeting with Hydrology, the City indicated that adequate downstream capacity and will not be required to be verified.

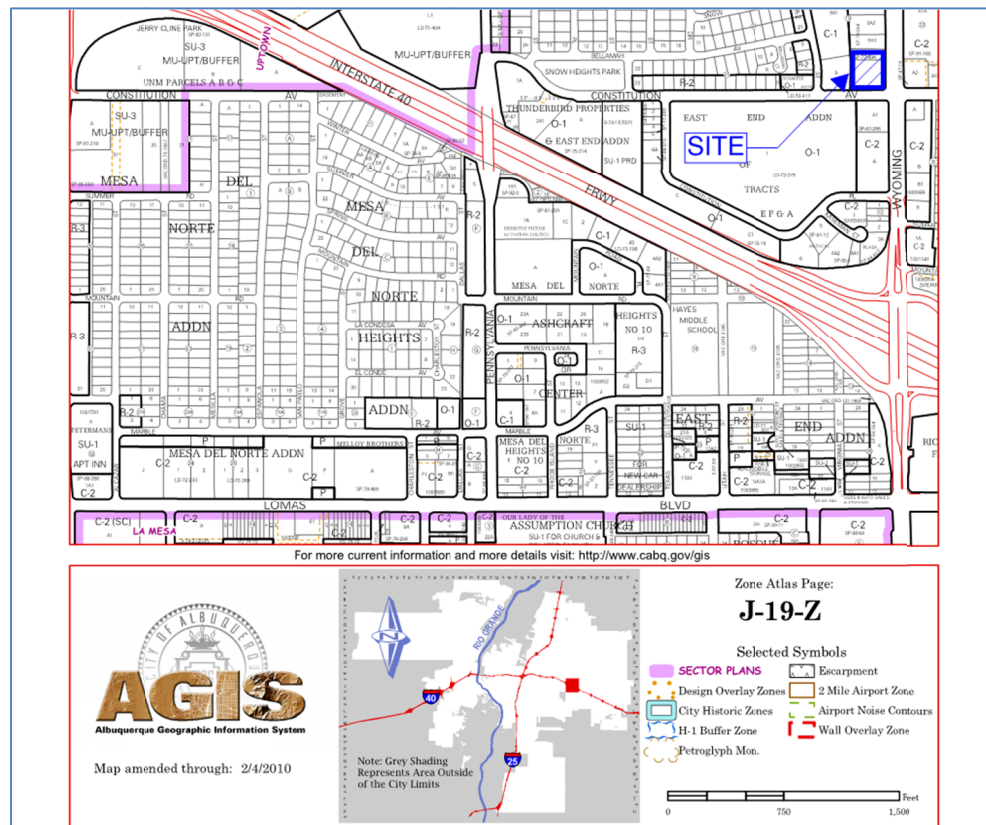


**Exhibit A – Vicinity Map**

## Location and Background

The site is located on the northwest corner of Constitution Ave. and Wyoming Blvd. The address of the parcels is 1401 and 1415 Wyoming Blvd. NE, Albuquerque, NM 87112. The proposed redevelopment will occur across two lots legally described as being a portion of Lot 9, Block 18 of the Snow Heights Addition to the City of Albuquerque, New Mexico. Both parcels are developed with a 3,000 sq-ft single story abandoned (Circle K) gas & c-store on the southern lot, and a 4,800 sq-ft commercial building (Café Istanbul) on the northern lot. The site Hydronium number is J19D049. The site is bordered to the south by Constitution Ave, Wyoming Blvd to the east, commercial buildings to the north and mixed use office & commercial to the west.

Both parcels in their current developed condition do not have any storm water facilities or water quality features and are 95 percent impervious. The sites redesign calls for a similar drainage route to the current drainage flow. Approximately 60% of the current site is drained by sheet flow discharging into Constitution Ave. through the easterly most driveway entrance. The balance of the site either sheet flows through the second driveway entrance at the alleyway ingress/egress location on Constitution Ave. or flows to the west into the adjacent commercial lot paved parking area. There is no storm drain in Constitution Ave. along the street frontage of the site.

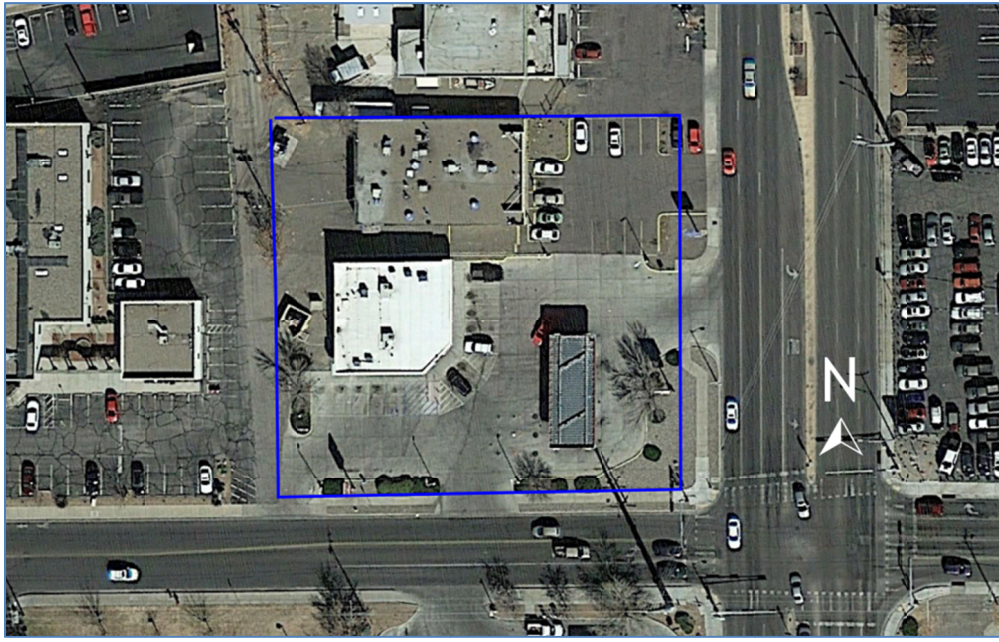


**Exhibit B – Site Aerial Image**

Runoff which sheet flows into Constitution Ave. are conveyed via the gutter system for approximately 2,200 lineal feet west to an existing stack of grate inlets at the intersection of Constitution Ave. and Bellamah Ave.

The approved drainage design on record at the City with reference J19-DO49, prepared by Isaacson & Arfman, P.A is dated May 25, 1988 and outlines the drainage calculations for the gas & convenience store site using the rational method outlined in the DPM current at the time of submittal.

There is no grading or drainage plan on file for the commercial lot to the north. From site inspection the alley drains to the west and ponds in the parking lot of the commercial building directly west of the site as shown in Exhibit C. At a certain elevation additional runoff can surface flow from this low area into the Virginia Apartment parking lot to the north. Although it is not reference on the grading and drainage plan for this site, from a site inspection the topography permits the flow of runoff into the driveway for the apartments at which point the runoff sheet flows to Virginia St. Historically this is the direction of flow for the commercial lot based on existing topography.

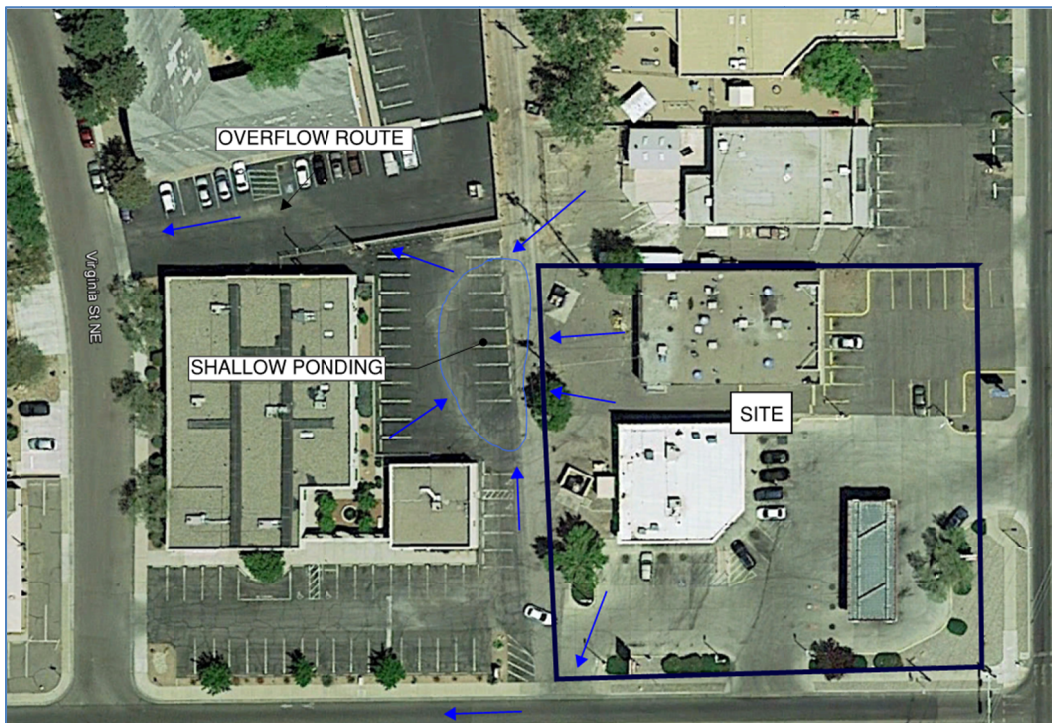


**Exhibit C – Historical Flows**

The approved paving permit which includes drainage and grading elevations for the Virginia St. Apartment Complex on record at the City has the reference J19-D63 prepared by Jeff Mortensen & Assoc., is dated October 25, 1988 and outlines the drainage calculations for the paving improvements. It does not reference any acceptance of offsite flows.

## Flood Plain

The floodplain information is published for the site by the Federal Emergency Management Agency (FEMA) Flood Insurance Rate Map (FIRM) for Bernalillo County, New Mexico and Incorporated Areas. The subject site is detailed on Community Panel Number 35001C0356H dated August 16, 2012 and is shown below.

The subject site is located within Flood Zone X, which is which is defined as, “Areas determined to be outside the 0.2% annual chance floodplain”. The site does not lie within a Flood Hazard Area as shown on the FEMA map requiring no further flood-proofing or other flood mitigation.

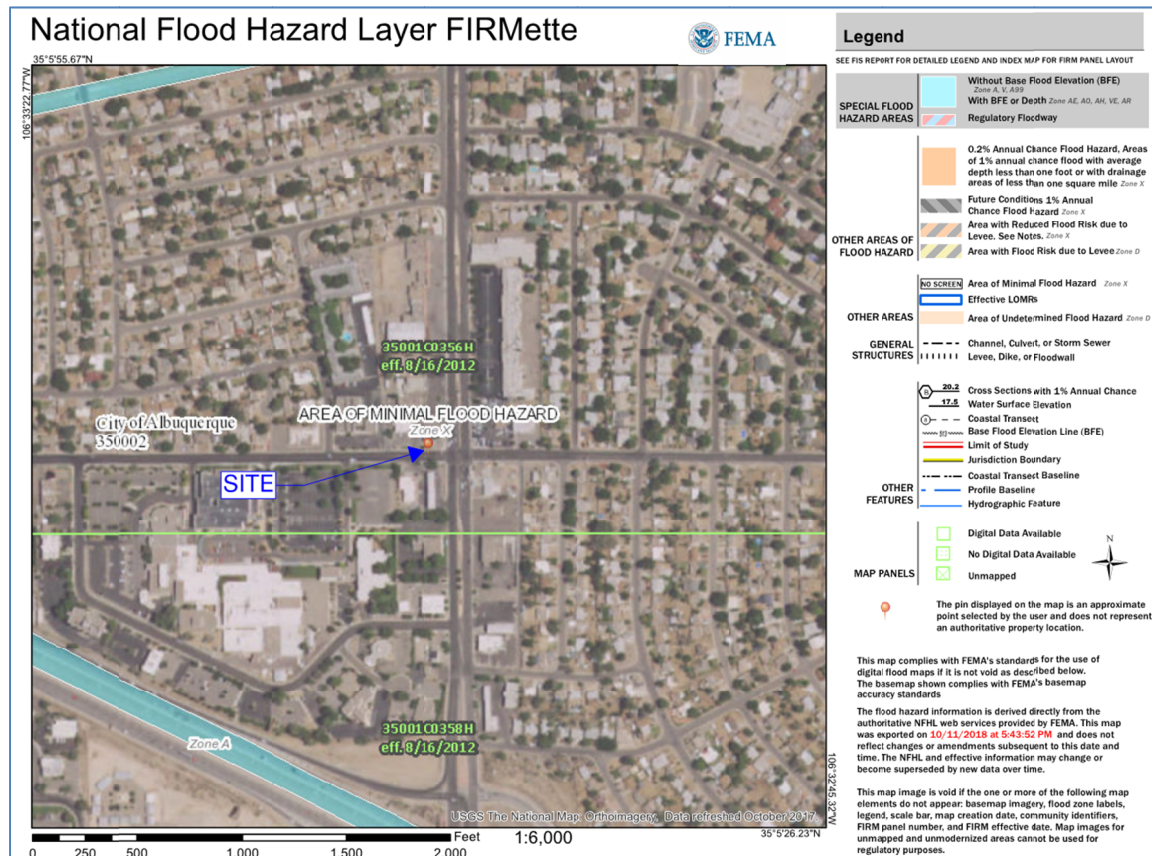

**Exhibit D – FIRM Map**

## Calculations

The site is located within Precipitation Zone 3, between San Mateo Blvd. and Eubank Blvd. as specified in Chapter 22, Section A.1 of the City of Albuquerque Development Process Manual Volume I – Design Criteria, 2006 Revision (DPM). The principal design storm is the 100-year 6 hour event. No detention basins or retention basins are proposed and therefore longer duration design storms are not considered in the calculations. As stated in the DPM in Chapter 22 Section A.2, the 100-year 6 hour event is 2.60 inches.

The appropriate land treatments A through D, as defined in the DPM Chapter 22 Section A.3, will be applied to the various pervious and impervious areas for the proposed re-developed site.

Excess precipitation is the depth of runoff remaining after the initial volume of rainfall retained on the surface and infiltration has been subtracted from the design storm hydrograph. The DPM defines the excess precipitation for the 100-year 6 hour event in Chapter 22 Table A-8 for Zone 2 with the corresponding land treatments.

A weighted excess precipitation rate is used to calculate the volume runoff as defined in the DPM Chapter 22 (a-5, a-6). The calculation requires the sum of excess precipitation multiplied by the corresponding treatment areas divided by the total area, multiplied by the weighted excess precipitation of the watershed area.

To determine the peak discharge for the re-development the corresponding treatment areas are multiplied by the peak rate for each treatment and sum to compute the total flow. The peak rates for the treatment areas are defined in the DPM Chapter 22 Table A-9 for the 100 year event.

As this site is a re-development the storm water quality volume is calculated based on the 0.48 inch storm. To calculate the required storm water quality volume to be captured and retained onsite, the impervious areas are multiplied by 0.26 inches for the 80th percentile storm.

## Existing Developed Conditions


The entire site is divided into four drainage basins; two onsite (B1 and B2) and two offsite basins (B3 and B4), consisting of Treatment B for the landscape areas and Treatment D for the impervious areas for the existing buildings and pavement areas.

The runoff and volume for the existing commercial lot north of the gas station (Basin B1) was calculated with all sheet flow entering the existing alley way and draining directly to the lot to the west, with a total runoff of 1.86 cfs. There is no drainage report for this parcel recorded with the

City. There is no landscaping across the parcel with Treatment D assigned for 100% of the area. Historically the runoff sheet flows to the alley way and ponds in the parking lot of the commercial site to the west of the parcel as discussed previously.

The peak discharge calculated for the gas station site (Basin B2) matches the approved peak discharge presented in the 1988 drainage plan for the parcel of ~2.7 cfs for the 100-year 6 hour event, as to be expected as the calculation methods listed in the DPM have not significantly changed over this time.

The only offsite flows that enter the site are generated from a 15-ft strip of pavement within the public ROW along Wyoming Blvd at the driveway entrance to the commercial site and a 15-ft landscape strip of public right-of-way between the property's east boundary and the back of the westerly curb (Basins B3 and B4 respectively). This flow amounts to 0.25 cfs and is added to the existing onsite flows. The runoff and volume calculations for the existing condition, based on the drainage criteria detailed in the DPM is included in appendix A.

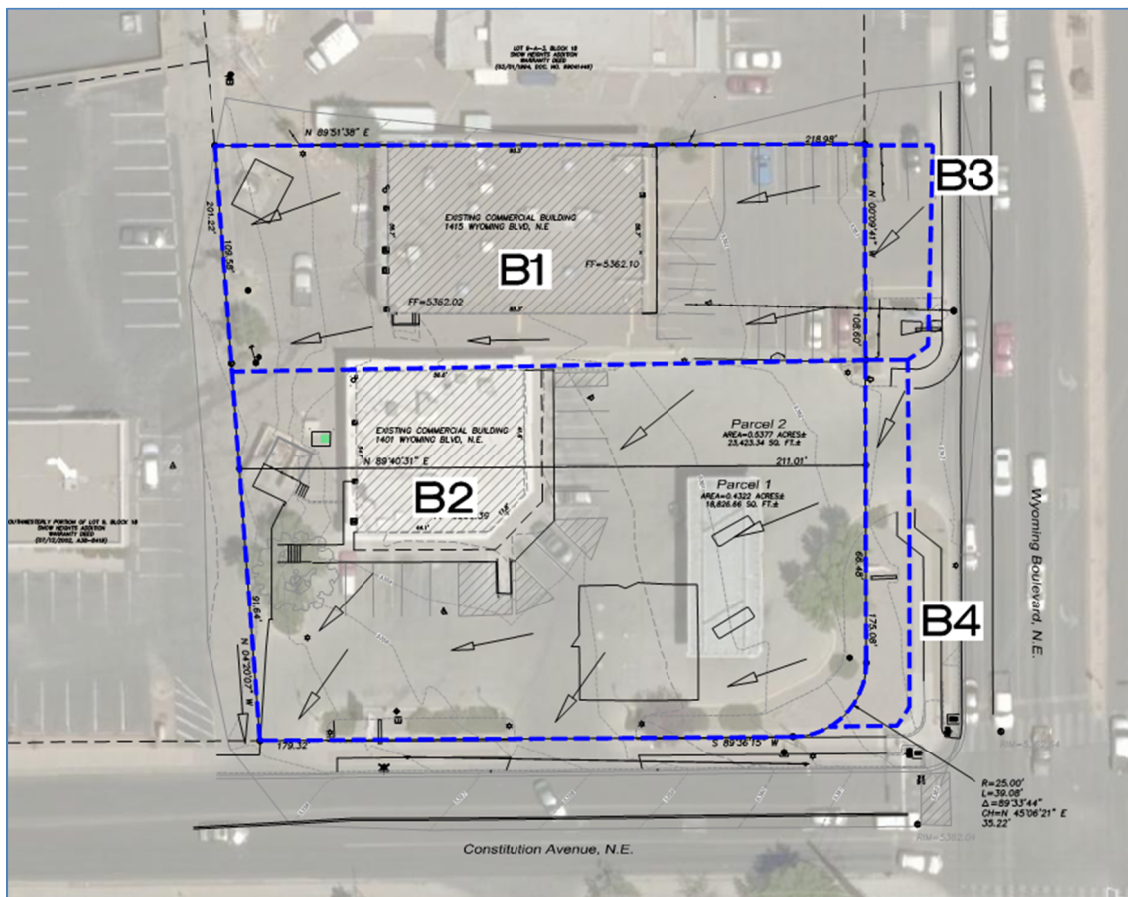

**Exhibit E – FIRM Map**

## Proposed Conditions

The developed site is divided into eight basins, with the offsite flows (Basins 6 and 7) included in the total developed discharge. There is one BMP surface Stormwater Quality volume (SWQV) pond proposed to capture a portion of the required volume, with the remaining volume allowed to freely discharge with a payment in lieu made for this volume. Included in the appendix are the calculations for the proposed site conditions. The expected total runoff from the site for the 100-year 6 hour event is 4.99 cfs with a volume of 0.193 ac-ft.

Roof drains are planned for the fuel canopy roof and c-store roof with the runoff collected and conveyed through 6-inch diameter storm drains that will discharge flows directly to the SWQV pond located in a landscape island, before additional flows discharge into Basin B2.

Per DPM Chapter 22.9.E, Table 1 all fueling stations must demonstrate control of oil from vehicle fueling areas. Basin B3 is the area covering the fueling bays. A trench drain is proposed on the west side of the fueling apron to capture all runoff generated from fuel spills or cleaning and maintenance, and flows south to the concrete oil water separator with a 450 gallon capacity. The oil water separator is a precast concrete vault that uses gravitational separation to improve the separation process of the oil water runoff which passes through before discharging to the SWQV pond. Included in the appendix is the oil water separator specification sheet. The proposed 450 gallon oil water separator is adequate to capture any major fuel spill/s that may occur during operations at the site. The detail specification for the oil water separator is included in the report appendix. The 450 gallon storage volume (60 cubic feet) is included in the summation of the stormwater quality volume for Basin B3.


For Basins B1 -4, which covers the impervious areas of the parking lot area, the drive isle and the building, the runoff sheet flows to the south west corner of the parcel similar to the historic drainage flows. This sheet flow discharges directly to Constitution Ave. and does not pass through any SWQV features (excluding the c-store roof area, canopy roof and fueling areas which pass through the SWQV pond). The combined total runoff is 4.15 cfs for the 100-year 6 hour event.

The existing topography and the proposed design grading results in Basin B8 sheet flows to the west into the commercial parking lot. Historically the majority of the commercial site drained to this area. With the redevelopment, it is expected to result in a decrease of flows to this area of 2,280 cubic feet (Historic Basin B1 minus Developed Basin B8). This will not rectify the historical

ponding issues which occur on the property to the west but will decrease the flow directed to this area.

Basin B6 represents the offsite flow from the driveway entrance that flows into the site. This area is currently paved and will be overlaid with new asphalt, and therefore is not included in the SWQV calculations. Basin B8 represents the existing paved alley way on the west side of the site. This area will be overlaid with new asphalt and therefore is not included in the SWQV calculations.

Therefore the required SWQV generated for the impervious areas that is not being captured with onsite storage is 547 cubic feet, and therefore generates a payment in lieu fee of \$4,374.

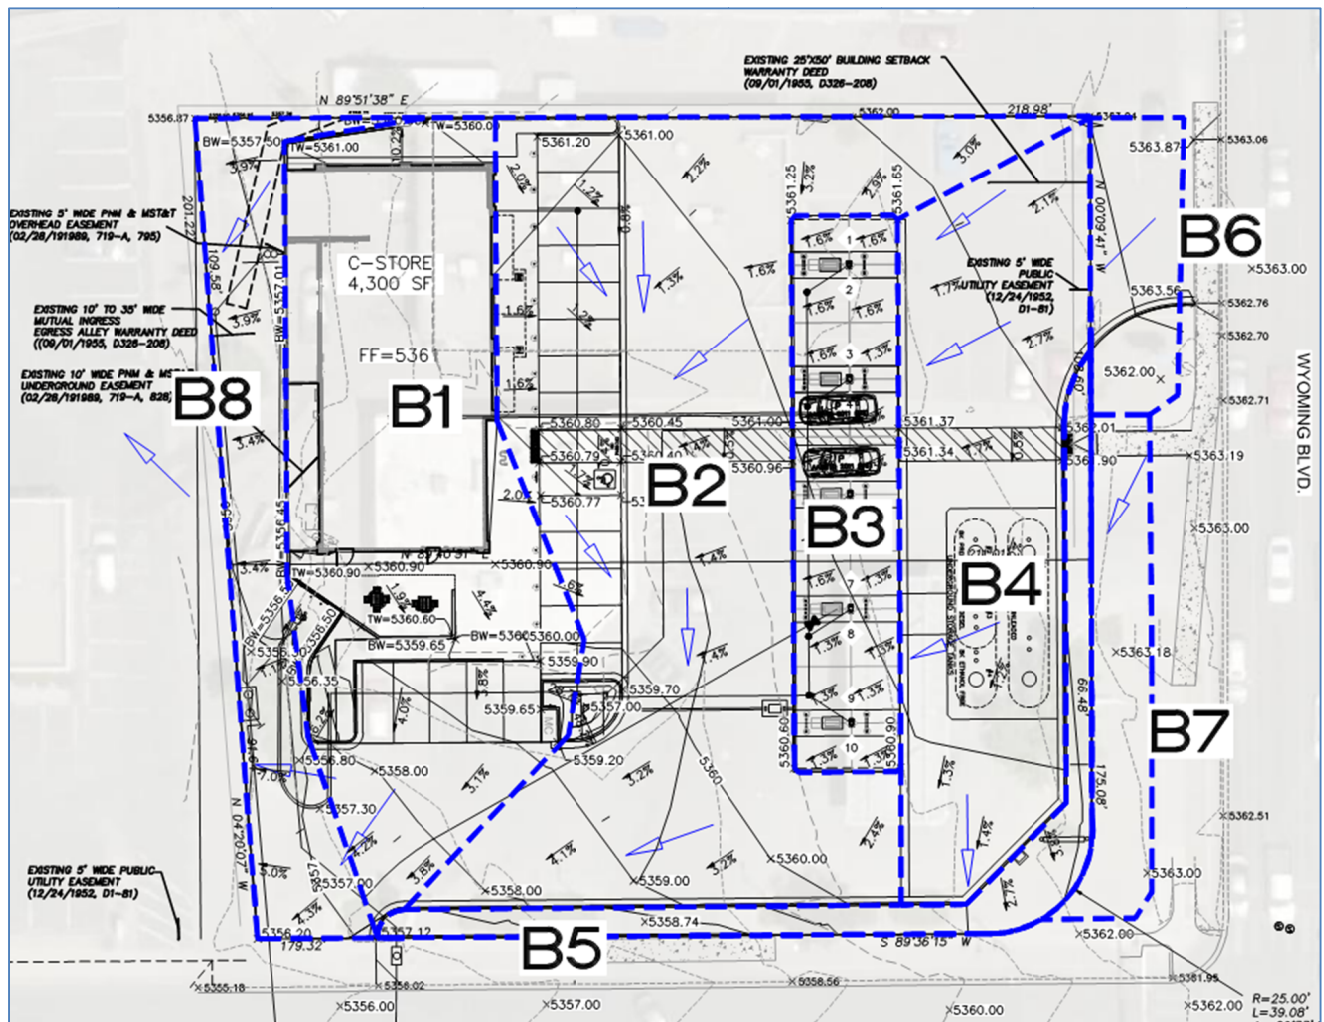

**Exhibit F – Drainage Basin Map**

## Stormwater Quality Volume Management

As this site is a re-development, the water quality volume is calculated based on the 0.48 inch storm. To calculate the Stormwater Quality Volume the impervious area is multiplied by 0.26 inches. The formula used is  $SWQV = 0.26 * I * 43,560 * (1/12)$  where "I" is the impervious area in acres.

The total impervious area required for management is generated from Basins B1-B4 is 0.82 acres and requires a total water quality volume of 773 cubic feet. Portions of Basins B1 and all of B3 is routed through the SWQV pond that has a total volume of 166 cubic feet. The volume retained in the 450 gallon oil water separator is 60 cubic feet which is also considered in the SWQV summation. Therefore a total of 547 cubic feet is not being managed onsite, and the developer is choosing Payment in Lieu of \$8/cf which totals \$4,374. The water quality volume calculations are detailed on the hydrology table in the appendix.

## Post Construction Maintenance Responsibility

As part of the City of Albuquerque's endeavor to uphold best management practices (BMPs) and ensure compliance with the City's Drainage Ordinance, Stormwater Quality Ordinance and the EPA MS4 Permit, a drainage and landscape maintenance plan is proposed for this site. The stormwater features proposed have been designed for easy maintenance that comprises of periodic tasks and inspections to ensure the features operate and perform to the design criteria to which it was designed. The maintenance of the BMPs shall be the responsibility of the owner of the property. The maintenance plan detailed below and listed on the grading and drainage plan shall be recorded in the Bernalillo County Records Room.

The maintenance comprise of the following:

**Responsible Party:** Property Operator.

**Access to surface and sub-surface stormwater quality elements:** All access to the stormwater quality elements shall be accessible from Constitution Ave. and from the paved areas within the site. There is no restricted access to the location of both the surface and sub-surface elements.

REGULAR MAINTENANCE	FREQUENCY
LITTER MANAGEMENT	
Pick up all litter at site and in Landscape areas and remove from site	Daily

<b>INLETS AND OUTLETS</b>	
Visual inspection for function. Remove silt from slab aprons and debris in pavement areas. Remove all fallen vegetation around inlet and outlet structures.	Monthly
<b>HARD SURFACES</b>	
Sweep all paving regularly. Maintain pavement in autumn after leaf fall. Coordinate with Landscape Contractor if additional maintenance is required.	As required

<b>OCCASIONAL TASKS</b>	<b>FREQUENCY</b>
<b>INSPECTION AND INLETS, OUTLETS AND CONTROL CHAMBERS</b>	
Inspect surface structures removing obstructions and silt as necessary. Check there is no physical damage. For below ground control chambers, remove cover and inspect ensuring water is flowing freely and that the exit route for water is unobstructed. Remove debris and silt.	Yearly
<b>POND VEGETATION</b>	
Ensure Pond vegetation is maintained by Landscape Contractor. All weeds and all cuttings removed from site.	As required
<b>SILT MANAGEMENT</b>	
Inspect swales and water quality pond for silt accumulation. Excavate silt, stack and dry within 2-feet of the water quality feature, but outside the design profile where water flows, spread, rake and overseed. Protect surface from siltation and manage main area of basin for design function or appearance.	Yearly

<b>REMEDIAL WORK</b>	<b>FREQUENCY</b>
Inspect storm all water quality structures regularly to check for damage or failure. Undertake remedial work as required.	Yearly

## Summary

This report outlines the Drainage Plan and presents the on-site BMP SWQV ponding and drainage improvements needed to safely convey the developed flows for the re-development of the site to a Maverik Gas Station and Convenience Store.

The solution improves the existing drainage issue where the commercial parcel drains to the west and ponds, after which additional sheet flow overflows to the Virginia St. Apartment complex and drains out to the street. This runoff is now re-routed through the developed site, a portion through a SWQV pond and allowed to discharge into Constitution Ave.



Per the DPM the design is required to control the oil wash-off from vehicle refueling areas and is achieved by passing flows through the 450 gallon oil water separator. The SWQV retains a total of 166 cubic feet in a surface pond, and 60 cubic feet in the oil water separator, with the remaining 547 cubic feet required to be paid in Lieu totaling \$4,374. The site does not increase

the historic flow released from the site and the solution adheres to best practices for stormwater quality management. The table below summarizes the runoff for each Basin.


**Table 1: Basin Runoff Summary**

<b>Basin No.</b>	<b>Q100</b>	<b>V100</b>	<b>SWQV Required</b>	<b>SWQV Provided</b>
1	1.15	0.045	209	166
2	1.75	0.068	329	-
3	0.41	0.016	77	60
4	0.84	0.033	158	-
5	0.13	0.004	0	-
6	0.16	0.006	Overlay	-
7	0.11	0.003	0	-
8	0.44	0.017	Overlay	-
<b>Total</b>	<b>4.99 cfs</b>	<b>0.19 ac-ft</b>	<b>773 cf</b>	<b>226 cf</b>

## APPENDIX A

<div>ENGINEER'S SEAL</div> <div></div> <div>RONALD R. BOHANNAN P.E. #78688</div>	MAVERIK	DRAWN BY RS
	1401 WYOMING BLVD. NE	DATE 2/5/2019
	GRADING AND DRAINAGE PLAN	2018055-GR
	<div> <i>TIERRA WEST, LLC</i></div> <div>5571 MIDWAY PARK PLACE NE ALBUQUERQUE, NM 87109 (505) 858-3100 www.tierrawestllc.com</div>	SHEET #  <b>C2</b>
		JOB # 2018055

Z:\2018\2018055-Maverik-Wyoming-&-Constitution\Drawings\2018055-Drainage-Developed.dwg, Plot: 04, 2019 - 3.27am

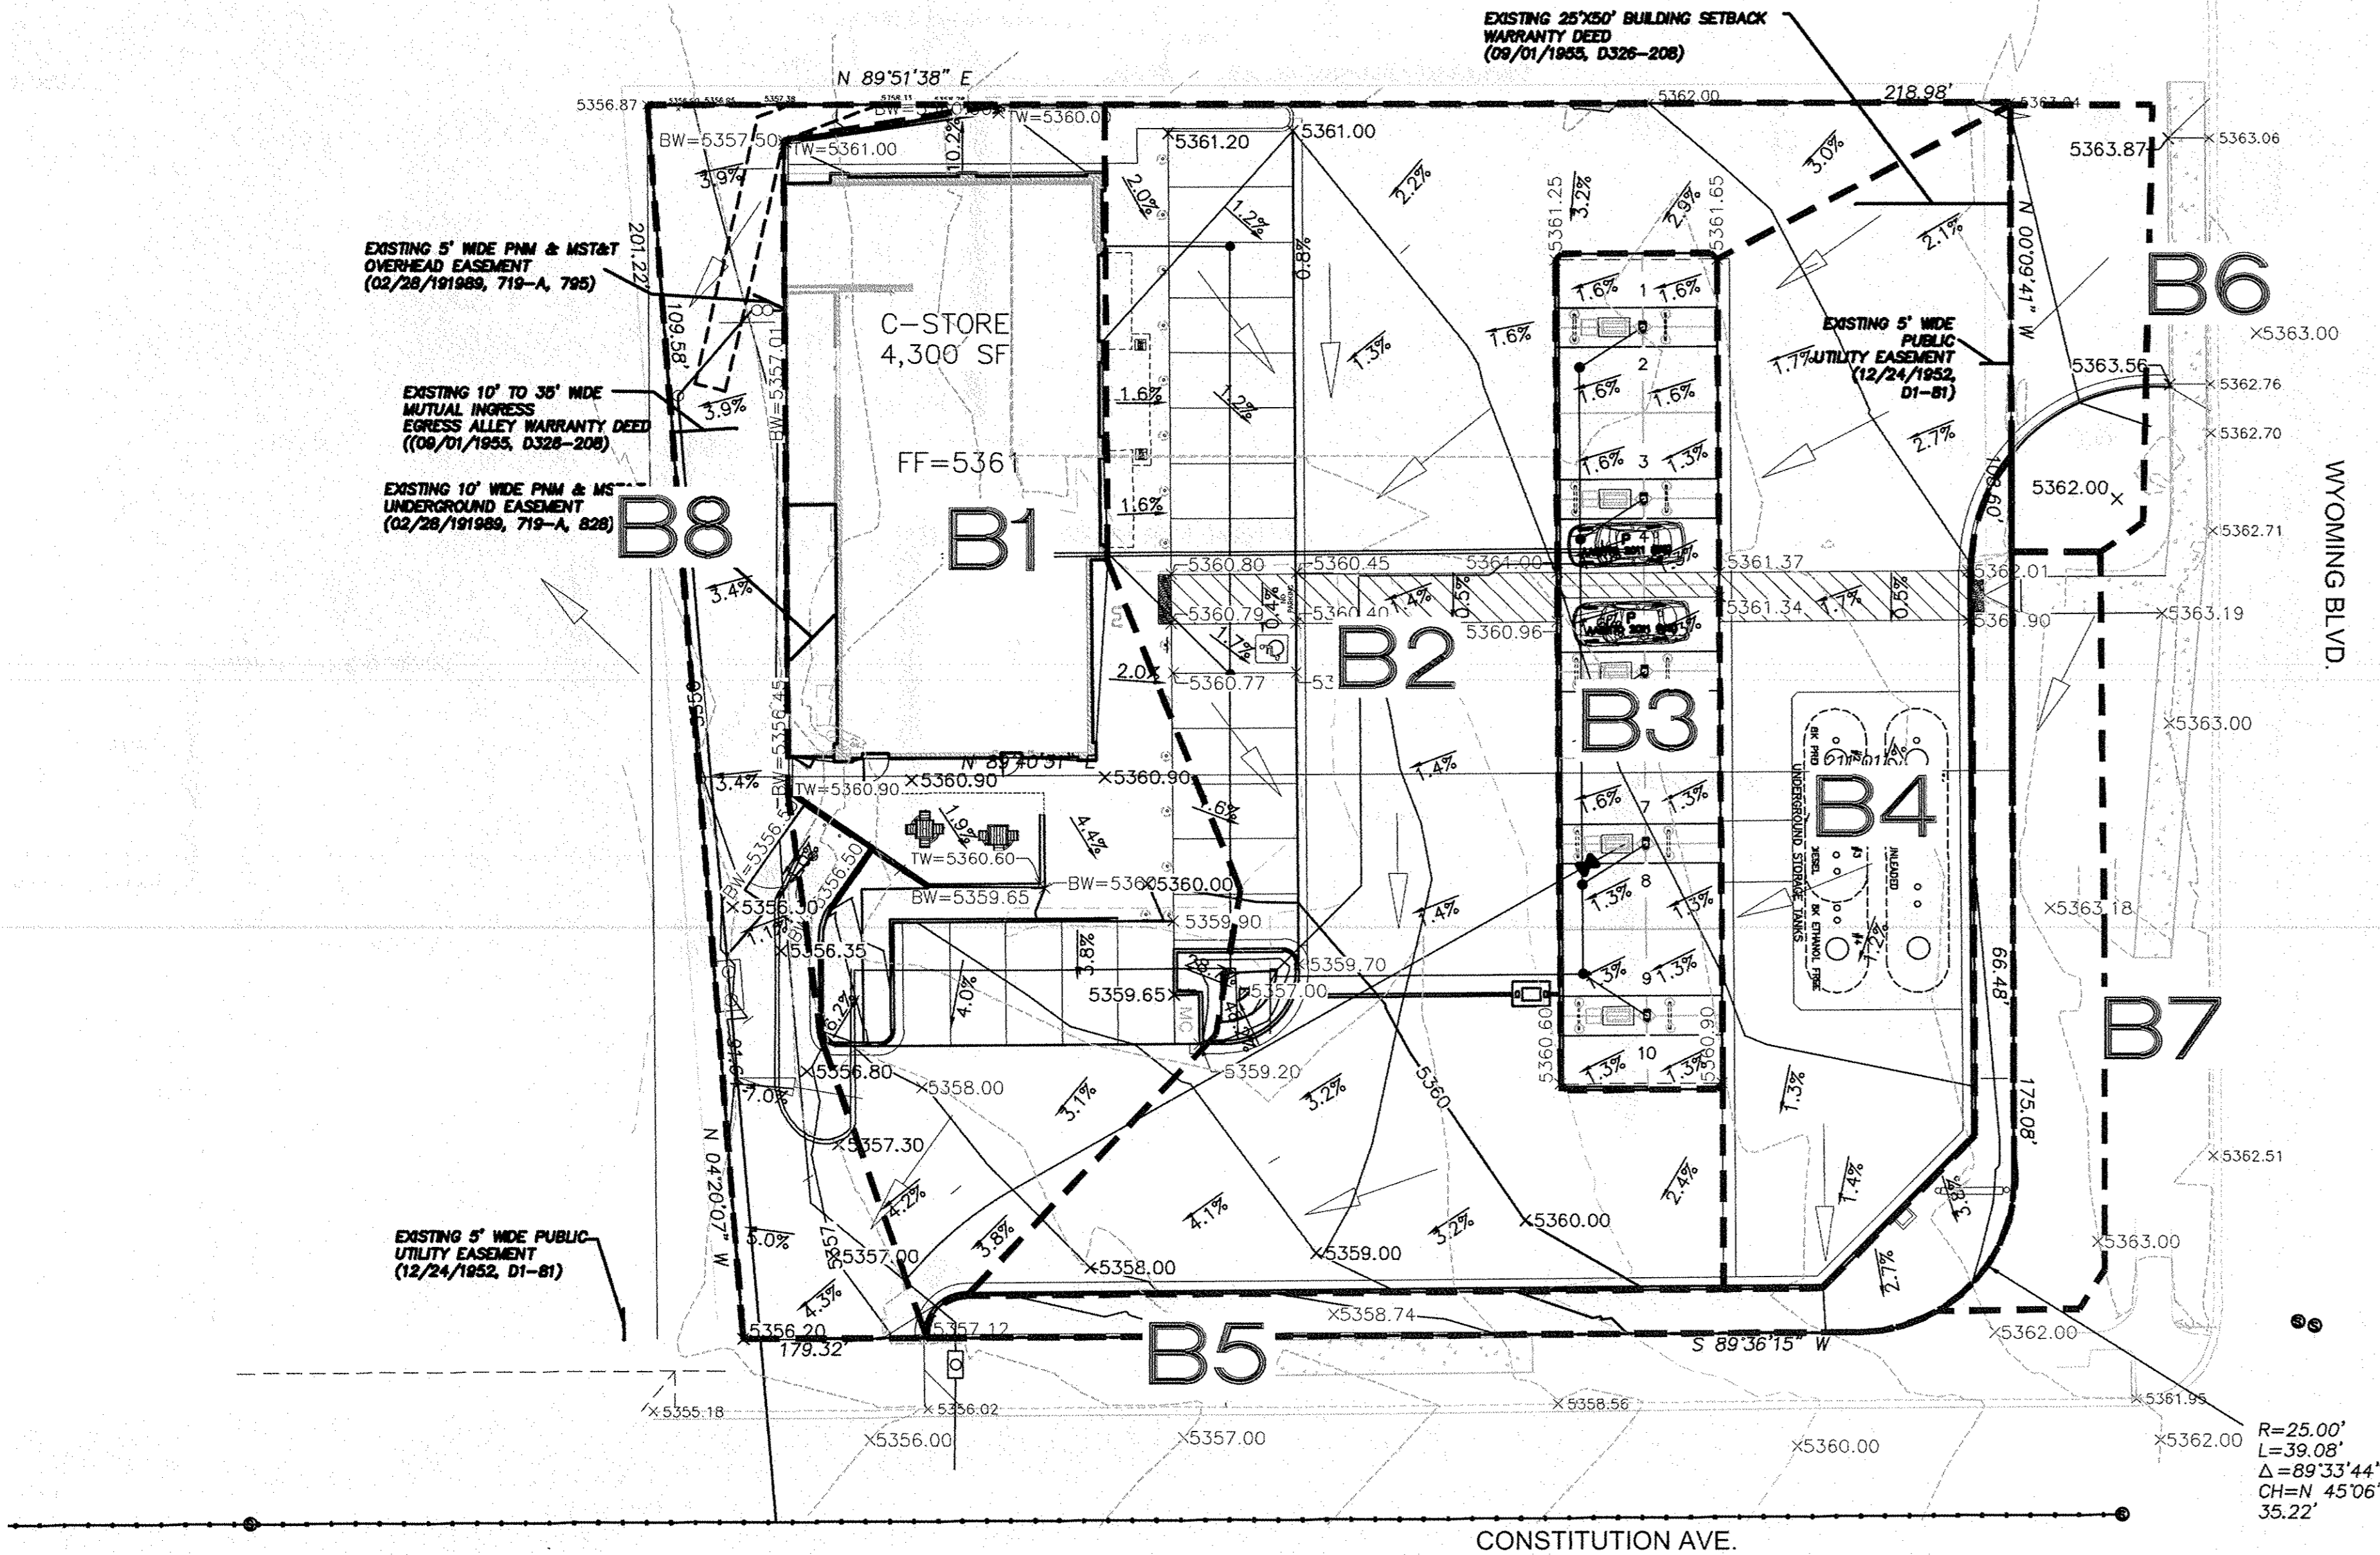

Basin Descriptions											100-Year, 6-Hr			10-Year, 6-Hr			Water Quality Volume		
Basin ID	Area (sf)	Area (acres)	Area (sq miles)	Treatment A		Treatment B		Treatment C		Treatment D		Weighted E (in)	Volume (ac-ft)	Flow cfs	Weighted E (in)	Volume (ac-ft)	Flow cfs	SWQV Required CF	SWQV Provided CF
				%	(acres)	%	(acres)	%	(acres)	%	(acres)								
1	10,160	0.233	0.00036	0%	0.000	0%	0.000	5%	0.012	95%	0.222	2.307	0.045	1.15	1.456	0.028	0.77	209	166
2	15,170	0.348	0.00054	0%	0.000	0%	0.000	0%	0.000	100%	0.348	2.360	0.068	1.75	1.500	0.044	1.18	329	-
3	3,535	0.081	0.00013	0%	0.000	0%	0.000	0%	0.000	100%	0.081	2.360	0.016	0.41	1.500	0.010	0.28	77	60
4	7,311	0.168	0.00026	0%	0.000	0%	0.000	0%	0.000	100%	0.168	2.360	0.033	0.84	1.500	0.021	0.57	158	-
5	2,214	0.051	0.00008	0%	0.000	100%	0.051	0%	0.000	0%	0.000	0.920	0.004	0.13	0.360	0.002	0.06	0	-
6	1,575	0.036	0.00006	0%	0.000	20%	0.007	0%	0.000	80%	0.029	2.072	0.006	0.16	1.272	0.004	0.11	Overlay	-
7	1,848	0.042	0.00007	0%	0.000	100%	0.042	0%	0.000	0%	0.000	0.920	0.003	0.11	0.360	0.001	0.05	0	-
8	3,831	0.088	0.00014	0%	0.000	2%	0.002	0%	0.000	98%	0.086	2.331	0.017	0.44	1.477	0.011	0.29	Overlay	-
Total	45,644	1.048	0.00164		0.000		0.102		0.012		0.934		0.193	4.994		0.120	3.311	773	226

Equations:

Weighted E = Ea\*Aa + Eb\*Ab + Ec\*Ac + Ed\*Ad / (Total Area)  
Volume = Weighted E \* Total Area  
Flow = Qa\*Aa + Qb\*Ab + Qc\*Ac + Qd\*Ad  
WQV<sub>required</sub> = 0.26\*A\*43560\*(1/12)

Excess Precipitation, E (in.)			
Zone 3	100-Year	10-Year	
Ea	0.66	0.19	
Eb	0.92	0.36	
Ec	1.29	0.62	
Ed	2.36	1.50	

Peak Discharge (cfs/acre)			
Zone 3	100-Year	10-Year	
Qa	1.87	0.58	
Qb	2.6	1.19	
Qc	3.45	2.00	
Qd	5.02	3.39	

LEGEND

- CURB & GUTTER
- BOUNDARY LINE
- EASEMENT
- CENTERLINE
- RIGHT-OF-WAY
- BUILDING
- SIDEWALK
- RETAINING WALL
- EXISTING CURB & GUTTER
- EXISTING BOUNDARY LINE
- DRAINAGE BASIN BOUNDARY
- FLOW DIRECTION

BMP SWQV NOTES

THE SWQV COULD BE MANAGED ONSITE HOWEVER THE DEVELOPER IS CHOOSING PAYMENT IN LIEU. A TOTAL OF 653 CUBIC FEET IN VOLUME IS NOT BEING CAPTURED AND THEREFORE GENERATES A FEE IN LIEU OF \$5,224.

MAINTENANCE OF BMPs

RESPONSIBLE PARTY: PROPERTY OPERATOR  
MAINTENANCE REQUIREMENTS AND FREQUENCY: REFER TABLE THIS PAGE  
ACCESS TO BMPs: ACCESS SHALL BE PROVIDED VIA SITE ACCESS DRIVES TO SURFACE SWQV POND. ALL REMOVAL AND DISPOSAL OF LANDSCAPING AND SEDIMENT SHALL BE COMPLETED BY CERTIFIED LANDSCAPE CONTRACTOR IN ACCORDANCE WITH THE LANDSCAPE MAINTENANCE SPECIFICATION. NO DEBRIS SHALL REMAIN ONSITE AFTER TRIMMING. SEDIMENTATION MONITORING SHALL BE COMPLETED BY THE PROPERTY OPERATOR YEARLY. IF SILT ACCUMULATION EXCEEDS 2 INCHES ON THE SWQV POND GAUGE THEN THE POND BOTTOM SHALL BE EXCAVATED AND STACKED WITHIN 2-FEET OF THE SWQV POND BERM. VISUAL INSPECT FOLLOWING STORM EVENTS SHALL BE COMPLETED AS REQUIRED TO ENSURE THE INFILTRATION OF THE SWQV IS ACHIEVED AT ACCEPTABLE RATES. THE SWQV, AT THE MAXIMUM 24" DEPTH, SHOULD INFILTRATE WITHIN 24 HOURS.



VECTOR CONTROL NOTES:

ALLOWING CONDITIONS SUCH AS THE ACCUMULATION OF STANDING WATER THAT CAN CONTRIBUTE TO THE BREEDING OF MOSQUITOES IS A VIOLATION OF THE CITY OF ALBUQUERQUE'S INSECT AND RODENT CONTROL ORDINANCE. MAINTENANCE OF THE RETENTION POND IS THE RESPONSIBILITY OF THE PROPERTY OWNER. IN ORDER TO PREVENT MOSQUITO BREEDING, VEGETATION SHOULD REGULARLY BE CLEARED FROM THE BASIN AND EDGES OF PONDS. THE SITE SHOULD BE MAINTAINED THROUGHOUT THE YEAR IN THIS MANNER. REMOVAL OF VEGETATION CREATES A LESS DESIRABLE SITE FOR MOSQUITO BREEDING. THIS WILL ALSO AID IN THE REDUCTION OF RODENT HARBORAGE. WHEN STANDING WATER DOES EXIST IT SHOULD BE TREATED WITH PUBLICLY AVAILABLE MOSQUITO PRODUCTS (E.G. MOSQUITO DUNKS) AT THE TREATMENT RATE DESIGNATED BY THE PRODUCT LABEL. SHOULD A SITE MAINTAIN PERMANENT STANDING WATER, MOSQUITO FISH (GAMBUSIA) CAN BE OBTAINED FROM THE CITY OF ALBUQUERQUE'S ENVIRONMENTAL HEALTH DEPARTMENT FREE OF CHARGE.

REGULAR MAINTENANCE	FREQUENCY
LITTER MANAGEMENT	
Pick up all litter at site and in Landscape areas and remove from site	Daily
INLETS AND OUTLETS	
Visual inspection for function. Remove silt from slab aprons and debris in pavement areas. Remove all fallen vegetation around inlet and outlet structures.	Monthly
HARD SURFACES	
Sweep all paving regularly. Maintain pavement in autumn after leaf fall. Coordinate with Landscape Contractor if additional maintenance is required.	As required


OCCASIONAL TASKS	FREQUENCY
INSPECTION AND INLETS, OUTLETS AND CONTROL CHAMBERS	
Inspect surface structures removing obstructions and silt as necessary. Check there is no physical damage. For below ground control chambers, remove cover and inspect ensuring water is flowing freely and that the exit route for water is unobstructed. Remove debris and silt.	Yearly
POND VEGETATION	
Ensure Pond vegetation is maintained by Landscape Contractor. All weeds and all cuttings removed from site.	As required
SILT MANAGEMENT	
Inspect swales and water quality pond for silt accumulation. Excavate silt, stack and dry within 2-feet of the water quality feature, but outside the design profile where water flows, spread, rake and overseed. Protect surface from siltation and manage main area of basin for design function or appearance.	Yearly

REMEDIAL WORK	FREQUENCY
Inspect storm all water quality structures regularly to check for damage or failure. Undertake remedial work as required.	Yearly

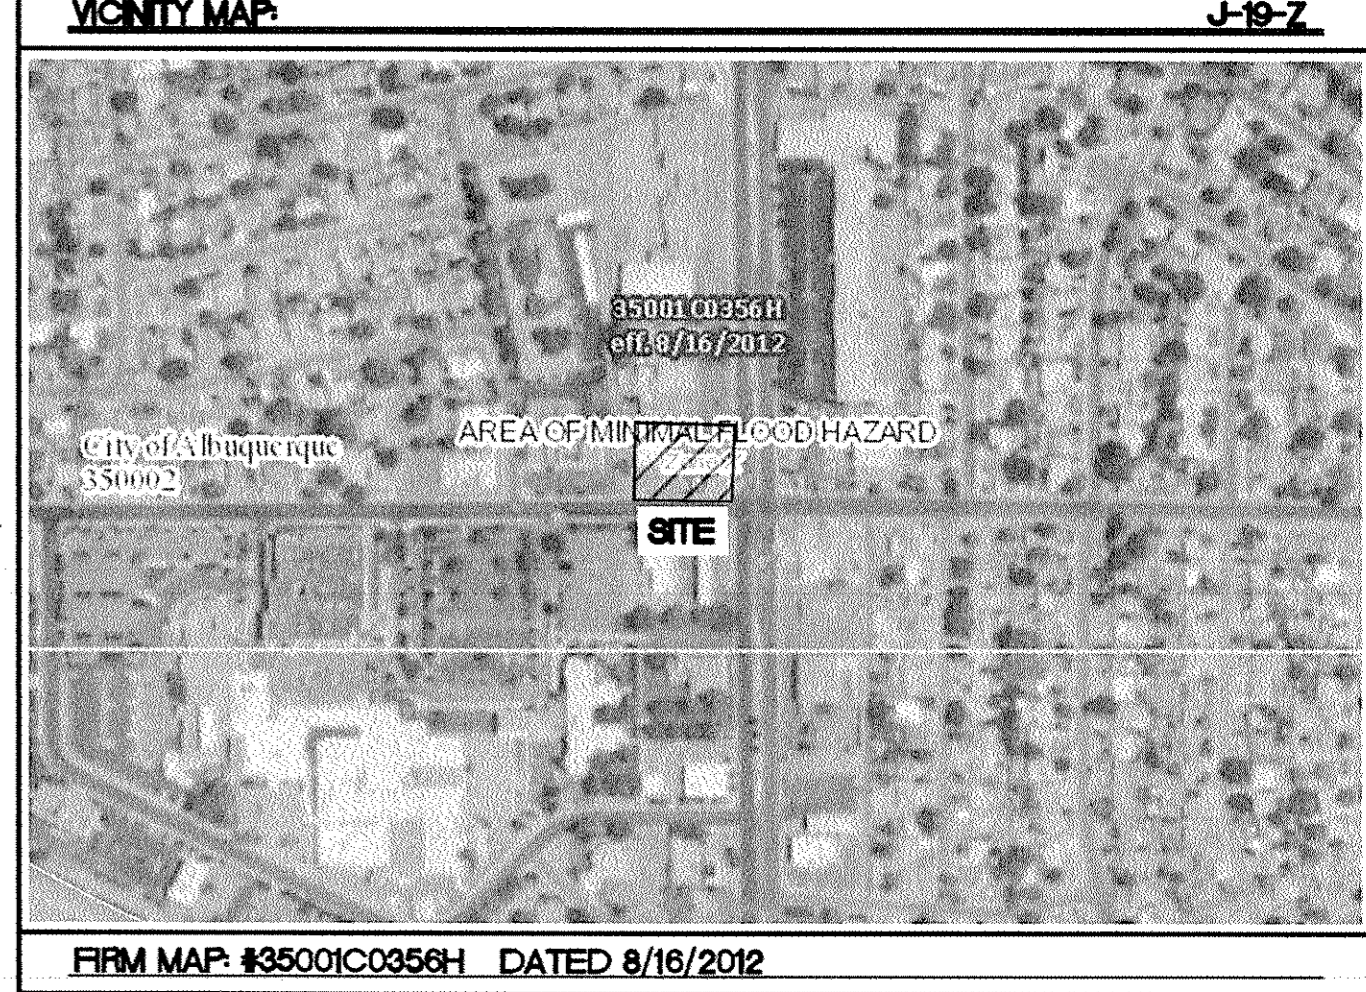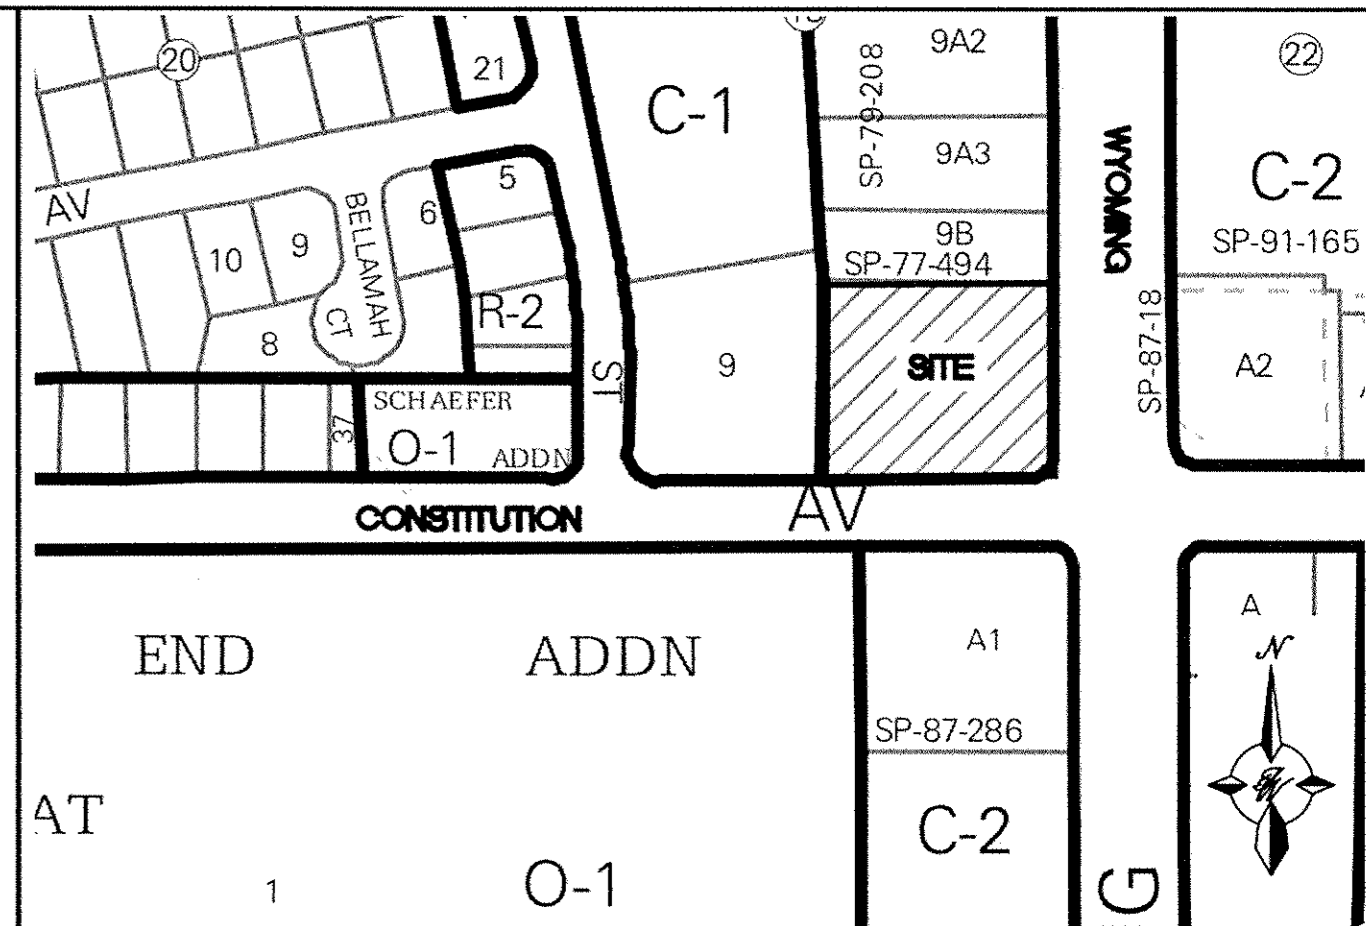

LEGAL DESCRIPTION:


LOT 9A, BLOCK 18 SNOW HEIGHTS

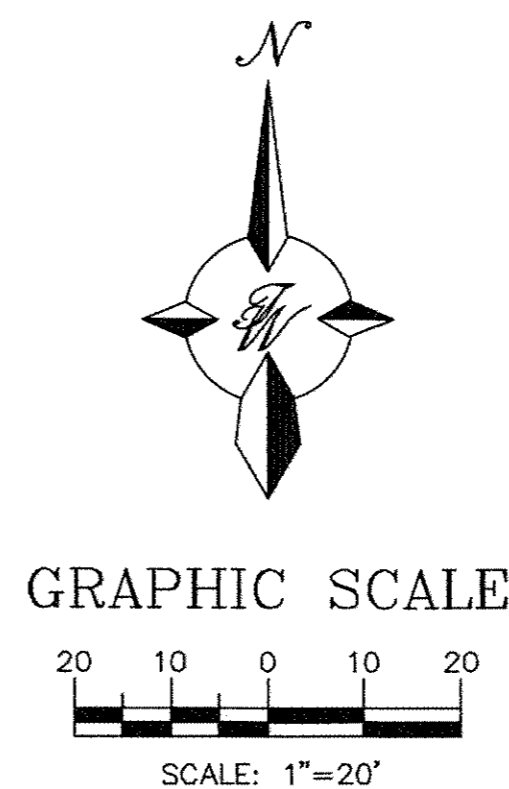

ENGINEER'S SEAL  
RONALD R. BOHANNAN  
REGISTERED PROFESSIONAL ENGINEER  
NEW MEXICO  
P.E. #7868

MAVERIK  
1401 WYOMING BLVD. NE  
DEVELOPED DRAINAGE PLAN  
TERRA WEST, LLC  
5571 MIDWAY PARK PLACE NE  
ALBUQUERQUE, NM 87109  
(505) 858-3100  
www.tierrowestllc.com

DRAWN BY  
RS  
DATE  
2/5/2019  
2018055-DRAINAGE DEVELOPED  
SHEET #  
C3  
JOB #  
2018055

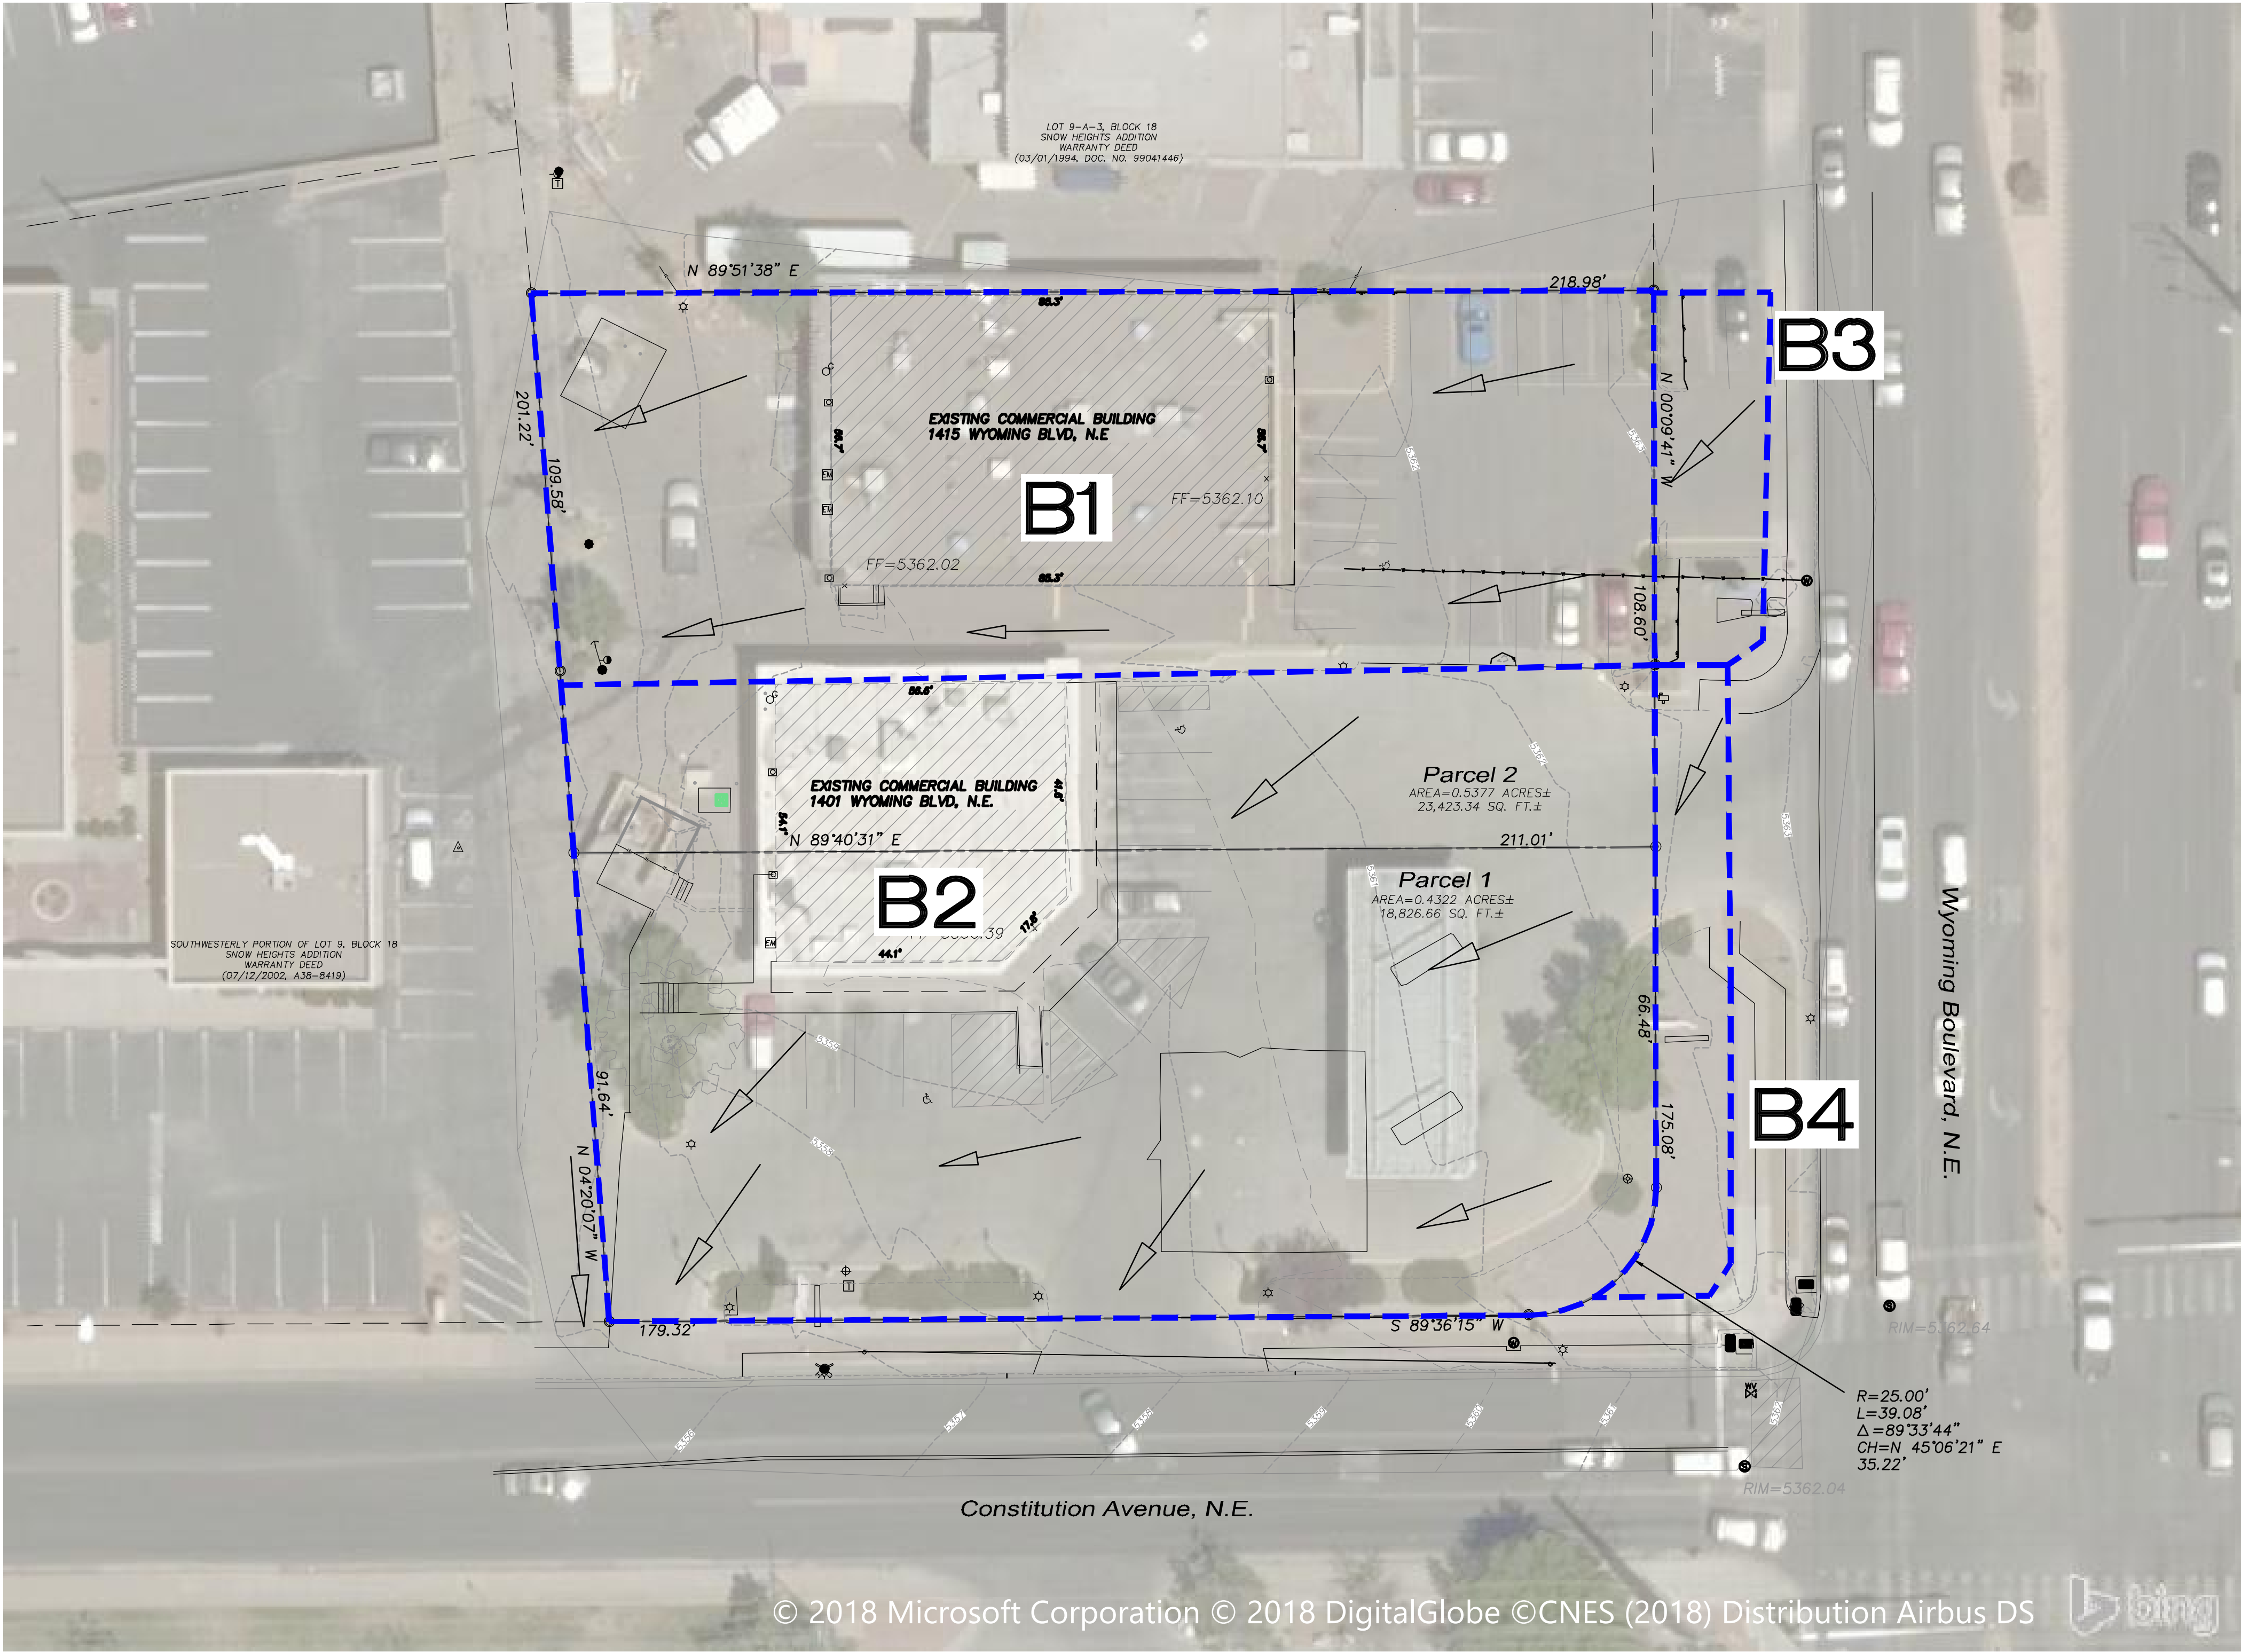

**LEGAL DESCRIPTION:**  
A PORTION OF LOT 9, BLOCK 18 SNOW HEIGHTS

- LEGEND**
- CURB & GUTTER
  - BOUNDARY LINE
  - EASEMENT
  - CENTERLINE
  - RIGHT-OF-WAY
  - BUILDING
  - SIDEWALK
  - RETAINING WALL
  - EXISTING CURB & GUTTER
  - EXISTING BOUNDARY LINE
  - DRAINAGE BASIN BOUNDARY
  - FLOW DIRECTION

Existing Conditions - Free Discharge																	
Basin Descriptions										100-Year, 6-Hr			10-Year, 6-Hr				
Basin ID	Area (sf)	Area (acres)	Area (sq miles)	Treatment A		Treatment B		Treatment C		Treatment D		Weighted E (in)	Volume (ac-ft)	Flow cfs	Weighted E (in)	Volume (ac-ft)	Flow cfs
				%	(acres)	%	(acres)	%	(acres)	%	(acres)						
B1	16,168.25	0.371	0.00058	0%	0.000	0%	0.000	0%	0.000	100%	0.371	2.360	0.073	1.86	1.500	0.046	1.26
B2	26,052.80	0.598	0.00093	0%	0.000	8%	0.000	0%	0.000	92%	0.550	2.171	0.108	2.76	1.380	0.069	1.87
B3	1,575.00	0.036	0.00006	0%	0.000	20%	0.000	0%	0.000	80%	0.029	1.888	0.006	0.15	1.200	0.004	0.10
B4	1,848.00	0.042	0.00007	0%	0.000	50%	0.000	0%	0.000	50%	0.021	1.180	0.004	0.11	0.750	0.003	0.07
Total	45,644.05	1.048	0.00164		0.000		0.000		0.000		0.972		0.191	4.88		0.121	3.29

**Equations:**


Weighted E =  $E_a \cdot A_a + E_b \cdot A_b + E_c \cdot A_c + E_d \cdot A_d$  / (Total Area)

Volume = Weighted E \* Total Area

Flow =  $Q_a \cdot A_a + Q_b \cdot A_b + Q_c \cdot A_c + Q_d \cdot A_d$

Excess Precipitation, E (in.)			
Zone 3	100-Year	10-Year	
Ea	0.66	0.19	
Eb	0.92	0.36	
Ec	1.29	0.62	
Ed	2.36	1.50	

Peak Discharge (cfs/acre)			
Zone 3	100-Year	10-Year	
Qa	1.87	0.58	
Qb	2.6	1.19	
Qc	3.45	2.00	
Qd	5.02	3.39	

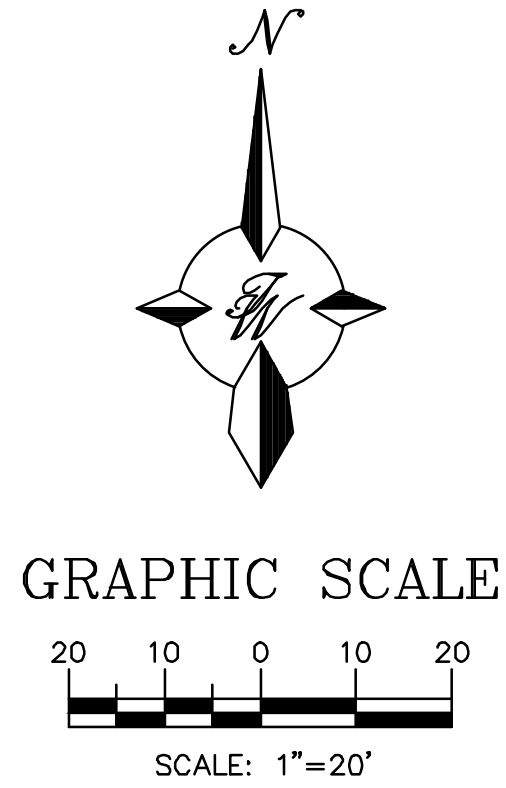

ENGINEER'S SEAL	MAVERIK	DRAWN BY
	1401 WYOMING BLVD. NE	RS
	HISTORIC DRAINAGE PLAN	DATE
		12/5/2018
RONALD R. BOHANNAN P.E. #7868	TERRA WEST, LLC 5571 MIDWAY PARK PLACE NE ALBUQUERQUE, NM 87109 (505) 858-3100 www.tierrawestllc.com	2018055-DRAINAGE HISTORIC
		SHEET #
		C1
		JOB #

Existing Conditions - Free Discharge

Basin Descriptions																	100-Year, 6-Hr				10-Year, 6-Hr		
Basin ID	Area (sf)	Area (acres)	Area (sq miles)	Treatment A		Treatment B		Treatment C		Treatment D		Weighted E (in)	Volume (ac-ft)	Flow cfs	Weighted E (in)	Volume (ac-ft)	Flow cfs						
				%	(acres)	%	(acres)	%	(acres)	%	(acres)												
B1	16,168	0.371	0.00058	0%	0.000	0%	0.000	0%	0.000	100%	0.371	2.360	0.073	1.86	1.500	0.046	1.26						
B2	26,053	0.598	0.00093	0%	0.000	8%	0.000	0%	0.000	92%	0.550	2.171	0.108	2.76	1.380	0.069	1.87						
B3	1,575	0.036	0.00006	0%	0.000	20%	0.000	0%	0.000	80%	0.029	1.888	0.006	0.15	1.200	0.004	0.10						
B4	1,848	0.042	0.00007	0%	0.000	50%	0.000	0%	0.000	50%	0.021	1.180	0.004	0.11	0.750	0.003	0.07						
Total	45,644	1.048	0.00164	0.000	0.000	0.000	0.000	0.000	0.000	0.972		0.191	4.88		0.121	3.29							

Proposed Conditions - Free Discharge

Basin Descriptions																			100-Year, 6-Hr				10-Year, 6-Hr			Water Quality Volume	
Basin ID	Area (sf)	Area (acres)	Area (sq miles)	Treatment A		Treatment B		Treatment C		Treatment D		Weighted E (in)	Volume (ac-ft)	Flow cfs	Weighted E (in)	Volume (ac-ft)	Flow cfs	SWQV Required CF	SWQV Provided CF								
				%	(acres)	%	(acres)	%	(acres)	%	(acres)																
1	10,160	0.233	0.00036	0%	0.000	0%	0.000	5%	0.012	95%	0.222	2.307	0.045	1.15	1.456	0.028	0.77	209	166								
2	15,170	0.348	0.00054	0%	0.000	0%	0.000	0%	0.000	100%	0.348	2.360	0.068	1.75	1.500	0.044	1.18	329	-								
3	3,535	0.081	0.00013	0%	0.000	0%	0.000	0%	0.000	100%	0.081	2.360	0.016	0.41	1.500	0.010	0.28	77	60								
4	7,311	0.168	0.00026	0%	0.000	0%	0.000	0%	0.000	100%	0.168	2.360	0.033	0.84	1.500	0.021	0.57	158	-								
5	2,214	0.051	0.00008	0%	0.000	100%	0.051	0%	0.000	0%	0.000	0.920	0.004	0.13	0.360	0.002	0.06	0	-								
6	1,575	0.036	0.00006	0%	0.000	20%	0.007	0%	0.000	80%	0.029	2.072	0.006	0.16	1.272	0.004	0.11	Overlay	-								
7	1,848	0.042	0.00007	0%	0.000	100%	0.042	0%	0.000	0%	0.000	0.920	0.003	0.11	0.360	0.001	0.05	0	-								
8	3,831	0.088	0.00014	0%	0.000	2%	0.002	0%	0.000	98%	0.086	2.331	0.017	0.44	1.477	0.011	0.29	Overlay	-								
Total	45,644	1.048	0.00164	0.000	0.000		0.102		0.012		0.934		0.193	4.994		0.120	3.311	773	226								

Equations:


Weighted E = Ea\*Aa + Eb\*Ab + Ec\*Ac + Ed\*Ad / (Total Area)  
Volume = Weighted E \* Total Area  
Flow = Qa\*Aa + Qb\*Ab + Qc\*Ac + Qd\*Ad  
WQV<sub>required</sub> = 0.26\*A\*43560\*(1/12)

Peak Discharge (cfs/acre)		
Zone 3	100-Year	10-Year
Qa	1.87	0.58
Qb	2.6	1.19
Qc	3.45	2.00
Qd	5.02	3.39

Excess Precipitation, E (in.)		
Zone 3	100-Year	10-Year
Ea	0.66	0.19
Eb	0.92	0.36
Ec	1.29	0.62
Ed	2.36	1.50

# 660-SA OIL WATER SEPARATOR

450 Gallon Capacity

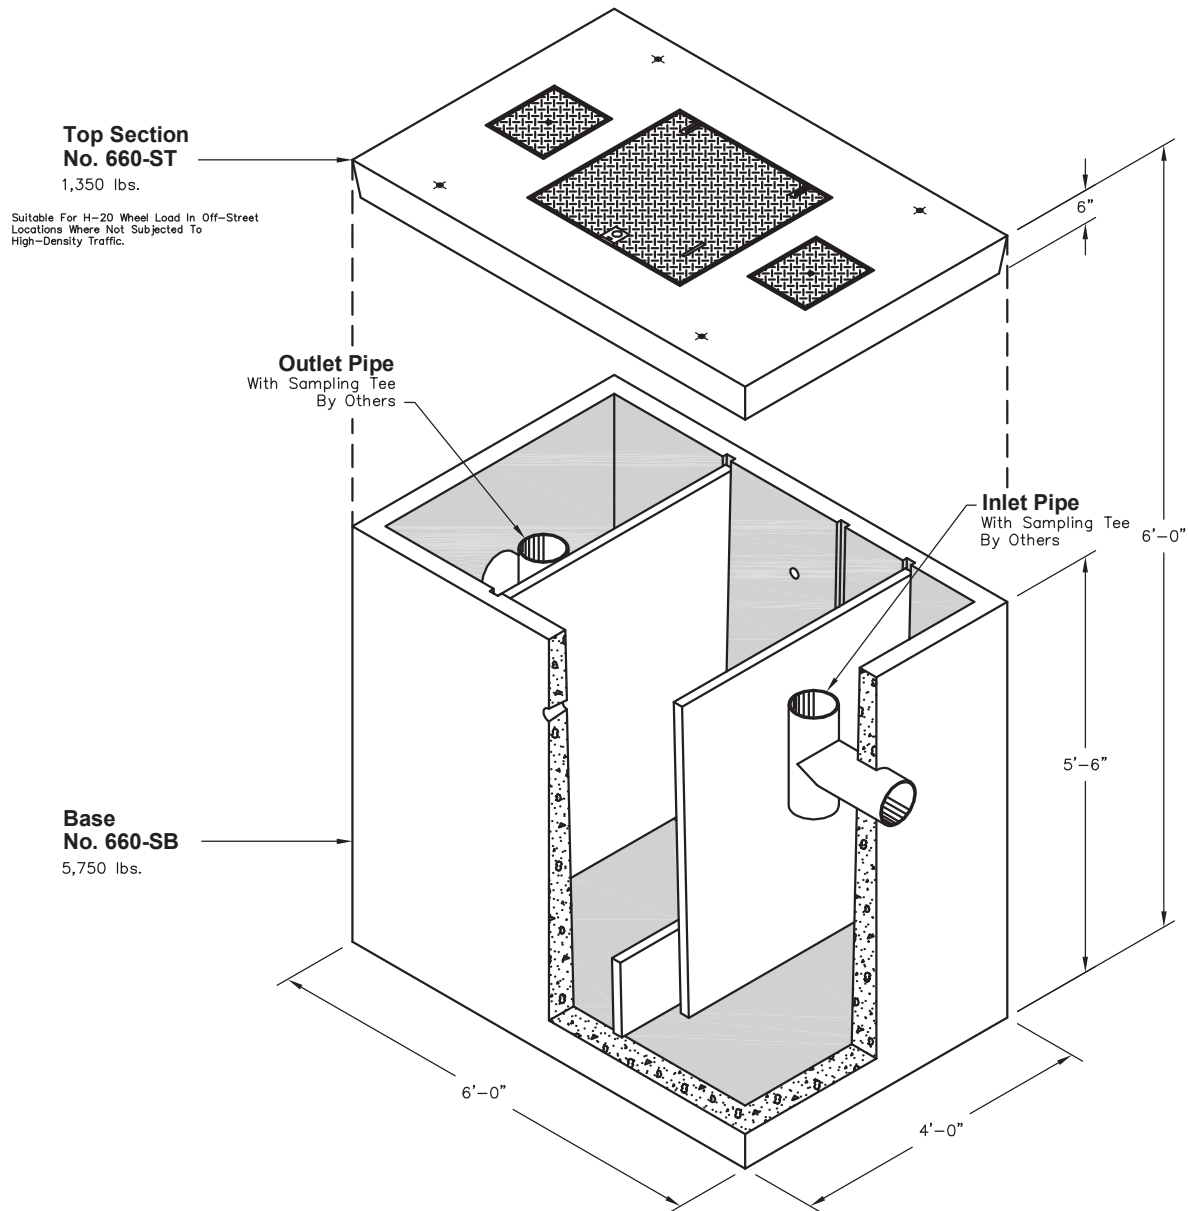


Non Skid Covers Available

**FOR DETAILS, SEE REVERSE>>**

Items Shown Are Subject To Change Without Notice  
Issue Date: April 2016

# 660-SA

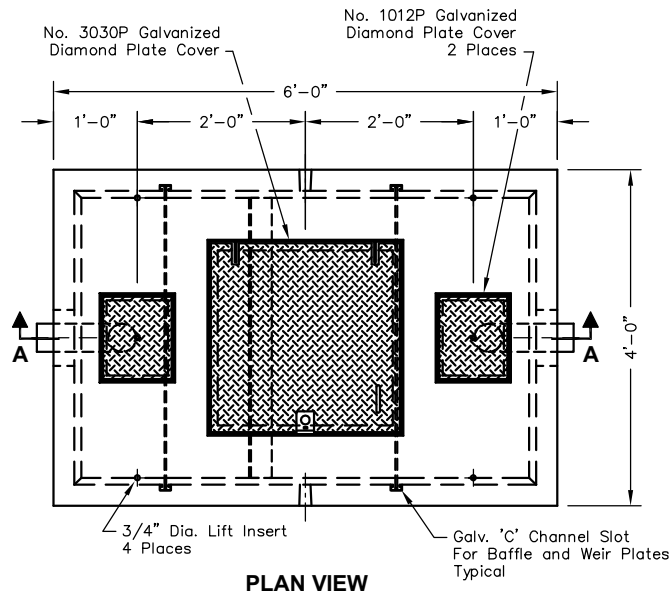

## STRUCTURAL NOTES:

1. Concrete: 28 Day Compressive Strength  $f'_c = 7000$  psi
2. Rebar: ASTM A-615 Grade 60
3. Mesh: ASTM A-185 Grade 65
4. Design: ACI-318-05 Building Code  
ASTM C-890 "Minimum Structural Design Loading For Underground Precast Concrete Water and Wastewater Structures"
5. Loads: HS-20 Truck Wheel w/ 30% Impact Per AASHTO

## GENERAL NOTES:

1. All Baffles and Weirs To Be Steel
2. Contractor to:  
Supply and Install All Piping & Sampling Tees  
Grout In All Pipes  
Fill With Clean Water Prior To "Start-Up" Of System  
Verify All Blockout Sizes and Locations

## FOR CUSTOM APPLICATIONS

THE FOLLOWING INFORMATION IS NEEDED:


Top Of Separator Elevation:

Inlet Pipe Size:

Inlet Pipe Elevation:


Outlet Pipe Size:

Outlet Pipe Elevation:

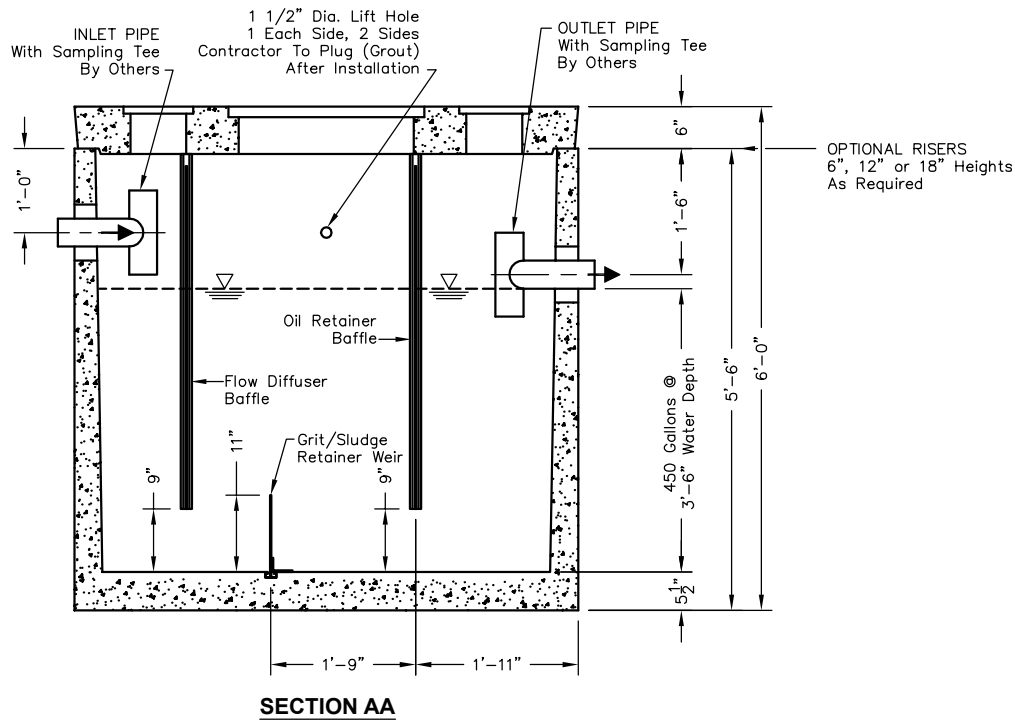

SCALE: 1/2"=1'-0"

Z:\2018\2018055-Maverik-Wyoming-&-Constitution\Drawings\2018055-Drainage-Developed.dwg, Plot: 04, 2019 - 3.27am

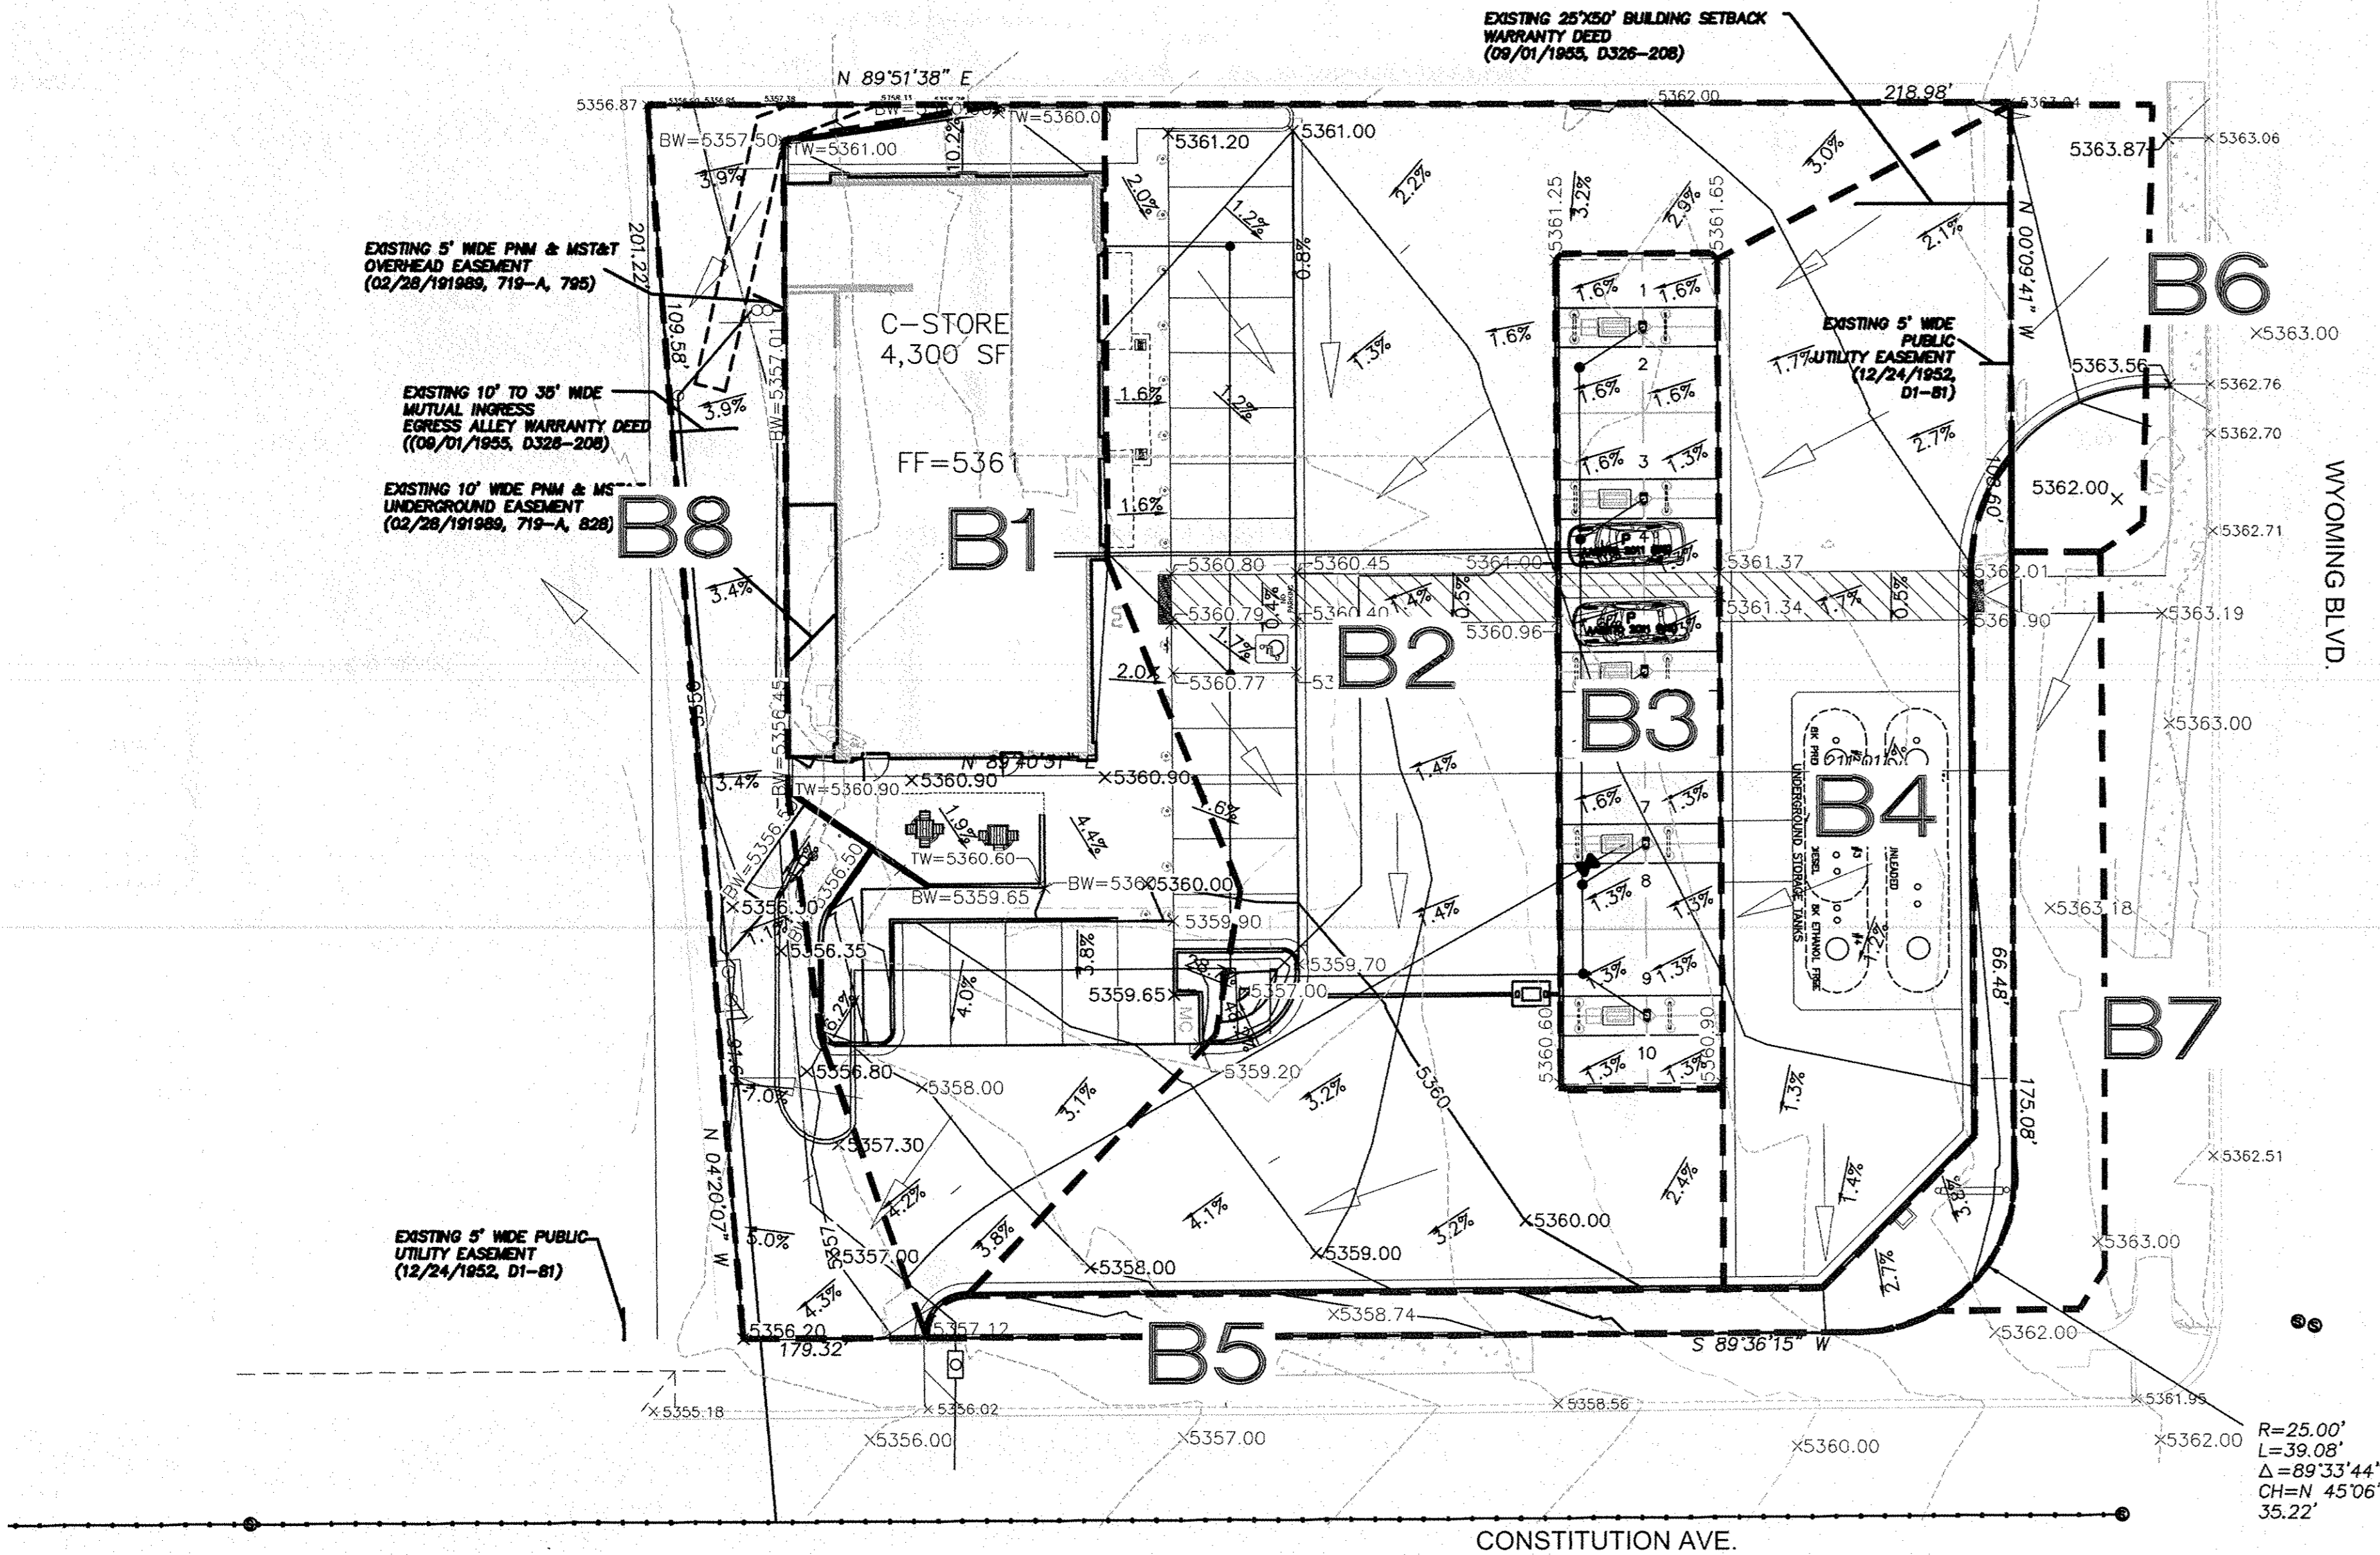

Basin Descriptions											100-Year, 6-Hr			10-Year, 6-Hr			Water Quality Volume		
Basin ID	Area (sf)	Area (acres)	Area (sq miles)	Treatment A		Treatment B		Treatment C		Treatment D		Weighted E (in)	Volume (ac-ft)	Flow cfs	Weighted E (in)	Volume (ac-ft)	Flow cfs	SWQV Required CF	SWQV Provided CF
				%	(acres)	%	(acres)	%	(acres)	%	(acres)								
1	10,160	0.233	0.00036	0%	0.000	0%	0.000	5%	0.012	95%	0.222	2.307	0.045	1.15	1.456	0.028	0.77	209	166
2	15,170	0.348	0.00054	0%	0.000	0%	0.000	0%	0.000	100%	0.348	2.360	0.068	1.75	1.500	0.044	1.18	329	-
3	3,535	0.081	0.00013	0%	0.000	0%	0.000	0%	0.000	100%	0.081	2.360	0.016	0.41	1.500	0.010	0.28	77	60
4	7,311	0.168	0.00026	0%	0.000	0%	0.000	0%	0.000	100%	0.168	2.360	0.033	0.84	1.500	0.021	0.57	158	-
5	2,214	0.051	0.00008	0%	0.000	100%	0.051	0%	0.000	0%	0.000	0.920	0.004	0.13	0.360	0.002	0.06	0	-
6	1,575	0.036	0.00006	0%	0.000	20%	0.007	0%	0.000	80%	0.029	2.072	0.006	0.16	1.272	0.004	0.11	Overlay	-
7	1,848	0.042	0.00007	0%	0.000	100%	0.042	0%	0.000	0%	0.000	0.920	0.003	0.11	0.360	0.001	0.05	0	-
8	3,831	0.088	0.00014	0%	0.000	2%	0.002	0%	0.000	98%	0.086	2.331	0.017	0.44	1.477	0.011	0.29	Overlay	-
Total	45,644	1.048	0.00164		0.000		0.102		0.012		0.934		0.193	4.994		0.120	3.311	773	226

Equations:

Weighted E = Ea\*Aa + Eb\*Ab + Ec\*Ac + Ed\*Ad / (Total Area)  
Volume = Weighted E \* Total Area  
Flow = Qa\*Aa + Qb\*Ab + Qc\*Ac + Qd\*Ad  
WQV<sub>required</sub> = 0.26\*A\*43560\*(1/12)

Excess Precipitation, E (in.)			
Zone 3	100-Year	10-Year	
Ea	0.66	0.19	
Eb	0.92	0.36	
Ec	1.29	0.62	
Ed	2.36	1.50	

Peak Discharge (cfs/acre)			
Zone 3	100-Year	10-Year	
Qa	1.87	0.58	
Qb	2.6	1.19	
Qc	3.45	2.00	
Qd	5.02	3.39	

LEGEND

- CURB & GUTTER
- BOUNDARY LINE
- EASEMENT
- CENTERLINE
- RIGHT-OF-WAY
- BUILDING
- SIDEWALK
- RETAINING WALL
- EXISTING CURB & GUTTER
- EXISTING BOUNDARY LINE
- DRAINAGE BASIN BOUNDARY
- FLOW DIRECTION

BMP SWQV NOTES

THE SWQV COULD BE MANAGED ONSITE HOWEVER THE DEVELOPER IS CHOOSING PAYMENT IN LIEU. A TOTAL OF 653 CUBIC FEET IN VOLUME IS NOT BEING CAPTURED AND THEREFORE GENERATES A FEE IN LIEU OF \$5,224.

MAINTENANCE OF BMPs

RESPONSIBLE PARTY: PROPERTY OPERATOR  
MAINTENANCE REQUIREMENTS AND FREQUENCY: REFER TABLE THIS PAGE  
ACCESS TO BMPs: ACCESS SHALL BE PROVIDED VIA SITE ACCESS DRIVES TO SURFACE SWQV POND. ALL REMOVAL AND DISPOSAL OF LANDSCAPING AND SEDIMENT SHALL BE COMPLETED BY CERTIFIED LANDSCAPE CONTRACTOR IN ACCORDANCE WITH THE LANDSCAPE MAINTENANCE SPECIFICATION. NO DEBRIS SHALL REMAIN ONSITE AFTER TRIMMING. SEDIMENTATION MONITORING SHALL BE COMPLETED BY THE PROPERTY OPERATOR YEARLY. IF SILT ACCUMULATION EXCEEDS 2 INCHES ON THE SWQV POND GAUGE THEN THE POND BOTTOM SHALL BE EXCAVATED AND STACKED WITHIN 2-FEET OF THE SWQV POND BERM. VISUAL INSPECT FOLLOWING STORM EVENTS SHALL BE COMPLETED AS REQUIRED TO ENSURE THE INFILTRATION OF THE SWQV IS ACHIEVED AT ACCEPTABLE RATES. THE SWQV, AT THE MAXIMUM 24" DEPTH, SHOULD INFILTRATE WITHIN 24 HOURS.



VECTOR CONTROL NOTES:

ALLOWING CONDITIONS SUCH AS THE ACCUMULATION OF STANDING WATER THAT CAN CONTRIBUTE TO THE BREEDING OF MOSQUITOES IS A VIOLATION OF THE CITY OF ALBUQUERQUE'S INSECT AND RODENT CONTROL ORDINANCE. MAINTENANCE OF THE RETENTION POND IS THE RESPONSIBILITY OF THE PROPERTY OWNER. IN ORDER TO PREVENT MOSQUITO BREEDING, VEGETATION SHOULD REGULARLY BE CLEARED FROM THE BASIN AND EDGES OF PONDS. THE SITE SHOULD BE MAINTAINED THROUGHOUT THE YEAR IN THIS MANNER. REMOVAL OF VEGETATION CREATES A LESS DESIRABLE SITE FOR MOSQUITO BREEDING. THIS WILL ALSO AID IN THE REDUCTION OF RODENT HARBORAGE. WHEN STANDING WATER DOES EXIST IT SHOULD BE TREATED WITH PUBLICLY AVAILABLE MOSQUITO PRODUCTS (E.G. MOSQUITO DUNKS) AT THE TREATMENT RATE DESIGNATED BY THE PRODUCT LABEL. SHOULD A SITE MAINTAIN PERMANENT STANDING WATER, MOSQUITO FISH (GAMBUSIA) CAN BE OBTAINED FROM THE CITY OF ALBUQUERQUE'S ENVIRONMENTAL HEALTH DEPARTMENT FREE OF CHARGE.

REGULAR MAINTENANCE	FREQUENCY
LITTER MANAGEMENT	
Pick up all litter at site and in Landscape areas and remove from site	Daily
INLETS AND OUTLETS	
Visual inspection for function. Remove silt from slab aprons and debris in pavement areas. Remove all fallen vegetation around inlet and outlet structures.	Monthly
HARD SURFACES	
Sweep all paving regularly. Maintain pavement in autumn after leaf fall. Coordinate with Landscape Contractor if additional maintenance is required.	As required


OCCASIONAL TASKS	FREQUENCY
INSPECTION AND INLETS, OUTLETS AND CONTROL CHAMBERS	
Inspect surface structures removing obstructions and silt as necessary. Check there is no physical damage. For below ground control chambers, remove cover and inspect ensuring water is flowing freely and that the exit route for water is unobstructed. Remove debris and silt.	Yearly
POND VEGETATION	
Ensure Pond vegetation is maintained by Landscape Contractor. All weeds and all cuttings removed from site.	As required
SILT MANAGEMENT	
Inspect swales and water quality pond for silt accumulation. Excavate silt, stack and dry within 2-feet of the water quality feature, but outside the design profile where water flows, spread, rake and overseed. Protect surface from siltation and manage main area of basin for design function or appearance.	Yearly

REMEDIAL WORK	FREQUENCY
Inspect storm all water quality structures regularly to check for damage or failure. Undertake remedial work as required.	Yearly

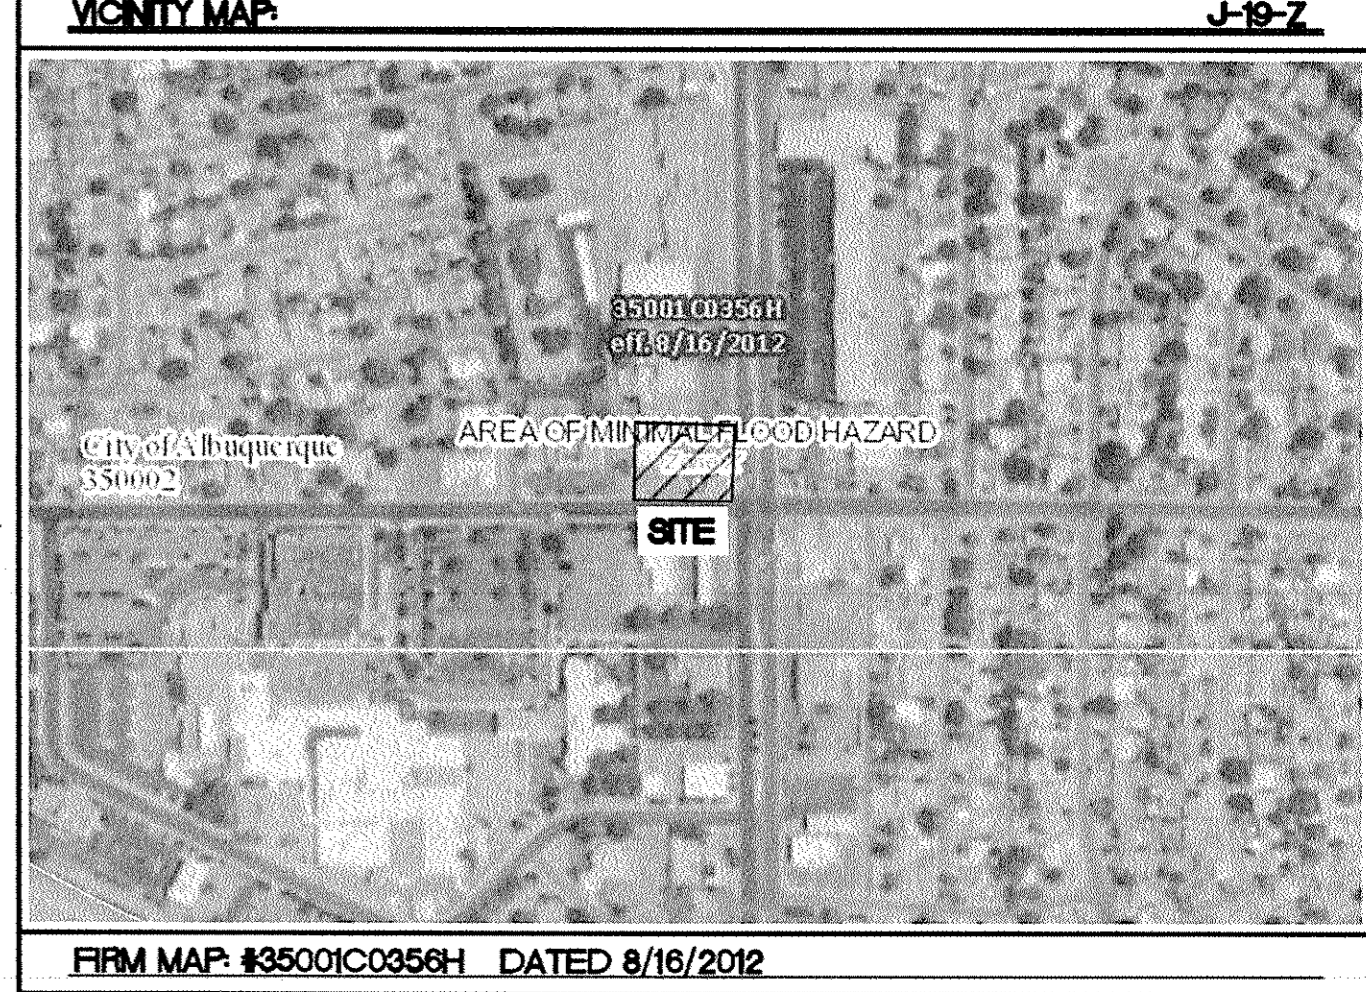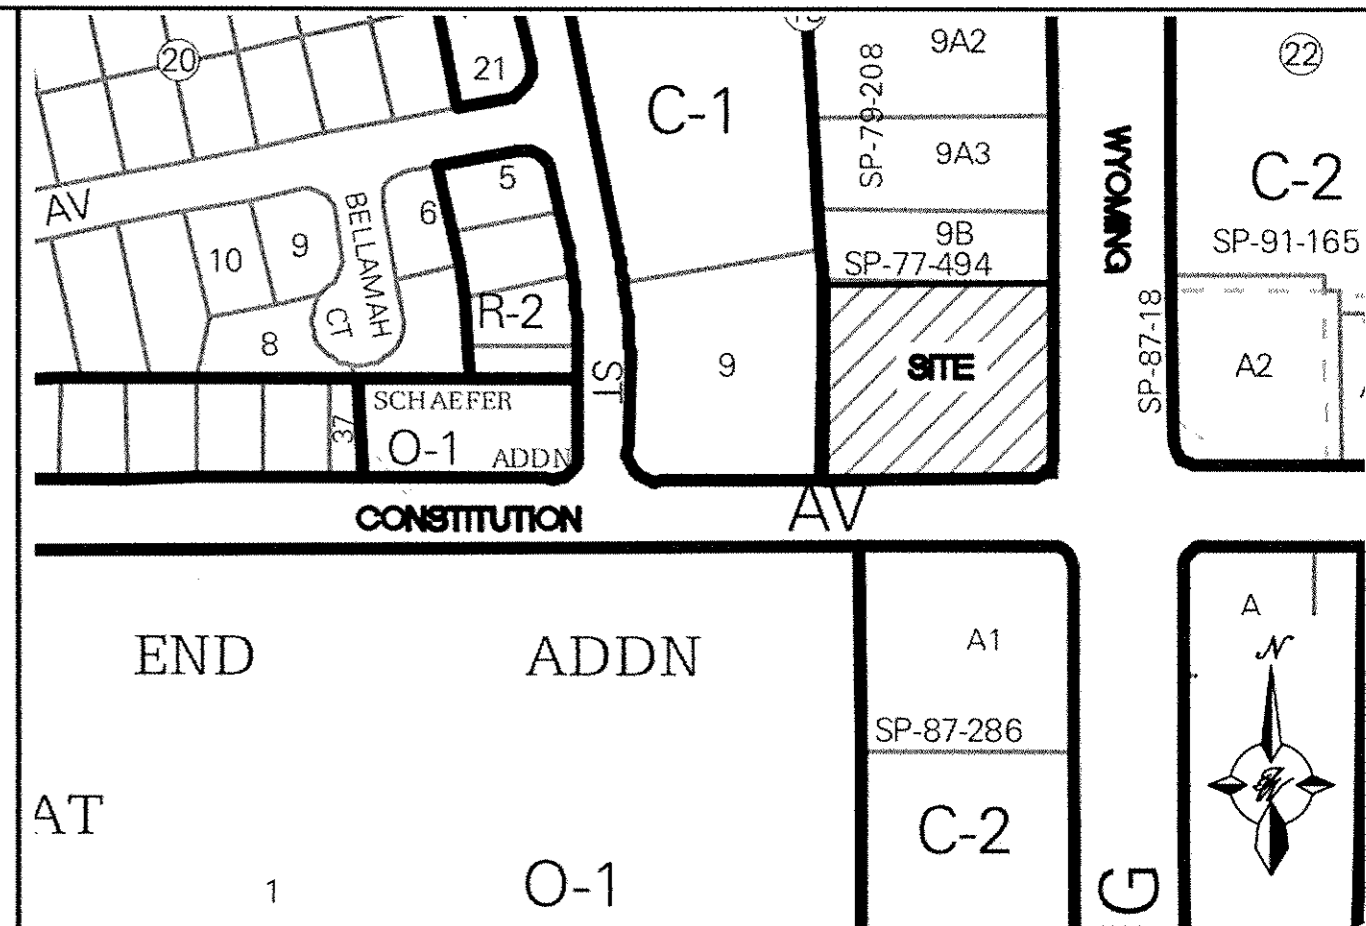

LEGAL DESCRIPTION:

LOT 9A, BLOCK 18 SNOW HEIGHTS


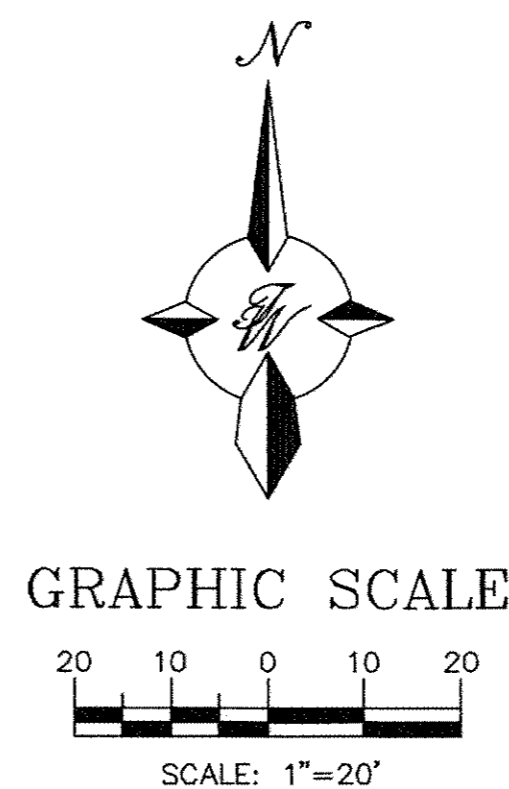


ENGINEER'S SEAL  
RONALD R. BOHANNAN  
REGISTERED PROFESSIONAL ENGINEER  
NEW MEXICO  
P.E. #7868


MAVERIK  
1401 WYOMING BLVD. NE  
DEVELOPED DRAINAGE  
PLAN  
TERRA WEST, LLC  
5571 MIDWAY PARK PLACE NE  
ALBUQUERQUE, NM 87109  
(505) 858-3100  
www.tierrowestllc.com

DRAWN BY  
RS  
DATE  
2/5/2019  
2018055-DRAINAGE  
DEVELOPED  
SHEET #  
C3  
JOB #  
2018055

Z:\2018\2018055\_Maverik\_Wyoming & Constitution.dwg, DRB\2018055-GR.dwg Feb. 25, 2019 - 3:45pm

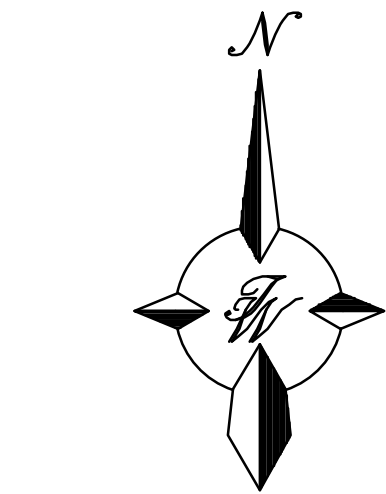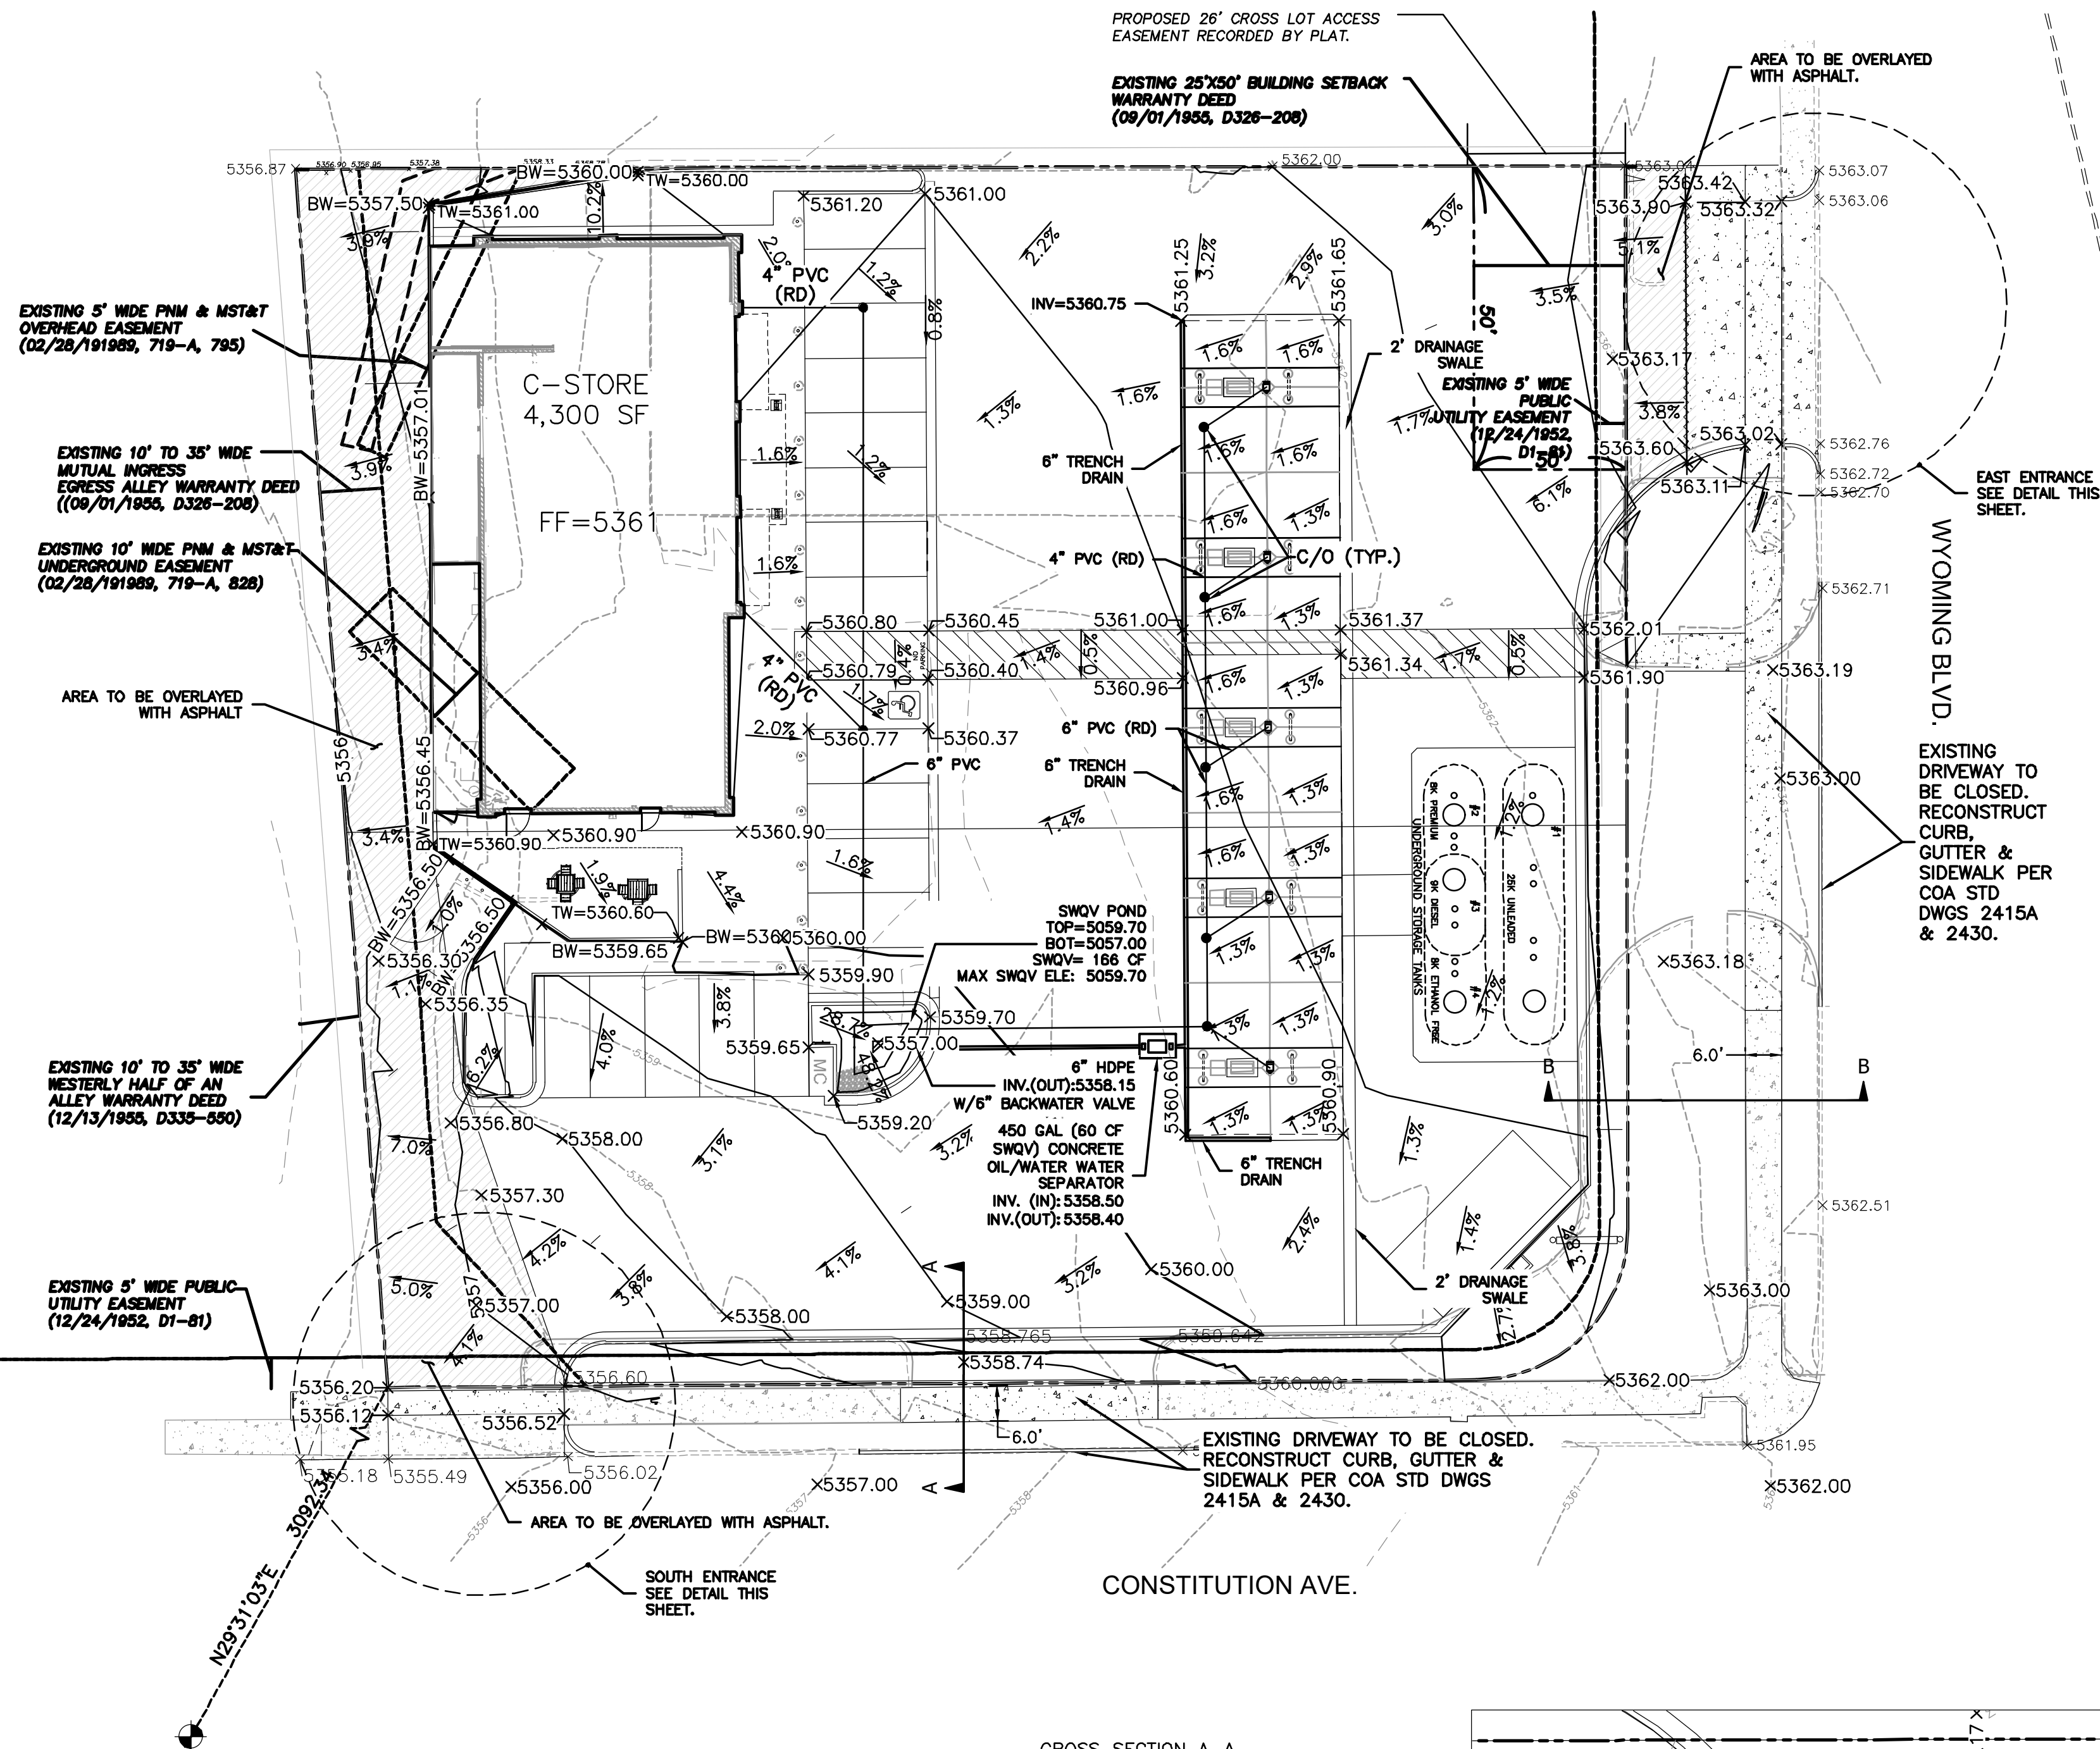

GRAPHIC SCALE



SCALE: 1"=20'

#### LEGEND

	CURB & GUTTER
	BOUNDARY LINE
	EASEMENT
	SIDEWALK
	CONTOUR MAJOR
	CONTOUR MINOR
	SPOT ELEVATION
	FLOW ARROW
	EXISTING CURB & GUTTER
	EXISTING CONTOUR MAJOR
	EXISTING CONTOUR MINOR
	EXISTING SPOT ELEVATION
	ASPHALT OVERLAY
	EXISTING PUBLIC SIDEWALK
	NEW PUBLIC SIDEWALK

#### NOTICE TO CONTRACTORS

1. AN EXCAVATION/CONSTRUCTION PERMIT WILL BE REQUIRED BEFORE BEGINNING ANY WORK WITHIN CITY RIGHT-OF-WAY.
2. ALL WORK DETAILED ON THESE PLANS TO BE PERFORMED, EXCEPT AS OTHERWISE STATED OR PROVIDED HEREON, SHALL BE CONSTRUCTED IN ACCORDANCE WITH CITY OF ALBUQUERQUE INTERIM STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION, 1985.
3. TWO WORKING DAYS PRIOR TO ANY EXCAVATION, CONTRACTOR MUST CONTACT LINE LOCATING SERVICE, 765-1234, FOR LOCATION OF EXISTING UTILITIES.
4. PRIOR TO CONSTRUCTION, THE CONTRACTOR SHALL EXCAVATE AND VERIFY THE HORIZONTAL AND VERTICAL LOCATIONS OF ALL CONNECTIONS. SHOULD A CONFLICT EXIST, THE CONTRACTOR SHALL NOTIFY THE ENGINEER SO THAT THE CONFLICT CAN BE RESOLVED WITH A MINIMUM AMOUNT OF DELAY.
5. BACKFILL COMPACTION SHALL BE ACCORDING TO TRAFFIC/STREET USE.
6. MAINTENANCE OF THESE FACILITIES SHALL BE THE RESPONSIBILITY OF THE OWNER OF THE PROPERTY SERVED.
7. WORK ON ARTERIAL STREETS SHALL BE PERFORMED ON A 24-HOUR BASIS.

#### EROSION CONTROL NOTES:

1. CONTRACTOR IS RESPONSIBLE FOR OBTAINING A TOPSOIL DISTURBANCE PERMIT PRIOR TO BEGINNING WORK.
2. CONTRACTOR IS RESPONSIBLE FOR MAINTAINING RUN-OFF ON SITE DURING CONSTRUCTION.
3. CONTRACTOR IS RESPONSIBLE FOR CLEANING ALL SEDIMENT THAT GETS INTO EXISTING RIGHT-OF-WAY.
4. REPAIR OF DAMAGED FACILITIES AND CLEANUP OF SEDIMENT ACCUMULATIONS ON ADJACENT PROPERTIES AND IN PUBLIC FACILITIES IS THE RESPONSIBILITY OF THE CONTRACTOR.
5. ALL EXPOSED EARTH SURFACES MUST BE PROTECTED FROM WIND AND WATER EROSION PRIOR TO FINAL (CITY) ACCEPTANCE OF ANY PROJECT.



VICINITY MAP



FRM MAP: #35001C0356H DATED 8/16/2012

#### LEGAL DESCRIPTION:

LOT 9A, BLOCK 18 SNOW HEIGHTS

#### NOTES


THE PARCELS 1401 AND 1415 WYOMING BLVD. NE. WILL BE CONSOLIDATED THROUGH A LOT LINE ELIMINATION RE-PLAT.

#### BMP SWQV NOTES


THE SWQV COULD BE MANAGED ONSITE HOWEVER THE DEVELOPER IS CHOOSING PAYMENT IN LIEU. A TOTAL OF 547 CF VOLUME IS NOT BEING CAPTURED AND THEREFORE GENERATES A FEE IN LIEU OF \$4,376.00

A.G.R.S. MONUMENT "17\_K19"  
STANDARD C.O.A. ALUMINUM DISC  
(FOUND IN PLACE)  
NEW MEXICO STATE PLANE COORDINATES  
(CENTRAL ZONE-N.A.D. 1983)  
N=1,487,200.514 US SURVEY FEET  
E=1,548,658.888 US SURVEY FEET  
PUBLISHED EL=5344.389 US SURVEY FT (NAVD 1988)  
GROUND TO GRID FACTOR=0.999657877  
DELTA ALPHA ANGLE=-0°10'34.73"


#### CROSS SECTION A-A

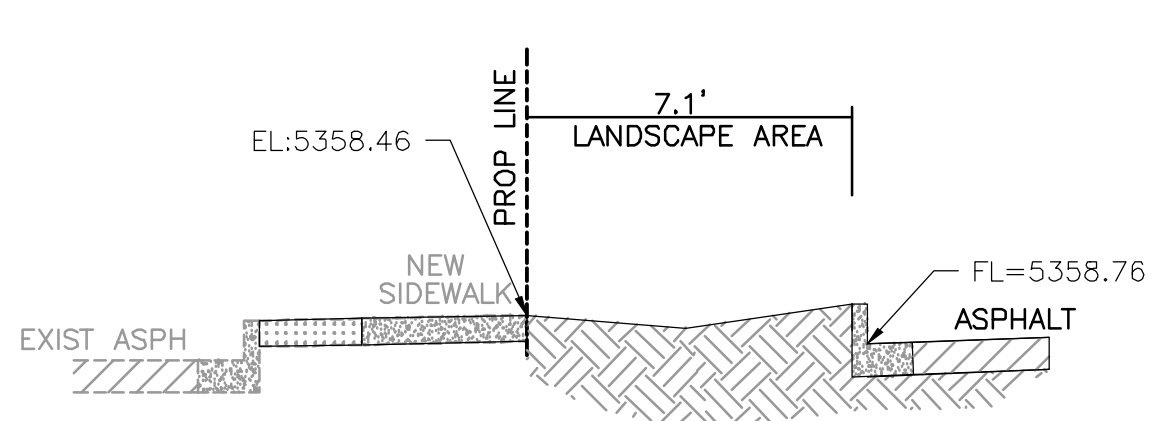


#### SECTION A-A NTS

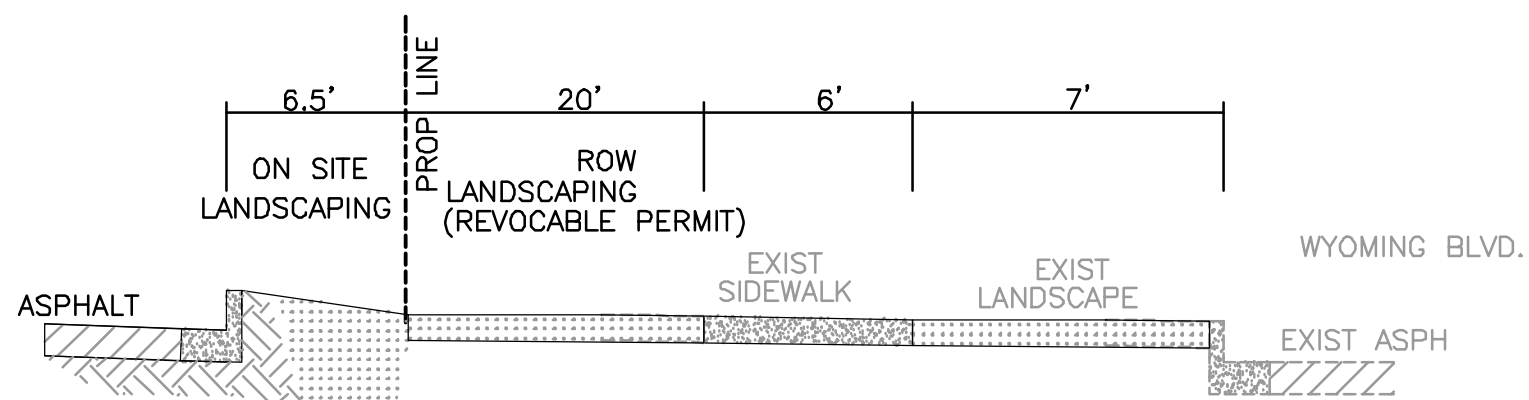

#### SECTION B-B NTS

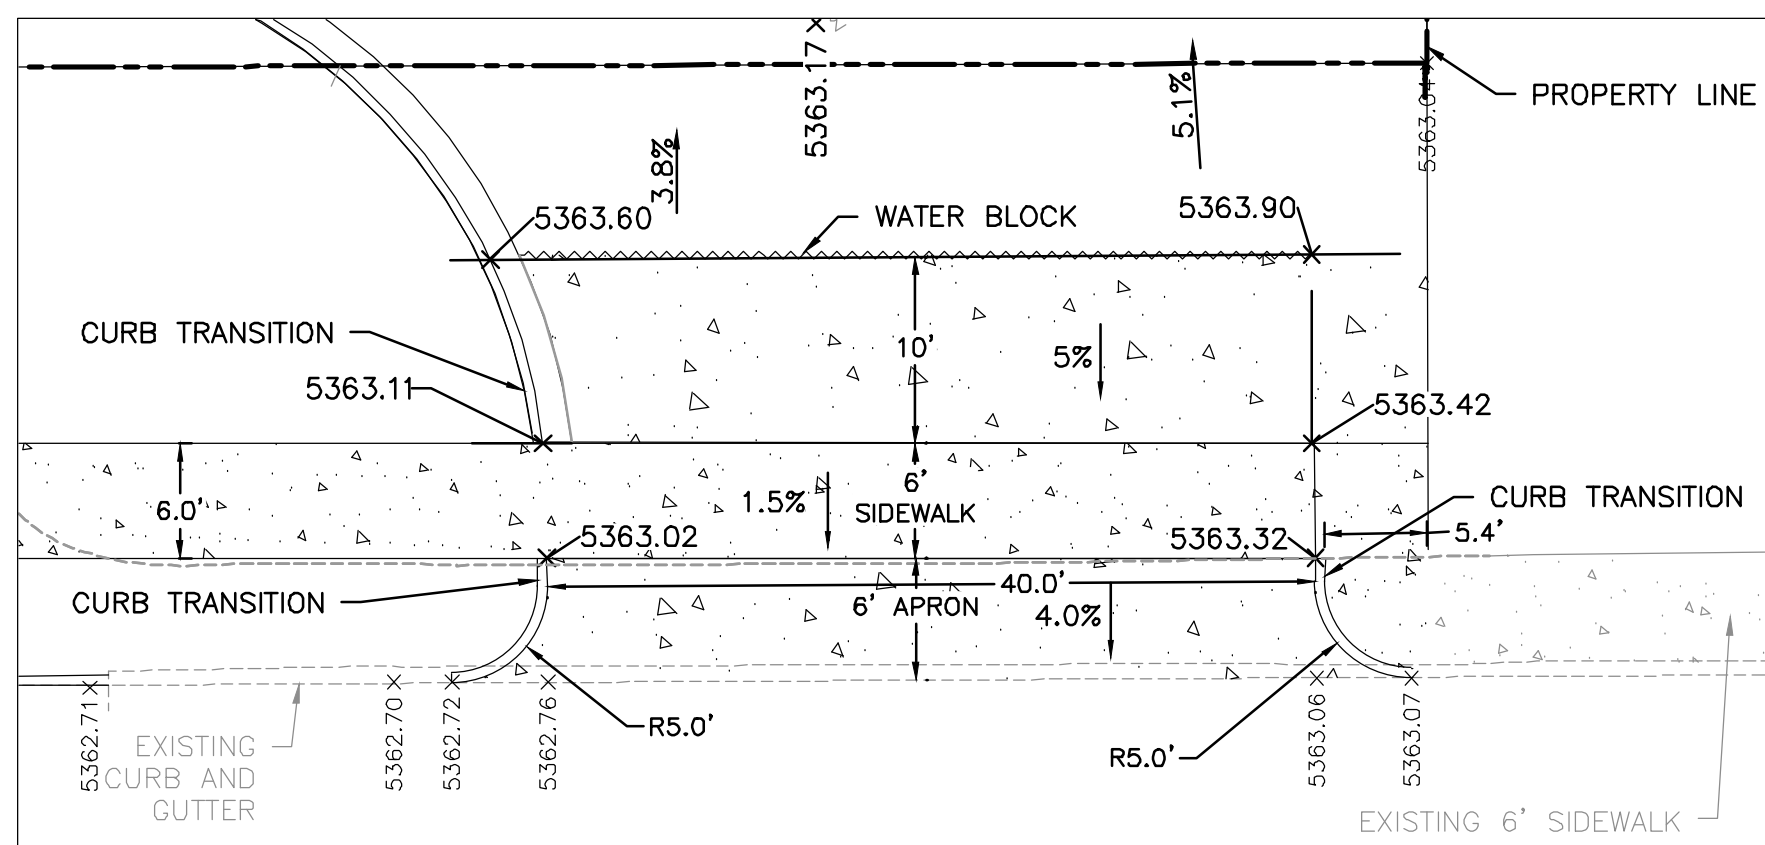


WYOMING BLVD. DRIVEWAY (EAST ENTRANCE)  
REFER NM DOT DRIVEWAY APRONS TYPE 2A  
SC: 1"=10'

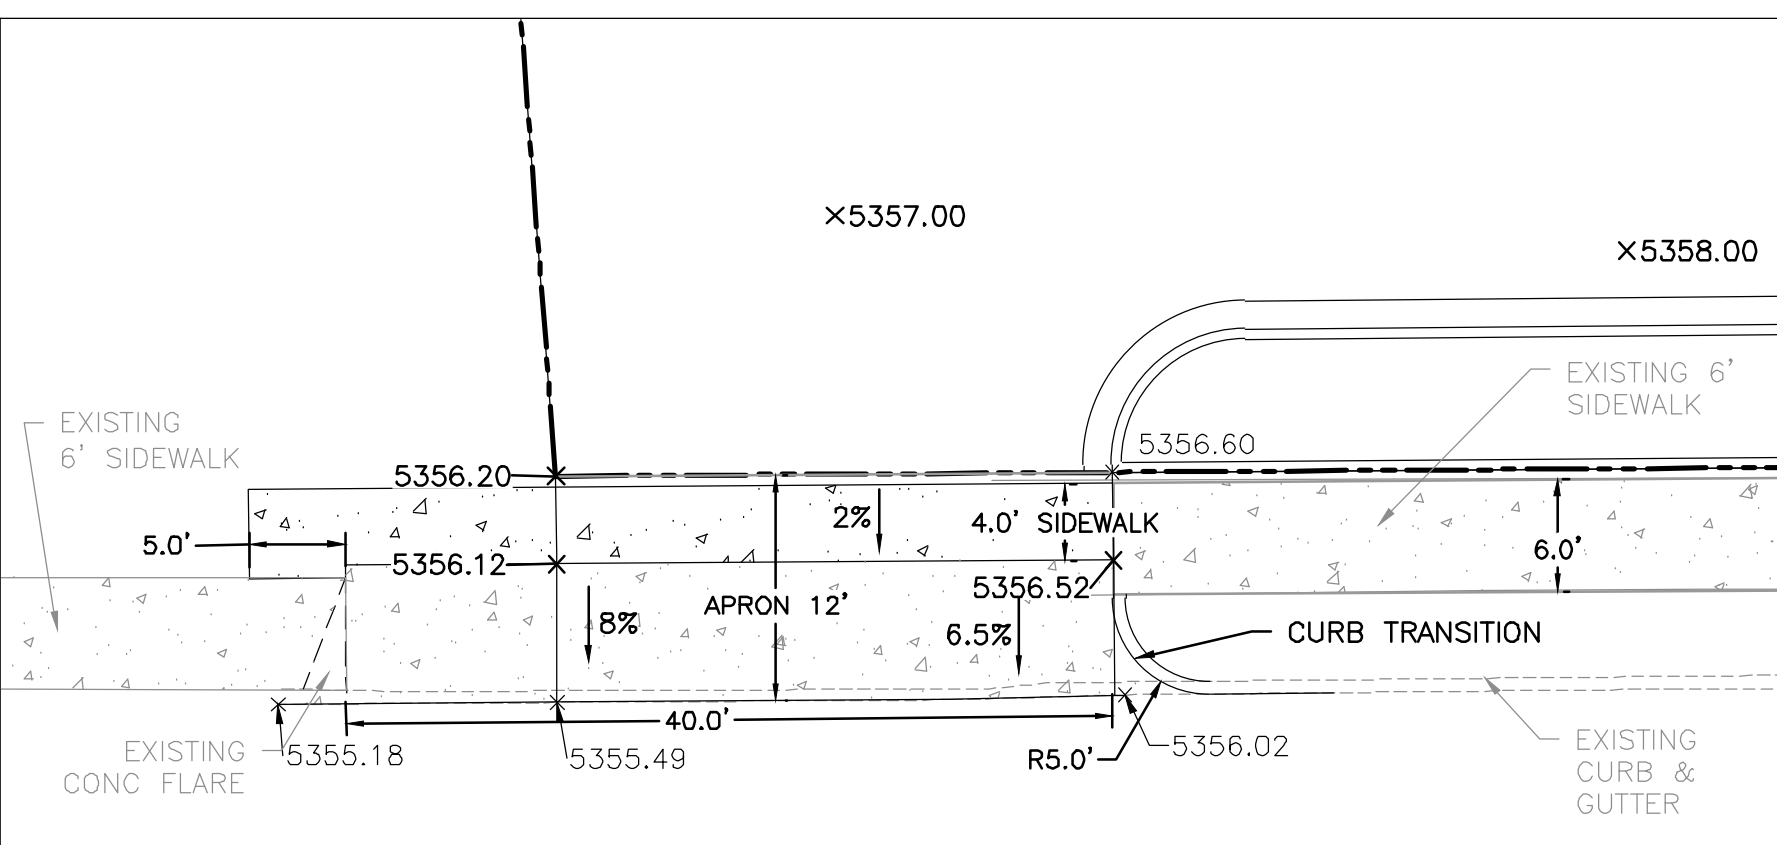

CONSTITUTION BLVD. ENTRANCE (SOUTH  
ENTRANCE) REFER NM DOT DRIVEWAY  
APRONS TYPE 2A  
SC: 1"=10'

#### CAUTION:

ALL EXISTING UTILITIES SHOWN WERE OBTAINED FROM RESEARCH, AS-BUILTS, SURVEYS OR INFORMATION PROVIDED BY OTHERS. IT SHALL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR TO CONDUCT ALL NECESSARY FIELD INVESTIGATIONS PRIOR TO AND INCLUDING ANY EXCAVATION, TO DETERMINE THE ACTUAL LOCATION OF UTILITIES AND OTHER IMPROVEMENTS, PRIOR TO STARTING THE WORK. ANY CHANGES FROM THIS PLAN SHALL BE COORDINATED WITH AND APPROVED BY THE ENGINEER.

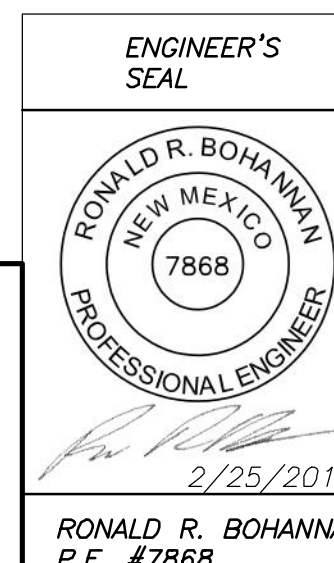

**MAVERIK**  
1401 WYOMING BLVD. NE  
**GRADING AND DRAINAGE PLAN**

**TERRA WEST, LLC**  
5571 MIDWAY PARK PLACE NE  
ALBUQUERQUE, NM 87109  
(505) 858-3100  
www.tierrowestllc.com

DRAWN BY  
RS  
DATE  
2/25/2019  
2018055-GR

SHEET #  
**C2**

JOB #  
2018055