



GEOTEXTILE OVER WIRE FENCE

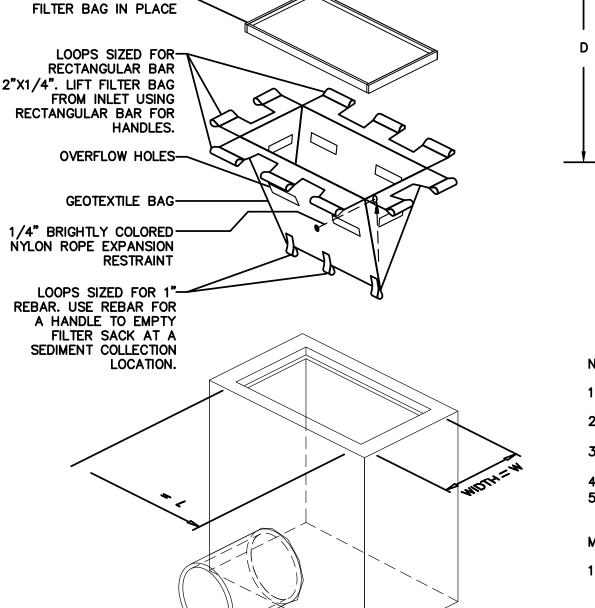

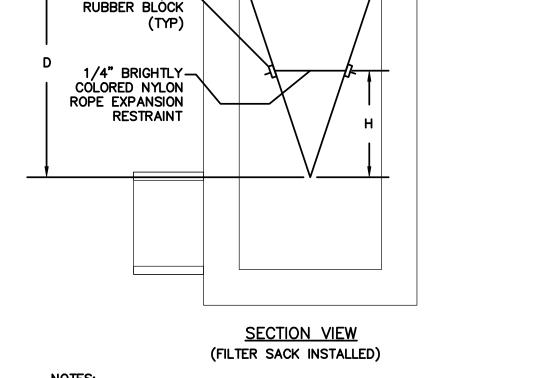

NOTES:

- 1. GEOTEXTILE SHALL BE A WOVEN POLYPROPYLENE FABRIC THAT MEETS OR EXCEEDS
- REQUIREMENTS IN THE SPECIFICATIONS TABLE. 2. PLACE AN OIL ABSORBENT PAD OR PILLOW OVER INLET GRATE WHEN OIL SPILLS ARE A
- 3. THE WIDTH, "W", OF THE FILTER SACK SHALL MATCH THE INSIDE WIDTH OF THE GRATED INLET BOX.
- 4. THE DEPTH, "D", OF THE FILTER SACK SHALL BE BETWEEN 18 INCHES AND 36 INCHES.
- 5. THE LENGTH, "L", OF THE FILTER SACK SHALL MATCH THE INSIDE LENGTH OF THE GRATED INLET BOX.


MAINTENANCE NOTES:

- 1. INLET PROTECTION DEVICES MUST BE INSPECTED FOR SEDIMENT ACCUMULATION WITHIN THE CATCH BASIN. REMOVE TRAPPED SEDIMENT WHEN BRIGHTLY COLORED EXPANSION RESTRAINT CAN NO LONGER BE SEEN.
- 2. REMOVAL OF SEDIMENT ACCUMULATED IN OR ADJACENT TO A STORM DRAIN INLET MUST BEGIN IMMEDIATELY UPON DISCOVERY, WITH COMPLETION OF THE ACTIVITY
- OCCURRING NO LATER THAN THE END OF THE FOLLOWING BUSINESS DAY. 3. INLET PROTECTION DEVICES SHALL BE INSPECTED FOR UNINTENDED BYPASS OR
- IMPROPER FLOW-RATES THAT MAY CAUSE DOWNSTREAM FLOODING. 4. CONTACT THE CEC FOR ALTERNATE INLET PROTECTION IF THE DESIGNED PROTECTION
- MAY IMPACT DOWNSTREAM BMPS, ADJACENT SLOPES, ETC., DUE TO PONDING ISSUES. ENSURE THAT NO UNDERMINING OF INLET PROTECTION DEVICES HAS OCCURRED.
- 5. INLET PROTECTION DEVICES AND BARRIERS SHALL BE REPAIRED OR REPLACED IF THEY SHOW SIGNS OF UNDERMINING OR DETERIORATION.

POSTS: STEEL EITHER T OR U TYPE.				
FENCE: WOVEN WIRE, 14-1/2 GA. 6" MAX. MESH OPENING				
FABRIC: 1. AMOCO 1198 2. BELTECH 810 3. MIRAFI 130X 4. LING GTF 190 5. SI 915 SC	ISOME	TRIC VIEW		
J. 31 913 3C				
	LOW TO MODERATE FLOW GE	LOW TO MODERATE FLOW GEOTEXTILE FABRIC SPECIFICATION TABLE		
	PROPERTIES	TEST METHOD	UNITS	
EXTEND WIRE FENCE A I. OF 2" INTO TRENCH	GRAB TENSILE STRENGTH GRAB TENSILE ELONGATION PUNCTURE MULLEN BURST TRAPEZOID TEAR	ASTM D-4632 ASTM D-4632 ASTM D-4833 ASTM D-3786 ASTM D-4533	300 LBS 20 % 120 LBS 800 PSI 120 LBS	
DDED GEOTEXTILE FABRIC N. 6" INTO GROUND LAID ALONG BOTTOM OF TRENCH	UV RESISTANCE APPARENT OPENING SIZE FLOW RATE PERMITTIVITY	ASTM D-4355 ASTM D-4751 ASTM D-4491 ASTM D-4491	80 % 40 US SIEVE 40 GAL/MIN/SQ FT 0.55 SEC -1	

PECIFICATION TABLE	MODERATE TO HIGH FLOW	GEOTEXTILE FABRIC	SPECIFICATION TABLE
UNITS	PROPERTIES	TEST METHOD	UNITS
300 LBS 20 % 120 LBS 800 PSI 120 LBS 80 % 40 US SIEVE 40 GAL/MIN/SQ FT 0.55 SEC -1	GRAB TENSILE STRENGTH GRAB TENSILE ELONGATION PUNCTURE MULLEN BURST TRAPEZOID TEAR UV RESISTANCE APPARENT OPENING SIZE FLOW RATE PERMITTIVITY	ASTM D-4632 ASTM D-4632 ASTM D-4833 ASTM D-3786 ASTM D-4533 ASTM D-4355 ASTM D-4751 ASTM D-4491 ASTM D-4491	265 LBS 20 % 135 LBS 420 PSI 45 LBS 90 % 20 US SIEVE 200 GAL/MIN/SQ FT 1.5 SEC -1

INLET PROTECTION FILTER SACK

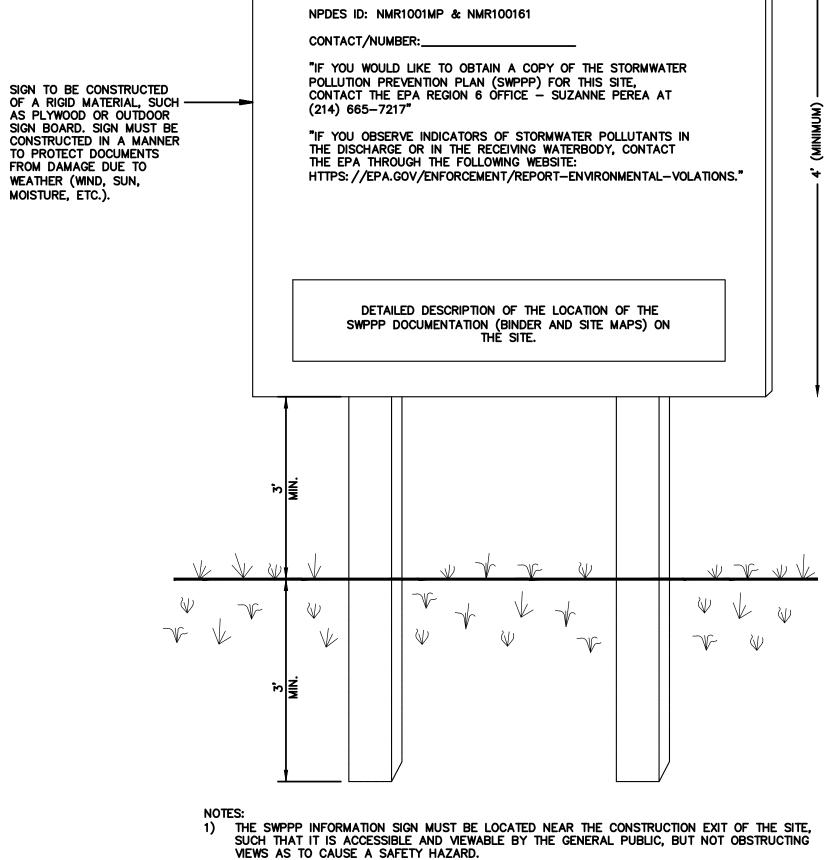

SWPPP INFORMATION

"SWPPP INFORMATION" MUST— BE DISPLAYED PROMINENTLY ACROSS THE TOP OF THE SIGN, AS SHOWN IN THE DETAIL.

FROM DAMAGE DUE TO WEATHER (WIND, SUN, MOISTURE, ETC.).

- 2) ALL POSTED DOCUMENTS MUST BE MAINTAINED IN A CLEARLY READABLE CONDITION AT ALL TIMES THROUGHOUT CONSTRUCTION AND UNTIL THE NOTICE-OF-TERMINATION (NOT) IS FILED FOR THE
- 3) CONTRACTOR SHALL POST OTHER STORM WATER AND/OR EROSION AND SEDIMENT CONTROL RELATED PERMITS ON THE SIGN AS REQUIRED BY THE GOVERNING AGENCY.
- 4) SIGN SHALL BE LOCATED OUTSIDE OF PUBLIC RIGHT-OF-WAY AND EASEMENTS UNLESS APPROVED
- BY THE GOVERNING AGENCY. 5) CONTRACTOR IS RESPONSIBLE FOR ENSURING STABILITY OF THE SWPPP INFORMATION SIGN.

SWPPP INFORMATION SIGN (SS)

ENGINEER'S SEAL	E
R. BOHANDAZ RETICO 7868 PR	E
PROPERTY OF THE PROPERTY OF TH	

P.E. #7868

ENGINEER'S SEAL	BLUE SKY DISTRIBUTING ALBUQUERQUE, NM	<i>DRAWN BY</i> pm
DR. BOHAND PZ 7868	ALBOQUENCOE, NIVI	DATE
	EROSION CONTROL	7-19-2022
	DETAILS	<i>DRAWING</i> 2020088-SWPPP.DWG
PROTITIONAL ENGINE		SHEET #
7-19-2022	5571 MIDWAY PARK PL NE ALBUQUERQUE, NEW MEXICO 87109	SW-3
RONALD R. BOHANNAN (505) 858-3100 www.tierrawestllc.com		JOB #

2020088

1. WOVEN WIRE FENCE TO BE FASTENED SECURELY TO FENCE POSTS WITH WIRE TIES.

2. GEOTEXTILE TO BE FASTENED SECURELY TO WOVEN WIRE FENCE WITH TIES SPACED EVERY

3. WHEN TWO SECTIONS OF GEOTEXTILE ADJOIN EACH OTHER THEY SHALL BE OVERLAPPED

BY SIX INCHES AND FOLDED.

4. MAINTENANCE SHALL BE PERFORMED AS NOTED IN THE EROSION CONTROL PLAN. COLLECTED MATERIAL SHALL BE REMOVED WHEN "BULGES" DEVELOP IN THE SILT FENCE.

ELEVATION

BACKFILL

A-A-SECTION

24" AT TOP AND MID SECTION.

WOVEN WIRE FENCE (MIN. 14 1/2 GAUGE, \angle

FINISH GRADE —

MAX. 6" MESH SPACING) WITH GEOTEXTILE COVER

FLOW

UNDISTURBED —

COMPACTED BACKFILL

5. ALL SILT FENCE SHALL INCLUDE WIRE SUPPORT UNLESS INDICATED OTHERWISE

SEDIMENTATION/SILT FENCE WITH WIRE SUPPORT

EXTEND WIRE FENCE A

EMBEDDED GEOTEXTILE FABRIC

MIN. 6" INTO OBOUND

W/ 6" LAID ALONG BOTTOM OF TRENCH

MIN. OF 2" INTO TRENCH