

Zuni




Albuquerque Public Schools  
Highland High School  
Gymnasium Upgrade

Receiving Waters and Critical Habitat: Rio Grande is located 8.9 miles to the SouthWest.  
Impairments: E. coli, Dissolved Oxygen, PCBs in Fish Tissue, Water Temperature  
Grade: Before and After 1%



For use in High Water Table Areas

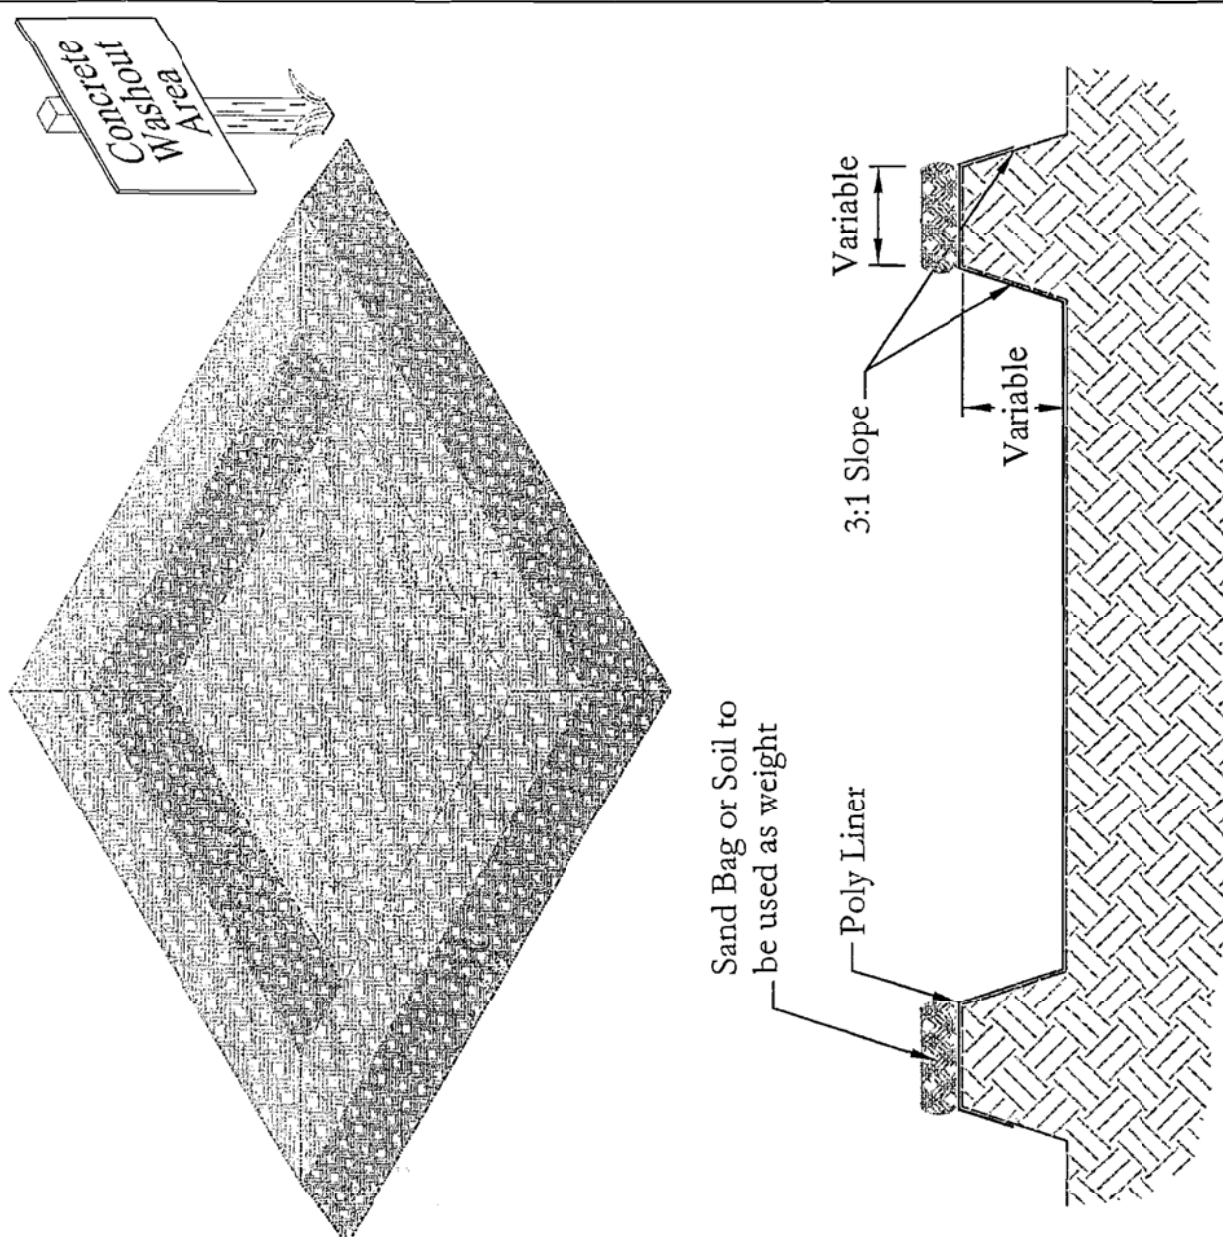

**1. Remove sediment, debris, ice and snow from the inlet grate surface and surrounding area.**

2. Verify fit by placing filter over inlet grate to ensure that Inlet Filter extends at least one inch beyond the front and both curb ends. The overlap slows water



flow and starts filtering sediment and debris before water drops into the inlet.

- 3. Position the mat.** Place Inlet Filter on grate with the net side down, flush to the back edge and extending beyond the grate opening on the front and both sides. The zip ties attach Inlet Filter to the inlet grate cover **WITHOUT LIFTING THE GRATE COVER.**



- 4. The filter material covering the inlet can be any material that will prevent the sediment and other foreign matter from entering the**

## storm drain system.

**Definition**  
A stabilized layer of aggregate that is underlain with Geotextile Class "C" (See Standards for Geotextile). Stabilized entrances are located at any point where traffic enters or leaves a construction site.

### The purpose

The purpose of the stabilized construction entrance is to reduce tracking of sediment onto streets or public rights-of-way and provide a stable area for entrance or exit from the construction site.

1 Stabilized construction entrances shall be located at no

2. For single family residences, the entrance should be located at the permanent driveway.
3. Stabilized construction entrances should not be used on existing pavement.

---

Length - Minimum

2. Width - Minimum of 30'-0", should be flared at the existing road to provide a turning radius.
3. Geotextile Class "C" shall be placed over the existing ground prior to placing stone. Plan approval authority may not require geotextile fabric for single family residence.
4. Stone-crushed aggregate, 2"-3" (See Standards for Geotextile and Rock). Recycled concrete equivalent may be used. The rock should be placed at least 6' deep over the length and width of the entrance.
5. Surface Water - All the surface water flowing to or diverted toward construction entrances shall be piped under the entrance to maintain positive drainage. The pipe under the construction entrance shall be protected with a mountable berm. The pipe shall be sized according to the drainage, with a minimum diameter being 6".
6. Location - A stabilized construction entrance shall be located at every point where construction traffic enters or leaves the site. The entrance shall not travel over the entire length of the stabilized construction entrance.

Figure 1: Typical Detail of Wall and Floor Slab. The diagram illustrates the construction details for a wall and floor slab. The wall section on the left is 16' Min. high and 8' Min. wide, featuring wire reinforcement and a filter cloth. The floor slab section on the right is 16' Min. high and 8' Min. wide, also featuring wire reinforcement and a filter cloth. A metal post connects the wall and floor slab. The wall is labeled 'Wire Reinforcement with 1 Layer of Filter Cloth Over' and '16' Min.'. The floor slab is labeled 'Wire Reinforcement', 'Filter Cloth over', 'Wire Reinforcement', 'Compacted Fill', '6' Min.', and '8' Min.'. The wall and floor slab are connected by a 'Metal Post'. The wall is labeled '16' Min.' and the floor slab is labeled '16' Min.'.

A temporary barrier of Geotextile Class "F" over wire reinforcement used to intercept sediment laden runoff from small drainage areas.

The purpose of silt fence is to reduce runoff where velocity and allow the deposition of transported sediment to occur. Limits imposed by ultraviolet light on the stability of the fabric will dictate the maximum period that the silt fence may be used.

1. Silt fence provides a barrier that can collect and hold debris and soil, preventing the material from entering critical areas, streams, streets, etc.
2. Silt fence can be used where the installation of a dike would destroy sensitive areas, woods, wetlands, etc.

Silt Fence is limited to intercepting sheet flow runoff from limited distances according to slope. It provides filtering and velocity dissipation to promote gravity settling of sediment.

**Steel posts must be used.** Silt fence should be placed as close to the contour as possible. No section of silt fence should exceed a grade of 5 percent for a distance more than 50 feet. Where ends of the geotextile fabric come together, the ends shall be overlapped, folded, and stapled to prevent sediment bypass. The length of the flow contributing to silt fence shall conform to the following limitations.

Slope (%)	Slope Steepness	Slope Length (Ft.) (Maximum)	Sill Fence Length (Ft.) (Maximum)
0-10	0-10:1	Unlimited	Unlimited
10-20	10:1-5:1	200	1,500
20-23	5:1-3:1	100	1,000
33-50	3:1-2:1	100	500
50 +	2:1 +	50	250

**Albuquerque Public Schools**  
**Highland High School**  
**Gymnasium Upgrade**

**Receiving Waters and Critical Habitat:** Rio Grande is located 8.9 miles to the SouthWest.

**Impairments: E. coli, Dissolved Oxygen, PCBs in Fish Tissue, Water Temperature**

**Grade: Before and After 1%**

