CITY OF ALBUQUERQUE

Richard J. Berry, Mayor

November 21, 2017

Mark Goodwin, P.E.
Mark Goodwin & Associates
PO Box 90606
Albuquerque, NM, 87199

RE: Juan Tabo Hills Estates
Drainage Report- Onsite Drainage Analysis, Volume 1 of 3, Addendum 1 (HGL)
Stamp Date: 3/8/2017
Hydrology File- M21D018; DRB# 1005278; CoA Project# 654887

Dear Mr. Goodwin:

Based on the information provided in your submittal received 3/16/17, the Drainage Report is approved for Work Order for construction of the subdivision public improvements (CPN# 654887) with the following understanding:

1. The HGL's provided in appendices 3-8 do not match. This appears to be the result of water surface disconnects caused by inverts of the stemlines entering the trunkline above the trunkline HGL. Hydrology has reviewed these discrepancies and does not believe they create and adverse impact on system function or public safety.
2. SDMH-29, at the Cougar Run Hammerhead, will require a pressure manhole and the submittal for this manhole will be provided at time of the Pre-Con meeting.
3. Use of the pipeful velocity as the 100-year velocity is unacceptable. Hydrology understands that the velocity profile changes within each pipe element; therefore the lowest modeled velocity will be stated on plans.
4. As-built drawings for CPN#688854 (Sandia Sunset stormdrain trunk) will need to be updated to reflect the updated velocities and flows.
5. Per the City Engineer, 1 ½" clear space between reinforcement and form work is insufficient and needs to be increased to 2"-3". This applies to sheet73.
6. This approval letter supersedes the disapproval letter dated 4/7/2017.

Addendum 2 of the Drainage Report- Onsite Drainage Analysis, Volume 1 of 3, contains no drainage calculations and is disapproved. Since the submittal of this Drainage Report on 3/16/17, the following actions have been taken:

- FEMA has approved the CLOMR
- The ESC has been submitted and approved
- The Floodplain Permit has been submitted and approved
- USACE has concurred that the project (within their jurisdiction) is allowed to proceed

PO Box 1293

Albuquerque

NM 87103

www.cabq.gov

Orig: Drainage File

CITY OF ALBUQUERQUE

Richard J. Berry, Mayor

- The Grading and Drainage Plan has been approved for Preliminary Plat and Grading Permit.
- The Work Order for the Sandia Sunset stormdrain trunk (CPN#688854) has been approved for construction and is under construction.
- The Work Order for the bank protection (CPN# 654886) is at DRC but the final design elements are still being worked out with AMAFCA.
- The Work Order for the subdivision public improvements (CPN# 654887) is at DRC, but has not been approved by Hydrology, DRC Chair, or City Engineer.

If you have any questions, you can contact me at 924-3695 or dpeterson@cabq.gov.

Sincerely,

Dana Peterson, P.E.
Senior Engineer, Planning Dept.
Development Review Services

PO Box 1293

Albuquerque

NM 87103

www.cabq.gov

Orig: Drainage File

CITY OF ALBUQUERQUE

Richard J. Berry, Mayor

April 7, 2017

James D. Hughes, P.E.
Mark Goodwin & Associates
PO Box 90606
Albuquerque, NM, 87199

RE: Juan Tabo Hills Estates
Drainage Report- Onsite Drainage Analysis, Volume 1 of 3, Addendum 1 (HGL)
Stamp Date: 3/8/2017
Hydrology File- M21D018; DRB# 1005278; CoA Project# 654887

Dear Mr. Hughes:

Based upon the information provided in your submittal received 3/16/17, the Drainage Report cannot be approved for Work Order for construction of the subdivision public improvements as shown in Project# 654887 until the following comments are addressed:

1. The outfall structure from the storm water quality pond into the Tijeras Arroyo needs to be designed and reflected in this report. This outfall will need to include a water quality feature to trap floatables in the pond and comply with AMAFCA's requirements to be protective of the shotcrete scour wall. The current design, as stated in section 4.1 does not explain how floatables are trapped. Plans for this structure may be included in the Work order Set for either Project# 654886 or 654887.

2. Include clarifying language that the berm for the storm water quality pond does not meet the NMOSE's minimum height and storage criteria to be considered a jurisdictional dam.

3. In Section 5, the HGL is stated to be belowground everywhere, however the plans appear to have two areas where the HGL daylights:
   a. The first is at the hammerhead at the south terminus of Cougar Run (SDMH-29). Surcharging here will require a pressure manhole and confirmation that the lowest adjacent house remains 1 foot above the HGL.
   b. The second area is in the open space between Blue Ribbon and Sandia Sunset. Several grates appear to surcharge (Inlets 68, 73, and 72). These should be tack welded to prevent theft; this will also resolve surcharging concerns.

   Please verify the HGL against the proposed grades as shown in plans and update Section 5 and the design accordingly.

PO Box 1293

Albuquerque

New Mexico 87103

www.cabq.gov

Orig: Drainage File

CITY OF ALBUQUERQUE

Richard J. Berry, Mayor

4. The HGL's, velocities, and storm drain slopes (Appendixes 2-11) do not match those reported on the work order plans (Project# 654887). This was noted along the main trunk under Sandia Sunset, but is also apparent in other areas. Resolve these discrepancies to reflect the correct design.

Since the submittal of this Drainage Report on 3/16/17, the following actions have been taken:

- FEMA has approved the CLOMR
- The ESC has been submitted and approved
- The Floodplain Permit has been submitted and approved
- USACE has concurred that the project (within their jurisdiction) is allowed to proceed
- The Grading and Drainage Plan has been approved for Preliminary Plat and Grading Permit.
- Work Order Sets for the bank protection features (Project# 654886) and the subdivision public improvements (Project# 654887) are in DRC, but are not yet approved.

Please inform Mr. Rudy Rael at 924-3977 prior to commencing work in the floodplain. If you have any questions, you can contact me at 924-3695.

PO Box 1293

Albuquerque

New Mexico 87103

www.cabq.gov

Sincerely,

Dana Peterson, P.E.
Senior Engineer, Planning Dept.
Development Review Services

Orig: Drainage File

City of Albuquerque

Planning Department

Development & Building Services Division

DRAINAGE AND TRANSPORTATION INFORMATION SHEET (REV 09/2015)

Project Title: Juan Tabo Hills West Building Permit #: _____ City Drainage #: M-21D018

DRB#: 1005278 EPC#: 1001370 Work Order#: 654885

Legal Description: Tract A Juan Tabo Hills West/Tract 1-A-1 Juan Tabo Hills Unit 2

City Address: Juan Tabo and Tijeras Arroyo

Engineering Firm: Mark Goodwin & Associates, PA Contact: Doug Hughes

Address: PO BOX 90606, Albuquerque, NM 87199

Phone#: 505-828-2200 Fax#: _____ E-mail: doug@goodwinengineers.com

Owner: Eastland Development, Inc. Contact: Rex Wilson

Address: PO BOX 9470, Albuquerque, NM 87119

Phone#: 505-899-6768 Fax#: _____ E-mail: rwr2d2@aol.com

Architect: _____ Contact: _____

Address: _____

Phone#: _____ Fax#: _____ E-mail: _____

Other Contact: Aldrich Land Surveying Contact: Tim Aldrich

Address: PO BOX 30701, Albuquerque, NM 87190

Phone#: 505-328-3988 Fax#: _____ E-mail: tim.aldrich@comcast.net

Check all that Apply:

DEPARTMENT:

X HYDROLOGY/ DRAINAGE

_____ TRAFFIC/ TRANSPORTATION

_____ MS4/ EROSION & SEDIMENT CONTROL

TYPE OF SUBMITTAL:

_____ ENGINEER/ ARCHITECT CERTIFICATION

_____ CONCEPTUAL G & D PLAN

_____ GRADING PLAN

_____ DRAINAGE MASTER PLAN

_____ DRAINAGE REPORT

_____ CLOMR/LOMR

_____ TRAFFIC CIRCULATION LAYOUT (TCL)

_____ TRAFFIC IMPACT STUDY (TIS)

_____ EROSION & SEDIMENT CONTROL PLAN (ESC)

X OTHER (SPECIFY) Design Calcs for DRC Plans

IS THIS A RESUBMITTAL?: _____ Yes _____ No

CHECK TYPE OF APPROVAL/ACCEPTANCE SOUGHT:

_____ BUILDING PERMIT APPROVAL

_____ CERTIFICATE OF OCCUPANCY

_____ PRELIMINARY PLAT APPROVAL

_____ SITE PLAN FOR SUB'D APPROVAL

_____ SITE PLAN FOR BLDG. PERMIT APPROVAL

_____ FINAL PLAT APPROVAL

_____ SIA/ RELEASE OF FINANCIAL GUARANTEE

_____ FOUNDATION PERMIT APPROVAL

_____ GRADING PERMIT APPROVAL

_____ SO-19 APPROVAL

_____ PAVING PERMIT APPROVAL

_____ GRADING/ PAD CERTIFICATION

_____ WORK ORDER APPROVAL

_____ CLOMR/LOMR

_____ PRE-DESIGN MEETING

X OTHER (SPECIFY) DRC

DATE SUBMITTED: March 16, 2017 By: Doug Hughes, PE

COA STAFF: ELECTRONIC SUBMITTAL RECEIVED: ___

Juan Tabo Hills Estates
Onsite Drainage Analysis Report
Volume 1 of 3
Addendum 1 (HGL)

Prepared For:

Eastside Development Inc.LC
P.O. Box 9470
Albuquerque, NM 87119
(505) 899-6768

Prepared By:

Mark Goodwin & Associates, PA
PO BOX 90606
Albuquerque, NM 87199
(505) 828-2200

Contents

Appendencies

1. Inlet Control Nomograph
2. Rocky Top Drive HGL
3. Galant Fox HGL
4. Blue Ribbon HGL
5. Silver Dollar HGL
6. Hubbard HGL
7. Duke City HGL (North of Sandia Sunset Ave)
8. Duke City HGL (South of Sandia Sunset Ave)
9. Tract K HGL (JB to SWQ Pond)
10. Running Bear Ave HGL
11. Manzano Vista HGL
12. Map - HGL Cross Section Plan
13. P&P Sheets
14. Rip Rap

1. Purpose & Scope of Report

The purpose of this addendum is to provide detailed hydraulic design calculations of the storm drain for the Infrastructure Plan approval of the Juan Tabo Hills Estates subdivision. The Juan Tabo Hills Estates Onsite Drainage Report Volume 1 of 3 with engineer's stamp dated 2-10-2016 was approved by City Hydrology in a letter written on Feb. 24, 2016. At that time the preliminary storm drain pipe sizes were based on Manning's equation and the pipe slope. The final storm drain pipe sizes as determined by the calculations in this addendum are based on detailed hydraulic analysis. The HGL is shown on the construction plan and profile sheets as it has been calculated using the WSPGW software. See Volume 1 for hydrology, street, and inlet design calculations. The capacities of streets and interception of inlets on grade were included in Volume 1 and have not changed. This addendum also provides the depth of ponding calculations for sump inlets.

2. Other Reports and Approvals

The Juan Tabo Hills Estates project site covers an area of 78 acres. The site was annexed into the City of Albuquerque (COA) in 2007. The Preliminary Plat was approved by the City of Albuquerque Development Review Board on Feb. 24, 2016 and was granted a one year extension by the DRB on Jan 25, 2017.The approved preliminary plat shows the proposed development of about 350 single family residential lots with all public streets and several HOA tracts for landscaping and trails. An Amended G&D plan with engineer's stamp dated Jan. 26, 2017 shows the same streets and storm drain but shows fewer lots. The city hydrology department approved the Amended G&D Plan in a letter that was written on Feb 23, 2017 with the condition that these detailed calculations be provided prior to construction plan approval.

Due to the nature of this site, the project also requires bank protection of the Tijeras Arroyo, a CLOMR and a 404 Permit. These are addressed in separate volumes of this Drainage Analysis Report as listed below:

- *Volume 2: Bank Protection.* This volume addresses the bank protection to prevent lateral migration of the Tijeras Arroyo. A one sheet Preliminary Tijeras Arroyo Bank Protection plan with engineer's stamp dated 3-24-2016 was distributed at the time of preliminary plat approval and contains the scour depth calculations and other design parameters used for the final design of the shotcrete bank protection.
- *Volume 3: CLOMR.* This volume addresses the fill to remove the FEMA floodplain from within the development. The CLOMR was written by FEMA on Nov. 14, 2016 Case No. 16-06-2447R.
- A Pre-Construction Notification was turned into the USACE and the NMED on June 21, 2016 for use of NWPs 7 and 13 (Outfall Structures and Bank Stabilization) as authorized under sections 404 and 401 of the Clean Water Act. The USACE letter dated July 22, 2016 verified that the activities are authorized and assigned Action No. SPA-2012-00299-ABQ.

3. Vicinity Map & Legal Description

Figure 1 below shows the location of the project site. The site is located on Zone Atlas Map M-21.

Legal Description: *Tract of land situated within Sections 33 and 34, Township 10 North, Range 4 East, New Mexico Principal Meridian, City of Albuquerque, Bernalillo County, New Mexico being all of TRACT A, JUAN TABO HILLS WEST, as the same is shown and designated on said plat filed for record in the office of the County Clerk of Bernalillo County, New Mexico on June 14, 2007 in Book 2007C, Page 161 and TRACT 1-A-1, JUAN TABO HILLS, UNIT 2, as the same is shown and designated on said plat filed for record in the office of County Clerk of Bernalillo County, New Mexico on February 20, 2008 in Book 2008C, Page 30.*

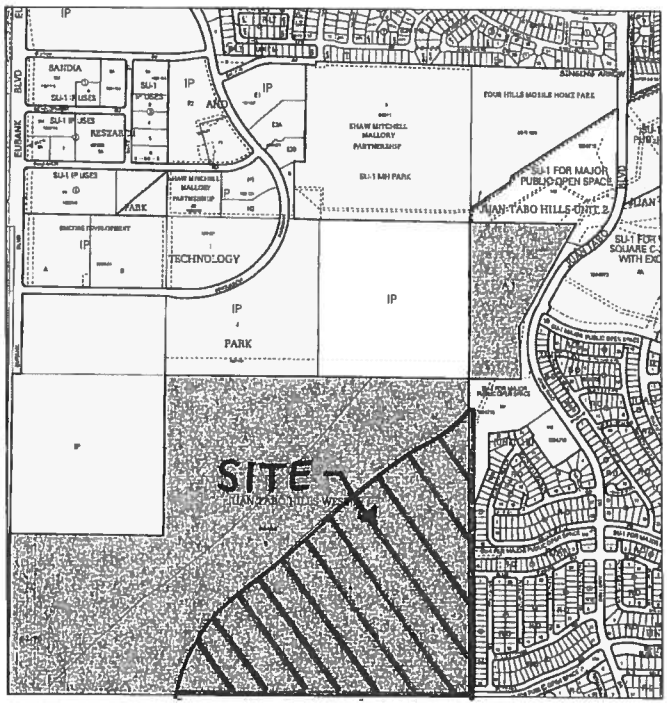

Figure 1: Vicinity Map

4. Storm Drain Changes

The storm drains were changed in three places because of these more detailed design considerations.

1. The outfall pipe from the SWQ pond at the south end of the project changed from 48" to 72" RCP.
2. The outfall pipe just north of Sandia Sunset Ave. changed from a single 96" to double 84" RCP.
3. The storm drain in Rocky Top Drive has been moved farther away from the trunk SAS in response to DRC comments from ABCWUA.

4.1 Cougar Run Outfall

Originally it looked like there was a lot of fall from Cougar Run to the Tijeras Arroyo so it had been anticipated that the first flush volume would be split at SD-MH 31 and discharged into the SWQ pond and then when the pond filled up the pond backwater would cause the peak 100-year flow to bypass the first flush diversion and continue in the 48" pipe to the Tijeras Arroyo outfall. There is not as much fall as originally thought so now all the flow, both first flush and 100-year peak flow rate, will go into the pond in the 48" storm drain from SD-MH 31 and it will pond to the SWQ elevation = 5391.25. A 10' x 10' outlet box will provide a 36' long weir with a crest elevation = 5391.30 and the peak 100-year stage in the pond is determined by the weir equation as follows.

$Q=3.0 \times 36' \times h^{3/2}$

Where $Q_{100}=198.21$ cfs

H=1.50'

So, the peak 100-year stage is 5392.80.

It is customary to provide an emergency overflow spillway sized to discharge the 100-year peak rate of flow entering the pond, and since this 10' x 10' box is sized for that flow rate, an additional spillway is not provided. The Dam top elevation is 5395.00 thus allowing 2.2' of freeboard.

The hydraulic capacity of the 72" pipe is checked using "Headwater Depth for Concrete Pipe Culverts with Inlet Control" nomograph (See Appendix 1) to make sure that it does not cause a headwater elevation higher than the weir equation above.

From the nomograph HW/D= 0.93 for "Groove end with headwall"

so HW= 6' x 0.93 = 5.58'

Where the invert of the pipe out of the box is 5385.0, the HGL at the upstream end of the 72" RCP is 5390.58, well below the weir crest. So, the 72" RCP is more than adequate to handle the 100-year peak rate of flow.

4.2 Sandia Sunset Outfall & Junction Box

The Junction Box on the 84" storm drain located north of Sandia Sunset is designed to divert the First Flush flow rate of 35.37 cfs south in the 30" RCP without overtopping the weir/wall inside the box. The top of wall elevation was set equal to the Headwater elevation as determined by the "Headwater Depth for Concrete Pipe Culverts with Inlet Control" nomograph (See Appendix 1)

From the nomograph HW/D= 1.4 for "Groove end with headwall"

so HW= 2.5' x 1.40 = 3.50'

Where the invert of the 30" RCP is 5405.50, the headwater elevation is 5409.00 and the top of the wall elevation is 5409.10. The wall is 30.5' long and forms a weir that is modeled in the WSPGW software. The reason that the outfall had to be changed to double 84" RCPs is that there is not enough fall through the Junction box to reaccelerate the flow after the incoming

velocity of 30 fps is slowed down by the weir to 7 fps. The pipe flow velocity of 1060.85 cfs is 21 fps in a 96" RCP and 14 fps in the double 84" RCP, a difference of about 4' velocity head, and there is not enough fall to accommodate that loss.
The 30" RCP diversion pipe cannot handle much more flow than the 35.37 cfs First Flush flow rate so that is the flow used in the HGL calculations for the storm drain between the Junction Box and the SWQ pond. The nomograph in appendix 1 was used to check the maximum flow that could be expected in the 30" RCP based on the 100-year HGL of the Sandia Sunset storm drain (5416.59) and inlet control at the 30" RCP the maximum flow would be 85 cfs, but the more limiting condition is backwater in the downstream pipe as given by manning's and the pipe slope as 72 cfs.

5. HGL Calculations

The hydraulic grade line is shown on profile view of the construction plan and profile sheets in Appendix 13, where it may be easily observed that the HGL is below finished grade everywhere. The WSPGW output files are in Appendixes 2 thru 11, and a map showing the stations used in the WSPGW models is in appendix 12.

6. Rip-Rap Design

Plate 3.18-3 in Appendix 13 is used to determine Rip-rap size. Two rip-rap stilling basins are to be constructed at the outlet of the two pipe penetrations. The length and width of the basins is typically equal to 4 times the pipe diameter and the depression of the basins is equal to half the pipe diameter.

Location	Q_{100} (cfs)	D (in)	W & L (ft)	B (ft)	D_{50} (ft)	Rip-rap Type
Sandia Sunset Ave	530 x 2	84	28	3.5	1.5	H
Cougar Run St	190	72	16	2	1.5	H

7. Sump Inlet Calculations

The following table summarizes the sump inlet calculations. All the sump inlets are provided with an emergency overflow, either by overtopping a street water block or by overtopping the curb and draining thru the HOA park to the arroyo. So, the inlets are sized to pass the peak 100-year flow rate while containing the ponding water in the right of way. Note that the lowest right of way elevation is typically 0.2' or more above the top of curb.

Inlet Summary Table

Inlet #	Street Name	Type	Grate Area (SF)	Grate Perimeter (FT)	Q100 (CFS)	Orifice depth[1] (FT)	Weir Depth[2] (FT)	Top of Curb Elevation	100-YR Water Surface Elev. at Sump[3],[4]	Overflow Crest Elevation	Emergency Overflow Depth	Emergency Overflow Elevation	Lowest Adjacent Pad Elevation
45	Rocky Top	Double 'A' DG, ST	17.38	14.80	26.13	0.10	0.70	5423.39	5423.55	5423.61	0.49	5424.10	5434.10
46	Rocky Top	Double 'A' DG, ST	17.38	14.80	26.13	0.10	0.70	5423.39	5423.55	5423.61			
13	Sandia Sunset	Single 'A'	8.69	11.50	0.48	0.00	0.06	5412.83	5412.35	5412.39	0.66	5413.05	5416.90
12	Sandia Sunset	Double 'A' DG, DT	17.38	18.50	26.50	0.10	0.61	5412.29	5412.36	5412.39			
S7	Rock Squirrel	Single 'A'	8.69	11.50	14.00	0.11	0.55	5409.49	5409.50	5409.70	0.40	5410.10	5412.60
S6	Rock Squirrel	5'x5' NMDOT	18.88	15.00	23.70	0.07	0.65	5409.38	5409.49	5409.70			
7	Lobo Trot	Single 'A'	8.69	11.50	6.58	0.02	0.33	5412.87	5412.66	5412.68	0.52	5413.20	5413.43
8	Lobo Trot	Single 'A'	8.69	11.50	6.58	0.02	0.33	5412.71	5412.50	5412.68			
68	Sandia Sunset	10'x5' NMDOT	37.76	25.00	17.05	0.01	0.37	5450.97	5450.80	5451.07	0.45	5451.52	5452.19
1	Silver Dollar	Single 'A'	8.69	11.50	12.62	0.09	0.51	5450.90	5450.87	5450.95	0.67	5451.62	5452.80
2	Silver Dollar	Single 'A'	8.69	11.50	13.00	0.10	0.52	5450.88	5450.86	5450.95			
3	Hubbard	Single 'A'	8.69	11.50	8.20	0.04	0.38	5444.11	5443.95	5444.15	0.59	5444.74	5445.80
4	Hubbard	Single 'A'	8.69	11.50	11.80	0.08	0.49	5444.01	5443.96	5444.15			
16a	Duke City	Single 'A'	8.69	11.50	0.00	0.00	0.00	5435.24	5434.70	5435.05	0.75	5435.80	5436.40
17	Duke City	Double 'A' DG, DT	17.38	18.50	27.22	0.11	0.62	5434.54	5434.62	5434.65			
18	Duke City	Double 'A' DG, DT	17.38	18.50	17.80	0.05	0.47	5433.04	5432.97	N/A	N/A	N/A	5434.40
19	Duke City	Double 'A' DG, DT	17.38	18.50	17.80	0.05	0.47	5433.05	5432.98	N/A	N/A	N/A	
23	Cougar Run	Double 'A' DG, DT	17.38	18.50	19.61	0.05	0.50	5396.82	5396.78	5396.82	0.53	5397.35	5499.40
23	Cougar Run	Double 'A' DG, DT	17.38	18.50	19.61	0.05	0.50	5396.82	5396.78	5396.82			
30	Cougar Run	5'x5' NMDOT	18.88	20.00	19.61	0.05	0.47	5396.82	5396.75	5396.82			

1) Orifice Equation $Q = 0.6\ A\ (2gh)^{0.5}$ so $h=(Q/.6/A)^2/2/g$

2) Weir Equation $Q = 3\ L\ h^{3/2}$ so $h= (Q/3/L)^{2/3}$

3) The orifice equation is used in accordance with FHA HEC-22, and the height is added to the center of the grate elevation which is 0.72' below the top of curb elevation.

4) The weir equation uses the length and height at the lip of gutter.The lip of gutter elevation is 0.54' below the top of curb and the effective length is = 2 x (Width of Grate) + (Length of curb opening)

5) The Area is calculated by "Hydraulic Tool Box 4.2" in accordance with Federal Highway Administration HEC-22 3rd eddition, Rev Aug., 2013 The effective length is more conservatively calculated.

6) Inlets 45, 46, S6, S7, 23, 24 & 30 have emergency overflow paths over the top of curb and thru the adjacent HOA Tract to the Tijeras Arroyo. Depth is calculated as a 50' wide weir with 3.0 coeficient.

7) The 100 year flow rate at inlets 18 and 19 is doubled because the inlets do not have an overflow path.

8) The rest of the sump inlets have emergency overflow path thru the waterblock at the adjacent intersection and contunue down the public street. Critical depth is assumed.

AS BUILT INFORMATION	BENCH MARKS	SURVEY INFORMATION			ENGINEER'S SEAL
CONTRACTOR	STATION "5–M22" IS LOCATED 8.7 MI. SE OF DOWNTOWN ALBUQUERQUE	FIELD NOTES			
WORK INSPECTOR'S ACCEPTANCE BY / DATE	ON THE EAST SIDE OF THE MUNICIPAL LIMITS LINE IN THE FOUR HILLS SUBDIVISION AREA. STATION IS 600 FT. EAST OF MUNICIPAL LIMITS LINE.	NO.	BY	DATE	
FIELD VERIFICATION BY / DATE	77.9' SE OF POWER POLE #SE37 & 186.0' NW OF POWER POLE #50. STATION IS A STANDARD ACS BRASS DISK SET IN A CONCRETE MONUMENT IN THE GROUND. STATION IS STAMPED "5–M22".				
DRAWINGS CORRECTED BY / DATE					
MICRO–FILM INFORMATION					

CHECKED BY	DMG	DATE	01/17
DRAWN BY	ACH	DATE	01/17
DESIGNED BY	JDH	DATE	01/17
DESIGN			
REVISIONS			
NO.	DATE	REMARKS	BY

mark goodwin & associates, p.a.
CONSULTING ENGINEERS
P.O. BOX 90606
ALBUQUERQUE, NEW MEXICO 87199
OFFICE (505) 828-2200, FAX (505) 797-9539

CITY PROJECT NO. | ZONE MAP NO. M-21-Z | SHEET 1 OF 10

GRADING & DRAINAGE PLAN

SCALE: 1" = 50'

TRACT 1-A-2, JUAN TABO HILLS, UNIT 2 (02/20/2008, BK-2008C, PG-30)

JUAN TABO BLVD.

6' HIGH RETAING WALLS 6' APART TOP WALL 2' BEHIND SIDEWALK

EXISTING 21" SANITARY SEWER

66" OUTLET INV= 30.85

66" OUTLET INV= 28.85

FLOODWAY

SHOTCRETE

ROCKY TOP DR. SE

TRACT 1-A JUAN TABO HILLS (02/20/2008, BK-2008C

TRACT A AMANCA PARCEL (12-23-81, BK. MISC. 898, PGS. 882-885)

SEE SHEET 2 OF 10

SEE SHEET 3 OF 10

VICINITY MAP — ZONE MAP: M-21

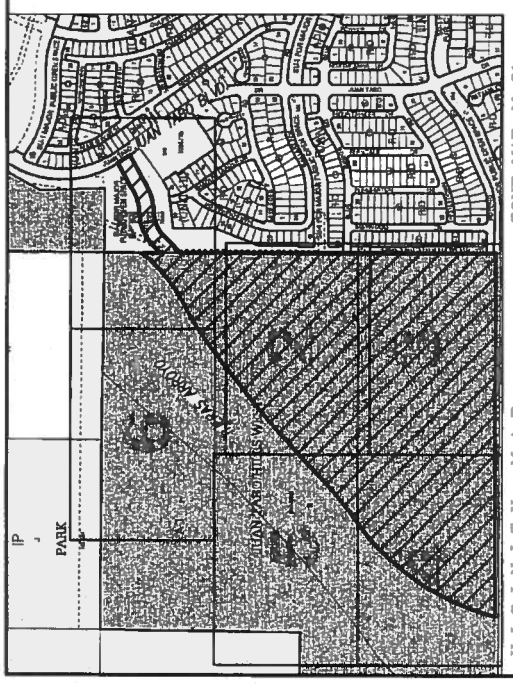

LEGEND

EXIST. HANDRAIL	• 29.29 NEW SPOT ELEVATIONS
EXIST. CONCRETE CURB	5390 NEW CONTOUR (MAJOR)
EXIST. CONCRETE/SIDEWALK	5386 NEW CONTOUR (MINOR)
EXIST. WALL OR HEAD WALL	NEW BOUNDARY LINE
EXIST. TOP CURB/FLOWLINE	NEW RIGHT-OF-WAY LINE
EXIST. SPOT ELEV.	NEW LOT LINE
EXIST. GUY WIRE	NEW CENTERLINE
EXIST. MONITOR WELL	NEW EASEMENT
EXIST. OVERHEAD ELECTRIC	NEW STANDARD CURB & GUTTER
EXIST. POWER POLE	NEW MOUNTABLE CURB & GUTTER
EXIST. SANITARY SEWER MANHOLE	NEW SIDEWALK
EXIST. STORM DRAIN MANHOLE	NEW RETAINING WALL THIS PROJECT
EXIST. WATER VALVE	NEW RETAINING WALL DEFERRED TO THE HOME BUILDERS
EXIST. WATER METER	
	LIMITS 100 YEAR FLOOD PLAIN
	LIMITS 500 YEAR FLOOD PLAIN
	LIMITS OF FLOODWAY
	LIMITS AO ZONE
	(18) BLOCK NUMBER INDENTITY

F:\A1103SA\A1039 JTH West - PPlat\GRADE & DRAIN\A1039-GRADING-SQ_RL.dwg, 2/21/2017 9:14:16 AM, SPS

SANDIA SUNSET AVE. S.E.

96" PIPE PENATRATION RIP RAP
STILLING BASIN TYPE VH (D_{50}=2')

ROCKY TOP DRIVE

DUKE CITY ST. S.E.

SUNSET ST. S.E.

SEE SHEET 1 OF 10

				ENGINEER'S SEAL	SURVEY INFORMATION			BENCH MARKS	AS BUILT INFORMATION	
					FIELD NOTES			STATION "5-M22" IS LOCATED 8.7 MI. SE OF DOWNTOWN ALBUQUERQUE	CONTRACTOR	
NO.	DATE	REMARKS	BY		NO.	BY	DATE	ON THE EAST SIDE OF THE MUNICIPAL LIMITS LINE IN THE FOUR HILLS	WORK STAKED BY	DATE
		REVISIONS						SUBDIVISION AREA. STATION IS 600 FT. EAST OF MUNICIPAL LIMITS LINE,	INSPECTOR'S ACCEPTANCE BY	DATE
		DESIGN						77.9' SE OF POWER POLE #SE37 & 186.0' NW OF POWER POLE #60.	FIELD VERIFICATION BY	DATE
DESIGNED BY	JDH	DATE	01/17					STATION IS A STANDARD ACS BRASS DISK SET IN A CONCRETE	DRAWINGS CORRECTED BY	DATE
DRAWN BY	ACH	DATE	01/17					MONUMENT IN THE GROUND. STATION IS STAMPED "5-M22".	MICRO-FILM INFORMATION	
CHECKED BY		DATE								

CITY PROJECT NO. | ZONE MAP NO. M-21-Z

GRADING & DRAINAGE PLAN

SCALE: 1" = 50'

MARK GOODWIN & ASSOCIATES, P.A.
CONSULTING ENGINEERS
P.O. BOX 90606
ALBUQUERQUE, NEW MEXICO 87199
OFFICE (505) 828-2200 FAX (505) 797-9539

BURROWING OWL ST. S.E.

CAINY

DUKE CITY ST. S.E.

ROCKY TOP DRIVE

FRED HARVEY AVE. S.E.

MANZANO VISTA AVE.

HUBBARD ST. S.E.

SILVER DOLLAR ST. S.E.

SECONO RD. S.E.

TRACT 1-A-3

JUAN TABO HILLS, UNIT 2 (02/20/2008, BK-2008C, PG-30)

MAYWOOD DRIVE S.E.

NO.	DATE	REMARKS	BY
		REVISIONS	
		DESIGN	
DESIGNED BY	JDH	DATE	01/17
DRAWN BY	ACH	DATE	01/17
CHECKED BY	DMG	DATE	01/17

ENGINEER'S SEAL

SURVEY INFORMATION

FIELD NOTES

NO.	BY	DATE

BENCH MARKS

STATION "5-M22" IS LOCATED 8.7 MI. SE OF DOWNTOWN ALBUQUERQUE ON THE EAST SIDE OF THE MUNICIPAL LIMITS LINE IN THE FOUR HILLS SUBDIVISION AREA. STATION IS 600 FT. EAST OF MUNICIPAL LIMITS LINE, 77.9' SE OF POWER POLE #SE37 & 186.0' NW OF POWER POLE #60. STATION IS A STANDARD ACS BRASS DISK SET IN A CONCRETE MONUMENT IN THE GROUND. STATION IS STAMPED "5-M22".

AS BUILT INFORMATION

CONTRACTOR

WORK STAKED BY — DATE

INSPECTOR'S ACCEPTANCE BY — DATE

FIELD VERIFICATION BY — DATE

DRAWINGS CORRECTED BY — DATE

MICRO-FILM INFORMATION

CITY PROJECT NO

ZONE MAP NO. M-21-Z

SHEET 3 OF 10

GRADING & DRAINAGE PLAN

SCALE: 1" = 50'

dmg MARK GOODWIN & ASSOCIATES, P.A. CONSULTING ENGINEERS P.O. BOX 90606 ALBUQUERQUE, NEW MEXICO 87199 (505) 828-2200 FAX (505) 797-9539

AS BUILT INFORMATION	BENCH MARKS	SURVEY INFORMATION	ENGINEER'S SEAL
CONTRACTOR	STATION "S-M22" IS LOCATED 8.7 MI. SE OF DOWNTOWN ALBUQUERQUE	FIELD NOTES	
WORK STAKED BY / DATE	ON THE EAST SIDE OF THE MUNICIPAL LIMITS LINE IN THE FOUR HILLS SUBDIVISION AREA. STATION IS 600 FT. EAST OF MUNICIPAL LIMITS LINE.	NO. / BY / DATE	
INSPECTOR'S ACCEPTANCE BY / DATE	77.9' SE OF POWER POLE #SE37 & 186.0' NW OF POWER POLE #60.		
FIELD VERIFICATION BY / DATE	STATION IS A STANDARD ACS BRASS DISK SET IN A CONCRETE		
DRAWINGS CORRECTED BY / DATE	MONUMENT IN THE GROUND. STATION IS STAMPED "S-M22".		
MICRO-FILM INFORMATION			

NO.	DATE	REMARKS	BY
		REVISIONS	
		DESIGN	
		DESIGNED BY JDH	DATE 01/17
		DRAWN BY ACH	DATE 01/17
		CHECKED BY DMG	DATE 01/17

SCALE: 1" = 50'

GRADING & DRAINAGE PLAN

dmg MARK GOODWIN & ASSOCIATES, P.A.
CONSULTING ENGINEERS
P.O. BOX 90606
ALBUQUERQUE, NEW MEXICO 87199
OFFICE (505) 828-2200, FAX (505) 797-9539

CITY PROJECT NO. | ZONE MAP NO. M-21-Z | SHEET 4 OF 10

A11 39 TH WEST PPLAT\GRADE & DRAIN\A11039-GRADING-50\01-20-17\ACH, SPS

F:\A11JOBS\A11039 7TH West - PPlat\GRADE & DRAIN\A11039-GRADING-50_PL.dwg, 2/21/2017 8:39:36 AM, SPS

GRADING NOTES:

1. THE CONTRACTOR(S) MUST COMPLY WITH NPDES TEMPORARY CONSTRUCTION REQUIREMENTS AND OBTAIN A PERMIT. CONTRACTOR SHALL ALSO PROVIDE A COPY OF THE APPLICATION FOR PERMIT AND NOTICE OF TERMINATION TO THE OWNER.
2. THE CONTRACTOR(S) IS RESPONSIBLE FOR PREPARING AND MAINTAINING A SWPPP FOR THE DURATION OF INFRASTRUCTURE CONSTRUCTION AND UNTIL THE CITY OF ALBUQUERQUE ACCEPTS THE PUBLIC INFRASTRUCTURE. CONTRACTOR SHALL PROVIDE THE OWNER WITH A COPY OF THE SWPPP AT THE BEGINNING OF THE PROJECT AND AT THE TIME OF NOTICE OF TERMINATION.
3. THE CONTRACTOR(S) IS RESPONSIBLE FOR CONSTRUCTING AND MAINTAINING EROSION CONTROLS FOR THE DURATION OF THE CONSTRUCTION OF THE PUBLIC INFRASTRUCTURE AND FOR THE REMOVAL OF THE EROSION CONTROLS WHERE DIRECTED TO DO SO BY THE OWNER AT THE TIME OF NOTICE OF TERMINATION.
4. THE CONTRACTOR IS RESPONSIBLE FOR CONSTRUCTION STAKING AND IS TO PROVIDE AN AS-BUILT SURVEY CERTIFIED BY A REGISTERED PROFESSIONAL SURVEYOR TO THE OWNER UPON COMPLETION OF THE CONSTRUCTION. THE EARTHWORK CONTRACTOR IS TO PROVIDE EARTHWORK SURVEY, AND THE WALL BUILDER IS TO PROVIDE WALL SURVEY.
5. EARTHWORK CONTRACTOR SHALL PREPARE ROUGH SUBGRADE FOR THE RETAINING WALL CONSTRUCTION AND PROVIDE SUFFICIENT BACKFILL MATERIAL STOCKPILED ON THE HIGH SIDE OF EACH WALL FOR THE WALL BUILDER TO COMPLETELY BACKFILL THE WALLS.
6. RETAINING WALLS ARE SHOWN FOR GRADING PURPOSES ONLY. RETAINING WALL DESIGN IS TO BE PERFORMED BY OTHERS, AND SHALL BE SUBMITTED TO THE CITY OF ALBUQUERQUE FOR REVIEW, APPROVAL, PERMIT, AND INSPECTION
7. EARTHWORK CONSTRUCTION SHALL BE IN ACCORDANCE WITH THE GEOTECHNICAL INVESTIGATION BY GEOTEST, INC. DATED JUNE 29, 2012.
8. TOPOGRAPHIC AND BOUNDARY SURVEY ARE BY ALDRICH LAND SURVEYING NOVEMBER 2011.
9. BENCHMARK USED IS AGRS BRASS CAP STAMPED "7-M21" HAVING AN ELEVATION OF 5498.07 (NGVD29).
10. FEMA SPECIAL FLOOD HAZARD ZONE ON THIS PROPERTY AS SHOWN ON LOMR CASE NO. 13-06-1053P EFFECTIVE JUNE 17, 2013.

FLOOD PLAIN LEGEND

— — — — —	LIMITS 100 YEAR FLOOD PLAIN
—— —— ——	LIMITS 500 YEAR FLOOD PLAIN
—·—·—·—	LIMITS OF FLOODWAY
————	LIMITS AO ZONE

TYPICAL LOT GRADING W/O SIDEYARD WALL

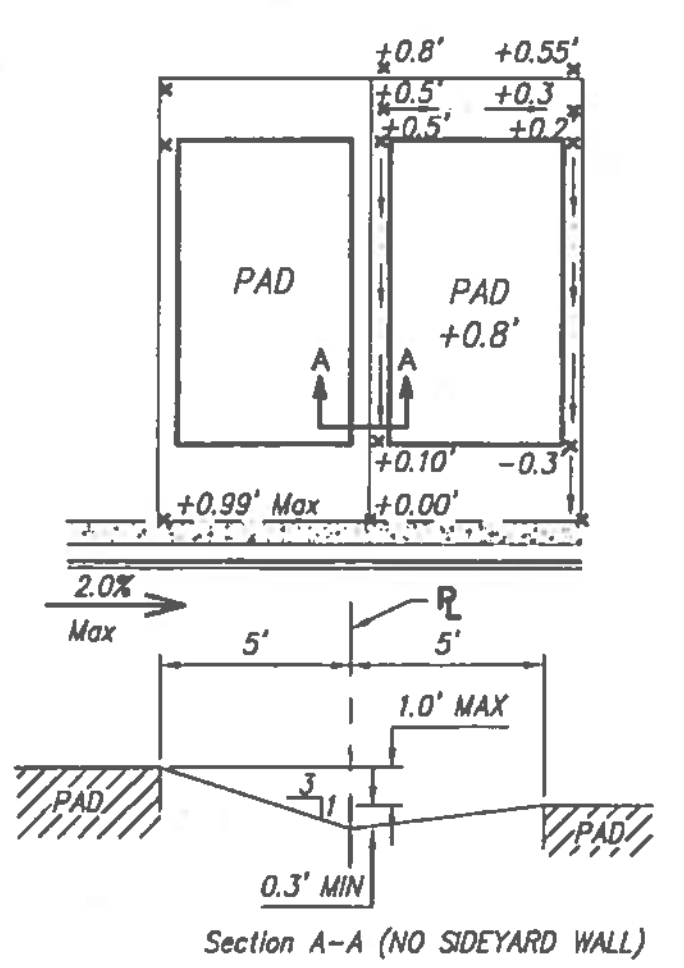

Section A-A (NO SIDEYARD WALL)

TYPICAL LOT GRADING WITH SIDEYARD WALL

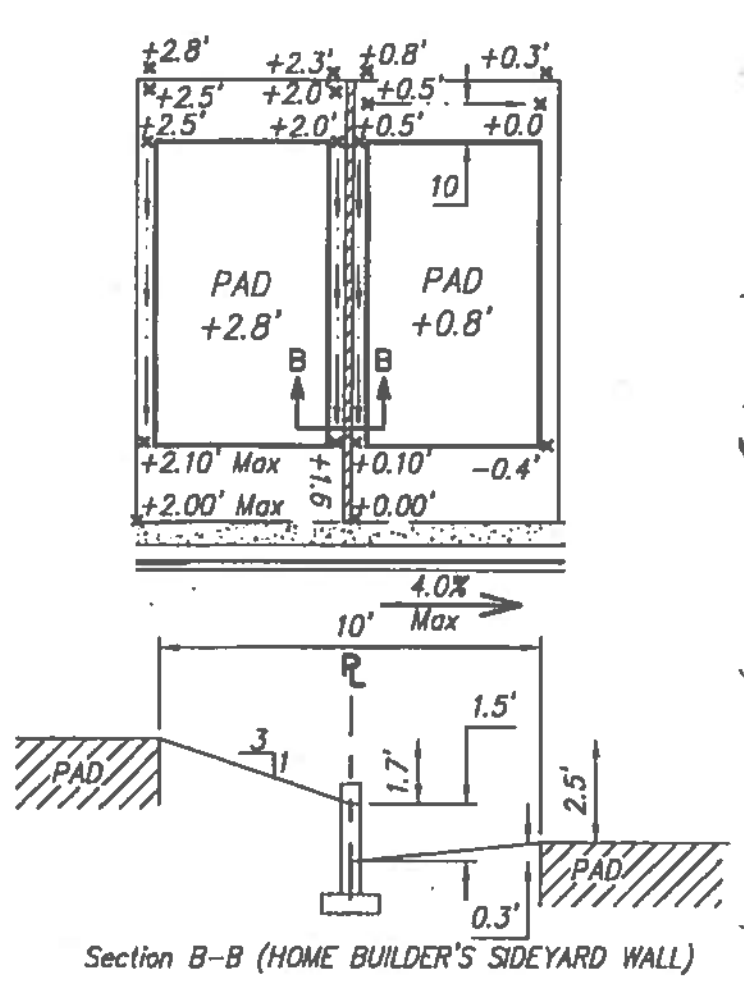

Section B-B (HOME BUILDER'S SIDEYARD WALL)

SEE SHEET 6 OF 10

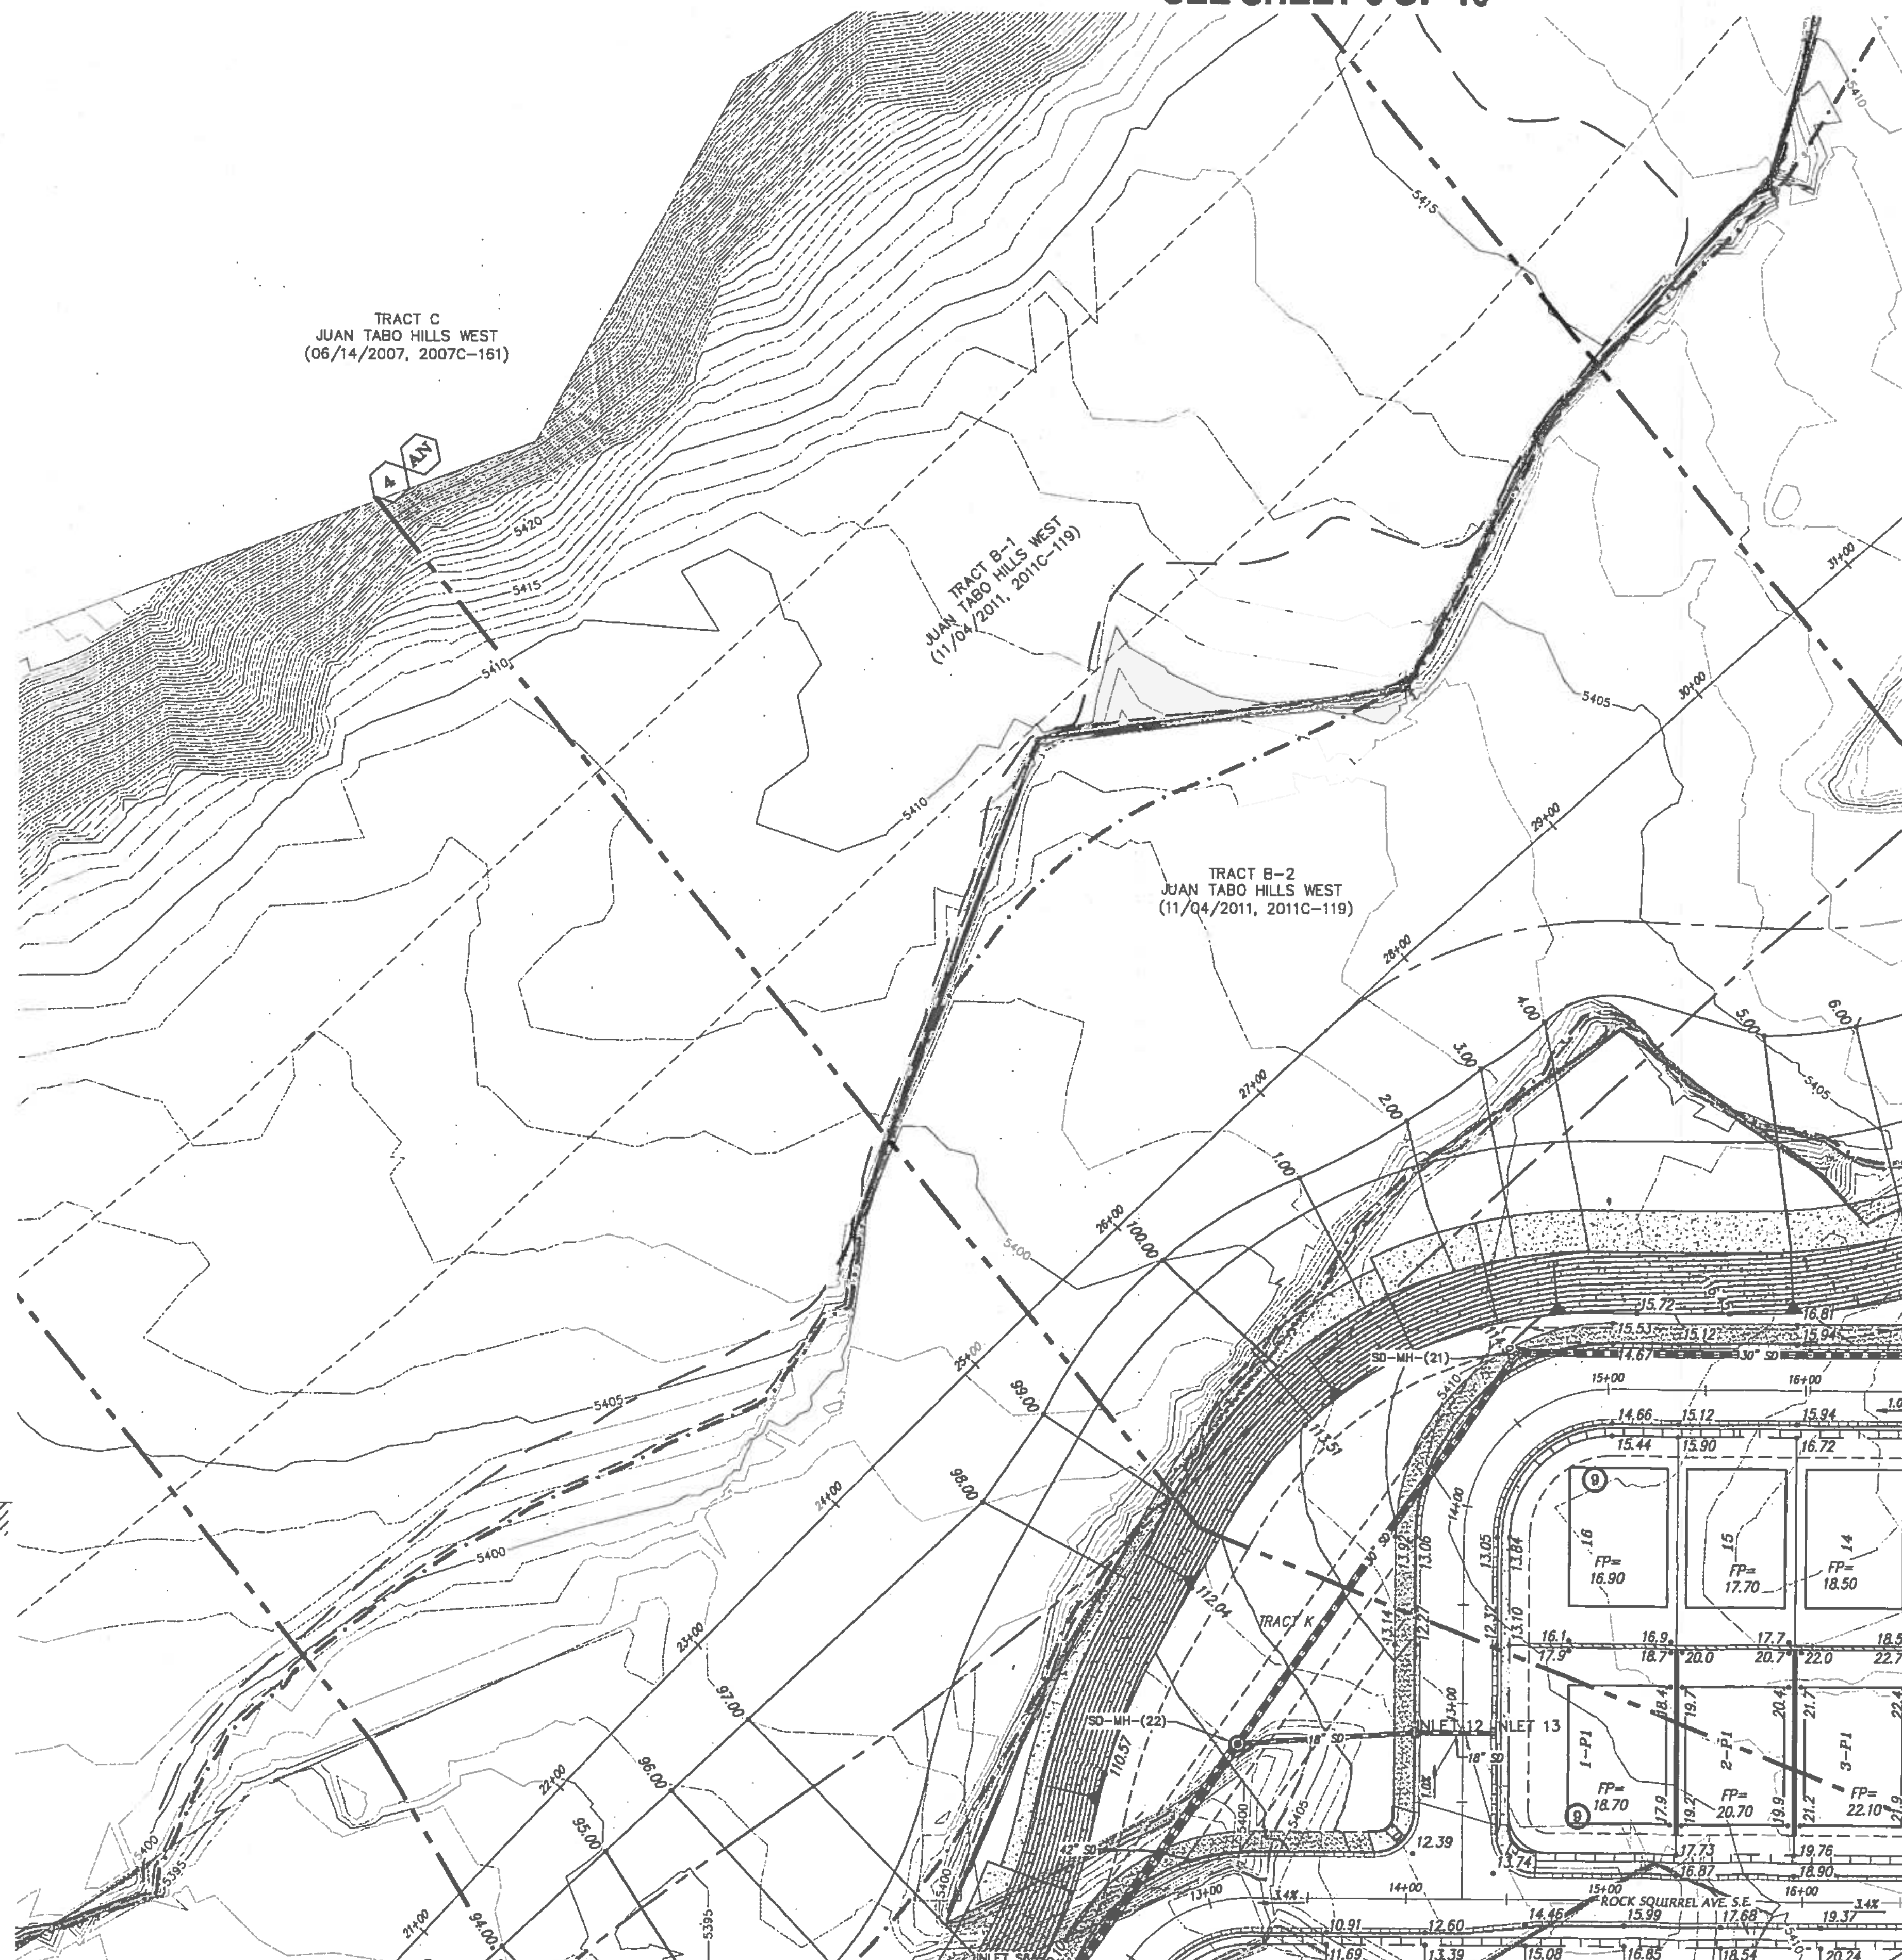

SEE SHEET 2 & 3 OF 10

SEE SHEET 4 OF 10

SCALE: 1" = 50'

ENGINEER'S SEAL	SURVEY INFORMATION			BENCH MARKS	AS BUILT INFORMATION	
	FIELD NOTES			STATION "5-M22" IS LOCATED 8.7 MI. SE OF DOWNTOWN ALBUQUERQUE	CONTRACTOR	
	NO.	BY	DATE	ON THE EAST SIDE OF THE MUNICIPAL LIMITS LINE IN THE FOUR HILLS	WORK STAKED BY	DATE
				SUBDIVISION AREA. STATION IS 600 FT. EAST OF MUNICIPAL LIMITS LINE,	INSPECTOR'S ACCEPTANCE BY	DATE
				77.9' SE OF POWER POLE #SE37 & 186.0' NW OF POWER POLE #60.	FIELD VERIFICATION BY	DATE
				STATION IS A STANDARD ACS BRASS DISK SET IN A CONCRETE	DRAWINGS CORRECTED BY	DATE
				MONUMENT IN THE GROUND. STATION IS STAMPED "5-M22".	MICRO-FILM INFORMATION	

JAMES D. HUGHES, NEW MEXICO REGISTERED PROFESSIONAL ENGINEER 2-21-2017

NO.	DATE	REMARKS	BY
		REVISIONS	
		DESIGN	
DESIGNED BY	JDH	DATE	01/17
DRAWN BY	ACH	DATE	01/17
CHECKED BY	DMG	DATE	01/17

GRADING & DRAINAGE PLAN

MARK GOODWIN & ASSOCIATES, P.A.
CONSULTING ENGINEERS
P.O. BOX 90606
ALBUQUERQUE, NEW MEXICO 87199
OFFICE (505) 828-2200, FAX (505) 797-9539

CITY PROJECT NO. | ZONE MAP NO. M-21-Z | SHEET 5 OF 10

AS BUILT INFORMATION	BENCH MARKS	SURVEY INFORMATION	ENGINEER'S SEAL
CONTRACTOR	"STATION "5-M22" IS LOCATED 8.7 MI. SE OF DOWNTOWN ALBUQUERQUE	FIELD NOTES	
WORK STAKED BY / DATE	ON THE EAST SIDE OF THE MUNICIPAL LIMITS LINE IN THE FOUR HILLS	NO. / BY / DATE	
INSPECTION'S ACCEPTANCE BY / DATE	SUBDIVISION AREA. STATION IS 600 FT. EAST OF MUNICIPAL LIMITS LINE.		
FIELD VERIFICATION BY / DATE	77.9' SE OF POWER POLE #SE37 & 186.0' NW OF POWER POLE #60.		
CORRECTED BY / DATE	STATION IS A STANDARD ACS BRASS DISK SET IN A CONCRETE		
DRAWINGS / DATE	MONUMENT IN THE GROUND. STATION IS STAMPED "5-M22".		
MICRO-FILM INFORMATION	"X= 1,564,261.207, Y= 1,475,763.595 (NAD 83) Z= 4597.719 (NAVD 1988)"		

CHECKED BY	DATE	REVISIONS	NO.	DATE	REMARKS	BY
DRAWN BY ACH	01/17	DESIGN				
DESIGNED BY JDH	01/17					

GRADING & DRAINAGE PLAN

dmg MARK GOODWIN & ASSOCIATES, P.A.
CONSULTING ENGINEERS
P.O. BOX 90606
ALBUQUERQUE, NEW MEXICO 87199
OFFICE (505) 828-2200, FAX (505) 797-9539

CITY PROJECT NO. | ZONE MAP NO. M-21-Z | SHEET 6 OF 10

SCALE: 1" = 50'

SEE SHEET 1 OF 10

SEE SHEET 5 OF 10

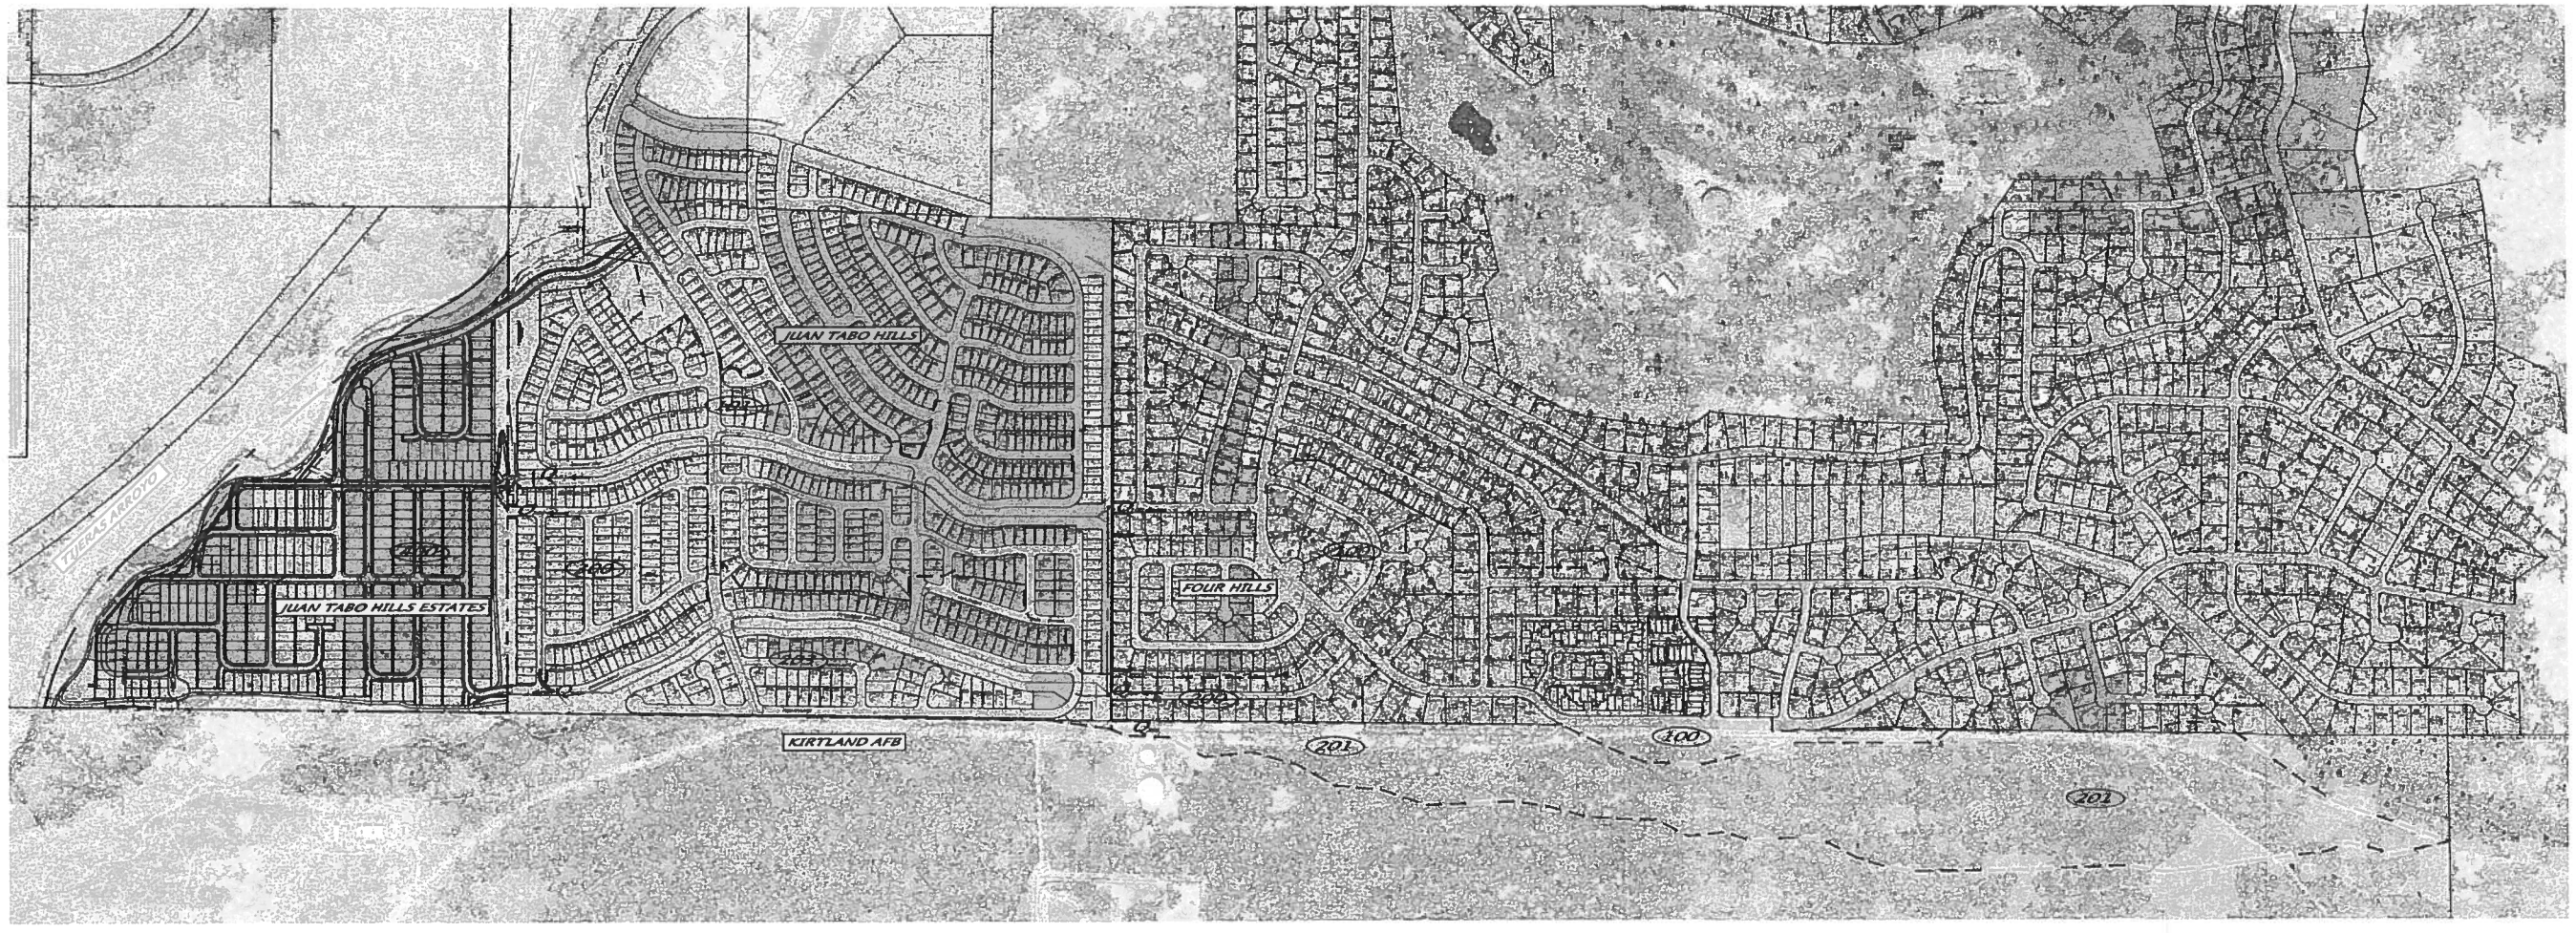

Table 1: HYDROLOGY SUMMARY TABLE

AHYMO BASIN ID	Location	AREA (Ac)	AREA (Sq mi)	Ground Cover (%) A	B	C	D	Q_{100} (cfs) Increment	Water Quality Volume (Ac-Ft) Increment	Sub Total
100	Four Hills	69.10	0.13922	5	18	35	38.7	328.22	1.3218	1.3218
101	Juan Tabo Hills	66.80	0.10436	0	19	39	42	282.50	1.0755	1.0755
200	Four Hills	9.00	0.01406	0	20	40	40	37.61	0.1380	1.4598
201	Kirtland	76.30	0.01528	100	0	0	0	27.64	0.0000	0.0000
203	Juan Tabo Hills	42.50	0.06641	0	22	45	33	172.59	0.5376	1.6131
300	Juan Tabo Hills	22.30	0.03484	0	14	29	57	99.75	0.4873	2.1004
400	JTH Estates	77.70	0.12141	0	9	41	50	343.61	1.4893	1.4893
TOTALS:		383.70	0.50					1291.92		5.05

LEGEND

- AHYMO BASIN BOUNDARY
- SUB-BASIN BOUNDARY
- NEW RCP STORM DRAIN
- (400) AHYMO BASIN NUMBER

N

500' 250' 0 500' 1000'

SCALE: 1" = 500'

AS BUILT INFORMATION

CONTRACTOR

WORK STARTED BY DATE

INSPECTOR'S ACCEPTANCE BY DATE

VERIFICATION BY DATE

DRAWINGS CORRECTED BY DATE

MICRO-FILM INFORMATION

BENCH MARKS

STATION "5-M22" IS LOCATED 8.7 MI. SE OF DOWNTOWN ALBUQUERQUE ON THE EAST SIDE OF THE MUNICIPAL LIMITS LINE IN THE FOUR HILLS SUBDIVISION AREA. STATION IS 600 FT. EAST OF MUNICIPAL LIMITS LINE, 71.9' SE OF POWER POLE #5637 & 186.0' NW OF POWER POLE #86. STATION IS A STANDARD AGS BRASS DISK SET IN A CONCRETE MONUMENT IN THE GROUND. STATION IS STAMPED "5-M22".

SURVEY INFORMATION

FIELD NOTES

NO.	BY	DATE

ENGINEER'S SEAL

JAMES D. HUGHES NEW MEXICO REGISTERED PROFESSIONAL ENGINEER

NO.	DATE	REVISIONS	BY
		DESIGN	JDH
		DRAWN	
		CHECKED	
		DATE	01/17

DESIGNED BY JDH

JUAN TABO HILLS ESTATE

DRAINAGE BASIN MAP

MARK GOODWIN & ASSOCIATES, P.A.
CONSULTING ENGINEERS
P.O. BOX 90606
ALBUQUERQUE, NEW MEXICO 87199
OFFICE (505) 828-2200, FAX (505) 797-9539

CITY PROJECT NO. | ZONE MAP NO. M-21-Z | SHEET OF 1 1

JUAN TABO HILLS ESTATES

ONSITE DRAINAGE BASIN MAP

dmg
MARK GOODWIN & ASSOCIATES, P.A
CONSULTING ENGINEERS
P.O. BOX 90606
ALBUQUERQUE, NEW MEXICO 87199
OFFICE (505) 828 2200, FAX (505) 797 9539

PROJECT NO	ZONE MAP NO	SHEET	OF
C	M-21-Z	8	10

NO.	DATE	REMARKS	BY
		REVISIONS	
		DESIGN	
DESIGNED BY	JDH	DATE	01/17
DRAWN BY	ACH	DATE	01/17
CHECKED BY	DMG	DATE	01/17

ENGINEER'S SEAL

JAMES D. HUGHES — 12965 — REGISTERED PROFESSIONAL ENGINEER — NEW MEXICO — 1-26-17

SURVEY INFORMATION		
FIELD NOTES		
NO	BY	DATE

BENCH MARKS

STATION "5-M22" IS LOCATED 8.7 MI. SE OF DOWNTOWN ALBUQUERQUE

ON THE EAST SIDE OF THE MUNICIPAL LIMITS LINE IN THE FOUR HILLS SUBDIVISION AREA. STATION IS 600 FT. EAST OF MUNICIPAL LIMITS LINE.

77.9', SE OF POWER POLE #3537 & 186.0', NW OF POWER POLE #60. STATION IS A STANDARD ACS BRASS DISK SET IN A CONCRETE MONUMENT IN THE GROUND. STATION IS STAMPED "5-M22".

X= 1,564,263.207, Y= 1,475,762.595, (NAD 83), Z= 5597.219 (NAVD 1988)

AS BUILT INFORMATION

CONTRACTOR		
WORK STAKED BY		DATE
INSPECTOR'S ACCEPTANCE	BY	DATE
VERIFICATION	BY	DATE
FIELD CORRECTED	BY	DATE
DRAWINGS		DATE

MICRO-FILM INFORMATION

RE ORDED BY DATE

Storm Drain System Design

STREET NAME	INLET #	Q (cfs)	PIPE #	SLOPE %	Q_{100} (cfs)	PIPE CAPACITY:	PIPE DIA (IN)	AREA of PIPE	VELOCITY (ft/sec)
Gallant Fox	S20	12.44	Existing	2.12	848.57	930.11	84	38.48	22.05
Blue Ribbon		12.44	P1		12.45				
Tract J	S21	12.45	P2	15.00	24.89	87.81	24	3.14	7.92
Tract J	S11	17.05	P3	1.00	41.94	66.69	36	7.07	5.93
Sandia Sunset			P4	2.00	890.51	903.40	84	38.48	23.14
Silver Dollar	S12	12.61	P5	2.00	12.61	14.85	18	1.77	7.25
Silver Dollar	S13	12.61	P6	2.00	25.82	31.99	18	1.77	14.50
Sandia Sunset			P7	2.20	916.13	947.49	84	38.48	23.81
Hubbard	S14	10.00	P8	2.00	10.00	14.85	18	1.77	5.66
Hubbard	S15	9.99	P9	2.00	19.99	31.99	18	1.77	11.31
Sandia Sunset			P10	7.00	936.12	1690.11	84	38.48	24.32
Duke City	S16	13.61	P11	1.50	12.22	12.86	18	1.77	6.92
Duke City	S17	13.61	P12	1.20	24.44	24.78	24	3.14	7.78
Duke City	S18	8.90	P13	1.00	8.90	10.50	18	1.77	5.04
Duke City	S19	8.90	P14	1.00	17.80	22.82	24	3.14	5.67
Sandia Sunset	10	6.60	P15	4.00	978.36	1277.60	84	38.48	25.42
Rocky Top	11	5.90	P17	1.50	5.90	12.86	18	1.77	3.34
Rocky Top	12	5.90	P18	2.00	11.80	14.85	24	3.14	3.76
Rocky Top	13	8.00	P19	2.00	8.00	14.85	18	1.77	4.53
Rocky Top	14	8.00	P20	1.50	27.80	27.70	24	3.14	8.85
Rocky Top	S1	28.13	P21	1.50	28.13	27.70	24	3.14	8.33
Rocky Top	S2	28.13	P22	0.56	80.06	101.54	48	12.57	8.37
Sandia Sunset		6.60	P23	1.50	1023.05	1119.91	96	50.27	20.35
Sandia Sunset	S3	13.49	P24	1.00	13.49	22.62	24	3.14	4.29
Sandia Sunset	S4	13.49	P25	1.00	26.98	22.62	24	3.14	8.59
Sandia Sunset			P26	1.00	62.35	66.69	36	7.07	8.82
Rock Squirrel	S5	18.85	P28	2.00	19.02	31.99	24	3.14	6.05
Rock Squirrel	S6	18.85	P29	1.00	100.22	100.60	42	9.62	10.42
Rock Squirrel			P30	1.00	100.22	100.60	42	9.62	10.42
Manzano Vista	15	5.90	P31	2.00	5.90	14.85	18	1.77	3.34
Manzano Vista	16	5.90	P32	3.14	11.80	18.61	18	1.77	6.68
Manzano Vista	17	7.10	P33	2.00	7.10	14.85	18	1.77	4.02
Manzano Vista	18	7.10	P34	3.14	26.00	40.09	24	3.14	8.28
Manzano Vista			P35	1.00	126.22	143.60	48	12.57	10.04
Lobo Trot	S7	6.58	P36	1.00	6.58	10.50	18	1.77	3.72
Lobo Trot	S8	6.58	P37	1.00	13.16	22.62	24	3.14	4.19
Manzano Vista			P38	1.00	139.38	143.60	48	12.57	11.09
Cougar Run St	S23 & S24	58.83	P39	1.10	198.21	206.30	54	15.90	12.48
48 RCP into Arroyo			P40	1.00	139.94	143.60	48	12.57	11.14
SWQ @ 48" RCP			P41	1.00	58.27	66.69	36	7.07	8.24
SWQ @ 96" RCP			P42	1.00	35.37	410.10	30	4.91	7.21

SEE SHEET 9 OF 11

LEGEND

- AHYMO BASIN BOUNDARY
- SUB-BASIN BOUNDARY
- NEW RCP STORM DRAIN
- 400 AHYMO BASIN NUMBER
- 400Q SUB-BASIN NUMBER
- (15) NEW INLET NUMBER
- (51) EXISTING INLET NUMBER
- (62) NEW RCP PIPE NUMBER
- HIGH POINT (WATERBLOCK)

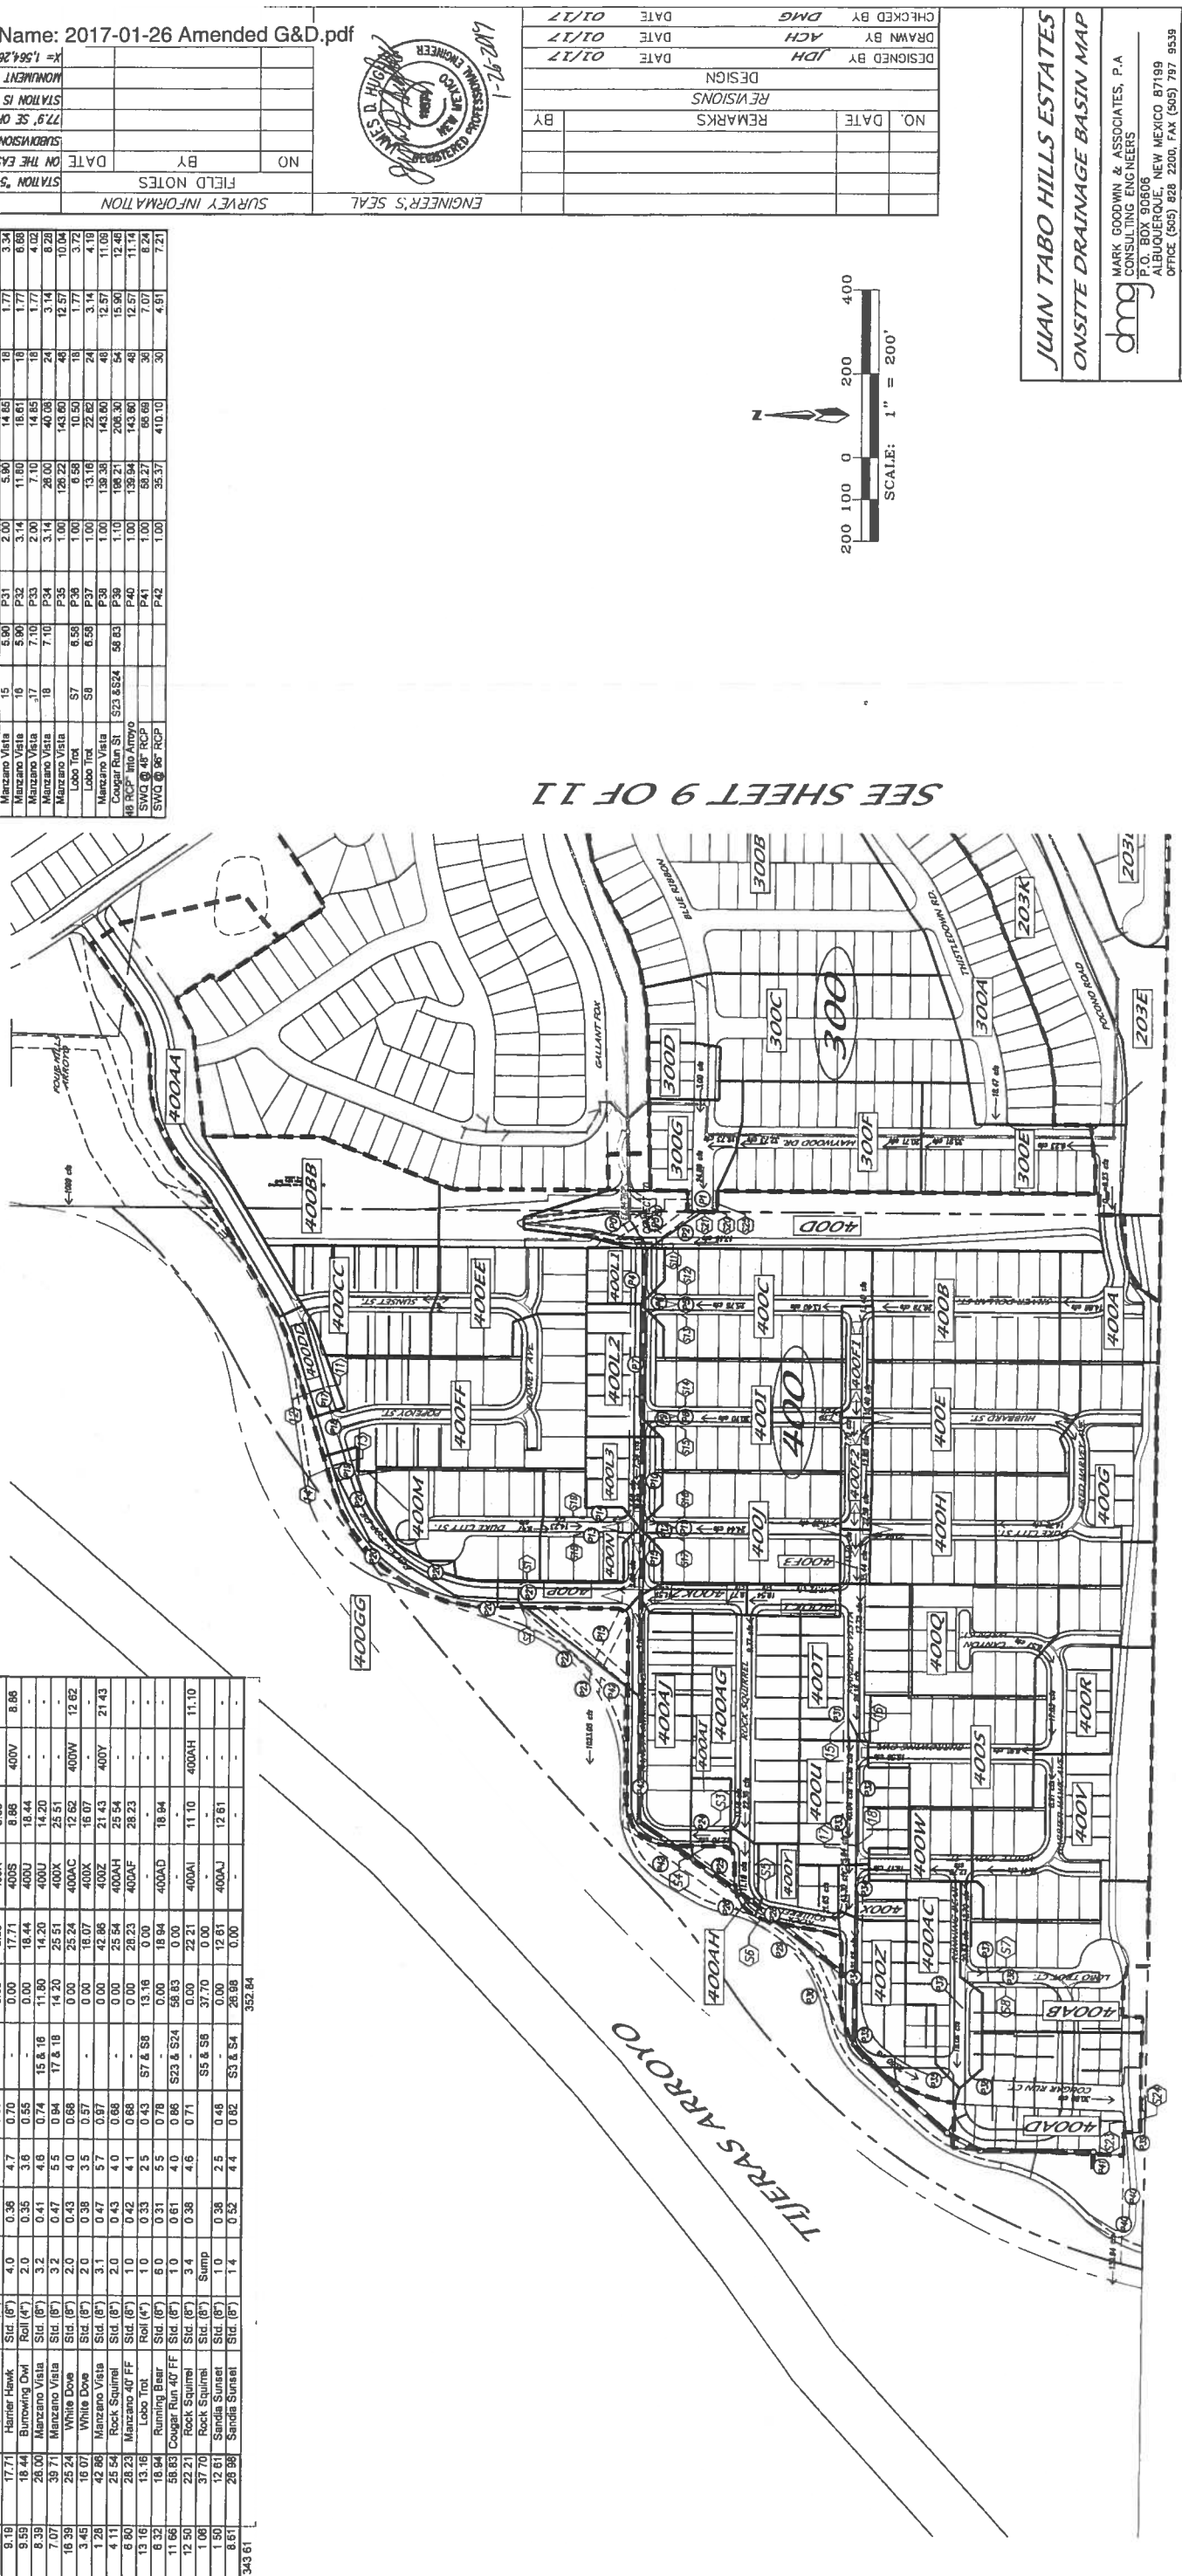

HYDROLOGY SUMMARY TABLE

AHYMO BASIN ID	SUB-BASIN ID	AREA (Ac)	Peak 100-YR Flow Q_{100} (cfs) Incremental	Surface	Street flows Curb Type	Location	Curb Slope (%)	Depth (ft)	Velocity (fps)	Energy (ft)	Inlet Calcs Inlet ID #	Intercepted (cfs)	By-passed (cfs)	Path 1 Downstrm ID	Path 1 Flow (cfs)	Path 2 Downstrm ID	Path 2 Flow (cfs)
400		77.70	343.61														
	400AA	3.18	14.05	14.05	Std. (8")	Rocky Top	8.0	0.29	5.5	0.76	-	0.00	14.05	400DD	14.05		
	400BB	2.45	10.82	10.82	n/a	Trail	-	-	-	-	-	0.00	10.82	400DD	10.82	-	-
	400CC	1.89	8.35	8.35	Std. (4")	Sunset St	3.6	0.23	3.6	0.45	-	0.00	8.35	400DD	8.35	-	-
	400DD	0.44	1.94	35.16	Std. (8')	Sunset St	1.2	0.53	3.1	0.68	11 & 12	11.80	23.36	400FF	23.36	-	-
	400EE	2.87	12.68	12.68	Std. (4")	Sunset St	1.0	0.33	2.5	0.43	-	0.00	12.68	400FF	12.68	-	-
	400FF	4.13	18.24	30.92	Std. (8")	Popejoy	3.8	0.42	5.2	0.84	-	-	-		-	-	-
				54.28	Std. (8")	Rocky Top	1.2	0.60	4.1	0.86	13 & 14	16.00	38.28	400GG	38.28	-	-
	400GG	1.18	5.12	43.40	Std. (8')	Rocky Top	2.1	0.49	4.9	0.86	-	0.00	43.40	400P	43.40	-	-
	400A	1.27	5.61	14.84	Std. (8")	Silver Dollar St	2.0	0.32	3.6	0.52	-	0.00	14.84	400B	14.84	-	-
	400B	2.68	11.84	28.68	Std. (8")	Silver Dollar St	2.0	0.43	4.0	0.68	-	0.00	28.68	400F1	13.34	400C	13.34
	400C	2.78	12.28	25.62	Std. (8")	Silver Dollar St	2.0	0.43	4.0	0.68	S12 & S13	25.62	0.00	400L1	0.00	-	-
	400D	3.86	17.05	17.05	n/a	Eastern Bndry	-	-	-	-	S11	17.05	0.00	400L1	0.00	-	-
	400L1	0.55	2.43	2.43	Std. (4")	Sandia Sunset	0.5	0.22	1.4	0.25	S22	2.43	0.00	400L3	3.71	400J	3.67
	400L2	0.84	3.71	3.71	Std. (4")	Sandia Sunset	2.8	0.23	3.1	0.38	-	0.00	3.71	400N	3.67	400F2	12.77
	400L3	0.82	3.62	7.33	Std. (4")	Sandia Sunset	3.4	0.28	4.1	0.54	-	0.00	7.33	400F2	7.66	400I	7.66
	400E	2.89	12.77	12.77	Std. (4")	Hubbard	2.0	0.30	3.4	0.48	-	0.00	12.77	400F2	12.77	-	-
	400F1	0.45	1.98	15.33	Std. (8")	Manzano Vista	3.2	0.34	4.2	0.61	-	0.00	15.33	400F2	7.66	400I	7.66
	400F2	0.45	2.03	22.46	Std. (8")	Manzano Vista	3.2	0.39	4.3	0.68	-	0.00	22.46	400F3	11.23	400J	11.23
	400F3	0.26	1.15	35.22	Std. (8")	Manzano Vista	3.2	0.44	4.2	0.71	-	0.00	35.22	400K1	17.61	400T	17.61
	400G	3.31	14.62	14.62	Std. (4")	Duke City	2.0	0.33	3.4	0.51	-	0.00	14.62	400H	14.62	-	-
	400H	1.86	8.22	22.84	Std. (8")	Duke City	2.0	0.42	3.9	0.66	-	0.00	22.84	400F3	22.84	-	-
	400I	2.79	12.32	19.99	Std. (8")	Hubbard	2.0/Sump	0.40	3.8	0.62	S14 & S15	19.99	0.00	400L1	0.00	-	-
	400J	2.79	12.32	27.22	Std. (8")	Duke City	4.0	0.46	4.0	0.71	S16 & S17	27.22	0.00	-	-	-	-
	400K1	0.41	1.81	19.42	Std. (8")	Rocky Top	1.9	0.41	3.7	0.62	-	0.00	19.42	400K2	9.71	400AG	9.71
	400K2	0.41	1.81	11.52	Std. (8")	Rocky Top	1.9	0.35	3.1	0.50	-	0.00	11.52	400P	5.76	400AJ	5.76
	400M	2.13	9.41	9.41	Std. (4")	Duke City	0.5	0.33	1.8	0.38	-	0.00	9.41	400N	9.41	-	-
	400N	1.07	4.73	17.80	Std. (8")	Duke City	0.5	0.44	2.0	0.50	S18 & S19	17.80	0.00	-	-	-	-
	400P	0.70	3.09	52.28	Std. (8")	Rocky Top	Sump				S1 & S2	52.26	0.02	400R	8.53	-	-
	400Q	1.93	8.53	8.53	Std. (4")	Canyon Wren Ct	0.5	0.33	1.8	0.38	-	0.00	8.53	400R	8.53	-	-
	400R	2.08	9.19	17.71	Std. (8")	Harrier Hawk	4.0	0.36	4.7	0.70	-	0.00	17.71	400S	8.86	400V	8.86
	400S	2.17	9.59	18.44	Std. (8")	Burrowing Owl	2.0	0.35	3.6	0.55	-	0.00	18.44	400U	18.44	-	-
	400T	1.90	8.39	28.00	Std. (8")	Manzano Vista	3.2	0.41	4.8	0.74	15 & 16	11.80	14.20	400U	14.20	400X	25.51
	400U	1.60	7.07	39.71	Std. (8")	Manzano Vista	3.2	0.47	5.5	0.94	17 & 18	14.20	25.51	400X	25.51	-	-
	400V	3.71	16.39	25.24	Std. (8")	White Dove	2.0	0.43	4.0	0.68		0.00	25.24	400AC	12.62	400W	12.62
	400W	0.78	3.45	16.07	Std. (8")	White Dove	2.0	0.38	3.5	0.57	-	0.00	16.07	400X	16.07	-	-
	400X	0.29	1.28	42.86	Std. (8")	Manzano Vista	3.1	0.47	5.7	0.97	-	0.00	42.86	400Z	21.43	400Y	21.43
	400Y	0.93	4.11	25.54	Std. (8")	Rock Squirrel	2.0	0.43	4.0	0.68	-	0.00	25.54	400AH	25.54	-	-
	400Z	1.54	6.80	28.23	Std. (8")	Manzano 40' FF	1.0	0.42	4.1	0.68	-	0.00	28.23	400AF	28.23	-	-
	400AB	2.98	13.16	13.16	Std. (4")	Lobo Trot	1.0	0.33	2.5	0.43	S7 & S8	13.16	0.00	-	-	-	-
	400AC	1.43	6.32	18.94	Std. (8")	Running Bear	6.0	0.31	5.5	0.78	-	0.00	18.94	400AD	18.94	-	-
	400AD	2.64	11.66	58.83	Std. (8")	Cougar Run 40' FF	1.0	0.61	4.0	0.86	S23 & S24	58.83	0.00	400AI	11.10	400AH	11.10
	400AG	2.83	12.50	22.21	Std. (8")	Rock Squirrel	3.4	0.38	4.6	0.71	-	0.00	22.21	-	-	-	-
	400AH	0.24	1.06	37.70	Std. (8")	Rock Squirrel	Sump				S5 & S6	37.70	0.00	400AJ	12.61	-	-
	400AI	0.34	1.50	12.61	Std. (8")	Sandia Sunset	1.0	0.38	2.5	0.48	-	0.00	12.61	-	-	-	-
	400AJ	1.95	8.61	28.98	Std. (8")	Sandia Sunset	1.4	0.52	4.4	0.82	S3 & S4	28.98	0.00	-	-	-	-
		77.70	343.61	L								352.84					

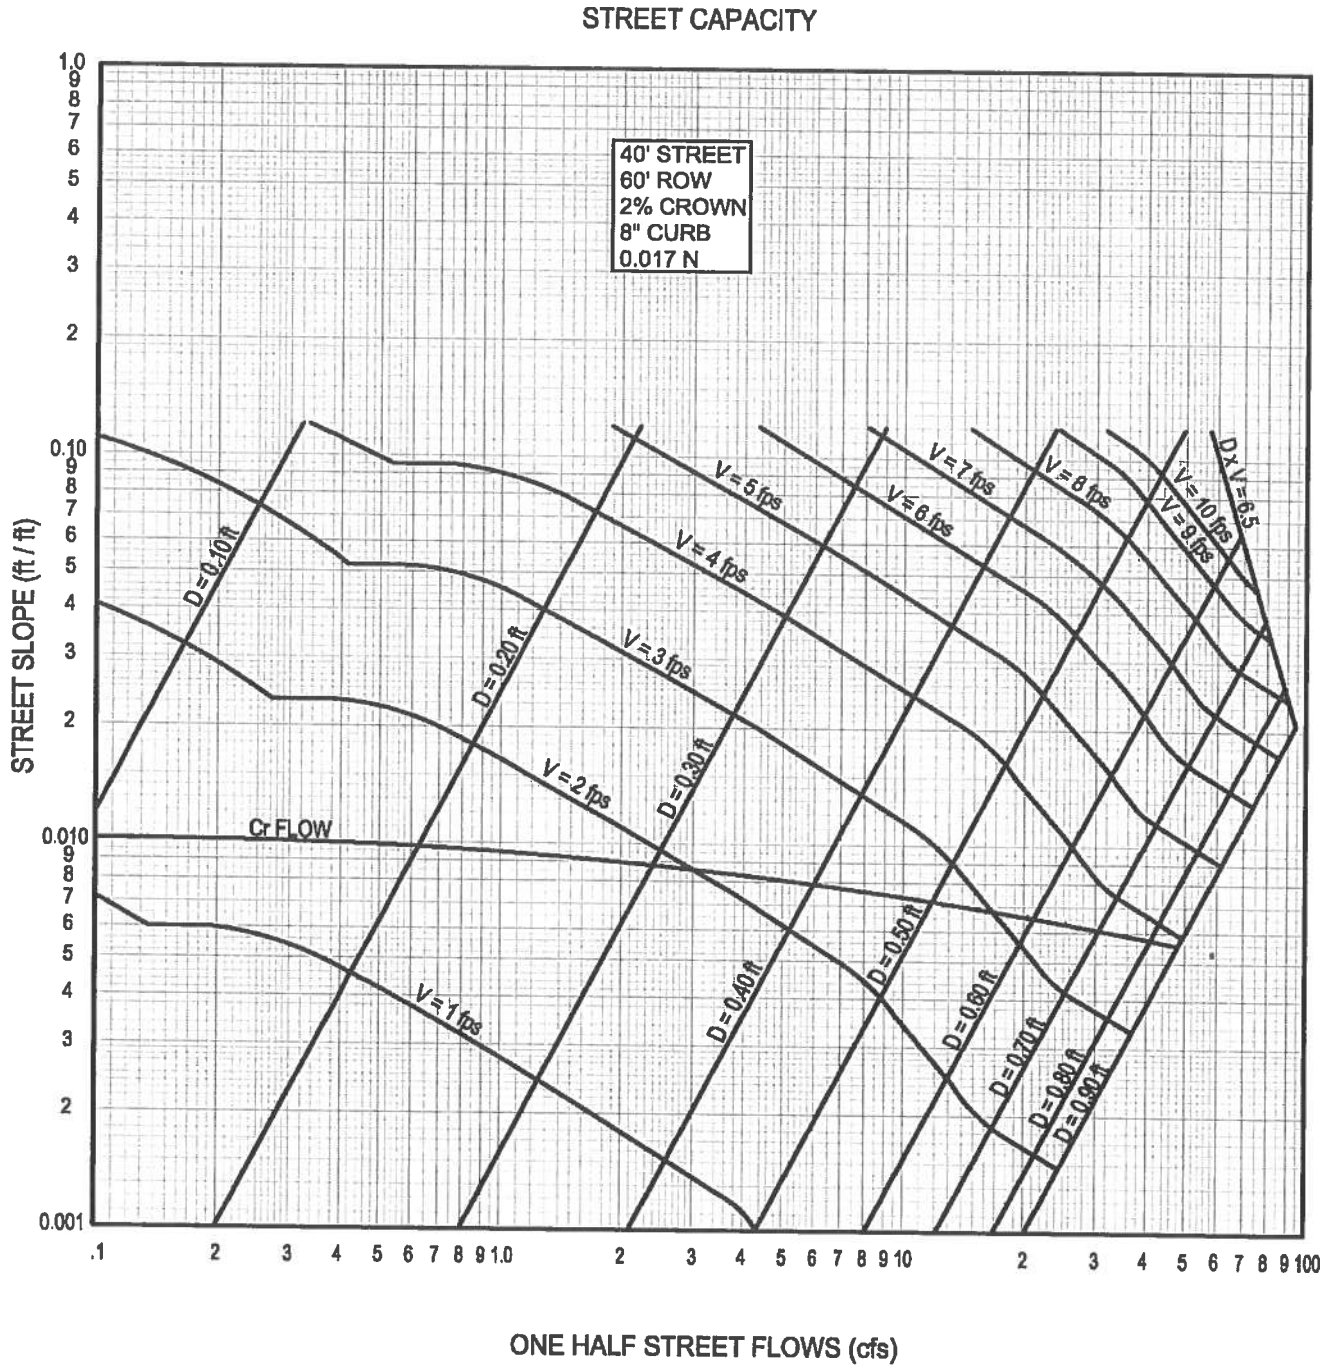
STREET CAPACITY
40' STREET
60' ROW
2% CROWN
8" CURB
0.017 N
STREET SLOPE (ft / ft)
ONE HALF STREET FLOWS (cfs)
Cr FLOW
D=0.10 ft
D=0.20 ft
D=0.30 ft
D=0.40 ft
D=0.50 ft
D=0.60 ft
D=0.70 ft
D=0.80 ft
D=0.90 ft
V=1 fps
V=2 fps
V=3 fps
V=4 fps
V=5 fps
V=6 fps
V=7 fps
V=8 fps
V=9 fps
V=10 fps
D x V = 6.5

PLATE 22.3 D-3

CHART 1

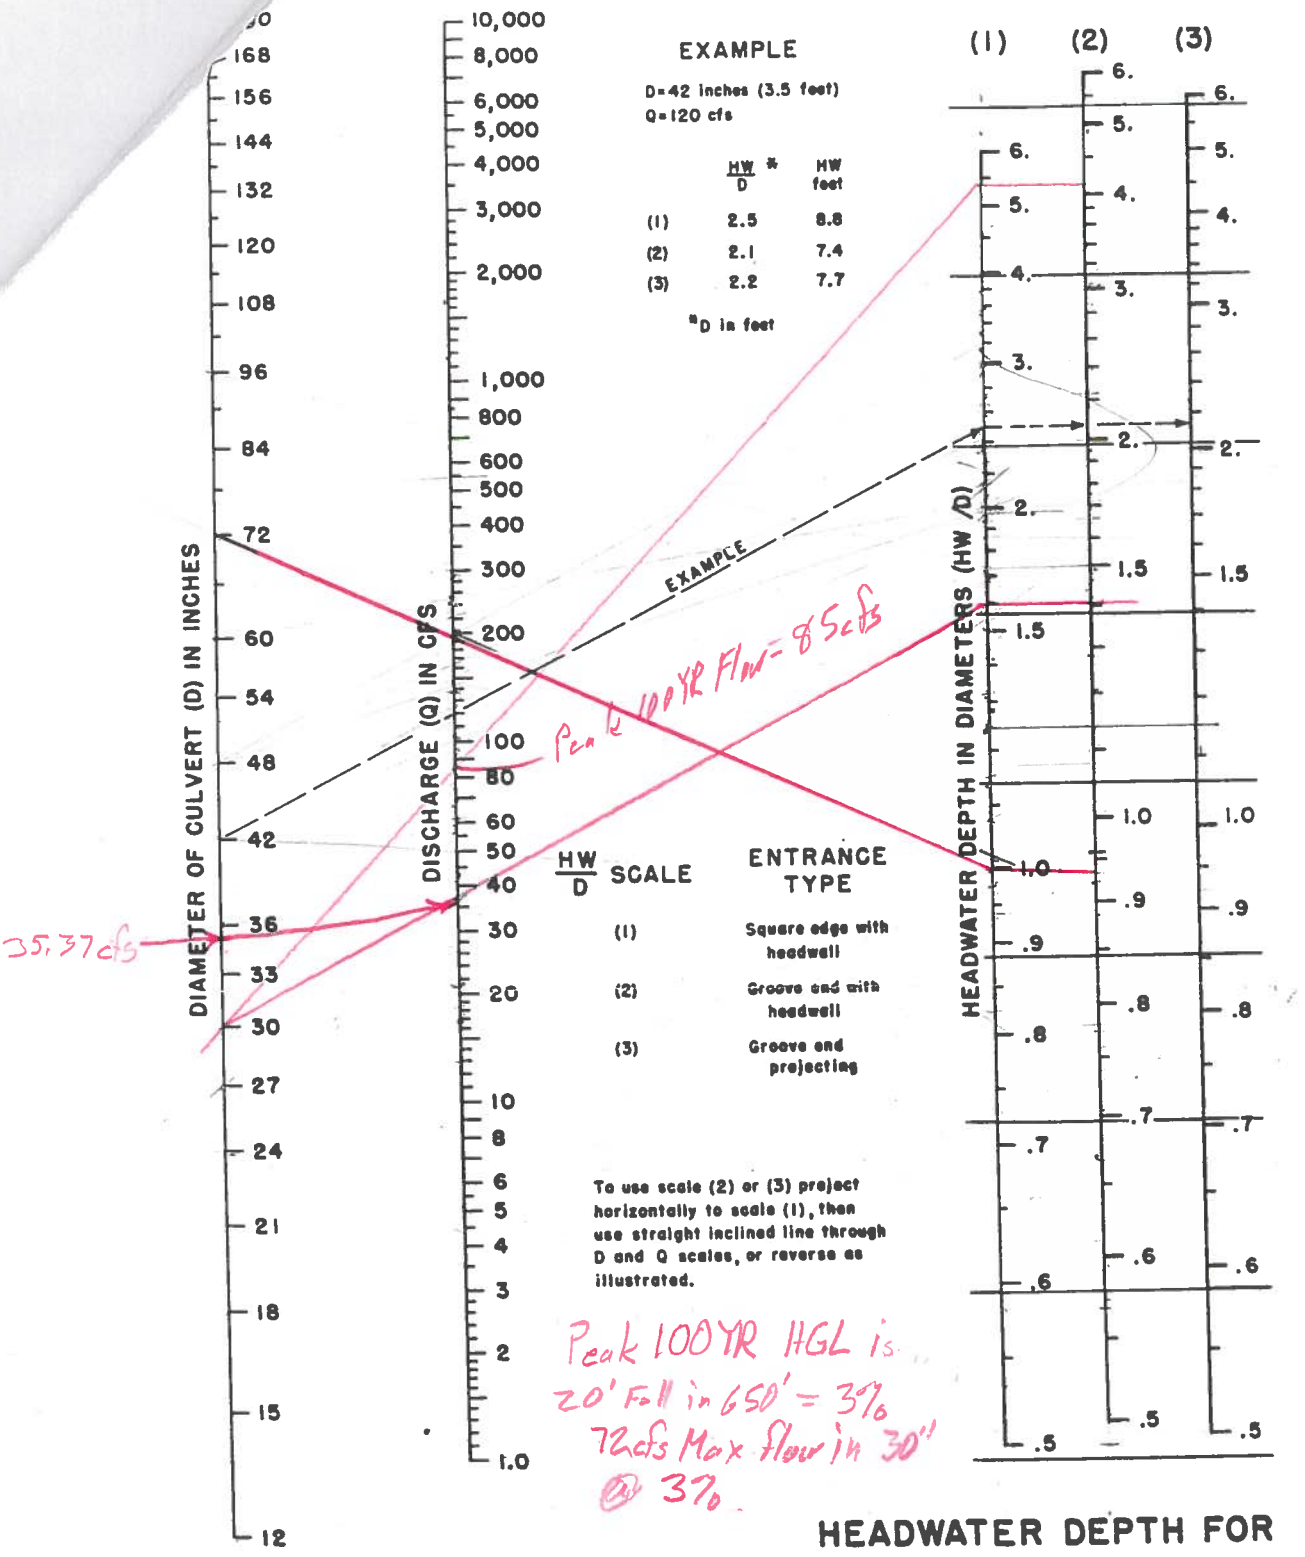

HEADWATER SCALES 2&3
REVISED MAY 1964

BUREAU OF PUBLIC ROADS JAN. 1963

HEADWATER DEPTH FOR CONCRETE PIPE CULVERTS WITH INLET CONTROL

D. Mark Goodwin & Associates, P.A.
Consulting Engineers
P.O. BOX 90606, ALBUQUERQUE,NM 87199
(505) 828-2200 FAX 797-9539

PROJECT
SUBJECT
BY DATE
CHECKED DATE
SHEET OF

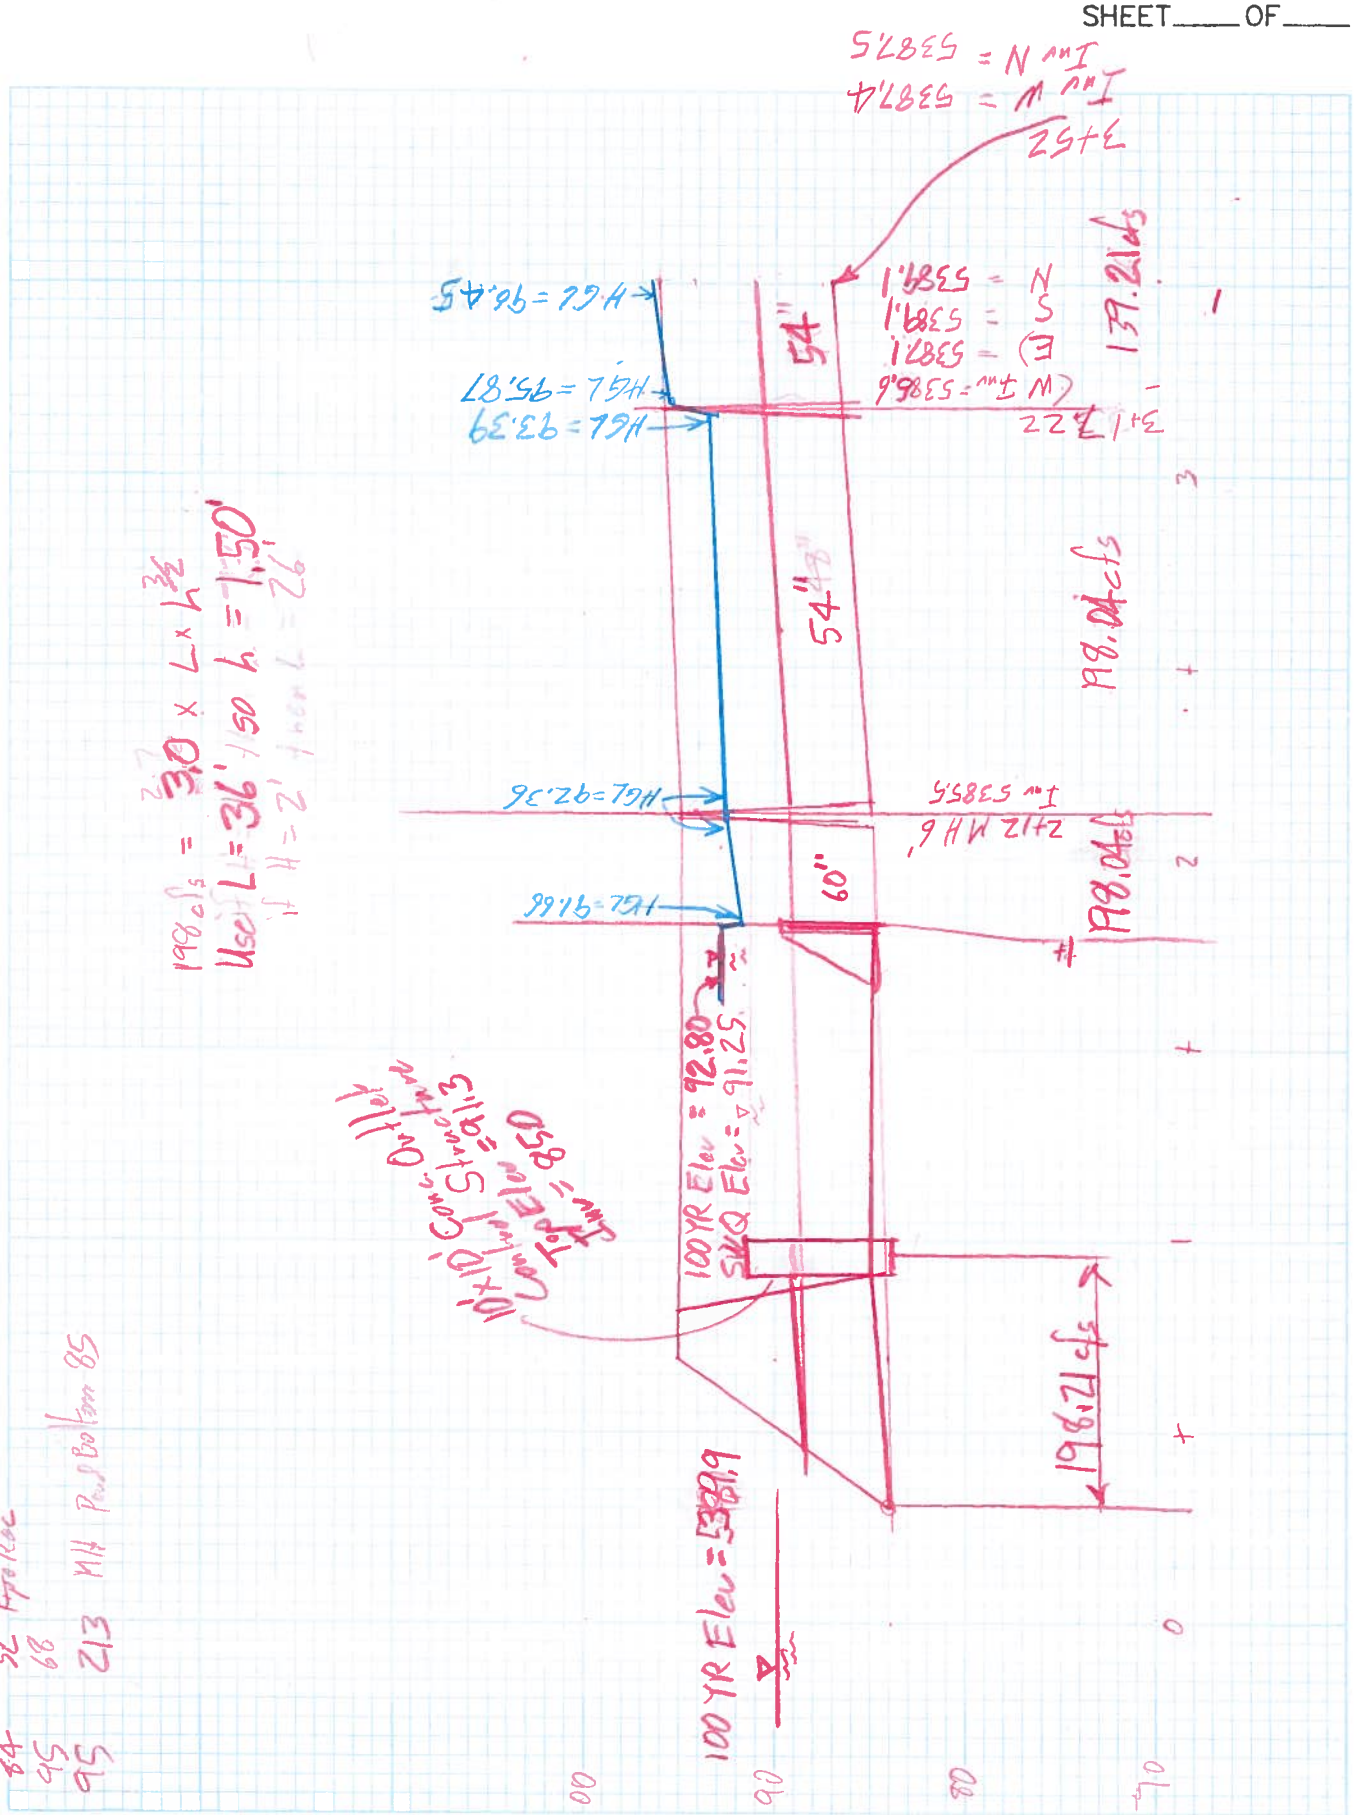

D. Mark Goodwin & Associates, P.A.
Consulting Engineers
P.O. BOX 90606, ALBUQUERQUE NM 87199
(505) 828-2200 FAX 797-9539

PROJECT Juan Tabo Hills Estates
SUBJECT Junction / Water Quality Box
BY Doug Hughes DATE 5/18/2016
CHECKED _____ DATE _____
SHEET ____ OF ____

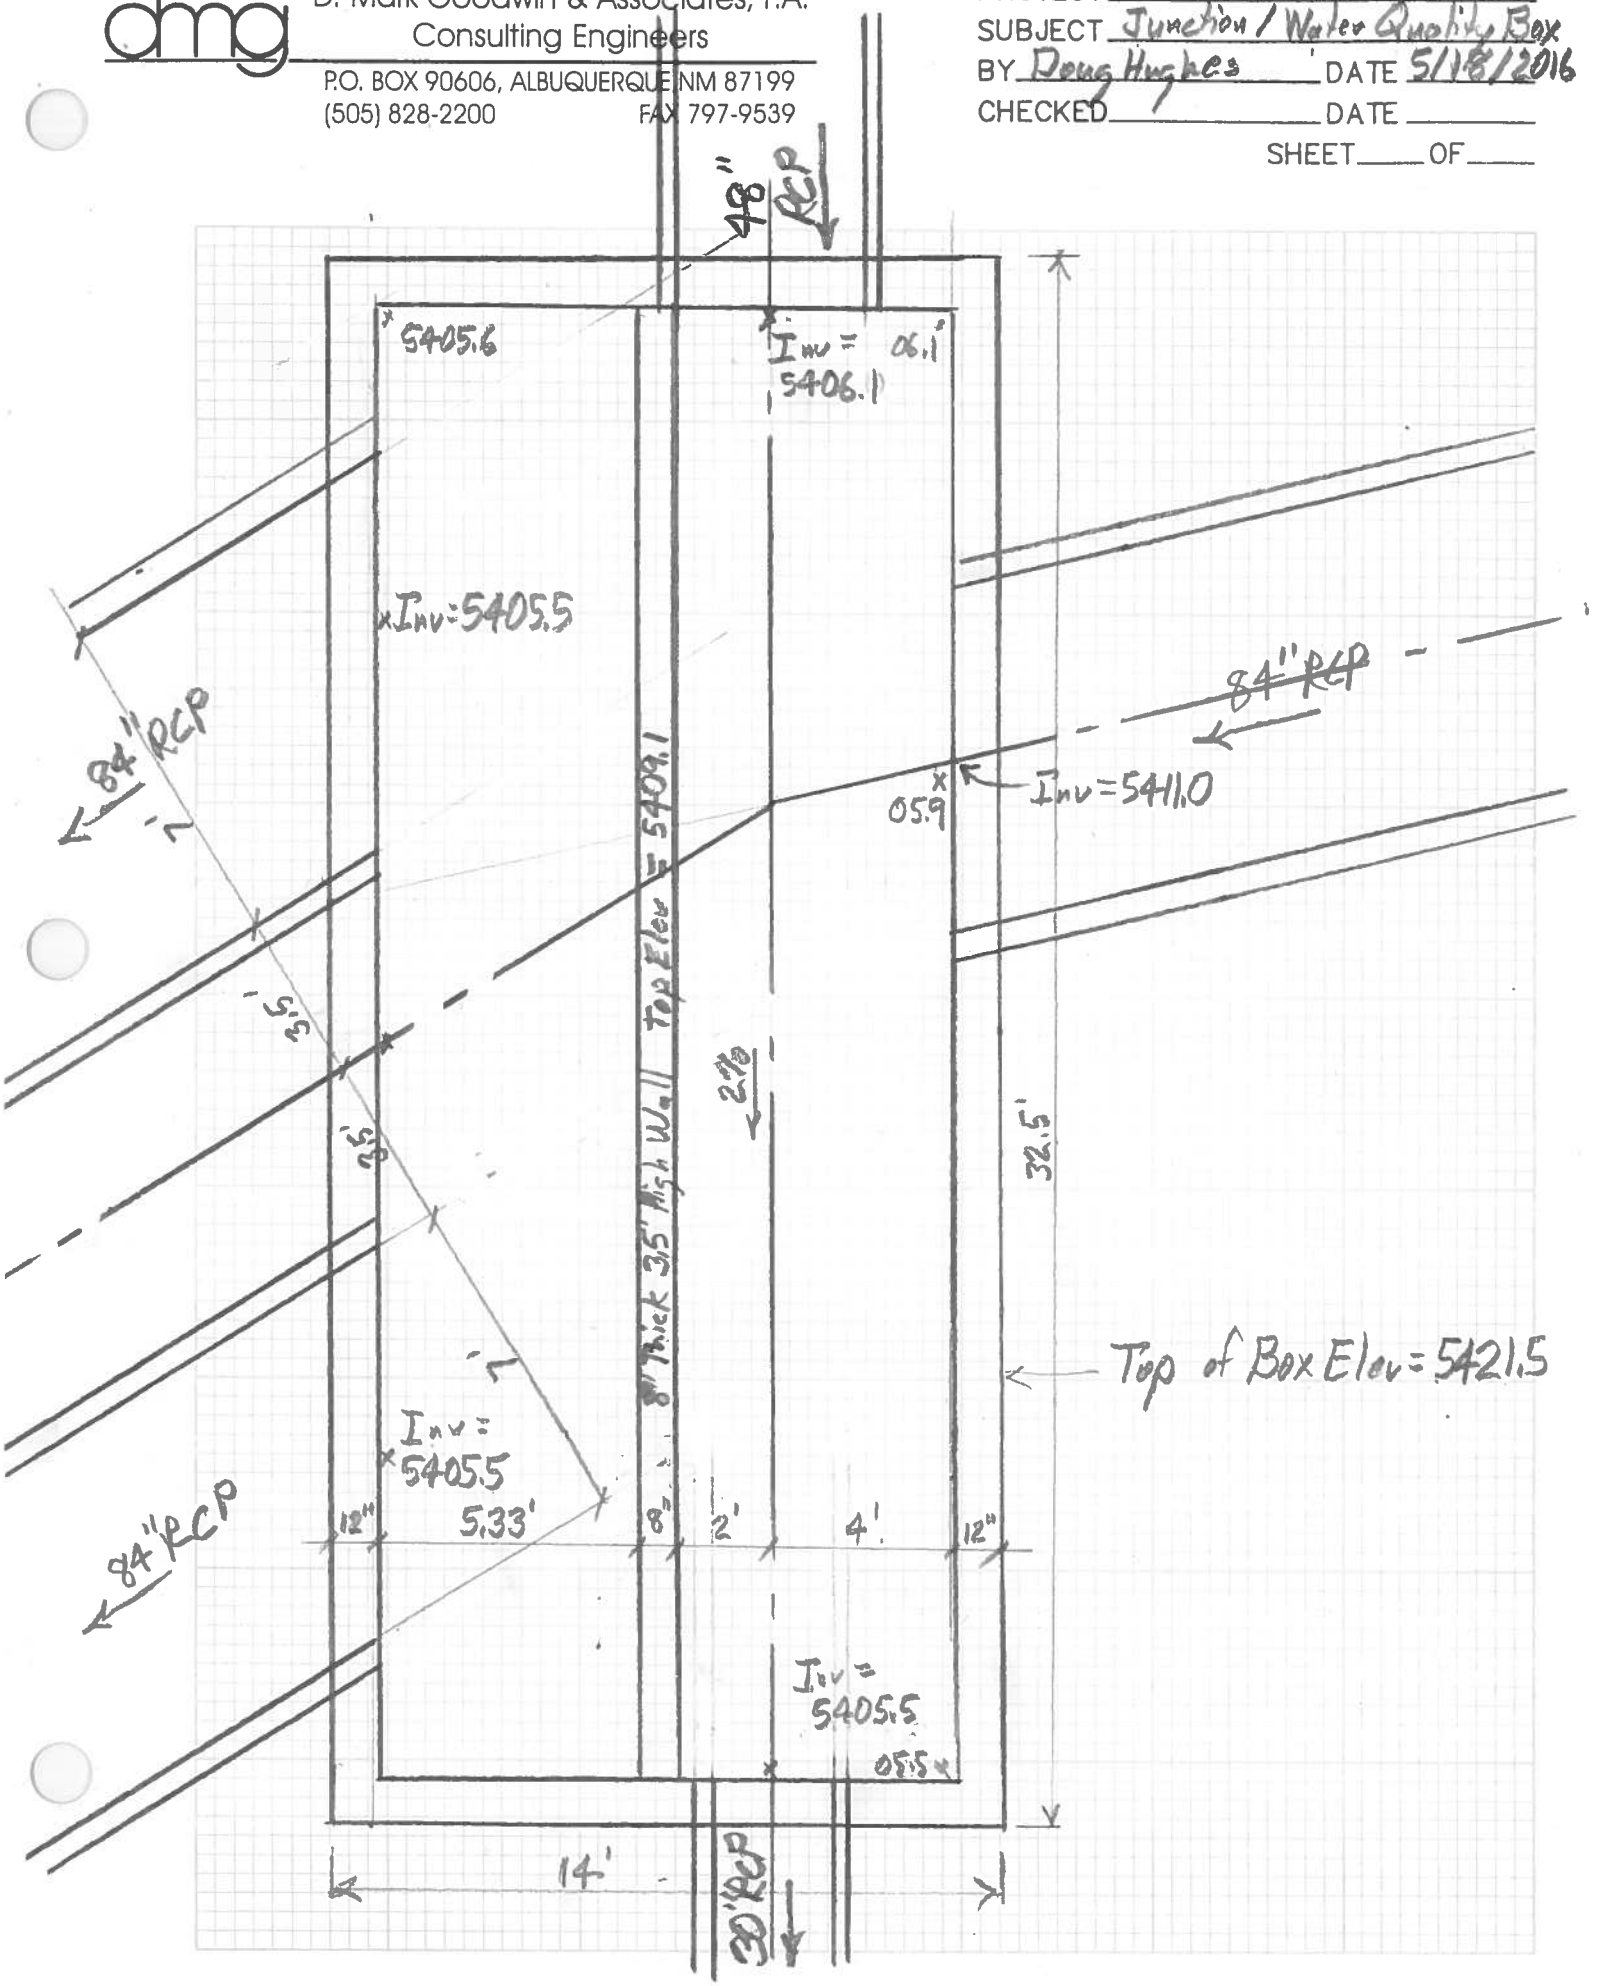

Rocky Top Drive

Station / L/Elem	Invert Elev / Ch Slope	Depth (FT) / SF Ave	Water Elev / HF	Q (CFS) / SE Dpth	Vel (FPS) / Froude N	Vel Head / Norm Dp	Energy Grd.El. / "N"	Super Elev / X-Fall	Critical Depth / ZR	Flow Top Width / ZL	Height/ Dia.-FT /	Base Wt or I.D. /	No Wth Prs/Pip / Type Ch
2254.000	5406.100	10.490	5416.590	80.06	11.33	1.99	5418.58	.00	2.77	.00	3.000	.000	1 .0
JB 212.000	.0373					.0144	3.05	10.49	.00	1.71	.013	.00	.00 PIPE
2466.000	5414.000	5.644	5419.645	80.06	11.33	1.99	5421.64	.00	2.77	.00	3.000	.000	1 .0
JUNCT STR	.1250					.0095	.04	.00	.00		.013	.00	.00 PIPE
MH-7 2470.000	5414.500	6.676	5421.176	27.80	5.66	.50	5421.67	.00	1.80	.00	2.500	.000	1 .0
156.214	.0314					.0046	.72	6.68	.00	1.07	.013	.00	.00 PIPE
2626.214	5419.399	2.551	5421.949	27.80	5.66	.50	5422.45	.00	1.80	.00	2.500	.000	1 .0
HYDRAULIC JUMP													
2626.214	5419.399	1.224	5420.623	27.80	11.64	2.10	5422.73	.00	1.80	2.50	2.500	.000	1 .0
2.130	.0314					.0195	.04	1.22	2.10	1.07	.013	.00	.00 PIPE
2628.344	5419.466	1.232	5420.698	27.80	11.54	2.07	5422.76	.00	1.80	2.50	2.500	.000	1 .0
10.656	.0314					.0181	.19	1.23	2.07	1.07	.013	.00	.00 PIPE
2639.000	5419.800	1.279	5421.080	27.80	11.00	1.88	5422.96	.00	1.80	2.50	2.500	.000	1 .0
MH-6 35.345	.0167					.0171	.61	1.28	1.93	1.29	.013	.00	.00 PIPE
2674.345	5420.389	1.273	5421.662	27.80	11.06	1.90	5423.56	.00	1.80	2.50	2.500	.000	1 .0
81.862	.0167					.0184	1.51	1.27	1.94	1.29	.013	.00	.00 PIPE
2756.207	5421.753	1.226	5422.979	27.80	11.60	2.09	5425.07	.00	1.80	2.50	2.500	.000	1 .0
38.793	.0167					.0209	.81	1.23	2.09	1.29	.013	.00	.00 PIPE

Station / L/Elem	Invert Elev / Ch Slope	Depth (FT)	Water Elev	Q (CFS)	Vel (FPS)	Vel Head / SF Ave	Energy Grd.El. / HF	Super Elev / SE Dpth	Critical Depth / Froude N	Flow Top Width / Norm Dp	Height/ Dia.-FT / "N"	Base Wt or I.D. / X-Fall	ZL / ZR	No Wth Prs/Pip / Type Ch
2795.000	5422.400	1.182	5423.582	27.80	12.17	2.30	5425.88	1.00	1.80	2.50	2.500	.000	.00	1 .0
TRANS STR	.1250					.0177	.07	2.18	2.24		.013	.00	.00	PIPE
MH-5														
2799.000	5422.900	1.824	5424.724	27.80	9.25	1.33	5426.05	.00	1.82	1.13	2.000	.000	.00	1 .0
21.186	.0107					.0137	.29	1.82	1.00	2.00	.013	.00	.00	PIPE
2820.186	5423.126	2.000	5425.126	27.80	8.85	1.22	5426.34	.00	1.82	.00	2.000	.000	.00	1 .0
128.814	.0107					.0147	1.89	2.00	.00	2.00	.013	.00	.00	PIPE
2949.000	5424.500	2.623	5427.124	27.80	8.85	1.22	5428.34	.00	1.82	.00	2.000	.000	.00	1 .0
MH-4														
139.000	.0029					.0151	2.10	2.62	.00	2.00	.013	.00	.00	PIPE
3088.000	5424.900	4.323	5429.223	27.80	8.85	1.22	5430.44	.00	1.82	.00	2.000	.000	.00	1 .0
JUNCT STR	.0200					.0089	.04	.00	.00		.013	.00	.00	PIPE
Inlet 3														
3093.000	5425.000	6.261	5431.261	11.80	3.76	.22	5431.48	.00	1.23	.00	2.000	.000	.00	1 .0
181.000	.0110					.0027	.49	6.26	.00	1.00	.013	.00	.00	PIPE
3274.000	5427.000	4.753	5431.753	11.80	3.76	.22	5431.97	.00	1.23	.00	2.000	.000	.00	1 .0
JUNCT STR	.0200					.0029	.01	.00	.00		.013	.00	.00	PIPE
Inlet 1A														
3279.000	5427.100	4.979	5432.080	5.90	3.34	.17	5432.25	.00	.94	.00	1.500	.000	.00	1 .0
27.300	.0073					.0032	.09	4.98	.00	.89	.013	.00	.00	PIPE
3306.300	5427.300	4.917	5432.217	5.90	3.34	.17	5432.39	.00	.94	.00	1.500	.000	.00	1 .0
Inlet 2B														

Program Package Serial Number: 1454

WATER SURFACE PROFILE LISTING Date: 2-24-2017 Time:10:46:43

Juan Tabo Hills Estates
Developed 100-YR Flow Rates
Galent Fox Ave.

Station / L/Elem	Invert Elev / Ch Slope	Depth (FT)	Water Elev	Q (CFS)	Vel (FPS)	Vel Head / SF Ave	Energy Grd.El. / HF	Super Elev / SE Dpth	Critical Depth / Froude N	Flow Top Width / Norm Dp	Height/ Dia.-FT / "N"	Base Wt or I.D. / X-Fall	ZL / ZR	No Wth Prs/Pip / Type Ch
1671.000	5403.000	7.500	5410.500	1060.85	3.21	.16	5410.66	.00	2.62	44.00	30.000	44.000	.00	0 .0
TRANS STR	.1000							7.50	.21		.045	.00	.00	RECTANG
1690.000	5404.900	2.126	5407.026	1060.85	20.79	6.71	5413.74	.00	3.93	24.00	30.000	24.000	.00	0 .0
TRANS STR	.1001					.0107	.01	2.13	2.51		.013	.00	.00	RECTANG
Outfall to Tijeras														
1691.000	5405.000	5.987	5410.987	1060.85	15.13	3.56	5414.54	.00	5.99	4.93	7.000	.000	.00	2 .0
84.791	.0056					.0062	.53	5.99	.71	7.00	.013	.00	.00	PIPE
1775.791	5405.471	6.367	5411.838	1060.85	14.43	3.23	5415.07	.00	5.99	4.01	7.000	.000	.00	2 .0
5.209	.0056					.0060	.03	6.37	.59	7.00	.013	.00	.00	PIPE
1781.000	5405.500	6.375	5411.875	1060.85	14.42	3.23	5415.10	.00	5.99	3.99	7.000	.000	.00	2 .0
TRANS STR	.0000					.0031	.01	6.38	.59		.013	.00	.00	PIPE
JB out														
1785.000	5405.500	10.047	5415.547	1060.85	4.40	.30	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
Inv. .125	3.5000					.0002	.00	10.05	.24	.39	.013	.00	.00	RECTANG
1785.125	5405.938	9.579	5415.517	1060.85	4.61	.33	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.118	3.5000					.0002	.00	9.58	.26	.39	.013	.00	.00	RECTANG
1785.243	5406.350	9.134	5415.484	1060.85	4.84	.36	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.111	3.5000					.0002	.00	9.13	.28	.39	.013	.00	.00	RECTANG
1785.354	5406.739	8.709	5415.447	1060.85	5.08	.40	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.104	3.5000					.0002	.00	8.71	.30	.39	.013	.00	.00	RECTANG

Juan Tabo Hills Estates
Developed 100-YR Flow Rates
Galent Fox Ave.

Station / L/Elem	Invert Elev / Ch Slope	Depth (FT) / SF Ave / HF	Water Elev / SE Dpth / Froude N	Q (CFS) / Norm Dp	Vel (FPS) / "N"	Vel Head / X-Fall	Energy Grd.El. / ZR	Super Elev / Type Ch	Critical Depth	Flow Top Width	Height/ Dia.-FT	Base Wt or I.D.	ZL	No Wth Prs/Pip
1785.458	5407.104	8.303	5415.407	1060.85	5.32	.44	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.098	3.5000					.0003	.00	8.30	.33	.39	.013	.00	.00	RECTANG
1785.556	5407.446	7.917	5415.363	1060.85	5.58	.48	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.091	3.5000					.0003	.00	7.92	.35	.39	.013	.00	.00	RECTANG
1785.648	5407.766	7.548	5415.314	1060.85	5.86	.53	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.085	3.5000					.0004	.00	7.55	.38	.39	.013	.00	.00	RECTANG
1785.733	5408.064	7.197	5415.261	1060.85	6.14	.59	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.079	3.5000					.0004	.00	7.20	.40	.39	.013	.00	.00	RECTANG
1785.812	5408.340	6.862	5415.203	1060.85	6.44	.64	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.073	3.5000					.0005	.00	6.86	.43	.39	.013	.00	.00	RECTANG
1785.885	5408.595	6.543	5415.138	1060.85	6.76	.71	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.067	3.5000					.0005	.00	6.54	.47	.39	.013	.00	.00	RECTANG
1785.951	5408.829	6.238	5415.067	1060.85	7.09	.78	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.049	3.5000					.0006	.00	6.24	.50	.39	.013	.00	.00	RECTANG
1786.000	5409.000	6.007	5415.007	1060.85	7.36	.84	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
Weir														
.065	-3.3999					.0006	.00	6.01	.53	.00	.013	.00	.00	RECTANG
1786.065	5408.778	6.308	5415.085	1060.85	7.01	.76	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.072	-3.3999					.0005	.00	6.31	.49	.00	.013	.00	.00	RECTANG

Juan Tabo Hills Estates
Developed 100-YR Flow Rates
Galent Fox Ave.

Station / L/Elem	Invert Elev / Ch Slope	Depth (FT)	Water Elev	Q (CFS)	Vel (FPS)	Vel Head / SF Ave	Energy Grd.El. / HF	Super Elev / SE Dpth	Critical Depth / Froude N	Flow Top Width / Norm Dp	Height/ Dia.-FT / "N"	Base Wt or I.D. / X-Fall	ZL / ZR	No Wth Prs/Pip / Type Ch
1786.137	5408.533	6.623	5415.156	1060.85	6.67	.69	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.078	-3.3999					.0005	.00	6.62	.46	.00	.013	.00	.00	RECTANG
1786.216	5408.267	6.954	5415.221	1060.85	6.36	.63	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.085	-3.3999					.0004	.00	6.95	.42	.00	.013	.00	.00	RECTANG
1786.301	5407.977	7.302	5415.279	1060.85	6.05	.57	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.092	-3.3999					.0003	.00	7.30	.39	.00	.013	.00	.00	RECTANG
1786.393	5407.665	7.667	5415.332	1060.85	5.77	.52	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.099	-3.3999					.0003	.00	7.67	.37	.00	.013	.00	.00	RECTANG
1786.491	5407.330	8.050	5415.380	1060.85	5.49	.47	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.105	-3.3999					.0003	.00	8.05	.34	.00	.013	.00	.00	RECTANG
1786.597	5406.971	8.453	5415.424	1060.85	5.23	.42	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.113	-3.3999					.0002	.00	8.45	.32	.00	.013	.00	.00	RECTANG
1786.710	5406.587	8.876	5415.463	1060.85	4.98	.39	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.120	-3.3999					.0002	.00	8.88	.29	.00	.013	.00	.00	RECTANG
1786.830	5406.180	9.319	5415.499	1060.85	4.74	.35	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.127	-3.3999					.0002	.00	9.32	.27	.00	.013	.00	.00	RECTANG
1786.957	5405.746	9.785	5415.531	1060.85	4.52	.32	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.043	-3.3999					.0002	.00	9.79	.25	.00	.013	.00	.00	RECTANG

Juan Tabo Hills Estates
Developed 100-YR Flow Rates
Galent Fox Ave.

Station / L/Elem	Invert Elev / Ch Slope	Depth (FT) / SF Ave	Water Elev / HF	Q (CFS) / SE Dpth	Vel (FPS) / Froude N	Vel Head / Norm Dp	Energy Grd.El. / "N"	Super Elev / X-Fall	Critical Depth / ZR	Flow Top Width / Type Ch	Height/Dia.-FT / No Wth	Base Wt or I.D. / Prs/Pip	ZL
1787.000	5405.600	9.941	5415.542	1060.85	4.45	.31	5415.85	2.36	3.93	24.00	30.000	24.000	.00
JUNCT STR	.0000					.0001	.00	12.30	.25		.013	.00	.00
1793.000	5405.600	10.197	5415.797	980.79	4.01	.25	5416.05	.00	3.73	24.00	30.000	24.000	.00
TRANS STR	.5399							10.20	.22		.013	.00	.00
JB pipe in													
1794.000	5411.000	5.503	5416.503	980.79	28.23	12.38	5428.88	.00	7.23	6.63	7.500	.000	.00
86.426	.0163					.0212	1.83	5.50	2.17	6.14	.013	.00	.00
1880.426	5412.411	5.395	5417.806	980.79	28.83	12.91	5430.71	.00	7.23	6.74	7.500	.000	.00
158.574	.0163					.0230	3.65	5.40	2.26	6.14	.013	.00	.00
2039.000	5415.000	5.164	5420.164	980.79	30.24	14.20	5434.36	.00	7.23	6.95	7.500	.000	.00
MH 13													
120.000	.0292					.0235	2.82	5.16	2.47	4.84	.013	.00	.00
2159.000	5418.500	5.307	5423.807	980.79	29.35	13.37	5437.18	.00	7.23	6.82	7.500	.000	.00
JUNCT STR	.0625					.0244	.20	5.31	2.34		.013	.00	.00
MH-12													
2167.000	5419.000	5.234	5424.234	938.55	30.41	14.36	5438.59	.00	6.85	6.08	7.000	.000	.00
143.183	.0310					.0251	3.59	5.23	2.38	4.89	.013	.00	.00
2310.183	5423.440	5.434	5428.874	938.55	29.28	13.31	5442.18	.00	6.85	5.83	7.000	.000	.00
114.817	.0310					.0229	2.63	5.43	2.20	4.89	.013	.00	.00
2425.000	5427.000	5.712	5432.712	938.55	27.91	12.10	5444.81	.00	6.85	5.42	7.000	.000	.00
JUNCT STR	.0250					.0226	.18	5.71	1.98		.013	.00	.00
MH-11													

Juan Tabo Hills Estates
Developed 100-YR Flow Rates
Galent Fox Ave.

Station / L/Elem	Invert Elev / Ch Slope	Depth (FT)	Water Elev	Q (CFS)	Vel (FPS)	Vel Head / SF Ave	Energy Grd.El. / HF	Super Elev / SE Dpth	Critical Depth / Froude N	Flow Top Width / Norm Dp	Height/ Dia.-FT / "N"	Base Wt or I.D. / X-Fall	ZL / ZR	No Wth Prs/Pip / Type Ch
2433.000	5427.200	5.395	5432.595	918.56	28.86	12.93	5445.53	.00	6.83	5.89	7.000	.000	.00	1 .0
237.000	.0224					.0238	5.64	5.39	2.19	5.51	.013	.00	.00	PIPE
2670.000	5432.500	5.308	5437.808	918.56	29.34	13.37	5451.17	.00	6.83	5.99	7.000	.000	.00	1 .0
JUNCT STR	.0250					.0256	.20	5.31	2.26		.013	.00	.00	PIPE
MH-10														
2678.000	5432.700	4.971	5437.671	892.94	30.55	14.49	5452.17	.00	6.81	6.35	7.000	.000	.00	1 .0
134.000	.0194					.0285	3.81	4.97	2.51	5.76	.013	.00	.00	PIPE
2812.000	5435.300	4.764	5440.063	892.94	32.02	15.92	5455.98	.00	6.81	6.53	7.000	.000	.00	1 .0
JUNCT STR	.0250					.0328	.13	4.76	2.73		.013	.00	.00	PIPE
Inlet 68														
2816.000	5435.400	4.330	5439.730	848.57	33.94	17.89	5457.62	.00	6.77	6.80	7.000	.000	.00	1 .0
13.399	.0971					.0345	.46	4.33	3.12	3.19	.013	.00	.00	PIPE
2829.399	5436.701	4.431	5441.132	848.57	33.04	16.95	5458.08	.00	6.77	6.75	7.000	.000	.00	1 .0
20.601	.0971					.0314	.65	4.43	2.98	3.19	.013	.00	.00	PIPE
2850.000	5438.701	4.619	5443.320	848.57	31.50	15.41	5458.73	.00	6.77	6.63	7.000	.000	.00	1 .0
MH 9														
5.381	.0936					.0291	.16	4.62	2.75	3.23	.013	.00	.00	PIPE
2855.381	5439.204	4.673	5443.877	848.57	31.09	15.01	5458.88	.00	6.77	6.60	7.000	.000	.00	1 .0
17.433	.0936					.0270	.47	4.67	2.69	3.23	.013	.00	.00	PIPE
2872.814	5440.835	4.877	5445.712	848.57	29.64	13.64	5459.35	.00	6.77	6.44	7.000	.000	.00	1 .0
14.670	.0936					.0241	.35	4.88	2.48	3.23	.013	.00	.00	PIPE

Juan Tabo Hills Estates
Developed 100-YR Flow Rates
Galent Fox Ave.

Station	Invert Elev	Depth (FT)	Water Elev	Q (CFS)	Vel (FPS)	Vel Head	Energy Grd.El.	Super Elev	Critical Depth	Flow Top Width	Height/ Dia.-FT	Base Wt or I.D.	ZL	No Wth Prs/Pip
L/Elem	Ch Slope					SF Ave	HF	SE Dpth	Froude N	Norm Dp	"N"	X-Fall	ZR	Type Ch
2887.484	5442.208	5.098	5447.307	848.57	28.26	12.40	5459.71	.00	6.77	6.23	7.000	.000	.00	1 .0
12.326	.0936					.0216	.27	5.10	2.27	3.23	.013	.00	.00	PIPE
2899.810	5443.362	5.338	5448.700	848.57	26.94	11.27	5459.97	.00	6.77	5.96	7.000	.000	.00	1 .0
10.233	.0936					.0194	.20	5.34	2.07	3.23	.013	.00	.00	PIPE
2910.043	5444.319	5.604	5449.923	848.57	25.69	10.25	5460.17	.00	6.77	5.59	7.000	.000	.00	1 .0
8.302	.0936					.0176	.15	5.60	1.86	3.23	.013	.00	.00	PIPE
2918.345	5445.096	5.905	5451.001	848.57	24.50	9.32	5460.32	.00	6.77	5.09	7.000	.000	.00	1 .0
6.306	.0936					.0162	.10	5.91	1.65	3.23	.013	.00	.00	PIPE
2924.652	5445.687	6.264	5451.951	848.57	23.36	8.47	5460.42	.00	6.77	4.29	7.000	.000	.00	1 .0
3.348	.0936					.0155	.05	6.26	1.41	3.23	.013	.00	.00	PIPE
2928.000	5446.000	6.774	5452.774	848.57	22.27	7.70	5460.47	.00	6.77	2.48	7.000	.000	.00	1 .0

MH-47

Program Package Serial Number: 1454

WATER SURFACE PROFILE LISTING Date: 3- 7-2017 Time:11:36:38

Juan Tabo Hills Estates
Developed 100-YR Flow Rates
Blue Ribbon

Station / L/Elem	Invert Elev / Ch Slope	Depth (FT)	Water Elev	Q (CFS)	Vel (FPS)	Vel Head / SF Ave	Energy Grd.El. / HF	Super Elev / SE Dpth	Critical Depth / Froude N	Flow Top Width / Norm Dp	Height/ Dia.-FT / "N"	Base Wt or I.D. / X-Fall	ZL / ZR	No Wth Prs/Pip / Type Ch
1671.000	5403.000	7.500	5410.500	1060.86	3.21	.16	5410.66	.00	2.62	44.00	30.000	44.000	.00	0 .0
TRANS STR	.1000							7.50	.21		.045	.00	.00	RECTANG
1690.000	5404.900	2.126	5407.026	1060.86	20.79	6.71	5413.74	.00	3.93	24.00	30.000	24.000	.00	0 .0
TRANS STR	.1001					.0107	.01	2.13	2.51		.013	.00	.00	RECTANG
Outfall to Tijeras														
1691.000	5405.000	5.986	5410.986	1060.86	15.14	3.56	5414.54	.00	5.99	4.93	7.000	.000	.00	2 .0
84.126	.0056					.0062	.52	5.99	.71	7.00	.013	.00	.00	PIPE
1775.126	5405.467	6.366	5411.833	1060.86	14.43	3.23	5415.07	.00	5.99	4.02	7.000	.000	.00	2 .0
5.874	.0056					.0060	.04	6.37	.59	7.00	.013	.00	.00	PIPE
1781.000	5405.500	6.376	5411.875	1060.86	14.42	3.23	5415.10	.00	5.99	3.99	7.000	.000	.00	2 .0
TRANS STR	.0000					.0031	.01	6.38	.59		.013	.00	.00	PIPE
JB-Outlet														
1785.000	5405.500	10.048	5415.548	1060.86	4.40	.30	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.125	3.5000					.0002	.00	10.05	.24	.39	.013	.00	.00	RECTANG
1785.125	5405.938	9.580	5415.518	1060.86	4.61	.33	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.118	3.5000					.0002	.00	9.58	.26	.39	.013	.00	.00	RECTANG
1785.243	5406.350	9.134	5415.484	1060.86	4.84	.36	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.111	3.5000					.0002	.00	9.13	.28	.39	.013	.00	.00	RECTANG
1785.354	5406.739	8.709	5415.448	1060.86	5.08	.40	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.104	3.5000					.0002	.00	8.71	.30	.39	.013	.00	.00	RECTANG

Program Package Serial Number: 1454

WATER SURFACE PROFILE LISTING Date: 3- 7-2017 Time:11:36:38

Juan Tabo Hills Estates
Developed 100-YR Flow Rates
Blue Ribbon

Station / L/Elem	Invert Elev / Ch Slope	Depth (FT) / SF Ave	Water Elev / HF	Q (CFS) / SE Dpth	Vel (FPS) / Froude N	Vel Head / Norm Dp	Energy Grd.El. / "N"	Super Elev / X-Fall	Critical Depth / ZR	Flow Top Width	Height/ Dia.-FT	Base Wt or I.D.	ZL	No Wth Prs/Pip / Type Ch
1785.458	5407.104	8.304	5415.408	1060.86	5.32	.44	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.098	3.5000					.0003	.00	8.30	.33	.39	.013	.00	.00	RECTANG
1785.556	5407.446	7.917	5415.364	1060.86	5.58	.48	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.091	3.5000					.0003	.00	7.92	.35	.39	.013	.00	.00	RECTANG
1785.648	5407.767	7.549	5415.315	1060.86	5.86	.53	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.085	3.5000					.0004	.00	7.55	.38	.39	.013	.00	.00	RECTANG
1785.733	5408.065	7.198	5415.263	1060.86	6.14	.59	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.079	3.5000					.0004	.00	7.20	.40	.39	.013	.00	.00	RECTANG
1785.812	5408.341	6.863	5415.204	1060.86	6.44	.64	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.073	3.5000					.0005	.00	6.86	.43	.39	.013	.00	.00	RECTANG
1785.885	5408.596	6.543	5415.140	1060.86	6.76	.71	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.067	3.5000					.0005	.00	6.54	.47	.39	.013	.00	.00	RECTANG
1785.952	5408.830	6.239	5415.069	1060.86	7.09	.78	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.049	3.5000					.0006	.00	6.24	.50	.39	.013	.00	.00	RECTANG
1786.000	5409.000	6.008	5415.008	1060.86	7.36	.84	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
Weir .065	-3.3999					.0006	.00	6.01	.53	.00	.013	.00	.00	RECTANG
1786.065	5408.778	6.308	5415.086	1060.86	7.01	.76	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.072	-3.3999					.0005	.00	6.31	.49	.00	.013	.00	.00	RECTANG

Juan Tabo Hills Estates
Developed 100-YR Flow Rates
Blue Ribbon

Station / L/Elem	Invert Elev / Ch Slope	Depth (FT) / SF Ave	Water Elev / HF	Q (CFS) / SE Dpth	Vel (FPS) / Froude N	Vel Head / Norm Dp	Energy Grd.El. / "N"	Super Elev / X-Fall	Critical Depth / ZR	Flow Top Width	Height/ Dia.-FT /	Base Wt or I.D. /	ZL	No Wth Prs/Pip / Type Ch
1786.137	5408.533	6.624	5415.157	1060.86	6.67	.69	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.078	-3.3999					.0005	.00	6.62	.46	.00	.013	.00	.00	RECTANG
1786.216	5408.267	6.955	5415.222	1060.86	6.36	.63	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.085	-3.3999					.0004	.00	6.96	.42	.00	.013	.00	.00	RECTANG
1786.301	5407.977	7.303	5415.280	1060.86	6.05	.57	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.092	-3.3999					.0003	.00	7.30	.39	.00	.013	.00	.00	RECTANG
1786.393	5407.665	7.668	5415.333	1060.86	5.76	.52	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.099	-3.3999					.0003	.00	7.67	.37	.00	.013	.00	.00	RECTANG
1786.491	5407.330	8.051	5415.381	1060.86	5.49	.47	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.106	-3.3999					.0003	.00	8.05	.34	.00	.013	.00	.00	RECTANG
1786.597	5406.970	8.454	5415.424	1060.86	5.23	.42	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.113	-3.3999					.0002	.00	8.45	.32	.00	.013	.00	.00	RECTANG
1786.710	5406.587	8.877	5415.463	1060.86	4.98	.39	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.120	-3.3999					.0002	.00	8.88	.29	.00	.013	.00	.00	RECTANG
1786.830	5406.179	9.321	5415.500	1060.86	4.74	.35	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.127	-3.3999					.0002	.00	9.32	.27	.00	.013	.00	.00	RECTANG
1786.957	5405.746	9.787	5415.532	1060.86	4.52	.32	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.043	-3.3999					.0002	.00	9.79	.25	.00	.013	.00	.00	RECTANG

Juan Tabo Hills Estates
Developed 100-YR Flow Rates
Blue Ribbon

Station / L/Elem	Invert Elev / Ch Slope	Depth (FT)	Water Elev	Q (CFS)	Vel (FPS)	Vel Head / SF Ave	Energy Grd.El. / HF	Super Elev / SE Dpth	Critical Depth / Froude N	Flow Top Width / Norm Dp	Height/ Dia.-FT / "N"	Base Wt or I.D. / X-Fall	ZL / ZR	No Wth Prs/Pip / Type Ch
1787.000	5405.600	9.942	5415.542	1060.86	4.45	.31	5415.85	2.36	3.93	24.00	30.000	24.000	.00	0 .0
JUNCT STR	.0000					.0001	.00	12.30	.25		.013	.00	.00	RECTANG
1793.000	5405.600	10.198	5415.798	980.80	4.01	.25	5416.05	.00	3.73	24.00	30.000	24.000	.00	0 .0
TRANS STR	5.3999							10.20	.22		.013	.00	.00	RECTANG
JB Pipe In														
1794.000	5411.000	5.585	5416.585	980.80	27.80	12.00	5428.58	.00	7.23	6.54	7.500	.000	.00	1 .0
62.641	.0163					.0202	1.27	5.59	2.11	6.14	.013	.00	.00	PIPE
1856.641	5412.022	5.516	5417.539	980.80	28.16	12.31	5429.85	.00	7.23	6.62	7.500	.000	.00	1 .0
182.359	.0163					.0218	3.97	5.52	2.16	6.14	.013	.00	.00	PIPE
2039.000	5415.000	5.276	5420.276	980.80	29.53	13.54	5433.82	.00	7.23	6.85	7.500	.000	.00	1 .0
MH-13														
120.000	.0292					.0219	2.63	5.28	2.36	4.84	.013	.00	.00	PIPE
2159.000	5418.500	5.484	5423.983	980.80	28.34	12.47	5436.45	.00	7.23	6.65	7.500	.000	.00	1 .0
JUNCT STR	.0625					.0225	.18	5.48	2.19		.013	.00	.00	PIPE
MH-12														
2167.000	5419.000	5.429	5424.429	938.56	29.31	13.34	5437.77	.00	6.85	5.84	7.000	.000	.00	1 .0
43.470	.0310					.0237	1.03	5.43	2.21	4.89	.013	.00	.00	PIPE
2210.470	5420.348	5.514	5425.862	938.56	28.86	12.93	5438.79	.00	6.85	5.72	7.000	.000	.00	1 .0
100.961	.0310					.0222	2.24	5.51	2.13	4.89	.013	.00	.00	PIPE
2311.431	5423.479	5.803	5429.282	938.56	27.52	11.76	5441.04	.00	6.85	5.27	7.000	.000	.00	1 .0
68.594	.0310					.0203	1.39	5.80	1.91	4.89	.013	.00	.00	PIPE

Juan Tabo Hills Estates
Developed 100-YR Flow Rates
Blue Ribbon

Station / L/Elem	Invert Elev / Ch Slope	Depth (FT)	Water Elev	Q (CFS)	Vel (FPS)	Vel Head / SF Ave	Energy Grd.El. / HF	Super Elev / SE Dpth	Critical Depth / Froude N	Flow Top Width / Norm Dp	Height/ Dia.-FT / "N"	Base Wt or I.D. / X-Fall	ZL / ZR	No Wth Prs/Pip / Type Ch
2380.026	5425.605	6.139	5431.745	938.56	26.23	10.69	5442.43	.00	6.85	4.60	7.000	.000	.00	1 .0
44.974	.0310					.0191	.86	6.14	1.66	4.89	.013	.00	.00	PIPE
2425.000	5427.000	6.574	5433.574	938.56	25.01	9.72	5443.29	.00	6.85	3.35	7.000	.000	.00	1 .0
JUNCT STR	.0250					.0190	.15	6.57	1.32		.013	.00	.00	PIPE
MH-11														
2433.000	5427.200	5.973	5433.173	918.57	26.26	10.71	5443.88	.00	6.83	4.95	7.000	.000	.00	1 .0
148.845	.0224					.0188	2.80	5.97	1.74	5.51	.013	.00	.00	PIPE
2581.845	5430.529	6.295	5436.824	918.57	25.19	9.85	5446.68	.00	6.83	4.21	7.000	.000	.00	1 .0
88.155	.0224					.0183	1.61	6.30	1.51	5.51	.013	.00	.00	PIPE
2670.000	5432.500	6.833	5439.333	918.57	24.02	8.96	5448.29	.00	6.83	2.14	7.000	.000	.00	1 .0
JUNCT STR	.0250					.0190	.15	6.83	1.00		.013	.00	.00	PIPE
MH-10														
2678.000	5432.700	7.872	5440.572	892.95	23.20	8.36	5448.93	.00	6.81	.00	7.000	.000	.00	1 .0
134.000	.0194					.0195	2.62	7.87	.00	5.76	.013	.00	.00	PIPE
2812.000	5435.300	7.890	5443.190	892.95	23.20	8.36	5451.55	.00	6.81	.00	7.000	.000	.00	1 .0
JUNCT STR	.5250					.0150	.06	.00	.00		.013	.00	.00	PIPE
Inlet 68														
2816.000	5437.400	13.076	5450.476	41.95	8.55	1.13	5451.61	.00	2.17	.00	2.500	.000	.00	1 .0
24.000	.0083					.0105	.25	13.08	.00	2.50	.013	.00	.00	PIPE
2840.000	5437.600	13.183	5450.783	41.95	8.55	1.13	5451.92	.00	2.17	.00	2.500	.000	.00	1 .0
JUNCT STR	.1500					.0100	.04	.00	.00		.013	.00	.00	PIPE
Inlet 73														

Program Package Serial Number: 1454

WATER SURFACE PROFILE LISTING Date: 3- 7-2017 Time:11:36:38

Juan Tabo Hills Estates
Developed 100-YR Flow Rates
Blue Ribbon

Station / L/Elem	Invert Elev / Ch Slope	Depth (FT) / SF Ave	Water Elev / HF	Q (CFS) / SE Dpth	Vel (FPS) / Froude N	Vel Head / Norm Dp	Energy Grd.El. / "N"	Super Elev / X-Fall	Critical Depth / ZR	Flow Top Width / Type Ch	Height/ Dia.-FT / No Wth Prs/Pip	Base Wt or I.D. /	ZL /
2844.000	5438.200	12.834	5451.034	39.95	8.14	1.03	5452.06	.00	2.13	.00	2.500	.000	.00
21.000	.2143					.0095	.20	12.83	.00	.78	.013	.00	.00
2865.000	5442.700	8.585	5451.285	39.95	8.14	1.03	5452.31	.00	2.13	.00	2.500	.000	.00
JUNCT STR	.1250					.0118	.05	.00	.00		.013	.00	.00
2869.000	5443.200	8.857	5452.057	26.95	8.58	1.14	5453.20	.00	1.81	.00	2.000	.000	.00
8.534	.2743					.0142	.12	8.86	.00	.65	.013	.00	.00
2877.534	5445.541	6.636	5452.177	26.95	8.58	1.14	5453.32	.00	1.81	.00	2.000	.000	.00
HYDRAULIC JUMP													
2877.534	5445.541	.666	5446.207	26.95	29.44	13.46	5459.67	.00	1.81	1.89	2.000	.000	.00
26.932	.2743					.2353	6.34	.67	7.45	.65	.013	.00	.00
2904.465	5452.929	.684	5453.613	26.95	28.33	12.46	5466.08	.00	1.81	1.90	2.000	.000	.00
16.961	.2743					.2090	3.54	.68	7.05	.65	.013	.00	.00
2921.427	5457.582	.709	5458.291	26.95	27.01	11.33	5469.62	.00	1.81	1.91	2.000	.000	.00
11.035	.2743					.1832	2.02	.71	6.59	.65	.013	.00	.00
2932.462	5460.609	.734	5461.343	26.95	25.76	10.30	5471.64	.00	1.81	1.93	2.000	.000	.00
8.004	.2743					.1607	1.29	.73	6.16	.65	.013	.00	.00
2940.466	5462.805	.761	5463.566	26.95	24.56	9.36	5472.93	.00	1.81	1.94	2.000	.000	.00
6.182	.2743					.1410	.87	.76	5.76	.65	.013	.00	.00

Inlet 72

Juan Tabo Hills Estates
Developed 100-YR Flow Rates
Blue Ribbon

Station	Invert Elev	Depth (FT)	Water Elev	Q (CFS)	Vel (FPS)	Vel Head	Energy Grd.El.	Super Elev	Critical Depth	Flow Top Width	Height/ Dia.-FT	Base Wt or I.D.	ZL	No Wth Prs/Pip
L/Elem	Ch Slope					SF Ave	HF	SE Dpth	Froude N	Norm Dp	"N"	X-Fall	ZR	Type Ch
2946.647	5464.500	.788	5465.289	26.95	23.41	8.51	5473.80	.00	1.81	1.95	2.000	.000	.00	1 .0
4.946	.2743					.1237	.61	.79	5.38	.65	.013	.00	.00	PIPE
2951.593	5465.857	.817	5466.674	26.95	22.32	7.74	5474.41	.00	1.81	1.97	2.000	.000	.00	1 .0
4.065	.2743					.1086	.44	.82	5.02	.65	.013	.00	.00	PIPE
2955.658	5466.972	.847	5467.819	26.95	21.29	7.04	5474.85	.00	1.81	1.98	2.000	.000	.00	1 .0
3.401	.2743					.0954	.32	.85	4.69	.65	.013	.00	.00	PIPE
2959.059	5467.905	.878	5468.783	26.95	20.30	6.40	5475.18	.00	1.81	1.99	2.000	.000	.00	1 .0
2.884	.2743					.0838	.24	.88	4.37	.65	.013	.00	.00	PIPE
2961.943	5468.696	.910	5469.606	26.95	19.35	5.81	5475.42	.00	1.81	1.99	2.000	.000	.00	1 .0
2.465	.2743					.0736	.18	.91	4.08	.65	.013	.00	.00	PIPE
2964.408	5469.373	.944	5470.317	26.95	18.45	5.29	5475.60	.00	1.81	2.00	2.000	.000	.00	1 .0
2.122	.2743					.0648	.14	.94	3.80	.65	.013	.00	.00	PIPE
2966.530	5469.955	.980	5470.935	26.95	17.59	4.81	5475.74	.00	1.81	2.00	2.000	.000	.00	1 .0
1.840	.2743					.0570	.10	.98	3.54	.65	.013	.00	.00	PIPE
2968.370	5470.459	1.017	5471.477	26.95	16.77	4.37	5475.85	.00	1.81	2.00	2.000	.000	.00	1 .0
1.594	.2743					.0503	.08	1.02	3.30	.65	.013	.00	.00	PIPE
2969.964	5470.896	1.057	5471.954	26.95	15.99	3.97	5475.92	.00	1.81	2.00	2.000	.000	.00	1 .0
1.392	.2743					.0443	.06	1.06	3.07	.65	.013	.00	.00	PIPE

Juan Tabo Hills Estates
Developed 100-YR Flow Rates
Blue Ribbon

Station / L/Elem	Invert Elev / Ch Slope	Depth (FT)	Water Elev	Q (CFS)	Vel (FPS)	Vel Head / SF Ave	Energy Grd.El. / HF	Super Elev / SE Dpth	Critical Depth / Froude N	Flow Top Width / Norm Dp	Height/ Dia.-FT / "N"	Base Wt or I.D. / X-Fall	ZL / ZR	No Wth Prs/Pip / Type Ch
2971.356	5471.278	1.098	5472.376	26.95	15.25	3.61	5475.99	.00	1.81	1.99	2.000	.000	.00	1 .0
1.213	.2743					.0391	.05	1.10	2.85	.65	.013	.00	.00	PIPE
2972.569	5471.611	1.141	5472.752	26.95	14.54	3.28	5476.03	.00	1.81	1.98	2.000	.000	.00	1 .0
1.053	.2743					.0346	.04	1.14	2.65	.65	.013	.00	.00	PIPE
2973.621	5471.899	1.187	5473.086	26.95	13.86	2.98	5476.07	.00	1.81	1.96	2.000	.000	.00	1 .0
.912	.2743					.0306	.03	1.19	2.46	.65	.013	.00	.00	PIPE
2974.533	5472.149	1.236	5473.386	26.95	13.22	2.71	5476.10	.00	1.81	1.94	2.000	.000	.00	1 .0
.791	.2743					.0271	.02	1.24	2.27	.65	.013	.00	.00	PIPE
2975.324	5472.366	1.287	5473.653	26.95	12.60	2.47	5476.12	.00	1.81	1.92	2.000	.000	.00	1 .0
.676	.2743					.0240	.02	1.29	2.10	.65	.013	.00	.00	PIPE
2976.000	5472.552	1.342	5473.894	26.95	12.02	2.24	5476.14	.00	1.81	1.88	2.000	.000	.00	1 .0
.573	.2743					.0214	.01	1.34	1.94	.65	.013	.00	.00	PIPE
2976.573	5472.709	1.401	5474.110	26.95	11.46	2.04	5476.15	.00	1.81	1.83	2.000	.000	.00	1 .0
.475	.2743					.0191	.01	1.40	1.78	.65	.013	.00	.00	PIPE
2977.048	5472.839	1.465	5474.305	26.95	10.92	1.85	5476.16	.00	1.81	1.77	2.000	.000	.00	1 .0
.383	.2743					.0171	.01	1.47	1.63	.65	.013	.00	.00	PIPE
2977.431	5472.944	1.535	5474.479	26.95	10.41	1.68	5476.16	.00	1.81	1.69	2.000	.000	.00	1 .0
.294	.2743					.0154	.00	1.54	1.48	.65	.013	.00	.00	PIPE

Juan Tabo Hills Estates
Developed 100-YR Flow Rates
Blue Ribbon

Station / L/Elem	Invert Elev / Ch Slope	Depth (FT)	Water Elev	Q (CFS)	Vel (FPS)	Vel Head / SF Ave	Energy Grd.El. / HF	Super Elev / SE Dpth	Critical Depth / Froude N	Flow Top Width / Norm Dp	Height/ Dia.-FT / "N"	Base Wt or I.D. / X-Fall	ZL / ZR	No Wth Prs/Pip / Type Ch
2977.725	5473.025	1.612	5474.637	26.95	9.93	1.53	5476.17	.00	1.81	1.58	2.000	.000	.00	1 .0
.197	.2743					.0140	.00	1.61	1.34	.65	.013	.00	.00	PIPE
2977.921	5473.079	1.700	5474.779	26.95	9.47	1.39	5476.17	.00	1.81	1.43	2.000	.000	.00	1 .0
.079	.2743					.0129	.00	1.70	1.18	.65	.013	.00	.00	PIPE
2978.000	5473.100	1.807	5474.907	26.95	9.02	1.26	5476.17	2.00	1.81	1.18	2.000	.000	.00	1 .0
JUNCT STR	.1250					.0083	.03	2.00	1.00		.013	.00	.00	PIPE
Inlet 71														
2982.000	5473.600	3.127	5476.727	14.50	4.62	.33	5477.06	.00	1.37	.00	2.000	.000	.00	1 .0
27.000	.0111					.0041	.11	3.13	.00	1.13	.013	.00	.00	PIPE
3009.000	5473.900	2.955	5476.854	14.50	4.62	.33	5477.19	.00	1.37	.00	2.000	.000	.00	1 .0
JUNCT STR	.0250					.0022	.01	.00	.00		.013	.00	.00	PIPE
Inlet 70														
3013.000	5474.000	3.680	5477.680	2.05	1.16	.02	5477.70	.00	.54	.00	1.500	.000	.00	1 .0
13.000	.0154					.0004	.00	3.68	.00	.40	.013	.00	.00	PIPE
3026.000	5474.200	3.486	5477.686	2.05	1.16	.02	5477.71	.00	.54	.00	1.500	.000	.00	1 .0
Inlet 69														

Program Package Serial Number: 1454

WATER SURFACE PROFILE LISTING Date: 2-24-2017 Time: 2:20:13

Juan Tabo Hills Estates
Developed 100-YR Flow Rates
Silver Dollar St.

Station	Invert Elev	Depth (FT)	Water Elev	Q (CFS)	Vel (FPS)	Vel Head	Energy Grd.El.	Super Elev	Critical Depth	Flow Top Width	Height/ Dia.-FT	Base Wt or I.D.	ZL	No Wth Prs/Pip
L/Elem	Ch Slope					SF Ave	HF	SE Dpth	Froude N	Norm Dp	"N"	X-Fall	ZR	Type Ch
1671.000	5403.000	7.500	5410.500	1060.85	3.21	.16	5410.66	.00	2.62	44.00	30.000	44.000	.00	0 .0
TRANS STR	.1000							7.50	.21		.045	.00	.00	RECTANG
1690.000	5404.900	2.126	5407.026	1060.85	20.79	6.71	5413.74	.00	3.93	24.00	30.000	24.000	.00	0 .0
TRANS STR	.1001					.0107	.01	2.13	2.51		.013	.00	.00	RECTANG
Outfall to Tijeras														
1691.000	5405.000	5.987	5410.987	1060.85	15.13	3.56	5414.54	.00	5.99	4.93	7.000	.000	.00	2 .0
84.791	.0056					.0062	.53	5.99	.71	7.00	.013	.00	.00	PIPE
1775.791	5405.471	6.367	5411.838	1060.85	14.43	3.23	5415.07	.00	5.99	4.01	7.000	.000	.00	2 .0
5.209	.0056					.0060	.03	6.37	.59	7.00	.013	.00	.00	PIPE
1781.000	5405.500	6.375	5411.875	1060.85	14.42	3.23	5415.10	.00	5.99	3.99	7.000	.000	.00	2 .0
JB out														
TRANS STR	.0000					.0031	.01	6.38	.59		.013	.00	.00	PIPE
1785.000	5405.500	10.047	5415.547	1060.85	4.40	.30	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
Inv .125	3.5000					.0002	.00	10.05	.24	.39	.013	.00	.00	RECTANG
1785.125	5405.938	9.579	5415.517	1060.85	4.61	.33	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.118	3.5000					.0002	.00	9.58	.26	.39	.013	.00	.00	RECTANG
1785.243	5406.350	9.134	5415.484	1060.85	4.84	.36	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.111	3.5000					.0002	.00	9.13	.28	.39	.013	.00	.00	RECTANG
1785.354	5406.739	8.709	5415.447	1060.85	5.08	.40	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.104	3.5000					.0002	.00	8.71	.30	.39	.013	.00	.00	RECTANG

Juan Tabo Hills Estates
Developed 100-YR Flow Rates
Silver Dollar St.

Station / L/Elem	Invert Elev / Ch Slope	Depth (FT) / SF Ave	Water Elev / HF	Q (CFS) / SE Dpth	Vel (FPS) / Froude N	Vel Head / Norm Dp	Energy Grd.El. / "N"	Super Elev / X-Fall	Critical Depth / ZR	Flow Top Width / Type Ch	Height/ Dia.-FT /	Base Wt or I.D. /	ZL /	No Wth Prs/Pip /
1785.458	5407.104	8.303	5415.407	1060.85	5.32	.44	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.098	3.5000					.0003	.00	8.30	.33	.39	.013	.00	.00	RECTANG
1785.556	5407.446	7.917	5415.363	1060.85	5.58	.48	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.091	3.5000					.0003	.00	7.92	.35	.39	.013	.00	.00	RECTANG
1785.648	5407.766	7.548	5415.314	1060.85	5.86	.53	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.085	3.5000					.0004	.00	7.55	.38	.39	.013	.00	.00	RECTANG
1785.733	5408.064	7.197	5415.261	1060.85	6.14	.59	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.079	3.5000					.0004	.00	7.20	.40	.39	.013	.00	.00	RECTANG
1785.812	5408.340	6.862	5415.203	1060.85	6.44	.64	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.073	3.5000					.0005	.00	6.86	.43	.39	.013	.00	.00	RECTANG
1785.885	5408.595	6.543	5415.138	1060.85	6.76	.71	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.067	3.5000					.0005	.00	6.54	.47	.39	.013	.00	.00	RECTANG
1785.951	5408.829	6.238	5415.067	1060.85	7.09	.78	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.049	3.5000					.0006	.00	6.24	.50	.39	.013	.00	.00	RECTANG
1786.000	5409.000	6.007	5415.007	1060.85	7.36	.84	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
weir														
.065	-3.3999					.0006	.00	6.01	.53	.00	.013	.00	.00	RECTANG
1786.065	5408.778	6.308	5415.085	1060.85	7.01	.76	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.072	-3.3999					.0005	.00	6.31	.49	.00	.013	.00	.00	RECTANG

Juan Tabo Hills Estates
Developed 100-YR Flow Rates
Silver Dollar St.

Station / L/Elem	Invert Elev / Ch Slope	Depth (FT)	Water Elev	Q (CFS)	Vel (FPS)	Vel Head / SF Ave	Energy Grd.El. / HF	Super Elev / SE Dpth	Critical Depth / Froude N	Flow Top Width / Norm Dp	Height/ Dia.-FT / "N"	Base Wt or I.D. / X-Fall	ZL / ZR	No Wth Prs/Pip / Type Ch
1786.137	5408.533	6.623	5415.156	1060.85	6.67	.69	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.078	-3.3999					.0005	.00	6.62	.46	.00	.013	.00	.00	RECTANG
1786.216	5408.267	6.954	5415.221	1060.85	6.36	.63	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.085	-3.3999					.0004	.00	6.95	.42	.00	.013	.00	.00	RECTANG
1786.301	5407.977	7.302	5415.279	1060.85	6.05	.57	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.092	-3.3999					.0003	.00	7.30	.39	.00	.013	.00	.00	RECTANG
1786.393	5407.665	7.667	5415.332	1060.85	5.77	.52	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.099	-3.3999					.0003	.00	7.67	.37	.00	.013	.00	.00	RECTANG
1786.491	5407.330	8.050	5415.380	1060.85	5.49	.47	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.105	-3.3999					.0003	.00	8.05	.34	.00	.013	.00	.00	RECTANG
1786.597	5406.971	8.453	5415.424	1060.85	5.23	.42	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.113	-3.3999					.0002	.00	8.45	.32	.00	.013	.00	.00	RECTANG
1786.710	5406.587	8.876	5415.463	1060.85	4.98	.39	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.120	-3.3999					.0002	.00	8.88	.29	.00	.013	.00	.00	RECTANG
1786.830	5406.180	9.319	5415.499	1060.85	4.74	.35	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.127	-3.3999					.0002	.00	9.32	.27	.00	.013	.00	.00	RECTANG
1786.957	5405.746	9.785	5415.531	1060.85	4.52	.32	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.043	-3.3999					.0002	.00	9.79	.25	.00	.013	.00	.00	RECTANG

Juan Tabo Hills Estates
Developed 100-YR Flow Rates
Silver Dollar St.

Station / L/Elem	Invert Elev / Ch Slope	Depth (FT) / SF Ave	Water Elev / HF	Q (CFS) / SE Dpth	Vel (FPS) / Froude N	Vel Head / Norm Dp	Energy Grd.El. / "N"	Super Elev / X-Fall	Critical Depth / ZR	Flow Top Width / Type Ch	Height/Dia.-FT /	Base Wt or I.D. /	ZL /	No Wth Prs/Pip /
1787.000	5405.600	9.941	5415.542	1060.85	4.45	.31	5415.85	2.36	3.93	24.00	30.000	24.000	.00	0 .0
JUNCT STR	.0000					.0001	.00	12.30	.25		.013	.00	.00	RECTANG
1793.000	5405.600	10.197	5415.797	980.79	4.01	.25	5416.05	.00	3.73	24.00	30.000	24.000	.00	0 .0
TRANS STR	5.3999							10.20	.22		.013	.00	.00	RECTANG
JB Pipe In														
1794.000	5411.000	5.585	5416.585	980.79	27.80	12.00	5428.58	.00	7.23	6.54	7.500	.000	.00	1 .0
62.622	.0163					.0202	1.27	5.59	2.11	6.14	.013	.00	.00	PIPE
1856.622	5412.022	5.516	5417.539	980.79	28.16	12.31	5429.85	.00	7.23	6.62	7.500	.000	.00	1 .0
182.378	.0163					.0218	3.97	5.52	2.16	6.14	.013	.00	.00	PIPE
2039.000	5415.000	5.276	5420.276	980.79	29.53	13.54	5433.82	.00	7.23	6.85	7.500	.000	.00	1 .0
MH-13														
120.000	.0292					.0219	2.63	5.28	2.36	4.84	.013	.00	.00	PIPE
2159.000	5418.500	5.484	5423.984	980.79	28.34	12.47	5436.45	.00	7.23	6.65	7.500	.000	.00	1 .0
JUNCT STR	.0625					.0225	.18	5.48	2.19		.013	.00	.00	PIPE
MH-12														
2167.000	5419.000	5.429	5424.428	938.55	29.31	13.34	5437.76	.00	6.85	5.84	7.000	.000	.00	1 .0
43.486	.0310					.0237	1.03	5.43	2.21	4.89	.013	.00	.00	PIPE
2210.486	5420.348	5.514	5425.862	938.55	28.86	12.93	5438.79	.00	6.85	5.72	7.000	.000	.00	1 .0
100.953	.0310					.0222	2.24	5.51	2.13	4.89	.013	.00	.00	PIPE
2311.439	5423.479	5.803	5429.282	938.55	27.51	11.76	5441.04	.00	6.85	5.27	7.000	.000	.00	1 .0
68.590	.0310					.0203	1.39	5.80	1.91	4.89	.013	.00	.00	PIPE

Juan Tabo Hills Estates
Developed 100-YR Flow Rates
Silver Dollar St.

Station / L/Elem	Invert Elev / Ch Slope	Depth (FT) / SF Ave	Water Elev / HF	Q (CFS) / SE Dpth	Vel (FPS) / Froude N	Vel Head / Norm Dp	Energy Grd.El. / "N"	Super Elev / X-Fall	Critical Depth / ZR	Flow Top Width / Type Ch	Height/ Dia.-FT /	Base Wt or I.D. /	ZL /	No Wth Prs/Pip /
2380.029	5425.605	6.139	5431.745	938.55	26.23	10.69	5442.43	.00	6.85	4.60	7.000	.000	.00	1 .0
44.971	.0310					.0191	.86	6.14	1.66	4.89	.013	.00	.00	PIPE
2425.000	5427.000	6.574	5433.574	938.55	25.01	9.72	5443.29	.00	6.85	3.35	7.000	.000	.00	1 .0
JUNCT STR	.0250					.0190	.15	6.57	1.32		.013	.00	.00	PIPE
MH-11														
2433.000	5427.200	5.973	5433.173	918.56	26.26	10.71	5443.88	.00	6.83	4.95	7.000	.000	.00	1 .0
148.858	.0224					.0188	2.80	5.97	1.74	5.51	.013	.00	.00	PIPE
2581.858	5430.529	6.295	5436.824	918.56	25.19	9.85	5446.68	.00	6.83	4.21	7.000	.000	.00	1 .0
88.142	.0224					.0183	1.61	6.30	1.51	5.51	.013	.00	.00	PIPE
2670.000	5432.500	6.833	5439.333	918.56	24.02	8.96	5448.29	7.00	6.83	2.14	7.000	.000	.00	1 .0
JUNCT STR	1.2000							7.00	1.00		.013	.00	.00	PIPE
MH-10														
2678.000	5442.100	1.733	5443.833	25.62	8.86	1.22	5445.05	.00	1.78	1.36	2.000	.000	.00	1 .0
48.432	.0118					.0118	.57	1.73	1.07	1.73	.013	.00	.00	PIPE
2726.432	5442.670	1.733	5444.402	25.62	8.86	1.22	5445.62	.00	1.78	1.36	2.000	.000	.00	1 .0
19.568	.0118					.0116	.23	1.73	1.07	1.73	.013	.00	.00	PIPE
2746.000	5442.900	1.777	5444.677	25.62	8.69	1.17	5445.85	2.00	1.78	1.26	2.000	.000	.00	1 .0
JUNCT STR	.1250					.0131	.05	2.00	1.00		.013	.00	.00	PIPE
Inlet 1														
2750.000	5443.400	3.037	5446.437	12.81	7.25	.82	5447.25	.00	1.34	.00	1.500	.000	.00	1 .0
25.000	.0120					.0149	.37	3.04	.00	1.50	.013	.00	.00	PIPE

Juan Tabo Hills Estates
Developed 100-YR Flow Rates
Silver Dollar St.

Station	Invert Elev	Depth (FT)	Water Elev	Q (CFS)	Vel (FPS)	Vel Head	Energy Grd.El.	Super Elev	Critical Depth	Flow Top Width	Height/ Dia.-FT	Base Wt or I.D.	ZL	No Wth Prs/Pip
L/Elem	Ch Slope					SF Ave	HF	SE Dpth	Froude N	Norm Dp	"N"	X-Fall	ZR	Type Ch
2775.000	5443.700	3.109	5446.809	12.81	7.25	.82	5447.63	.00	1.34	.00	1.500	.000	.00	1 .0

Inlet 2

Program Package Serial Number: 1454

WATER SURFACE PROFILE LISTING Date: 2-24-2017 Time:12:15: 4

Juan Tabo Hills Estates
Developed 100-YR Flow Rates
Hubbard St.

Station / L/Elem	Invert Elev / Ch Slope	Depth (FT)	Water Elev	Q (CFS)	Vel (FPS)	Vel Head / SF Ave	Energy Grd.El. / HF	Super Elev / SE Dpth	Critical Depth / Froude N	Flow Top Width / Norm Dp	Height/ Dia.-FT / "N"	Base Wt or I.D. / X-Fall	ZL / ZR	No Wth Prs/Pip / Type Ch
1671.000	5403.000	7.500	5410.500	1060.85	3.21	.16	5410.66	.00	2.62	44.00	30.000	44.000	.00	0 .0
TRANS STR	.1000							7.50	.21		.045	.00	.00	RECTANG
1690.000	5404.900	2.126	5407.026	1060.85	20.79	6.71	5413.74	.00	3.93	24.00	30.000	24.000	.00	0 .0
TRANS STR	.1001					.0107	.01	2.13	2.51		.013	.00	.00	RECTANG
Outfall to Tijeras														
1691.000	5405.000	5.987	5410.987	1060.85	15.13	3.56	5414.54	.00	5.99	4.93	7.000	.000	.00	2 .0
84.791	.0056					.0062	.53	5.99	.71	7.00	.013	.00	.00	PIPE
1775.791	5405.471	6.367	5411.838	1060.85	14.43	3.23	5415.07	.00	5.99	4.01	7.000	.000	.00	2 .0
5.209	.0056					.0060	.03	6.37	.59	7.00	.013	.00	.00	PIPE
1781.000	5405.500	6.375	5411.875	1060.85	14.42	3.23	5415.10	.00	5.99	3.99	7.000	.000	.00	2 .0
JB Pipe Out														
TRANS STR	.0000					.0031	.01	6.38	.59		.013	.00	.00	PIPE
1785.000	5405.500	10.047	5415.547	1060.85	4.40	.30	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
Inv														
.125	3.5000					.0002	.00	10.05	.24	.39	.013	.00	.00	RECTANG
1785.125	5405.938	9.579	5415.517	1060.85	4.61	.33	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.118	3.5000					.0002	.00	9.58	.26	.39	.013	.00	.00	RECTANG
1785.243	5406.350	9.134	5415.484	1060.85	4.84	.36	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.111	3.5000					.0002	.00	9.13	.28	.39	.013	.00	.00	RECTANG
1785.354	5406.739	8.709	5415.447	1060.85	5.08	.40	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.104	3.5000					.0002	.00	8.71	.30	.39	.013	.00	.00	RECTANG

Juan Tabo Hills Estates
Developed 100-YR Flow Rates
Hubbard St.

Station / L/Elem	Invert Elev / Ch Slope	Depth (FT)	Water Elev	Q (CFS)	Vel (FPS)	Vel Head / SF Ave	Energy Grd.El. / HF	Super Elev / SE Dpth	Critical Depth / Froude N	Flow Top Width / Norm Dp	Height/ Dia.-FT / "N"	Base Wt or I.D. / X-Fall	ZL / ZR	No Wth Prs/Pip / Type Ch
1785.458	5407.104	8.303	5415.407	1060.85	5.32	.44	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.098	3.5000					.0003	.00	8.30	.33	.39	.013	.00	.00	RECTANG
1785.556	5407.446	7.917	5415.363	1060.85	5.58	.48	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.091	3.5000					.0003	.00	7.92	.35	.39	.013	.00	.00	RECTANG
1785.648	5407.766	7.548	5415.314	1060.85	5.86	.53	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.085	3.5000					.0004	.00	7.55	.38	.39	.013	.00	.00	RECTANG
1785.733	5408.064	7.197	5415.261	1060.85	6.14	.59	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.079	3.5000					.0004	.00	7.20	.40	.39	.013	.00	.00	RECTANG
1785.812	5408.340	6.862	5415.203	1060.85	6.44	.64	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.073	3.5000					.0005	.00	6.86	.43	.39	.013	.00	.00	RECTANG
1785.885	5408.595	6.543	5415.138	1060.85	6.76	.71	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.067	3.5000					.0005	.00	6.54	.47	.39	.013	.00	.00	RECTANG
1785.951	5408.829	6.238	5415.067	1060.85	7.09	.78	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.049	3.5000					.0006	.00	6.24	.50	.39	.013	.00	.00	RECTANG
1786.000	5409.000	6.007	5415.007	1060.85	7.36	.84	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
weir														
.065	-3.3999					.0006	.00	6.01	.53	.00	.013	.00	.00	RECTANG
1786.065	5408.778	6.308	5415.085	1060.85	7.01	.76	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.072	-3.3999					.0005	.00	6.31	.49	.00	.013	.00	.00	RECTANG

Juan Tabo Hills Estates
Developed 100-YR Flow Rates
Hubbard St.

Station / L/Elem	Invert Elev / Ch Slope	Depth (FT)	Water Elev	Q (CFS)	Vel (FPS)	Vel Head / SF Ave	Energy Grd.El. / HF	Super Elev / SE Dpth	Critical Depth / Froude N	Flow Top Width / Norm Dp	Height/ Dia.-FT / "N"	Base Wt or I.D. / X-Fall	ZL / ZR	No Wth Prs/Pip / Type Ch
1786.137	5408.533	6.623	5415.156	1060.85	6.67	.69	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.078	-3.3999					.0005	.00	6.62	.46	.00	.013	.00	.00	RECTANG
1786.216	5408.267	6.954	5415.221	1060.85	6.36	.63	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.085	-3.3999					.0004	.00	6.95	.42	.00	.013	.00	.00	RECTANG
1786.301	5407.977	7.302	5415.279	1060.85	6.05	.57	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.092	-3.3999					.0003	.00	7.30	.39	.00	.013	.00	.00	RECTANG
1786.393	5407.665	7.667	5415.332	1060.85	5.77	.52	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.099	-3.3999					.0003	.00	7.67	.37	.00	.013	.00	.00	RECTANG
1786.491	5407.330	8.050	5415.380	1060.85	5.49	.47	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.105	-3.3999					.0003	.00	8.05	.34	.00	.013	.00	.00	RECTANG
1786.597	5406.971	8.453	5415.424	1060.85	5.23	.42	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.113	-3.3999					.0002	.00	8.45	.32	.00	.013	.00	.00	RECTANG
1786.710	5406.587	8.876	5415.463	1060.85	4.98	.39	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.120	-3.3999					.0002	.00	8.88	.29	.00	.013	.00	.00	RECTANG
1786.830	5406.180	9.319	5415.499	1060.85	4.74	.35	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.127	-3.3999					.0002	.00	9.32	.27	.00	.013	.00	.00	RECTANG
1786.957	5405.746	9.785	5415.531	1060.85	4.52	.32	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.043	-3.3999					.0002	.00	9.79	.25	.00	.013	.00	.00	RECTANG

Juan Tabo Hills Estates
Developed 100-YR Flow Rates
Hubbard St.

Station / L/Elem	Invert Elev / Ch Slope	Depth (FT) / SF Ave	Water Elev / HF	Q (CFS) / SE Dpth	Vel (FPS) / Froude N	Vel Head / Norm Dp	Energy Grd.El. / "N"	Super Elev / X-Fall	Critical Depth / ZR	Flow Top Width / Type Ch	Height/Dia.-FT / No Wth	Base Wt or I.D. / Prs/Pip	ZL
1787.000	5405.600	9.941	5415.542	1060.85	4.45	.31	5415.85	2.36	3.93	24.00	30.000	24.000	.00
JUNCT STR	.0000					.0001	.00	12.30	.25		.013	.00	.00
1793.000	5405.600	10.197	5415.797	980.79	4.01	.25	5416.05	.00	3.73	24.00	30.000	24.000	.00
TRANS STR	5.3999							10.20	.22		.013	.00	.00
JB Pipe In													
1794.000	5411.000	5.592	5416.592	980.79	27.76	11.97	5428.56	.00	7.23	6.53	7.500	.000	.00
60.344	.0163					.0202	1.22	5.59	2.10	6.14	.013	.00	.00
1854.344	5411.985	5.526	5417.511	980.79	28.11	12.27	5429.78	.00	7.23	6.61	7.500	.000	.00
184.656	.0163					.0217	4.00	5.53	2.15	6.14	.013	.00	.00
2039.000	5415.000	5.285	5420.285	980.79	29.48	13.49	5433.78	.00	7.23	6.84	7.500	.000	.00
MH-13													
120.000	.0292					.0218	2.61	5.29	2.36	4.84	.013	.00	.00
2159.000	5418.500	5.499	5423.999	980.79	28.25	12.39	5436.39	.00	7.23	6.63	7.500	.000	.00
JUNCT STR	.0625					.0223	.18	5.50	2.18		.013	.00	.00
MH-12													
2167.000	5419.000	5.446	5424.446	938.55	29.22	13.25	5437.70	.00	6.85	5.82	7.000	.000	.00
81.165	.0310					.0231	1.88	5.45	2.19	4.89	.013	.00	.00
2248.165	5421.517	5.629	5427.146	938.55	28.29	12.43	5439.58	.00	6.85	5.56	7.000	.000	.00
85.564	.0310					.0214	1.83	5.63	2.04	4.89	.013	.00	.00
2333.729	5424.170	5.935	5430.105	938.55	26.98	11.30	5441.41	.00	6.85	5.03	7.000	.000	.00
58.466	.0310					.0197	1.15	5.94	1.81	4.89	.013	.00	.00

Juan Tabo Hills Estates
Developed 100-YR Flow Rates
Hubbard St.

Station / L/Elem	Invert Elev / Ch Slope	Depth (FT)	Water Elev	Q (CFS)	Vel (FPS)	Vel Head / SF Ave	Energy Grd.El. / HF	Super Elev / SE Dpth	Critical Depth / Froude N	Flow Top Width / Norm Dp	Height/ Dia.-FT / "N"	Base Wt or I.D. / X-Fall	ZL / ZR	No Wth Prs/Pip / Type Ch
2392.196	5425.983	6.301	5432.284	938.55	25.72	10.27	5442.56	.00	6.85	4.20	7.000	.000	.00	1 .0
32.804	.0310					.0191	.63	6.30	1.54	4.89	.013	.00	.00	PIPE
2425.000	5427.000	6.846	5433.846	938.55	24.52	9.34	5443.18	7.00	6.85	2.05	7.000	.000	.00	1 .0
JUNCT STR	1.0625							7.00	1.00		.013	.00	.00	PIPE
MH-11														
2433.000	5435.500	1.441	5436.941	19.99	8.25	1.06	5438.00	.00	1.61	1.80	2.000	.000	.00	1 .0
36.559	.0105					.0102	.37	1.44	1.25	1.44	.013	.00	.00	PIPE
2469.559	5435.882	1.459	5437.341	19.99	8.14	1.03	5438.37	.00	1.61	1.78	2.000	.000	.00	1 .0
26.019	.0105					.0095	.25	1.46	1.22	1.44	.013	.00	.00	PIPE
2495.578	5436.154	1.528	5437.682	19.99	7.76	.93	5438.62	.00	1.61	1.70	2.000	.000	.00	1 .0
4.422	.0105					.0086	.04	1.53	1.11	1.44	.013	.00	.00	PIPE
2500.000	5436.200	1.606	5437.806	19.99	7.39	.85	5438.65	2.00	1.61	1.59	2.000	.000	.00	1 .0
JUNCT STR	.1250					.0050	.02	2.00	1.00		.013	.00	.00	PIPE
Inlet 3														
2504.000	5436.700	2.359	5439.059	9.99	3.18	.16	5439.22	.00	1.13	.00	2.000	.000	.00	1 .0
25.000	.0120					.0020	.05	2.36	.00	.88	.013	.00	.00	PIPE
2529.000	5437.000	2.108	5439.108	9.99	3.18	.16	5439.26	.00	1.13	.00	2.000	.000	.00	1 .0
Inlet 4														

Program Package Serial Number: 1454

WATER SURFACE PROFILE LISTING Date: 2-24-2017 Time:11:33:51

Juan Tabo Hills Estates
Developed 100-YR Flow Rates
Duke City north of Sandia Sunset Ave.

Station	Invert Elev	Depth (FT)	Water Elev	Q (CFS)	Vel (FPS)	Vel Head	Energy Grd.El.	Super Elev	Critical Depth	Flow Top Width	Height/ Dia.-FT	Base Wt or I.D.	ZL	No Wth Prs/Pip
L/Elem	Ch Slope					SF Ave	HF	SE Dpth	Froude N	Norm Dp	"N"	X-Fall	ZR	Type Ch
1671.000	5403.000	7.500	5410.500	1060.85	3.21	.16	5410.66	.00	2.62	44.00	30.000	44.000	.00	0 .0
TRANS STR	.1000							7.50	.21		.045	.00	.00	RECTANG
1690.000	5404.900	2.126	5407.026	1060.85	20.79	6.71	5413.74	.00	3.93	24.00	30.000	24.000	.00	0 .0
TRANS STR	.1001					.0107	.01	2.13	2.51		.013	.00	.00	RECTANG
Outfall to Tijeras														
1691.000	5405.000	5.987	5410.987	1060.85	15.13	3.56	5414.54	.00	5.99	4.93	7.000	.000	.00	2 .0
84.791	.0056					.0062	.53	5.99	.71	7.00	.013	.00	.00	PIPE
1775.791	5405.471	6.367	5411.838	1060.85	14.43	3.23	5415.07	.00	5.99	4.01	7.000	.000	.00	2 .0
5.209	.0056					.0060	.03	6.37	.59	7.00	.013	.00	.00	PIPE
1781.000	5405.500	6.375	5411.875	1060.85	14.42	3.23	5415.10	.00	5.99	3.99	7.000	.000	.00	2 .0
TRANS STR	.0000					.0031	.01	6.38	.59		.013	.00	.00	PIPE
JB Pipe out														
1785.000	5405.500	10.047	5415.547	1060.85	4.40	.30	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
inv .125	3.5000					.0002	.00	10.05	.24	.39	.013	.00	.00	RECTANG
1785.125	5405.938	9.579	5415.517	1060.85	4.61	.33	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.118	3.5000					.0002	.00	9.58	.26	.39	.013	.00	.00	RECTANG
1785.243	5406.350	9.134	5415.484	1060.85	4.84	.36	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.111	3.5000					.0002	.00	9.13	.28	.39	.013	.00	.00	RECTANG
1785.354	5406.739	8.709	5415.447	1060.85	5.08	.40	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.104	3.5000					.0002	.00	8.71	.30	.39	.013	.00	.00	RECTANG

Juan Tabo Hills Estates
Developed 100-YR Flow Rates
Duke City north of Sandia Sunset Ave.

Station / L/Elem	Invert Elev / Ch Slope	Depth (FT) / SF Ave	Water Elev / HF	Q (CFS) / SE Dpth	Vel (FPS) / Froude N	Vel Head / Norm Dp	Energy Grd.El. / "N"	Super Elev / X-Fall	Critical Depth / ZR	Flow Top Width / Type Ch	Height/Dia.-FT / No Wth	Base Wt or I.D. / Prs/Pip	ZL /
1785.458	5407.104	8.303	5415.407	1060.85	5.32	.44	5415.85	.00	3.93	24.00	30.000	24.000	.00
.098	3.5000					.0003	.00	8.30	.33	.39	.013	.00	.00
1785.556	5407.446	7.917	5415.363	1060.85	5.58	.48	5415.85	.00	3.93	24.00	30.000	24.000	.00
.091	3.5000					.0003	.00	7.92	.35	.39	.013	.00	.00
1785.648	5407.766	7.548	5415.314	1060.85	5.86	.53	5415.85	.00	3.93	24.00	30.000	24.000	.00
.085	3.5000					.0004	.00	7.55	.38	.39	.013	.00	.00
1785.733	5408.064	7.197	5415.261	1060.85	6.14	.59	5415.85	.00	3.93	24.00	30.000	24.000	.00
.079	3.5000					.0004	.00	7.20	.40	.39	.013	.00	.00
1785.812	5408.340	6.862	5415.203	1060.85	6.44	.64	5415.85	.00	3.93	24.00	30.000	24.000	.00
.073	3.5000					.0005	.00	6.86	.43	.39	.013	.00	.00
1785.885	5408.595	6.543	5415.138	1060.85	6.76	.71	5415.85	.00	3.93	24.00	30.000	24.000	.00
.067	3.5000					.0005	.00	6.54	.47	.39	.013	.00	.00
1785.951	5408.829	6.238	5415.067	1060.85	7.09	.78	5415.85	.00	3.93	24.00	30.000	24.000	.00
.049	3.5000					.0006	.00	6.24	.50	.39	.013	.00	.00
1786.000	5409.000	6.007	5415.007	1060.85	7.36	.84	5415.85	.00	3.93	24.00	30.000	24.000	.00
.065	-3.3999					.0006	.00	6.01	.53	.00	.013	.00	.00
1786.065	5408.778	6.308	5415.085	1060.85	7.01	.76	5415.85	.00	3.93	24.00	30.000	24.000	.00
.072	-3.3999					.0005	.00	6.31	.49	.00	.013	.00	.00

Juan Tabo Hills Estates
Developed 100-YR Flow Rates
Duke City north of Sandia Sunset Ave.

Station / L/Elem	Invert Elev / Ch Slope	Depth (FT) / SF Ave	Water Elev / HF	Q (CFS) / SE Dpth	Vel (FPS) / Froude N	Vel Head / Norm Dp	Energy Grd.El. / "N"	Super Elev / X-Fall	Critical Depth / ZR	Flow Top Width / Type Ch	Height/Dia.-FT / No	Base Wt or I.D. / Prs/Pip	ZL / Wth
1786.137	5408.533	6.623	5415.156	1060.85	6.67	.69	5415.85	.00	3.93	24.00	30.000	24.000	.00
.078	-3.3999					.0005	.00	6.62	.46	.00	.013	.00	.00
1786.216	5408.267	6.954	5415.221	1060.85	6.36	.63	5415.85	.00	3.93	24.00	30.000	24.000	.00
.085	-3.3999					.0004	.00	6.95	.42	.00	.013	.00	.00
1786.301	5407.977	7.302	5415.279	1060.85	6.05	.57	5415.85	.00	3.93	24.00	30.000	24.000	.00
.092	-3.3999					.0003	.00	7.30	.39	.00	.013	.00	.00
1786.393	5407.665	7.667	5415.332	1060.85	5.77	.52	5415.85	.00	3.93	24.00	30.000	24.000	.00
.099	-3.3999					.0003	.00	7.67	.37	.00	.013	.00	.00
1786.491	5407.330	8.050	5415.380	1060.85	5.49	.47	5415.85	.00	3.93	24.00	30.000	24.000	.00
.105	-3.3999					.0003	.00	8.05	.34	.00	.013	.00	.00
1786.597	5406.971	8.453	5415.424	1060.85	5.23	.42	5415.85	.00	3.93	24.00	30.000	24.000	.00
.113	-3.3999					.0002	.00	8.45	.32	.00	.013	.00	.00
1786.710	5406.587	8.876	5415.463	1060.85	4.98	.39	5415.85	.00	3.93	24.00	30.000	24.000	.00
.120	-3.3999					.0002	.00	8.88	.29	.00	.013	.00	.00
1786.830	5406.180	9.319	5415.499	1060.85	4.74	.35	5415.85	.00	3.93	24.00	30.000	24.000	.00
.127	-3.3999					.0002	.00	9.32	.27	.00	.013	.00	.00
1786.957	5405.746	9.785	5415.531	1060.85	4.52	.32	5415.85	.00	3.93	24.00	30.000	24.000	.00
.043	-3.3999					.0002	.00	9.79	.25	.00	.013	.00	.00

Juan Tabo Hills Estates
Developed 100-YR Flow Rates
Duke City north of Sandia Sunset Ave.

Station / L/Elem	Invert Elev / Ch Slope	Depth (FT)	Water Elev	Q (CFS)	Vel (FPS)	Vel Head / SF Ave	Energy Grd.El. / HF	Super Elev / SE Dpth	Critical Depth / Froude N	Flow Top Width / Norm Dp	Height/ Dia.-FT / "N"	Base Wt or I.D. / X-Fall	ZL / ZR	No Wth Prs/Pip / Type Ch
1787.000	5405.600	9.941	5415.542	1060.85	4.45	.31	5415.85	2.36	3.93	24.00	30.000	24.000	.00	0 .0
JUNCT STR	.0000					.0001	.00	12.30	.25		.013	.00	.00	RECTANG
1793.000	5405.600	10.197	5415.797	980.79	4.01	.25	5416.05	.00	3.73	24.00	30.000	24.000	.00	0 .0
TRANS STR	5.3999							10.20	.22		.013	.00	.00	RECTANG
JB pipe in														
1794.000	5411.000	6.002	5417.002	980.79	25.88	10.40	5427.40	.00	7.23	6.00	7.500	.000	.00	1 .0
245.000	.0163					.0174	4.26	6.00	1.81	6.14	.013	.00	.00	PIPE
2039.000	5415.000	5.896	5420.896	980.79	26.33	10.76	5431.66	.00	7.23	6.15	7.500	.000	.00	1 .0
MH-13														
20.340	.0292					.0174	.35	5.90	1.89	4.84	.013	.00	.00	PIPE
2059.340	5415.593	5.994	5421.587	980.79	25.91	10.42	5432.01	.00	7.23	6.01	7.500	.000	.00	1 .0
48.874	.0292					.0163	.80	5.99	1.82	4.84	.013	.00	.00	PIPE
2108.213	5417.019	6.315	5423.333	980.79	24.70	9.48	5432.81	.00	7.23	5.47	7.500	.000	.00	1 .0
33.897	.0292					.0150	.51	6.32	1.62	4.84	.013	.00	.00	PIPE
2142.111	5418.007	6.697	5424.705	980.79	23.55	8.61	5433.32	.00	7.23	4.64	7.500	.000	.00	1 .0
16.889	.0292					.0144	.24	6.70	1.39	4.84	.013	.00	.00	PIPE
2159.000	5418.500	7.231	5425.731	980.79	22.46	7.83	5433.56	7.50	7.23	2.79	7.500	.000	.00	1 .0
JUNCT STR	.5625							7.50	1.00		.013	.00	.00	PIPE
MH-12														
2167.000	5423.000	1.298	5424.297	17.80	8.25	1.06	5425.35	.00	1.52	1.91	2.000	.000	.00	1 .0
32.065	.0109					.0109	.35	1.30	1.37	1.30	.013	.00	.00	PIPE

Juan Tabo Hills Estates
Developed 100-YR Flow Rates
Duke City north of Sandia Sunset Ave.

Station / L/Elem	Invert Elev / Ch Slope	Depth (FT) / SF Ave	Water Elev / HF	Q (CFS) / SE Dpth	Vel (FPS) / Froude N	Vel Head / Norm Dp	Energy Grd.El. / "N"	Super Elev / X-Fall	Critical Depth / ZR	Flow Top Width / Type Ch	Height/Dia.-FT / No Wth Prs/Pip	Base Wt or I.D. / ZL
2199.065	5423.348	1.298	5424.646	17.80	8.25	1.06	5425.70	.00	1.52	1.91	2.000	.000 .00
69.387	.0109					.0105	.73	1.30	1.37	1.30	.013	.00 .00
2268.452	5424.103	1.330	5425.433	17.80	8.02	1.00	5426.43	.00	1.52	1.89	2.000	.000 .00
25.669	.0109					.0096	.25	1.33	1.30	1.30	.013	.00 .00
2294.121	5424.381	1.388	5425.770	17.80	7.65	.91	5426.68	.00	1.52	1.84	2.000	.000 .00
8.878	.0109					.0085	.08	1.39	1.20	1.30	.013	.00 .00
2302.999	5424.478	1.450	5425.928	17.80	7.29	.83	5426.75	.00	1.52	1.79	2.000	.000 .00
2.001	.0109					.0076	.02	1.45	1.10	1.30	.013	.00 .00
2305.000	5424.500	1.520	5426.020	17.80	6.95	.75	5426.77	.00	1.52	1.71	2.000	.000 .00
JUNCT STR	.1250					.0072	.03	1.52	1.00		.013	.00 .00
Inlet 19												
2309.000	5425.000	2.180	5427.180	8.90	5.04	.39	5427.57	.00	1.15	.00	1.500	.000 .00
21.000	.0095					.0072	.15	2.18	.00	1.08	.013	.00 .00
2330.000	5425.200	2.131	5427.331	8.90	5.04	.39	5427.72	.00	1.15	.00	1.500	.000 .00
Inlet 18												

Program Package Serial Number: 1454

WATER SURFACE PROFILE LISTING Date: 2-24-2017 Time:10:29:33

Juan Tabo Hills Estates
Developed 100-YR Flow Rates
Duke City south of Sandia Sunset Ave.

Station / L/Elem	Invert Elev / Ch Slope	Depth (FT)	Water Elev	Q (CFS)	Vel (FPS)	Vel Head / SF Ave	Energy Grd.El. / HF	Super Elev / SE Dpth	Critical Depth / Froude N	Flow Top Width / Norm Dp	Height/ Dia.-FT / "N"	Base Wt or I.D. / X-Fall	ZL / ZR	No Wth Prs/Pip / Type Ch
1671.000	5403.000	7.500	5410.500	1060.85	3.21	.16	5410.66	.00	2.62	44.00	30.000	44.000	.00	0 .0
TRANS STR	.1000							7.50	.21		.045	.00	.00	RECTANG
1690.000	5404.900	2.126	5407.026	1060.85	20.79	6.71	5413.74	.00	3.93	24.00	30.000	24.000	.00	0 .0
TRANS STR	.1001					.0107	.01	2.13	2.51		.013	.00	.00	RECTANG
Outfall to Tijeras														
1691.000	5405.000	5.987	5410.987	1060.85	15.13	3.56	5414.54	.00	5.99	4.93	7.000	.000	.00	2 .0
84.791	.0056					.0062	.53	5.99	.71	7.00	.013	.00	.00	PIPE
1775.791	5405.471	6.367	5411.838	1060.85	14.43	3.23	5415.07	.00	5.99	4.01	7.000	.000	.00	2 .0
5.209	.0056					.0060	.03	6.37	.59	7.00	.013	.00	.00	PIPE
1781.000	5405.500	6.375	5411.875	1060.85	14.42	3.23	5415.10	.00	5.99	3.99	7.000	.000	.00	2 .0
TRANS STR	.0000					.0031	.01	6.38	.59		.013	.00	.00	PIPE
JB out														
1785.000	5405.500	10.047	5415.547	1060.85	4.40	.30	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
inv														
.125	3.5000					.0002	.00	10.05	.24	.39	.013	.00	.00	RECTANG
1785.125	5405.938	9.579	5415.517	1060.85	4.61	.33	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.118	3.5000					.0002	.00	9.58	.26	.39	.013	.00	.00	RECTANG
1785.243	5406.350	9.134	5415.484	1060.85	4.84	.36	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.111	3.5000					.0002	.00	9.13	.28	.39	.013	.00	.00	RECTANG
1785.354	5406.739	8.709	5415.447	1060.85	5.08	.40	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.104	3.5000					.0002	.00	8.71	.30	.39	.013	.00	.00	RECTANG

Juan Tabo Hills Estates
Developed 100-YR Flow Rates
Duke City south of Sandia Sunset Ave.

Station / L/Elem	Invert Elev / Ch Slope	Depth (FT)	Water Elev	Q (CFS)	Vel (FPS)	Vel Head / SF Ave	Energy Grd.El. / HF	Super Elev / SE Dpth	Critical Depth / Froude N	Flow Top Width / Norm Dp	Height/ Dia.-FT / "N"	Base Wt or I.D. / X-Fall	ZL / ZR	No Wth Prs/Pip / Type Ch
1785.458	5407.104	8.303	5415.407	1060.85	5.32	.44	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.098	3.5000					.0003	.00	8.30	.33	.39	.013	.00	.00	RECTANG
1785.556	5407.446	7.917	5415.363	1060.85	5.58	.48	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.091	3.5000					.0003	.00	7.92	.35	.39	.013	.00	.00	RECTANG
1785.648	5407.766	7.548	5415.314	1060.85	5.86	.53	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.085	3.5000					.0004	.00	7.55	.38	.39	.013	.00	.00	RECTANG
1785.733	5408.064	7.197	5415.261	1060.85	6.14	.59	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.079	3.5000					.0004	.00	7.20	.40	.39	.013	.00	.00	RECTANG
1785.812	5408.340	6.862	5415.203	1060.85	6.44	.64	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.073	3.5000					.0005	.00	6.86	.43	.39	.013	.00	.00	RECTANG
1785.885	5408.595	6.543	5415.138	1060.85	6.76	.71	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.067	3.5000					.0005	.00	6.54	.47	.39	.013	.00	.00	RECTANG
1785.951	5408.829	6.238	5415.067	1060.85	7.09	.78	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.049	3.5000					.0006	.00	6.24	.50	.39	.013	.00	.00	RECTANG
1786.000	5409.000	6.007	5415.007	1060.85	7.36	.84	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
weir														
.065	-3.3999					.0006	.00	6.01	.53	.00	.013	.00	.00	RECTANG
1786.065	5408.778	6.308	5415.085	1060.85	7.01	.76	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.072	-3.3999					.0005	.00	6.31	.49	.00	.013	.00	.00	RECTANG

Program Package Serial Number: 1454

WATER SURFACE PROFILE LISTING Date: 2-24-2017 Time:10:29:33

Juan Tabo Hills Estates
Developed 100-YR Flow Rates
Duke City south of Sandia Sunset Ave.

Station	Invert Elev	Depth (FT)	Water Elev	Q (CFS)	Vel (FPS)	Vel Head	Energy Grd.El.	Super Elev	Critical Depth	Flow Top Width	Height/ Dia.-FT	Base Wt or I.D.	ZL	No Wth Prs/Pip
L/Elem	Ch Slope					SF Ave	HF	SE Dpth	Froude N	Norm Dp	"N"	X-Fall	ZR	Type Ch
1786.137	5408.533	6.623	5415.156	1060.85	6.67	.69	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.078	-3.3999					.0005	.00	6.62	.46	.00	.013	.00	.00	RECTANG
1786.216	5408.267	6.954	5415.221	1060.85	6.36	.63	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.085	-3.3999					.0004	.00	6.95	.42	.00	.013	.00	.00	RECTANG
1786.301	5407.977	7.302	5415.279	1060.85	6.05	.57	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.092	-3.3999					.0003	.00	7.30	.39	.00	.013	.00	.00	RECTANG
1786.393	5407.665	7.667	5415.332	1060.85	5.77	.52	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.099	-3.3999					.0003	.00	7.67	.37	.00	.013	.00	.00	RECTANG
1786.491	5407.330	8.050	5415.380	1060.85	5.49	.47	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.105	-3.3999					.0003	.00	8.05	.34	.00	.013	.00	.00	RECTANG
1786.597	5406.971	8.453	5415.424	1060.85	5.23	.42	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.113	-3.3999					.0002	.00	8.45	.32	.00	.013	.00	.00	RECTANG
1786.710	5406.587	8.876	5415.463	1060.85	4.98	.39	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.120	-3.3999					.0002	.00	8.88	.29	.00	.013	.00	.00	RECTANG
1786.830	5406.180	9.319	5415.499	1060.85	4.74	.35	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.127	-3.3999					.0002	.00	9.32	.27	.00	.013	.00	.00	RECTANG
1786.957	5405.746	9.785	5415.531	1060.85	4.52	.32	5415.85	.00	3.93	24.00	30.000	24.000	.00	0 .0
.043	-3.3999					.0002	.00	9.79	.25	.00	.013	.00	.00	RECTANG

Juan Tabo Hills Estates
Developed 100-YR Flow Rates
Duke City south of Sandia Sunset Ave.

Station / L/Elem	Invert Elev / Ch Slope	Depth (FT)	Water Elev	Q (CFS)	Vel (FPS)	Vel Head / SF Ave	Energy Grd.El. / HF	Super Elev / SE Dpth	Critical Depth / Froude N	Flow Top Width / Norm Dp	Height/ Dia.-FT / "N"	Base Wt or I.D. / X-Fall	ZL / ZR	No Wth Prs/Pip / Type Ch
1787.000	5405.600	9.941	5415.542	1060.85	4.45	.31	5415.85	2.36	3.93	24.00	30.000	24.000	.00	0 .0
JUNCT STR	.0000					.0001	.00	12.30	.25		.013	.00	.00	RECTANG
1793.000	5405.600	10.197	5415.797	980.79	4.01	.25	5416.05	.00	3.73	24.00	30.000	24.000	.00	0 .0
TRANS STR	5.3999							10.20	.22		.013	.00	.00	RECTANG
JB Pipe in														
1794.000	5411.000	6.002	5417.002	980.79	25.88	10.40	5427.40	.00	7.23	6.00	7.500	.000	.00	1 .0
245.000	.0163					.0174	4.26	6.00	1.81	6.14	.013	.00	.00	PIPE
2039.000	5415.000	5.896	5420.896	980.79	26.33	10.76	5431.66	.00	7.23	6.15	7.500	.000	.00	1 .0
20.340	.0292					.0174	.35	5.90	1.89	4.84	.013	.00	.00	PIPE
2059.340	5415.593	5.994	5421.587	980.79	25.91	10.42	5432.01	.00	7.23	6.01	7.500	.000	.00	1 .0
MH-13														
48.874	.0292					.0163	.80	5.99	1.82	4.84	.013	.00	.00	PIPE
2108.213	5417.019	6.315	5423.333	980.79	24.70	9.48	5432.81	.00	7.23	5.47	7.500	.000	.00	1 .0
33.897	.0292					.0150	.51	6.32	1.62	4.84	.013	.00	.00	PIPE
2142.111	5418.007	6.697	5424.705	980.79	23.55	8.61	5433.32	.00	7.23	4.64	7.500	.000	.00	1 .0
16.889	.0292					.0144	.24	6.70	1.39	4.84	.013	.00	.00	PIPE
2159.000	5418.500	7.231	5425.731	980.79	22.46	7.83	5433.56	7.50	7.23	2.79	7.500	.000	.00	1 .0
JUNCT STR	.8750							7.50	1.00		.013	.00	.00	PIPE
MH-12														
2167.000	5425.500	1.713	5427.213	24.44	8.53	1.13	5428.34	.00	1.75	1.40	2.000	.000	.00	1 .0
124.700	.0109					.0109	1.36	1.71	1.05	1.71	.013	.00	.00	PIPE

Program Package Serial Number: 1454

WATER SURFACE PROFILE LISTING

Date: 2-24-2017 Time:10:29:33

Juan Tabo Hills Estates
Developed 100-YR Flow Rates
Duke City south of Sandia Sunset Ave.

Station / L/Elem	Invert Elev / Ch Slope	Depth (FT)	Water Elev	Q (CFS)	Vel (FPS)	Vel Head / SF Ave	Energy Grd.El. / HF	Super Elev / SE Dpth	Critical Depth / Froude N	Flow Top Width / Norm Dp	Height/ Dia.-FT / "N"	Base Wt or I.D. / X-Fall	ZL / ZR	No Wth Prs/Pip / Type Ch
2291.700	5426.855	1.713	5428.568	24.44	8.53	1.13	5429.70	.00	1.75	1.40	2.000	.000	.00	1 .0
13.300	.0109					.0107	.14	1.71	1.05	1.71	.013	.00	.00	PIPE
2305.000	5427.000	1.747	5428.747	24.44	8.40	1.09	5429.84	2.00	1.75	1.33	2.000	.000	.00	1 .0
JUNCT STR	.1250					.0121	.05	2.00	1.00		.013	.00	.00	PIPE
MH-91														
2309.000	5427.500	2.898	5430.398	12.22	6.92	.74	5431.14	.00	1.32	.00	1.500	.000	.00	1 .0
21.000	.0095					.0135	.28	2.90	.00	1.50	.013	.00	.00	PIPE
2330.000	5427.700	2.982	5430.682	12.22	6.92	.74	5431.42	.00	1.32	.00	1.500	.000	.00	1 .0
Inlet 17														

Program Package Serial Number: 1454

WATER SURFACE PROFILE LISTING

Date: 6-10-2016 Time:12:32:19

Juan Tabo Hills Estates

Developed 100-YR Flow Rates

SWQ MH thru Tract K to SWQ Pond

Station	Invert Elev	Depth (FT)	Water Elev	Q (CFS)	Vel (FPS)	Vel Head	Energy Grd.El.	Super Elev	Critical Depth	Flow Top Width	Height/ Dia.-FT	Base Wt or I.D.	ZL	No Wth Prs/Pip
L/Elem	Ch Slope					SF Ave	HF	SE Dpth	Froude N	Norm Dp	"N"	X-Fall	ZR	Type Ch
150.000	5383.000	9.800	5392.800	198.04	.81	.01	5392.81	.00	1.25	25.00	30.000	25.000	.00	0 .0
TRANS STR	.2222					.0053	.05	9.80	.05		.045	.00	.00	RECTANG
159.000	5385.000	7.645	5392.645	198.04	5.18	.42	5393.06	.00	3.65	5.00	30.000	5.000	.00	0 .0
TRANS STR	.0000					.0055	.01	7.65	.33		.013	.00	.00	RECTANG
Pipe into SWQ Pond														
160.000	5385.000	6.655	5391.655	198.04	12.45	2.41	5394.06	.00	4.02	.00	4.500	.000	.00	1 .0
52.000	.0096					.0101	.53	6.66	.00	3.81	.013	.00	.00	PIPE
212.000	5385.500	6.857	5392.357	198.04	12.45	2.41	5394.77	.00	4.02	.00	4.500	.000	.00	1 .0
MH-31														
102.000	.0108					.0101	1.03	6.86	.00	3.57	.013	.00	.00	PIPE
314.000	5386.600	6.792	5393.392	198.04	12.45	2.41	5395.80	.00	4.02	.00	4.500	.000	.00	1 .0
JUNCT STR	.0833					.0076	.05	6.79	.00		.013	.00	.00	PIPE
MH-30														
320.000	5387.100	8.773	5395.873	139.21	8.75	1.19	5397.06	.00	3.47	.00	4.500	.000	.00	1 .0
33.000	.0091					.0050	.17	8.77	.00	2.89	.013	.00	.00	PIPE
353.000	5387.400	9.051	5396.451	139.21	8.75	1.19	5397.64	.00	3.47	.00	4.500	.000	.00	1 .0
MH-29														
399.000	.0090					.0050	2.00	9.05	.00	2.89	.013	.00	.00	PIPE
752.000	5391.000	7.451	5398.451	139.21	8.75	1.19	5399.64	.00	3.47	.00	4.500	.000	.00	1 .0
JUNCT STR	.0125					.0046	.04	7.45	.00		.013	.00	.00	PIPE
MH-28														
760.000	5391.100	7.816	5398.916	126.05	7.93	.98	5399.89	.00	3.30	.00	4.500	.000	.00	1 .0
20.000	.0100					.0041	.08	7.82	.00	2.62	.013	.00	.00	PIPE

Program Package Serial Number: 1454

WATER SURFACE PROFILE LISTING Date: 6-10-2016 Time:12:32:19

Juan Tabo Hills Estates
Developed 100-YR Flow Rates
SWQ MH thru Tract K to SWQ Pond

Station	Invert Elev	Depth (FT)	Water Elev	Q (CFS)	Vel (FPS)	Vel Head	Energy Grd.El.	Super Elev	Critical Depth	Flow Top Width	Height/ Dia.-FT	Base Wt or I.D.	ZL	No Wth Prs/Pip
L/Elem	Ch Slope					SF Ave	HF	SE Dpth	Froude N	Norm Dp	"N"	X-Fall	ZR	Type Ch
780.000	5391.300	7.795	5399.095	126.05	7.93	.98	5400.07	.00	3.30	.00	4.500	.000	.00	1 .0
MH-27														
97.000	.0113					.0041	.40	7.80	.00	2.52	.013	.00	.00	PIPE
877.000	5392.400	7.191	5399.591	126.05	7.93	.98	5400.57	.00	3.30	.00	4.500	.000	.00	1 .0
MH-26														
92.000	.0109					.0041	.38	7.19	.00	2.55	.013	.00	.00	PIPE
969.000	5393.400	6.666	5400.066	126.05	7.93	.98	5401.04	.00	3.30	.00	4.500	.000	.00	1 .0
MH 25														
128.000	.0047					.0041	.53	6.67	.00	3.45	.013	.00	.00	PIPE
1097.000	5394.000	6.592	5400.592	126.05	7.93	.98	5401.57	.00	3.30	.00	4.500	.000	.00	1 .0
JUNCT STR	.0833					.0045	.03	.00	.00		.013	.00	.00	PIPE
MH 24														
1103.000	5394.500	6.228	5400.729	100.05	7.96	.98	5401.71	.00	3.03	.00	4.000	.000	.00	1 .0
189.000	.0101					.0049	.92	6.23	.00	2.45	.013	.00	.00	PIPE
1292.000	5396.400	5.392	5401.792	100.05	7.96	.98	5402.78	.00	3.03	.00	4.000	.000	.00	1 .0
MH-23														
134.000	.0119					.0049	.65	5.39	.00	2.32	.013	.00	.00	PIPE
1426.000	5398.000	4.442	5402.442	100.05	7.96	.98	5403.43	.00	3.03	.00	4.000	.000	.00	1 .0
JUNCT STR	.1250					.0043	.02	4.44	.00		.013	.00	.00	PIPE
Inlet S6														
1430.000	5398.500	4.781	5403.281	62.35	6.48	.65	5403.93	.00	2.47	.00	3.500	.000	.00	1 .0
149.000	.0093					.0038	.57	4.78	.00	2.04	.013	.00	.00	PIPE
1579.000	5399.880	3.974	5403.854	62.35	6.48	.65	5404.51	.00	2.47	.00	3.500	.000	.00	1 .0
JUNCT STR	.0833					.0056	.03	3.97	.00		.013	.00	.00	PIPE
MH 22														

Program Package Serial Number: 1454

WATER SURFACE PROFILE LISTING Date: 6-10-2016 Time:12:32:19

Juan Tabo Hills Estates
Developed 100-YR Flow Rates
SWQ MH thru Tract K to SWQ Pond

Station / L/Elem	Invert Elev / Ch Slope	Depth (FT)	Water Elev	Q (CFS)	Vel (FPS)	Vel Head / SF Ave	Energy Grd.El. / HF	Super Elev / SE Dpth	Critical Depth / Froude N	Flow Top Width / Norm Dp	Height/Dia.-FT / "N"	Base Wt or I.D. / X-Fall	ZL / ZR	No Wth Prs/Pip / Type Ch
1585.000	5400.380	3.509	5403.889	35.37	7.21	.81	5404.69	.00	2.02	.00	2.500	.000	.00	1 .0
240.000	.0076					.0074	1.78	3.51	.00	2.03	.013	.00	.00	PIPE
1825.000	5402.200	3.673	5405.873	35.37	7.21	.81	5406.68	.00	2.02	.00	2.500	.000	.00	1 .0
307.000	.0078					.0074	2.28	3.67	.00	1.99	.013	.00	.00	PIPE
2132.000	5404.610	3.719	5408.329	35.37	7.21	.81	5409.14	.00	2.02	.00	2.500	.000	.00	1 .0
78.000	.0114					.0074	.58	3.72	.00	1.70	.013	.00	.00	PIPE
2210.000	5405.500	3.409	5408.909	35.37	7.21	.81	5409.72	.00	2.02	.00	2.500	.000	.00	1 .0

MH-21

MH 20

Junction Box

W S P G W - CIVILDESIGN Version 14.05

Program Package Serial Number: 1454

WATER SURFACE PROFILE LISTING

Date: 7-15-2016 Time: 2: 1:43

Juan Tabo Hills Estates
Developed 100-YR Flow Rates
Running Bear Ave to SWQ Pond

Station / L/Elem	Invert Elev / Ch Slope	Depth (FT)	Water Elev	Q (CFS)	Vel (FPS)	Vel Head / SF Ave	Energy Grd.El. / HF	Super Elev / SE Dpth	Critical Depth / Froude N	Flow Top Width / Norm Dp	Height/Dia.-FT / "N"	Base Wt or I.D. / X-Fall	ZL / ZR	No Wth Prs/Pip / Type Ch
150.000	5383.000	9.800	5392.800	198.04	.81	.01	5392.81	.00	1.25	25.00	30.000	25.000	.00	0 .0
TRANS STR	.2222					.0053	.05	9.80	.05		.045	.00	.00	RECTANG
159.000	5385.000	7.645	5392.645	198.04	5.18	.42	5393.06	.00	3.65	5.00	30.000	5.000	.00	0 .0
TRANS STR	.0000					.0055	.01	7.65	.33		.013	.00	.00	RECTANG
Pipe into SWQ Pond														
160.000	5385.000	6.655	5391.655	198.04	12.45	2.41	5394.06	.00	4.02	.00	4.500	.000	.00	1 .0
52.000	.0096					.0101	.53	6.66	.00	3.81	.013	.00	.00	PIPE
212.000	5385.500	6.857	5392.357	198.04	12.45	2.41	5394.77	.00	4.02	.00	4.500	.000	.00	1 .0
MH-31														
102.000	.0108					.0101	1.03	6.86	.00	3.57	.013	.00	.00	PIPE
314.000	5386.600	6.792	5393.392	198.04	12.45	2.41	5395.80	.00	4.02	.00	4.500	.000	.00	1 .0
JUNCT STR	.0833					.0076	.05	6.79	.00		.013	.00	.00	PIPE
MH-30														
320.000	5387.100	8.773	5395.873	139.21	8.75	1.19	5397.06	.00	3.47	.00	4.500	.000	.00	1 .0
33.000	.0091					.0050	.17	8.77	.00	2.89	.013	.00	.00	PIPE
353.000	5387.400	9.051	5396.451	139.21	8.75	1.19	5397.64	.00	3.47	.00	4.500	.000	.00	1 .0
MH-29														
399.000	.0090					.0050	2.00	9.05	.00	2.89	.013	.00	.00	PIPE
752.000	5391.000	7.451	5398.451	139.21	8.75	1.19	5399.64	.00	3.47	.00	4.500	.000	.00	1 .0
JUNCT STR	.0625					.0042	.03	.00	.00		.013	.00	.00	PIPE
MH-28														
760.000	5391.500	7.901	5399.401	13.16	4.19	.27	5399.67	.00	1.31	.00	2.000	.000	.00	1 .0
149.167	.0422					.0034	.50	7.90	.00	.73	.013	.00	.00	PIPE

Running Bear Ave to SWQ Pond

W S P G W - CIVILDESIGN Version 14.05

Program Package Serial Number: 1454

WATER SURFACE PROFILE LISTING

Date: 7-15-2016 Time: 2: 1:43

Juan Tabo Hills Estates
Developed 100-YR Flow Rates
Running Bear Ave to SWQ Pond

Station	Invert Elev	Depth (FT)	Water Elev	Q (CFS)	Vel (FPS)	Vel Head	Energy Grd.El.	Super Elev	Critical Depth	Flow Top Width	Height/ Dia.-FT	Base Wt or I.D.	ZL	No Wth Prs/Pip
L/Elem	Ch Slope					SF Ave	HF	SE Dpth	Froude N	Norm Dp	"N"	X-Fall	ZR	Type Ch
909.167	5397.801	2.189	5399.990	13.16	4.19	.27	5400.26	.00	1.31	.00	2.000	.000	.00	1 .0
HYDRAULIC JUMP														
909.167	5397.801	.734	5398.535	13.16	12.59	2.46	5401.00	.00	1.31	1.93	2.000	.000	.00	1 .0
39.625	.0422					.0400	1.59	.73	3.01	.73	.013	.00	.00	PIPE
948.792	5399.475	.743	5400.218	13.16	12.39	2.38	5402.60	.00	1.31	1.93	2.000	.000	.00	1 .0
34.607	.0422					.0367	1.27	.74	2.94	.73	.013	.00	.00	PIPE
983.399	5400.937	.769	5401.706	13.16	11.81	2.17	5403.87	.00	1.31	1.95	2.000	.000	.00	1 .0
16.845	.0422					.0322	.54	.77	2.75	.73	.013	.00	.00	PIPE
1000.245	5401.648	.797	5402.445	13.16	11.26	1.97	5404.41	.00	1.31	1.96	2.000	.000	.00	1 .0
10.739	.0422					.0283	.30	.80	2.57	.73	.013	.00	.00	PIPE
1010.984	5402.102	.826	5402.928	13.16	10.74	1.79	5404.72	.00	1.31	1.97	2.000	.000	.00	1 .0
7.619	.0422					.0248	.19	.83	2.40	.73	.013	.00	.00	PIPE
1018.602	5402.423	.856	5403.279	13.16	10.24	1.63	5404.91	.00	1.31	1.98	2.000	.000	.00	1 .0
5.672	.0422					.0218	.12	.86	2.24	.73	.013	.00	.00	PIPE
1024.274	5402.663	.888	5403.551	13.16	9.76	1.48	5405.03	.00	1.31	1.99	2.000	.000	.00	1 .0
4.397	.0422					.0192	.08	.89	2.09	.73	.013	.00	.00	PIPE
1028.672	5402.849	.921	5403.770	13.16	9.31	1.34	5405.11	.00	1.31	1.99	2.000	.000	.00	1 .0
3.437	.0422					.0169	.06	.92	1.95	.73	.013	.00	.00	PIPE

Program Package Serial Number: 1454

WATER SURFACE PROFILE LISTING Date: 7-15-2016 Time: 2: 1:43

Juan Tabo Hills Estates
Developed 100-YR Flow Rates
Running Bear Ave to SWQ Pond

Station	Invert Elev	Depth (FT)	Water Elev	Q (CFS)	Vel (FPS)	Vel Head	Energy Grd.El.	Super Elev	Critical Depth	Flow Top Width	Height/ Dia.-FT	Base Wt or I.D.	ZL	No Wth Prs/Pip
L/Elem	Ch Slope					SF Ave	HF	SE Dpth	Froude N	Norm Dp	"N"	X-Fall	ZR	Type Ch
1032.109	5402.994	.956	5403.950	13.16	8.87	1.22	5405.17	.00	1.31	2.00	2.000	.000	.00	1 .0
2.741	.0422					.0148	.04	.96	1.81	.73	.013	.00	.00	PIPE
1034.850	5403.109	.992	5404.102	13.16	8.46	1.11	5405.21	.00	1.31	2.00	2.000	.000	.00	1 .0
2.150	.0422					.0131	.03	.99	1.69	.73	.013	.00	.00	PIPE
1037.000	5403.201	1.030	5404.231	13.16	8.07	1.01	5405.24	.00	1.31	2.00	2.000	.000	.00	1 .0
MH-35 38.785	.0129					.0115	.45	1.03	1.57	1.02	.013	.00	.00	PIPE
1075.785	5403.700	1.069	5404.769	13.16	7.70	.92	5405.69	.00	1.31	2.00	2.000	.000	.00	1 .0
15.501	.0129					.0102	.16	1.07	1.47	1.02	.013	.00	.00	PIPE
1091.286	5403.899	1.111	5405.010	13.16	7.34	.84	5405.85	.00	1.31	1.99	2.000	.000	.00	1 .0
8.260	.0129					.0090	.07	1.11	1.36	1.02	.013	.00	.00	PIPE
1099.546	5404.005	1.155	5405.160	13.16	7.00	.76	5405.92	.00	1.31	1.98	2.000	.000	.00	1 .0
4.495	.0129					.0079	.04	1.16	1.26	1.02	.013	.00	.00	PIPE
1104.041	5404.063	1.202	5405.265	13.16	6.67	.69	5405.96	.00	1.31	1.96	2.000	.000	.00	1 .0
2.371	.0129					.0070	.02	1.20	1.17	1.02	.013	.00	.00	PIPE
1106.412	5404.093	1.251	5405.344	13.16	6.36	.63	5405.97	.00	1.31	1.94	2.000	.000	.00	1 .0
.588	.0129					.0062	.00	1.25	1.08	1.02	.013	.00	.00	PIPE
1107.000	5404.100	1.305	5405.405	13.16	6.06	.57	5405.98	2.00	1.31	1.90	2.000	.000	.00	1 .0
JUNCT STR	.1250					.0049	.02	2.00	1.00		.013	.00	.00	PIPE

Inlet 8

Program Package Serial Number: 1454

WATER SURFACE PROFILE LISTING Date: 7-15-2016 Time: 2: 1:43

Juan Tabo Hills Estates
Developed 100-YR Flow Rates
Running Bear Ave to SWQ Pond

Station	Invert Elev	Depth (FT)	Water Elev	Q (CFS)	Vel (FPS)	Vel Head	Energy Grd.El.	Super Elev	Critical Depth	Flow Top Width	Height/ Dia.-FT	Base Wt or I.D.	ZL	No Wth Prs/Pip
L/Elem	Ch Slope					SF Ave	HF	SE Dpth	Froude N	Norm Dp	"N"	X-Fall	ZR	Type Ch
1111.000	5404.600	1.696	5406.296	6.58	3.72	.22	5406.51	.00	.99	.00	1.500	.000	.00	1 .0
21.000	.0095					.0039	.08	1.70	.00	.87	.013	.00	.00	PIPE
1132.000	5404.800	1.603	5406.403	6.58	3.72	.22	5406.62	.00	.99	.00	1.500	.000	.00	1 .0

Inlet #7

Juan Tabo Hills Estates
Developed 100-YR Flow Rates
Manzano Vista K to SWQ Pond

Station / L/Elem	Invert Elev / Ch Slope	Depth (FT)	Water Elev	Q (CFS)	Vel (FPS) / SF Ave	Vel Head / HF	Energy Grd.El. / SE Dpth	Super Elev / Froude N	Critical Depth / Norm Dp	Flow Top Width	Height/ Dia.-FT / "N"	Base Wt or I.D. / X-Fall	ZL / ZR	No Wth Prs/Pip / Type Ch
150.000	5383.000	9.800	5392.800	198.04	.81	.01	5392.81	.00	1.25	25.00	30.000	25.000	.00	0 .0
TRANS STR	.2222					.0053	.05	9.80	.05		.045	.00	.00	RECTANG
159.000	5385.000	7.645	5392.645	198.04	5.18	.42	5393.06	.00	3.65	5.00	30.000	5.000	.00	0 .0
TRANS STR	.0000					.0055	.01	7.65	.33		.013	.00	.00	RECTANG
Pipe into SWQ Pond														
160.000	5385.000	6.655	5391.655	198.04	12.45	2.41	5394.06	.00	4.02	.00	4.500	.000	.00	1 .0
52.000	.0096					.0101	.53	6.66	.00	3.81	.013	.00	.00	PIPE
212.000	5385.500	6.857	5392.357	198.04	12.45	2.41	5394.77	.00	4.02	.00	4.500	.000	.00	1 .0
MH-31														
102.000	.0108					.0101	1.03	6.86	.00	3.57	.013	.00	.00	PIPE
314.000	5386.600	6.792	5393.392	198.04	12.45	2.41	5395.80	.00	4.02	.00	4.500	.000	.00	1 .0
JUNCT STR	.0833					.0076	.05	6.79	.00		.013	.00	.00	PIPE
MH-30														
320.000	5387.100	8.773	5395.873	139.21	8.75	1.19	5397.06	.00	3.47	.00	4.500	.000	.00	1 .0
33.000	.0091					.0050	.17	8.77	.00	2.89	.013	.00	.00	PIPE
353.000	5387.400	9.051	5396.451	139.21	8.75	1.19	5397.64	.00	3.47	.00	4.500	.000	.00	1 .0
MH-29														
399.000	.0090					.0050	2.00	9.05	.00	2.89	.013	.00	.00	PIPE
752.000	5391.000	7.451	5398.451	139.21	8.75	1.19	5399.64	.00	3.47	.00	4.500	.000	.00	1 .0
JUNCT STR	.0125					.0046	.04	7.45	.00		.013	.00	.00	PIPE
MH-28														
760.000	5391.100	7.816	5398.916	126.05	7.93	.98	5399.89	.00	3.30	.00	4.500	.000	.00	1 .0
20.000	.0100					.0041	.08	7.82	.00	2.62	.013	.00	.00	PIPE

Manzano Vista to SWQ Pond

Program Package Serial Number: 1454

WATER SURFACE PROFILE LISTING Date: 7-15-2016 Time: 9:39:56

Juan Tabo Hills Estates
Developed 100-YR Flow Rates
Manzano Vista K to SWQ Pond

Station	Invert Elev	Depth (FT)	Water Elev	Q (CFS)	Vel (FPS)	Vel Head	Energy Grd.El.	Super Elev	Critical Depth	Flow Top Width	Height/ Dia.-FT	Base Wt or I.D.	ZL	No Wth Prs/Pip
L/Elem	Ch Slope					SF Ave	HF	SE Dpth	Froude N	Norm Dp	"N"	X-Fall	ZR	Type Ch
780.000	5391.300	7.795	5399.095	126.05	7.93	.98	5400.07	.00	3.30	.00	4.500	.000	.00	1 .0
MH 27														
97.000	.0113					.0041	.40	7.80	.00	2.52	.013	.00	.00	PIPE
877.000	5392.400	7.191	5399.591	126.05	7.93	.98	5400.57	.00	3.30	.00	4.500	.000	.00	1 .0
MH 26														
92.000	.0109					.0041	.38	7.19	.00	2.55	.013	.00	.00	PIPE
969.000	5393.400	6.666	5400.066	126.05	7.93	.98	5401.04	.00	3.30	.00	4.500	.000	.00	1 .0
MH 25														
128.000	.0047					.0041	.53	6.67	.00	3.45	.013	.00	.00	PIPE
1097.000	5394.000	6.592	5400.592	126.05	7.93	.98	5401.57	.00	3.30	.00	4.500	.000	.00	1 .0
JUNCT STR	.3333					.0087	.05	.00	.00		.013	.00	.00	PIPE
MH 24														
1103.000	5396.000	4.691	5400.691	26.00	8.28	1.06	5401.75	.00	1.79	.00	2.000	.000	.00	1 .0
90.772	.0351					.0132	1.20	4.69	.00	1.13	.013	.00	.00	PIPE
1193.772	5399.187	2.773	5401.959	26.00	8.28	1.06	5403.02	.00	1.79	.00	2.000	.000	.00	1 .0
HYDRAULIC JUMP														
1193.772	5399.187	1.142	5400.329	26.00	14.02	3.05	5403.38	.00	1.79	1.98	2.000	.000	.00	1 .0
25.739	.0351					.0341	.88	1.14	2.55	1.13	.013	.00	.00	PIPE
1219.511	5400.091	1.142	5401.233	26.00	14.02	3.05	5404.29	.00	1.79	1.98	2.000	.000	.00	1 .0
77.969	.0351					.0321	2.51	1.14	2.55	1.13	.013	.00	.00	PIPE
1297.480	5402.828	1.188	5404.016	26.00	13.37	2.77	5406.79	.00	1.79	1.96	2.000	.000	.00	1 .0
30.520	.0351					.0284	.87	1.19	2.37	1.13	.013	.00	.00	PIPE

Program Package Serial Number: 1454

WATER SURFACE PROFILE LISTING Date: 7-15-2016 Time: 9:39:56

Juan Tabo Hills Estates
Developed 100-YR Flow Rates
Manzano Vista K to SWQ Pond

Station	Invert Elev	Depth (FT)	Water Elev	Q (CFS)	Vel (FPS)	Vel Head	Energy Grd.El.	Super Elev	Critical Depth	Flow Top Width	Height/ Dia.-FT	Base Wt or I.D.	ZL	No Wth Prs/Pip
L/Elem	Ch Slope					SF Ave	HF	SE Dpth	Froude N	Norm Dp	"N"	X-Fall	ZR	Type Ch
1328.000	5403.900	1.237	5405.137	26.00	12.75	2.52	5407.66	.00	1.79	1.94	2.000	.000	.00	1 .0
MH 44														
69.000	.0261					.0276	1.91	1.24	2.19	1.25	.013	.00	.00	PIPE
1397.000	5405.700	1.210	5406.911	26.00	13.08	2.66	5409.57	.00	1.79	1.96	2.000	.000	.00	1 .0
MH 43														
41.350	.0296					.0279	1.15	1.21	2.29	1.20	.013	.00	.00	PIPE
1438.350	5406.924	1.227	5408.151	26.00	12.86	2.57	5410.72	.00	1.79	1.95	2.000	.000	.00	1 .0
47.572	.0296					.0258	1.23	1.23	2.22	1.20	.013	.00	.00	PIPE
1485.922	5408.333	1.278	5409.611	26.00	12.26	2.33	5411.95	.00	1.79	1.92	2.000	.000	.00	1 .0
23.481	.0296					.0229	.54	1.28	2.06	1.20	.013	.00	.00	PIPE
1509.403	5409.028	1.332	5410.360	26.00	11.69	2.12	5412.48	.00	1.79	1.89	2.000	.000	.00	1 .0
14.456	.0296					.0203	.29	1.33	1.90	1.20	.013	.00	.00	PIPE
1523.859	5409.456	1.391	5410.847	26.00	11.15	1.93	5412.78	.00	1.79	1.84	2.000	.000	.00	1 .0
9.892	.0296					.0181	.18	1.39	1.75	1.20	.013	.00	.00	PIPE
1533.751	5409.749	1.453	5411.202	26.00	10.63	1.75	5412.96	.00	1.79	1.78	2.000	.000	.00	1 .0
6.766	.0296					.0162	.11	1.45	1.60	1.20	.013	.00	.00	PIPE
1540.517	5409.949	1.522	5411.471	26.00	10.13	1.59	5413.07	.00	1.79	1.71	2.000	.000	.00	1 .0
4.665	.0296					.0146	.07	1.52	1.46	1.20	.013	.00	.00	PIPE
1545.182	5410.087	1.597	5411.684	26.00	9.66	1.45	5413.13	.00	1.79	1.60	2.000	.000	.00	1 .0
2.798	.0296					.0132	.04	1.60	1.31	1.20	.013	.00	.00	PIPE

Juan Tabo Hills Estates
Developed 100-YR Flow Rates
Manzano Vista K to SWQ Pond

Station	Invert Elev	Depth (FT)	Water Elev	Q (CFS)	Vel (FPS)	Vel Head	Energy Grd.El.	Super Elev	Critical Depth	Flow Top Width	Height/ Dia.-FT or I.D.	Base Wt ZL	No Wth Prs/Pip
L/Elem	Ch Slope					SF Ave	HF	SE Dpth	Froude N	Norm Dp	"N"	X-Fall ZR	Type Ch
1547.980	5410.170	1.683	5411.853	26.00	9.21	1.32	5413.17	.00	1.79	1.46	2.000	.000 .00	1 .0
1.020	.0296					.0122	.01	1.68	1.17	1.20	.013	.00 .00	PIPE
1549.000	5410.200	1.786	5411.986	26.00	8.78	1.20	5413.18	.00	1.79	1.24	2.000	.000 .00	1 .0
JUNCT STR	.0249					.0072	.03	1.79	1.00		.013	.00 .00	PIPE
MH 42													
1553.000	5410.300	3.588	5413.888	11.80	3.76	.22	5414.11	.00	1.23	.00	2.000	.000 .00	1 .0
51.017	.0338					.0027	.14	3.59	.00	.73	.013	.00 .00	PIPE
1604.017	5412.026	2.000	5414.026	11.80	3.76	.22	5414.25	.00	1.23	.00	2.000	.000 .00	1 .0
.264	.0338					.0027	.00	2.00	.00	.73	.013	.00 .00	PIPE
1604.281	5412.035	2.000	5414.035	11.80	3.76	.22	5414.25	.00	1.23	.00	2.000	.000 .00	1 .0
HYDRAULIC JUMP													
1604.281	5412.035	.729	5412.764	11.80	11.40	2.02	5414.78	.00	1.23	1.92	2.000	.000 .00	1 .0
14.075	.0338					.0339	.48	.73	2.74	.73	.013	.00 .00	PIPE
1618.356	5412.511	.729	5413.240	11.80	11.40	2.02	5415.26	.00	1.23	1.92	2.000	.000 .00	1 .0
77.119	.0338					.0335	2.58	.73	2.74	.73	.013	.00 .00	PIPE
1695.475	5415.121	.732	5415.853	11.80	11.32	1.99	5417.84	.00	1.23	1.93	2.000	.000 .00	1 .0
56.436	.0338					.0311	1.76	.73	2.71	.73	.013	.00 .00	PIPE
1751.911	5417.031	.758	5417.789	11.80	10.79	1.81	5419.60	.00	1.23	1.94	2.000	.000 .00	1 .0
20.791	.0338					.0273	.57	.76	2.53	.73	.013	.00 .00	PIPE

Program Package Serial Number: 1454

WATER SURFACE PROFILE LISTING Date: 7-15-2016 Time: 9:39:56

Juan Tabo Hills Estates
Developed 100-YR Flow Rates
Manzano Vista K to SWQ Pond

Station	Invert Elev	Depth (FT)	Water Elev	Q (CFS)	Vel (FPS)	Vel Head	Energy Grd.El.	Super Elev	Critical Depth	Flow Top Width	Height/ Dia.-FT or I.D.	Base Wt | X-Fall	ZL	No Wth Prs/Pip
L/Elem	Ch Slope					SF Ave	HF	SE Dpth	Froude N	Norm Dp	"N"	ZR		Type Ch
1772.702	5417.734	.786	5418.521	11.80	10.29	1.64	5420.16	.00	1.23	1.95	2.000	.000	.00	1 .0
12.266	.0338					.0239	.29	.79	2.37	.73	.013	.00	.00	PIPE
1784.969	5418.149	.814	5418.963	11.80	9.81	1.49	5420.46	.00	1.23	1.97	2.000	.000	.00	1 .0
8.252	.0338					.0210	.17	.81	2.21	.73	.013	.00	.00	PIPE
1793.220	5418.429	.844	5419.273	11.80	9.35	1.36	5420.63	.00	1.23	1.98	2.000	.000	.00	1 .0
6.013	.0338					.0185	.11	.84	2.06	.73	.013	.00	.00	PIPE
1799.233	5418.632	.875	5419.507	11.80	8.92	1.24	5420.74	.00	1.23	1.98	2.000	.000	.00	1 .0
4.499	.0338					.0162	.07	.88	1.92	.73	.013	.00	.00	PIPE
1803.732	5418.785	.908	5419.693	11.80	8.50	1.12	5420.82	.00	1.23	1.99	2.000	.000	.00	1 .0
3.477	.0338					.0143	.05	.91	1.80	.73	.013	.00	.00	PIPE
1807.209	5418.902	.942	5419.844	11.80	8.11	1.02	5420.87	.00	1.23	2.00	2.000	.000	.00	1 .0
2.714	.0338					.0125	.03	.94	1.67	.73	.013	.00	.00	PIPE
1809.923	5418.994	.977	5419.971	11.80	7.73	.93	5420.90	.00	1.23	2.00	2.000	.000	.00	1 .0
2.033	.0338					.0110	.02	.98	1.56	.73	.013	.00	.00	PIPE
1811.956	5419.063	1.015	5420.078	11.80	7.37	.84	5420.92	.00	1.23	2.00	2.000	.000	.00	1 .0
1.563	.0338					.0097	.02	1.02	1.45	.73	.013	.00	.00	PIPE
1813.519	5419.116	1.054	5420.170	11.80	7.03	.77	5420.94	.00	1.23	2.00	2.000	.000	.00	1 .0
1.137	.0338					.0086	.01	1.05	1.35	.73	.013	.00	.00	PIPE

Program Package Serial Number: 1454

WATER SURFACE PROFILE LISTING Date: 7-15-2016 Time: 9:39:56

Juan Tabo Hills Estates
Developed 100-YR Flow Rates
Manzano Vista K to SWQ Pond

Station / L/Elem	Invert Elev / Ch Slope	Depth (FT)	Water Elev	Q (CFS)	Vel (FPS)	Vel Head / SF Ave	Energy Grd.El. / HF	Super Elev / SE Dpth	Critical Depth / Froude N	Flow Top Width / Norm Dp	Height/ Dia.-FT / "N"	Base Wt or I.D. / X-Fall	ZL / ZR	No Wth Prs/Pip / Type Ch
1814.656	5419.154	1.095	5420.250	11.80	6.70	.70	5420.95	.00	1.23	1.99	2.000	.000	.00	1 .0
.776	.0338					.0076	.01	1.10	1.26	.73	.013	.00	.00	PIPE
1815.432	5419.181	1.138	5420.319	11.80	6.39	.63	5420.95	.00	1.23	1.98	2.000	.000	.00	1 .0
.428	.0338					.0067	.00	1.14	1.17	.73	.013	.00	.00	PIPE
1815.860	5419.195	1.184	5420.379	11.80	6.09	.58	5420.96	.00	1.23	1.97	2.000	.000	.00	1 .0
.140	.0338					.0059	.00	1.18	1.08	.73	.013	.00	.00	PIPE
1816.000	5419.200	1.234	5420.434	11.80	5.80	.52	5420.96	.00	1.23	1.94	2.000	.000	.00	1 .0
JUNCT STR	.1250					.0043	.02	1.23	1.00		.013	.00	.00	PIPE
1820.000	5419.700	1.548	5421.248	5.90	3.34	.17	5421.42	.00	.94	.00	1.500	.000	.00	1 .0
2.091	.0263					.0031	.01	1.55	.00	.61	.013	.00	.00	PIPE
1822.091	5419.755	1.500	5421.255	5.90	3.34	.17	5421.43	.00	.94	.00	1.500	.000	.00	1 .0
5.198	.0263					.0029	.02	1.50	.00	.61	.013	.00	.00	PIPE
1827.288	5419.892	1.360	5421.252	5.90	3.50	.19	5421.44	.00	.94	.87	1.500	.000	.00	1 .0
1.474	.0263					.0029	.00	1.36	.44	.61	.013	.00	.00	PIPE
1828.762	5419.931	1.280	5421.211	5.90	3.67	.21	5421.42	.00	.94	1.06	1.500	.000	.00	1 .0
HYDRAULIC JUMP														
1828.762	5419.931	.641	5420.572	5.90	8.19	1.04	5421.61	.00	.94	1.48	1.500	.000	.00	1 .0
6.038	.0263					.0205	.12	.64	2.07	.61	.013	.00	.00	PIPE

MH-40

Program Package Serial Number: 1454

WATER SURFACE PROFILE LISTING Date: 7-15-2016 Time: 9:39:56

Juan Tabo Hills Estates
Developed 100-YR Flow Rates
Manzano Vista K to SWQ Pond

Station	Invert Elev	Depth (FT)	Water Elev	Q (CFS)	Vel (FPS)	Vel Head	Energy Grd.El.	Super Elev	Critical Depth	Flow Top Width	Height/ Dia.-FT	Base Wt or I.D.	ZL	No Wth Prs/Pip
L/Elem	Ch Slope					SF Ave	HF	SE Dpth	Froude N	Norm Dp	"N"	X-Fall	ZR	Type Ch
1834.800	5420.089	.664	5420.753	5.90	7.81	.95	5421.70	.00	.94	1.49	1.500	.000	.00	1 .0
7.363	.0263					.0180	.13	.66	1.93	.61	.013	.00	.00	PIPE
1842.163	5420.283	.689	5420.972	5.90	7.44	.86	5421.83	.00	.94	1.50	1.500	.000	.00	1 .0
4.990	.0263					.0159	.08	.69	1.80	.61	.013	.00	.00	PIPE
1847.154	5420.415	.715	5421.130	5.90	7.10	.78	5421.91	.00	.94	1.50	1.500	.000	.00	1 .0
3.566	.0263					.0140	.05	.72	1.68	.61	.013	.00	.00	PIPE
1850.720	5420.508	.742	5421.250	5.90	6.77	.71	5421.96	.00	.94	1.50	1.500	.000	.00	1 .0
2.609	.0263					.0123	.03	.74	1.56	.61	.013	.00	.00	PIPE
1853.329	5420.577	.770	5421.347	5.90	6.45	.65	5421.99	.00	.94	1.50	1.500	.000	.00	1 .0
1.855	.0263					.0108	.02	.77	1.46	.61	.013	.00	.00	PIPE
1855.184	5420.626	.800	5421.426	5.90	6.15	.59	5422.01	.00	.94	1.50	1.500	.000	.00	1 .0
1.336	.0263					.0095	.01	.80	1.35	.61	.013	.00	.00	PIPE
1856.520	5420.661	.831	5421.492	5.90	5.86	.53	5422.03	.00	.94	1.49	1.500	.000	.00	1 .0
.869	.0263					.0084	.01	.83	1.26	.61	.013	.00	.00	PIPE
1857.389	5420.684	.864	5421.548	5.90	5.59	.49	5422.03	.00	.94	1.48	1.500	.000	.00	1 .0
.484	.0263					.0074	.00	.86	1.17	.61	.013	.00	.00	PIPE
1857.873	5420.697	.899	5421.596	5.90	5.33	.44	5422.04	.00	.94	1.47	1.500	.000	.00	1 .0
.127	.0263					.0066	.00	.90	1.08	.61	.013	.00	.00	PIPE

Program Package Serial Number: 1454

WATER SURFACE PROFILE LISTING Date: 7-15-2016 Time: 9:39:56

Juan Tabo Hills Estates
Developed 100-YR Flow Rates
Manzano Vista K to SWQ Pond

Station	Invert Elev	Depth (FT)	Water Elev	Q (CFS)	Vel (FPS)	Vel Head	Energy Grd.El.	Super Elev	Critical Depth	Flow Top Width	Height/ Dia.-FT	Base Wt or I.D.	ZL	No Wth Prs/Pip
L/Elem	Ch Slope					SF Ave	HF	SE Dpth	Froude N	Norm Dp	"N"	X-Fall	ZR	Type Ch
1858.000	5420.700	.938	5421.638	5.90	5.08	.40	5422.04	.00	.94	1.45	1.500	.000	.00	1 .0

Inlet 15

AS BUILT INFORMATION	BENCH MARKS	SURVEY INFORMATION	ENGINEER'S SEAL
CONTRACTOR	STATION "5-M22" IS LOCATED 8.7 MI. SE OF DOWNTOWN ALBUQUERQUE	FIELD NOTES	
WORK STAKED BY	ON THE EAST SIDE OF THE MUNICIPAL LIMITS LINE IN THE FOUR HILLS	NO. BY DATE	
INSPECTOR'S ACCEPTANCE BY	SUBDIVISION AREA. STATION IS 600 FT. EAST OF MUNICIPAL LIMITS LINE.		
FIELD VERIFICATION BY	77.9' SE OF POWER POLE #5637 & 186.0' NW OF POWER POLE #80.		
DRAWINGS CONTRACTOR	STATION IS A STANDARD ACS BRASS DISK SET IN A CONCRETE		
DATE	RECORDED BY		

NO.	REMARKS	DATE	BY
	REVISIONS		
	DESIGN		
	DESIGNED BY	DATE	

CERTIFICATE OF SUBSTANTIAL COMPLIANCE

dmg MARK GOODWIN & ASSOCIATES, P.A.
CONSULTING ENGINEERS
P.O. BOX 90606
ALBUQUERQUE, NEW MEXICO 87199
OFFICE (505) 828-2200, FAX (505) 797-9539

CITY OF ALBUQUERQUE
PUBLIC WORKS DEPARTMENT

TITLE: JUAN TABO HILLS ESTATES
HGL CROSS SECTION PLAN

DESIGN REVIEW COMMITTEE	CITY ENGINEER APPROVAL	LAST DESIGN UPDATE	MD./DAY/YR.

LEGEND

SCALE: 1" = 100'

MATCHLINE

TRACT 1-A-1-B

TRACT O

Galant Fox

Blue Ribbon Rd.

Silver Dollar St.

Hubbard St.

Sandia Sunset Ave.

Duke City St.

Rock Squirrel Ave.

Tread K

Junction Box

Manzano Vista Ave.

Running Bear Ave.

Cougar Run

Lobo Trail Ct.

TIJERAS ARROYO

INLET 1A, INLET 2B, INLET 4, INLET 16, INLET 16A, INLET 17, INLET 18, INLET 19, INLET 45, INLET 48, INLET S6, INLET S7, INLET 12, INLET 13, INLET 24, INLET 30, INLET (98), INLET (1), INLET (2), INLET (3), INLET (4), INLET (5), INLET (6), INLET (7), INLET (8), INLET (9), INLET (10), INLET (11), INLET (12), INLET (13), INLET (15), INLET (16), INLET (17), INLET (18), INLET (19), INLET (20), INLET (21), INLET (22), INLET (23), INLET (24), INLET (25), INLET (26), INLET (27), INLET (28), INLET (38), INLET (40), INLET (42), INLET (44), INLET (47), INLET (68), INLET (70), INLET (71), INLET (72), INLET (73), INLET (81), INLET (89), SD-MH-(1), SD-MH-(2), SD-MH-(3), SD-MH-(4), SD-MH-(5), SD-MH-(6), SD-MH-(7), SD-MH-(12), SD-MH-(13), SD-MH-(20), SD-MH-(21), SD-MH-(22), SD-MH-(23), SD-MH-(24), SD-MH-(25), SD-MH-(26), SD-MH-(27), SD-MH-(28), SD-MH-(38), SD-MH-(40), SD-MH-(42), SD-MH-(44), SD-MH-(47), SD-MH-(81)

CONSTRUCTION PLANS

FOR

JUAN TABO HILLS ESTATES

ALBUQUERQUE, NEW MEXICO

INDEX TO DRAWINGS

SHEET NO.

THE SUBJECT PROPERTY IS LOCATED NEAR A FORMER LANDFILL. DUE TO THE SUBJECT PROPERTY BEING NEAR A FORMER LANDFILL CERTAIN PRECAUTIONARY MEASURES MAY NEED TO BE TAKEN TO ENSURE THE HEALTH AND SAFETY OF THE PUBLIC. RECOMMENDATIONS MADE BY A PROFESSIONAL ENGINEER WITH EXPERTISE IN LANDFILLS AND LANDFILL GAS ISSUES (AS REQUIRED BY THE MOST CURRENT VERSION OF THE INTERIM GUIDELINES FOR DEVELOPMENT WITHIN CITY. DESIGNATED LANDFILL BUFFER ZONES) SHALL BE CONSULTED PRIOR TO DEVELOPMENT OF THE SITE.

DRB NO. 1004073

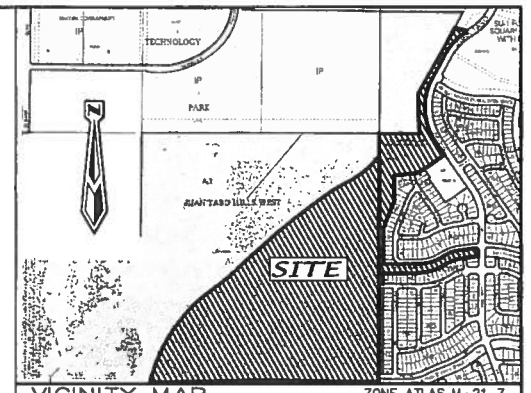

VICINITY MAP ZONE ATLAS M-21-Z SCALE: NONE

GENERAL NOTES

NOTICE TO CONTRACTORS

1. AN EXCAVATION/CONSTRUCTION PERMIT WILL BE REQUIRED BEFORE BEGINNING ANY WORK WITHIN THE CITY RIGHT-OF-WAY.
2. ALL WORK DETAILED ON THESE PLANS TO BE PERFORMED UNDER CONTRACT SHALL, EXCEPT AS OTHERWISE STATED OR PROVIDED FOR HEREON, BE CONSTRUCTED IN ACCORDANCE WITH THE CITY OF ALBUQUERQUE STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION, 1986 EDITION AS REVISED THROUGH UPDATE 9.
3. TWO WORKING DAYS PRIOR TO ANY EXCAVATION, THE CONTRACTOR MUST CONTACT NEW MEXICO ONE CALL SYSTEM (260–1990) FOR LOCATION OF EXISTING UTILITIES.
4. PRIOR TO CONSTRUCTION, THE CONTRACTOR SHALL EXCAVATE AND VERIFY THE HORIZONTAL AND VERTICAL LOCATIONS OF ALL OBSTRUCTIONS. SHOULD A CONFLICT EXIST, THE CONTRACTOR SHALL NOTIFY THE ENGINEER IMMEDIATELY SO THAT THE CONFLICT CAN BE RESOLVED WITH A MINIMUM AMOUNT OF DELAY.
5. SEVEN (7) WORKING DAYS PRIOR TO BEGINNING OF CONSTRUCTION, THE CONTRACTOR SHALL SUBMIT TO CONSTRUCTION COORDINATION DIVISION A DETAILED CONSTRUCTION SCHEDULE. TWO (2) WORKING DAYS PRIOR TO THE START OF CONSTRUCTION, THE CONTRACTOR SHALL OBTAIN A BARRICADING PERMIT FROM THE CONSTRUCTION COORDINATION DIVISION. CONTRACTOR SHALL NOTIFY THE CONSTRUCTION COORDINATION ENGINEER (924–3400) PRIOR TO OCCUPYING AN INTERSECTION. REFER TO SECTION 19 OF THE GENERAL CONDITIONS OF THE STANDARD SPECIFICATIONS.
6. ALL WORK AFFECTING ARTERIAL ROADWAYS REQUIRES TWENTY-FOUR HOUR CONSTRUCTION.
7. ALL STREET STRIPING ALTERED OR DESTROYED SHALL BE REPLACED WITH PLASTIC REFLECTORIZED PAVEMENT MARKING BY CONTRACTOR TO THE SAME LOCATION AS WAS EXISTING, OR AS INDICATED BY THIS PLAN SET.
8. CONTRACTOR SHALL NOTIFY THE ENGINEER NOT LESS THAN SEVEN (7) DAYS PRIOR TO STARTING WORK IN ORDER THAT THE CITY SURVEYOR MAY TAKE NECESSARY MEASURES TO ENSURE THE PRESERVATION OF SURVEY MONUMENTS. CONTRACTOR SHALL NOT DISTURB PERMANENT SURVEY MONUMENTS WITHOUT THE CONSENT OF THE CITY SURVEYOR AND SHALL NOTIFY THE CITY SURVEYOR AND BEAR THE EXPENSE OF REPLACING ANY THAT MAY BE DISTURBED WITHOUT PERMISSION. REPLACEMENT SHALL BE DONE ONLY BY THE CITY SURVEYOR. WHEN A CHANGE IS MADE IN THE FINISHED ELEVATIONS OF THE PAVEMENT OF ANY ROADWAY IN WHICH A PERMANENT SURVEY MONUMENT IS LOCATED, CONTRACTOR SHALL, AT HIS OWN EXPENSE, ADJUST THE MONUMENT COVER TO THE NEW GRADE UNLESS OTHERWISE SPECIFIED. REFER TO SECTION 4.4 OF THE GENERAL CONDITIONS OF THE STANDARD SPECIFICATIONS.
9. CONTRACTOR SHALL RECORD DATA ON ALL UTILITY LINES AND ACCESSORIES AS REQUIRED BY THE CITY OF ALBUQUERQUE FOR THE PREPARATION OF "AS CONSTRUCTED" DRAWINGS. CONTRACTOR SHALL NOT COVER UTILITY LINES AND ACCESSORIES UNTIL ALL DATA HAVE BEEN RECORDED.
10. CONTRACTOR SHALL MAINTAIN A GRAFFITI-FREE WORK SITE. CONTRACTOR SHALL PROMPTLY REMOVE ANY GRAFFITI FROM ALL EQUIPMENT, WHETHER PERMANENT OR TEMPORARY.
11. THE CONTRACTOR SHALL COORDINATE WITH THE WATER AUTHORITY SEVEN (7) DAYS IN ADVANCE OF PERFORMING WORK THAT WILL AFFECT THE PUBLIC WATER OR SANITARY SEWER INFRASTRUCTURE. WORK REQUIRING SHUTOFF OF WELL COLLECTORS, TRANSMISSION LINES, OR FACILITIES DESIGNATED AS MASTER PLAN FACILITIES MUST BE COORDINATED WITH THE WATER AUTHORITY 14 DAYS IN ADVANCE OF PERFORMING SUCH WORK. ONLY WATER AUTHORITY CREWS ARE AUTHORIZED TO OPERATE PUBLIC VALVES. SHUTOFF REQUESTS MUST BE MADE ONLINE AT http://www.abcwua.org/Water_Shut_off_and_Turn_on_Procedures.aspx
12. RCP SHALL BE INSTALLED SO THAT THE JOINT GAP AT THE HOME POSITION SHALL CONFORM TO THE APPROVED MANUFACTURER'S RECOMMENDATIONS. MANUFACTURER'S RECOMMENDED JOINT GAP TOLERANCES FOR EACH PIPE SIZE AND TYPE SHALL BE SUBMITTED TO THE ENGINEER FOR FOR APPROVAL PRIOR TO PLACEMENT OF PIPE. RCP JOINTS SHALL NOT BE GROUTED UNLESS DIRECTED BY THE ENGINEER AFTER CITY APPROVAL.
13. ALL EXCAVATION, TRENCHING, AND SHORING ACTIVITIES MUST BE CARRIED-OUT IN ACCORDANCE WITH OSHA 29 CFR 1926.650 SUBPART P.
14. ELECTRONIC MARKER DEVICE (EMD) WILL BE PLACED ACCORDING TO SECTION 170 OF THE CITY OF ALBUQUERQUE STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION, 1986 EDITION AS REVISED THROUGH UPDATE AMENDMENT #9.
15. PRIVATE STREETS REQUIRE STREET NAME SIGNS, STOP SIGNS, AND ANY NECESSARY STRIPING (DEVELOPER'S RESPONSIBILITY).
16. CONTRACTOR SHALL ASSUME RESPONSIBILITY FOR ANY DAMAGE TO EXISTING PAVEMENT, PAVEMENT MARKINGS, CURB & GUTTER, SIGNAGE, HANDICAP RAMPS AND SIDEWALK DURING CONSTRUCTION PART FROM THOSE SECTIONS INDICATED FOR REMOVAL ON THE PLANS AND SHALL REPAIR OR REPLACE, PER CITY OF ALBUQUERQUE STANDARDS, AT HIS OWN EXPENSE.

THE FOLLOWING NOTES ALSO APPLY WHEN CHECKED

- [x] ALL UTILITIES AND UTILITY SERVICE LINES SHALL BE INSTALLED PRIOR TO PAVING.
- [x] BACKFILL COMPACTION SHALL BE ACCORDING TO SPECIFIED STREET USE.
- [ ] TACK COAT REQUIREMENTS SHALL BE DETERMINED BY THE ENGINEER.
- [x] SIDEWALK AND WHEELCHAIR RAMPS WITHIN THE CURB RETURNS SHALL BE CONSTRUCTED WHEREVER A NEW CURB RETURN IS CONSTRUCTED.
- [ ] IF CURB IS DEPRESSED FOR A DRIVEPAD, THE DRIVEPAD SHALL BE CONSTRUCTED PRIOR TO ACCEPTANCE OF CURB AND GUTTER.
- [x] ALL STORM DRAINAGE FACILITIES SHALL BE COMPLETED PRIOR TO FINAL ACCEPTANCE.

NOTE:
CONTRACTOR SHALL PROVIDE AND MAINTAIN ALL CONSTRUCTION SIGNING UNTIL PROJECT HAS BEEN ACCEPTED BY THE CITY OF ALBUQUERQUE.

CAUTION:
NOTE THAT ALL EXISTING UTILITIES MAY NOT BE SHOWN. ALL EXISTING SERVICE CONNECTIONS ARE NOT SHOWN. ANY EXISTING UTILITIES THAT ARE SHOWN ARE APPROXIMATE LOCATION ONLY. IT SHALL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR TO CONTACT ALL THE UTILITY OWNERS AND TO CONDUCT ALL NECESSARY FIELD INVESTIGATIONS PRIOR TO ANY EXCAVATIONS TO DETERMINE THE ACTUAL LOCATION OF UTILITIES AND OTHER IMPROVEMENTS. DISTURBANCE OF EXISTING UTILITIES SHALL BE REPLACED AT THE CONTRACTOR'S EXPENSE.

dmg D. MARK GOODWIN & ASSOCIATES, P.A.
CONSULTING ENGINEERS
P. O. BOX 90606
ALBUQUERQUE, NEW MEXICO 87199
(505) 828-2200, FAX (505) 797-9539

REV.	SHEETS	CITY ENGINEER	DATE	USER DEPARTMENT	DATE	USER DEPARTMENT	DATE

ENGINEERS STAMP & SIGNATURE

JAMES D. MURPHY 14874 REGISTERED PROFESSIONAL ENGINEER NEW MEXICO
7-15-2017

APPROVALS	ENGINEER	DATE
DRC CHAIRMAN		
TRANSPORTATION		
WATER/WASTEWATER		
HYDROLOGY		
CIP		
CONSTR. MNGMT.		
CONSTR. COORD.		

APPROVED FOR CONSTRUCTION

CITY ENGINEER DATE

CITY PROJECT NO. 654887

SHEET OF 1 75

F:\A11.095\A11039 JTH West - Final\PLANS\A11039 COVER SHEET.dwg, Last saved by: Stephen, 1/11/17

F:\A11.095\A11039 JTH West - Final\PLANS\A11039 COVER SHEET.dwg, 3/13/2017 9:23:30 AM, DPS

NOTES

1. THIS PROJECT SITE LIES WITHIN THE 2NR ZONE FOR PADS BETWEEN ELEVATIONS 5065.7 AND 5142.7
2. ALL FIRE HYDRANTS ARE ABCWUA STD. DWG 2340 AND 4' BURY UNLESS OTHERWISE SPECIFIED.
3. ALL METER BOXES ADJACENT TO MOUNTABLE CURB SHALL HAVE DUCTILE IRON METER BOX COVER & LID PER ABCWUA STD. DWG 2368. WATER METER BOX PER ABCWUA STD. DWG #2366. WATER SERVICE PER ABCWUA STD. DWG #2362.
4. ALL FIRE HYDRANTS TO HAVE A 6" GATE VALVE & BOX PER ABCWUA STD. DWG #2326.
5. CONTRACTOR TO USE POLY COATED CMP FOR VALVE BOXES.
6. CONTRACTOR IS NOT TO INSTALL THE STEPS IN THE SAS MANHOLES.
7. ALL SANITARY SEWER MANHOLES PER ABCWUA STD. DWG #2101, #2107 AND #2109.
8. ALL WATER LINES SHALL BE C-900, DR-18, PVC.
9. ALL SEWER LINES SHALL BE SDR-35, PVC.
10. ALL GATE VALVES & VALVES BOXES PER DWG 2326.
11. ALL SEWER SERVICES PER DWG 2125.
12. ALL MAN HOLES SHALL BE PER DWG 2101 FOR TYPE C AND 2102 FOR TYPE E
13. ALL WATER AND SEWER MAINS AND SERVICE LINES SHALL HAVE TRACER WIRE OVER THE TOP OF PIPE.

FIRE HYDRANT – GPS AS-BUILT

FIRE HYDRANT #	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
10			
11			

GATE VALVE – GPS AS-BUILT

GATE VALVE #	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
17			
18			
20			
22			
23			

SURVEY INFORMATION

FIELD NOTES

NO.	BY	DATE

STATION "S-M22" IS LOCATED 8.7 MI. SE OF DOWNTOWN ALBUQUERQUE

ON THE EAST SIDE OF THE MUNICIPAL LIMITS LINE IN THE FOUR HILLS SUBDIVISION AREA. STATION IS 600 FT. EAST OF MUNICIPAL LIMITS LINE.

77.9' SE OF POWER POLE #ES37 & 186.0' NW OF POWER POLE #50.

STATION IS A STANDARD ACS BRASS DISK SET IN A CONCRETE MONUMENT IN THE GROUND. STATION IS STAMPED "S-M22".

X= 1,564,263.207, Y= 1,475,762.595, (NAD 83), Z= 5597.219 (NAVD 1988)

BENCH MARKS

NO.	DESCRIPTION	DATE

ENGINEER'S SEAL

JAMES D. HUGHES — NEW MEXICO REGISTERED PROFESSIONAL ENGINEER — 3-14-17

AS BUILT INFORMATION

CONTRACTOR

WORK STARTED BY	DATE

INSPECTION'S ACCEPTANCE BY	DATE

FIELD VERIFICATION BY	DATE

DRAWINGS CORRECTED BY	DATE

MICRO-FILM INFORMATION

RECORDED BY	DATE

NO.	REMARKS	DATE	BY

REVISIONS

DESIGNED BY	JDH	02/17
DRAWN BY	SPS	02/17
CHECKED BY	DMG	02/17

DESIGN — DATE

CERTIFICATE OF SUBSTANTIAL COMPLIANCE

dmg
MARK GOODWIN & ASSOCIATES, P.A.
CONSULTING ENGINEERS
P.O. BOX 90606
ALBUQUERQUE, NEW MEXICO 87199
OFFICE (505) 828-2200, FAX (505) 797-9539

CITY OF ALBUQUERQUE
PUBLIC WORKS DEPARTMENT

TITLE: JUAN TABO HILLS ESTATES
RUNNING BEAR
UTILITY PLAN & PROFILE

DESIGN REVIEW COMMITTEE | CITY ENGINEER APPROVAL | LAST DESIGN UPDATE | MO./DAY/YR. | MO./DAY/YR.

CITY PROJECT NO. 6548B7 | ZONE MAP NO. M-21 | SHEET 49 OF 75

SANITARY SEWER SERVICES

LOT	STATION AT ROW	INV. ELEV. AT ROW	LENGTH AT ROW	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
8–P1	23+67.75	5414.83	21.50'			
9–P1	23+17.75	5413.16	21.50'			
10–P1	22+67.75	5411.37	21.50'			
11–P1	22+17.75	5409.58	21.50'			
12–P1	21+67.75	5407.79	21.50'			
13–P1	21+17.75	5405.88	21.50'			
14–P1	20+67.75	5403.40	21.50'			
15–P1	20+17.75	5400.44	21.50'			
16–P1	19+67.75	5397.88	21.50'			

WATER METER SERVICES – GPS AS-BUILT

LOT	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
8–P1			
9–P1			
10–P1			
11–P1			
12–P1			
13–P1			
14–P1			
15–P1			
16–P1			

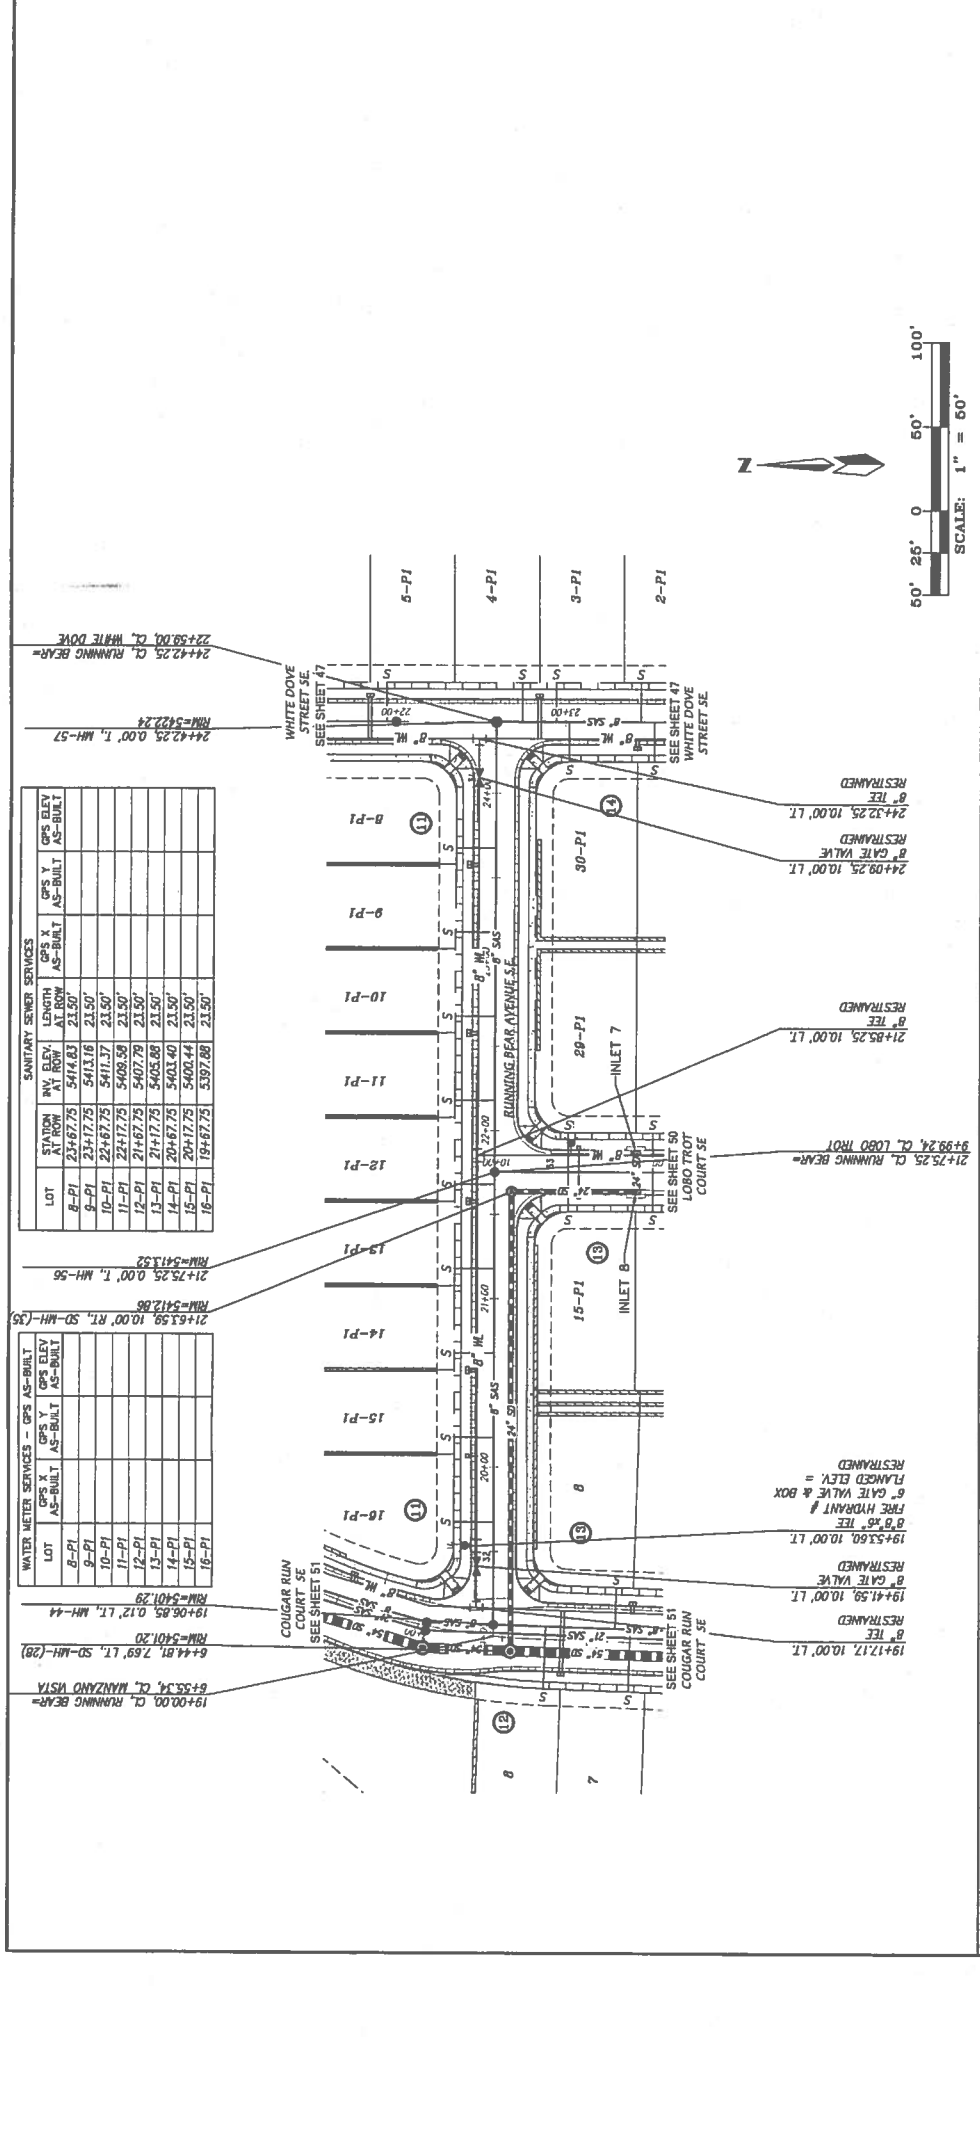

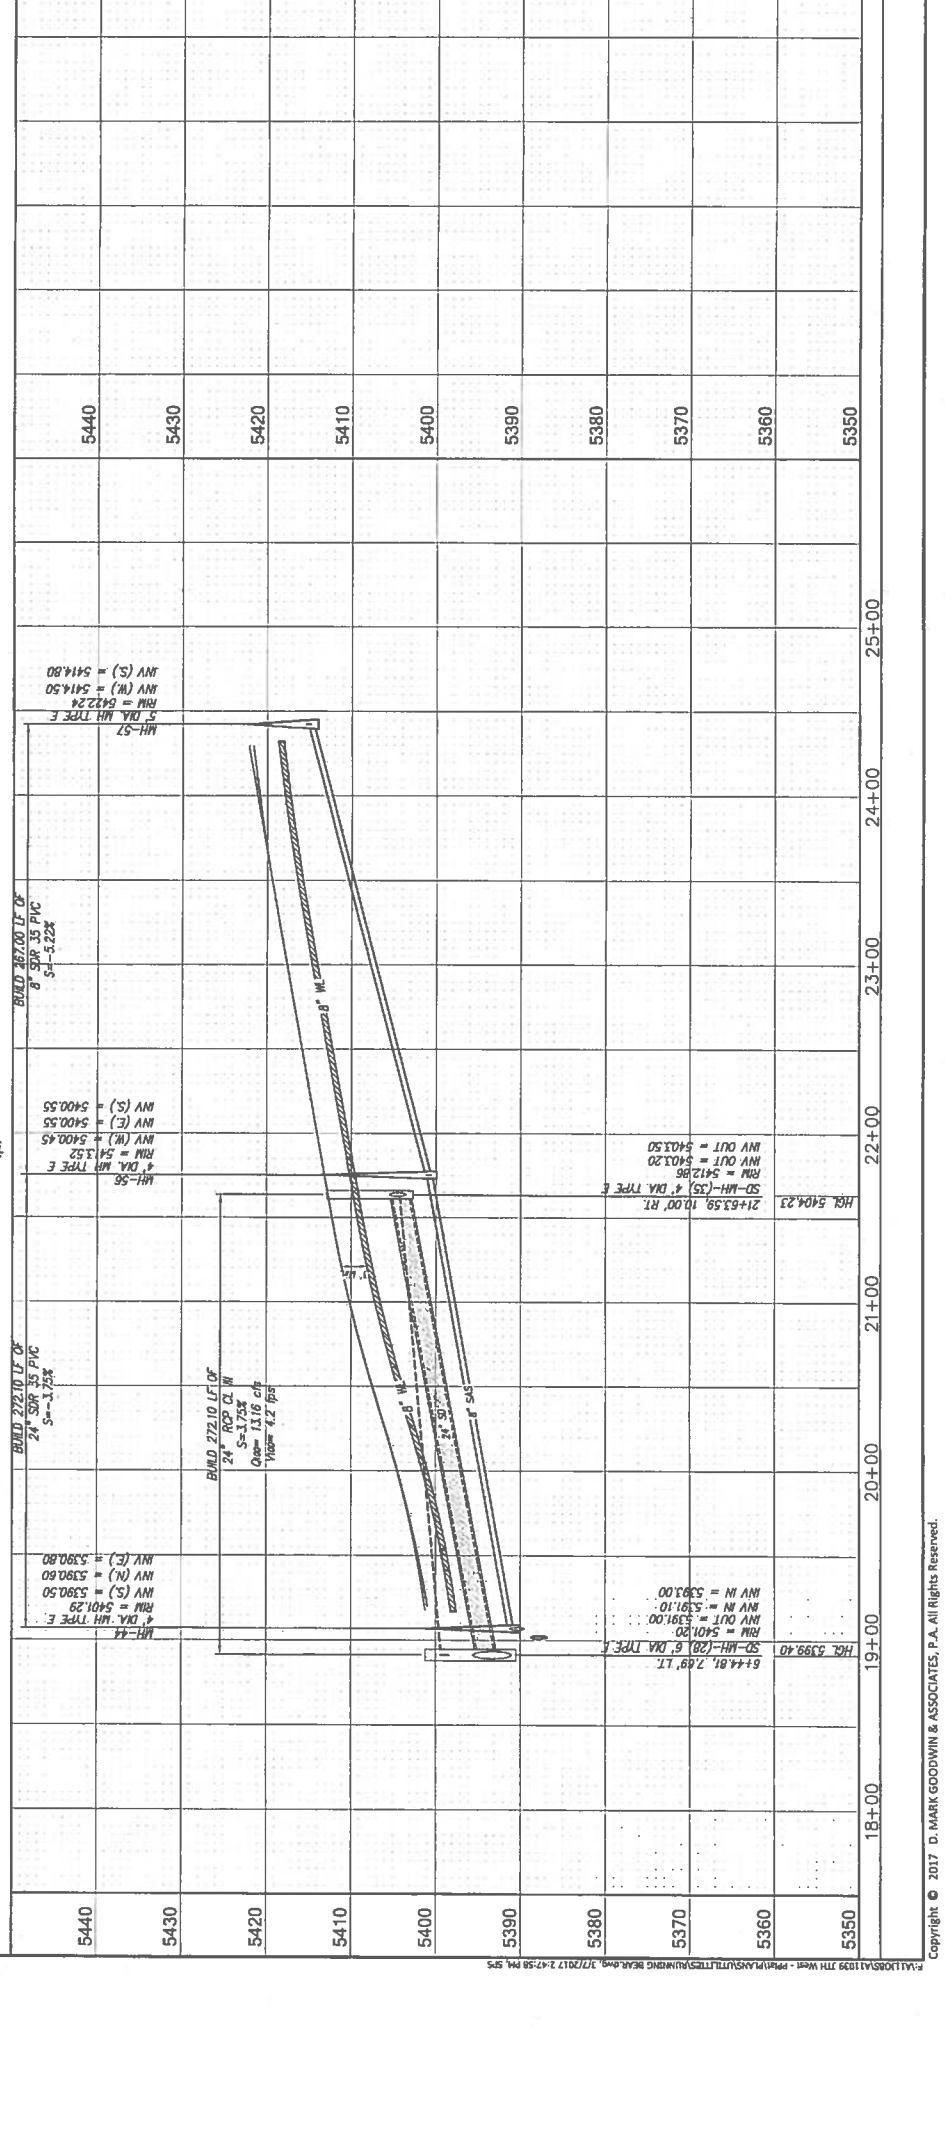

NOTES

1. THIS PROJECT SITE LIES WITHIN THE 2WR ZONE FOR PADS BETWEEN ELEVATIONS 5065.7 AND 5142.7
2. ALL FIRE HYDRANTS ARE ABCWUA STD. DWG 2340 AND 4' BURY UNLESS OTHERWISE SPECIFIED.
3. ALL METER BOXES ADJACENT TO MOUNTABLE CURB SHALL HAVE DUCTILE IRON METER BOX COVER & LID PER ABCWUA STD. DWG 2306. WATER METER BOX PER ABCWUA STD. DWG 2306. WATER SERVICE PER ABCWUA STD. DWG #2302.
4. ALL FIRE HYDRANTS TO HAVE A 6" GATE VALVE & BOX PER ABCWUA STD. DWG #2320.
5. CONTRACTOR TO USE POLY COATED CAP FOR VALVE BOXES.
6. CONTRACTOR IS REQ'D TO INSTALL THE STEPS IN THE SAS MANHOLES.
7. ALL SANITARY SEWER MANHOLES PER ABCWUA STD. DWG #2101, #2107 AND #2108.
8. ALL WATER LINES SHALL BE C-900, DR-18, PVC.
9. ALL SEWER LINES SHALL BE SDR-35, PVC.
10. ALL GATE VALVES & VALVES BOXES PER DWG 2326.
11. ALL SEWER SERVICES PER DWG 2125.
12. ALL MAN HOLES SHALL BE PER DWG 2101 FOR TYPE C AND 2102 FOR TYPE E
13. ALL WATER AND SEWER MAINS AND SERVICE LINES SHALL HAVE TRACER WIRE OVER THE TOP OF PIPE.

FIRE HYDRANT – GPS AS-BUILT

FIRE HYDRANT #	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
15			

GATE VALVE – GPS AS-BUILT

GATE VALVE #	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
33			

WATER METER SERVICES – GPS AS-BUILT

LOT	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
1–P1			
2–P1			
3–P1			
4–P1			
5–P1			

WATER METER SERVICES – GPS AS-BUILT

LOT	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
9–P1			
10–P1			
11–P1			
12–P1			
13–P1			
14–P1			
15–P1			

SANITARY SEWER SERVICES

LOT	STATION AT PUE	INV. ELEV. AT PUE	LENGTH AT PUE	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
5–P1	10+42.74	5408.10	23.50			
4–P1	10+92.56	5407.79	23.50			
3–P1	11+42.56	5408.60	23.50			
2–P1	11+92.56	5409.60	23.50			
1–P1	12+42.56	5410.13	23.50			

SANITARY SEWER SERVICES

LOT	STATION AT PUE	INV. ELEV. AT PUE	LENGTH AT PUE	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
9–P1	13+42.56	5412.71	33.50			
10–P1	12+92.56	5411.60	33.50			
11–P1	12+42.56	5410.57	33.50			
12–P1	11+92.56	5408.53	33.50			
13–P1	11+42.56	5408.33	33.50			
14–P1	10+92.56	5407.73	33.50			
15–P1	10+42.56	5407.23	33.50			

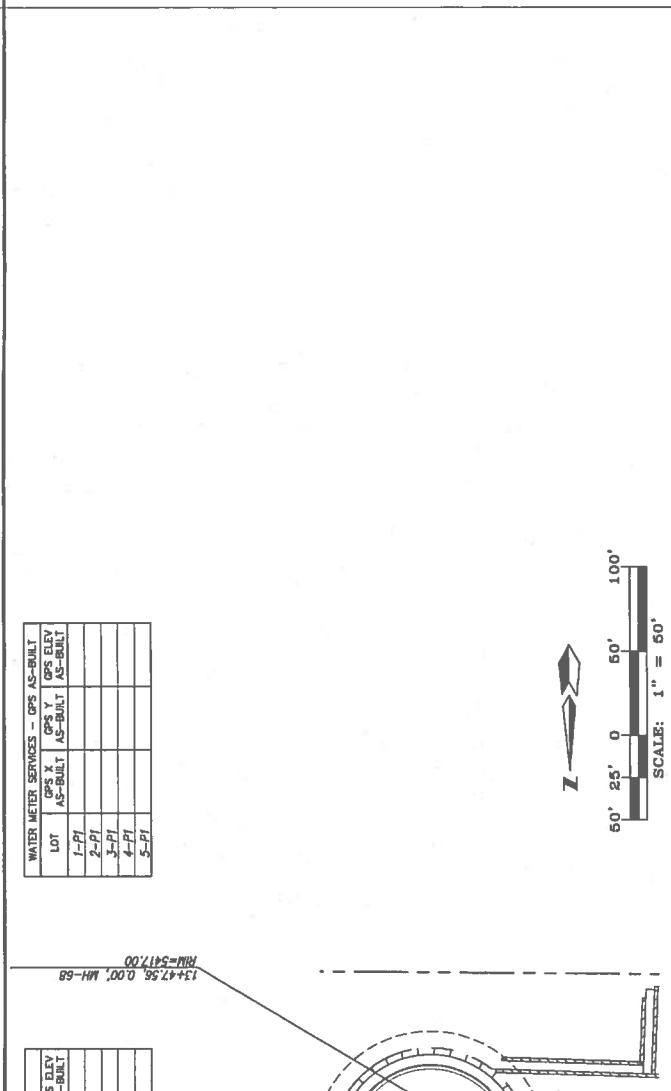

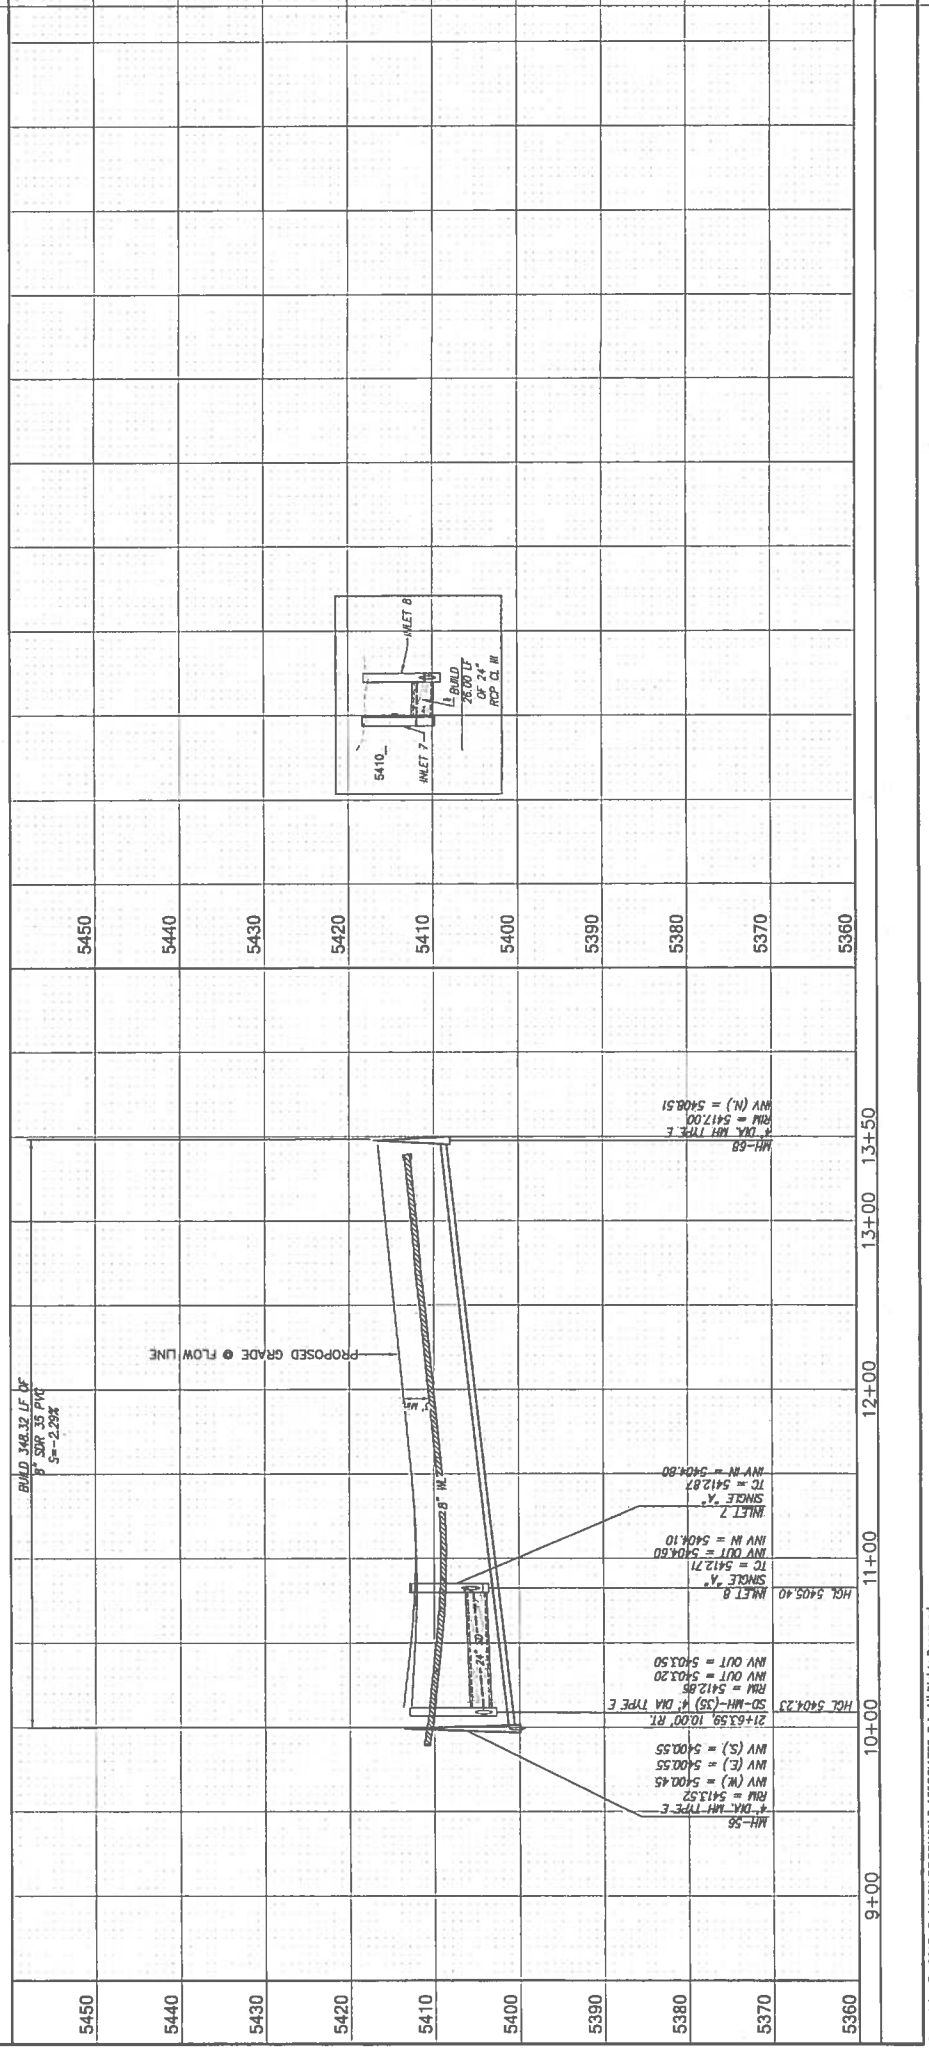

AS BUILT INFORMATION

CONTRACTOR

WORK	BY	DATE
STAKED		
INSPECTION'S		
ACCEPTANCE	BY	DATE
FIELD VERIFICATION	BY	DATE
DRAWINGS CORRECTED	BY	DATE

MICRO-FILM INFORMATION

RECORDED BY	DATE

NO.

BENCH MARKS

STATION "5-M22" IS LOCATED 0.7 MI. SE OF DOWNTOWN ALBUQUERQUE

ON THE EAST SIDE OF THE MUNICIPAL LIMITS LINE IN THE FOUR HILLS SUBDIVISION AREA. STATION IS 600 FT. EAST OF MUNICIPAL LIMITS LINE.

77.9', SE OF POWER POLE #537 & 186.0' NW OF POWER POLE #60.

STATION IS A STANDARD ACS BRASS DISK SET IN A CONCRETE MONUMENT IN THE GROUND. STATION IS STAMPED "5-M22".

X= 1,564,263.207, Y= 1,473,762.595, (NAD 83), Z= 5597.219 (NAVD 1988)

FIELD NOTES

NO.	BY	DATE

SURVEY INFORMATION

ENGINEER'S SEAL

JAMES D. HUGHES — NEW MEXICO — REGISTERED PROFESSIONAL ENGINEER — 5-15-2017

NO.	REMARKS	BY	DATE

REVISIONS

DESIGN			
DESIGNED BY	JDH	DATE	02/17
DRAWN BY	SPS	DATE	02/17
CHECKED BY	DMG	DATE	02/17

CERTIFICATE OF SUBSTANTIAL COMPLIANCE

dmg
MARK GOODWIN & ASSOCIATES, P.A.
CONSULTING ENGINEERS
P.O. BOX 90606
ALBUQUERQUE, NEW MEXICO 87199
OFFICE (505) 828-2200, FAX (505) 797-9539

CITY OF ALBUQUERQUE
PUBLIC WORKS DEPARTMENT

TITLE: JUAN TABO HILLS ESTATES
LOBO TROT ROAD S.E.
UTILITY PLAN & PROFILE

DESIGN REVIEW COMMITTEE | CITY ENGINEER APPROVAL | LAST DESIGN UPDATE | MO./DAY/YR. | MO./DAY/YR.

CITY PROJECT NO. 654887 | ZONE MAP NO. M-21 | SHEET 50 OF 75

1. THE MAIN TRUNK SAS (21"-24") IS TO BE CONSTRUCTED BEFORE THIS PROJECT BEGINS. SEE SEPARATE WORK ORDER CITY PROJECT# 654885.

FIRE HYDRANT – GPS AS-BUILT

FIRE HYDRANT #	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
10			
11			

GATE VALVE – GPS AS-BUILT

GATE VALVE #	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
17			
18			
20			
22			
23			

BENCH MARKS	AS BUILT INFORMATION
STATION "5-A22" IS LOCATED 8.7 MI. SE OF DOWNTOWN ALBUQUERQUE	CONTRACTOR
ON THE EAST SIDE OF THE MUNICIPAL LIMITS LINE IN THE FOUR HILLS SUBDIVISION AREA. STATION IS 600 FT. EAST OF MUNICIPAL LIMITS LINE.	STAKED BY / WORK
77.9' SE OF POWER POLE #SE37 & 18.0' NW OF POWER POLE #80. STATION IS A STANDARD ACS BRASS DISK SET IN A CONCRETE MONUMENT IN THE GROUND. STATION IS STAMPED "5-A22".	INSPECTOR'S ACCEPTANCE BY / FIELD VERIFICATION BY
X= 1,564,263.207, Y= 1,475,762.585, (NAD 83), Z= 5597.219 (NAVD 1988)	DRAWINGS CORRECTED BY / MICRO-FILM INFORMATION
	RECORDED BY / NO.

SURVEY INFORMATION

FIELD NOTES

NO.	BY	DATE

ENGINEER'S SEAL

JAMES D. KELLY, NEW MEXICO 14729, REGISTERED PROFESSIONAL ENGINEER, 3/14/2017

NO.	DATE	REMARKS	BY

REVISIONS

DESIGNED BY	JDH	DATE	02/17
DRAWN BY	SPS	DATE	02/17
CHECKED BY	DMG	DATE	02/17

DESIGN

CERTIFICATE OF SUBSTANTIAL COMPLIANCE

dmg
MARK GOODWIN & ASSOCIATES, P.A.
CONSULTING ENGINEERS
P.O. BOX 90606
ALBUQUERQUE, NEW MEXICO 87199
OFFICE (505) 828-2200, FAX (505) 797-9539

CITY OF ALBUQUERQUE
PUBLIC WORKS DEPARTMENT

TITLE: JUAN TABO HILLS ESTATES
COUGAR RUN COURT S.E.
UTILITY PLAN & PROFILE

DESIGN REVIEW COMMITTEE	CITY ENGINEER APPROVAL	LAST DESIGN UPDATE	MO./DAY/YR.	MO./DAY/YR.

CITY PROJECT NO 654887 | ZONE MAP NO. M-21 | SHEET 51 OF 75

WATER METER SERVICES – GPS AS-BUILT				
LOT	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT	
1				
2				
3				
4				
5				
6				
7				
8				

SANITARY SEWER SERVICES					
LOT	STATION AT ROW	INV. ELEV. AT ROW	LENGTH AT ROW	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
1	2+74.75	5392.18	25.00'			
2	3+24.75	5393.01	25.00'			
3	3+74.75	5393.51	25.00'			
4	4+24.75	5394.01	25.00'			
5	4+74.75	5394.51	25.00'			
6	5+24.75	5395.01	25.00'			
7	5+74.75	5395.51	25.00'			
8	6+24.75	5396.01	25.00'			

WATER METER SERVICES – GPS AS-BUILT			
LOT	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
1			
2			
3			
4			
5			
6			
7			
8			

SANITARY SEWER SERVICES					
LOT	STATION AT ROW	INV. ELEV. AT ROW	LENGTH AT ROW	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
1	2+46.83	5391.02	25.00'			
2	2+74.02	5392.50	25.00'			
3	3+33.76	5393.10	25.00'			
4	3+83.76	5393.60	25.00'			
5	4+33.76	5394.10	25.00'			
6	4+83.76	5394.60	25.00'			
7	5+33.76	5395.10	25.00'			
8	5+83.76	5395.60	25.00'			

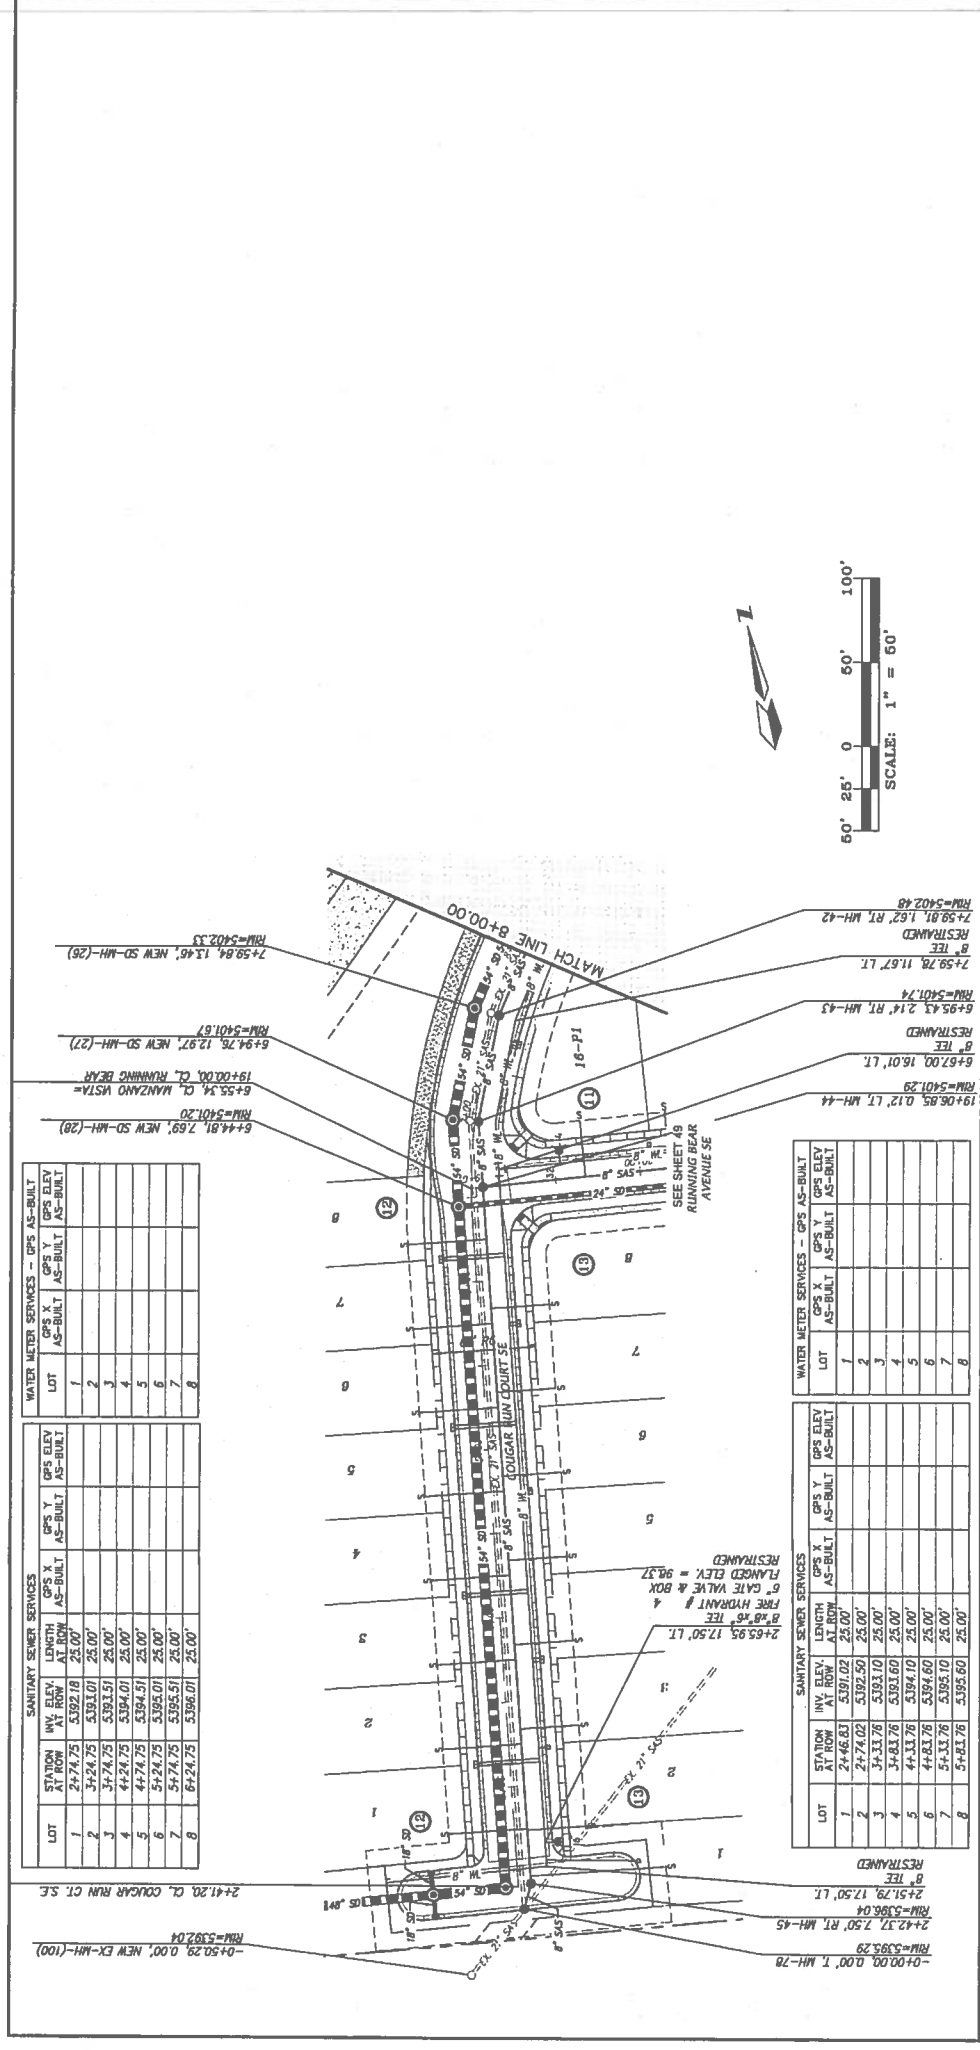

F:\ALLJOBSA\11039 7TH West - Proj\PLANS\UTILITIES\COUGAR RUN CT. SE.dwg, 2/27/2017 2:50:37 PM, SPS

User ID: doug, Date/Time: 3/15/2017 4:37 PM, Document Name: 2017-03-15 HGL Profiles.pdf

NO.	DATE	REMARKS	BY

REVISIONS

DESIGN

DESIGNED BY	JDH	DATE	02/17
DRAWN BY	SPS	DATE	02/17
CHECKED BY	DMG	DATE	02/17

CITY OF ALBUQUERQUE
PUBLIC WORKS DEPARTMENT

TITLE: JUAN TABO HILLS ESTATES
MANZANO VISTA
PAVING PLAN & PROFILE

DESIGN REVIEW COMMITTEE | CITY ENGINEER APPROVAL | LAST DESIGN UPDATE MO./DAY/YR. | MO./DAY/YR.

CITY PROJECT NO 654887 | ZONE MAP NO. M-21 | SHEET 52 OF 75

MARK GOODWIN & ASSOCIATES, P.A.
CONSULTING ENGINEERS
P.O. BOX 90606
ALBUQUERQUE, NEW MEXICO 87199
OFFICE (505) 828-2200, FAX (505) 797-9539

CERTIFICATE OF SUBSTANTIAL COMPLIANCE

ENGINEER'S SEAL

SURVEY INFORMATION

FIELD NOTES

NO.	BY	DATE

BENCH MARKS

STATION "S-422" IS LOCATED 8.7 MI. SE OF DOWNTOWN ALBUQUERQUE

ON THE EAST SIDE OF THE MUNICIPAL LIMITS LINE IN THE FOUR HILLS SUBDIVISION AREA. STATION IS 600 FT. EAST OF MUNICIPAL LIMITS LINE.

77.9' SE OF POWER POLE #E37 & 186.0' NW OF POWER POLE #50.

MONUMENT IN THE GROUND. STATION IS STAMPED "S-422".

STATION IS A STANDARD ACS BRASS DISK SET IN A CONCRETE

X= 1,564,263.207, Y= 1,473,762.595, (NAD 83), Z= 5597.219 (NAVD 1988)

AS BUILT INFORMATION

CONTRACTOR

WORK STAKED BY | DATE

INSPECTOR'S ACCEPTANCE BY | DATE

FIELD VERIFICATION BY | DATE

DRAWINGS CORRECTED BY | DATE

MICRO-FILM INFORMATION

RECORDED BY | DATE

NO.

FIRE HYDRANT – GPS AS-BUILT

FIRE HYDRANT #	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
9			

GATE VALVE – GPS AS-BUILT

GATE VALVE #	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
31			
30			
27			

WATER METER SERVICES – GPS AS-BUILT

LOT	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
19–P1			
20–P1			
21–P1			
22–P1			
23–P1			
24–P1			
25–P1			
26–P1			
27–P1			

SANITARY SEWER SERVICES

LOT	STATION AT ROW	INV. ELEV. AT ROW	LENGTH AT ROW	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
19–P1	16+55.50	5421.16	24.50'			
20–P1	16+05.50	5418.55	24.50'			
21–P1	15+55.50	5417.93	24.50'			
22–P1	15+05.50	5416.31	24.50'			
23–P1	14+55.50	5414.70	24.50'			
24–P1	14+05.50	5413.08	24.50'			
25–P1	13+55.50	5411.47	24.50'			
26–P1	13+05.50	5409.85	24.50'			
27–P1	12+55.50	5408.23	24.50'			
7–P1 B11	12+74.50	5408.85	24.50'			
7–P1 B17	16+70.50	5421.65	24.50'			

WATER METER SERVICES – GPS AS-BUILT

LOT	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
1			
2			
3			
4			
5			
6			

SANITARY SEWER SERVICES

LOT	STATION AT ROW	INV. ELEV. AT ROW	LENGTH AT ROW	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
1	9+64.94	5401.05	29.00'			
2	10+24.05	5401.62	25.00'			
3	10+74.50	5402.96	24.50'			
4	11+24.50	5404.29	24.50'			
5–P1	11+74.50	5405.65	24.50'			
6–P1	12+24.50	5407.20	24.50'			

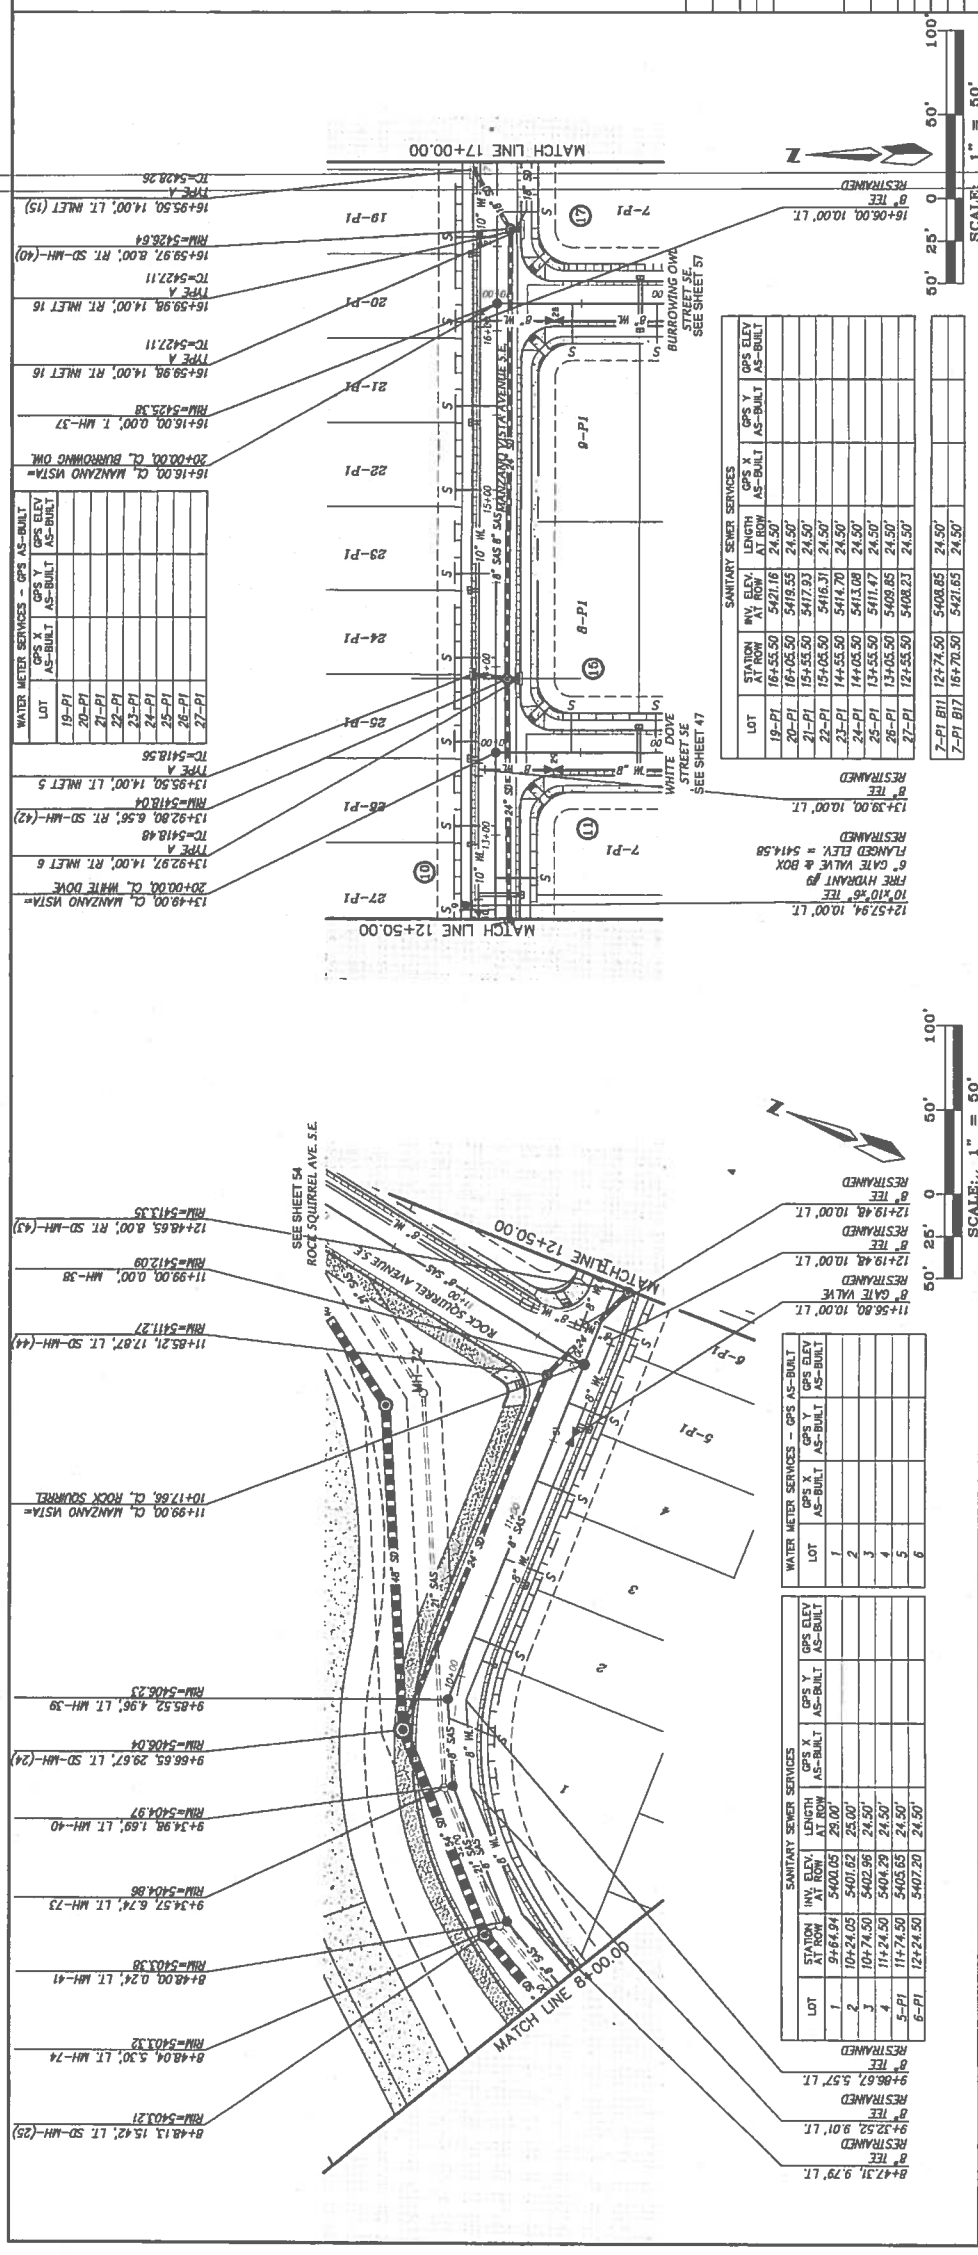

F:\ALL JOBS\ALL1039 JTH West - PRELIM PLANS\UTILITIES\COUGAR RUN CT. SS.dwg, 3/7/2017 4:13:18 PM, SPS

User ID: doug, Date/Time: 3/15/2017 4:37 PM, Document Name: 2017-03-15 HGL Profiles.pdf

NOTES

1. THIS PROJECT SITE LIES WITHIN THE 2NR ZONE FOR PADS BETWEEN ELEVATIONS 5065.7 AND 5142.7
2. ALL FIRE HYDRANTS ARE ABCWUA STD. DWG 2140 AND 4' BURY UNLESS OTHERWISE SPECIFIED.
3. ALL METER BOXES ADJACENT TO MOUNTABLE CURB SHALL HAVE DUCTILE IRON METER BOX COVER & LID PER ABCWUA STD. DWG 2368. WATER METER BOX PER ABCWUA STD. DWG #2366; WATER SERVICE PER ABCWUA STD. DWG #2362.
4. ALL FIRE HYDRANTS TO HAVE A 6" GATE VALVE & BOX PER ABCWUA STD. DWG #2329.
5. CONTRACTOR TO USE POLY COATED CMP FOR VALVE BOXES.
6. CONTRACTOR IS NOT TO INSTALL THE STEPS IN THE SAS MANHOLES.
7. ALL SANITARY SEWER MANHOLES PER ABCWUA STD. DWG #2101, #2107 AND #2108.
8. ALL WATER LINES SHALL BE C-900, DR-18, PVC.
9. ALL SEWER LINES SHALL BE SDR-35, PVC.
10. ALL GATE VALVES & VALVES BOXES PER DWG 2326.
11. ALL SEWER SERVICES PER DWG 2125.
12. ALL MAN HOLES SHALL BE PER DWG 2101 FOR TYPE C AND 2102 FOR TYPE E.
13. ALL WATER AND SEWER MAINS AND SERVICE LINES SHALL HAVE TRACER WIRE OVER THE TOP OF PIPE.

AS BUILT INFORMATION

CONTRACTOR

INSPECTOR'S ACCEPTANCE QTY — DATE

FIELD VERIFICATION BY — DATE

CORRECTED BY — DRAWINGS — DATE

MICRO-FILM INFORMATION

RECORDED BY — DATE

BENCH MARKS

STATION "S-422" IS LOCATED 8.7 MI. SE OF DOWNTOWN ALBUQUERQUE ON THE EAST SIDE OF THE MUNICIPAL LIMITS LINE IN THE FOUR HILLS SUBDIVISION AREA. STATION IS 600 FT. EAST OF MUNICIPAL LIMITS LINE. 77.9' SE OF POWER POLE #ES37 & 186.0' NW OF POWER POLE #60. STATION IS A STANDARD ACS BRASS DISK SET IN A CONCRETE MONUMENT IN THE GROUND. STATION IS STAMPED "S-422". X= 1,564,261.207, Y= 1,473,762.595, (NAD 83), Z= 5397.219 (NAVD 1988)

SURVEY INFORMATION

FIELD NOTES

NO.	BY	DATE

ENGINEER'S SEAL

JAMES D. HUGHES — NEW MEXICO — 14844 — REGISTERED PROFESSIONAL ENGINEER — 7-12-2017

NO.	REMARKS	BY	DATE

REVISIONS

DESIGN

DESIGNED BY	JDH	DATE 02/17
DRAWN BY	SPS	DATE 02/17
CHECKED BY	DMG	DATE 02/17

CERTIFICATE OF SUBSTANTIAL COMPLIANCE

dmg — MARK GOODWIN & ASSOCIATES, P.A. CONSULTING ENGINEERS, P.O. BOX 90606, ALBUQUERQUE, NEW MEXICO 87199, OFFICE (505) 828-2200, FAX (505) 797-9539

CITY OF ALBUQUERQUE
PUBLIC WORKS DEPARTMENT

TITLE: JUAN TABO HILLS ESTATES
DUKE CITY STREET S.E.
UTILITY PLAN & PROFILE

DESIGN REVIEW COMMITTEE | CITY ENGINEER APPROVAL | LAST DESIGN UPDATE | MO./DAY/YR. | MO./DAY/YR.

CITY PROJECT NO. 654887 | ZONE MAP NO. M-21 | SHEET 55 OF 75

FIRE HYDRANT – GPS AS-BUILT

FIRE HYDRANT #	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT

GATE VALVE – GPS AS-BUILT

GATE VALVE #	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
14			
24			

WATER METER SERVICES – GPS AS-BUILT

LOT	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
1–P1			
2–P1			
3–P1			
4–P1			
5–P1			
6–P1			
7–P1			

WATER METER SERVICES – GPS AS-BUILT

LOT	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
8–P1			
9–P1			

BLOCK 7 SANITARY SEWER SERVICES

LOT	STATION AT ROW	INV. ELEV. AT ROW	LENGTH AT ROW	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
1–P1	15+42.28	5429.85	24.50'			
2–P1	16+02.28	5429.79	24.50'			
3–P1	16+62.28	5431.48	24.50'			
4–P1	17+22.28	5432.75	24.50'			
5–P1	17+82.28	5433.95	24.50'			
6–P1	18+42.28	5435.15	24.50'			
7–P1	19+02.28	5436.40	24.50'			

BLOCK 18 SANITARY SEWER SERVICES

LOT	STATION AT ROW	INV. ELEV. AT ROW	LENGTH AT ROW	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
8–P1	20+94.50	5439.70	23.50'			
9–P1	20+44.50	5439.10	23.50'			

BLOCK 17 SANITARY SEWER SERVICES

LOT	STATION AT ROW	INV. ELEV. AT ROW	LENGTH AT ROW	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
14–P1	20+46.50	5438.67	23.50'			
15–P1	20+96.50	5439.67	23.50'			

BLOCK 8 SANITARY SEWER SERVICES

LOT	STATION AT ROW	INV. ELEV. AT ROW	LENGTH AT ROW	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
1–P1	15+42.28	5428.76	24.50'			
2–P1	16+02.28	5429.77	24.50'			
3–P1	16+62.28	5431.48	24.50'			
4–P1	17+22.28	5432.75	24.50'			
5–P1	17+82.28	5433.95	24.50'			
6–P1	18+42.28	5435.15	24.50'			
7–P1	19+02.28	5436.35	24.50'			

BLOCK 3 SANITARY SEWER SERVICES

LOT	STATION AT ROW	INV. ELEV. AT ROW	LENGTH AT ROW	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
1–P1	9+57.37	5429.21	23.50'			
2–P1	9+75.62	5429.01	23.50'			
3–P1	10+44.50	5428.44	23.50'			
4–P1	11+04.50	5428.08	23.50'			
5–P1	11+64.50	5427.78	23.50'			
6–P1	12+24.50	5427.48	23.50'			
7–P1	12+84.50	5427.51	23.50'			
8–P1	13+48.50	5427.26	23.50'			

BLOCK 4 SANITARY SEWER SERVICES

LOT	STATION AT ROW	INV. ELEV. AT ROW	LENGTH AT ROW	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
1–P1	11+38.50	5427.91	23.50'			
2–P1	11+98.50	5427.61	23.50'			
3–P1	12+58.50	5427.64	23.50'			
4–P1	13+18.50	5427.34	23.50'			
5–P1	13+78.50	5427.43	23.50'			
6–P1	14+38.50	5428.78	23.50'			

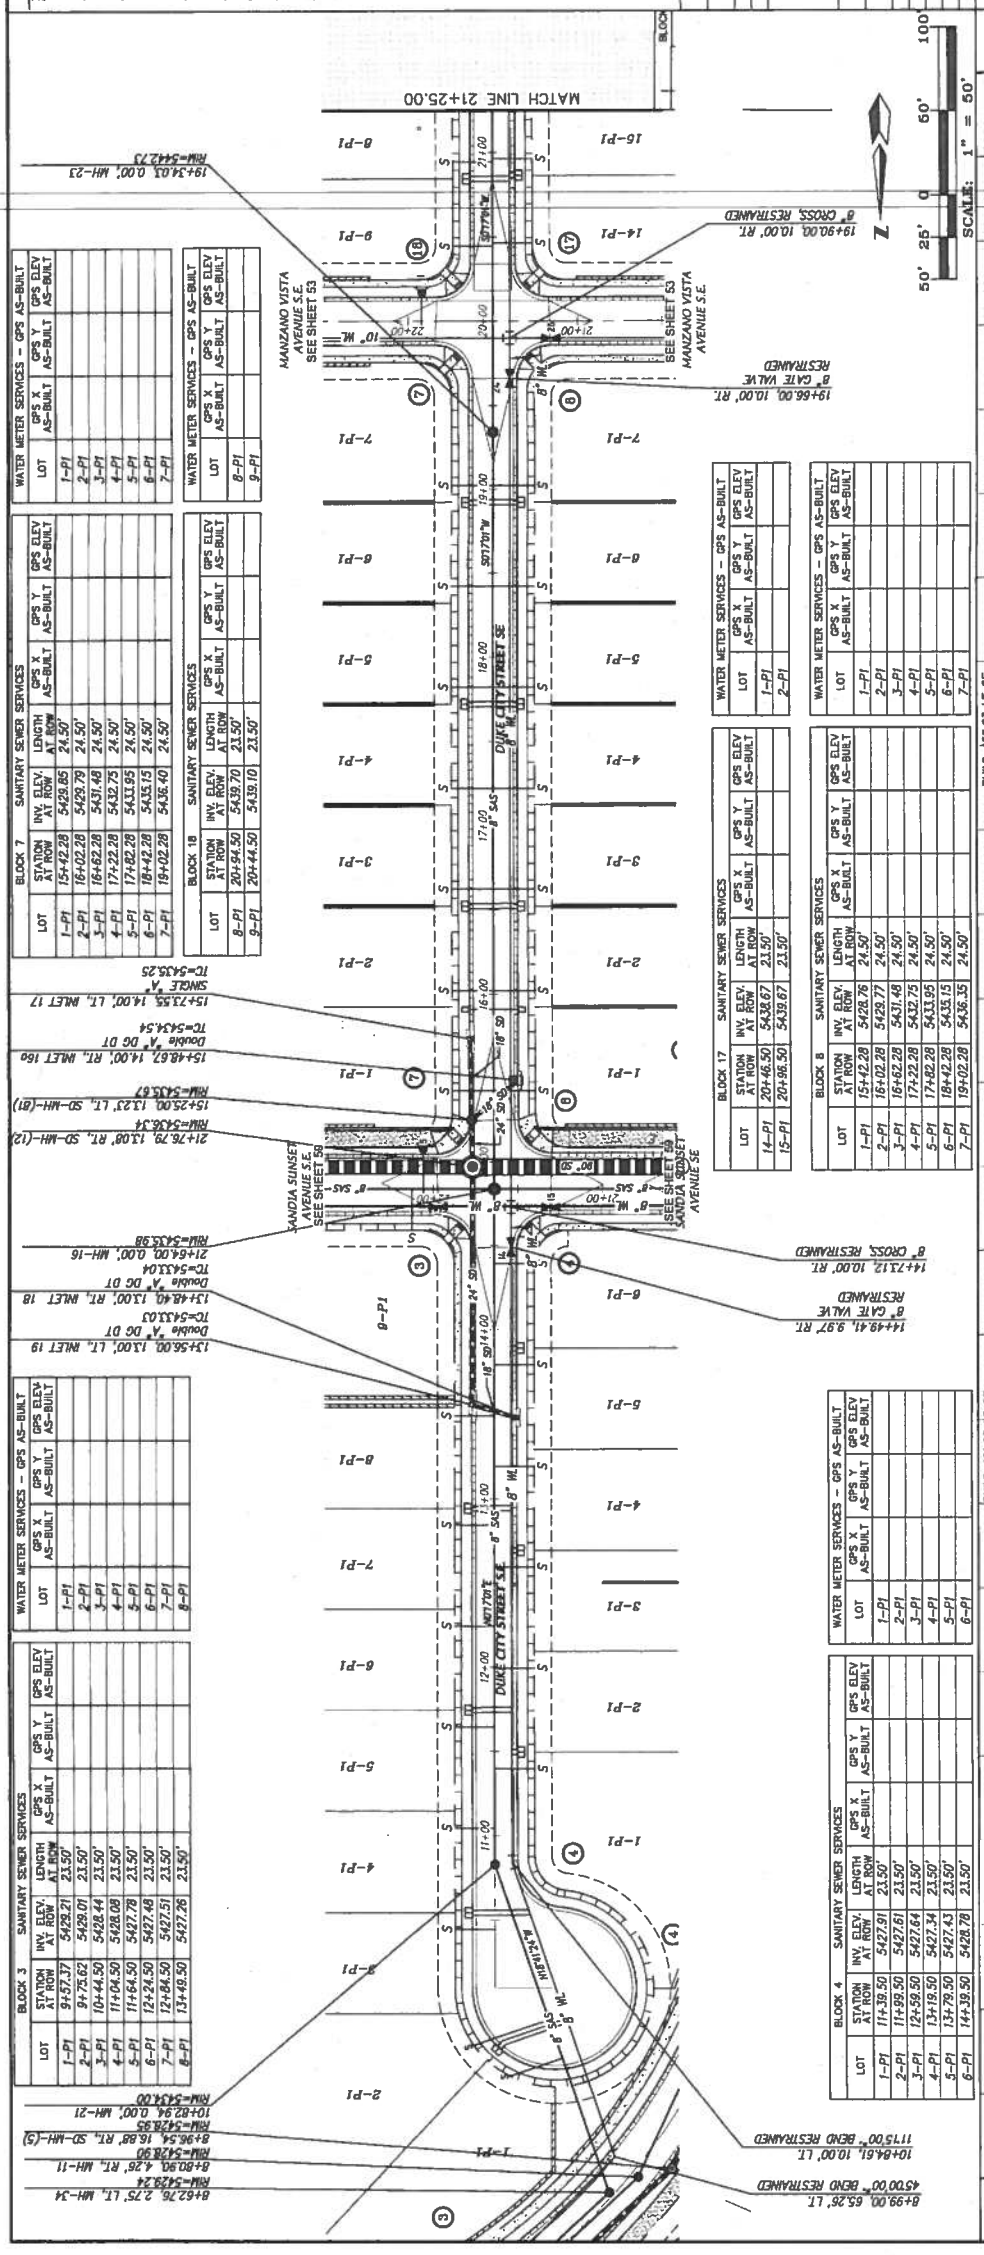

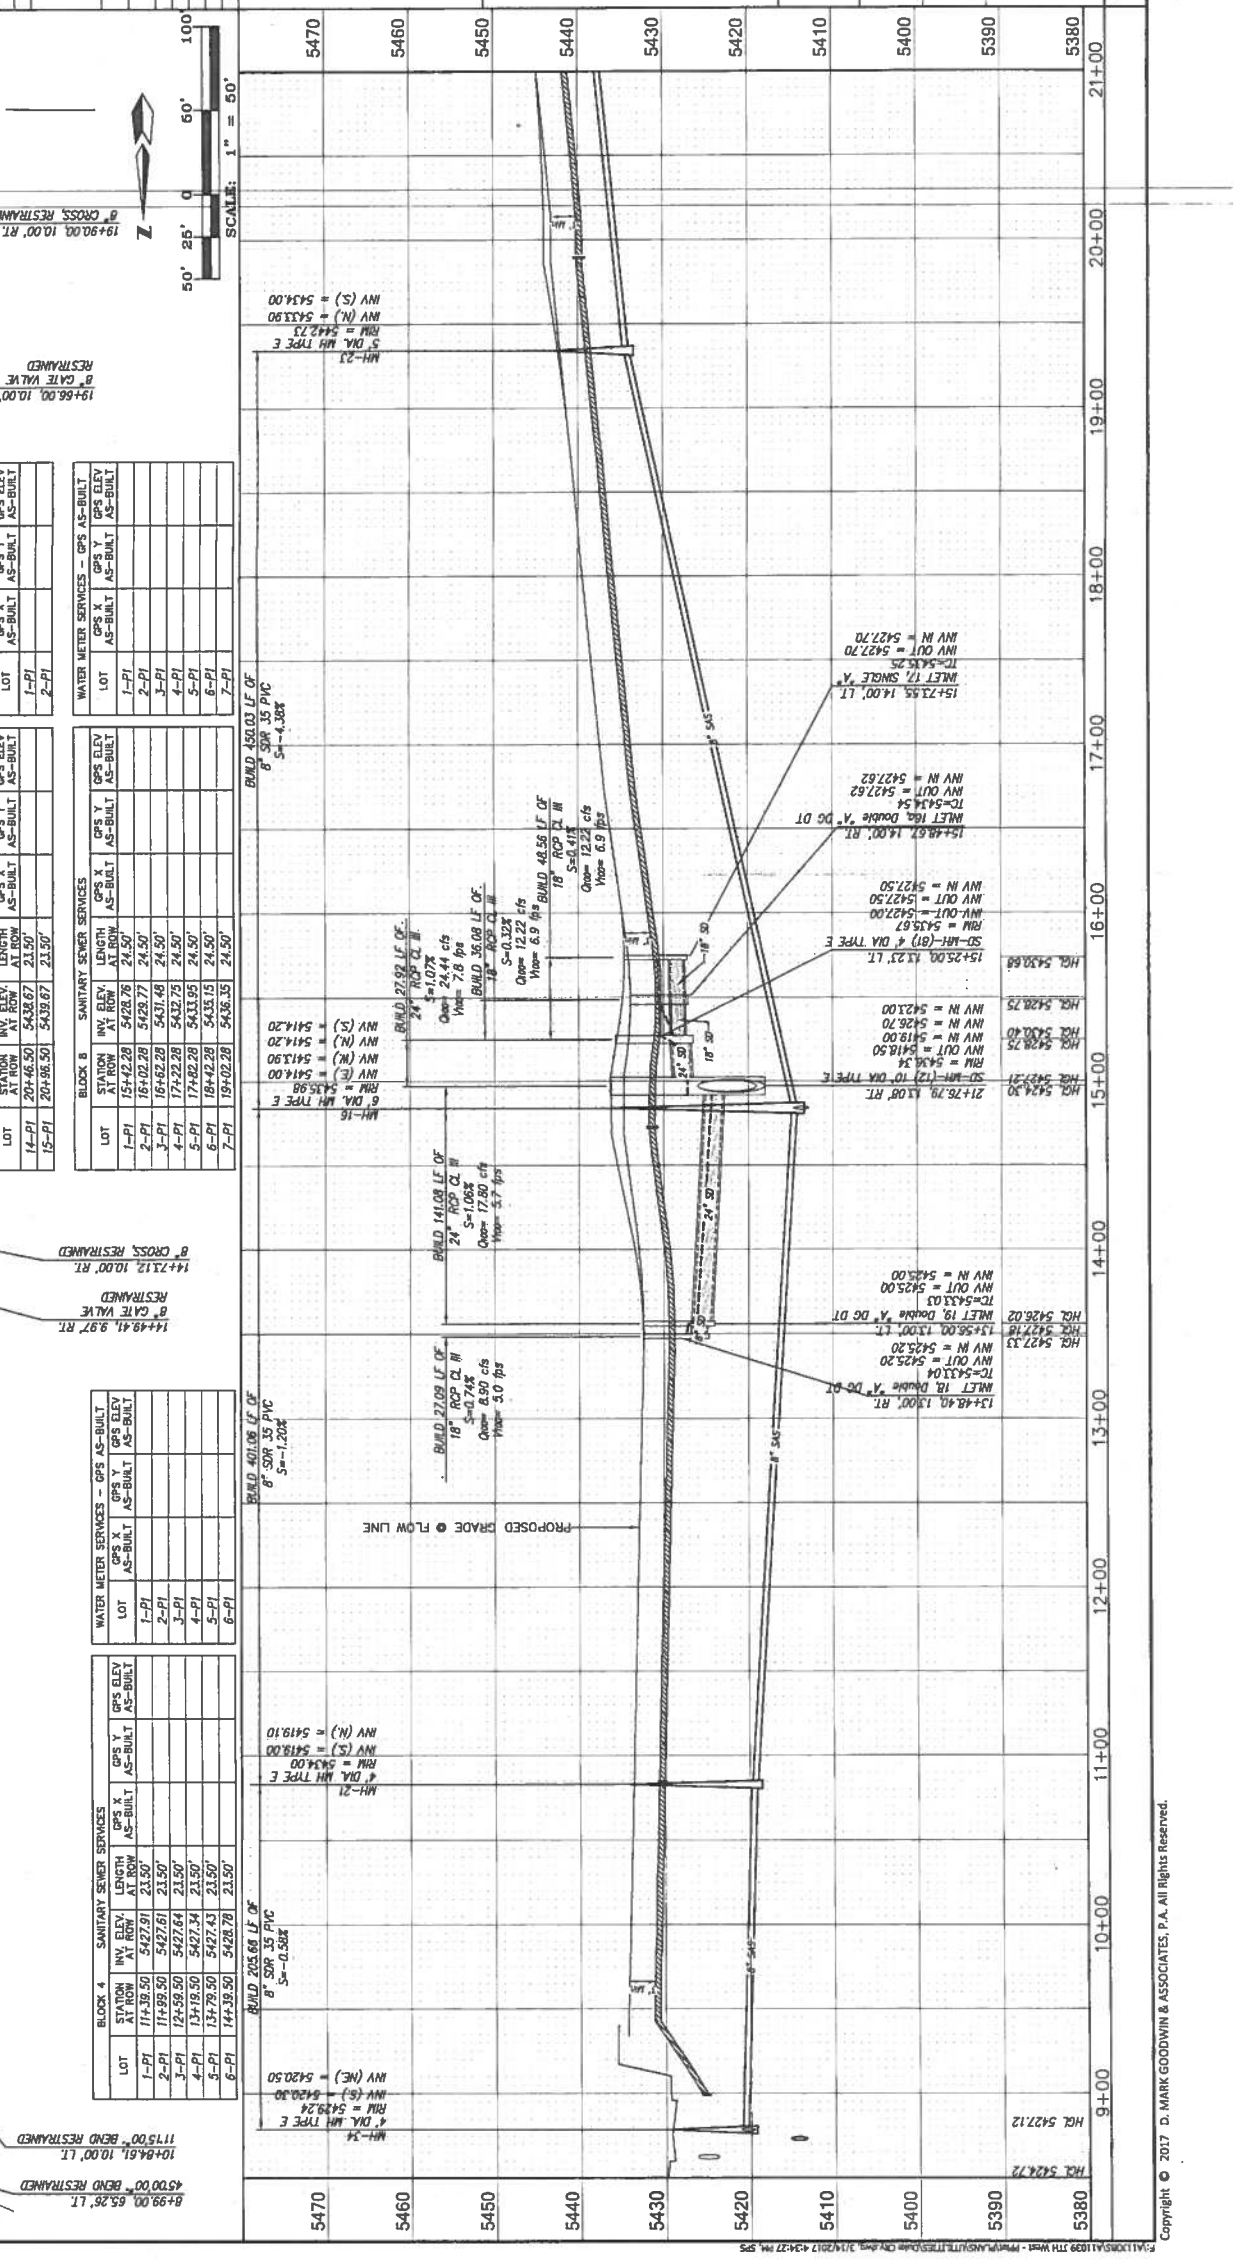

P:\ALLJOBS\A11099 7TH West - Phase\PLANS\UTILITIES\Duke Dwgs, 3/14/2017 4:34:27 PM, SPS

NOTES

1. THIS PROJECT SITE LIES WITHIN THE 2WP ZONE FOR PADS BETWEEN ELEVATIONS 5065.7 AND 5142.7
2. ALL FIRE HYDRANTS ARE ABCWUA STD. DWG 2340 AND 4' BURY UNLESS OTHERWISE SPECIFIED.
3. ALL METER BOXES ADJACENT TO MOUNTABLE CURB SHALL HAVE DUCTILE IRON METER BOX COVER & LID PER ABCWUA STD. DWG 2368. WATER METER BOX PER ABCWUA STD. DWG #2366. WATER SERVICE PER ABCWUA STD. DWG #2362.
4. ALL FIRE HYDRANTS TO HAVE A 6" GATE VALVE & BOX PER ABCWUA STD. DWG #2128.
5. CONTRACTOR TO USE POLY COATED CMP FOR VALVE BOXES.
6. CONTRACTOR IS NOT TO INSTALL THE STEPS IN THE SAS MANHOLES.
7. ALL SANITARY SEWER MANHOLES PER ABCWUA STD. DWG #2101, #2107 AND #2109.
8. ALL WATER LINES SHALL BE C-900, DR-18, PVC.
9. ALL SEWER LINES SHALL BE SDR-35, PVC.
10. ALL GATE VALVES & VALVES BOXES PER DWG 2126.
11. ALL SEWER SERVICES PER DWG 2125.
12. ALL MAN HOLES SHALL BE PER DWG 2101 FOR TYPE C AND 2102 FOR TYPE E
13. ALL WATER AND SEWER MAINS AND SERVICE LINES SHALL HAVE TRACER WIRE OVER THE TOP OF PIPE.

FIRE HYDRANT #	FIRE HYDRANT – GPS AS-BUILT GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
10			
11			

GATE VALVE #	GATE VALVE – GPS AS-BUILT GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
17			
18			
20			
22			
23			

AS BUILT INFORMATION

CONTRACTOR

STAMPED BY / MARK — DATE

INSPECTOR'S ACCEPTANCE BY — DATE

FIELD VERIFICATION BY — DATE

CHANGES CORRECTED BY — DATE

MICRO-FILM INFORMATION

RECORDED BY — DATE

BENCH MARKS

STATION "S-422" IS LOCATED 8.7 MI. SE OF DOWNTOWN ALBUQUERQUE

ON THE EAST SIDE OF THE MUNICIPAL LIMITS LINE IN THE FOUR HILLS SUBDIVISION AREA. STATION IS 600 FT. EAST OF MUNICIPAL LIMITS LINE.

77.9' SE OF POWER POLE #637 & 186.0' NW OF POWER POLE #60. STATION IS A STANDARD ACS BRASS DISK SET IN A CONCRETE MONUMENT IN THE GROUND. STATION IS STAMPED "S-422".

X= 1,564,261.207, Y= 1,475,762.593, (NAD 83), Z= 5597.219 (NAVD 1988).

FIELD NOTES

NO.	BY	DATE

SURVEY INFORMATION

ENGINEER'S SEAL

4-15-2017

NO.	REMARKS	DATE	BY

REVISIONS

DESIGNED BY	JDH	02/17
DRAWN BY	SPS	02/17
CHECKED BY	DMG	02/17

DESIGN — DATE

dmg
MARK GOODWIN & ASSOCIATES, P.A.
CONSULTING ENGINEERS
P.O. BOX 90606
ALBUQUERQUE, NEW MEXICO 87199
OFFICE (505) 828-2200, FAX (505) 797-9539

CERTIFICATE OF SUBSTANTIAL COMPLIANCE

CITY OF ALBUQUERQUE
PUBLIC WORKS DEPARTMENT

TITLE: JUAN TABO HILLS ESTATES
SANDIA SUNSET AVE SE
UTILITY PLAN & PROFILE

LAST DESIGN UPDATE — MO./DAY/YR.

DESIGN REVIEW COMMITTEE — CITY ENGINEER APPROVAL — MO./DAY/YR.

CITY PROJECT NO. 654887 — ZONE MAP NO. M-21 — SHEET 58 OF 75

WATER METER SERVICES – GPS AS-BUILT LOT	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
6-P1			
7-P1			
8-P1			
9-P1			

SANITARY SEWER SERVICES LOT	STATION AT ROW	INV. ELEV. AT ROW	LENGTH AT ROW	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
10-P1			21.50'			
11-P1			21.50'			
12-P1			21.50'			
13-P1			21.50'			
14-P1			21.50'			
15-P1			21.50'			
16-P1			21.50'			

SCALE: 1" = 100'

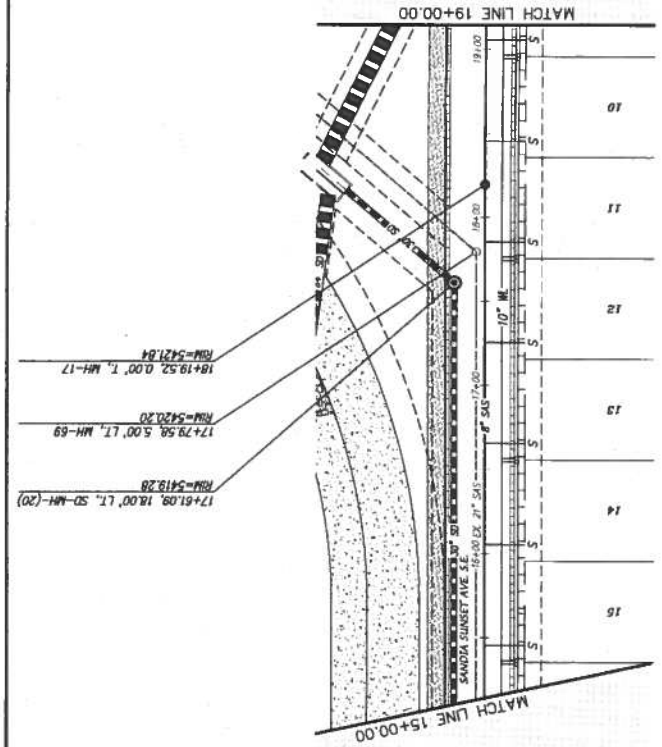

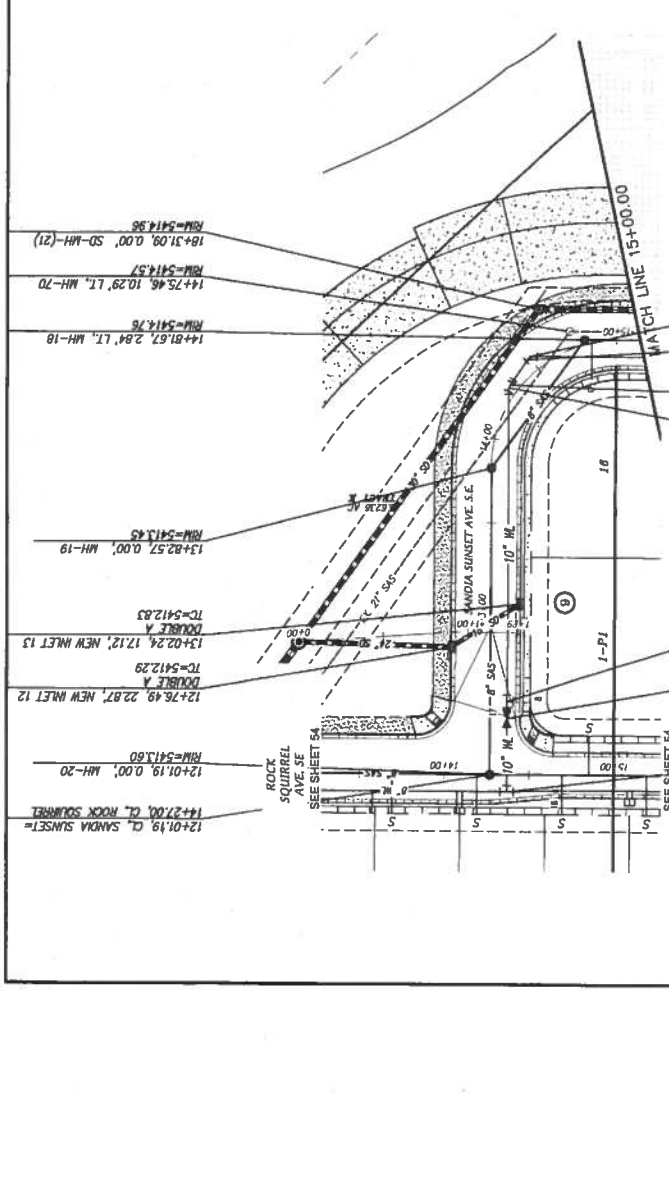

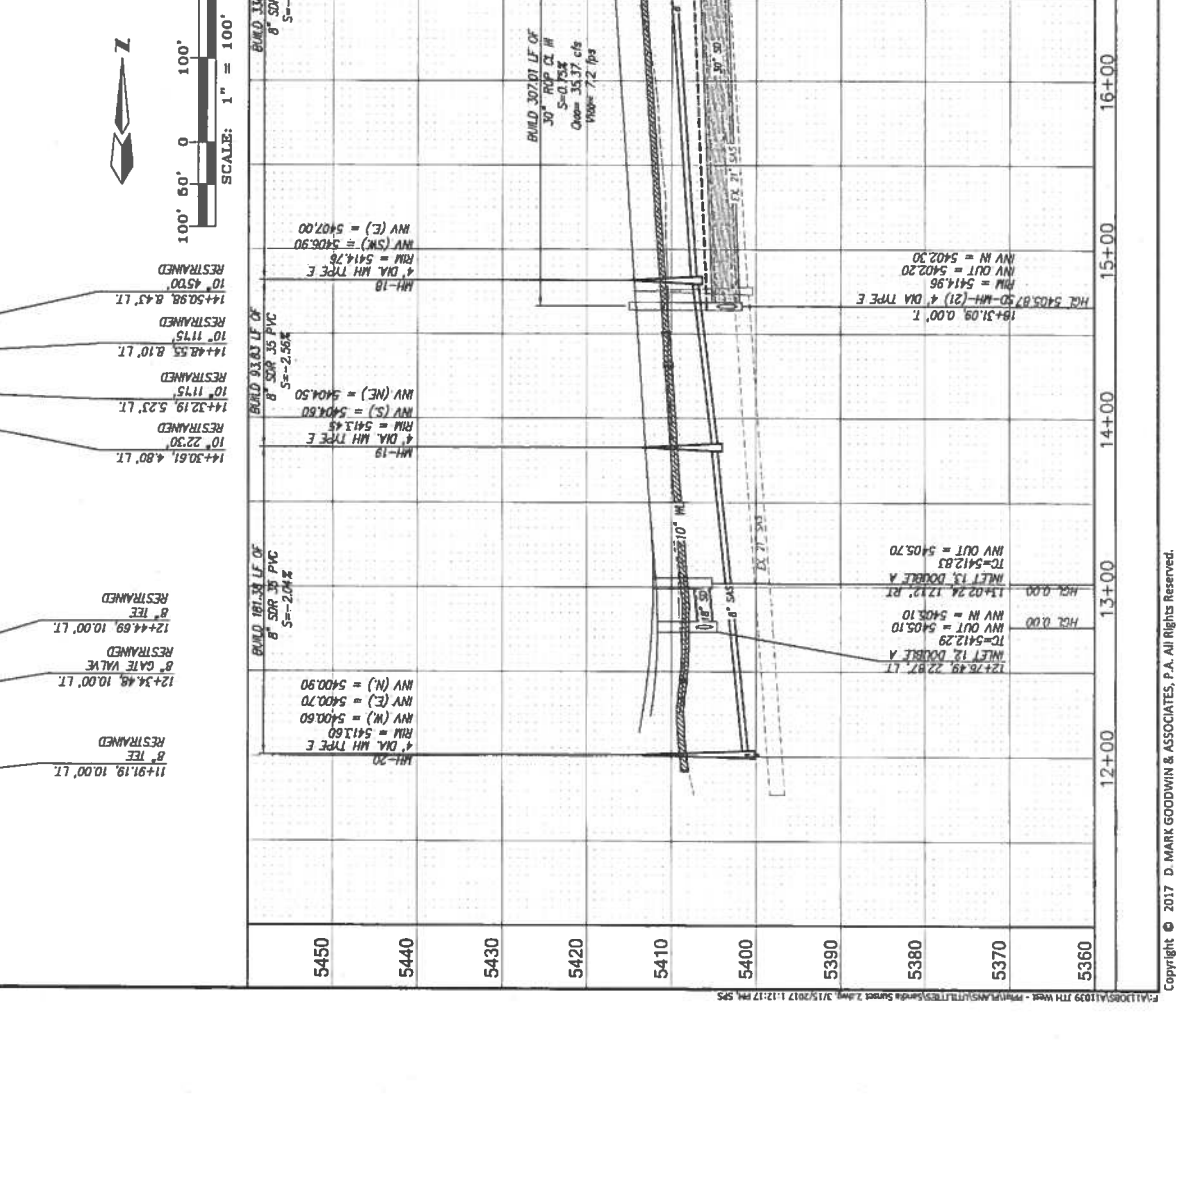

NOTES

1. THIS PROJECT SITE LIES WITHIN THE 2MR ZONE FOR PADS BETWEEN ELEVATIONS 5063.7 AND 5142.7
2. ALL FIRE HYDRANTS ARE ABCWUA STD. DWG 2340 AND 4' BURY UNLESS OTHERWISE SPECIFIED.
3. ALL METER BOXES ADJACENT TO MOUNTABLE CURB SHALL HAVE DUCTILE IRON METER BOX COVER & LID PER ABCWUA STD. DWG 2366. WATER METER BOX PER ABCWUA STD. DWG #2366. WATER SERVICE PER ABCWUA STD. DWG #2362.
4. ALL FIRE HYDRANTS TO HAVE A 6" GATE VALVE & BOX PER ABCWUA STD. DWG #2126.
5. CONTRACTOR TO USE POLY COATED CMP FOR VALVE BOXES.
6. CONTRACTOR IS NOT TO INSTALL THE STEPS IN THE SAS MANHOLES.
7. ALL SANITARY SEWER MANHOLES PER ABCWUA STD. DWG #2101, #2107 AND #2109.
8. ALL WATER LINES SHALL BE C-900, DR-18, PVC.
9. ALL SEWER LINES SHALL BE SDR-35, PVC.
10. ALL GATE VALVES & VALVES BOXES PER DWG 2336.
11. ALL SEWER SERVICES PER DWG 2125.
12. ALL MAN HOLES SHALL BE PER DWG 2101 FOR TYPE C AND 2102 FOR TYPE E
13. ALL WATER AND SEWER MAINS AND SERVICE LINES SHALL HAVE TRACER WIRE OVER THE TOP OF PIPE.

FIRE HYDRANT – GPS AS-BUILT

FIRE HYDRANT #	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
4			
5			
6			
7			

GATE VALVE – GPS AS-BUILT

GATE VALVE #	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
11			
13			
15			

SURVEY INFORMATION – FIELD NOTES

NO.	BY	DATE

ENGINEER'S SEAL

JAMES D. HUGHES, NEW MEXICO 14269, REGISTERED PROFESSIONAL ENGINEER
3-15-2017

NO.	REMARKS	DATE	BY

REVISIONS

DESIGNED BY	JDH	DATE	02/17
DRAWN BY	SPS	DATE	02/17
CHECKED BY	DMG	DATE	02/17

DESIGN

BENCH MARKS

RECORDED BY	DATE
X= 1,564,283.207, Y= 1,473,762.595, (NAD 83), Z= 5597.219 (NAVD 1988)	
MONUMENT IN THE GROUND. STATION IS STAMPED "S-422".	
STATION IS A STANDARD ACS BRASS DISK SET IN A CONCRETE	
77.9' SE OF POWER POLE #5237 & 186.0' NW OF POWER POLE #80.	
SUBDIVISION AREA STATION IS 600 FT. EAST OF MUNICIPAL LIMITS LINE.	
ON THE EAST SIDE OF THE MUNICIPAL LIMITS LINE IN THE FOUR HILLS	
STATION "S-422" IS LOCATED 8.7 MI. SE OF DOWNTOWN ALBUQUERQUE	

AS BUILT INFORMATION

CONTRACTOR

WORK STAKED BY — DATE

INSPECTOR'S ACCEPTANCE BY — DATE

FIELD VERIFICATION BY — DATE

DRAWINGS CORRECTED BY — DATE

MICRO-FILM INFORMATION

NO.

CERTIFICATE OF SUBSTANTIAL COMPLIANCE

dmg
MARK GOODWIN & ASSOCIATES, P.A.
CONSULTING ENGINEERS
P.O. BOX 90606
ALBUQUERQUE, NEW MEXICO 87199
OFFICE (505) 828-2200, FAX (505) 797-9539

CITY OF ALBUQUERQUE
PUBLIC WORKS DEPARTMENT

TITLE: JUAN TABO HILLS ESTATES
SANDIA SUNSET AVE SE
UTILITY PLAN & PROFILE

DESIGN REVIEW COMMITTEE	CITY ENGINEER APPROVAL	LAST DESIGN UPDATE	MO./DAY/YR.
			MO./DAY/YR.

CITY PROJECT NO. 654887 | ZONE MAP NO. M-21 | SHEET 59 OF 75

SCALE: 1" = 100' (100' 50' 0 100' 200')

SANITARY SEWER SERVICES

LOT	STATION AT ROW	INV. ELEV. AT ROW	LENGTH AT ROW	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
9–P1	22+12.50	5432.51	24.50'			
10–P1	22+89.50	5434.94	24.50'			
11–P1	23+38.50	5436.52	24.50'			
12–P1	23+89.50	5438.09	24.50'			
13–P1	24+39.50	5439.55	24.50'			
14–P1	24+89.50	5440.86	24.50'			
15–P1	25+39.50	5442.37	24.50'			
16–P1	25+89.50	5443.85	24.50'			
17–P1	26+39.50	5444.82	24.50'			
18–P1	26+89.50	5445.63	24.50'			
19–P1	27+39.50	5445.87	24.50'			
20–P1	27+89.50	5445.59	24.50'			

WATER METER SERVICES – GPS AS-BUILT

LOT	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
9–P1			
10–P1			
11–P1			
12–P1			
13–P1			
14–P1			
15–P1			
16–P1			
17–P1			
18–P1			
19–P1			
20–P1			

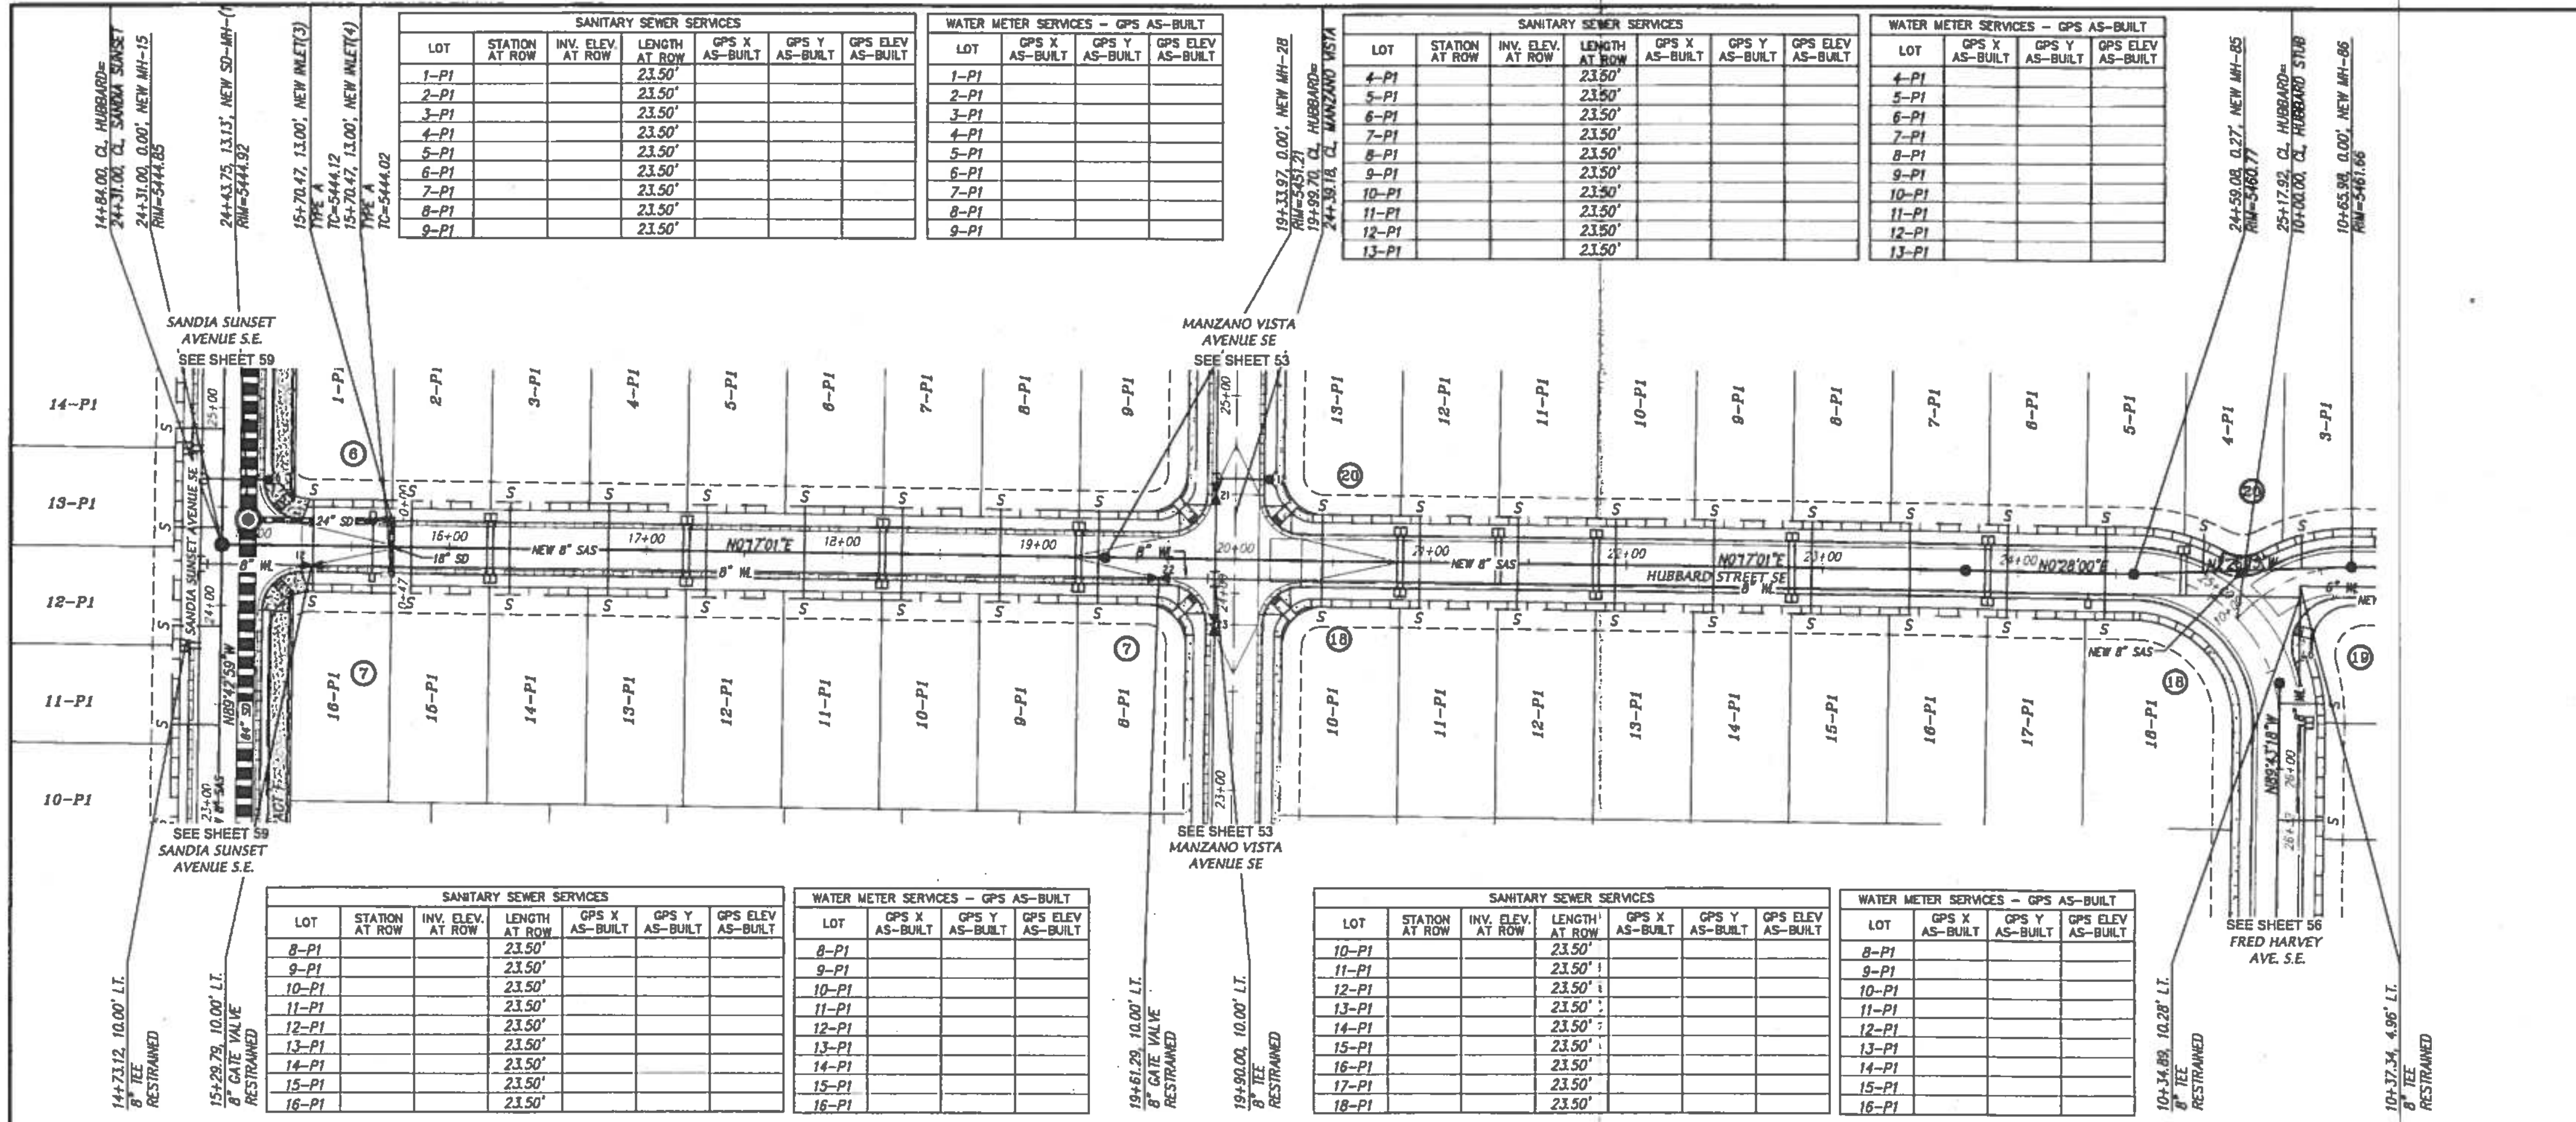
10-P1
11-P1
12-P1
13-P1
14-P1
14+73.12, 10.00' LT.
8" TEE
RESTRAINED
15+29.79, 10.00' LT.
8" GATE VALVE
RESTRAINED
SEE SHEET 59
SANDIA SUNSET
AVENUE S.E.
SANDIA SUNSET AVENUE SE
N89°42'59"W
84" SD
SANDIA SUNSET
AVENUE S.E.
SEE SHEET 59
14+84.00, CL, HUBBARD=
24+31.00, CL, SANDIA SUNSET
24+31.00, 0.00', NEW MH-15
RIM=5444.85
24+43.75, 13.13', NEW SD-MH-(11)
RIM=5444.92
15+70.47, 13.00', NEW INLET(3)
TYPE A
TC=5444.12
15+70.47, 13.00', NEW INLET(4)
TYPE A
TC=5444.02
16-P1
15-P1
14-P1
13-P1
12-P1
11-P1
10-P1
9-P1
8-P1
1-P1
2-P1
3-P1
4-P1
5-P1
6-P1
7-P1
8-P1
9-P1
24" SD
18" SD
NEW 8" SAS
8" WL
N01°17'01"E
16+00
17+00
18+00
19+00
19+61.29, 10.00' LT.
8" GATE VALVE
RESTRAINED
19+90.00, 10.00' LT.
8" TEE
RESTRAINED
SEE SHEET 53
MANZANO VISTA
AVENUE SE
MANZANO VISTA
AVENUE SE
SEE SHEET 53
19+33.97, 0.00', NEW MH-28
RIM=5451.21
19+99.70, CL, HUBBARD=
24+39.18, CL, MANZANO VISTA
10-P1
11-P1
12-P1
13-P1
14-P1
15-P1
16-P1
17-P1
18-P1
13-P1
12-P1
11-P1
10-P1
9-P1
8-P1
7-P1
6-P1
5-P1
4-P1
3-P1
HUBBARD STREET SE
N01°17'01"E
N01°28'00"E
21+00
22+00
23+00
24+00
10+34.89, 10.28' LT.
8" TEE
RESTRAINED
SEE SHEET 56
FRED HARVEY
AVE. S.E.
N89°43'18"W
26+00
10+37.34, 4.96' LT.
8" TEE
RESTRAINED
24+59.08, 0.27', NEW MH-85
RIM=5460.77
25+17.92, CL, HUBBARD=
10+00.00, CL, HUBBARD STUB
10+65.98, 0.00', NEW MH-86
RIM=5461.66

SANITARY SEWER SERVICES					
LOT	STATION AT ROW	INV. ELEV. AT ROW	LENGTH AT ROW	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
8-P1			23.50'			
9-P1			23.50'			
10-P1			23.50'			
11-P1			23.50'			
12-P1			23.50'			
13-P1			23.50'			
14-P1			23.50'			
15-P1			23.50'			
16-P1			23.50'			

WATER METER SERVICES - GPS AS-BUILT			
LOT	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
8-P1			
9-P1			
10-P1			
11-P1			
12-P1			
13-P1			
14-P1			
15-P1			
16-P1			

SANITARY SEWER SERVICES						
LOT	STATION AT ROW	INV. ELEV. AT ROW	LENGTH AT ROW	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
1-P1			23.50'			
2-P1			23.50'			
3-P1			23.50'			
4-P1			23.50'			
5-P1			23.50'			
6-P1			23.50'			
7-P1			23.50'			
8-P1			23.50'			
9-P1			23.50'			

WATER METER SERVICES - GPS AS-BUILT			
LOT	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
1-P1			
2-P1			
3-P1			
4-P1			
5-P1			
6-P1			
7-P1			
8-P1			
9-P1			

SANITARY SEWER SERVICES						
LOT	STATION AT ROW	INV. ELEV. AT ROW	LENGTH AT ROW	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
10-P1			23.50'			
11-P1			23.50'			
12-P1			23.50'			
13-P1			23.50'			
14-P1			23.50'			
15-P1			23.50'			
16-P1			23.50'			
17-P1			23.50'			
18-P1			23.50'			

WATER METER SERVICES - GPS AS-BUILT			
LOT	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
8-P1			
9-P1			
10-P1			
11-P1			
12-P1			
13-P1			
14-P1			
15-P1			
16-P1			

SANITARY SEWER SERVICES						
LOT	STATION AT ROW	INV. ELEV. AT ROW	LENGTH AT ROW	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
4-P1			23.60'			
5-P1			23.50'			
6-P1			23.50'			
7-P1			23.50'			
8-P1			23.50'			
9-P1			23.50'			
10-P1			23.50'			
11-P1			23.50'			
12-P1			23.50'			
13-P1			23.50'			

WATER METER SERVICES - GPS AS-BUILT			
LOT	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
4-P1			
5-P1			
6-P1			
7-P1			
8-P1			
9-P1			
10-P1			
11-P1			
12-P1			
13-P1			

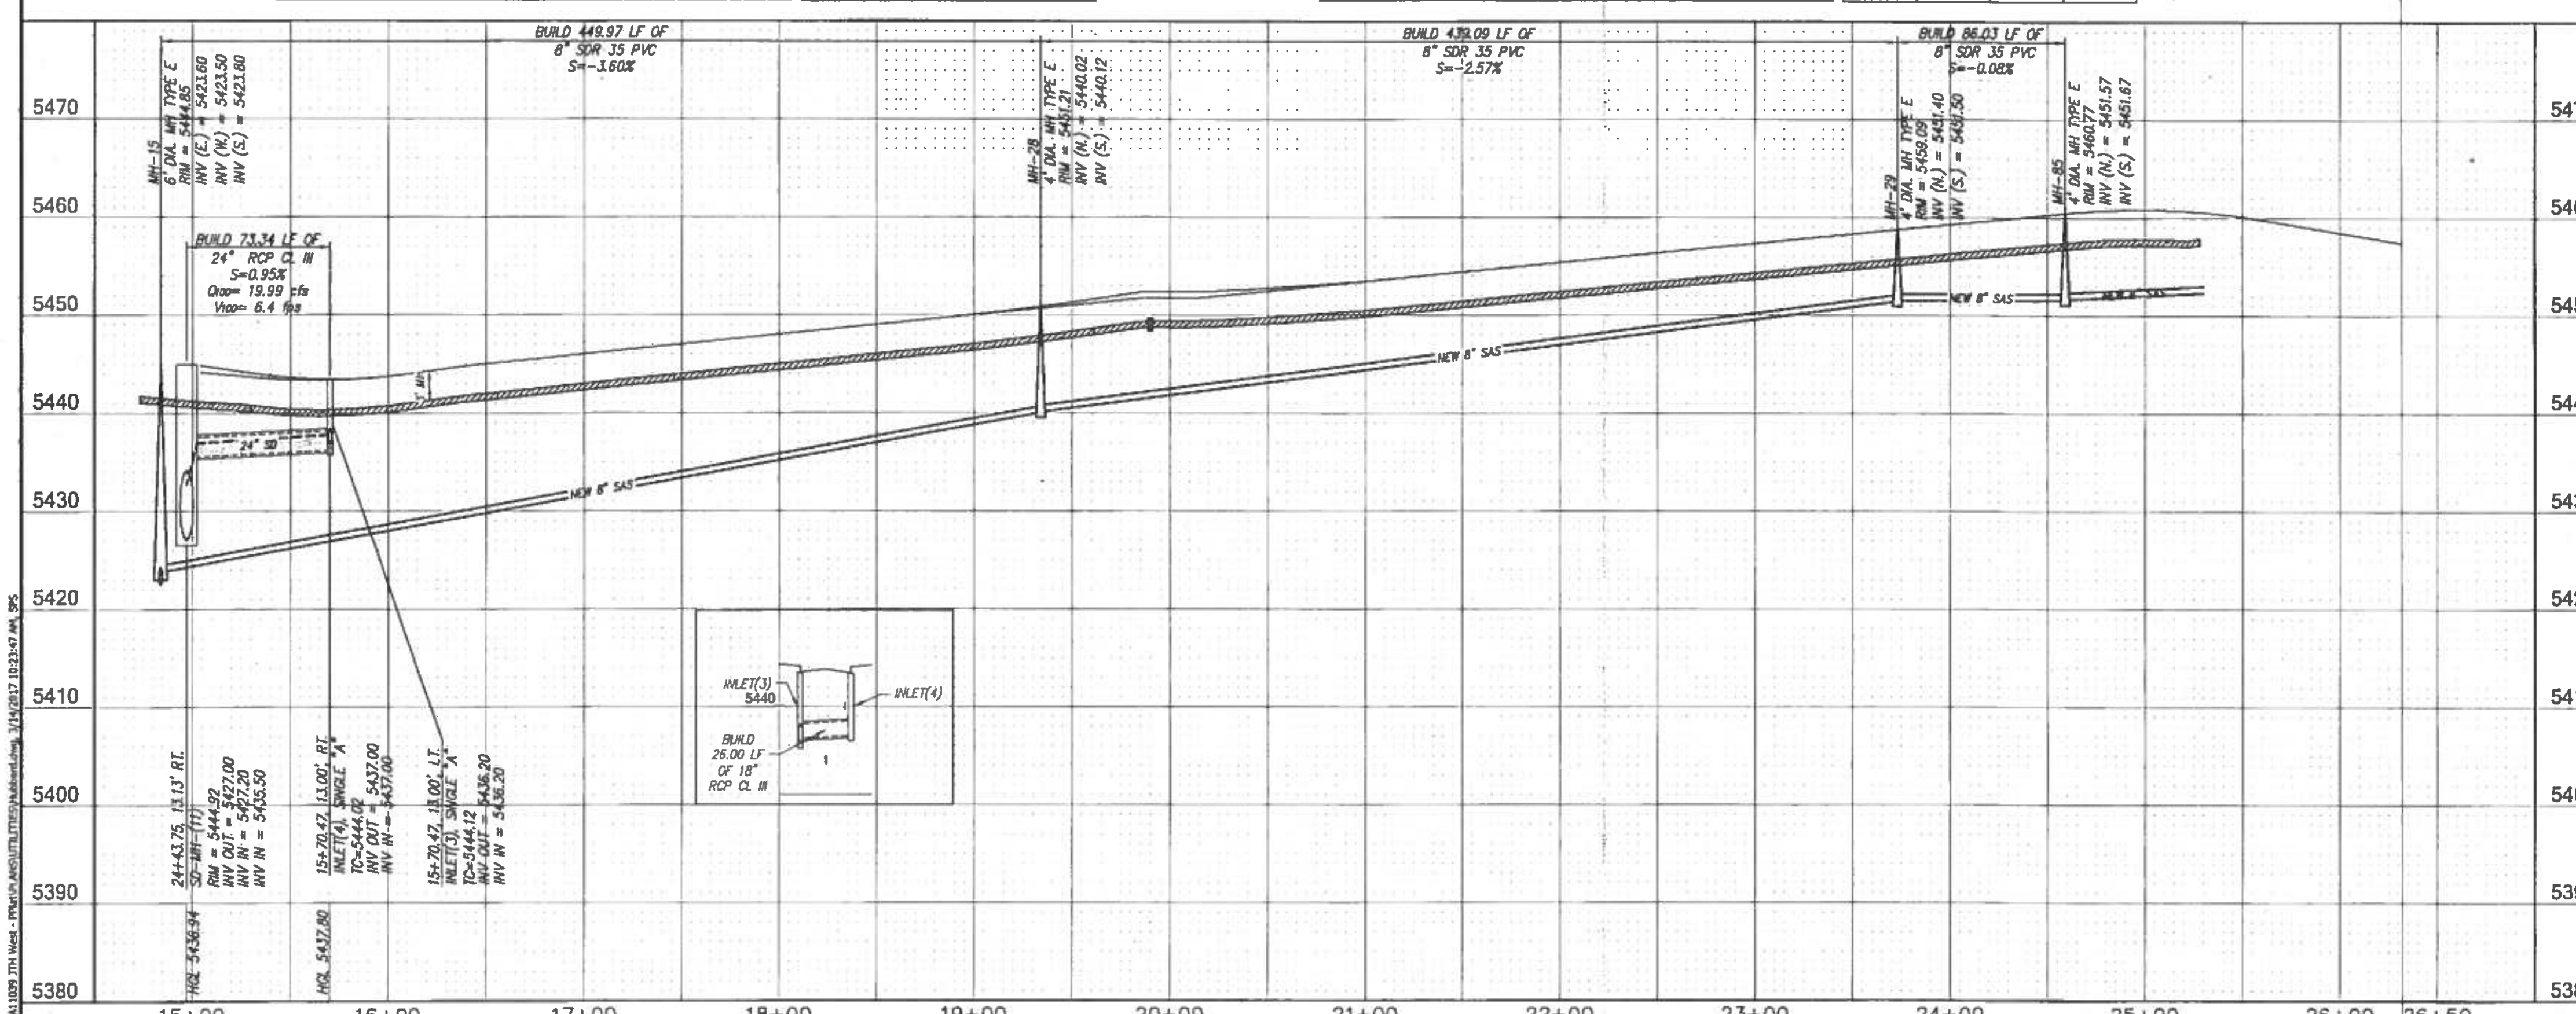
5380
5390
5400
5410
5420
5430
5440
5450
5460
5470
15+00
16+00
17+00
18+00
19+00
20+00
21+00
22+00
23+00
24+00
25+00
26+00
26+50
HGL 5436.94
24+43.75, 13.13' RT.
SD-MH-(11)
RIM = 5444.92
INV OUT = 5427.00
INV IN = 5427.20
INV IN = 5435.50
HGL 5437.80
15+70.47, 13.00', RT.
INLET(4), SINGLE "A"
TC=5444.02
INV OUT = 5437.00
INV IN = 5437.00
15+70.47, 13.00', LT.
INLET(3), SINGLE "A"
TC=5444.12
INV OUT = 5436.20
INV IN = 5436.20
BUILD 73.34 LF OF
24" RCP CL III
S=0.95%
Qcap= 19.99 cfs
Vcap= 6.4 fps
MH-15
6' DIA. MH TYPE E
RIM = 5444.85
INV (E.) = 5423.60
INV (W.) = 5423.50
INV (S.) = 5423.80
BUILD 449.97 LF OF
8" SDR 35 PVC
S=-3.60%
NEW 8" SAS
INLET(3)
5440
BUILD
26.00 LF
OF 18"
RCP CL III
INLET(4)
MH-28
4' DIA. MH TYPE E
RIM = 5451.21
INV (N.) = 5440.02
INV (S.) = 5440.12
BUILD 439.09 LF OF
8" SDR 35 PVC
S=-2.57%
MH-29
4' DIA. MH TYPE E
RIM = 5459.09
INV (N.) = 5451.40
INV (S.) = 5451.50
BUILD 86.03 LF OF
8" SDR 35 PVC
S=-0.08%
MH-85
4' DIA. MH TYPE E
RIM = 5460.77
INV (N.) = 5451.57
INV (S.) = 5451.67

NOTES

1. THIS PROJECT SITE LIES WITHIN THE 2WR ZONE FOR PADS BETWEEN ELEVATIONS 5065.7 AND 5142.7
2. ALL FIRE HYDRANTS ARE ABCWUA STD. DWG 2340 AND 4' BURY UNLESS OTHERWISE SPECIFIED.
3. ALL METER BOXES ADJACENT TO MOUNTABLE CURB SHALL HAVE DUCTILE IRON METER BOX COVER & LID PER ABCWUA STD. DWG 2366. WATER METER BOX PER ABCWUA STD. DWG #2366; WATER SERVICE PER ABCWUA STD. DWG #2362.
4. ALL FIRE HYDRANTS TO HAVE A 6" GATE VALVE & BOX PER ABCWUA STD. DWG #2326.
5. CONTRACTOR TO USE POLY COATED CAP FOR VALVE BOXES.
6. CONTRACTOR IS NOT TO INSTALL THE STEPS IN THE SAS MANHOLES
7. ALL SANITARY SEWER MANHOLES PER ABCWUA STD. DWG #2101, #2107 AND #2105.
8. ALL WATER LINES SHALL BE C-900, DR-18, PVC.
9. ALL SEWER LINES SHALL BE SDR-35, PVC.
10. ALL GATE VALVES & VALVES BOXES PER DWG 2326.
11. ALL SEWER SERVICES PER DWG 2125.
12. ALL MAN HOLES SHALL BE PER DWG 2101 FOR TYPE C AND 2102 FOR TYPE E.
13. ALL WATER AND SEWER MAINS AND SERVICE LINES SHALL HAVE TRACER WIRE OVER THE TOP OF PIPE.

SCALE: 1" = 50'
50' 25' 0 50' 100'

FIRE HYDRANT - GPS AS-BUILT			
FIRE HYDRANT #	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
10			
11			

GATE VALVE - GPS AS-BUILT			
GATE VALVE #	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
17			
18			
20			
22			
23			

CERTIFICATE OF SUBSTANTIAL COMPLIANCE

SURVEY INFORMATION		
FIELD NOTES		
NO.	BY	DATE

BENCH MARKS

STATION "5-M22" IS LOCATED 8.7 MI. SE OF DOWNTOWN ALBUQUERQUE ON THE EAST SIDE OF THE MUNICIPAL LIMITS LINE IN THE FOUR HILLS SUBDIVISION AREA. STATION IS 600 FT. EAST OF MUNICIPAL LIMITS LINE, 77.9' SE OF POWER POLE #SE37 & 186.0' NW OF POWER POLE #60. STATION IS A STANDARD ACS BRASS DISK SET IN A CONCRETE MONUMENT IN THE GROUND. STATION IS STAMPED "5-M22". X= 1,564,263.207, Y= 1,475,762.595, (NAD 83), Z= 5597.219 (NAVD 1988)

AS BUILT INFORMATION	
CONTRACTOR	
WORK STAKED BY	DATE
INSPECTOR'S ACCEPTANCE BY	DATE
FIELD VERIFICATION BY	DATE
DRAWINGS CORRECTED BY	DATE
MICRO-FILM INFORMATION	
RECORDED BY	DATE
NO.	

ENGINEER'S SEAL

JAMES D. HUGHES — NEW MEXICO — REGISTERED PROFESSIONAL ENGINEER — 3-17-2017

NO.	DATE	REMARKS	BY
		REVISIONS	
		DESIGN	
DESIGNED BY	JDH	DATE	02/17
DRAWN BY	SPS	DATE	02/17
CHECKED BY	DMG	DATE	02/17

dmg MARK GOODWIN & ASSOCIATES, P.A.
CONSULTING ENGINEERS
P.O. BOX 90606
ALBUQUERQUE, NEW MEXICO 87199
OFFICE (505) 828-2200, FAX (505) 797-9539

CITY OF ALBUQUERQUE
PUBLIC WORKS DEPARTMENT

TITLE:
JUAN TABO HILLS ESTATES
HUBBARD STREET S.E.
UTILITY PLAN & PROFILE

DESIGN REVIEW COMMITTEE	CITY ENGINEER APPROVAL	MO./DAY/YR.	MO./DAY/YR.

LAST DESIGN UPDATE

CITY PROJECT NO. 654887 | ZONE MAP NO. M-21 | SHEET 60 OF 75

NOTES

1. DMS PROJECT SITE LIES WITHIN THE 2NM ZONE FOR PADS BETWEEN ELEVATIONS 5065.7 AND 5142.7
2. ALL FIRE HYDRANTS ARE ABCWUA STD. DWG 2340 AND 4' BURY UNLESS OTHERWISE SPECIFIED.
3. ALL METER BOXES ADJACENT TO MOUNTABLE CURB SHALL HAVE DUCTILE IRON METER BOX COVER & LID PER ABCWUA STD. DWG 2366; WATER METER BOX PER ABCWUA STD. DWG #2366; WATER SERVICE PER ABCWUA STD. DWG #2362.
4. ALL FIRE HYDRANTS TO HAVE A 6" GATE VALVE & BOX PER ABCWUA STD. DWG #2326.
5. CONTRACTOR TO USE POLY COATED CAP FOR VALVE BOXES.
6. CONTRACTOR IS NOT TO INSTALL THE STEPS IN THE SAS MANHOLES.
7. ALL SANITARY SEWER MANHOLES PER ABCWUA STD. DWG #2101, #2107 AND #2109.
8. ALL WATER LINES SHALL BE C-900, DR-18, PVC.
9. ALL SEWER LINES SHALL BE SDR-35, PVC.
10. ALL GATE VALVES & VALVES BOXES PER DWG 2326.
11. ALL SEWER SERVICES PER DWG 2125.
12. ALL MAN HOLES SHALL BE PER DWG 2101 FOR TYPE C AND 2102 FOR TYPE E.
13. ALL WATER AND SEWER MAINS AND SERVICE LINES SHALL HAVE TRACER WIRE OVER THE TOP OF PIPE.

AS BUILT INFORMATION

CONTRACTOR

INSPECTOR'S MARK	DATE
ON THE EAST SIDE OF THE MUNICIPAL LIMITS LINE IN THE FOUR HILLS	
SUBDIVISION AREA. STATION IS 600 FT. EAST OF MUNICIPAL LIMITS LINE.	
779', SE OF POWER POLE #5237 & 186.0', NW OF POWER POLE #60.	
STATION IS A STANDARD ACS BRASS DISK SET IN A CONCRETE	
MONUMENT IN THE GROUND. STATION IS STAMPED "S-422".	
X= 1,564,261.207, Y= 1,475,762.585, (NAD 83) Z= 5597.219 (NAVD 1988)	

MICRO-FILM INFORMATION

NO.	RECORDED BY	DATE

BENCH MARKS

STATION "S-422" IS LOCATED 6.7 MI. SE OF DOWNTOWN ALBUQUERQUE

FIELD NOTES

NO	BY	DATE

SURVEY INFORMATION

FIRE HYDRANT – GPS AS-BUILT

FIRE HYDRANT #	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT

GATE VALVE – GPS AS-BUILT

GATE VALVE #	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT

ENGINEER'S SEAL

JAMES D. HUGHES — NEW MEXICO — REGISTERED PROFESSIONAL ENGINEER — 14729 — 3/17/17

NO.	DATE	REMARKS	BY

REVISIONS

DESIGN			
DESIGNED BY	JDH	DATE	02/17
DRAWN BY	SPS	DATE	02/17
CHECKED BY	DMG	DATE	02/17

CERTIFICATE OF SUBSTANTIAL COMPLIANCE

dmg
MARK GOODWIN & ASSOCIATES, P.A.
CONSULTING ENGINEERS
P.O. BOX 90606
ALBUQUERQUE, NEW MEXICO 87199
OFFICE (505) 828-2200, FAX (505) 797-9539

CITY OF ALBUQUERQUE
PUBLIC WORKS DEPARTMENT

TITLE: JUAN TABO HILLS ESTATES
HUBBARD STREET S.E.
UTILITY PLAN & PROFILE

DESIGN REVIEW COMMITTEE	CITY ENGINEER APPROVAL	LAST DESIGN UPDATE	MO./DAY/YR.

CITY PROJECT NO. 654887 | ZONE MAP NO. M-21 | SHEET 61 OF 75

SANITARY SEWER SERVICES

LOT	STATION AT ROW	INV. ELEV AT ROW	LENGTH AT ROW	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
1-P1		5457.75	19.50'			
2-P1		5456.75	19.50'			
3-P1		5456.00	17.20			

WATER METER SERVICES – GPS AS-BUILT

LOT	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
1-P1			
2-P1			
3-P1			

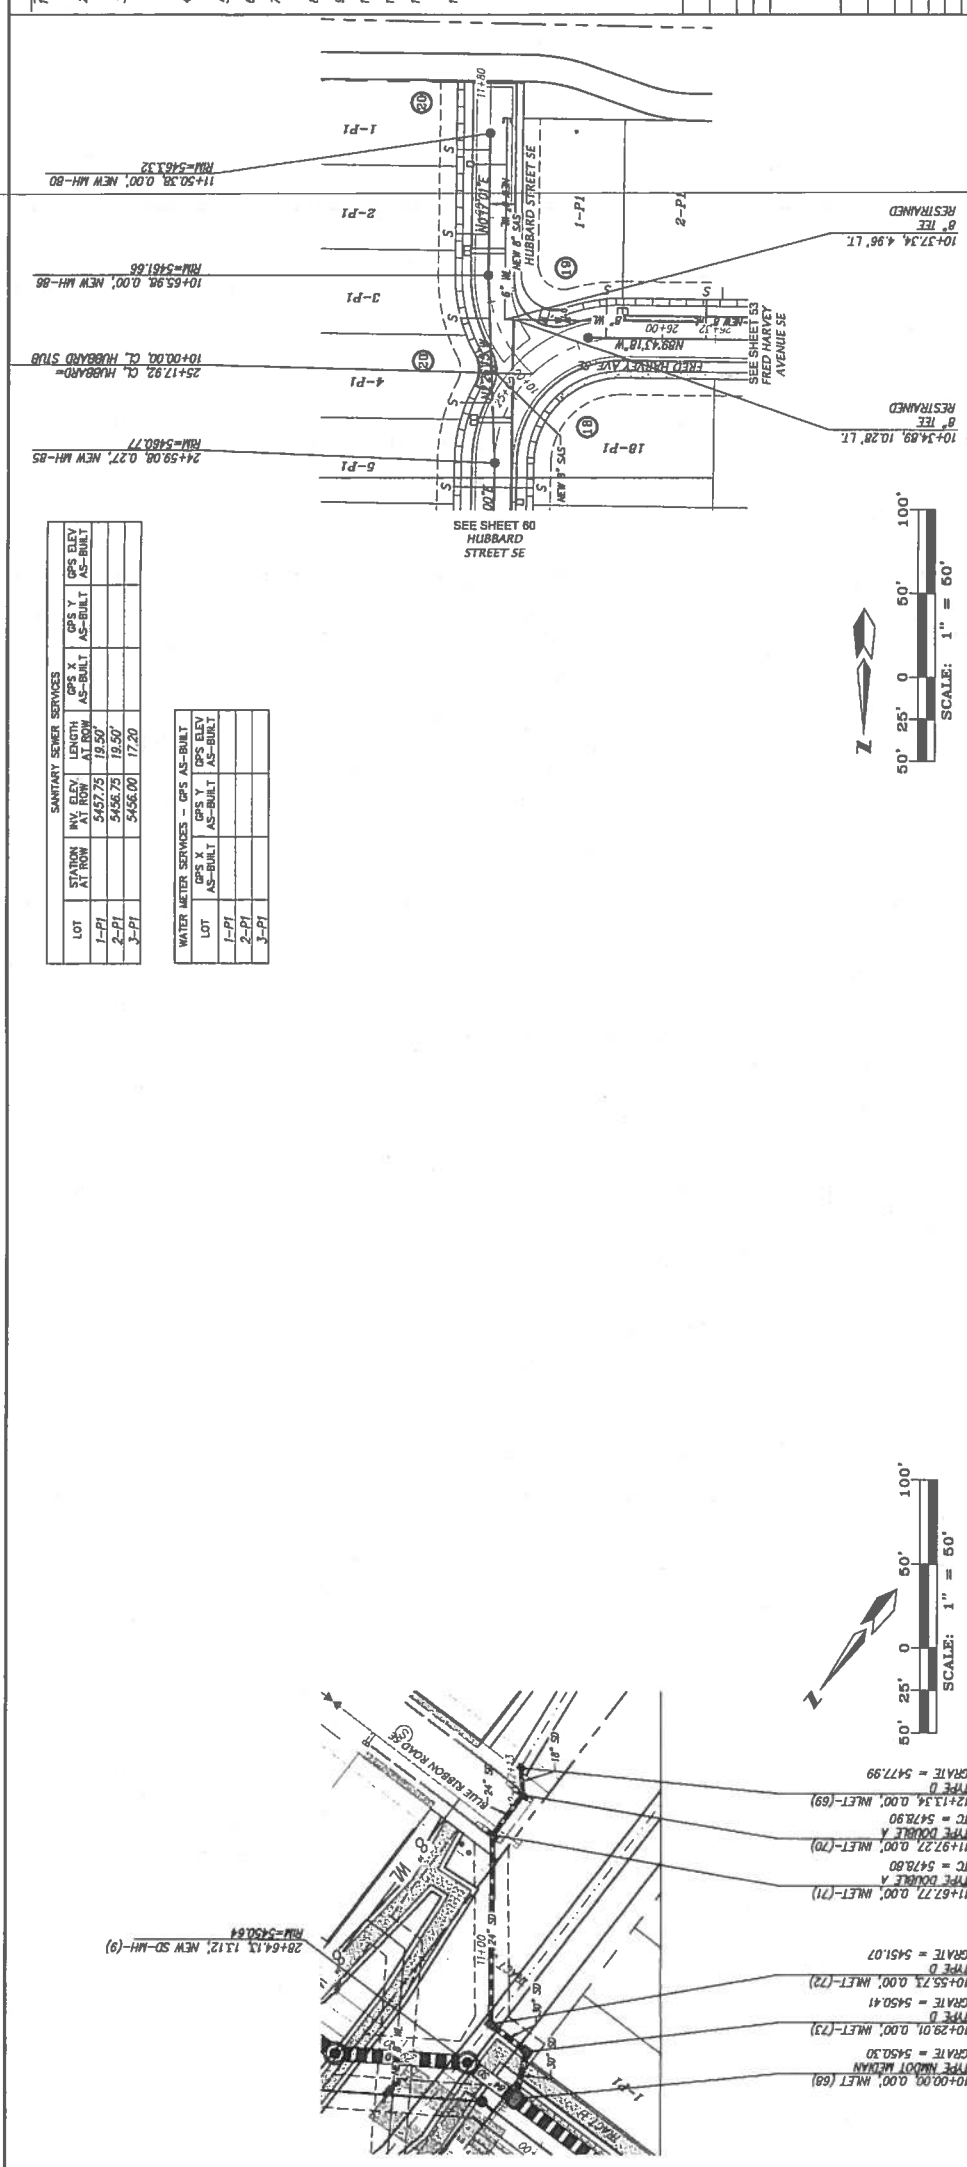

User ID: doug, Date/Time: 3/15/2017 4:37 PM, Document Name: 2017-03-15 HGL Profiles.pdf

AS BUILT INFORMATION	BENCH MARKS	SURVEY INFORMATION	ENGINEER'S SEAL
CONTRACTOR	"STATION "5–M22" IS LOCATED 8.7 MI. SE OF DOWNTOWN ALBUQUERQUE	FIELD NOTES	
STAKED BY / WORK	DATE	BY	NO.
INSPECTOR'S ACCEPTANCE BY	DATE	ON THE EAST SIDE OF THE MUNICIPAL LIMITS LINE IN THE FOUR HILLS	
FIELD VERIFICATION BY	DATE	SUBDIVISION AREA. STATION IS 600 FT. EAST OF MUNICIPAL LIMITS LINE.	
CORRECTED BY	DATE	77.9' SE OF POWER POLE #5E37 & 186.0' NW OF POWER POLE #60.	
DRAWINGS		STATION IS A STANDARD ACS BRASS DISK SET IN A CONCRETE	
MICRO-FILM INFORMATION		MONUMENT IN THE GROUND. STATION IS STAMPED "5–M22".	
RECORDED BY	DATE	X= 1,564,261.207, Y= 1,475,762.595, (NAD 83), Z= 5597.219 (NAVD 1988)	
NO.			

NO.	DATE	REMARKS	BY

REVISIONS

DESIGNED BY	JDH	DATE	02/17
DRAWN BY	SPS	DATE	02/17
CHECKED BY	DMG	DATE	02/17

DESIGN

CERTIFICATE OF SUBSTANTIAL COMPLIANCE

dmg
MARK GOODWIN & ASSOCIATES, P.A.
CONSULTING ENGINEERS
P.O. BOX 90606
ALBUQUERQUE, NEW MEXICO 87199
OFFICE (505) 828-2200, FAX (505) 797-9539

CITY OF ALBUQUERQUE
PUBLIC WORKS DEPARTMENT

TITLE: JUAN TABO HILLS ESTATES
SILVER DOLLAR STREET S.E.
UTILITY PLAN & PROFILE

DESIGN REVIEW COMMITTEE	CITY ENGINEER APPROVAL	LAST DESIGN UPDATE	MO./DAY/YR.

CITY PROJECT NO. 654887 | ZONE MAP NO. M-21 | SHEET 62 OF 75

SCALE: 1" = 50'

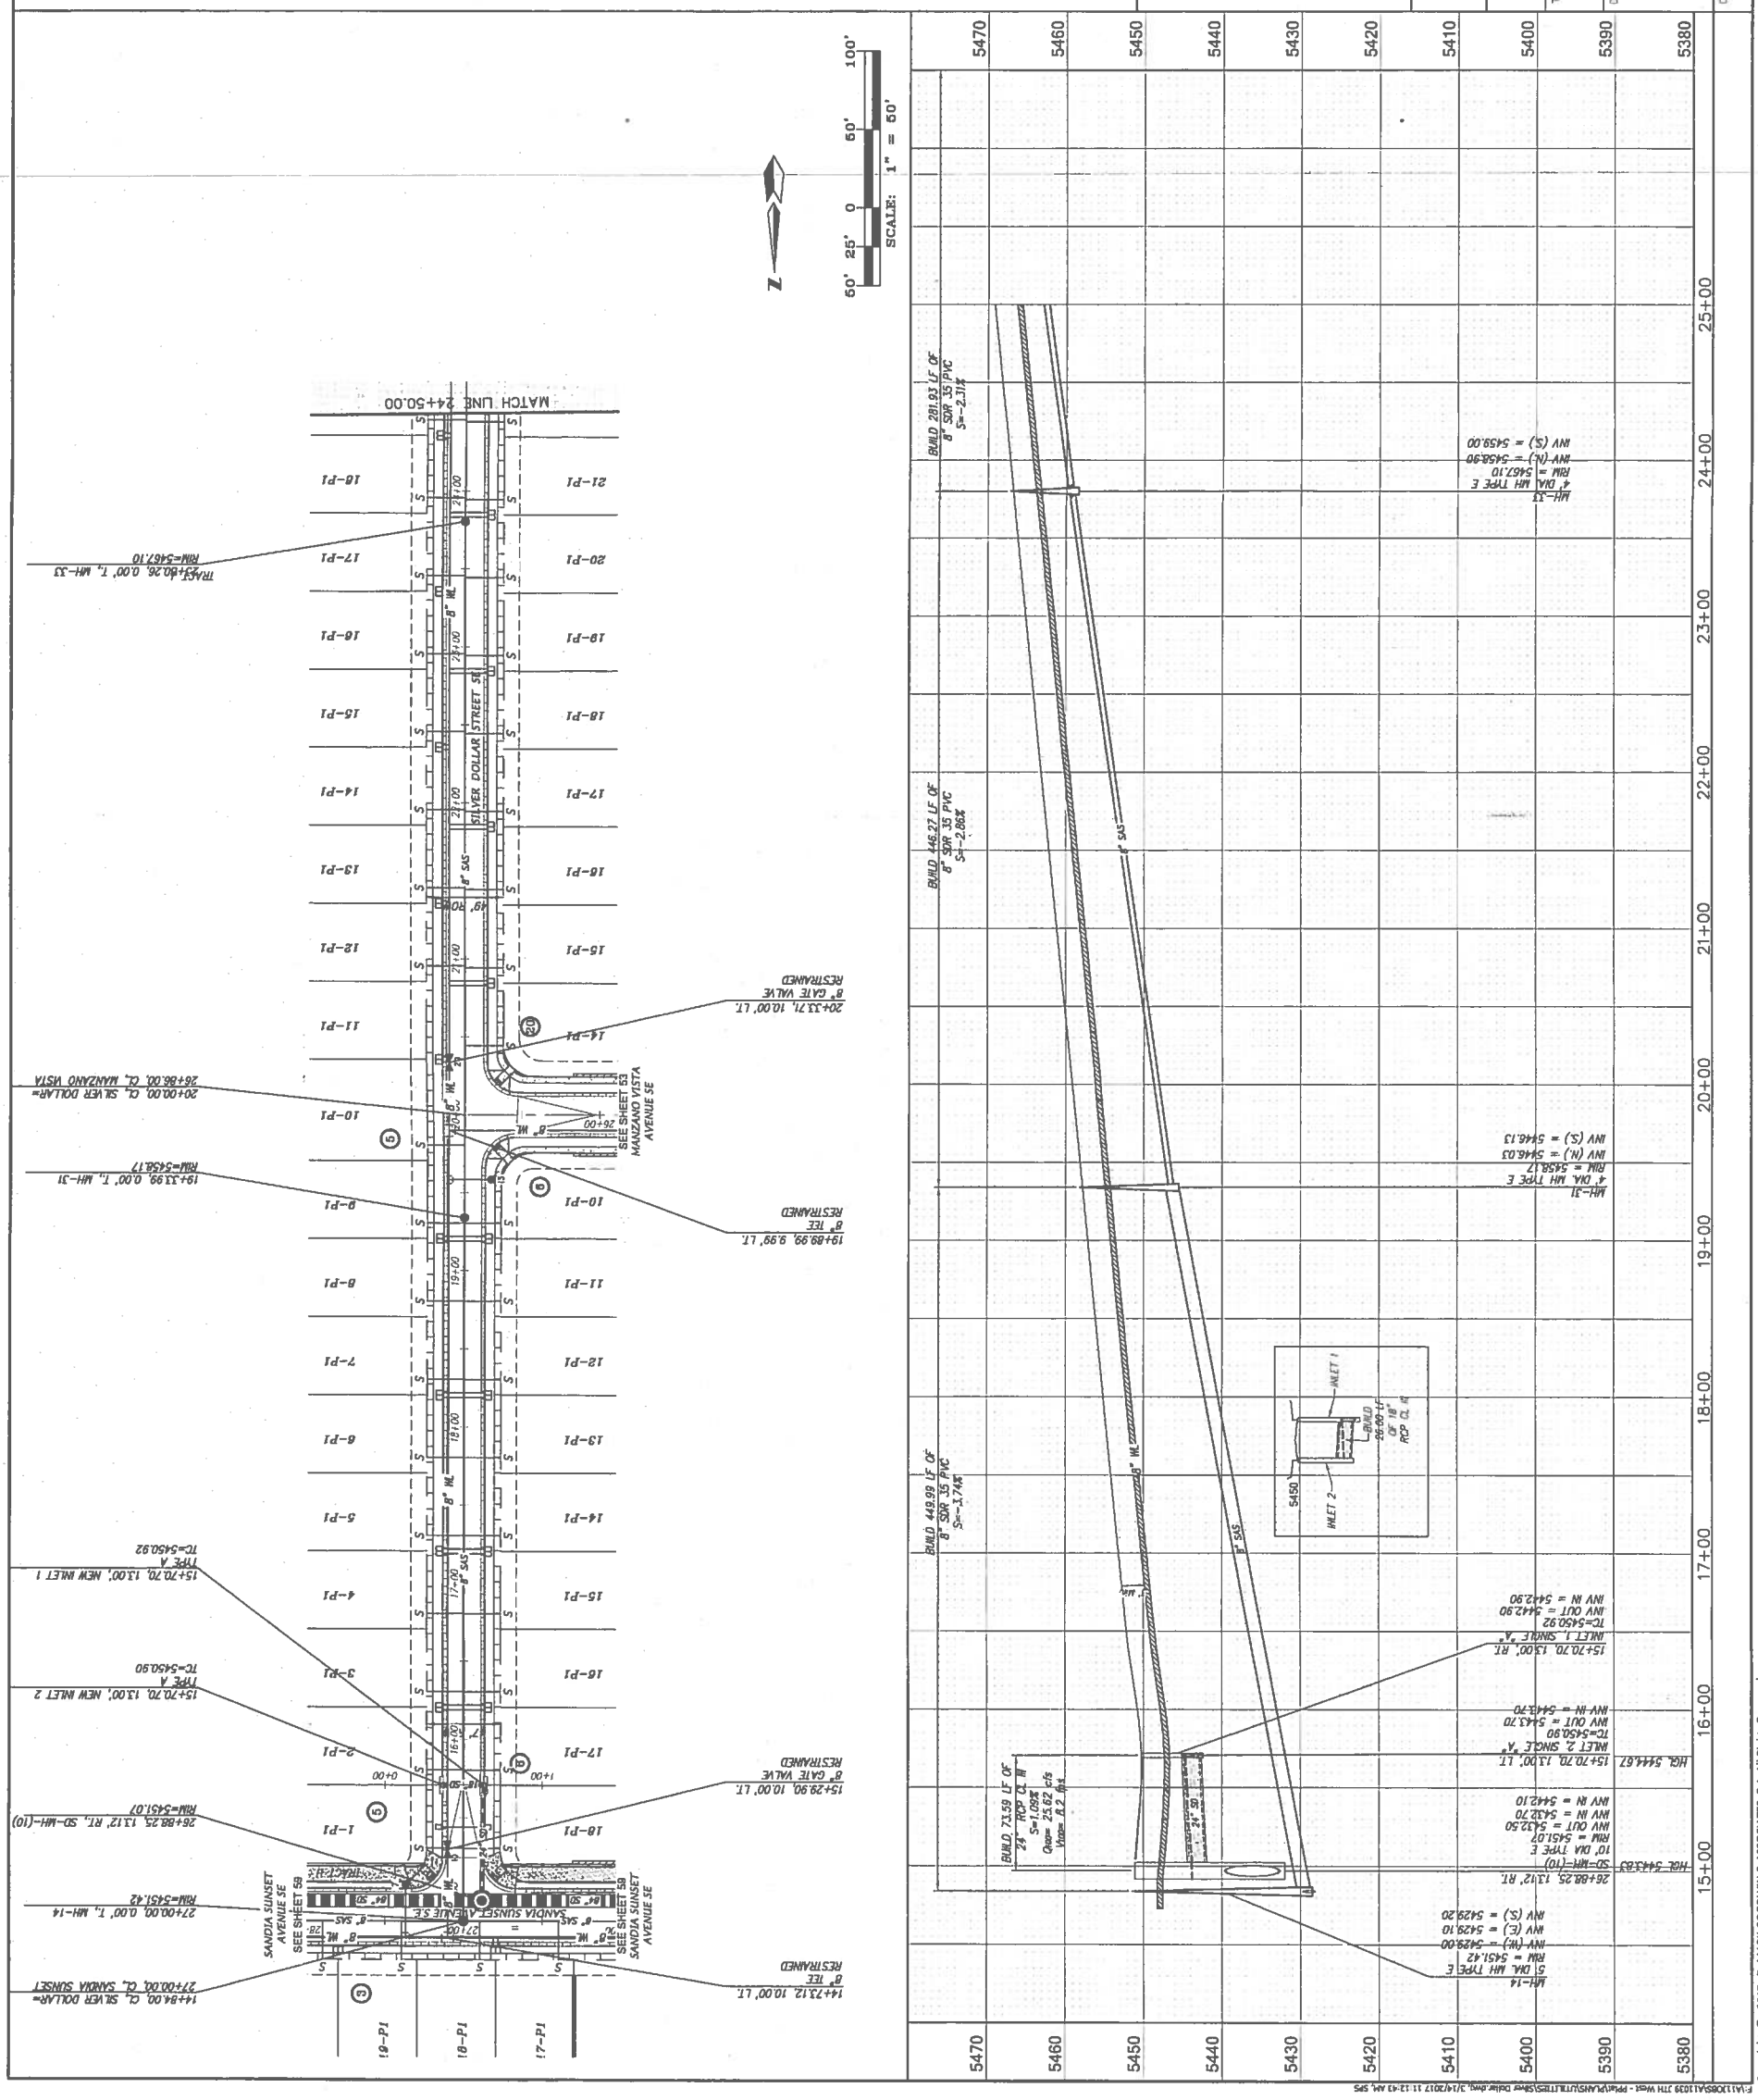

F:\A1130BS\A1130 3TH West - PPLN\PLANS\UTILITIES\Silver Dollar.dwg, 3/14/2017 11:13:43 AM, SPS

NOTES

1. THIS PROJECT SITE LIES WITHIN THE 2WR ZONE FOR PADS BETWEEN ELEVATIONS 5083.7 AND 5142.7
2. ALL FIRE HYDRANTS ARE ABCWUA STD. DWG 2340 AND 4' BURY UNLESS OTHERWISE SPECIFIED.
3. ALL METER BOXES ADJACENT TO MOUNTABLE CURB SHALL HAVE DUCTILE IRON METER BOX COVER & LID PER ABCWUA STD. DWG 2368. WATER METER BOX PER ABCWUA STD. DWG #2366. WATER SERVICE PER ABCWUA STD. DWG #2362.
4. ALL FIRE HYDRANTS TO HAVE A 6" GATE VALVE & BOX PER ABCWUA STD. DWG #2126.
5. CONTRACTOR TO USE POLY COATED CAP FOR VALVE BOXES.
6. CONTRACTOR IS NOT TO INSTALL THE STEPS IN THE SAS MANHOLES.
7. ALL SANITARY SEWER MANHOLES PER ABCWUA STD. DWG #2101, #2107 AND #2109.
8. ALL WATER LINES SHALL BE C-900, DR-18, PVC.
9. ALL SEWER LINES SHALL BE SDR-35, PVC.
10. ALL GATE VALVES & VALVES BOXES PER DWG 2326.
11. ALL SEWER SERVICES PER DWG 2125.
12. ALL MAN HOLES SHALL BE PER DWG 2101 FOR TYPE C AND 2102 FOR TYPE E.
13. ALL WATER AND SEWER MAINS AND SERVICE LINES SHALL HAVE TRACER WIRE OVER THE TOP OF PIPE.

1. THE MAIN TRUNK SAS (21"-24") IS TO BE CONSTRUCTED BEFORE THIS PROJECT BEGINS. SEE SEPARATE WORK ORDER CITY PROJECT# 654887.

FIRE HYDRANT – GPS AS-BUILT

FIRE HYDRANT #	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
2			

GATE VALVE – GPS AS-BUILT

GATE VALVE #	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
17			
18			
20			
22			
23			

AS BUILT INFORMATION

CONTRACTOR
WORK STAKED BY — DATE
INSPECTOR'S ACCEPTANCE BY — DATE
FIELD VERIFICATION BY — DATE
DRAWINGS CORRECTED BY — DATE

BENCH MARKS

STATION "S-422" IS LOCATED 0.7 MI. SE OF DOWNTOWN ALBUQUERQUE
ON THE EAST SIDE OF THE MUNICIPAL LIMITS LINE IN THE FOUR HILLS SUBDIVISION AREA. STATION IS 600 FT. EAST OF MUNICIPAL LIMITS LINE.
77.9' SE OF POWER POLE #537 & 186.0' NW OF POWER POLE #50.
STATION IS A STANDARD ACS BRASS DISK SET IN A CONCRETE MONUMENT IN THE GROUND. STATION IS STAMPED "S-422".
X= 1,564,263.207, Y= 1,475,762.595, (NAD 83), Z= 5597.219 (NAVD 1988)

MICRO-FILM INFORMATION — RECORDED BY — DATE

FIELD NOTES

NO.	BY	DATE

SURVEY INFORMATION

ENGINEER'S SEAL

JAMES D. KNIGHT — NEW MEXICO — REGISTERED PROFESSIONAL ENGINEER — 7-14-17

NO.	REMARKS	DATE	BY
	REVISIONS		
	DESIGN		
DESIGNED BY	JDH	DATE	02/17
DRAWN BY	SPS	DATE	02/17
CHECKED BY	DMG	DATE	02/17

CERTIFICATE OF SUBSTANTIAL COMPLIANCE

dmg
MARK GOODWIN & ASSOCIATES, P.A.
CONSULTING ENGINEERS
P.O. BOX 90606
ALBUQUERQUE, NEW MEXICO 87199
OFFICE (505) 828-2200, FAX (505) 797-9539

CITY OF ALBUQUERQUE
PUBLIC WORKS DEPARTMENT

TITLE: JUAN TABO HILLS ESTATES
ROCKY TOP DRIVE SE
UTILITY PLAN & PROFILE

DESIGN REVIEW COMMITTEE — CITY ENGINEER APPROVAL — LAST DESIGN UPDATE — MO./DAY/YR. — MO./DAY/YR.

CITY PROJECT NO. 654887 | ZONE MAP NO. M-21 | SHEET 67 OF 75

SCALE: 1" = 50'

P:\A11308\SA11308 JTH MAP - PRELIM\ANS\UTILITIES\Rocky Top Drive SE.dwg, 3/14/2017 2:50:49 PM, SPS

AS BUILT INFORMATION		BENCH MARKS		SURVEY INFORMATION		ENGINEER'S SEAL
CONTRACTOR		STATION "5-M22" IS LOCATED 8.7 MI. SE OF DOWNTOWN ALBUQUERQUE		FIELD NOTES		
WORK STAKED BY	DATE	ON THE EAST SIDE OF THE MUNICIPAL LIMITS LINE IN THE FOUR HILLS SUBDIVISION AREA. STATION IS 600 FT. EAST OF MUNICIPAL LIMITS LINE.	NO.	BY	DATE	
INSPECTOR'S ACCEPTANCE BY	DATE	77.9' SE OF POWER POLE #5237 & 186.0' NW OF POWER POLE #60. STATION IS A STANDARD ACS BRASS DISK SET IN A CONCRETE MONUMENT IN THE GROUND. STATION IS STAMPED "5-M22".				
VERIFICATION BY FIELD	DATE					
DRAWINGS CORRECTED BY	DATE	MICRO-FILM INFORMATION				
		RECORDED BY	DATE			
		NO.				

NO.	DATE	REMARKS	BY

REVISIONS

DESIGN

DESIGNED BY	JDH	DATE	02/17
DRAWN BY	SPS	DATE	02/17
CHECKED BY	DMG	DATE	02/17

CITY OF ALBUQUERQUE
PUBLIC WORKS DEPARTMENT

TITLE: JUAN TABO HILLS ESTATES
PARK 1
UTILITY PLAN & PROFILE

MARK GOODWIN & ASSOCIATES, P.A.
CONSULTING ENGINEERS
P.O. BOX 90606
ALBUQUERQUE, NEW MEXICO 87199
OFFICE (505) 828-2200, FAX (505) 797-9539

CERTIFICATE OF SUBSTANTIAL COMPLIANCE

DESIGN REVIEW COMMITTEE | CITY ENGINEER APPROVAL | LAST DESIGN UPDATE | MO./DAY/YR. | MO./DAY/YR.

CITY PROJECT NO. 654887 | ZONE MAP NO. M-21 | SHEET 69 OF 75

SCALE: 1" = 50'

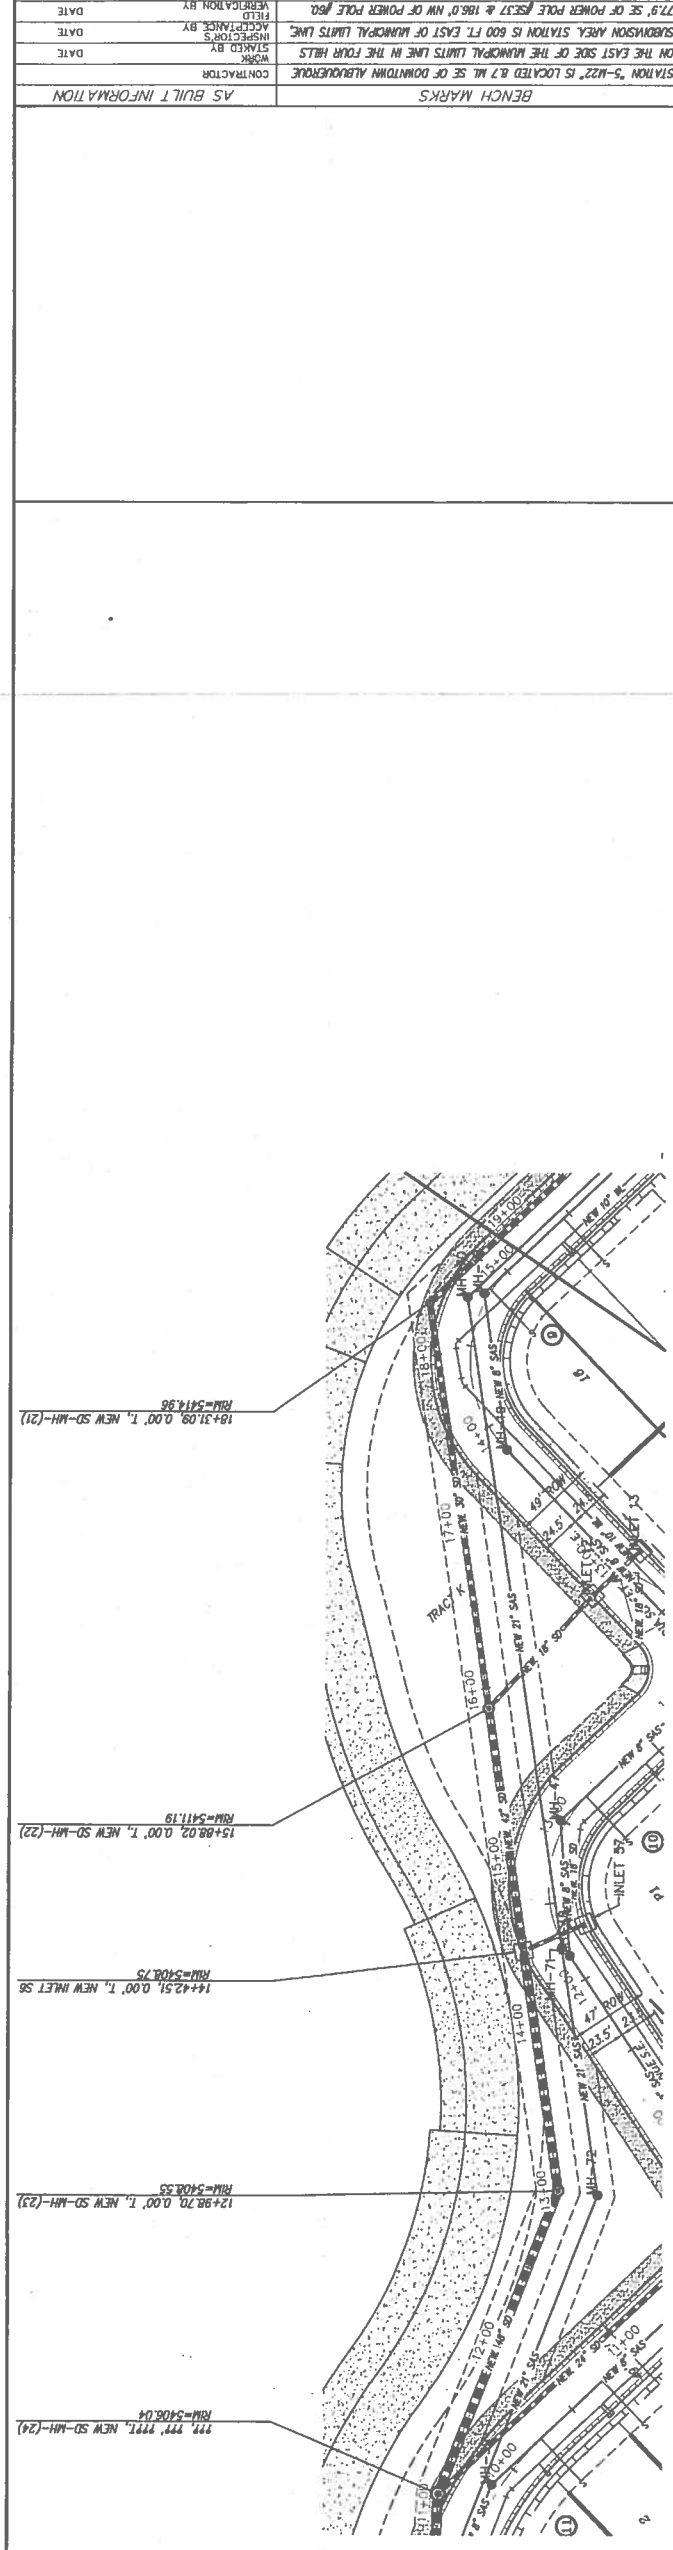

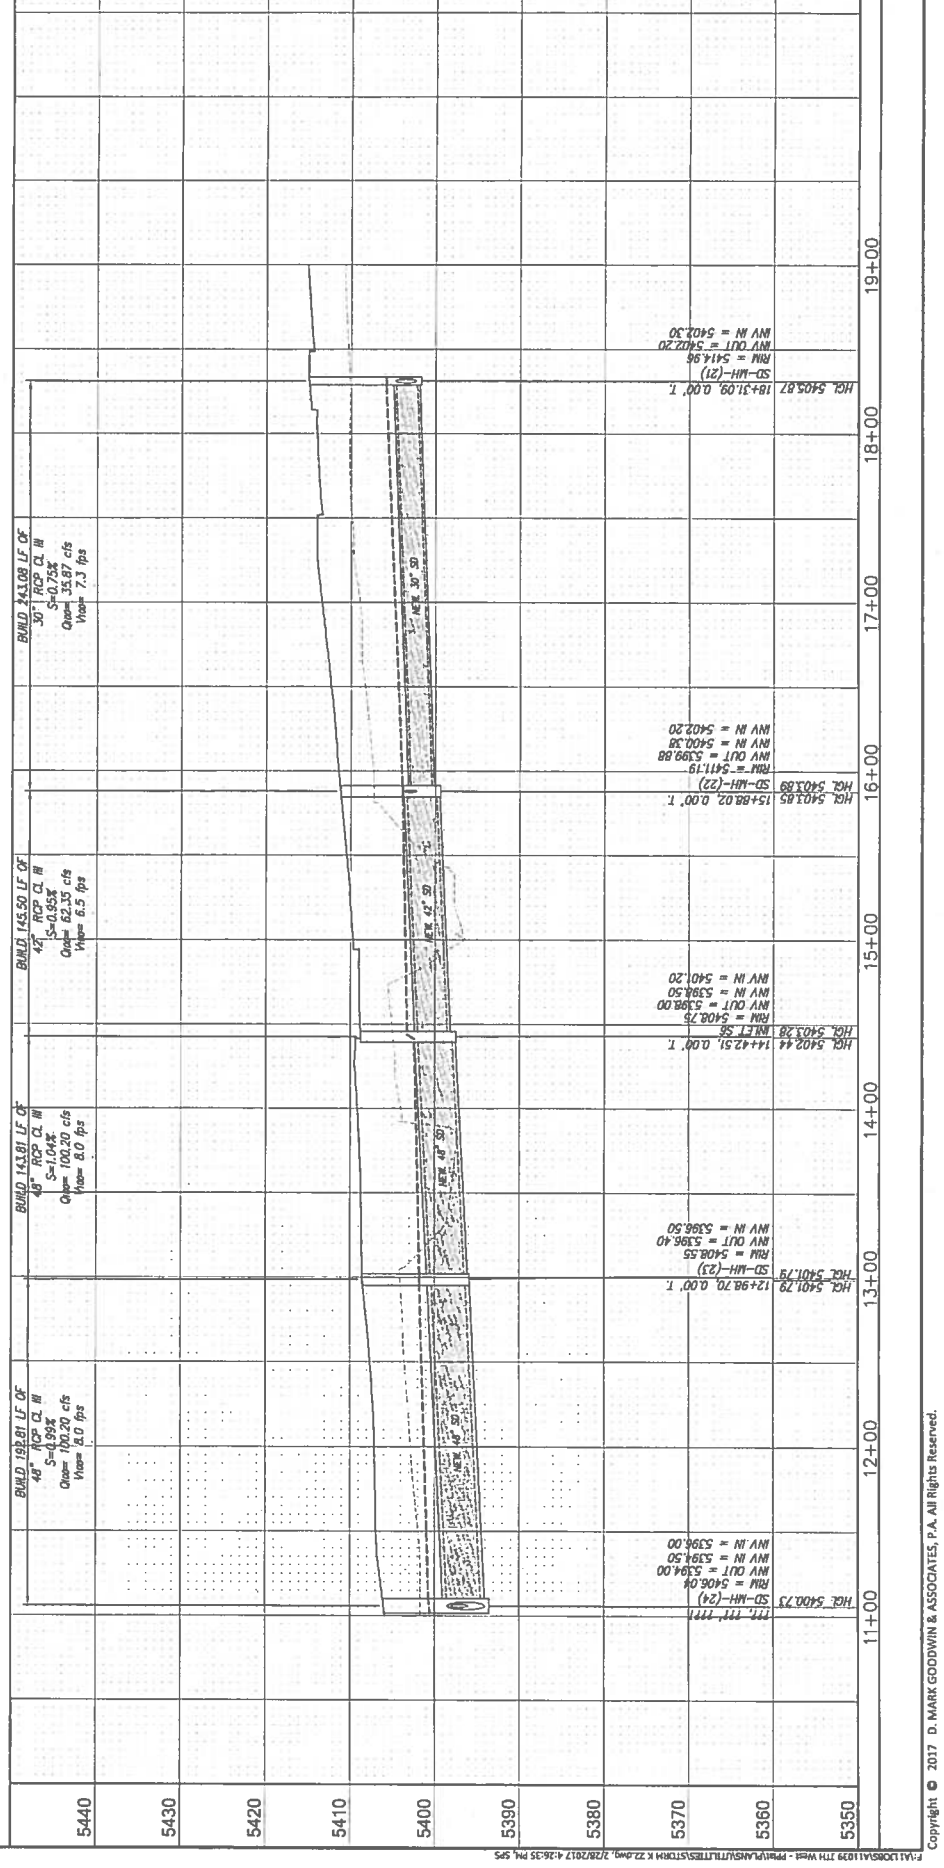

User ID: doug, Date/Time: 3/15/2017 4:37 PM, Document Name: 2017-03-15 HGL Profiles.pdf

AS BUILT INFORMATION		BENCH MARKS		SURVEY INFORMATION		ENGINEER'S SEAL
CONTRACTOR		STATION "S-422" IS LOCATED 8.7 MI. SE OF DOWNTOWN ALBUQUERQUE		FIELD NOTES		
WORK STAKED BY	DATE	ON THE EAST SIDE OF THE MUNICIPAL LIMITS LINE IN THE FOUR HILLS SUBDIVISION AREA. STATION IS 600 FT. EAST OF MUNICIPAL LIMITS LINE.	NO.	BY	DATE	
INSPECTOR'S ACCEPTANCE BY	DATE	77.9' SE OF POWER POLE #537 & 186.0' NW OF POWER POLE #60.				
FIELD VERIFICATION BY	DATE	STATION IS A STANDARD ACS BRASS DISK SET IN A CONCRETE				
DRAWINGS CORRECTED BY	DATE	MONUMENT IN THE GROUND. STATION IS STAMPED "S-422".				
MICRO-FILM INFORMATION		X= 1,564,263.207, Y= 1,475,762.595, (NAD 83) Z= 5597.219 (NAVD 1988)				
RECORDED BY	DATE					
NO						

REVISIONS				DESIGN			
NO.	DATE	REMARKS	BY	DESIGNED BY	JDH	DATE	02/17
				DRAWN BY	SPS	DATE	02/17
				CHECKED BY	DMG	DATE	02/17

CERTIFICATE OF SUBSTANTIAL COMPLIANCE

dmg MARK GOODWIN & ASSOCIATES, P.A.
CONSULTING ENGINEERS
P.O. BOX 90606
ALBUQUERQUE, NEW MEXICO 87199
OFFICE (505) 828-2200, FAX (505) 797-9539

CITY OF ALBUQUERQUE
PUBLIC WORKS DEPARTMENT

TITLE: JUAN TABO HILLS ESTATES
PARK 2
UTILITY PLAN & PROFILE

DESIGN REVIEW COMMITTEE | CITY ENGINEER APPROVAL | LAST DESIGN UPDATE | MO./DAY/YR. | MO./DAY/YR.

CITY PROJECT NO. 654887 | ZONE MAP NO. M-21 | SHEET 10 OF 75

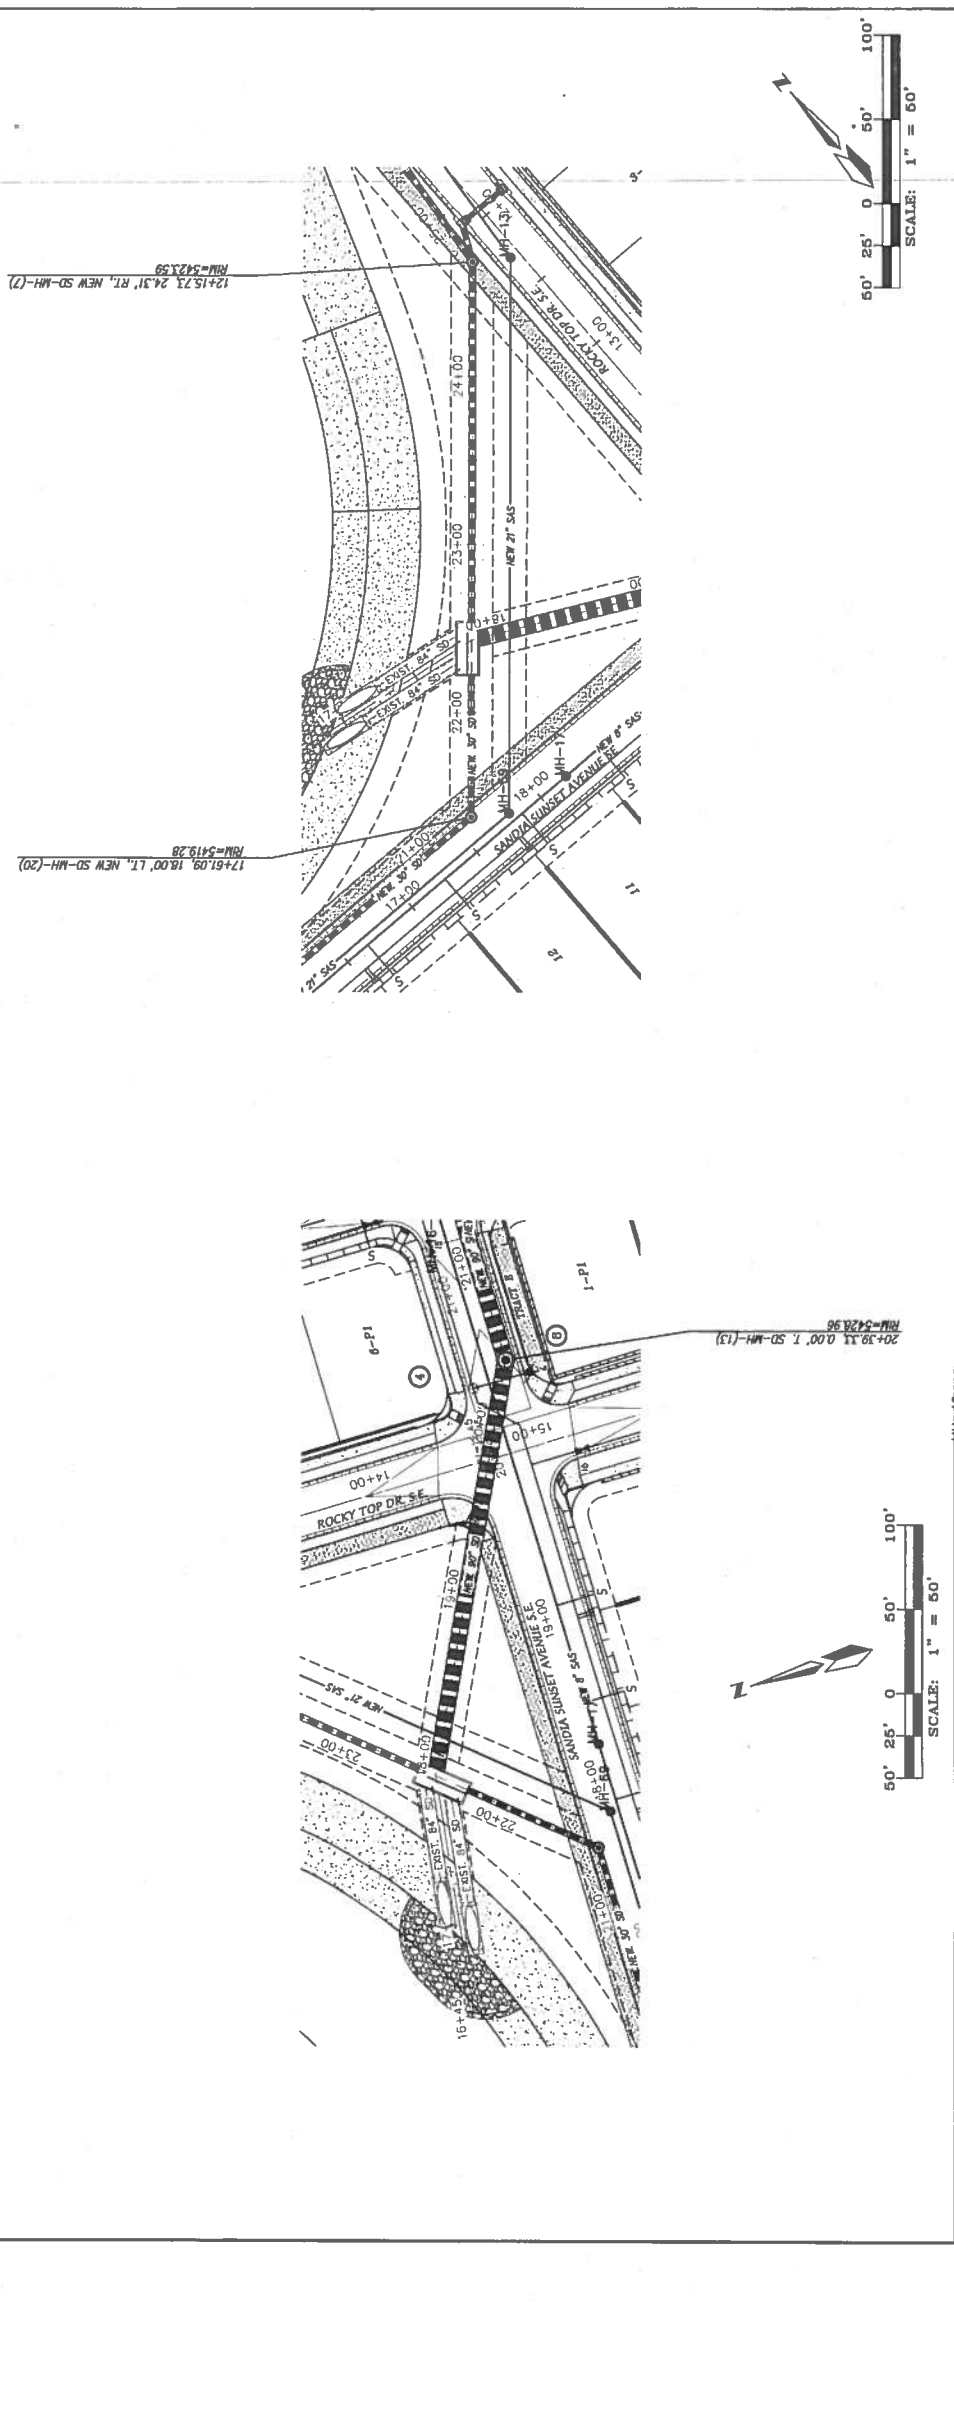

F:\ALLJOBS\A11039 7TH West - PHASE\PLANS\UTILITIES\STORM K (1) 28.dwg, 3/15/2017 1:19:42 PM, SPS

F:\A11JOBS\A11039 JTH West - PPlat\PLANS\UTILITIES\STORM K (2) 24.dwg, 3/14/2017 4:19:28 PM, SPS

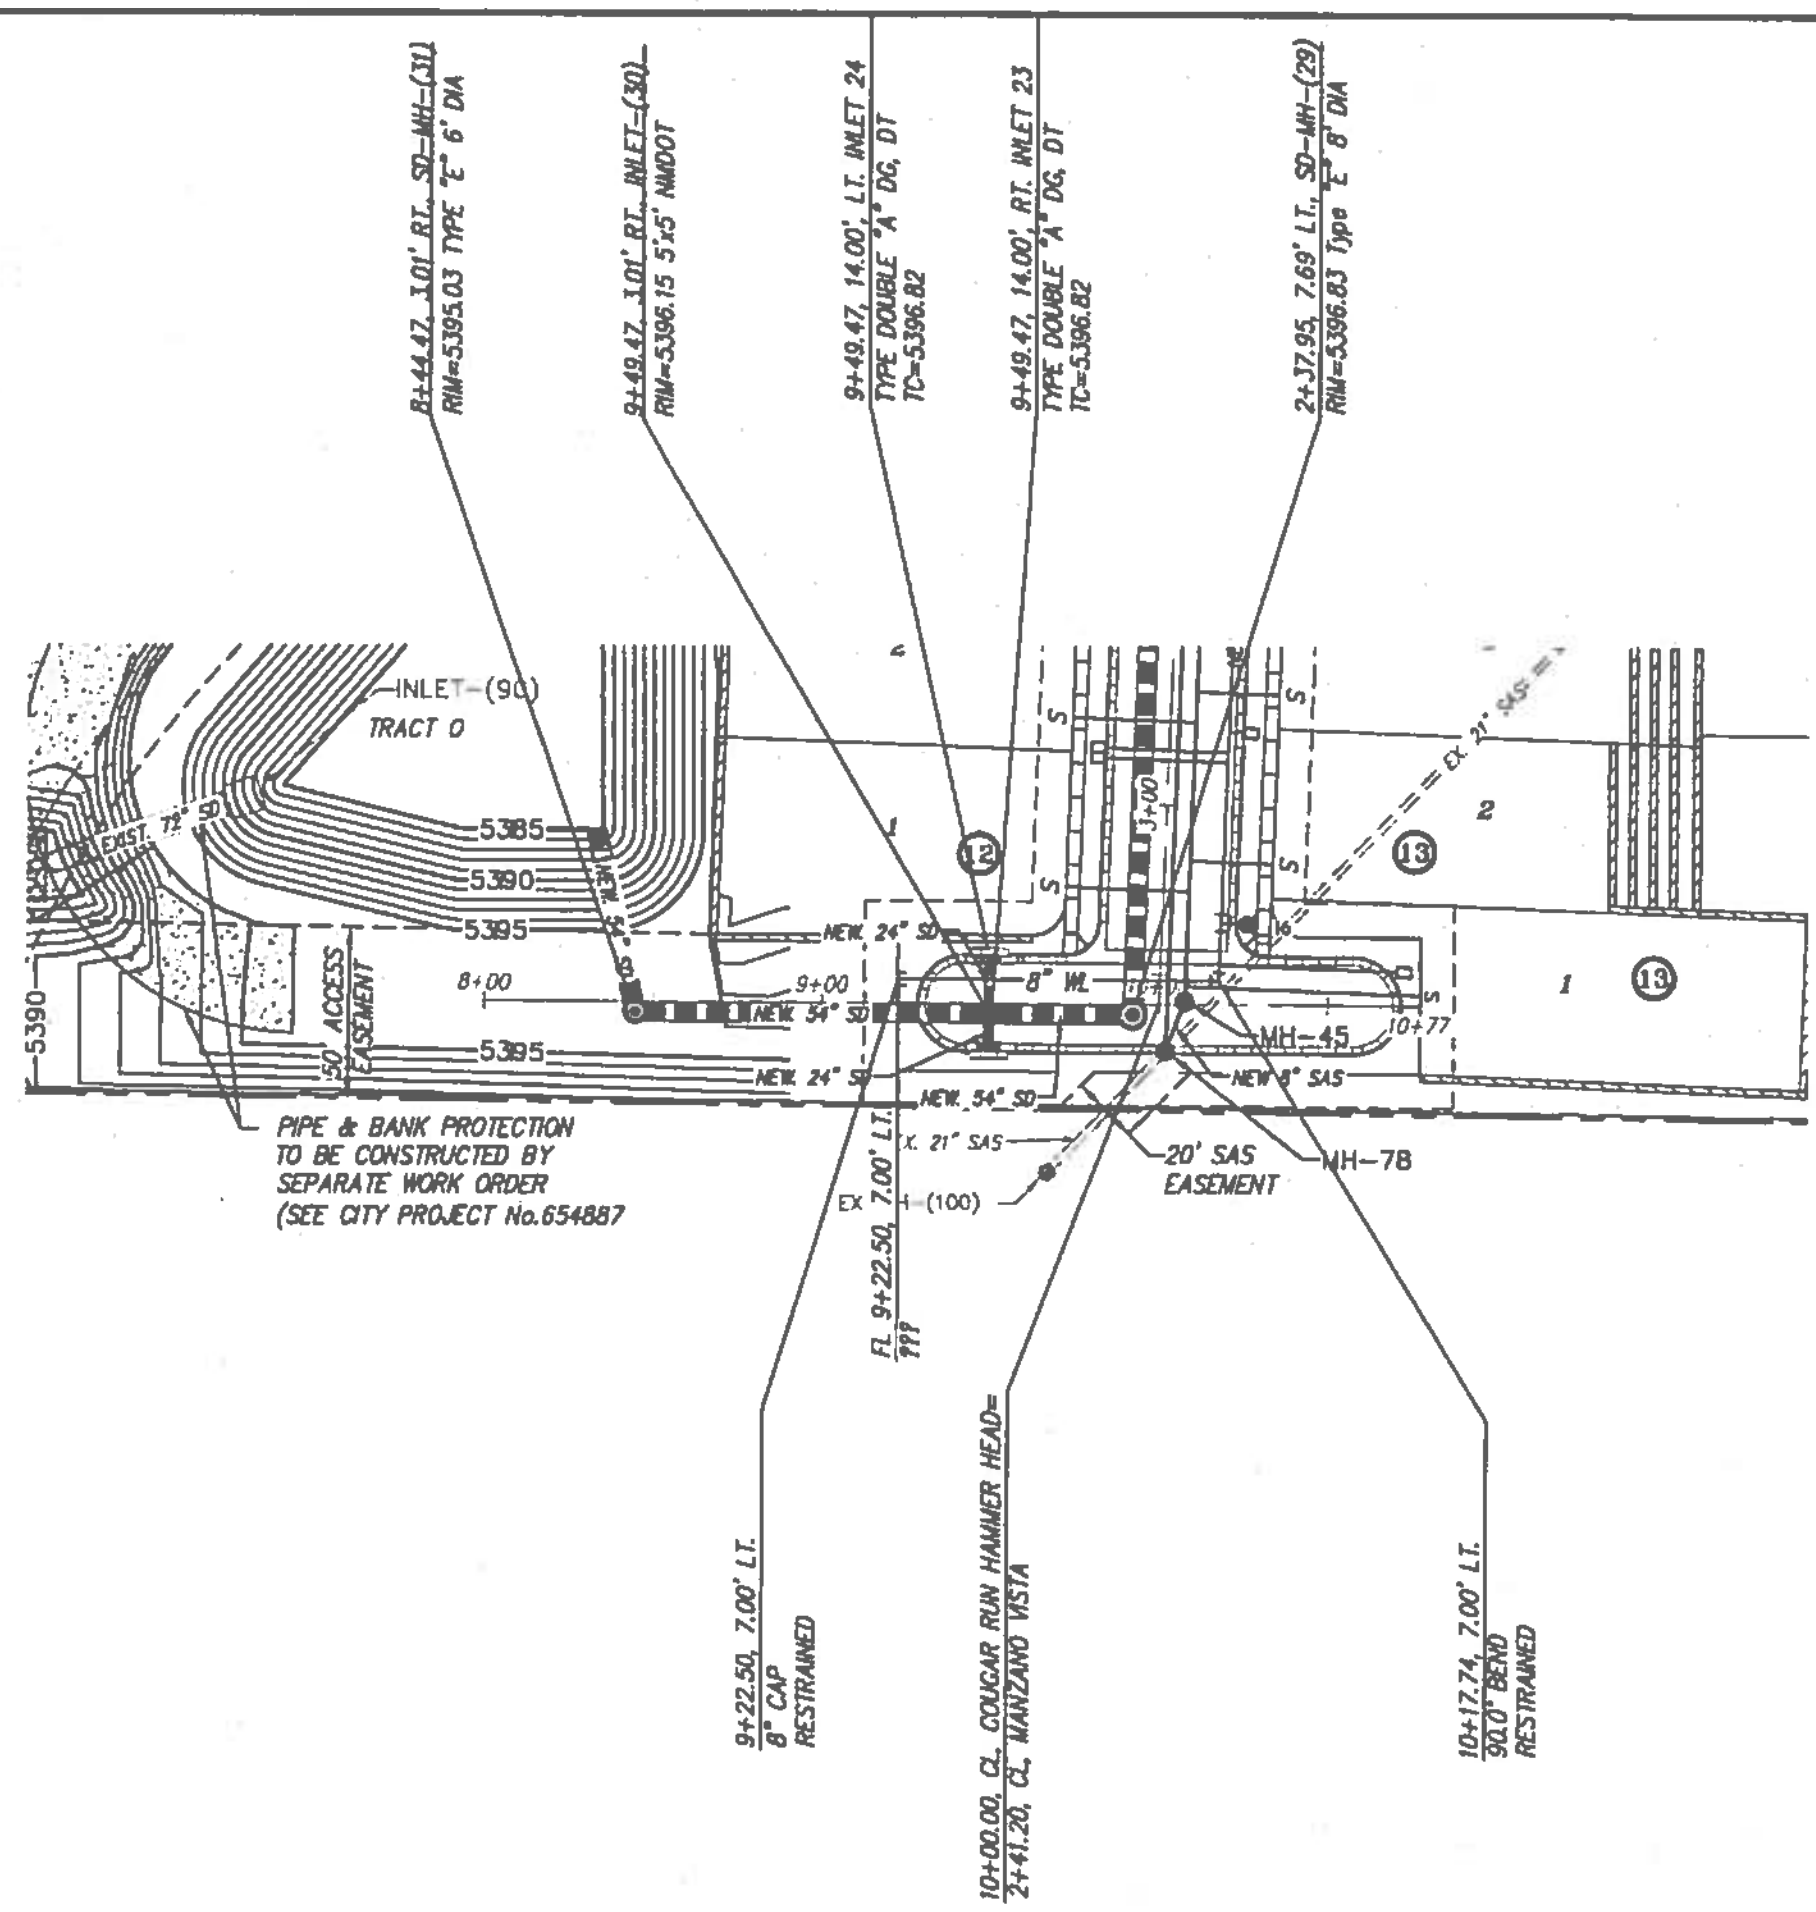

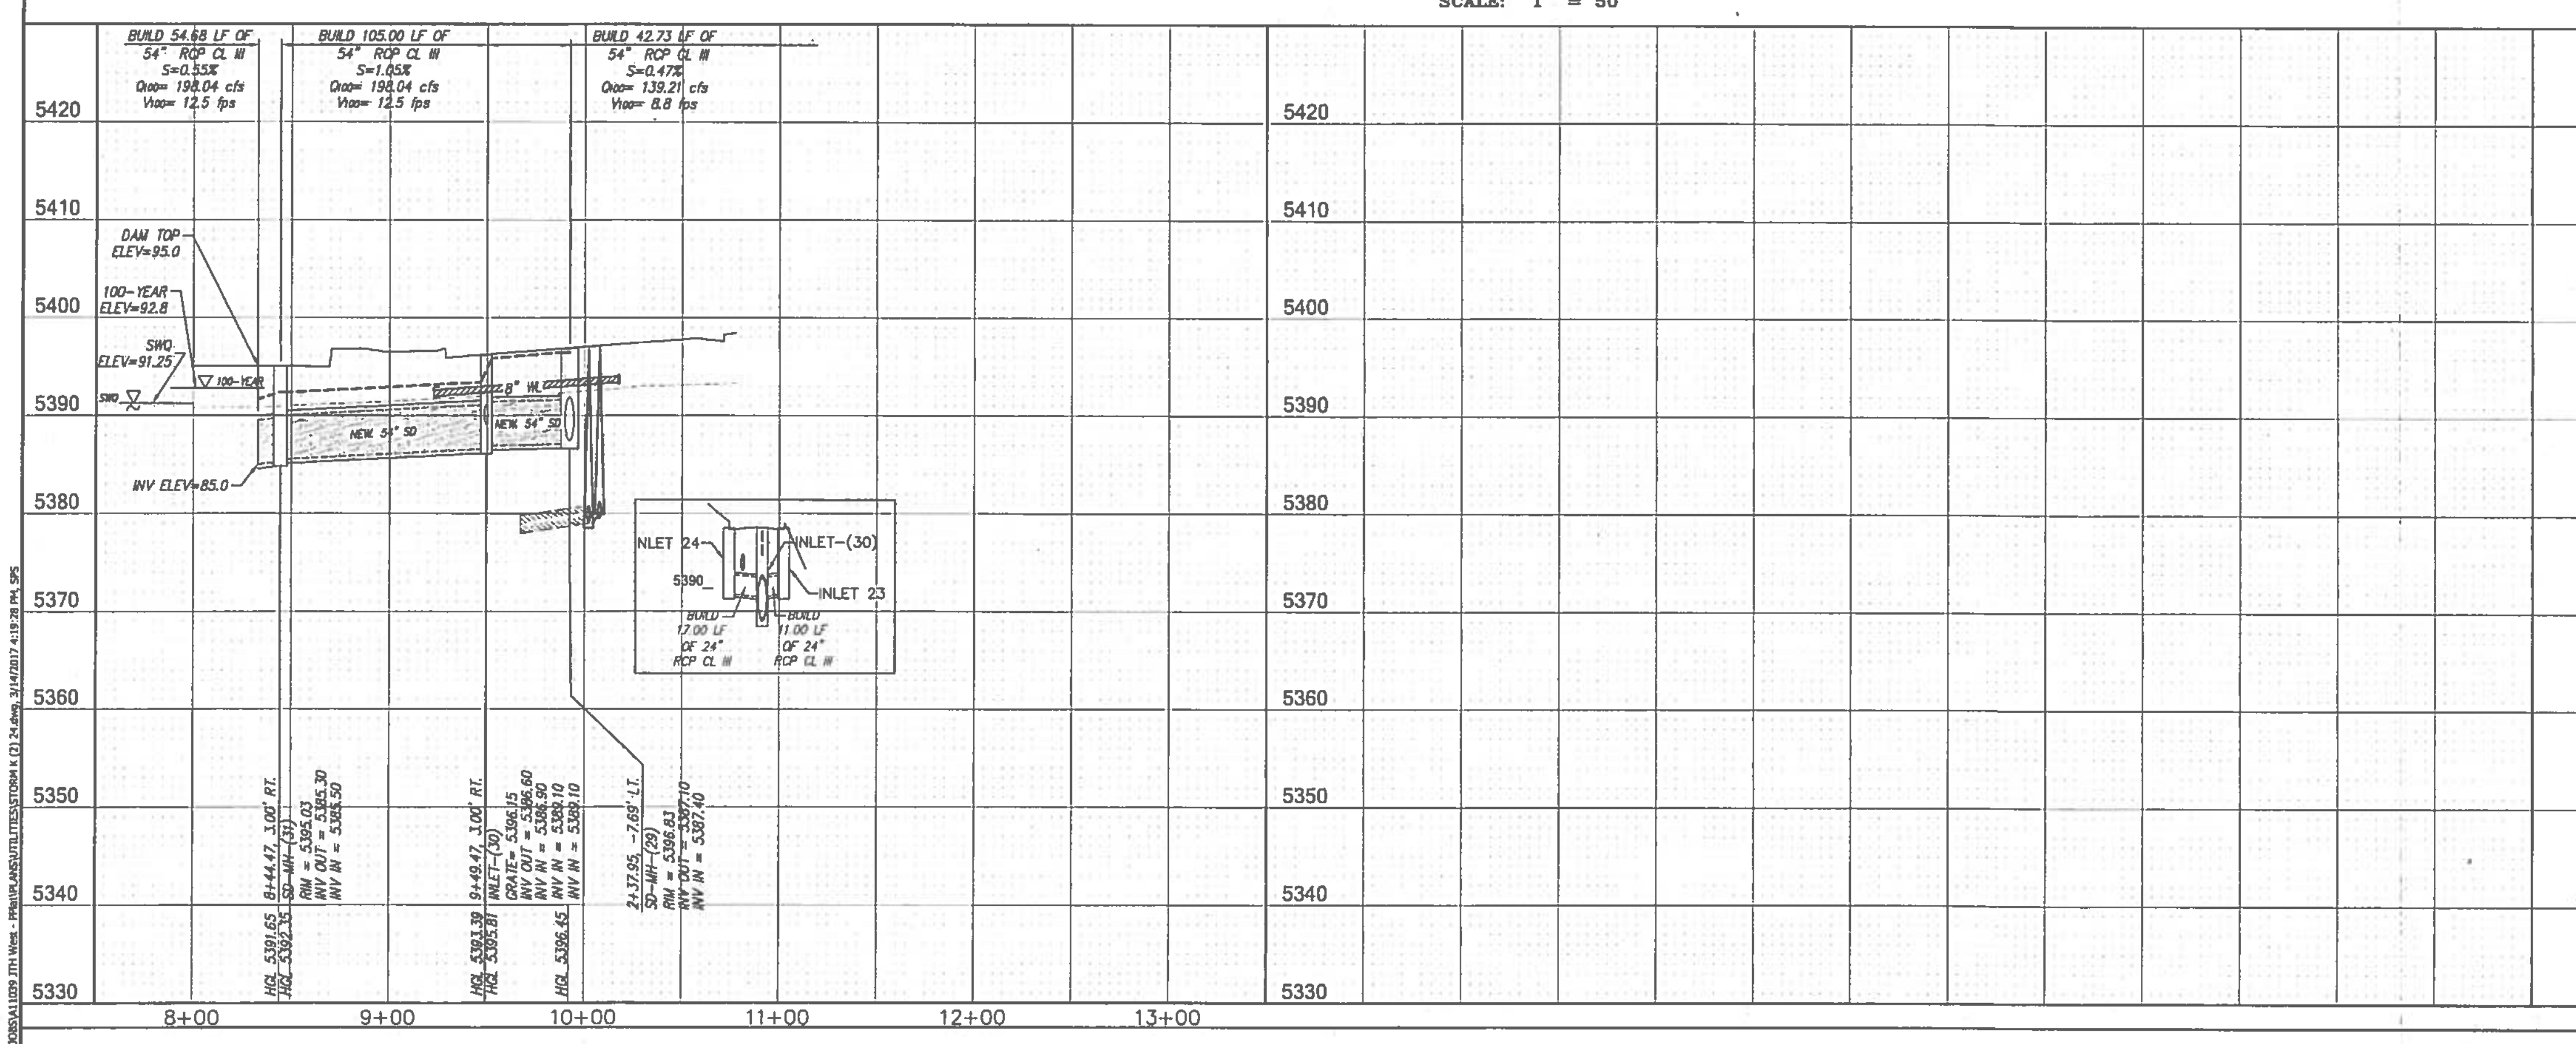

NOTES

1. THIS PROJECT SITE LIES WITHIN THE 2WR ZONE FOR PADS BETWEEN ELEVATIONS 5065.7 AND 5142.7
2. ALL FIRE HYDRANTS ARE ABCWUA STD. DWG 2340 AND 4' BURY UNLESS OTHERWISE SPECIFIED.
3. ALL METER BOXES ADJACENT TO MOUNTABLE CURB SHALL HAVE DUCTILE IRON METER BOX COVER & LID PER ABCWUA STD. DWG 2368; WATER METER BOX PER ABCWUA STD. DWG #2366; WATER SERVICE PER ABCWUA STD. DWG #2362.
4. ALL FIRE HYDRANTS TO HAVE A 6" GATE VALVE & BOX PER ABCWUA STD. DWG #2326.
5. CONTRACTOR TO USE POLY COATED CMP FOR VALVE BOXES.
6. CONTRACTOR IS NOT TO INSTALL THE STEPS IN THE SAS MANHOLES.
7. ALL SANITARY SEWER MANHOLES PER ABCWUA STD. DWG #2101, #2107 AND #2109.
8. ALL WATER LINES SHALL BE C-900, DR-18, PVC.
9. ALL SEWER LINES SHALL BE SDR-35, PVC.
10. ALL GATE VALVES & VALVES BOXES PER DWG 2326.
11. ALL SEWER SERVICES PER DWG 2125.
12. ALL MAN HOLES SHALL BE PER DWG 2101 FOR TYPE C AND 2102 FOR TYPE E.
13. ALL WATER AND SEWER MAINS AND SERVICE LINES SHALL HAVE TRACER WIRE OVER THE TOP OF PIPE.

FIRE HYDRANT - GPS AS-BUILT

FIRE HYDRANT #	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
10			
11			

GATE VALVE - GPS AS-BUILT

GATE VALVE #	GPS X AS-BUILT	GPS Y AS-BUILT	GPS ELEV AS-BUILT
17			
18			
20			
22			
23			

AS BUILT INFORMATION

CONTRACTOR	
WORK STAKED BY	DATE
INSPECTOR'S ACCEPTANCE BY	DATE
FIELD VERIFICATION BY	DATE
DRAWINGS CORRECTED BY	DATE

MICRO-FILM INFORMATION

RECORDED BY	DATE
NO.	

BENCH MARKS

STATION "5-M22" IS LOCATED 8.7 MI. SE OF DOWNTOWN ALBUQUERQUE ON THE EAST SIDE OF THE MUNICIPAL LIMITS LINE IN THE FOUR HILLS SUBDIVISION AREA. STATION IS 600 FT. EAST OF MUNICIPAL LIMITS LINE, 77.9' SE OF POWER POLE #SE37 & 186.0' NW OF POWER POLE #60. STATION IS A STANDARD ACS BRASS DISK SET IN A CONCRETE MONUMENT IN THE GROUND. STATION IS STAMPED "5-M22".
X= 1,564,263.207, Y= 1,475,762.595, (NAD 83), Z= 5597.219 (NAVD 1988)

SURVEY INFORMATION

FIELD NOTES

NO.	BY	DATE

ENGINEER'S SEAL

JAMES D. HUGHES
NEW MEXICO
REGISTERED PROFESSIONAL ENGINEER
3-14-2017

CERTIFICATE OF SUBSTANTIAL COMPLIANCE

NO.	DATE	REMARKS	BY

REVISIONS

DESIGN

DESIGNED BY	JDH	DATE	02/17
DRAWN BY	SPS	DATE	02/17
CHECKED BY	DMG	DATE	02/17

dmg MARK GOODWIN & ASSOCIATES, P.A.
CONSULTING ENGINEERS
P.O. BOX 90606
ALBUQUERQUE, NEW MEXICO 87199
OFFICE (505) 828-2200, FAX (505) 797-9539

CITY OF ALBUQUERQUE
PUBLIC WORKS DEPARTMENT

TITLE: JUAN TABO HILLS ESTATES
COUGAR RUN
UTILITY PLAN & PROFILE

DESIGN REVIEW COMMITTEE	CITY ENGINEER APPROVAL	MO./DAY/YR.	MO./DAY/YR.

LAST DESIGN UPDATE

CITY PROJECT NO.	ZONE MAP NO.	SHEET	OF
654887	M-21	71	75

User ID: doug, Date/Time: 3/15/2017 4:37 PM, Document Name: 2017-03-15 HGL Profiles.pdf

GENERAL STRUCTURAL NOTES

1. CODES AND MANUALS:
   International Building Code, 2012 Edition
   ACI 318-05
2. DESIGN LOADS:
   A. Equivalent Fluid Pressure = 32 pcf
   B. Maximum allowable soil bearing pressure: 2,000 psf.
3. GENERAL:
   A. The Contractor shall verify all dimensions in the field.
   B. The Contractor shall be responsible for providing safe and adequate shoring for all parts of the structure during construction.
4. MATERIALS:
   A. Cast-in-place Concrete:
      1. Hardrock Concrete (Unit Wt.=150 pcf)
         a. 4,000 psi @ 28 days (air entrained)
      2. Provide 3/4" chamfer at all exposed edges.
   B. Reinforcing Steel:
      1. All reinforcing steel shall conform to ASTM A615 Grade 60.
      2. Reinforcing steel shall be fabricated and placed in accordance with the Building Code Requirements for Reinforced Concrete ACI 318 and the Standard Manual ACI 315.
      3. Where lapped splices in reinforcing occur, the minimum lap shall be made as follows:
         a. Vertical reinforcing: 30 bar dia. or 18" minimum.
         b. Horizontal reinforcing: 30 bar dia. or 18" minimum.
         c. Horizontal corner bars: 30 bar dia. or 18" minimum.
      4. Concrete cover for reinforcing shall be as follows:
         a. Concrete cast against and permanently exposed to earth ..... 3"
         b. Concrete exposed to earth or weather
            1. Bars larger than No. 5 ..... 2"
            2. Bars No. 5 or smaller ..... 1 1/2"
      5. All horizontal reinforcing in footings, walls and beams shall be continuous around corners or have corner bars of the same size and spacing as the horizontal bars and lap a minimum of 30 bar diameters or 24" minimum.
5. SITE GRADING AND EARTHWORK
   A. Foundation Preparation:
      Building areas shall be completely stripped of vegetation, pavement, existing construction and debris, and soft or muddy areas.
   B. Foundations:
      Overexcavate beneath bottom elevation of all foundations a minimum of one foot. The excavation shall extend a minimum of two feet laterally beyond the edge of all foundations. The exposed bottoms of excavations shall be scarified to a depth of 8", moistened within optimum moisture +/-3%, and compacted to a minimum of 95% of maximum density as determined by ASTM D-1557. The structural fill shall be brought to subgrade within optimum moisture +/-3%, placed in uniform horizontal lifts, 8" max. loose depth, and compacted to a minimum of 95% of maximum density as determined by ASTM D-1557.
   C. Backfill:
      All backfill should be thoroughly mixed within optimum moisture +/-3%, placed in uniform horizontal lifts, 8" max. loose depth, and compacted to a minimum of 95% of maximum density as determined by ASTM D-1557.
   D. Site Drainage:
      Provide positive surface drainage away from foundation excavations during construction.

SURVEY INFORMATION			BENCH MARKS	AS BUILT INFORMATION
FIELD NOTES				CONTRACTOR
NO.	BY	DATE		WORK STAKED BY / DATE
				INSPECTOR'S ACCEPTANCE BY / DATE
				FIELD VERIFICATION BY / DATE
				DRAWINGS CONNECTED BY / DATE
				MICRO-FILM INFORMATION
				RECORDED BY / DATE
				NO.

ENGINEER'S SEAL

REVISIONS				
NO.	DATE	REMARKS	BY	

DESIGN
DESIGNED BY DM DATE
DRAWN BY CB DATE
CHECKED BY DM DATE

dmg
MARK GOODWIN & ASSOCIATES, P.A.
CONSULTING ENGINEERS
P.O. BOX 90606
ALBUQUERQUE, NEW MEXICO 87199
OFFICE (505) 828-2200, FAX (505) 797-9539

CITY OF ALBUQUERQUE
PUBLIC WORKS DEPARTMENT

TITLE: JUAN TABO HILLS ESTATES
SD-MH5 STRUCTURAL DRAWINGS

DESIGN REVIEW COMMITTEE	CITY ENGINEER APPROVAL	LAST DESIGN UPDATE	MO./DAY/YR.	NO./DAY/YR.

CITY PROJECT NO. 654887 | ZONE MAP NO. H 21 | SHEET 72 OF 75

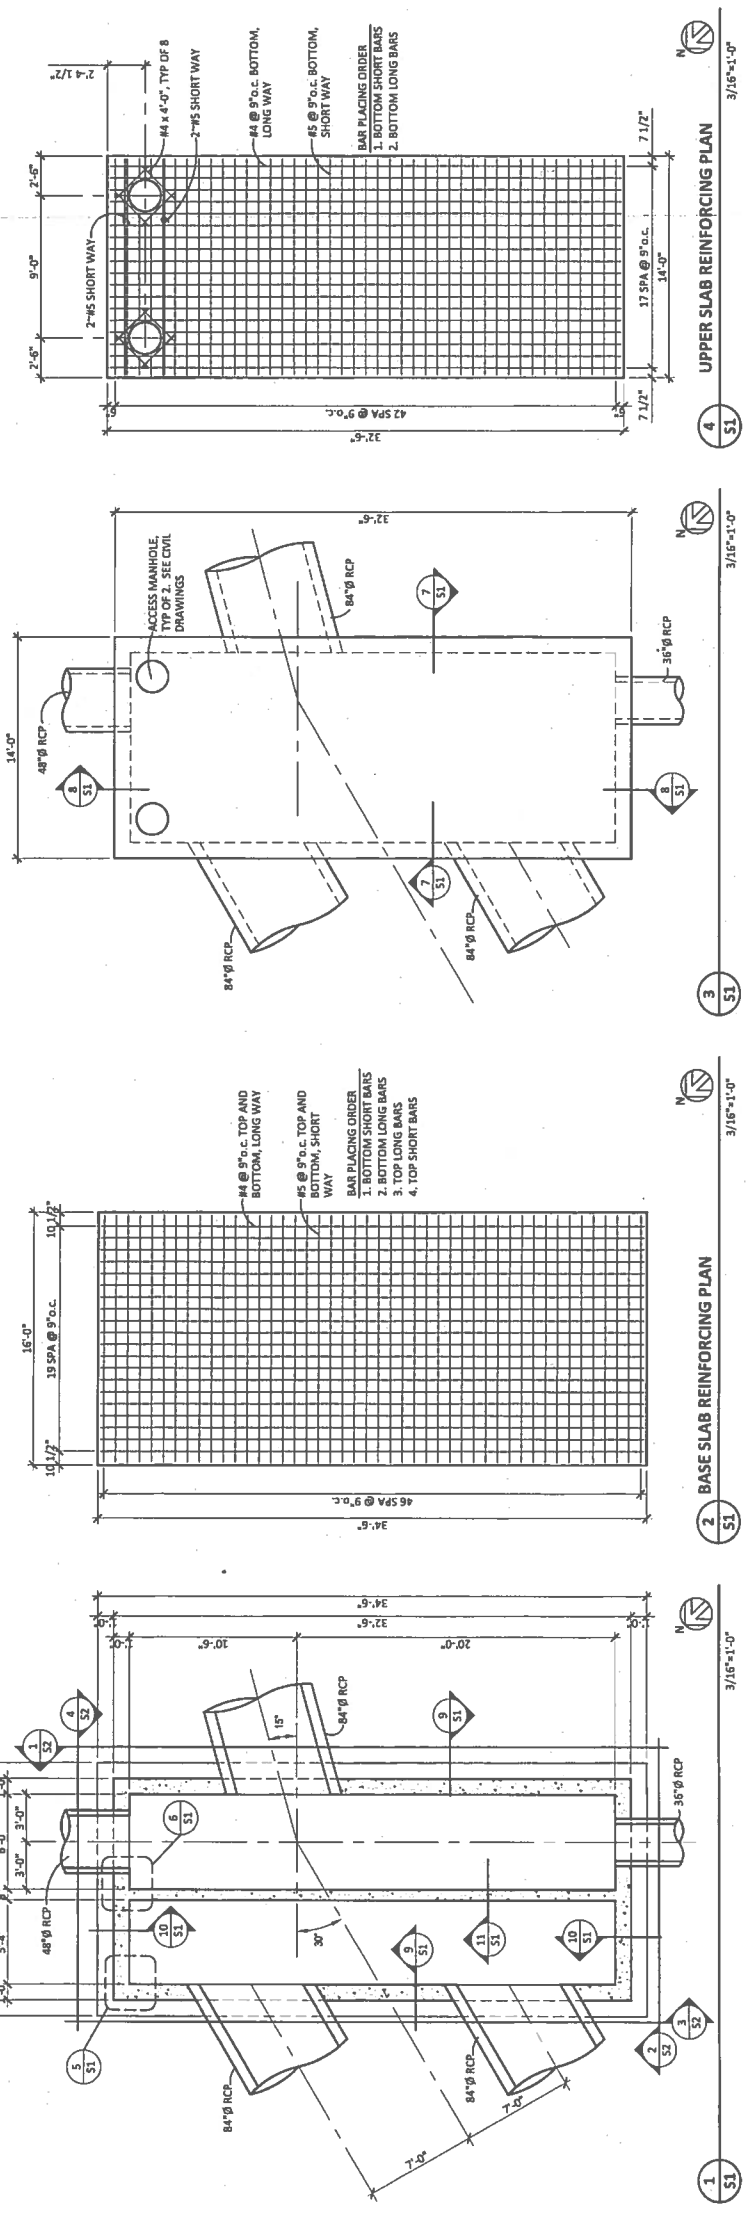

MacCormack Engineering: G17-021 February 15, 2017

AS BUILT INFORMATION	BENCH MARKS	SURVEY INFORMATION	ENGINEER'S SEAL
CONTRACTOR		FIELD NOTES	
WORK STAKED BY DATE		NO. BY DATE	
INSPECTOR'S ACCEPTANCE BY DATE			
FIELD VERIFICATION BY DATE			
DRAWINGS CORRECTED BY DATE			
MICRO-FILM INFORMATION			
RECORDED BY DATE			
NO.			

NO.	DATE	REMARKS	BY

REVISIONS
DESIGN
DESIGNED BY DM DATE
DRAWN BY CB DATE
CHECKED BY DM DATE

MARK GOODWIN & ASSOCIATES, P.A.
CONSULTING ENGINEERS
P.O. BOX 90606
ALBUQUERQUE, NEW MEXICO 87199
OFFICE (505) 828-2200, FAX (505) 797-9539

CITY OF ALBUQUERQUE
PUBLIC WORKS DEPARTMENT

TITLE: JUAN TABO HILLS ESTATES
SD-MHS STRUCTURAL DRAWINGS

DESIGN REVIEW COMMITTEE	CITY ENGINEER APPROVAL	LAST DESIGN UPDATE	MO./DAY/YR.
			MO./DAY/YR.

CITY PROJECT NO. 654887 | ZONE MAP NO. H-21 | SHEET OF 73 75

KEYED NOTES

1. #5 VERT @ 9"o.c. INSIDE FACE, #4 VERT @ 9"o.c. OUTSIDE FACE.
2. 2 ADDITIONAL #5 VERT INSIDE FACE.
3. 3 ADDITIONAL #5 VERT INSIDE FACE.
4. 5 ADDITIONAL #5 VERT INSIDE FACE.
5. 3 ADDITIONAL #4 HORIZ EACH FACE.
6. 3 ADDITIONAL #4 HORIZ x 10'-0" EACH FACE.

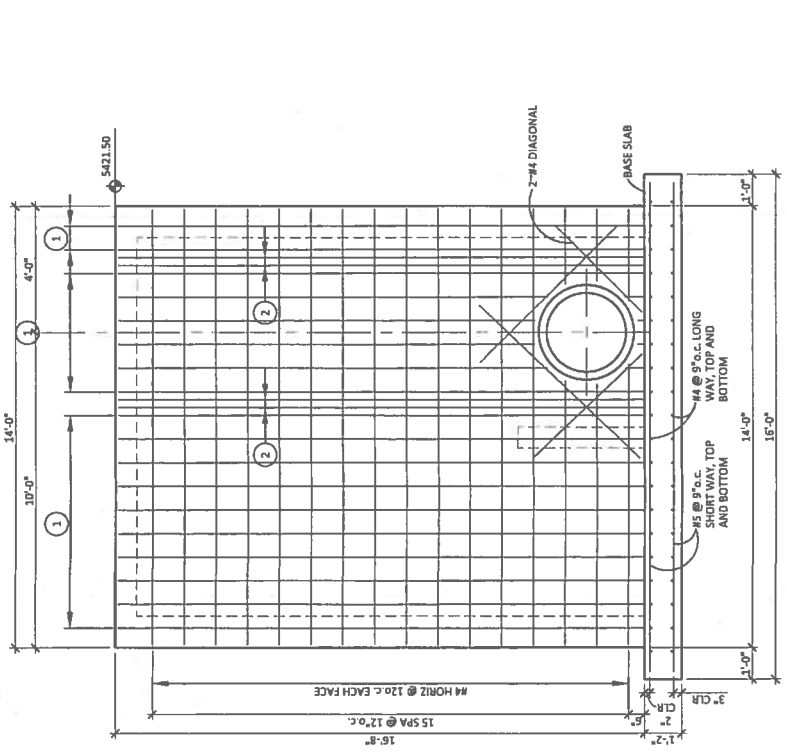

3/8"=1'-0"

2 S2

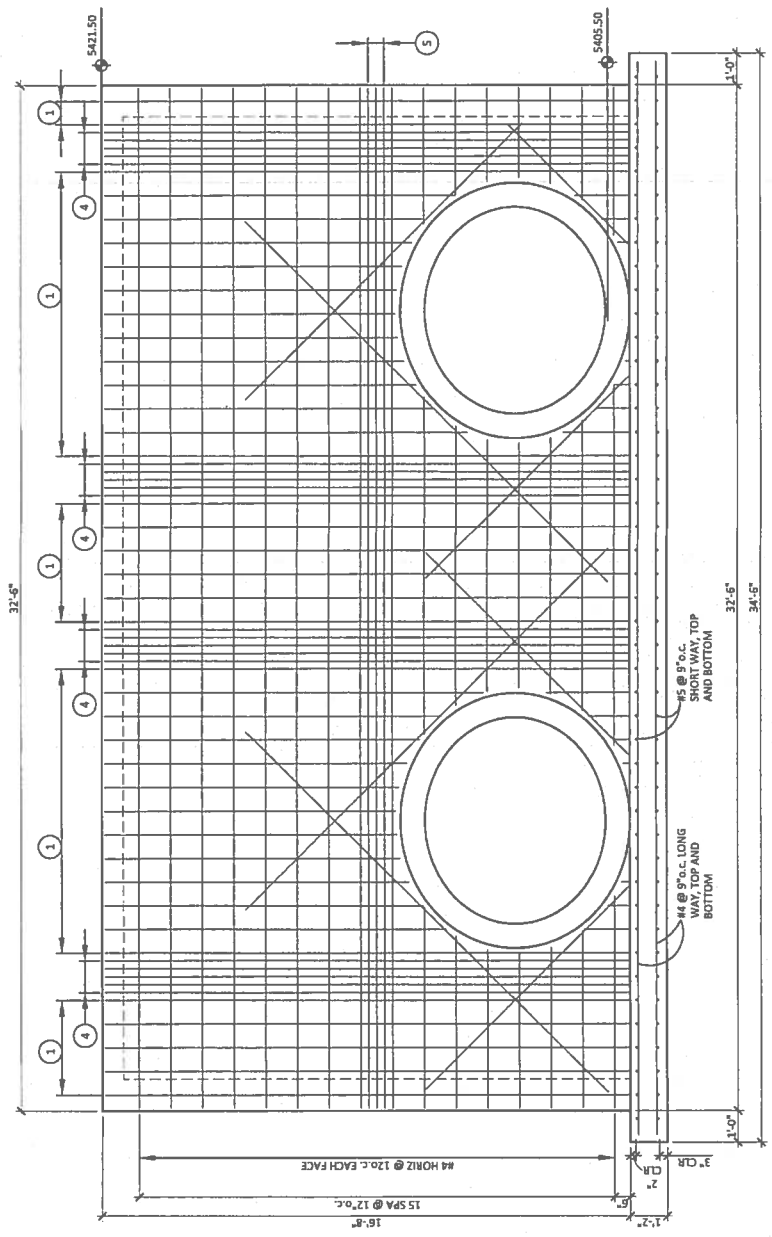

3/8"=1'-0"

4 S2

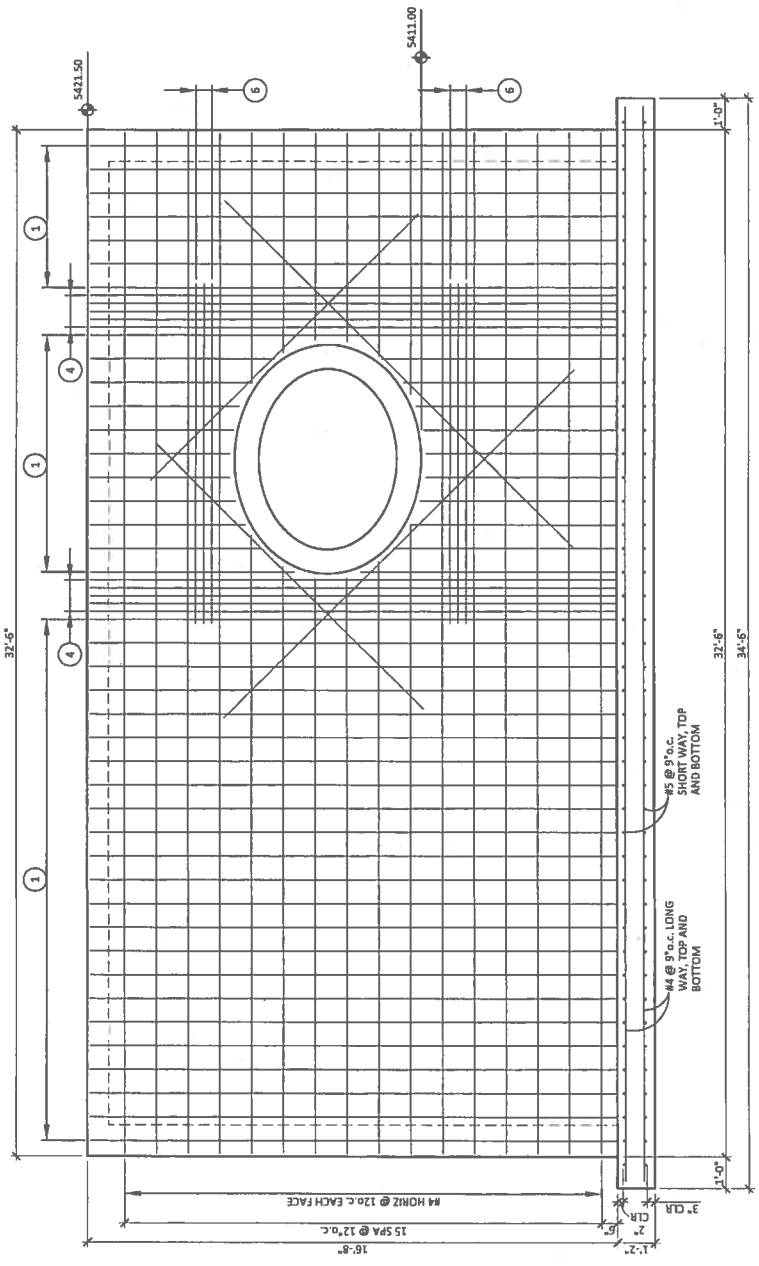

3/8"=1'-0"

1 S2

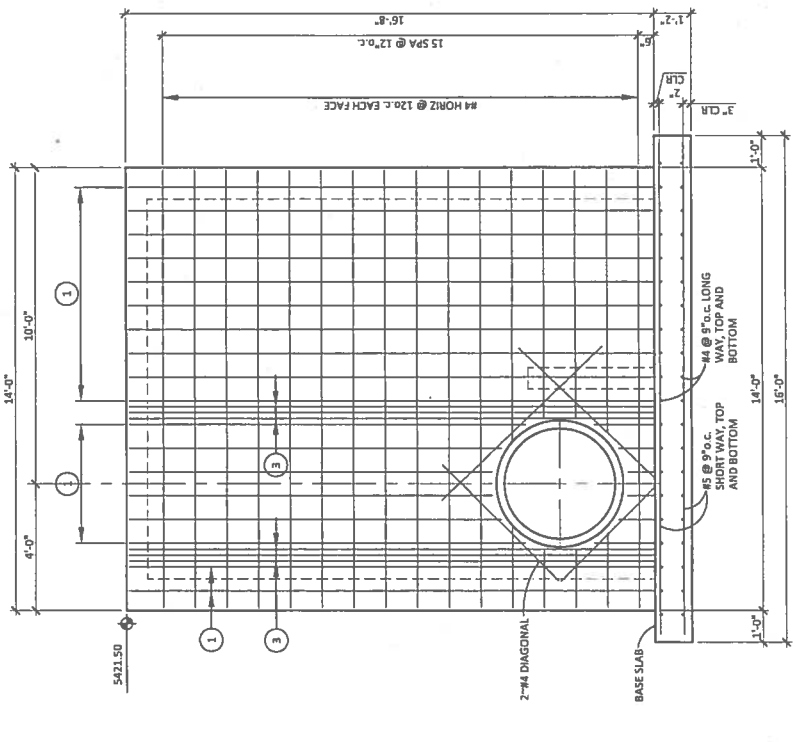

3/8"=1'-0"

3 S2

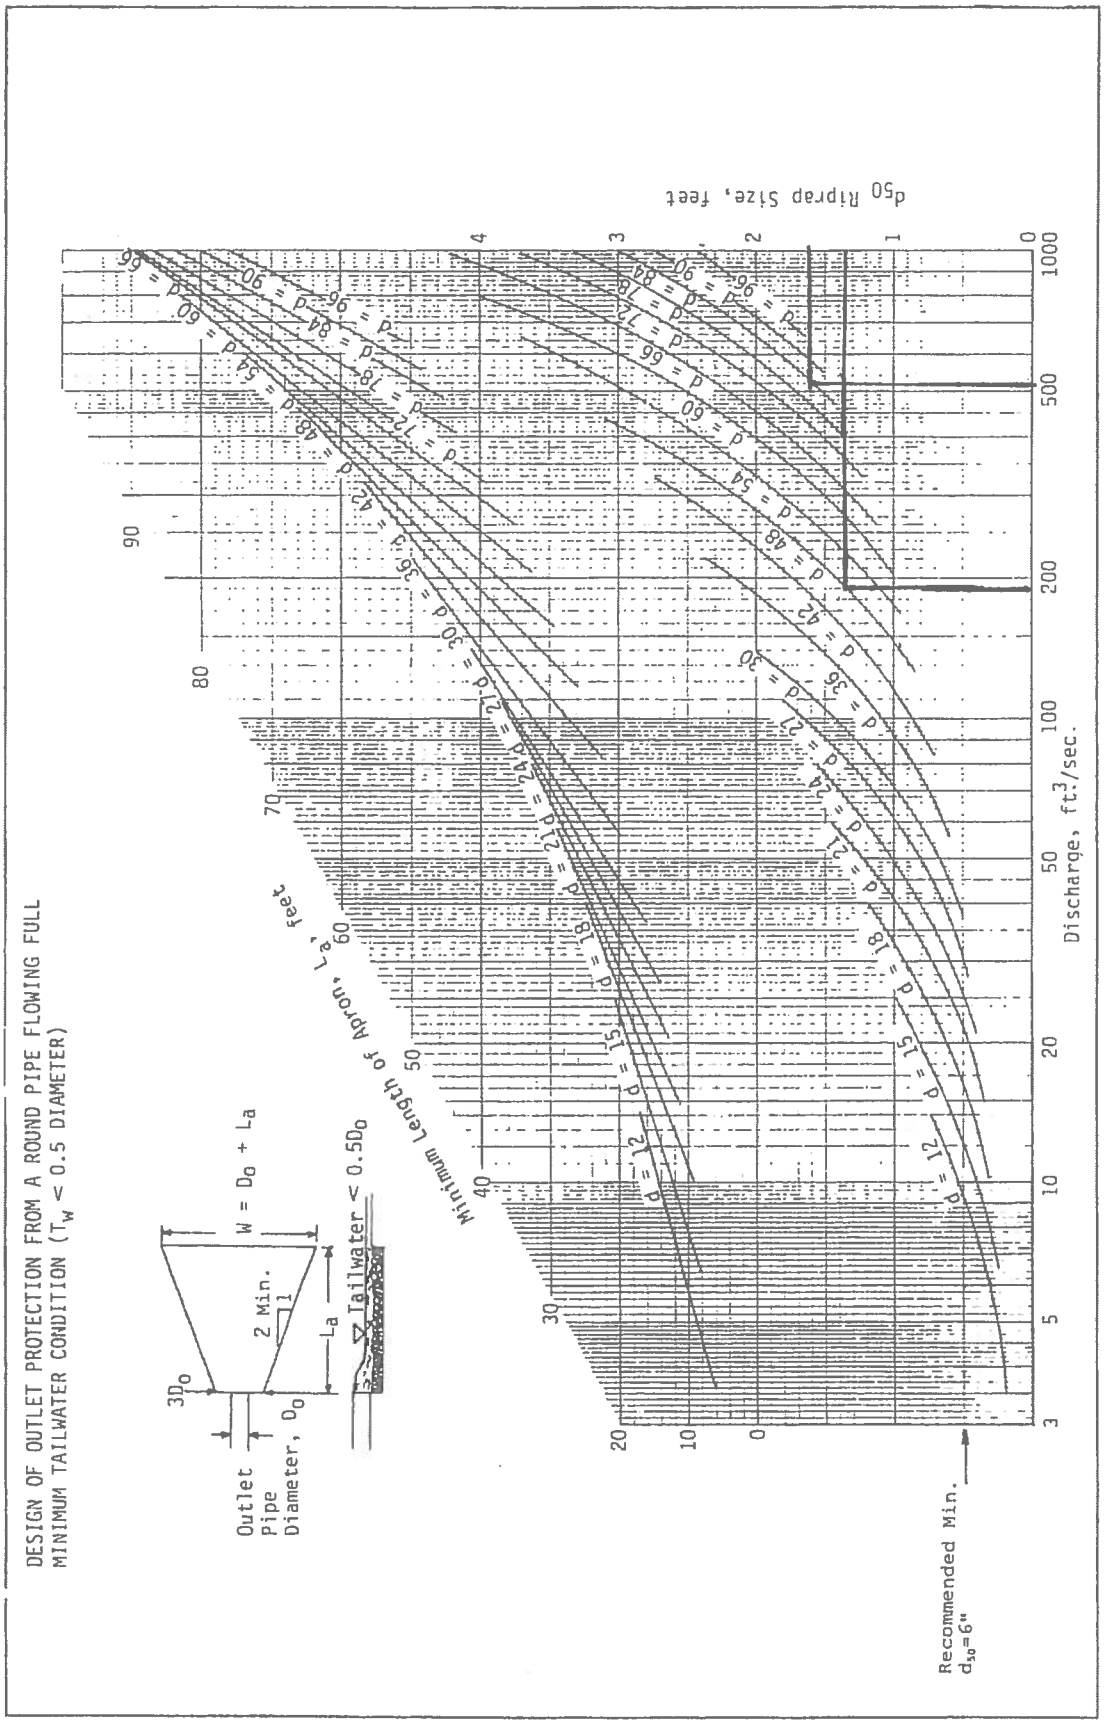

Source: USDA-SCS Plate 3.18-3